





DESIGN STUDIO consultant consultant This sheet is part of a set and is not to be used alone This sheet is not to be used for construction unless the designer's signature appear on drawings and status box indcates drawings have been released for These plans and prints thereof, as instruments of service, are owned by the designer and are for use this project only. Reproduction and/or distribution without the prior written consent of the designer is 4. Copyright Su-Ling Slaton, 2025 Residence Remodeling & Addition GAS METER ELECTRIC METER 130 Vasona Oaks Dr, Los Gatos, CA 95032 # description date planning comments response 6.9.202 planning comments resp. 6.19.2025 client review plan check construction 4.19.2024 AS NOTED


EXHIBIT 9

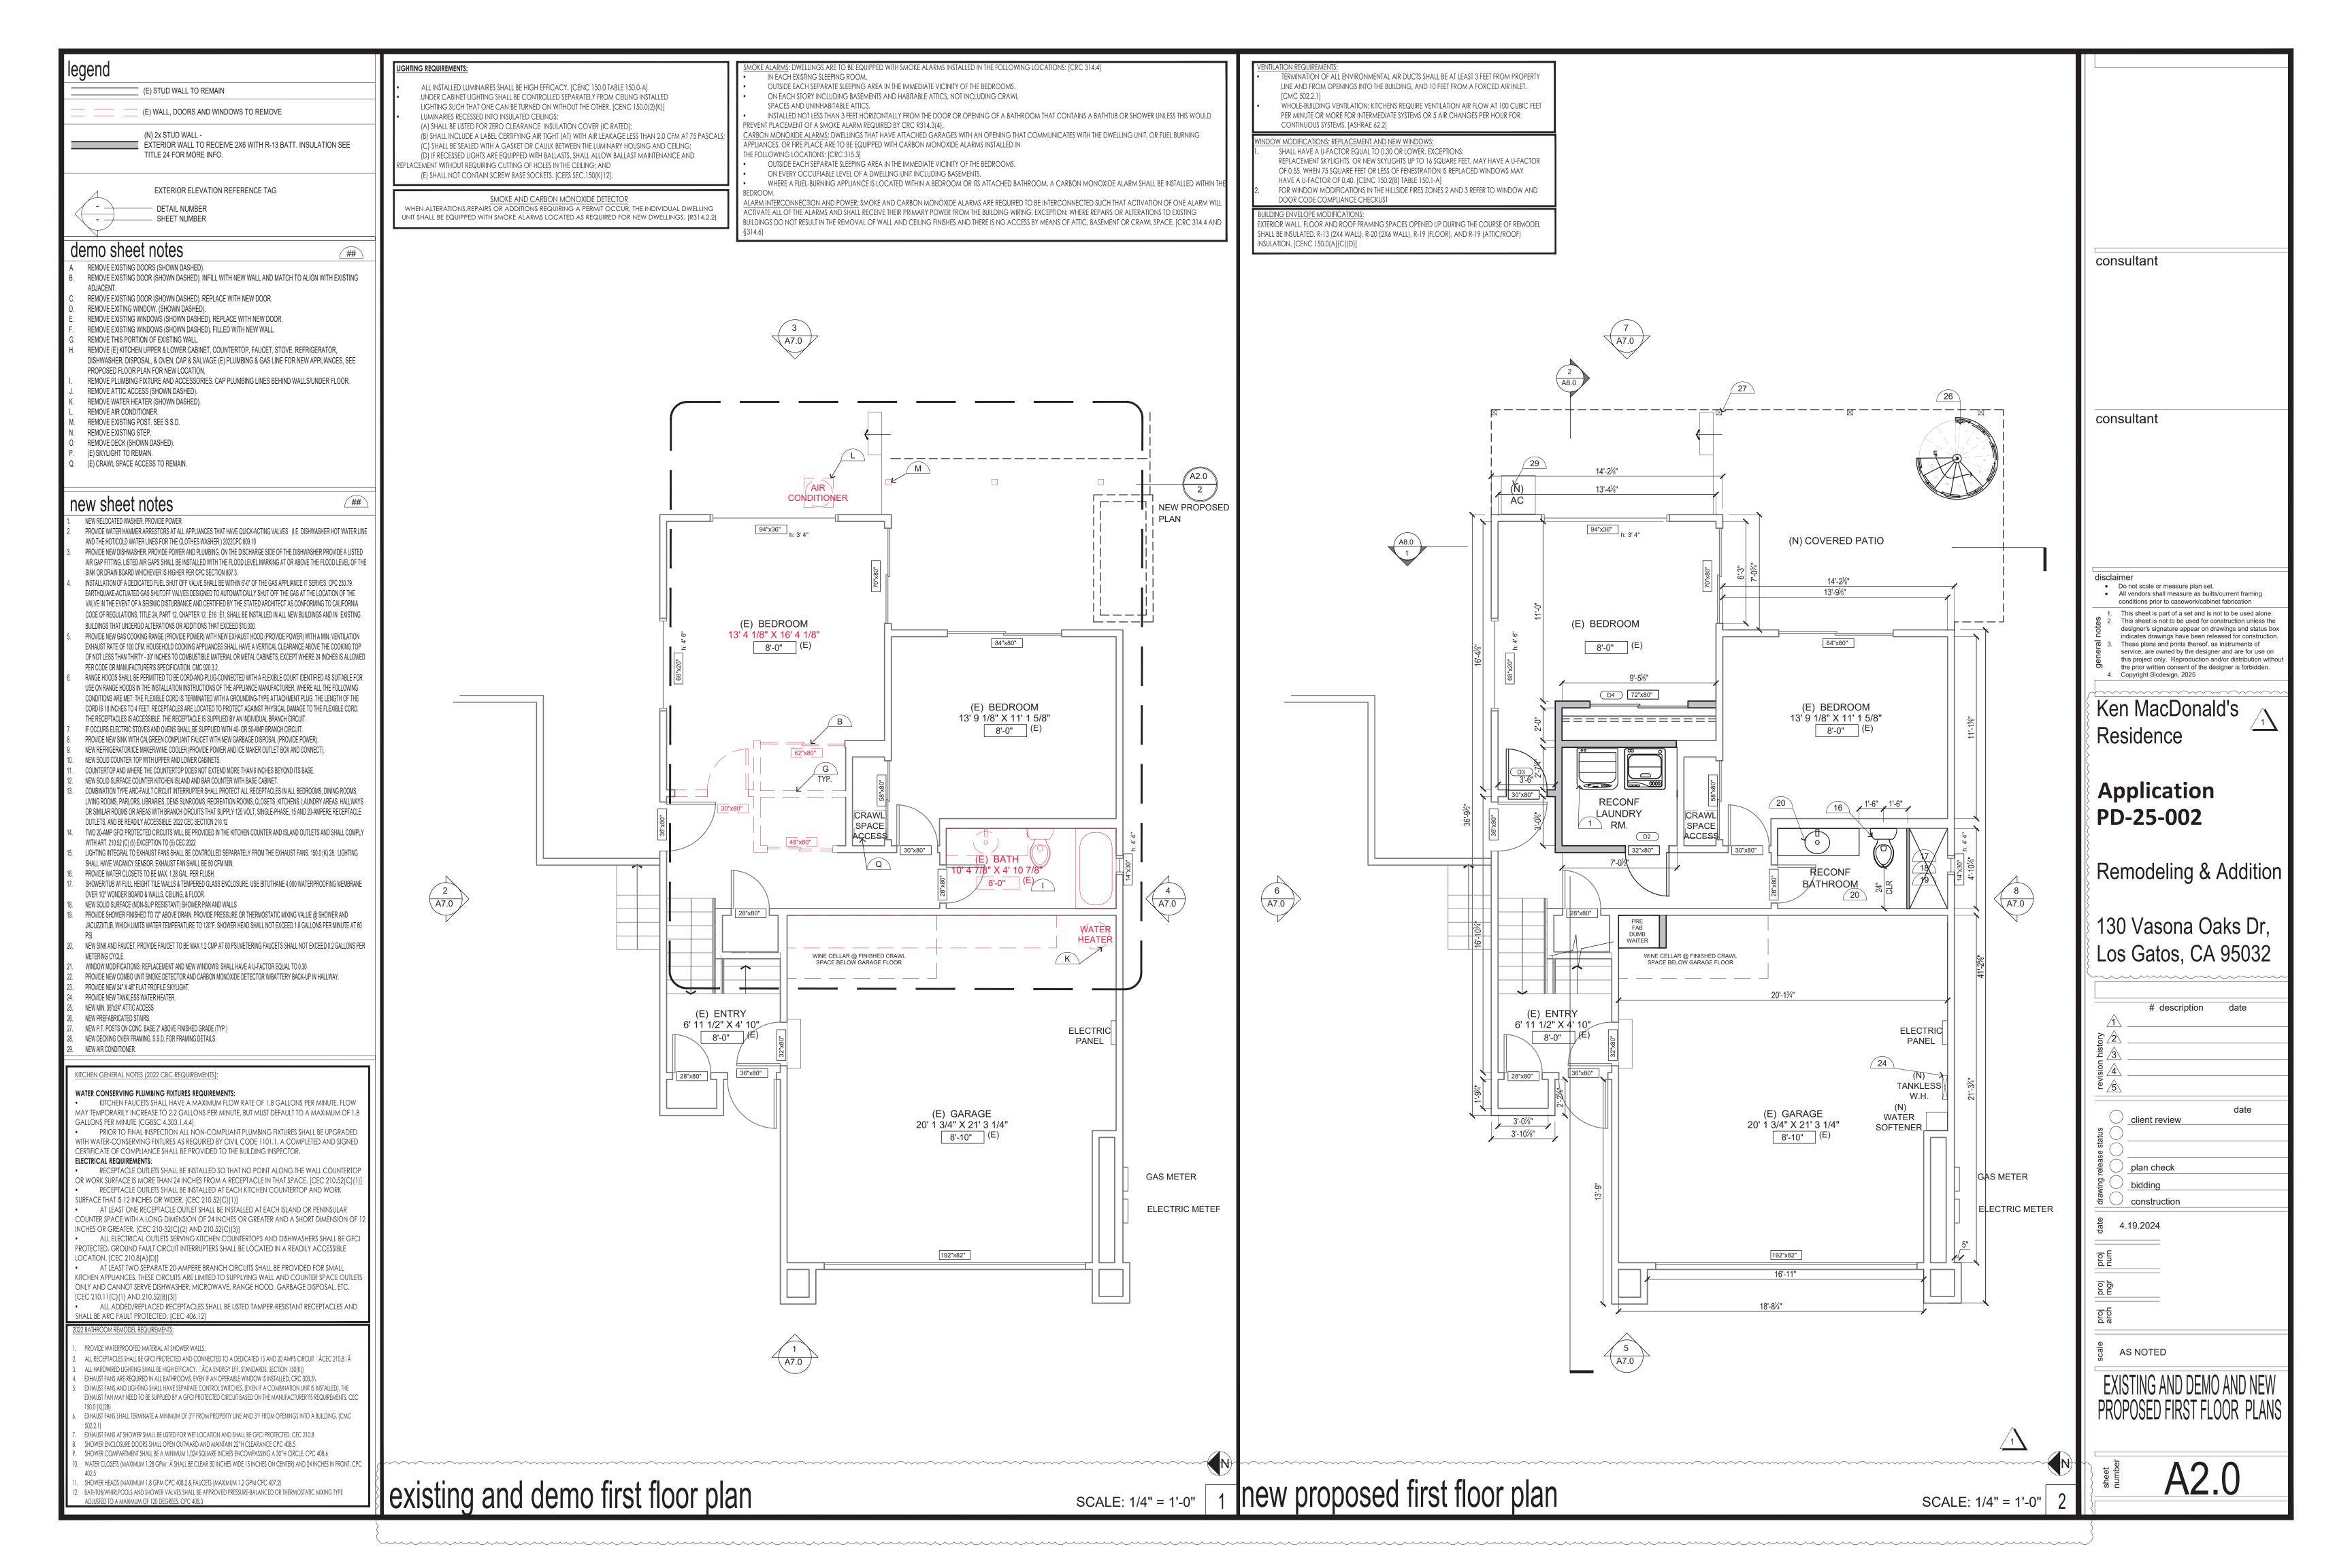


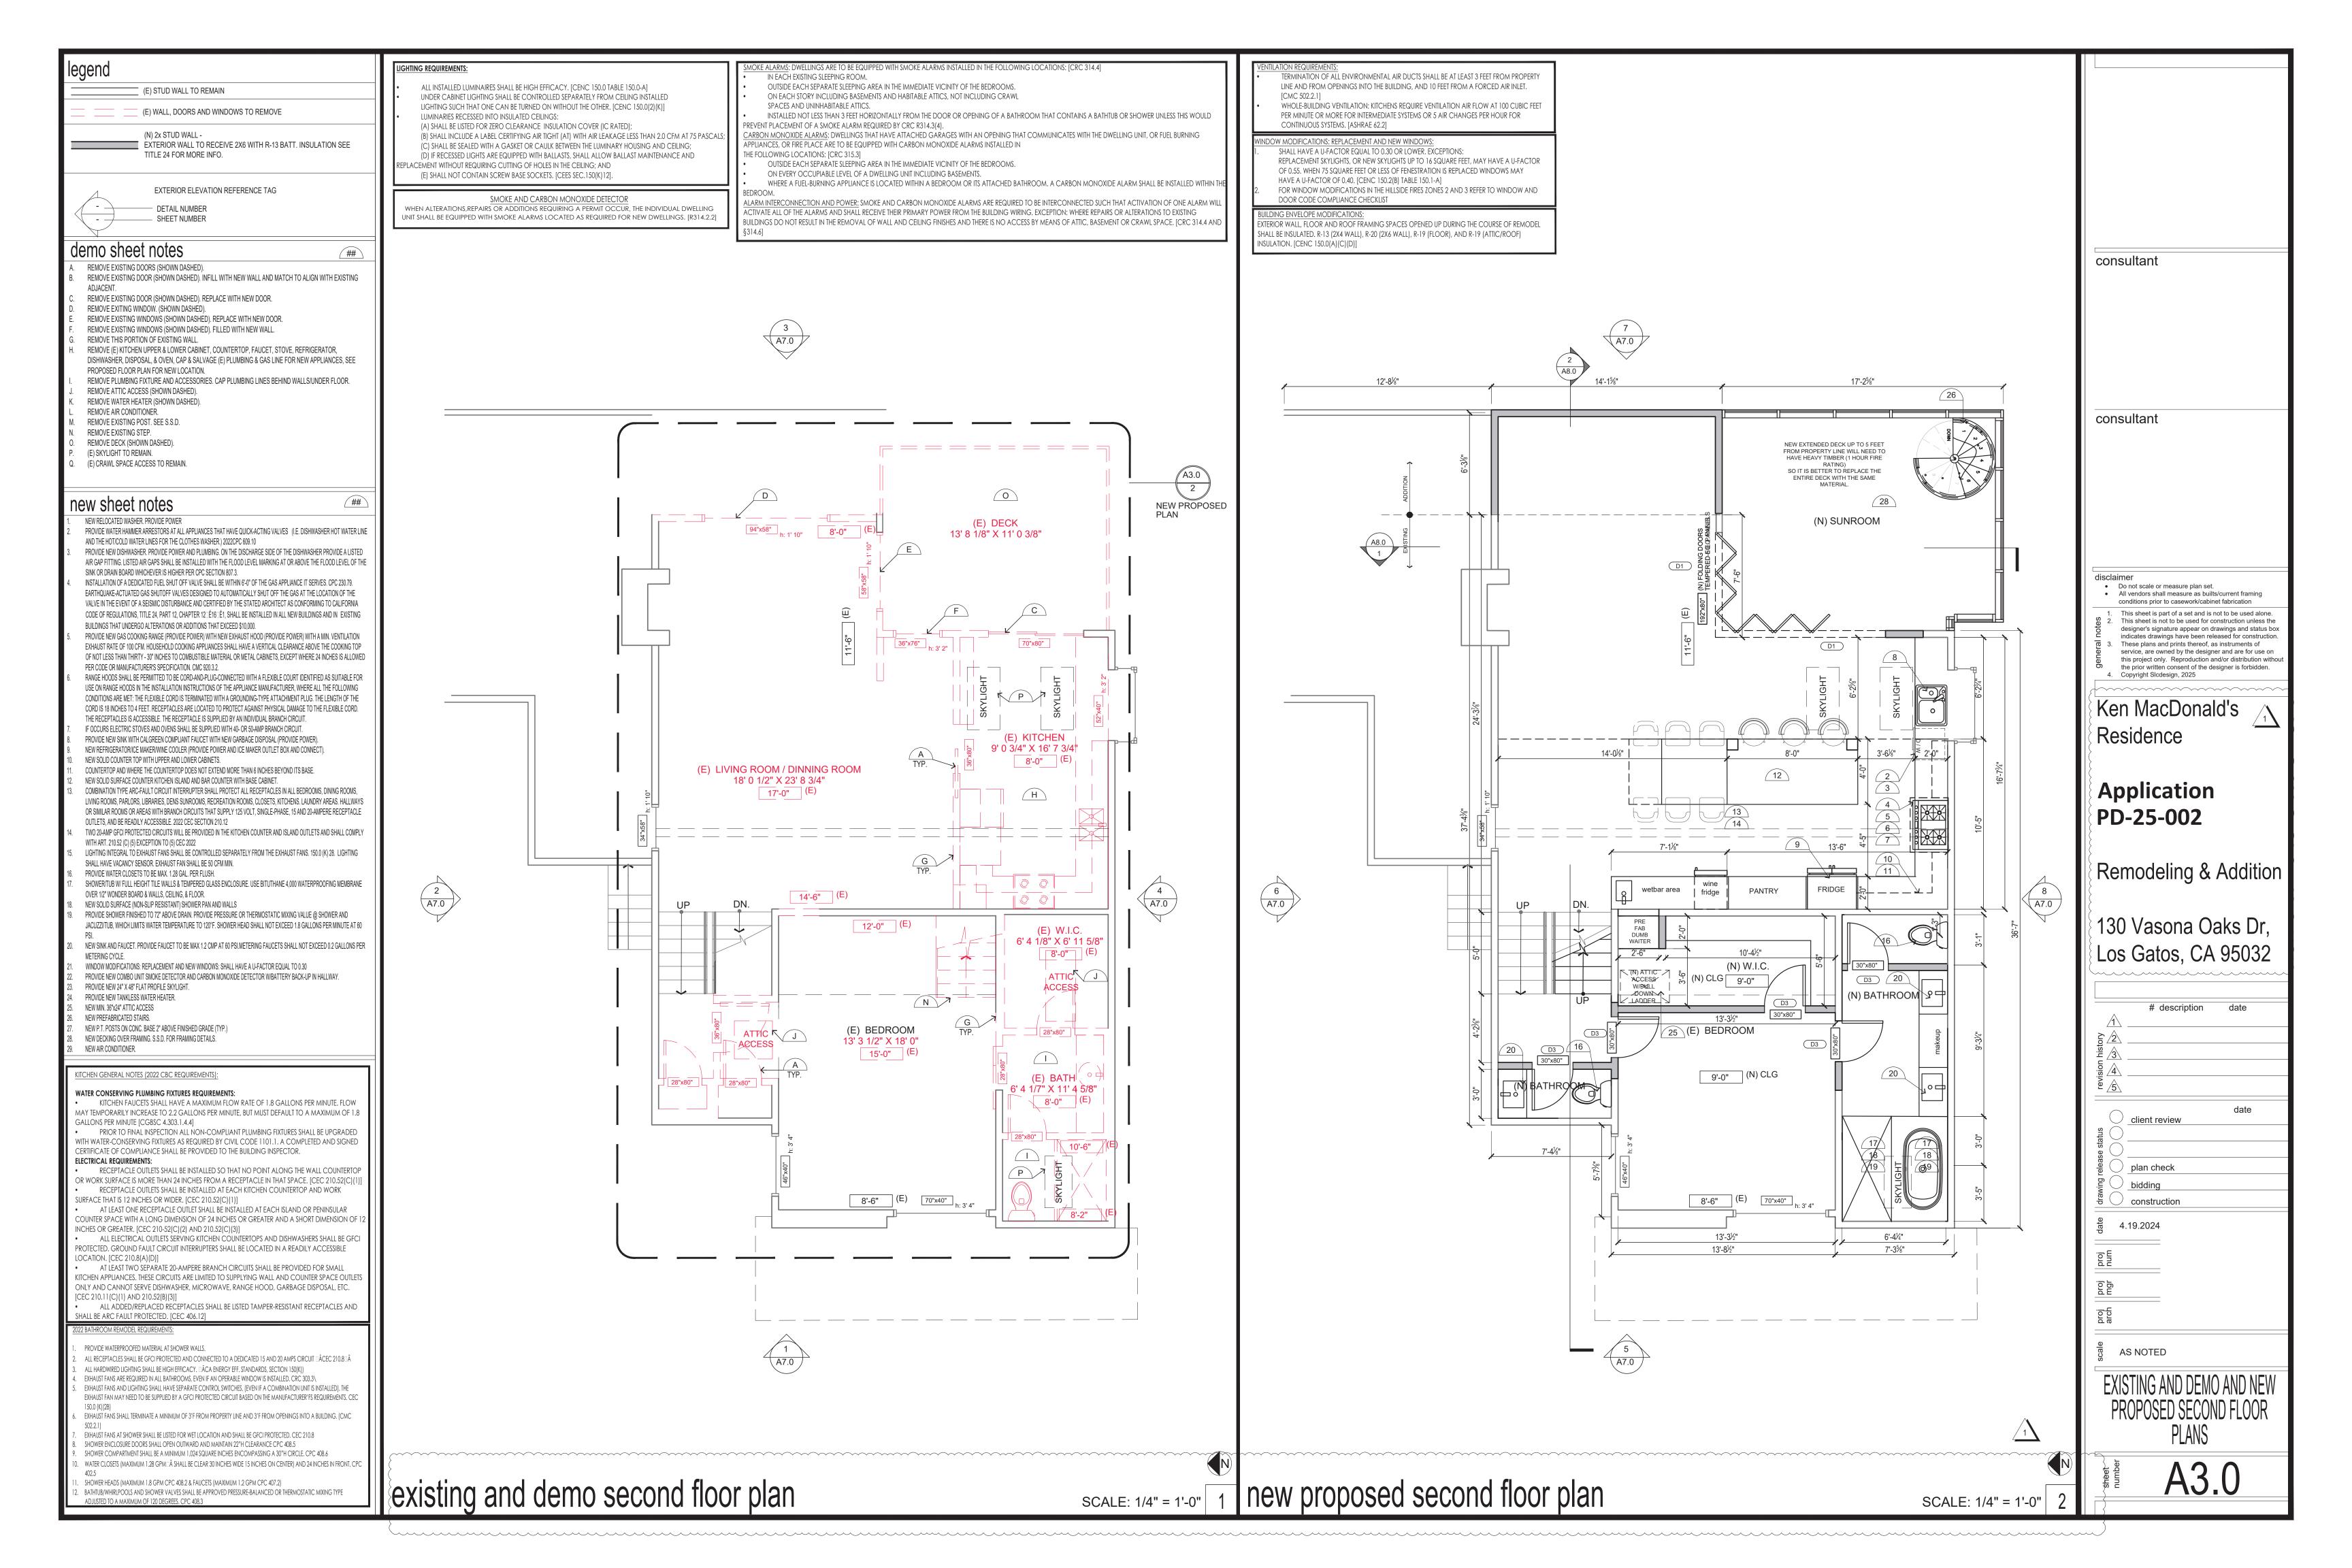

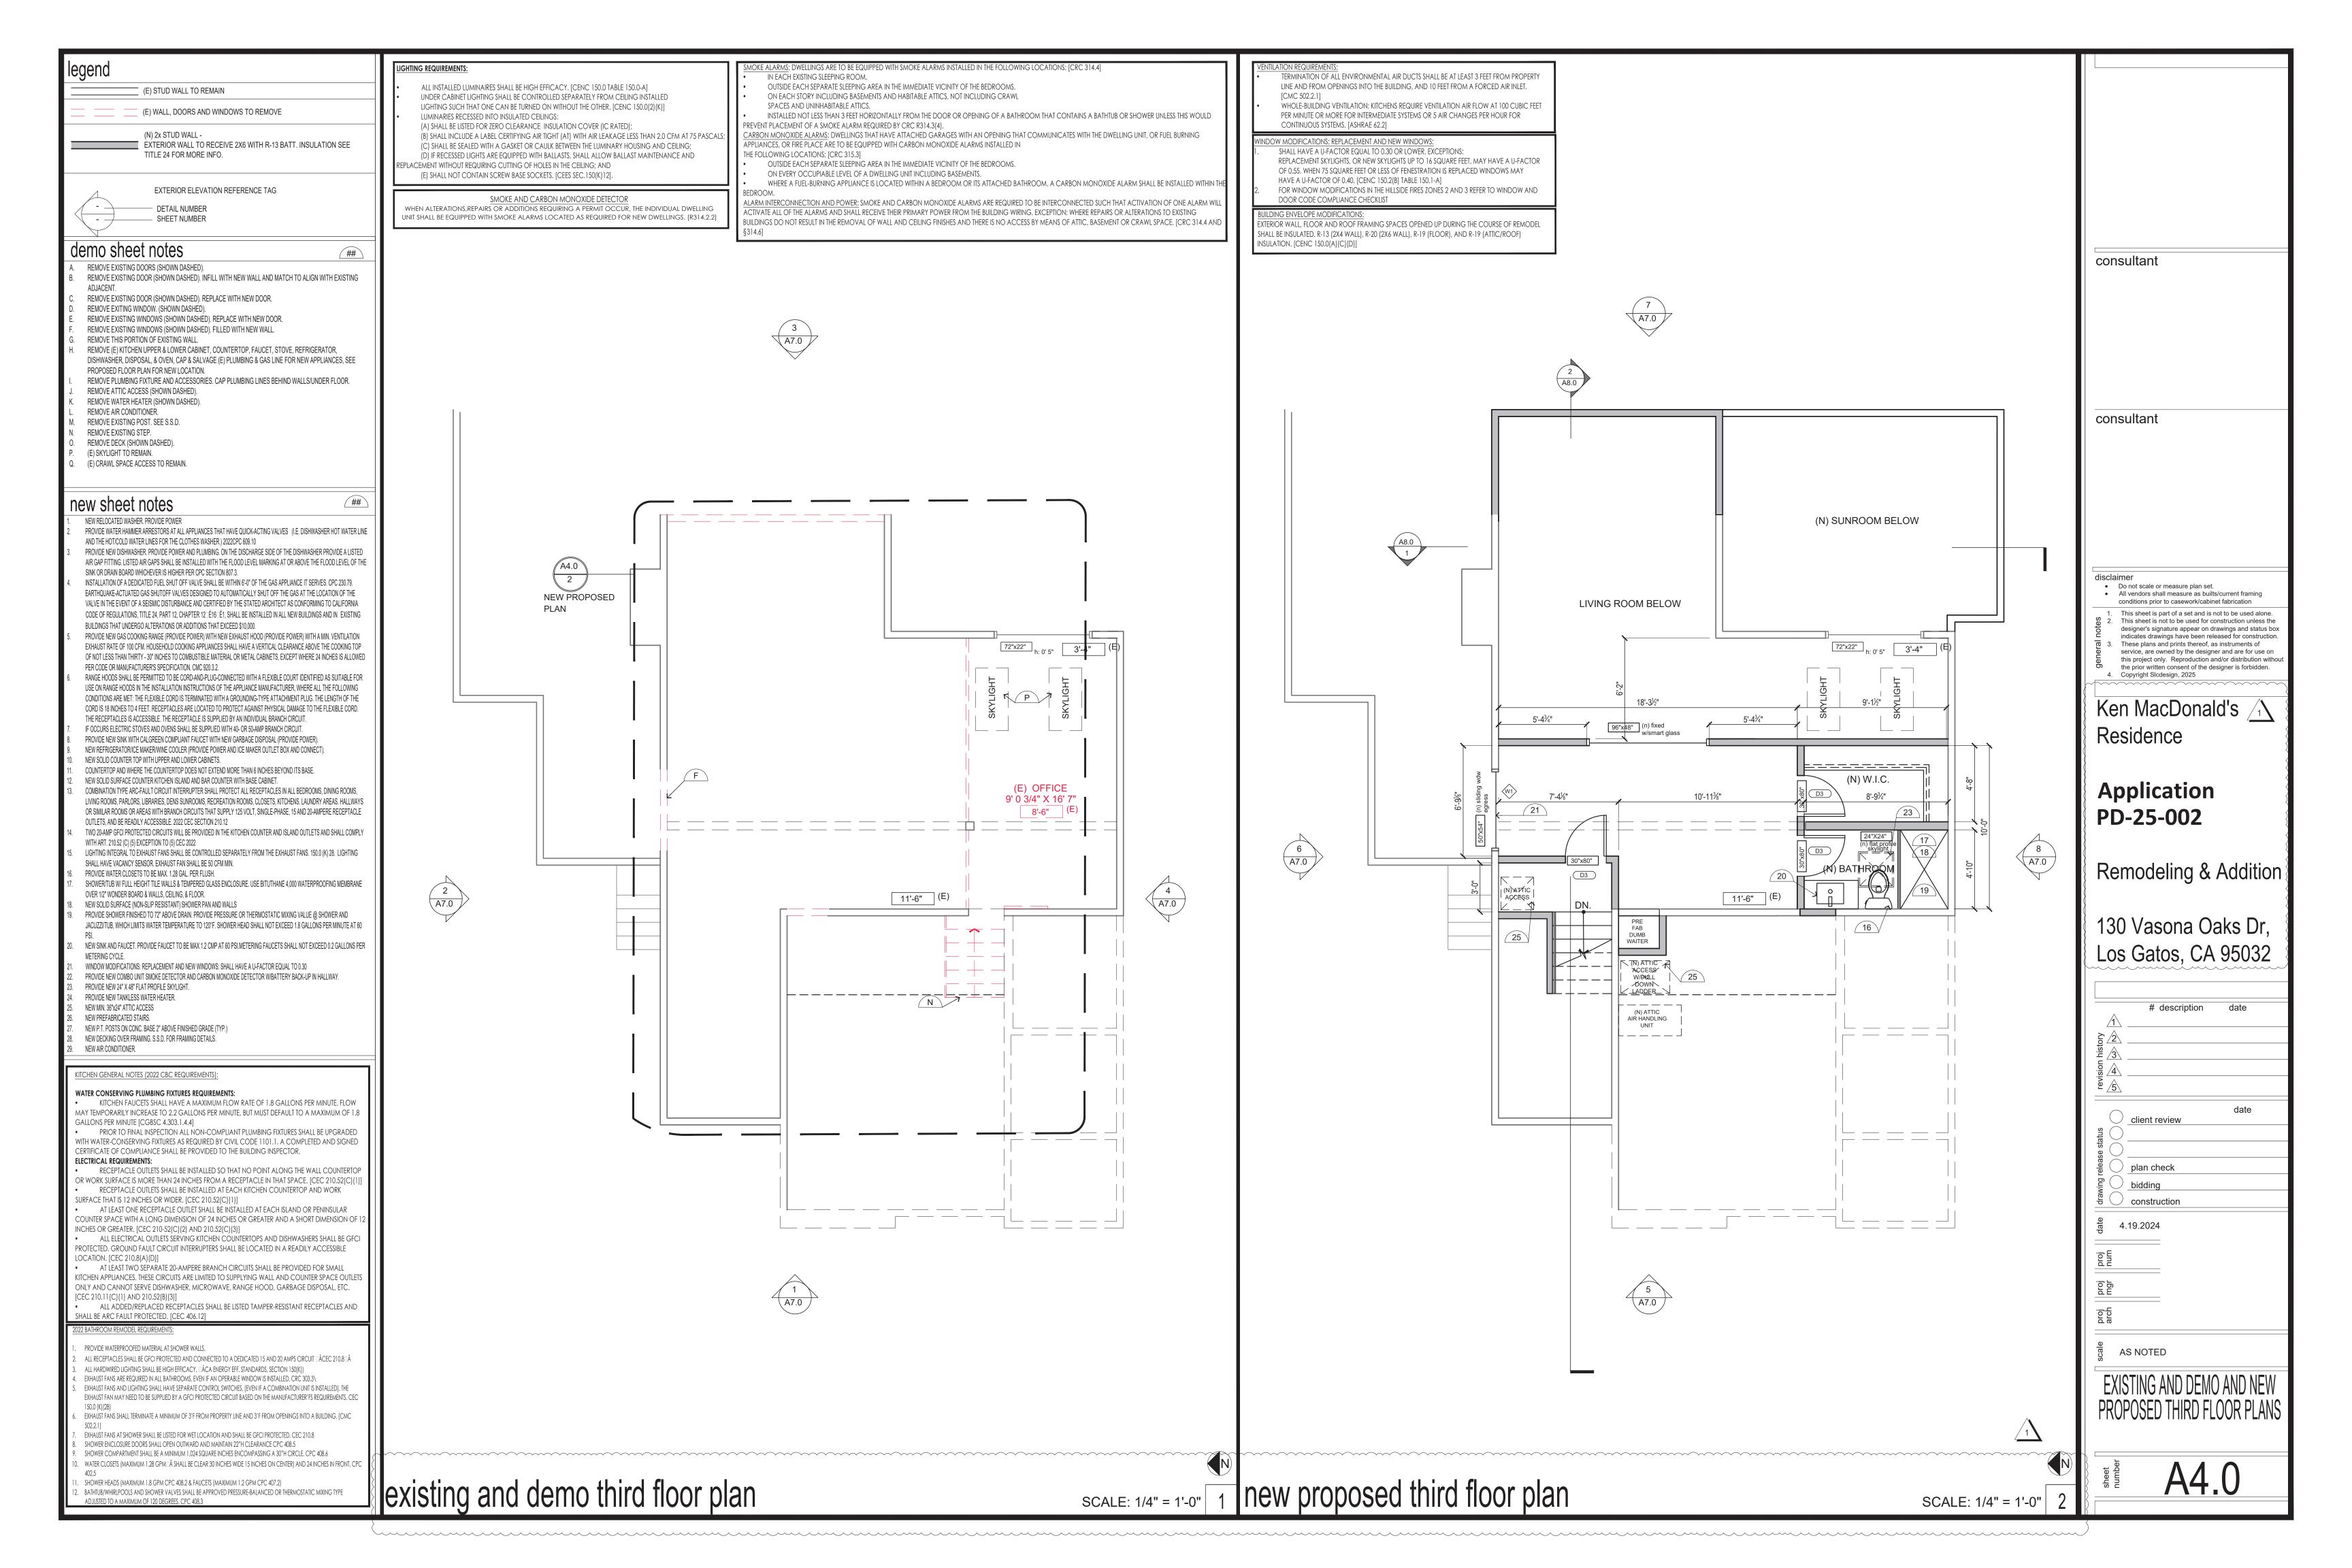

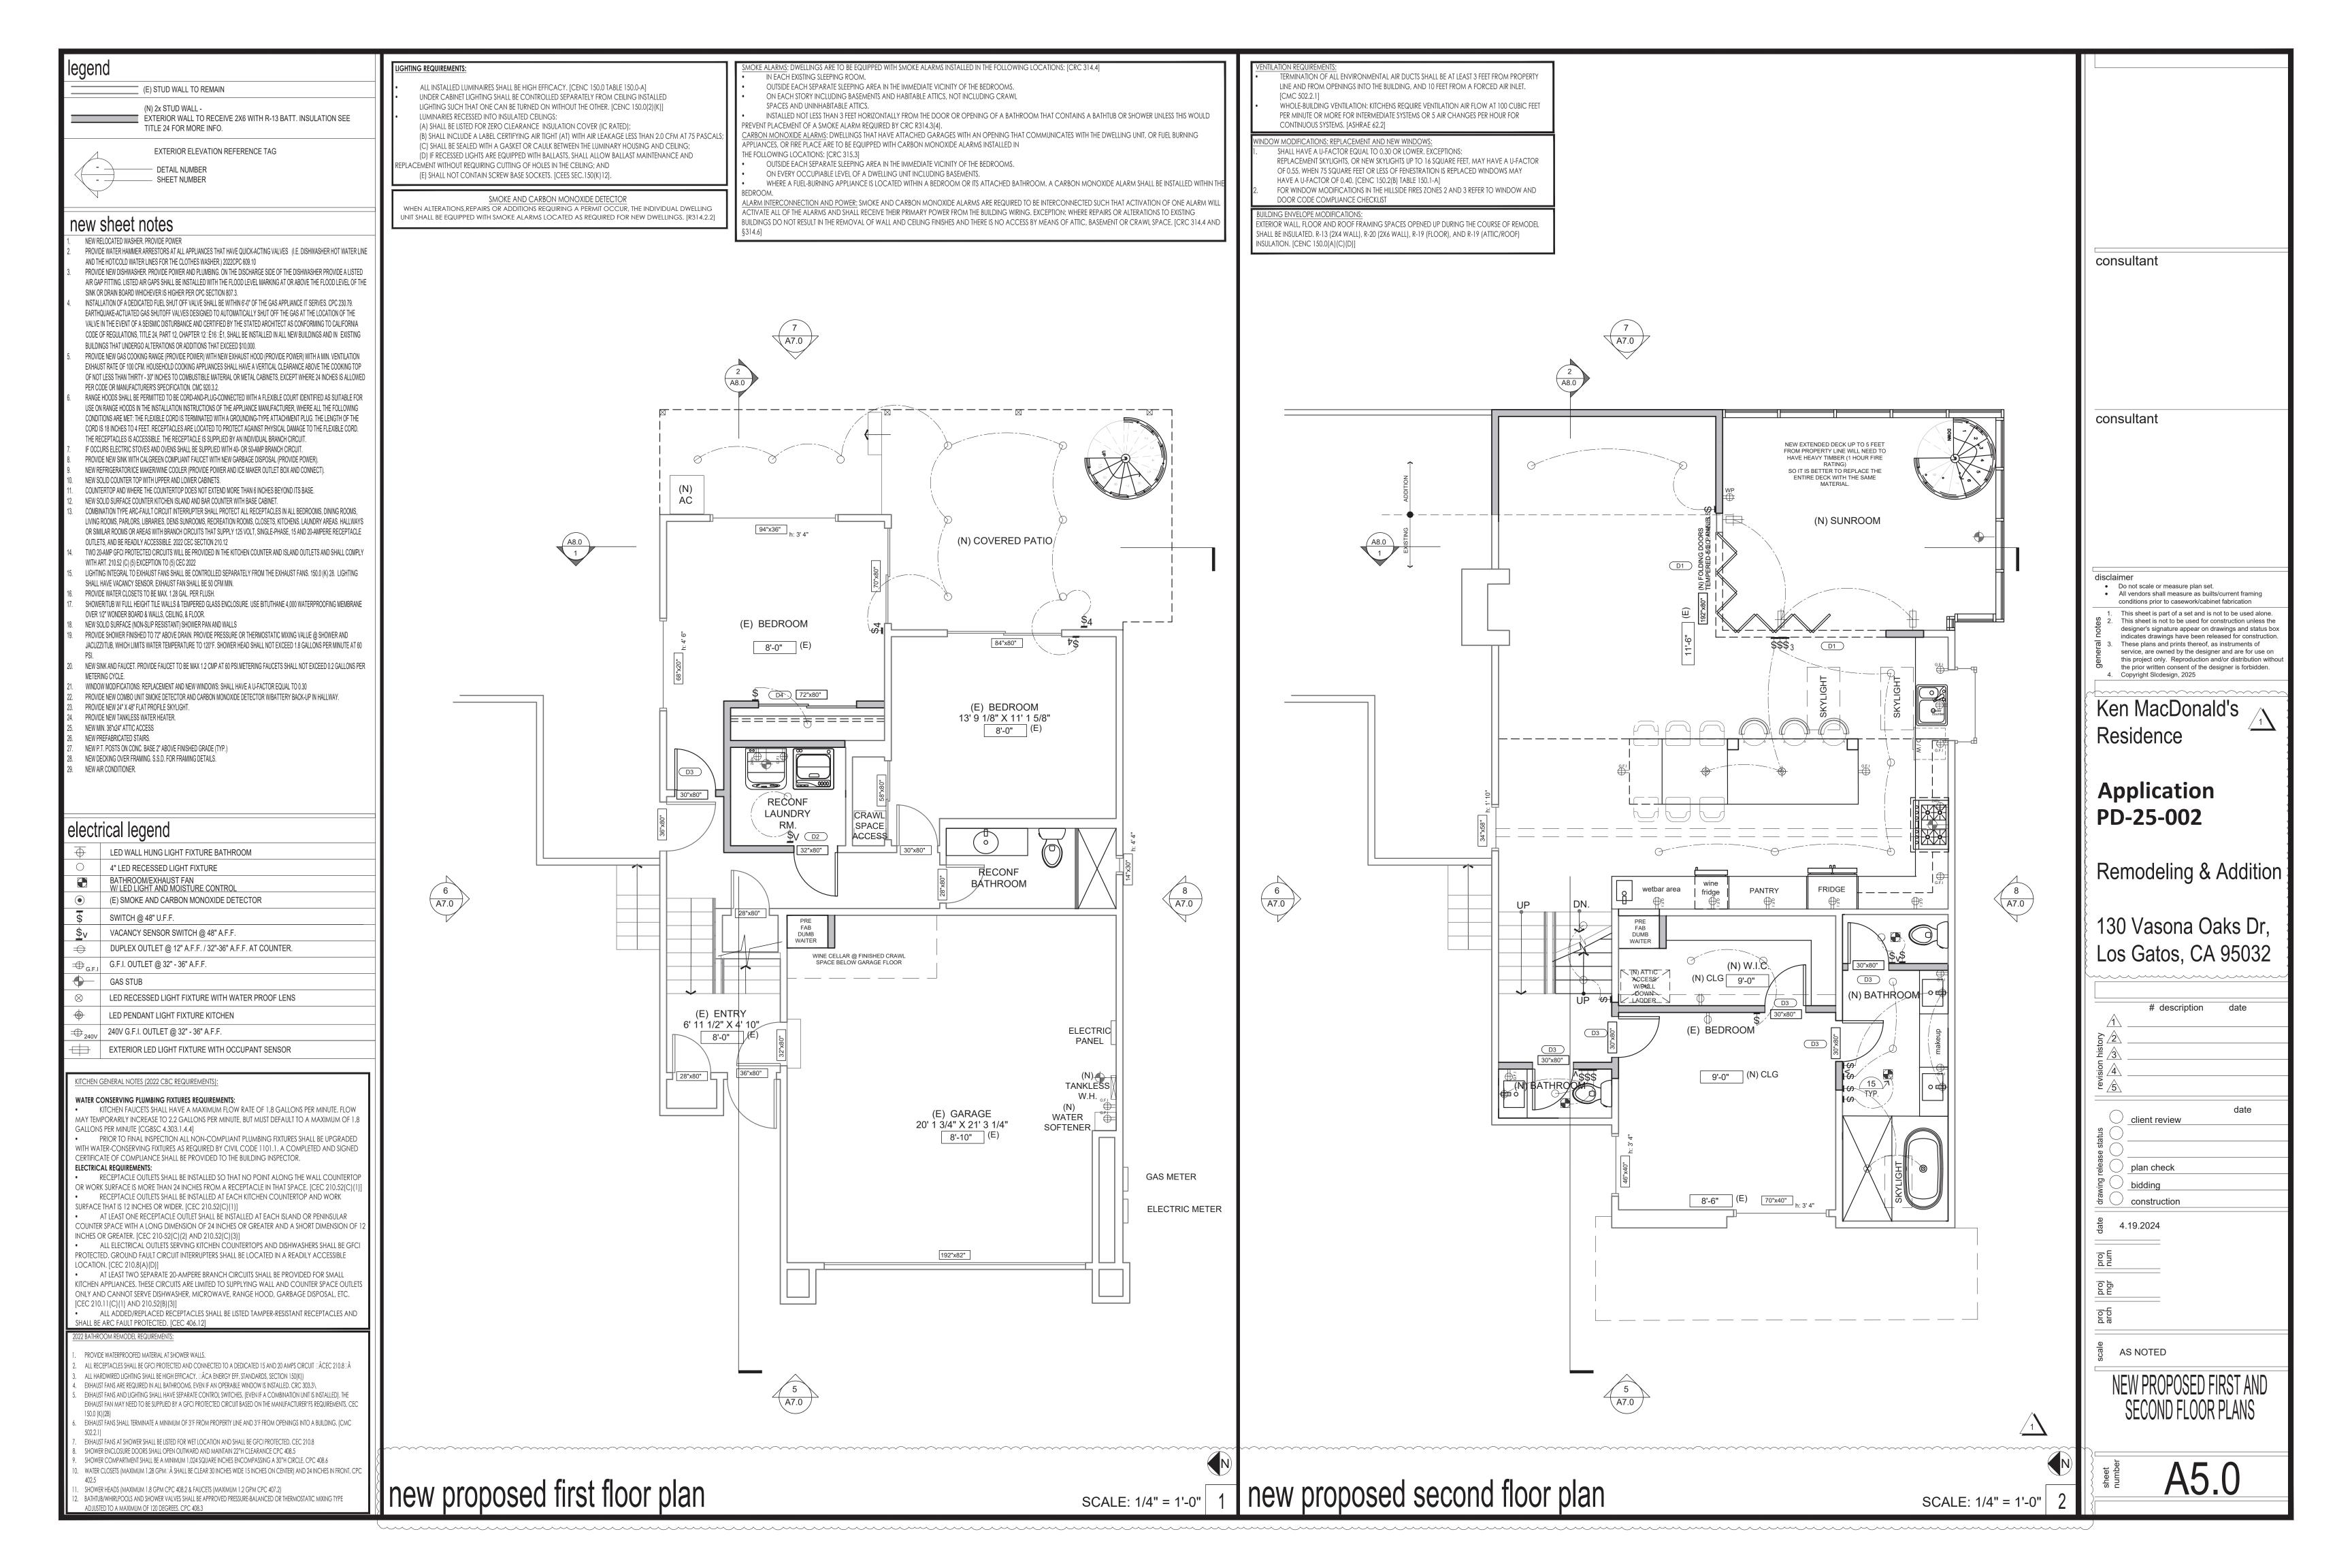

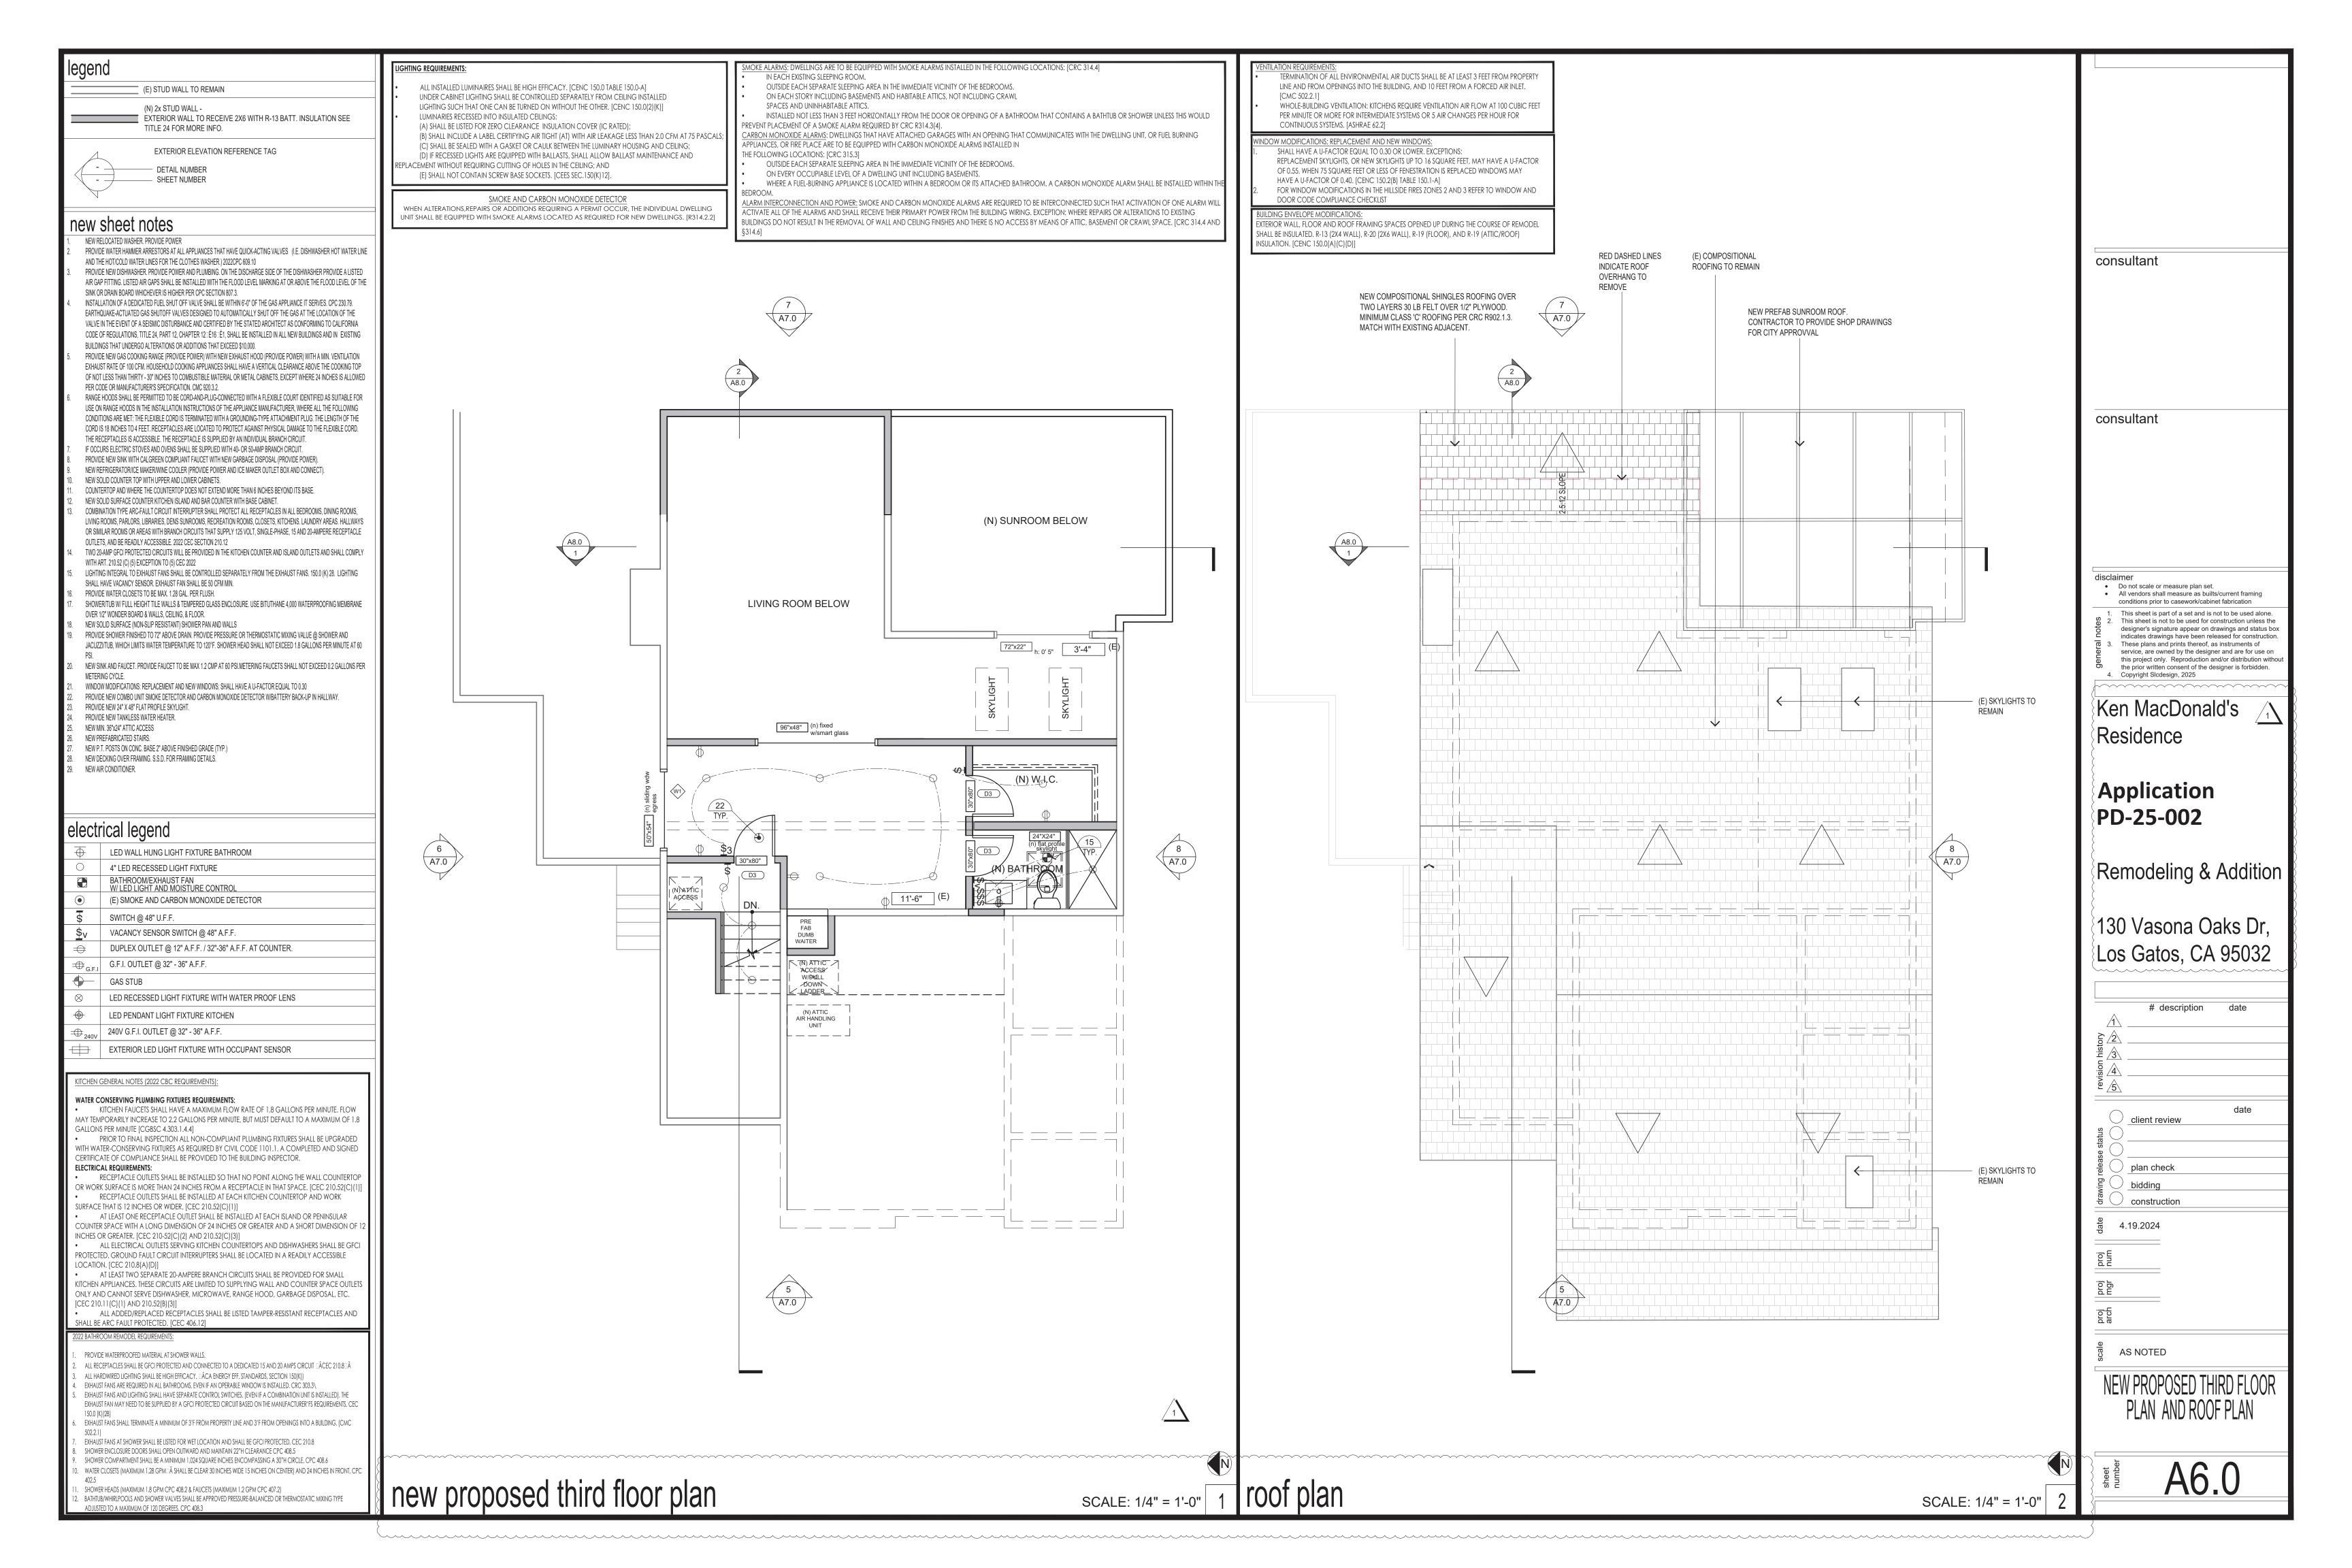

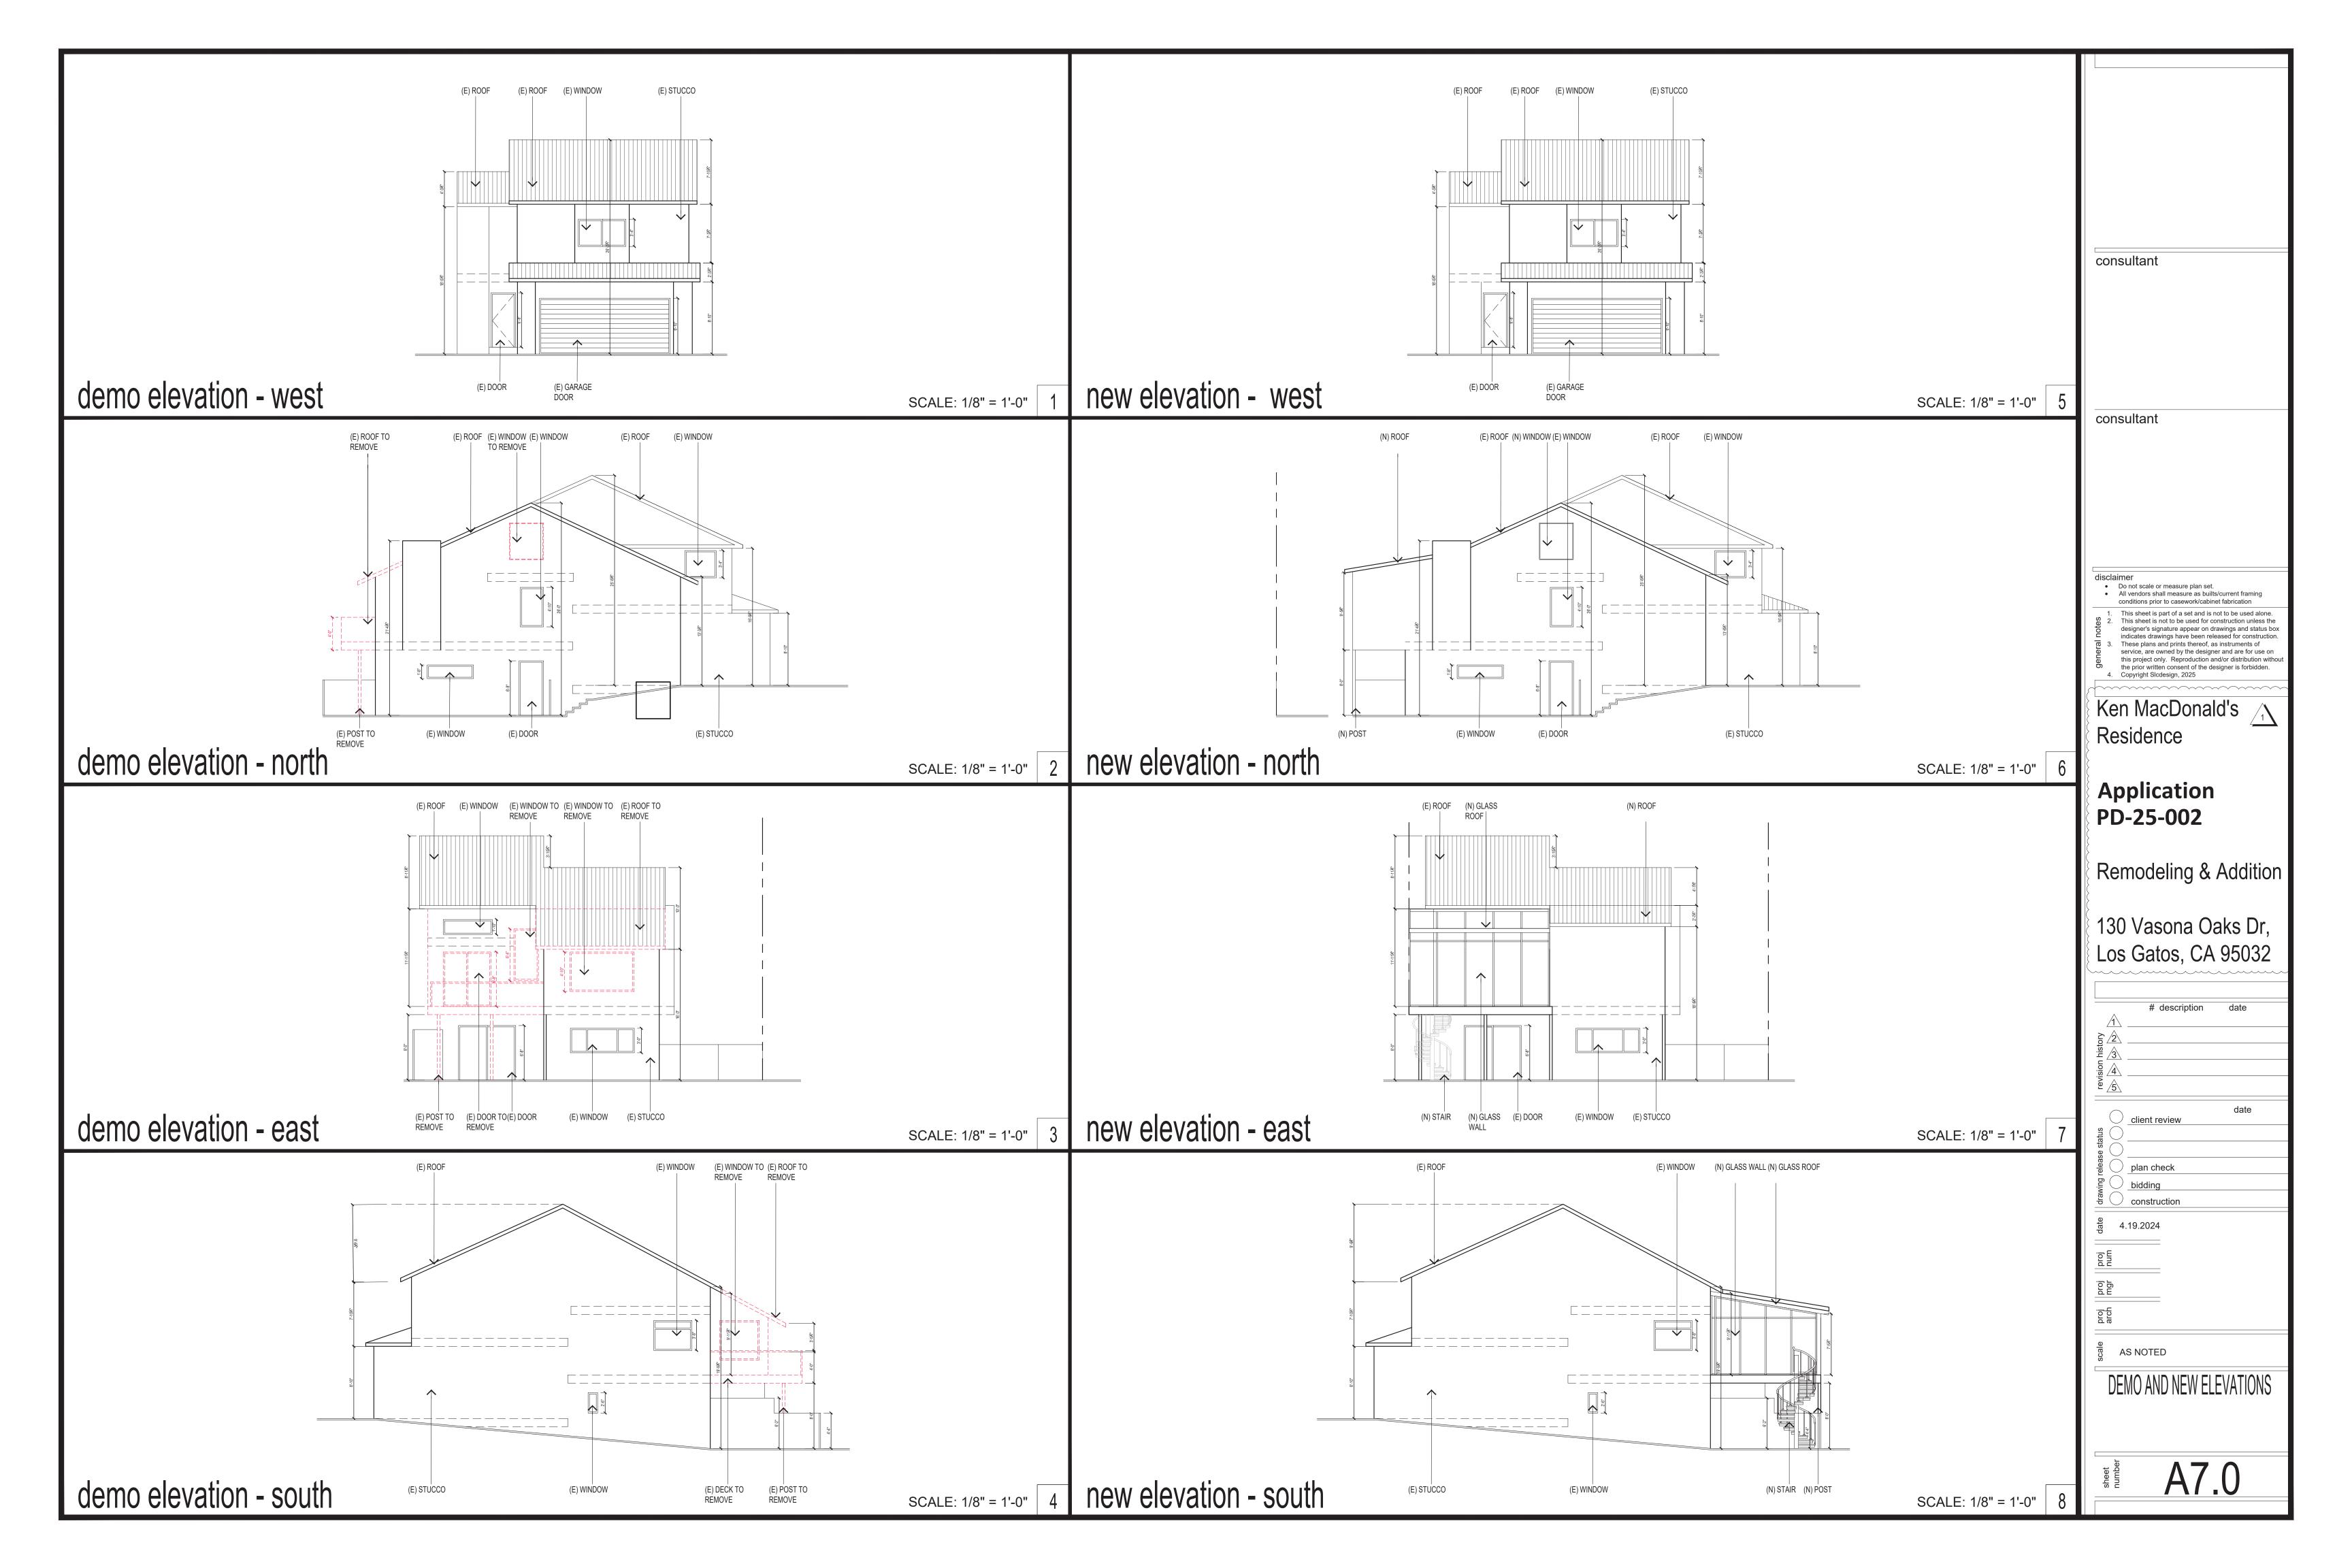


stair general notes

- . STAIR TREADS AND RISERS: STAIR RISER HEIGHTS SHALL BE 7 $rac{3}{4}$ INCHES MAXIMUM AND 4 INCHES MINIMUM. STAIR TREAD DEPTHS SHALL BE 10 INCHES MINIMUM. THE RISER HEIGHT SHALL BE MEASURED VERTICALLY BETWEEN THE LEADING EDGES OF ADJACENT TREADS. THE TREAD DEPTH SHALL BE MEASURED HORIZONTALLY BETWEEN THE VERTICAL PLANES OF THE FOREMOST PROJECTION OF ADJACENT TREADS AND AT A RIGHT ANGLE TO THE TREAD'S LEADING EDGE. WINDER TREADS SHALL HAVE A MINIMUM TREAD DEPTH OF 10 INCHES MEASURED AT A RIGHT ANGLE TO THE TREAD'S LEADING EDGE AT THE WALKLINE. WINDER TREADS SHALL HAVE A MINIMUM TREAD DEPTH OF 6" AT ANY POINT IN THE CLEAR WIDTH OF THE STAIR.
- STAIRWAY LANDINGS: THERE SHALL BE A FLOOR OR LANDING AT THE TOP AND BOTTOM OF EACH STAIRWAY. THE WIDTH OF THE LANDINGS SHALL NOT BE LESS THAN THE WIDTH OF STAIRWAYS THEY SERVE. EVERY LANDING SHALL HAVE A MINIMUM DIMENSION OF 36" MEASURED IN THE DIRECTION OF TRAVEL.
- . ENCLOSURES UNDER STAIRWAYS. THE WALLS AND CEILING WITHIN ENCLOSED USABLE SPACES UNDER ENCLOSED AND UNENCLOSED STAIR- WAYS SHALL BE PROTECTED ON THE ENCLOSED SIDE WITH % INCH GYPSUM BOARD. THERE SHALL BE NO ENCLOSED USABLE SPACE UNDER EXTERIOR EXIT STAIRWAYS UNLESS THE SPACE IS COMPLETELY EN- CLOSED IN 1-HOUR FIRE-RESISTIVE RATED CONSTRUCTION. THE OPEN SPACE UNDER EXTERIOR STAIRWAYS SHALL NOT BE USED FOR ANY PURPOSE.
- HANDRAIL HEIGHT: HANDRAIL HEIGHT, MEASURED ABOVE STAIR TREAD NOSING, OR FINISH SURFACE RAMP SLOPE SHALL BE UNIFORM, NOT LESS THAN 34 INCHES AND NOT MORE THAN 38 INCHES.
- HANDRAIL GRIP-SIZE: HANDRAILS WITH A CIRCULAR CROSS- SECTION SHALL HAVE AN OUTSIDE DIAMETER OF AT LEAST 1.25 INCHES AND NOT GREATER THAN 2 INCHES OR SHALL PROVIDE EQUIVALENT GRIP-SIZE. IF THE HANDRAIL IS NOT CIRCULAR, IT SHALL HAVE A PERIMETER DIMENSION OF AT LEAST 4 INCHES AND NOT GREATER THAN 6.25 INCHES WITH A MAXIMUM CROSS-SECTION DIMENSION OF 2.25 INCHES. EDGES SHALL HAVE A MINIMUM RADIUS OF 0.01 INCH.

guardrail general notes

- CONFORM TO 2019 CRC R301.5. HANDRAILS AND GUARDS SHALL BE DESIGNED TO RESIST A CONCENTRATED LOAD OF 200LB APPLIED IN ANY DIRECTION. [CRC R301.5]
- GUARDRAILS ARE REQUIRED ALONG OPEN SIDES OF STAIRWAYS, LANDINGS, BALCONIES, PORCHES, DECKS, FLOOR OPENINGS, RAMPS, AND ROOFS USED FOR OTHER THAN SERVICE OF THE BUILDING, WHICH ARE MORE THAN 30" ABOVE GRADE OR FLOOR BELOV GUARDRAILS SHALL HAVE A 42" MINIMUM HEIGHT, 42" HIGH ALONG OPEN SIDES OF
- GUARDRAILS MUST BE ABLE TO WITHSTAND A LOAD OF 20 POUNDS PER LINEAL FOOT APPLIED HORIZONTALLY AT THE TOP OF THE GUARDRAIL.
- INTERMEDIATE RAILS, PANELS OR FILLERS, AND THEIR CONNECTIONS, SHALL BE CAPABLE OF WITHSTANDING A LOAD OF 25 POUNDS PER SQUARE FOOT APPLIED AT RIGHT ANGLES TO THE GUARDRAIL.
- GUARDRAILS SHALL BE DESIGNED SO THAT A 6" DIAMETER SPHERE CANNOT PASS THROUGH THE TRIANGULAR SPACE FORMED BY THE BOTTOM OF THE RAIL, THE RISER AND THE TREAD.
- BALUSTERS ON A HANDRAIL OR A GUARDRAIL SHALL BE SO SPACED SO THAT A 4" SPHERE CANNOT PASS THROUGH.

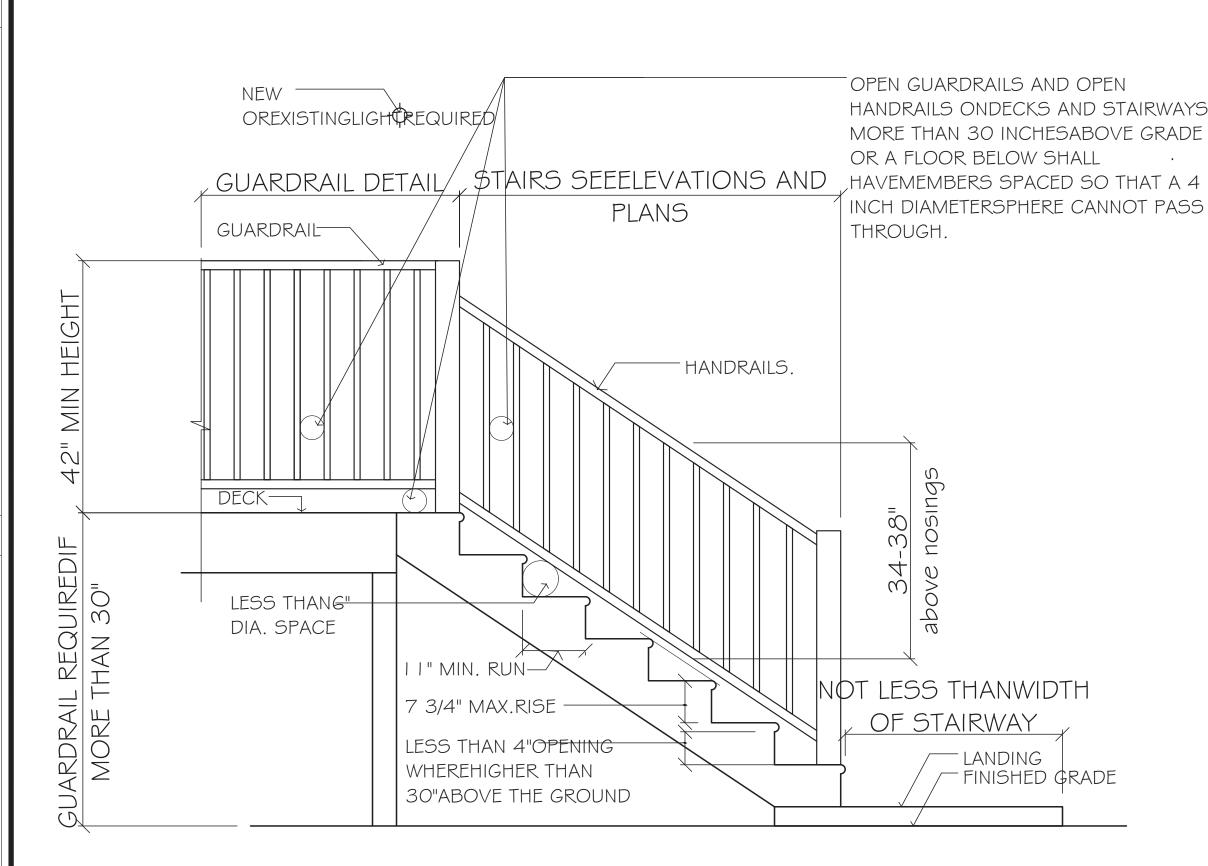

DOOR AND WINDOW SCHEDULE					
MARK	D1	D2		D4	W1
WIDTH	6' - 0"	2' - 8"	2' - 6"	6' - 0"	4' - 2"
HEIGHT	6' - 8"	6' - 8"	6' - 8"	6' - 8"	4' - 6"
LOCATION	(N) SUNROOM	RECONF LAUNDRT RM.	(E) BEDROOM, (N) BEDROOM, (N) BATHROOM, (N) W.I.C.	(N) CLOSET	(N) BEDROOM
QUANTITY	2	1	8	1	1
COMMENTS	FOLDING TEMPERED DOOR	SINGLE PANEL SOLID DOOR		SLIDING DOOR	SLIDING EGRESS WINDOW

 Do not scale or measure plan set. All vendors shall measure as builts/current framing This sheet is part of a set and is not to be used alone. This sheet is not to be used for construction unless the

consultant

consultant

designer's signature appear on drawings and status box indicates drawings have been released for construction . These plans and prints thereof, as instruments of service, are owned by the designer and are for use on this project only. Reproduction and/or distribution without the prior written consent of the designer is forbidden. 4. Copyright Slcdesign, 2025

Ken MacDonald's Residence


Application PD-25-002

SCALE: 3/8" = 1'-0" 4

SCALE: 3/16" = 1'-0"

Remodeling & Addition

130 Vasona Oaks Dr, Los Gatos, CA 95032

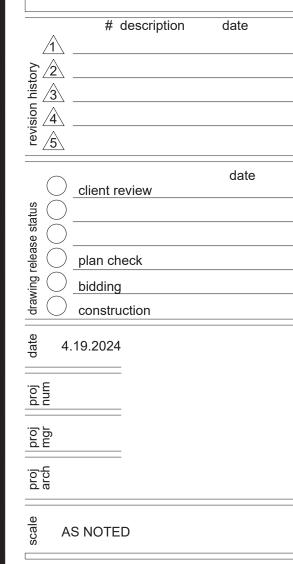



SCHEDULE AND DETAIL

A8.0

stairs and guardrail details


SCALE: 3/4" = 1'-0" 3 door and window schedule

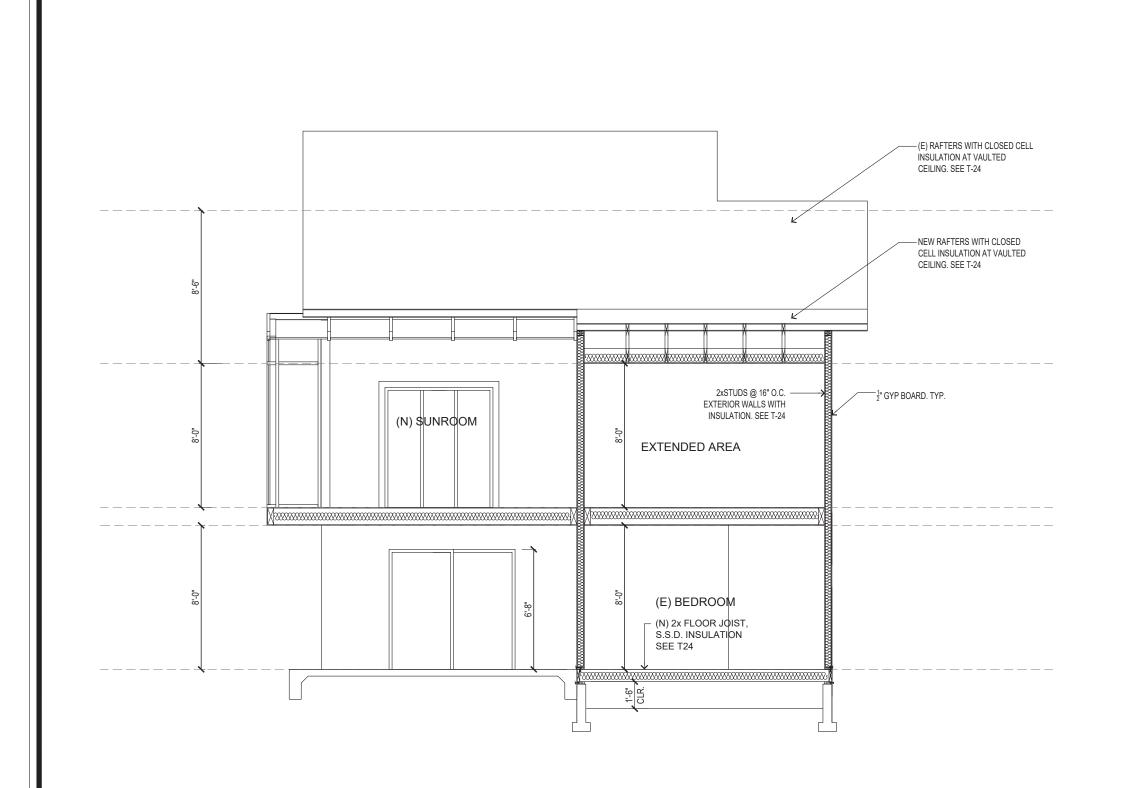

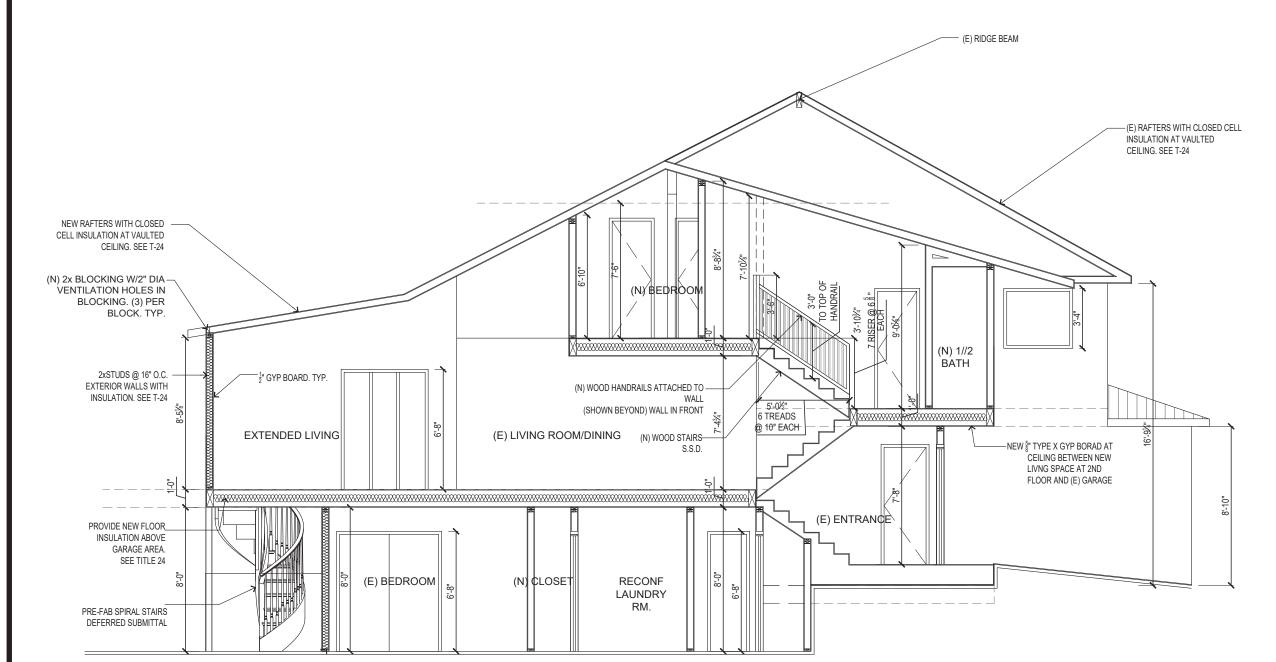

section a-a

SCALE: 3/16" = 1'-0" 1 Section b-b

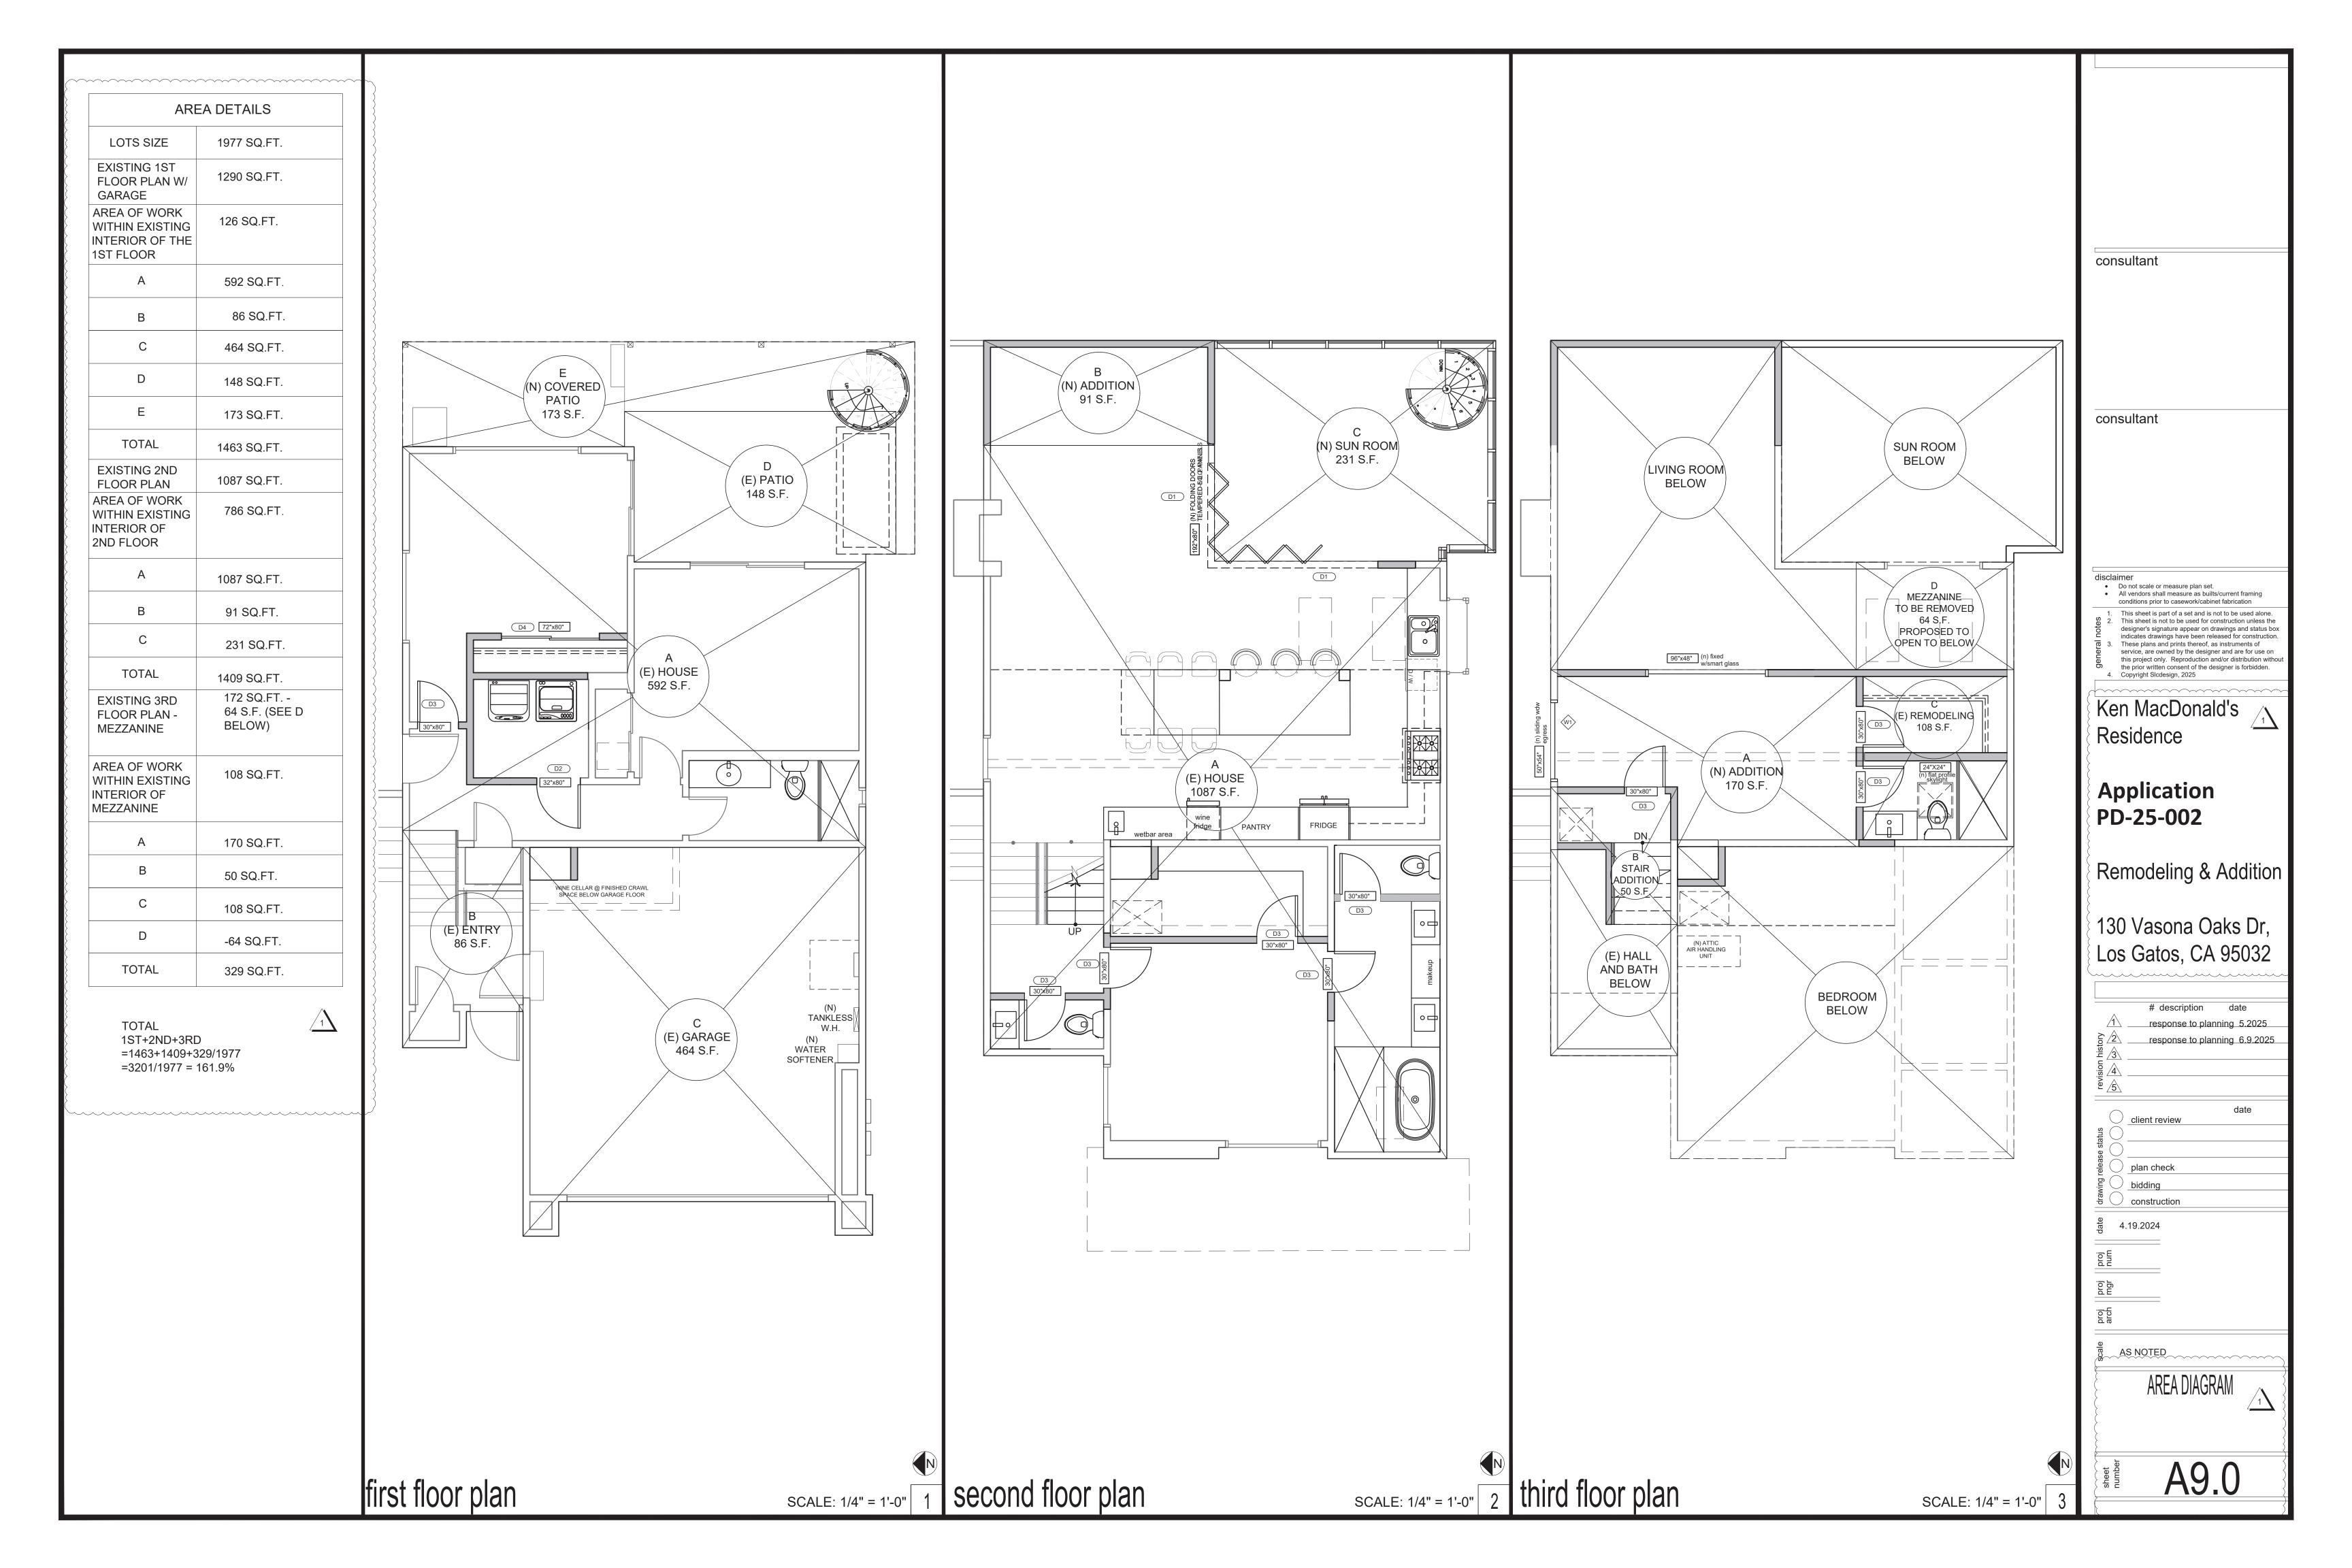

This Page Intentionally Left Blank