A REMODEL FOR

[redacted]

14344 LA RINCONADA DRIVE LOS GATOS CA 95032

CITY STAMP AREA

NOTE TO CONTRACTOR

THE CONTRACTOR AND/OR SUPPLIER OF MATERIALS SHALL NOT SCALE ANY DIMENSIONS FOR CONSTRUCTION PURPOSES. IN THE EVENT A DIMENSION IS REQUIRED THAT DOES NOT OCCUR ON THE DRAWINGS AND/OR A DIMENSION ERROR IS FOUND ON THE DRAWINGS. THE CONTRACTOR AND/OR SUPPLIER OF MATERIALS WILL NOTIFY THE OFFICE OF MICHELLE MINER DESIGN. AND REQUIRES ASSISTANCE AS SOON AS POSSIBLE. IF ANY ERROR IS FOUND ON PLAN OF ANY KIND NOTIFY MICHELLE MINER DESIGN THE CONTRACTOR AND/OR SUPPLIER OF MATERIALS SHALL BE SOLELY RESPONSIBLE FOR THE RESULTS OF ERRORS, DISCREPANCIES AND OMISSIONS WHICH THE CONTRACTOR AND/OR MATERIAL SUPPLIER FAILED TO NOTIFY THE OFFICE OF MICHELLE MINER DESIGN. PRIOR TO CONSTRUCTION AND/OR FABRICATION OF THE WORK. NO DEVIATION FROM THE PLANS IN ANY WAY SHALL BE MADE WITHOUT THE WRITTEN CONSENT OF MICHELLE MINER DESIGN. APPROVAL BY THE CITY INSPECTOR DOES NOT CONSTITUTE AUTHORITY TO DEVIATE FROM THE PLANS OR OTHER DOCUMENTS PROVIDED BY THE OFFICE OF MICHELLE MINER DESIGN.

SPECIAL NOTES

BEFORE YOU START CONSTRUCTION REVIEW ALL SHEETS CAREFULLY. READ THE GREEN CHECKLIST SHEETS AND THE TITLE 24 SHEETS FOR REQUIREMENTS AS RULES HAVE CHANGED AND THERE MAY BE THINGS YOU ARE NOT EXPECTING

SCOPE OF WORK

ADD 120 S.F. OF LIVING SPACE TO BECOME LAUNDRY
ADD 992 S.F. GARAGE

ANALYSIS

ASSESSOR'S PARCEL #	409-14-019
LOT AREA:	21,690 S.F.
ZONING:	R1-8
TYPE OF CONSTRUCTION:	V-B
OCCUPANCY RATING:	R-3, U
EXISTING USE:	SINGLE FAMILY RES.
SLOPE OF LOT	FLAT LOT
FLOOD ZONE	X
HISTORIC	NO
FIRE SPRINKLERS	NO
WUI	NO
STORIES	ONE

EXISTING

EXISTING LIVING:	1430 S.F.
EXISTING SHED:	120 S.F.
TOTAL EXISTING	1550 S.F.

PROPOSED

NEW LIVING	120 S.F.
NEW GARAGE	992 S.F.
ATTIC OVER GARAGE THAT COUNTS	450 S.F.
TOTAL SQUARE FOOTAGE	3112 S.F.
TOTAL COVERAGE	2662 S.F.
MAX FAR FOR HOUSE	4772 S.F.
MAX FAR FOR GARAGE	1150 S.F.
MAX LOT COVERAGE (40%)	8676 S.F.

INDEX

INDEX - VICINITY MAP - ANALYSIS - SCOPE OF WORK - NOTES - MAPS	1
SITE PLAN	2
BLUEPRINT FOR CLEAN BAY	3
GREEN CHECKLIST	4
GREEN CHECKLIST 2	5
EXISTING FLOOR PLAN	6
NEW FLOOR PLAN	7
EXTERIOR ELEVATIONS	8
SECTIONS & ROOF PLAN	9
ELECTRICAL PLAN	10
ELECTRICAL MECHANICAL NOTES	11
NOTES	12
DETAILS	13
TITLE 24	14
MF-1R	15
STRUCTURAL NOTES	S1
FOUNDATION/FLOOR FRAMING	S2
ROOF FRAMING PLAN	S3
CEILING FRAMING PLAN	S4
STRUCTURAL DETAILS	SD1
STRUCTURAL DETAILS	SD2
STRUCTURAL DETAILS	SD3

DEFERRED SUBMITTALS

SEPARATE PERMIT

ATTACHMENT 4

GENERAL NOTES

1. ALL WORK SHALL CONFORM TO THE REQUIREMENTS OF APPLICABLE FEDERAL, STATE, AND LOCAL CODES AND OTHER REQUIREMENTS WHICH HAVE BEEN ADOPTED BY THE LOCAL JURISDICTION OR ARE OTHERWISE APPLICABLE TO THIS PROJECT.
2. THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR THE VERIFICATION OF ALL DIMENSIONS, GRADES, AND OTHER CONDITIONS, AND SHALL CORRELATE AT THE JOB SITE ALL SUCH ITEMS. GENERAL CONTRACTOR SHALL REPORT ANY DISCREPANCIES TO THE ARCHITECT FOR CLARIFICATION AND CORRECTION PRIOR TO BEGINNING ANY WORK.
3. THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR THE WORK AND THE COORDINATION OF ALL TRADES AND GOVERNING AGENCIES, AND SHALL PROVIDE ALL MATERIALS AND LABOR (SHOWN OR INFERRED) ON THESE PLANS TO RENDER THE WORK COMPLETE.
4. IT SHALL BE THE GENERAL CONTRACTORS RESPONSIBILITY FOR THE SUPERVISION OF THE WORK.
5. THE ARCHITECT ASSUMES NO RESPONSIBILITY FOR THE SUPERVISION OF THE WORK OR THE PROPER EXECUTION OF THE SAME.
6. WRITTEN DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALED DIMENSIONS. ANY AND ALL DISCREPANCIES SHALL BE REPORTED TO THE ARCHITECT IMMEDIATELY, PRIOR TO COMMENCEMENT OF WORK.
7. THESE DRAWINGS SHALL BE CONSIDERED SUBSTANTIALLY COMPLETE. IT IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO PROVIDE ALL LABOR AND MATERIALS NECESSARY TO RENDER THE WORK COMPLETE, AS IS THE INTENT OF THESE DRAWINGS, EITHER SHOWN OR INFERRED HEREIN, THROUGH PROPER AND ESTABLISHED CONSTRUCTION PRACTICES.
8. EXISTING CONSTRUCTION DETAILS SHOWN HEREIN ARE ASSUMED TO BE SUBSTANTIALLY CORRECT AND MAY NOT DEPICT THE ACTUAL CONDITION. THE GENERAL CONTRACTOR SHALL VERIFY EXISTING CONDITIONS AND NOTIFY THE ARCHITECT ANY DISCREPANCIES PRIOR TO COMMENCEMENT OF WORK.
9. ANY PROPOSED SHUT DOWN OF UTILITIES SHALL BE REGISTERED IN WRITING AT LEAST SEVEN (7) WORKING DAYS IN ADVANCE. REQUESTS SHALL BE DIRECTED TO THE ARCHITECT.
10. ANY PROPOSED WORK THAT TAKES PLACE AFTER NORMAL BUSINESS HOURS SHALL BE MADE IN WRITING AT LEAST SEVEN (7) WORKING DAYS IN ADVANCE. REQUESTS SHALL BE DIRECTED TO THE ARCHITECT.
11. PROVIDE ALL REQUIRED FIRE BLOCKING IN ACCORDANCE WITH SECTION 718 OF THE CURRENT ADOPTED EDITION OF C.B.C.
12. EXITING NOTE: THIS BUILDING OR SPACE SHALL PROVIDE A READILY DISTINGUISHABLE MEANS OF EGRESS COMPLYING WITH CHAPTER 10 AND CHAPTER 11 (WHERE APPLICABLE FOR ACCESSIBILITY PURPOSE) OF THE CURRENT EDITION OF THE CALIFORNIA BUILDING CODE. THE EXIT SYSTEM SHALL MAINTAIN A CONTINUOUS, UNOBSTRUCTED AND UNDIMINISHED PATH OF EXIT TRAVEL FROM ANY OCCUPIED POINT WITHIN THE BUILDING TO A PUBLIC WAY.
13. JOB COPIES OF THE APPROVED BUILDING PLANS, REVISIONS, AND DEFERRED SUBMITTALS SHALL BE ON-SITE DURING INSPECTIONS.

CONSTRUCTION SITE SHALL BE ENCLOSED BY 6' OPAQUE FENCE AT ALL TIMES DURING CONSTRUCTION.

NO CONSTRUCTION MATERIAL, EQUIPMENT, PORTABLE TOILETS, TRASH CONTAINERS, OR DEBRIS SHALL BE PLACED IN THE PUBLIC RIGHT-OF-WAY.

A TRASH CONTAINER SHALL BE MAINTAINED ON SITE AT ALL TIMES AND DEBRIS ON SITE WHICH COULD OTHERWISE BLOW AWAY, SHALL BE REGULARLY COLLECTED AND PLACED IN CONTAINER.

ALL CONSTRUCTION DEBRIS (WOOD SCRAPS AND OTHER DEBRIS, WHICH CANNOT BLOW AWAY) SHALL BE PILED WITHIN THE PROPERTY LINES OF THE PROJECT IN A NEAT AND SAFE MANNER.

THE PROJECT SHALL HAVE A SIGNAGE VIEWABLE FROM THE PUBLIC STREET THAT INDICATES THE HOURS OF CONSTRUCTION AS: MON-FRI FROM 7:30 AM TO 6 PM, SATURDAYS FROM 9AM TO 5 PM.

VICINITY MAP

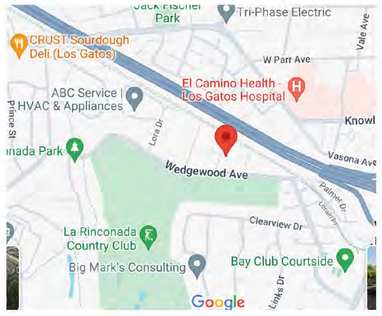

PARCEL MAP

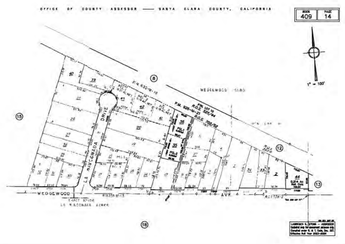

APPLICABLE CODE

ALL CONSTRUCTION SHALL COMPLY WITH:

2022	CALIF. FIRE CODE
2022	CALIF. BLDG CODE
2022	CALIF. RESIDENTIAL CODE
2022	CALIF. MECH. CODE
2022	CALIF. PLUMB'G CODE
2022	CALIF. ELEC. CODE
2022	CALIF. ENERGY CODES
2022	CALIF. GREEN BUILDING CODES

ANY OTHER APPLICABLE LOCAL & STATE LAWS & REGULATIONS.

PERSONAE

OWNER
[redacted]
14344 LA RINCONADA DRIVE
LOS GATOS CA 9503
[redacted]

DESIGNER
MICHELLE MINER DESIGN
MICHELLE MINER
18488 PROSPECT RD. #6
SARATOGA, CA 95070
SHELMINER@AOL.COM
408-396-0984

TONY TRUONG
500 E. CALAVERAS BLVD. SUITE 218
MILPITAS, CA 95035
408-899-0220
TRUONGDESIGNS@GMAIL.COM

TITLE 24
FRI ENERGY CONSULTANTS
21 N,. HARRISON AVE, SUITE 210
CAMPBELL, CA 95008
NICK@FRICONSULTING.COM
408-866-1620

REVISIONS

REV #	DATE	BY

DESIGNERS SIGNATURE

Michelle Miner

THE PLANS, IDEAS AND DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF THE DESIGNER. DEVISED SOLELY FOR THIS PROJECT. PLANS SHALL NOT BE USED, WHOLE OR IN PART, FOR ANY OTHER PURPOSE WITHOUT THE WRITTEN PERMISSION MICHELLE MINER DESIGN

michelle miner design
18488 Prospect Rd. #6 Saratoga, CA 95070
408.396.0984 Shelminer@aol.com

14344 LA RINCONADA DRIVE LOS GATOS CA 95032

[redacted]

DRAWN
MM
CHECKED
MM
DATE
8/14/2024
SCALE
AS SHOWN
JOB NO.

PAGE:
1/15

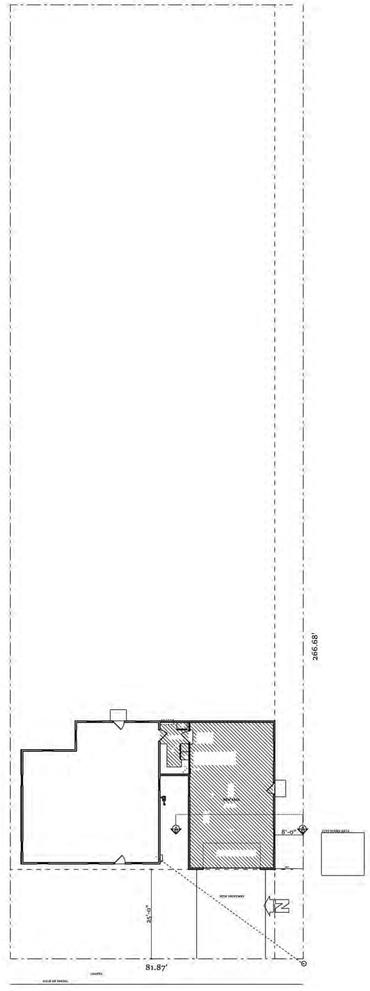

SITE PLAN

SCALE: 1" = 20'-0"

REVISIONS

REV #	DATE	BY

DESIGNERS SIGNATURE

Michelle Miner

THE PLANS, IDEAS AND DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF THE DESIGNER. DEVISED SOLELY FOR THIS PROJECT. PLANS SHALL NOT BE USED, WHOLE OR IN PART, FOR ANY OTHER PURPOSE WITHOUT THE WRITTEN PERMISSION MICHELLE MINER DESIGN

michelle miner design
18488 Prospect Rd. #6 Saratoga, CA 95070
408.396.0984 Shelminer@aol.com

[redacted]

14344 LA RINCONADA DRIVE LOS GATOS CA 95032

[redacted]

DRAWN
MM

CHECKED
MM

DATE
8/14/2024

SCALE
AS SHOWN

JOB NO.

PAGE:
2/15

SITE PLAN

Construction Best Management Practices (BMPs)

Construction projects are required to implement year-round stormwater BMPs.

Materials & Waste Management

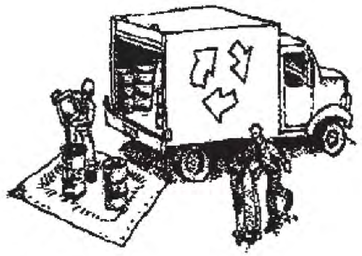

Non-Hazardous Materials

- ❑ Berm and cover stockpiles of sand, dirt or other construction material with tarps when rain is forecast or when they are not in use.
- ❑ Use (but don't overuse) reclaimed water for dust control.
- ❑ Ensure dust control water doesn't leave site or discharge to storm drains.

Hazardous Materials

- ❑ Label all hazardous materials and hazardous wastes (such as pesticides, paints, thinners, solvents, fuel, oil, and antifreeze) in accordance with City, County, State and Federal regulations.
- ❑ Store hazardous materials and wastes in water tight containers, store in appropriate secondary containment, and cover them at the end of every work day or during wet weather or when rain is forecast.
- ❑ Follow manufacturer's application instructions for hazardous materials and do not use more than necessary. Do not apply chemicals outdoors when rain is forecast within 24 hours.
- ❑ Arrange for appropriate disposal of all hazardous wastes.

Waste Management

- ❑ Cover and maintain dumpsters. Check frequently for leaks. Place dumpsters under roofs or cover with tarps or plastic sheeting secured around the outside of the dumpster. A plastic liner is recommended to prevent leaks. Never clean out a dumpster by hosing it down on the construction site.
- ❑ Place portable toilets away from storm drains. Make sure they are in good working order. Check frequently for leaks.
- ❑ Dispose of all wastes and demolition debris properly. Recycle materials and wastes that can be recycled, including solvents, water-based paints, vehicle fluids, broken asphalt and concrete, wood, and cleared vegetation.
- ❑ Dispose of liquid residues from paints, thinners, solvents, glues, and cleaning fluids as hazardous waste.
- ❑ Keep site free of litter (e.g. lunch items, cigarette butts).
- ❑ Prevent litter from uncovered loads by covering loads that are being transported to and from site.

Construction Entrances and Perimeter

- ❑ Establish and maintain effective perimeter controls and stabilize all construction entrances and exits to sufficiently control erosion and sediment discharges from site and tracking off site.
- ❑ Sweep or vacuum any street tracking immediately and secure sediment source to prevent further tracking. Never hose down streets to clean up tracking.

Equipment Management & Spill Control

Maintenance and Parking

- ❑ Designate an area of the construction site, well away from streams or storm drain inlets and fitted with appropriate BMPs, for auto and equipment parking, and storage.
- ❑ Perform major maintenance, repair jobs, and vehicle and equipment washing off site.
- ❑ If refueling or vehicle maintenance must be done onsite, work in a bermed area away from storm drains and over a drip pan or drop cloths big enough to collect fluids. Recycle or dispose of fluids as hazardous waste.
- ❑ If vehicle or equipment cleaning must be done onsite, clean with water only in a bermed area that will not allow rinse water to run into gutters, streets, storm drains, or surface waters.
- ❑ Do not clean vehicle or equipment onsite using soaps, solvents, degreasers, or steam cleaning equipment, and do not use diesel oil to lubricate equipment or parts onsite.

Spill Prevention and Control

- ❑ Keep spill cleanup materials (e.g., rags, absorbents and cat litter) available at the construction site at all times.
- ❑ Maintain all vehicles and heavy equipment. Inspect frequently for and repair leaks. Use drip pans to catch leaks until repairs are made.
- ❑ Clean up leaks, drips and other spills immediately and dispose of cleanup materials properly.
- ❑ Use dry cleanup methods whenever possible (absorbent materials, cat litter and/or rags).
- ❑ Sweep up spilled dry materials immediately. Never attempt to "wash them away" with water, or bury them.
- ❑ Clean up spills on dirt areas by digging up and properly disposing of contaminated soil.
- ❑ Report significant spills to the appropriate local spill response agencies immediately. If the spill poses a significant hazrd to human health and safety, property or the environment, you must report it to the State Office of Emergency Services. (800) 852-7550 (24 hours).

Earthmoving

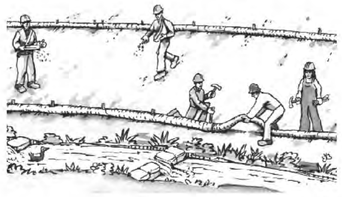

Grading and Earthwork

- ❑ Schedule grading and excavation work during dry weather.
- ❑ Stabilize all denuded areas, install and maintain temporary erosion controls (such as erosion control fabric or bonded fiber matrix) until vegetation is established.
- ❑ Remove existing vegetation only when absolutely necessary, plant temporary vegetation for erosion control on slopes or where construction is not immediately planned.
- ❑ Prevent sediment from migrating offsite and protect storm drain inlets, drainage courses and streams by installing and maintaining appropriate BMPs (i.e. silt fences, gravel bags, fiber rolls, temporary swales, etc.).
- ❑ Keep excavated soil on site and transfer it to dump trucks on site, not in the streets.

Contaminated Soils

- ❑ If any of the following conditions are observed, test for contamination and contact the Regional Water Quality Control Board:
  - Unusual soil conditions, discoloration, or odor.
  - Abandoned underground tanks.
  - Abandoned wells
  - Buried barrels, debris, or trash.
- ❑ If the above conditions are observed, document any signs of potential contamination and clearly mark them so they are not distrurbed by construction activities.

Landscaping

- ❑ Protect stockpiled landscaping materials from wind and rain by storing them under tarps all year-round.
- ❑ Stack bagged material on pallets and under cover.
- ❑ Discontinue application of any erodible landscape material within 2 days before a forecast rain event or during wet weather.

Concrete Management and Dewatering

Concrete Management

- ❑ Store both dry and wet materials under cover, protected from rainfall and runoff and away from storm drains or waterways. Store materials off the ground, on pallets. Protect dry materials from wind.
- ❑ Wash down exposed aggregate concrete only when the wash water can (1) flow onto a dirt area; (2) drain onto a bermed surface from which it can be pumped and disposed of properly; or (3) block any storm drain inlets and vacuum washwater from the gutter. If possible, sweep first.
- ❑ Wash out concrete equipment/trucks offsite or in a designated washout area onsite, where the water will flow into a temporary waste pit, and make sure wash water does not leach into the underlying soil. (See CASQA Construction BMP Handbook for properly designed concrete washouts.)

Dewatering

- ❑ Discharges of groundwater or captured runoff from dewatering operations must be properly managed and disposed. When possible, send dewatering discharge to landscaped area or sanitary sewer. If discharging to the sanitary sewer, call your local wastewater treatment plant.
- ❑ Divert run-on water from offsite away from all disturbed areas.
- ❑ When dewatering, notify and obtain approval from the local municipality before discharging water to a street gutter or storm drain. Filtration or diversion through a basin, tank, or sediment trap may be required.
- ❑ In areas of known or suspected contamination, call your local agency to determine whether the ground water must be tested. Pumped groundwater may need to be collected and hauled off-site for treatment and proper disposal.

Paving/Asphalt Work

Paving

- ❑ Avoid paving and seal coating in wet weather or when rain is forecast, to prevent materials that have not cured from contacting stormwater runoff.
- ❑ Cover storm drain inlets and manholes when applying seal coat, slurry seal, fog seal, or similar materials.
- ❑ Collect and recycle or properly dispose of excess abrasive gravel or sand. Do NOT sweep or wash it into gutters.

Sawcutting & Asphalt/Concrete Removal

- ❑ Protect storm drain inlets during saw cutting.
- ❑ If saw cut slurry enters a catch basin, clean it up immediately.
- ❑ Shovel or vacuum saw cut slurry deposits and remove from the site. When making saw cuts, use as little water as possible. Sweep up, and properly dispose of all residues.

Painting & Paint Removal

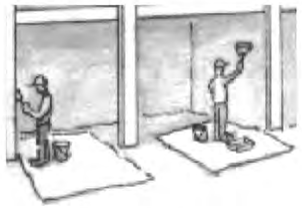

Painting Cleanup and Removal

- ❑ Never clean brushes or rinse paint containers into a street, gutter, storm drain, or stream.
- ❑ For water-based paints, paint out brushes to the extent possible, and rinse into a drain that goes to the sanitary sewer. Never pour paint down a storm drain.
- ❑ For oil-based paints, paint out brushes to the extent possible and clean with thinner or solvent in a proper container. Filter and reuse thinners and solvents. Dispose of excess liquids as hazardous waste.
- ❑ Sweep up or collect paint chips and dust from non-hazardous dry stripping and sand blasting into plastic drop cloths and dispose of as trash.
- ❑ Chemical paint stripping residue and chips and dust from marine paints or paints containing lead, mercury, or tributyltin must be disposed of as hazardous waste. Lead based paint removal requires a state-certified contractor.

Santa Clara Valley
Urban Runoff
Pollution Prevention Program

Storm drain polluters may be liable for fines of up to $10,000 per day!

2022 CALIFORNIA GREEN BUILDING STANDARDS CODE

RESIDENTIAL MANDATORY MEASURES, SHEET 1 (January 2023)

A = ARCHITECT C = CONTRACTOR
Y = YES
N/A = NOT APPLICABLE
RESPON. PARTY = RESPONSIBLE PARTY (ie: ARCHITECT, ENGINEER, OWNER, CONTRACTOR, INSPECTOR ETC.)

Y	N/A	RESPON. PARTY
Y		A

CHAPTER 3
GREEN BUILDING
SECTION 301 GENERAL

301.1 SCOPE. Buildings shall be designed to include the green building measures specified as mandatory in the application checklists contained in this code. Voluntary green building measures are also included in the application checklists and may be included in the design and construction of structures covered by this code, but are not required unless adopted by a city, county, or city and county as specified in Section 101.7.

301.1.1 Additions and alterations. [HCD] The mandatory provisions of Chapter 4 shall be applied to additions or alterations of existing residential buildings where the addition or alteration increases the building's conditioned area, volume, or size. The requirements shall apply only to and/or within the specific area of the addition or alteration.

The mandatory provision of Section 4.106.4.2 may apply to additions or alterations of existing parking facilities or the addition of new parking facilities serving existing multifamily buildings. See Section 4.106.4.3 for application.

Note: Repairs including, but not limited to, resurfacing, restriping and repairing or maintaining existing lighting fixtures are not considered alterations for the purpose of this section.

Note: On and after January 1, 2014, residential buildings undergoing permitted alterations, additions, or improvements shall replace noncompliant plumbing fixtures with water-conserving plumbing fixtures. Plumbing fixture replacement is required prior to issuance of a certificate of final completion, certificate of occupancy or final permit approval by the local building department. See Civil Code Section 1101.1, et seq., for the definition of a noncompliant plumbing fixture, types of residential buildings affected and other important enactment dates.

301.2 LOW-RISE AND HIGH-RISE RESIDENTIAL BUILDINGS. [HCD] The provisions of individual sections of CALGreen may apply to either low-rise residential buildings high-rise residential buildings, or both. Individual sections will be designated by banners to indicate where the section applies specifically to low-rise only (LR) or high-rise only (HR). When the section applies to both low-rise and high-rise buildings, no banner will be used.

SECTION 302 MIXED OCCUPANCY BUILDINGS

302.1 MIXED OCCUPANCY BUILDINGS. In mixed occupancy buildings, each portion of a building shall comply with the specific green building measures applicable to each specific occupancy.

Exceptions:

1. [HCD] Accessory structures and accessory occupancies serving residential buildings shall comply with Chapter 4 and Appendix A4, as applicable.
2. [HCD] For purposes of *CALGreen*, live/work units, complying with Section 419 of the *California Building Code*, shall not be considered mixed occupancies. Live/Work units shall comply with Chapter 4 and Appendix A4, as applicable.

DIVISION 4.1 PLANNING AND DESIGN

ABBREVIATION DEFINITIONS:

HCD	Department of Housing and Community Development
BSC	California Building Standards Commission
DSA-SS	Division of the State Architect, Structural Safety
OSHPD	Office of Statewide Health Planning and Development
LR	Low Rise
HR	High Rise
AA	Additions and Alterations
N	New

CHAPTER 4
RESIDENTIAL MANDATORY MEASURES
SECTION 4.102 DEFINITIONS

4.102.1 DEFINITIONS
The following terms are defined in Chapter 2 *(and are included here for reference)*

FRENCH DRAIN. A trench, hole or other depressed area loosely filled with rock, gravel, fragments of brick or similar pervious material used to collect or channel drainage or runoff water.

WATTLES. Wattles are used to reduce sediment in runoff. Wattles are often constructed of natural plant materials such as hay, straw or similar material shaped in the form of tubes and placed on a downflow slope. Wattles are also used for perimeter and inlet controls.

4.106 SITE DEVELOPMENT

Y	N/A	RESPON. PARTY
Y		C

4.106.1 GENERAL. Preservation and use of available natural resources shall be accomplished through evaluation and careful planning to minimize negative effects on the site and adjacent areas. Preservation of slopes, management of storm water drainage and erosion controls shall comply with this section.

Y	N/A	RESPON. PARTY
Y		C

4.106.2 STORM WATER DRAINAGE AND RETENTION DURING CONSTRUCTION. Projects which disturb less than one acre of soil and are not part of a larger common plan of development which in total disturbs one acre or more, shall manage storm water drainage during construction. In order to manage storm water drainage during construction, one or more of the following measures shall be implemented to prevent flooding of adjacent property, prevent erosion and retain soil runoff on the site.

1. Retention basins of sufficient size shall be utilized to retain storm water on the site.
2. Where storm water is conveyed to a public drainage system, collection point, gutter or similar disposal method, water shall be filtered by use of a barrier system, wattle or other method approved by the enforcing agency.
3. Compliance with a lawfully enacted storm water management ordinance.

Note: Refer to the State Water Resources Control Board for projects which disturb one acre or more of soil, or are part of a larger common plan of development which in total disturbs one acre or more of soil.

(Website: https://www.waterboards.ca.gov/water_issues/programs/stormwater/construction.html)

Y	N/A	RESPON. PARTY
Y		C

4.106.3 GRADING AND PAVING. Construction plans shall indicate how the site grading or drainage system will manage all surface water flows to keep water from entering buildings. Examples of methods to manage surface water include, but are not limited to, the following:

1. Swales
2. Water collection and disposal systems
3. French drains
4. Water retention gardens
5. Other water measures which keep surface water away from buildings and aid in groundwater recharge.

Exception: Additions and alterations not altering the drainage path.

Y	N/A	RESPON. PARTY
Y		C

4.106.4 Electric vehicle (EV) charging for new construction. New construction shall comply with Sections 4.106.4.1 or 4.106.4.2 to facilitate future installation and use of EV chargers. Electric vehicle supply equipment (EVSE) shall be installed in accordance with the *California Electrical Code,* Article 625.

Exceptions:

1. On a case-by-case basis, where the local enforcing agency has determined EV charging and infrastructure are not feasible based upon one or more of the following conditions:
   1.1 Where there is no local utility power supply or the local utility is unable to supply adequate power.
   1.2 Where there is evidence suitable to the local enforcing agency substantiating that additional local utility infrastructure design requirements, directly related to the implementation of Section 4.106.4, may adversely impact the construction cost of the project.
2. Accessory Dwelling Units (ADU) and Junior Accessory Dwelling Units (JADU) without additional parking facilities.

Y	N/A	RESPON. PARTY
Y		C

4.106.4.1 New one- and two-family dwellings and townhouses with attached private garages. For each dwelling unit, install a listed raceway to accommodate a dedicated 208/240-volt branch circuit. The raceway shall not be less than trade size 1 (nominal 1-inch inside diameter). The raceway shall originate at the main service or subpanel and shall terminate into a listed cabinet, box or other enclosure in close proximity to the proposed location of an EV charger. Raceways are required to be continuous at enclosed, inaccessible or concealed areas and spaces. The service panel and/or subpanel shall provide capacity to install a 40-ampere 208/240-volt minimum dedicated branch circuit and space(s) reserved to permit installation of a branch circuit overcurrent protective device.

Exemption: A raceway is not required if a minimum 40-ampere 208/240-volt dedicated EV branch circuit is installed in close proximity to the proposed location of an EV charger at the time of original construction in accordance with the *California Electrical Code*.

4.106.4.1.1 Identification. The service panel or subpanel circuit directory shall identify the overcurrent protective device space(s) reserved for future EV charging as "EV CAPABLE". The raceway termination location shall be permanently and visibly marked as "EV CAPABLE".

Y	N/A	RESPON. PARTY
	N/A	

4.106.4.2 New multifamily dwellings, hotels and motels and new residential parking facilities.
When parking is provided, parking spaces for new multifamily dwellings, hotels and motels shall meet the requirements of Sections 4.106.4.2.1 and 4.106.4.2.2. Calculations for spaces shall be rounded up to the nearest whole number. A parking space served by electric vehicle supply equipment or designed as a future EV charging space shall count as at least one standard automobile parking space only for the purpose of complying with any applicable minimum parking space requirements established by a local jurisdiction. See Vehicle Code Section 22511.2 for further details.

Y	N/A	RESPON. PARTY
	N/A	

4.106.4.2.1Multifamily development projects with less than 20 dwelling units; and hotels and motels with less than 20 sleeping units or guest rooms.
The number of dwelling units, sleeping units or guest rooms shall be based on all buildings on a project site subject to this section.

1.EV Capable. Ten (10) percent of the total number of parking spaces on a building site, provided for all types of parking facilities, shall be electric vehicle charging spaces (EV spaces) capable of supporting future Level 2 EVSE. Electrical load calculations shall demonstrate that the electrical panel service capacity and electrical system, including any on-site distribution transformer(s), have sufficient capacity to simultaneously charge all EVs at all required EV spaces at a minimum of 40 amperes.

The service panel or subpanel circuit directory shall identify the overcurrent protective device space(s) reserved for future EV charging purposes as "EV CAPABLE" in accordance with the California Electrical Code.

Exceptions:

1.When EV chargers (Level 2 EVSE) are installed in a number equal to or greater than the required number of EV capable spaces.

2.When EV chargers (Level 2 EVSE) are installed in a number less than the required number of EV capable spaces, the number of EV capable spaces required may be reduced by a number equal to the number of EV chargers installed.

Notes:

a.Construction documents are intended to demonstrate the project's capability and capacity for facilitating future EV charging.

b.There is no requirement for EV spaces to be constructed or available until receptacles for EV charging or EV chargers are installed for use.

2.EV Ready. Twenty-five (25) percent of the total number of parking spaces shall be equipped with low power Level 2 EV charging receptacles. For multifamily parking facilities, no more than one receptacle is required per dwelling unit when more than one parking space is provided for use by a single dwelling unit.

Exception: Areas of parking facilities served by parking lifts.

Y	N/A	RESPON. PARTY
	N/A	

4.106.4.2.2 Multifamily development projects with 20 or more dwelling units, hotels and motels with 20 or more sleeping units or guest rooms.
The number of dwelling units, sleeping units or guest rooms shall be based on all buildings on a project site subject to this section.

1.EV Capable. Ten (10) percent of the total number of parking spaces on a building site, provided for all types of parking facilities, shall be electric vehicle charging spaces (EV spaces) capable of supporting future Level 2 EVSE. Electrical load calculations shall demonstrate that the electrical panel service capacity and electrical system, including any on-site distribution transformer(s), have sufficient capacity to simultaneously charge all EVs at all required EV spaces at a minimum of 40 amperes.

The service panel or subpanel circuit directory shall identify the overcurrent protective device space(s) reserved for future EV charging purposes as "EV CAPABLE" in accordance with the California Electrical Code.

Exception: When EV chargers (Level 2 EVSE) are installed in a number greater than five (5) percent of parking spaces required by Section 4.106.4.2.2, Item 3, the number of EV capable spaces required may be reduced by a number equal to the number of EV chargers installed over the five (5) percent required.

Notes:

a.Construction documents shall show locations of future EV spaces.

b.There is no requirement for EV spaces to be constructed or available until receptacles for EV charging or EV chargers are installed for use.

2.EV Ready. Twenty-five (25) percent of the total number of parking spaces shall be equipped with low power Level 2 EV charging receptacles. For multifamily parking facilities, no more than one receptacle is required per dwelling unit when more than one parking space is provided for use by a single dwelling unit.

Exception: Areas of parking iifts.

3.EV Chargers. Five (5) percent of the total number of parking spaces shall be equipped with Level 2 EVSE. Where common use parking is provided, at least one EV charger shall be located in the common use parking area and shall be available for use by all residents or guests.

When low power Level 2 EV charging receptacles or Level 2 EVSE are installed beyond the minimum required, an automatic load management system (ALMS) may be used to reduce the maximum required electrical capacity to each space served by the ALMS. The electrical system and any on-site distribution transformers shall have sufficient capacity to deliver at least 3.3 kW simultaneously to each EV charging station (EVCS) served by the ALMS. The branch circuit shall have a minimum capacity of 40 amperes, and installed EVSE shall have a capacity of not less than 30 amperes. ALMS shall not be used to reduce the minimum required electrical capacity to the required EV capable spaces.

4.106.4.2.2.1 Electric vehicle charging stations (EVCS).
Electric vehicle charging stations required by Section 4.106.4.2.2, Item 3, shall comply with Section 4.106.4.2.2.1.

Exception: Electric vehicle charging stations serving public accommodations, public housing, motels and hotels shall not be required to comply with this section. See California Building Code, Chapter 11B, for applicable requirements.

4.106.4.2.2.1.1 Location.
EVCS shall comply with at least one of the following options:

1.The charging space shall be located adjacent to an accessible parking space meeting the requirements of the California Building Code, Chapter 11A, to allow use of the EV charger from the accessible parking space.

2.The charging space shall be located on an accessible route, as defined in the California Building Code, Chapter 2, to the building.

Exception: Electric vehicle charging stations designed and constructed in compliance with the California Building Code, Chapter 11B, are not required to comply with Section 4.106.4.2.2.1.1 and Section 4.106.4.2.2.1.2, Item 3.

4.106.4.2.2.1.2 Electric vehicle charging stations (EVCS) dimensions.
The charging spaces shall be designed to comply with the following:

1.The minimum length of each EV space shall be 18 feet (5486 mm).

2.The minimum width of each EV space shall be 9 feet (2743 mm).

3.One in every 25 charging spaces, but not less than one, shall also have an 8-foot (2438 mm) wide minimum aisle. A 5-foot (1524 mm) wide minimum aisle shall be permitted provided the minimum width of the EV space is 12 feet (3658 mm).

a.Surface slope for this EV space and the aisle shall not exceed 1 unit vertical in 48 units horizontal (2.083 percent slope) in any direction.

4.106.4.2.2.1.3 Accessible EV spaces.
In addition to the requirements in Sections 4.106.4.2.2.1.1 and 4.106.4.2.2.1.2, all EVSE, when installed, shall comply with the accessibility provisions for EV chargers in the California Building Code, Chapter 11B. EV ready spaces and EVCS in multifamily developments shall comply with California Building Code, Chapter 11A, Section 1109A.

4.106.4.2.3 EV space requirements.
1.Single EV space required. Install a listed raceway capable of accommodating a 208/240-volt dedicated branch circuit. The raceway shall not be less than trade size 1 (nominal 1-inch inside diameter). The raceway shall originate at the main service or subpanel and shall terminate into a listed cabinet, box or enclosure in close proximity to the location or the proposed location of the EV space. Construction documents shall identify the raceway termination point, receptacle or charger location, as applicable. The service panel and/ or subpanel shall have a 40-ampere minimum dedicated branch circuit, including branch circuit overcurrent protective device installed, or space(s) reserved to permit installation of a branch circuit overcurrent protective device.

Exception: A raceway is not required if a minimum 40-ampere 208/240-volt dedicated EV branch circuit is installed in close proximity to the location or the proposed location of the EV space, at the time of original construction in accordance with the California Electrical Code.

2.Multiple EV spaces required. Construction documents shall indicate the raceway termination point and the location of installed or future EV spaces, receptacles or EV chargers. Construction documents shall also provide information on amperage of installed or future receptacles or EVSE, raceway method(s), wiring schematics and electrical load calculations. Plan design shall be based upon a 40-ampere minimum branch circuit. Required raceways and related components that are planned to be installed underground, enclosed, inaccessible or in concealed areas and spaces shall be installed at the time of original construction.

Y	N/A	RESPON. PARTY
Y		C

4.106.4.2.4 Identification.
The service panel or subpanel circuit directory shall identify the overcurrent protective device space(s) reserved for future EV charging purposes as "EV CAPABLE" in accordance with the California Electrical Code.

4.106.4.2.5 Electric Vehicle Ready Space Signage .
Electric vehicle ready spaces shall be identified by signage or pavement markings, in compliance with Caltrans Traffic Operations Policy Directive 13-01 (Zero Emission Vehicle Signs and Pavement Markings) or its successor(s).

Y	N/A	RESPON. PARTY
	N/A	

4.106.4.3 Electric vehicle charging for additions and alterations of parking facilities serving existing multifamily buildings.
When new parking facilities are added, or electrical systems or lighting of existing parking facilities are added or altered and the work requires a building permit, ten (10) percent of the total number of parking spaces added or altered shall be electric vehicle charging spaces (EV spaces) capable of supporting future Level 2 EVSE.

Notes:

1.Construction documents are intended to demonstrate the project's capability and capacity for facilitating future EV charging.

2.There is no requirement for EV spaces to be constructed or available until EV chargers are installed for use.

DIVISION 4.2 ENERGY EFFICIENCY

4.201 GENERAL

4.201.1 SCOPE. For the purposes of mandatory energy efficiency standards in this code, the California Energy Commission will continue to adopt mandatory standards.

DIVISION 4.3 WATER EFFICIENCY AND CONSERVATION

4.303 INDOOR WATER USE

Y	N/A	RESPON. PARTY
Y		C

4.303.1 WATER CONSERVING PLUMBING FIXTURES AND FITTINGS. Plumbing fixtures (water closets and urinals) and fittings (faucets and showerheads) shall comply with the sections 4.303.1.1, 4.303.1.2, 4.303.1.3, and 4.303.4.4.

Note: All noncompliant plumbing fixtures in any residential real property shall be replaced with water-conserving plumbing fixtures. Plumbing fixture replacement is required prior to issuance of a certificate of final completion, certificate of occupancy, or final permit approval by the local building department. See Civil Code Section 1101.1, et seq., for the definition of a noncompliant plumbing fixture, types of residential buildings affected and other important enactment dates.

4.303.1.1 Water Closets. The effective flush volume of all water closets shall not exceed 1.28 gallons per flush. Tank-type water closets shall be certified to the performance criteria of the U.S. EPA WaterSense Specification for Tank-type Toilets.

Note: The effective flush volume of dual flush toilets is defined as the composite, average flush volume of two reduced flushes and one full flush.

4.303.1.2 Urinals. The effective flush volume of wall mounted urinals shall not exceed 0.125 gallons per flush. The effective flush volume of all other urinals shall not exceed 0.5 gallons per flush.

4.303.1.3 Showerheads.

4.303.1.3.1 Single Showerhead. Showerheads shall have a maximum flow rate of not more than 1.8 gallons per minute at 80 psi. Showerheads shall be certified to the performance criteria of the U.S. EPA WaterSense Specification for Showerheads.

4.303.1.3.2 Multiple showerheads serving one shower . When a shower is served by more than one showerhead, the combined flow rate of all the showerheads and/or other shower outlets controlled by a single valve shall not exceed 1.8 gallons per minute at 80 psi, or the shower shall be designed to only allow one shower outlet to be in operation at a time.

Note: A hand-held shower shall be considered a showerhead.

4.303.1.4 Faucets.

4.303.1.4.1 Residential Lavatory Faucets. The maximum flow rate of residential lavatory faucets shall not exceed 1.2 gallons per minute at 60 psi. The minimum flow rate of residential lavatory faucets shall not be less than 0.8 gallons per minute at 20 psi.

4.303.1.4.2 Lavatory Faucets in Common and Public Use Areas. The maximum flow rate of lavatory faucets installed in common and public use areas (outside of dwellings or sleeping units) in residential buildings shall not exceed 0.5 gallons per minute at 60 psi.

4.303.1.4.3 Metering Faucets. Metering faucets when installed in residential buildings shall not deliver more than 0.2 gallons per cycle.

4.303.1.4.4 Kitchen Faucets. The maximum flow rate of kitchen faucets shall not exceed 1.8 gallons per minute at 60 psi. Kitchen faucets may temporarily increase the flow above the maximum rate, but not to exceed 2.2 gallons per minute at 60 psi, and must default to a maximum flow rate of 1.8 gallons per minute at 60 psi.

Note: Where complying faucets are unavailable, aerators or other means may be used to achieve reduction.

4.303.1.4.5 Pre-rinse spray valves.
When Installed, shall meet the requirements in the *California Code of Regulations* , Title 20 (Appliance Efficiency Regulations), Sections 1605.1 (h)(4) Table H-2, Section 1605.3 (h)(4)(A), and Section 1607 (d)(7) and shall be equipped with an integral automatic shutoff.

FOR REFERENCE ONLY: The following table and code section have been reprinted from the *California Code of Regulations* , Title 20 (Appliance Efficiency Regulations),Section 1605.1 (h)(4) and Section 1605.3 (h)(4)(A).

TABLE H-2

STANDARDS FOR COMMERCIAL PRE-RINSE SPRAY VALVES MANUFACTURED ON OR AFTER JANUARY 28, 2019

PRODUCT CLASS [spray force in ounce force (ozf)]	MAXIMUM FLOW RATE (gpm)
Product Class 1 (≤ 5.0 ozf)	1.00
Product Class 2 (> 5.0 ozf and ≤ 8.0 ozf)	1.20
Product Class 3 (> 8.0 ozf)	1.28

Title 20 Section 1605.3 (h)(4)(A): Commercial prerinse spray values manufactured on or after January 1, 2006, shall have a minimum spray force of not less than 4.0 ounces-force (ozf)[113 grams-force(gf)]

Y	N/A	RESPON. PARTY
	N/A	

4.303.2 Submeters for multifamily buildings and dwelling units in mixed-used residential/commercial buildings.
Submeters shall be installed to measure water usage of individual rental dwelling units in accordance with the *California Plumbing Code*.

Y	N/A	RESPON. PARTY
Y		C

4.303.3 Standards for plumbing fixtures and fittings. Plumbing fixtures and fittings shall be installed in accordance with the *California Plumbing Code*, and shall meet the applicable standards referenced in Table 1701.1 of the *California Plumbing Code*.

NOTE:
THIS TABLE COMPILES THE DATA IN SECTION 4.303.1, AND IS INCLUDED AS A CONVENIENCE FOR THE USER.

TABLE - MAXIMUM FIXTURE WATER USE

FIXTURE TYPE	FLOW RATE
SHOWER HEADS (RESIDENTIAL)	1.8 GMP @ 80 PSI
LAVATORY FAUCETS (RESIDENTIAL)	MAX. 1.2 GPM @ 60 PSI MIN. 0.8 GPM @ 20 PSI
LAVATORY FAUCETS IN COMMON & PUBLIC USE AREAS	0.5 GPM @ 60 PSI
KITCHEN FAUCETS	1.8 GPM @ 60 PSI
METERING FAUCETS	0.2 GAL/CYCLE
WATER CLOSET	1.28 GAL/FLUSH
URINALS	0.125 GAL/FLUSH

Y	N/A	RESPON. PARTY
Y		C

4.304 OUTDOOR WATER USE

4.304.1 OUTDOOR POTABLE WATER USE IN LANDSCAPE AREAS . Residential developments shall comply with a local water efficient landscape ordinance or the current California Department of Water Resources' Model Water Efficient Landscape Ordinance (MWELO), whichever is more stringent.

NOTES:

1. The Model Water Efficient Landscape Ordinance (MWELO) is located in the *California Code Regulations*, Title 23, Chapter 2.7, Division 2. MWELO and supporting documents, including water budget calculator, are available at: https://www.water.ca.gov/

DIVISION 4.4 MATERIAL CONSERVATION AND RESOURCE EFFICIENCY

4.406 ENHANCED DURABILITY AND REDUCED MAINTENANCE

Y	N/A	RESPON. PARTY
Y		C

4.406.1 RODENT PROOFING. Annular spaces around pipes, electric cables, conduits or other openings in sole/bottom plates at exterior walls shall be protected against the passage of rodents by closing such openings with cement mortar, concrete masonry or a similar method acceptable to the enforcing agency.

4.408 CONSTRUCTION WASTE REDUCTION, DISPOSAL AND RECYCLING

Y	N/A	RESPON. PARTY
Y		C

4.408.1 CONSTRUCTION WASTE MANAGEMENT. Recycle and/or salvage for reuse a minimum of 65 percent of the non-hazardous construction and demolition waste in accordance with either Section 4.408.2, 4.408.3 or 4.408.4, or meet a more stringent local construction and demolition waste management ordinance.

Exceptions:

1. Excavated soil and land-clearing debris.
2. Alternate waste reduction methods developed by working with local agencies if diversion or recycle facilities capable of compliance with this item do not exist or are not located reasonably close to the jobsite.
3. The enforcing agency may make exceptions to the requirements of this section when isolated jobsites are located in areas beyond the haul boundaries of the diversion facility.

Y	N/A	RESPON. PARTY
Y		C

4.408.2 CONSTRUCTION WASTE MANAGEMENT PLAN . Submit a construction waste management plan in conformance with Items 1 through 5. The construction waste management plan shall be updated as necessary and shall be available during construction for examination by the enforcing agency.

1. Identify the construction and demolition waste materials to be diverted from disposal by recycling, reuse on the project or salvage for future use or sale.
2. Specify if construction and demolition waste materials will be sorted on-site (source separated) or bulk mixed (single stream).
3. Identify diversion facilities where the construction and demolition waste material collected will be taken.
4. Identify construction methods employed to reduce the amount of construction and demolition waste generated.
5. Specify that the amount of construction and demolition waste materials diverted shall be calculated by weight or volume, but not by both.

Y	N/A	RESPON. PARTY
Y		C

4.408.3 WASTE MANAGEMENT COMPANY. Utilize a waste management company, approved by the enforcing agency, which can provide verifiable documentation that the percentage of construction and demolition waste material diverted from the landfill complies with Section 4.408.1.

Note: The owner or contractor may make the determination if the construction and demolition waste materials will be diverted by a waste management company.

Y	N/A	RESPON. PARTY
Y		C

4.408.4 WASTE STREAM REDUCTION ALTERNATIVE [LR]. Projects that generate a total combined weight of construction and demolition waste disposed of in landfills, which do not exceed 3.4 lbs./sq.ft. of the building area shall meet the minimum 65% construction waste reduction requirement in Section 4.408.1

4.408.4.1 WASTE STREAM REDUCTION ALTERNATIVE. Projects that generate a total combined weight of construction and demolition waste disposed of in landfills, which do not exceed 2 pounds per square foot of the building area, shall meet the minimum 65% construction waste reduction requirement in Section 4.408.1

Y	N/A	RESPON. PARTY
Y		C

4.408.5 DOCUMENTATION . Documentation shall be provided to the enforcing agency which demonstrates compliance with Section 4.408.2, items 1 through 5, Section 4.408.3 or Section 4.408.4..

Notes:

1. Sample forms found in "A Guide to the California Green Building Standards Code (Residential)" located at www.hcd.ca.gov/CALGreen.html may be used to assist in documenting compliance with this section.
2. Mixed construction and demolition debris (C & D) processors can be located at the California Department of Resources Recycling and Recovery (CalRecycle).

4.410 BUILDING MAINTENANCE AND OPERATION

Y	N/A	RESPON. PARTY
Y		C

4.410.1 OPERATION AND MAINTENANCE MANUAL. At the time of final inspection, a manual, compact disc, web-based reference or other media acceptable to the enforcing agency which includes all of the following shall be placed in the building:

1. Directions to the owner or occupant that the manual shall remain with the building throughout the life cycle of the structure.
2. Operation and maintenance instructions for the following:
   a. Equipment and appliances, including water-saving devices and systems, HVAC systems, photovoltaic systems, electric vehicle chargers, water-heating systems and other major appliances and equipment.
   b. Roof and yard drainage, including gutters and downspouts.
   c. Space conditioning systems, including condensers and air filters.
   d. Landscape irrigation systems.
   e. Water reuse systems.
3. Information from local utility, water and waste recovery providers on methods to further reduce resource consumption, including recycle programs and locations.
4. Public transportation and/or carpool options available in the area.
5. Educational material on the positive impacts of an interior relative humidity between 30-60 percent and what methods an occupant may use to maintain the relative humidity level in that range.
6. Information about water-conserving landscape and irrigation design and controllers which conserve water.
7. Instructions for maintaining gutters and downspouts and the importance of diverting water at least 5 feet away from the foundation.
8. Information on required routine maintenance measures, including, but not limited to, caulking, painting, grading around the building, etc.
9. Information about state solar energy and incentive programs available.
10. A copy of all special inspections verifications required by the enforcing agency or this code.
11. Information from the Department of Forestry and Fire Protection on maintenance of defensible space around residential structures.
12. Information and/or drawings identifying the location of grab bar reinforcements.

Y	N/A	RESPON. PARTY
	N/A	

4.410.2 RECYCLING BY OCCUPANTS. Where 5 or more multifamily dwelling units are constructed on a building site, provide readily accessible area(s) that serves all buildings on the site and are identified for the depositing, storage and collection of non-hazardous materials for recycling, including (at a minimum) paper, corrugated cardboard, glass, plastics, organic waster, and metals, or meet a lawfully enacted local recycling ordinance, if more restrictive.

Exception: Rural jurisdictions that meet and apply for the exemption in Public Resources Code Section 42649.82 (a)(2)(A) et seq. are note required to comply with the organic waste portion of this section.

DIVISION 4.5 ENVIRONMENTAL QUALITY

SECTION 4.501 GENERAL

4.501.1 Scope
The provisions of this chapter shall outline means of reducing the quality of air contaminants that are odorous, irritating and/or harmful to the comfort and well being of a building's installers, occupants and neighbors.

SECTION 4.502 DEFINITIONS

5.102.1 DEFINITIONS
The following terms are defined in Chapter 2 *(and are included here for reference)*

AGRIFIBER PRODUCTS. Agrifiber products include wheatboard, strawboard, panel substrates and door cores, not including furniture, fixtures and equipment (FF&E) not considered base building elements.

COMPOSITE WOOD PRODUCTS. Composite wood products include hardwood plywood, particleboard and medium density fiberboard. "Composite wood products" does not include hardboard, structural plywood, structural panels, structural composite lumber, oriented strand board, glued laminated timber, prefabricated wood I-joists or finger-jointed lumber, all as specified in California Code of regulations (CCR), title 17, Section 93120.1.

DIRECT-VENT APPLIANCE. A fuel-burning appliance with a sealed combustion system that draws all air for combustion from the outside atmosphere and discharges all flue gases to the outside atmosphere.

DISCLAIMER: *THIS DOCUMENT IS PROVIDED AND INTENDED TO BE USED AS A MEANS TO INDICATE AREAS OF COMPLIANCE WITH THE CALIFORNIA GREEN BUILDING STANDARDS (CALGREEN) CODE. DUE TO THE VARIABLES BETWEEN BUILDING DEPARTMENT JURISDICTIONS, THIS CHECKLIST IS TO BE USED ON AN INDIVIDUAL PROJECT BASIS AND MAY BE MODIFIED BY THE END USER TO MEET THOSE INDIVIDUAL NEEDS. THE END USER ASSUMES ALL RESPONSIBILITY ASSOCIATED WITH THE USE OF THIS DOCUMENT, INCLUDING VERIFICATION WITH THE FULL CODE.*

REVISIONS

REV #	DATE	BY

DESIGNERS SIGNATURE

Michelle Miner

THE PLANS, IDEAS AND DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF THE DESIGNER. DRAWN SOLELY FOR THIS PROJECT. PLANS SHALL NOT BE USED, WHOLE OR IN PART, FOR ANY OTHER PURPOSE WITHOUT THE WRITTEN PERMISSION MICHELLE MINER DESIGN

michelle miner design
18488 Prospect Rd. #6 Saratoga, CA 95070
408.396.0984 Shelminer@aol.com

14344 LA RINCONADA DRIVE LOS GATOS CA 95032

DRAWN MM
CHECKED MM
DATE 8/14/2024
SCALE AS SHOWN
JOB NO.

2022 CALIFORNIA GREEN BUILDING STANDARDS CODE
RESIDENTIAL MANDATORY MEASURES, SHEET 2 (January 2023)

A = ARCHITECT C = CONTRACTOR
Y = YES
N/A = NOT APPLICABLE
RESPON. PARTY = RESPONSIBLE PARTY (ie: ARCHITECT, ENGINEER, OWNER, CONTRACTOR, INSPECTOR ETC.)

Y	N/A	RESPON. PARTY
Y	☐	C

MAXIMUM INCREMENTAL REACTIVITY (MIR). The maximum change in weight of ozone formed by adding a compound to the "Base Reactive Organic Gas (ROG) Mixture" per weight of compound added, expressed to hundredths of a gram (g O^3/g ROC).
Note: MIR values for individual compounds and hydrocarbon solvents are specified in CCR, Title 17, Sections 94700 and 94701.

MOISTURE CONTENT. The weight of the water in wood expressed in percentage of the weight of the oven-dry wood.

PRODUCT-WEIGHTED MIR (PWMIR). The sum of all weighted-MIR for all ingredients in a product subject to this article. The PWMIR is the total product reactivity expressed to hundredths of a gram of ozone formed per gram of product (excluding container and packaging).
Note: PWMIR is calculated according to equations found in CCR, Title 17, Section 94521 (a).

REACTIVE ORGANIC COMPOUND (ROC). Any compound that has the potential, once emitted, to contribute to ozone formation in the troposphere.

VOC. A volatile organic compound (VOC) broadly defined as a chemical compound based on carbon chains or rings with vapor pressures greater than 0.1 millimeters of mercury at room temperature. These compounds typically contain hydrogen and may contain oxygen, nitrogen and other elements. See CCR Title 17, Section 94508(a).

4.503 FIREPLACES

Y	N/A	RESPON. PARTY
Y	☐	C

4.503.1 GENERAL. Any installed gas fireplace shall be a direct-vent sealed-combustion type. Any installed woodstove or pellet stove shall comply with U.S. EPA New Source Performance Standards (NSPS) emission limits as applicable, and shall have a permanent label indicating they are certified to meet the emission limits. Woodstoves, pellet stoves and fireplaces shall also comply with applicable local ordinances.

4.504 POLLUTANT CONTROL

Y	N/A	RESPON. PARTY
Y	☐	C

4.504.1 COVERING OF DUCT OPENINGS & PROTECTION OF MECHANICAL EQUIPMENT DURING CONSTRUCTION. At the time of rough installation, during storage on the construction site and until final startup of the heating, cooling and ventilating equipment, all duct and other related air distribution component openings shall be covered with tape, plastic, sheet metal or other methods acceptable to the enforcing agency to reduce the amount of water, dust or debris which may enter the system.

Y	N/A	RESPON. PARTY
Y	☐	C

4.504.2 FINISH MATERIAL POLLUTANT CONTROL. Finish materials shall comply with this section.

Y	N/A	RESPON. PARTY
Y	☐	C

4.504.2.1 Adhesives, Sealants and Caulks. Adhesives, sealant and caulks used on the project shall meet the requirements of the following standards unless more stringent local or regional air pollution or air quality management district rules apply:

1. Adhesives, adhesive bonding primers, adhesive primers, sealants, sealant primers and caulks shall comply with local or regional air pollution control or air quality management district rules where applicable or SCAQMD Rule 1168 VOC limits, as shown in Table 4.504.1 or 4.504.2, as applicable. Such products also shall comply with the Rule 1168 prohibition on the use of certain toxic compounds (chloroform, ethylene dichloride, methylene chloride, perchloroethylene and trichloroethylene), except for aerosol products, as specified in Subsection 2 below.
2. Aerosol adhesives, and smaller unit sizes of adhesives, and sealant or caulking compounds (in units of product, less packaging, which do not weigh more than 1 pound and do not consist of more than 16 fluid ounces) shall comply with statewide VOC standards and other requirements, including prohibitions on use of certain toxic compounds, of *California Code of Regulations* , Title 17, commencing with section 94507.

Y	N/A	RESPON. PARTY
Y	☐	C

4.504.2.2 Paints and Coatings. Architectural paints and coatings shall comply with VOC limits in Table 1 of the ARB Architectural Suggested Control Measure, as shown in Table 4.504.3, unless more stringent local limits apply. The VOC content limit for coatings that do not meet the definitions for the specialty coatings categories listed in Table 4.504.3 shall be determined by classifying the coating as a Flat, Nonflat or Nonflat-High Gloss coating, based on its gloss, as defined in subsections 4.21, 4.36, and 4.37 of the 2007 California Air Resources Board, Suggested Control Measure, and the corresponding Flat, Nonflat or Nonflat-High Gloss VOC limit in Table 4.504.3 shall apply.

Y	N/A	RESPON. PARTY
Y	☐	C

4.504.2.3 Aerosol Paints and Coatings. Aerosol paints and coatings shall meet the Product-weighted MIR Limits for ROC in Section 94522(a)(2) and other requirements, including prohibitions on use of certain toxic compounds and ozone depleting substances, in Sections 94522(e)(1) and (f)(1) of *California Code of Regulations*, Title 17, commencing with Section 94520; and in areas under the jurisdiction of the Bay Area Air Quality Management District additionally comply with the percent VOC by weight of product limits of Regulation 8, Rule 49.

Y	N/A	RESPON. PARTY
Y	☐	C

4.504.2.4 Verification. Verification of compliance with this section shall be provided at the request of the enforcing agency. Documentation may include, but is not limited to, the following:

1. Manufacturer's product specification.
2. Field verification of on-site product containers.

TABLE 4.504.1 - ADHESIVE VOC LIMIT [1,2]
(Less Water and Less Exempt Compounds in Grams per Liter)

ARCHITECTURAL APPLICATIONS	VOC LIMIT
INDOOR CARPET ADHESIVES	50
CARPET PAD ADHESIVES	50
OUTDOOR CARPET ADHESIVES	150
WOOD FLOORING ADHESIVES	100
RUBBER FLOOR ADHESIVES	60
SUBFLOOR ADHESIVES	50
CERAMIC TILE ADHESIVES	65
VCT & ASPHALT TILE ADHESIVES	50
DRYWALL & PANEL ADHESIVES	50
COVE BASE ADHESIVES	50
MULTIPURPOSE CONSTRUCTION ADHESIVE	70
STRUCTURAL GLAZING ADHESIVES	100
SINGLE-PLY ROOF MEMBRANE ADHESIVES	250
OTHER ADHESIVES NOT LISTED	50
SPECIALTY APPLICATIONS	
PVC WELDING	510
CPVC WELDING	490
ABS WELDING	325
PLASTIC CEMENT WELDING	250
ADHESIVE PRIMER FOR PLASTIC	550
CONTACT ADHESIVE	80
SPECIAL PURPOSE CONTACT ADHESIVE	250
STRUCTURAL WOOD MEMBER ADHESIVE	140
TOP & TRIM ADHESIVE	250
SUBSTRATE SPECIFIC APPLICATIONS	
METAL TO METAL	30
PLASTIC FOAMS	50
POROUS MATERIAL (EXCEPT WOOD)	50
WOOD	30
FIBERGLASS	80

1. IF AN ADHESIVE IS USED TO BOND DISSIMILAR SUBSTRATES TOGETHER, THE ADHESIVE WITH THE HIGHEST VOC CONTENT SHALL BE ALLOWED.
2. FOR ADDITIONAL INFORMATION REGARDING METHODS TO MEASURE THE VOC CONTENT SPECIFIED IN THIS TABLE, SEE SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT RULE 1168.

Y	N/A	RESPON. PARTY
Y	☐	C

TABLE 4.504.2 - SEALANT VOC LIMIT
(Less Water and Less Exempt Compounds in Grams per Liter)

SEALANTS	VOC LIMIT
ARCHITECTURAL	250
MARINE DECK	760
NONMEMBRANE ROOF	300
ROADWAY	250
SINGLE-PLY ROOF MEMBRANE	450
OTHER	420
SEALANT PRIMERS	
ARCHITECTURAL	
NON-POROUS	250
POROUS	775
MODIFIED BITUMINOUS	500
MARINE DECK	760
OTHER	750

TABLE 4.504.3 - VOC CONTENT LIMITS FOR ARCHITECTURAL COATINGS [2,3]
GRAMS OF VOC PER LITER OF COATING, LESS WATER & LESS EXEMPT COMPOUNDS

COATING CATEGORY	VOC LIMIT
FLAT COATINGS	50
NON-FLAT COATINGS	100
NONFLAT-HIGH GLOSS COATINGS	150
SPECIALTY COATINGS	
ALUMINUM ROOF COATINGS	400
BASEMENT SPECIALTY COATINGS	400
BITUMINOUS ROOF COATINGS	50
BITUMINOUS ROOF PRIMERS	350
BOND BREAKERS	350
CONCRETE CURING COMPOUNDS	350
CONCRETE/MASONRY SEALERS	100
DRIVEWAY SEALERS	50
DRY FOG COATINGS	150
FAUX FINISHING COATINGS	350
FIRE RESISTIVE COATINGS	350
FLOOR COATINGS	100
FORM-RELEASE COMPOUNDS	250
GRAPHIC ARTS COATINGS (SIGN PAINTS)	500
HIGH TEMPERATURE COATINGS	420
INDUSTRIAL MAINTENANCE COATINGS	250
LOW SOLIDS COATINGS [1]	120
MAGNESITE CEMENT COATINGS	450
MASTIC TEXTURE COATINGS	100
METALLIC PIGMENTED COATINGS	500
MULTICOLOR COATINGS	250
PRETREATMENT WASH PRIMERS	420
PRIMERS, SEALERS, & UNDERCOATERS	100
REACTIVE PENETRATING SEALERS	350
RECYCLED COATINGS	250
ROOF COATINGS	50
RUST PREVENTATIVE COATINGS	250
SHELLACS	
CLEAR	730
OPAQUE	550
SPECIALTY PRIMERS, SEALERS & UNDERCOATERS	100
STAINS	250
STONE CONSOLIDANTS	450
SWIMMING POOL COATINGS	340
TRAFFIC MARKING COATINGS	100
TUB & TILE REFINISH COATINGS	420
WATERPROOFING MEMBRANES	250
WOOD COATINGS	275
WOOD PRESERVATIVES	350
ZINC-RICH PRIMERS	340

1. GRAMS OF VOC PER LITER OF COATING, INCLUDING WATER & EXEMPT COMPOUNDS
2. THE SPECIFIED LIMITS REMAIN IN EFFECT UNLESS REVISED LIMITS ARE LISTED IN SUBSEQUENT COLUMNS IN THE TABLE.
3. VALUES IN THIS TABLE ARE DERIVED FROM THOSE SPECIFIED BY THE CALIFORNIA AIR RESOURCES BOARD, ARCHITECTURAL COATINGS SUGGESTED CONTROL MEASURE, FEB. 1, 2008. MORE INFORMATION IS AVAILABLE FROM THE AIR RESOURCES BOARD.

Y	N/A	RESPON. PARTY
Y	☐	C

TABLE 4.504.5 - FORMALDEHYDE LIMITS [1]
MAXIMUM FORMALDEHYDE EMISSIONS IN PARTS PER MILLION

PRODUCT	CURRENT LIMIT
HARDWOOD PLYWOOD VENEER CORE	0.05
HARDWOOD PLYWOOD COMPOSITE CORE	0.05
PARTICLE BOARD	0.09
MEDIUM DENSITY FIBERBOARD	0.11
THIN MEDIUM DENSITY FIBERBOARD [2]	0.13

1. VALUES IN THIS TABLE ARE DERIVED FROM THOSE SPECIFIED BY THE CALIF. AIR RESOURCES BOARD, AIR TOXICS CONTROL MEASURE FOR COMPOSITE WOOD AS TESTED IN ACCORDANCE WITH ASTM E 1333. FOR ADDITIONAL INFORMATION, SEE CALIF. CODE OF REGULATIONS, TITLE 17, SECTIONS 93120 THROUGH 93120.12.
2. THIN MEDIUM DENSITY FIBERBOARD HAS A MAXIMUM THICKNESS OF 5/16" (8 MM).

DIVISION 4.5 ENVIRONMENTAL QUALITY (continued)

Y	N/A	RESPON. PARTY
Y	☐	C

4.504.3 CARPET SYSTEMS. All carpet installed in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specification 01350)

See California Department of Public Health's website for certification programs and testing labs.

https://www.cdph.ca.gov/Programs/CCDPHP/DEODC/EHLB/IAQ/Pages/VOC.aspx.

Y	N/A	RESPON. PARTY
Y	☐	C

4.504.3.1 Carpet cushion. All carpet cushion installed in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specification 01350)

See California Department of Public Health's website for certification programs and testing labs.

https://www.cdph.ca.gov/Programs/CCDPHP/DEODC/EHLB/IAQ/Pages/VOC.aspx.

Y	N/A	RESPON. PARTY
Y	☐	C

4.504.3.2 Carpet adhesive. All carpet adhesive shall meet the requirements of Table 4.504.1.

Y	N/A	RESPON. PARTY
Y	☐	C

4.504.4 RESILIENT FLOORING SYSTEMS. Where resilient flooring is installed , at least 80% of floor area receiving resilient flooring shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specification 01350)

See California Department of Public Health's website for certification programs and testing labs.

hhttps://www.cdph.ca.gov/Programs/CCDPHP/DEODC/EHLB/IAQ/Pages/VOC.aspx.

Y	N/A	RESPON. PARTY
Y	☐	C

4.504.5 COMPOSITE WOOD PRODUCTS. Hardwood plywood, particleboard and medium density fiberboard composite wood products used on the interior or exterior of the buildings shall meet the requirements for formaldehyde as specified in ARB's Air Toxics Control Measure for Composite Wood (17 CCR 93120 et seq.), by or before the dates specified in those sections, as shown in Table 4.504.5

Y	N/A	RESPON. PARTY
Y	☐	C

4.504.5.1 Documentation. Verification of compliance with this section shall be provided as requested by the enforcing agency. Documentation shall include at least one of the following:

1. Product certifications and specifications.
2. Chain of custody certifications.
3. Product labeled and invoiced as meeting the Composite Wood Products regulation (see CCR, Title 17, Section 93120, et seq.).
4. Exterior grade products marked as meeting the PS-1 or PS-2 standards of the Engineered Wood Association, the Australian AS/NZS 2269, European 636 3S standards, and Canadian CSA 0121, CSA 0151, CSA 0153 and CSA 0325 standards.
5. Other methods acceptable to the enforcing agency.

4.505 INTERIOR MOISTURE CONTROL

Y	N/A	RESPON. PARTY
Y	☐	C

4.505.1 General. Buildings shall meet or exceed the provisions of the *California Building Standards Code* .

Y	N/A	RESPON. PARTY
Y	☐	C

4.505.2 CONCRETE SLAB FOUNDATIONS. Concrete slab foundations required to have a vapor retarder by California Building Code, Chapter 19, or concrete slab-on-ground floors required to have a vapor retarder by the California Residential Code, Chapter 5, shall also comply with this section.

Y	N/A	RESPON. PARTY
Y	☐	C

4.505.2.1 Capillary break. A capillary break shall be installed in compliance with at least one of the following:

1. A 4-inch (101.6 mm) thick base of 1/2 inch (12.7mm) or larger clean aggregate shall be provided with a vapor barrier in direct contact with concrete and a concrete mix design, which will address bleeding, shrinkage, and curling, shall be used. For additional information, see American Concrete Institute, ACI 302.2R-06.
2. Other equivalent methods approved by the enforcing agency.
3. A slab design specified by a licensed design professional.

Y	N/A	RESPON. PARTY
Y	☐	C

4.505.3 MOISTURE CONTENT OF BUILDING MATERIALS. Building materials with visible signs of water damage shall not be installed. Wall and floor framing shall not be enclosed when the framing members exceed 19 percent moisture content. Moisture content shall be verified in compliance with the following:

1. Moisture content shall be determined with either a probe-type or contact-type moisture meter.Equivalent moisture verification methods may be approved by the enforcing agency and shall satisfy requirements found in Section 101.8 of this code.
2. Moisture readings shall be taken at a point 2 feet (610 mm) to 4 feet (1219 mm) from the grade stamped end of each piece verified.
3. At least three random moisture readings shall be performed on wall and floor framing with documentation acceptable to the enforcing agency provided at the time of approval to enclose the wall and floor framing.

Insulation products which are visibly wet or have a high moisture content shall be replaced or allowed to dry prior to enclosure in wall or floor cavities. Wet-applied insulation products shall follow the manufacturers' drying recommendations prior to enclosure.

4.506 INDOOR AIR QUALITY AND EXHAUST

Y	N/A	RESPON. PARTY
Y	☐	C

4.506.1 Bathroom exhaust fans. Each bathroom shall be mechanically ventilated and shall comply with the following:

1. Fans shall be ENERGY STAR compliant and be ducted to terminate outside the building.
2. Unless functioning as a component of a whole house ventilation system, fans must be controlled by a humidity control.
   a. Humidity controls shall be capable of adjustment between a relative humidity range less than or equal to 50% to a maximum of 80%. A humidity control may utilize manual or automatic means of adjustment.
   b. A humidity control may be a separate component to the exhaust fan and is not required to be integral (i.e., built-in)

Notes:

1. For the purposes of this section, a bathroom is a room which contains a bathtub, shower or tub/shower combination.
2. Lighting integral to bathroom exhaust fans shall comply with the *California Energy Code*.

4.507 ENVIRONMENTAL COMFORT

Y	N/A	RESPON. PARTY
Y	☐	C

4.507.2 HEATING AND AIR-CONDITIONING SYSTEM DESIGN. Heating and air conditioning systems shall be sized, designed and have their equipment selected using the following methods:

1. The heat loss and heat gain is established according to ANSI/ACCA 2 Manual J - 2011 (Residential Load Calculation), ASHRAE handbooks or other equivalent design software or methods.
2. Duct systems are sized according to ANSI/ACCA 1 Manual D - 2014 (Residential Duct Systems), ASHRAE handbooks or other equivalent design software or methods.
3. Select heating and cooling equipment according to ANSI/ACCA 3 Manual S - 2014 (Residential Equipment Selection), or other equivalent design software or methods.

Exception: Use of alternate design temperatures necessary to ensure the system functions are acceptable.

Y	N/A	RESPON. PARTY
Y	☐	C

CHAPTER 7
INSTALLER & SPECIAL INSPECTOR QUALIFICATIONS

702 QUALIFICATIONS

Y	N/A	RESPON. PARTY
Y	☐	C

702.1 INSTALLER TRAINING. HVAC system installers shall be trained and certified in the proper installation of HVAC systems including ducts and equipment by a nationally or regionally recognized training or certification program. Uncertified persons may perform HVAC installations when under the direct supervision and responsibility of a person trained and certified to install HVAC systems or contractor licensed to install HVAC systems. Examples of acceptable HVAC training and certification programs include but are not limited to the following:

1. State certified apprenticeship programs.
2. Public utility training programs.
3. Training programs sponsored by trade, labor or statewide energy consulting or verification organizations.
4. Programs sponsored by manufacturing organizations.
5. Other programs acceptable to the enforcing agency.

Y	N/A	RESPON. PARTY
Y	☐	C

702.2 SPECIAL INSPECTION [HCD]. When required by the enforcing agency, the owner or the responsible entity acting as the owner's agent shall employ one or more special inspectors to provide inspection or other duties necessary to substantiate compliance with this code. Special inspectors shall demonstrate competence to the satisfaction of the enforcing agency for the particular type of inspection or task to be performed. In addition to other certifications or qualifications acceptable to the enforcing agency, the following certifications or education may be considered by the enforcing agency when evaluating the qualifications of a special inspector:

1. Certification by a national or regional green building program or standard publisher.
2. Certification by a statewide energy consulting or verification organization, such as HERS raters, building performance contractors, and home energy auditors.
3. Successful completion of a third party apprentice training program in the appropriate trade.
4. Other programs acceptable to the enforcing agency.

Notes:

1. Special inspectors shall be independent entities with no financial interest in the materials or the project they are inspecting for compliance with this code.
2. HERS raters are special inspectors certified by the California Energy Commission (CEC) to rate homes in California according to the Home Energy Rating System (HERS).

[BSC] When required by the enforcing agency, the owner or the responsible entity acting as the owner's agent shall employ one or more special inspectors to provide inspection or other duties necessary to substantiate compliance with this code. Special inspectors shall demonstrate competence to the satisfaction of the enforcing agency for the particular type of inspection or task to be performed. In addition, the special inspector shall have a certification from a recognized state, national or international association, as determined by the local agency. The area of certification shall be closely related to the primary job function, as determined by the local agency.

Note: Special inspectors shall be independent entities with no financial interest in the materials or the project they are inspecting for compliance with this code.

703 VERIFICATIONS

703.1 DOCUMENTATION. Documentation used to show compliance with this code shall include but is not limited to, construction documents, plans, specifications, builder or installer certification, inspection reports, or other methods acceptable to the enforcing agency which demonstrate substantial conformance. When specific documentation or special inspection is necessary to verify compliance, that method of compliance will be specified in the appropriate section or identified applicable checklist.

DISCLAIMER: *THIS DOCUMENT IS PROVIDED AND INTENDED TO BE USED AS A MEANS TO INDICATE AREAS OF COMPLIANCE WITH THE CALIFORNIA GREEN BUILDING STANDARDS (CALGREEN) CODE. DUE TO THE VARIABLES BETWEEN BUILDING DEPARTMENT JURISDICTIONS, THIS CHECKLIST IS TO BE USED ON AN INDIVIDUAL PROJECT BASIS AND MAY BE MODIFIED BY THE END USER TO MEET THOSE INDIVIDUAL NEEDS. THE END USER ASSUMES ALL RESPONSIBILITY ASSOCIATED WITH THE USE OF THIS DOCUMENT, INCLUDING VERIFICATION WITH THE FULL CODE.*

REVISIONS

REV #	DATE	BY

DESIGNERS SIGNATURE

Michelle Miner

THE PLANS, IDEAS AND DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF THE DESIGNER. DRAWN SOLELY FOR THIS PROJECT. PLANS SHALL NOT BE USED, WHOLE OR IN PART, FOR ANY OTHER PURPOSE WITHOUT THE WRITTEN PERMISSION MICHELLE MINER DESIGN

michelle miner design
18488 Prospect Rd. #6 Saratoga, CA 95070
408.396.0984 Shelminer@aol.com

14344 LA RINCONADA DRIVE LOS GATOS CA 95032

DRAWN	MM
CHECKED	MM
DATE	8/14/2024
SCALE	AS SHOWN
JOB NO.	

PAGE: 5/15

GREEN CHECKLIST 2

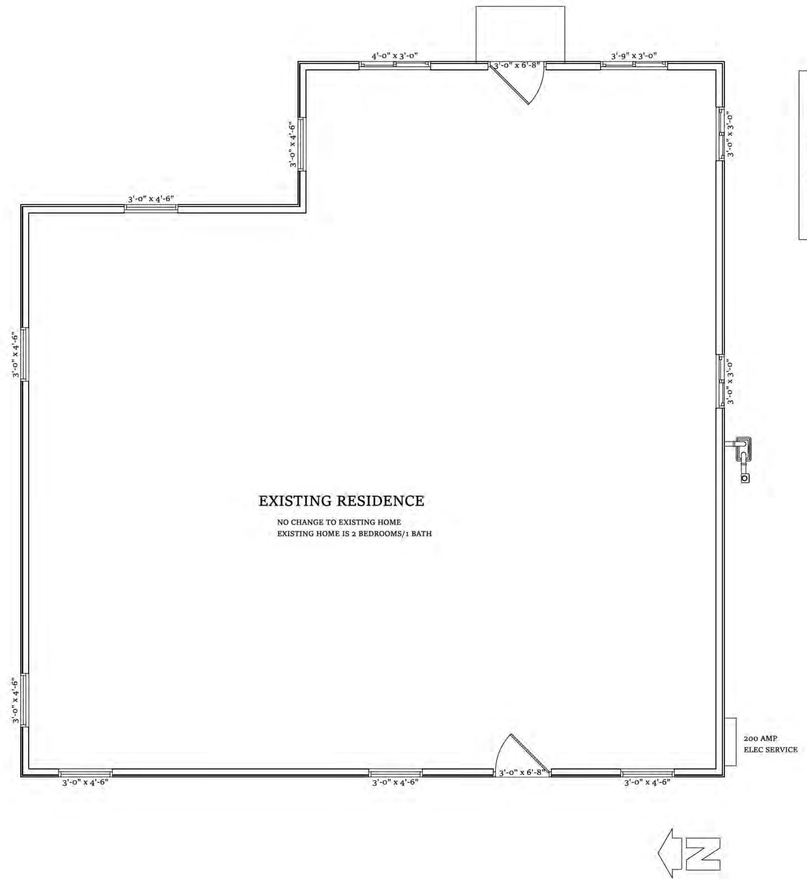

LEGEND

EXISTING WALLS

WALLS TO BE REMOVED

CITY STAMP AREA

EXISTING FLOOR PLAN

SCALE: 1/4" = 1'-0"

REVISIONS

REV #	DATE	BY

DESIGNERS SIGNATURE

Michelle Miner

THE PLANS, IDEAS AND DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF THE DESIGNER. DEVISED SOLELY FOR THIS PROJECT. PLANS SHALL NOT BE USED, WHOLE OR IN PART, FOR ANY OTHER PURPOSE WITHOUT THE WRITTEN PERMISSION MICHELLE MINER DESIGN

michelle miner design
18488 Prospect Rd. #6 Saratoga, CA 95070
408.396.0984 Shelminer@aol.com

14344 LA RINCONADA DRIVE LOS GATOS CA 95032

DRAWN
MM

CHECKED
MM

DATE
8/14/2024

SCALE
AS SHOWN

JOB NO.

PAGE:
6/15

EXISTING FLOOR PLAN

* NOTE TO CONTRACTOR *

THE CONTRACTOR AND/OR SUPPLIER OF MATERIALS SHALL NOT SCALE ANY DIMENSIONS FOR CONSTRUCTION PURPOSES. IN THE EVENT A DIMENSION IS REQUIRED THAT DOES NOT OCCUR ON THE DRAWINGS AND/OR A DIMENSION ERROR IS FOUND ON THE DRAWINGS. THE CONTRACTOR AND/OR SUPPLIER OF MATERIALS WILL NOTIFY THE OFFICE OF MICHELLE MINER DESIGN. AND REQUIRES ASSISTANCE AS SOON AS POSSIBLE. IF ANY ERROR IS FOUND ON PLAN OF ANY KIND NOTIFY MICHELLE MINER DESIGN THE CONTRACTOR AND/OR SUPPLIER OF MATERIALS SHALL BE SOLELY RESPONSIBLE FOR THE RESULTS OF ERRORS, DISCREPANCIES AND OMISSIONS WHICH THE CONTRACTOR AND/OR MATERIAL SUPPLIER FAILED TO NOTIFY THE OFFICE OF MICHELLE MINER DESIGN. PRIOR TO CONSTRUCTION AND/OR FABRICATION OF THE WORK. NO DEVIATION FROM THE PLANS IN ANY WAY SHALL BE MADE WITHOUT THE WRITTEN CONSENT OF MICHELLE MINER DESIGN. APPROVAL BY THE CITY INSPECTOR DOES NOT CONSTITUTE AUTHORITY TO DEVIATE FROM THE PLANS OR OTHER DOCUMENTS PROVIDED BY THE OFFICE OF MICHELLE MINER DESIGN.

LEGEND

EXISTING WALLS

NEW WALLS

ALL NEW EXTERIOR WALLS TO BE 2X4
ALL NEW INTERIOR WALLS TO BE 2X4

NOTES

SEE WINDOW AND DOOR SHEET FOR MORE DETAILS
CONTRACTOR TO FIELD VERIFY ALL EXISTING OPENINGS SIZES BEFORE ORDERING WINDOWS AND DOORS

ATTIC VENTILATION CALC'S:

120 S.F./ 150 = 0.8 S.F.
BALANCE 50% INTAKE, 50% EXHAUST = 0.4 S.F.
0.4 S.F. (144) = 57.6 S.I. INTAKE AND 57.6 S.I. EXHAUST

INTAKE DRILLED EAVE VENTS
32 L.F./ 1.33 = 24 BLKS
24 BLKS (3) = 72 HOLES
72 (3.142)(1.563) = 353 S.I.

EXHAUST VENTS
16 LINEAR FEET OF RIDGE
55 LINEAR FEET (18) S.I. PER FOOT = 280 S.I.
(OR GABLE VENTS OR COMBINATION)

* DRILL ALL 2X BLOCKING W/ (3) 2 1/2" DIA. HOLES & 2" CONT. SCREENED VENTS

50% OF THE REQUIRED VENTILATING AREA WILL BE PROVIDED BY VENTILATORS LOCATED IN THE UPPER PORTION OF THE SPACE TO BE VENTILATED AT LEAST 3 FEET ABOVE EAVE OR CORNICE VENTS WITH THE BALANCE OF THE REQUIRED VENTILATION PROVIDED BY EAVE OR CORNICE VENTS.

FOUNDATION VENTILATION CALC'S:

120 S.F./ 150 / .58 = 2 VENTS SPACED EQ.

FOR CROSS VENTILATION. USE 6"X 14" VULCAN SCREENED FND VENTS OR APPROVED EQ.

REPLACE ANY VENTS THAT ARE COVERED BY NEW CONSTRUCTION

DRYER MOISTURE EXHAUST DUCT TO OUTSIDE OF BUILDING WITH BACKDRAFT DAMPER, MAXIMUM COMBINED LENGTH OF 14 FEET w/ 2 ELBOWS UNLESS OTHERWISE PERMITTED BY MANUFACTURER AND APPROVED BY BUILDING OFFICIAL; MAINTAIN MIN. 36" SEPARATION FROM BUILDING OPENINGS AT EXHAUST WALL VENT

PROVIDE RECESSED DRYER VENT BOX AND RECESSED WASHER HOOK UPS. SEE DETAIL 17 ON INTERIOR FINISH SHEET FOR CONCEPT. CONTRACTOR TO SELECT BOXES
VERIFY LOCATION OF DRYER VENT WITH OWNERS DRYER TO INSURE PROPER INSTALL LOCATION

A) DOOR SHALL HAVE A MINIMUM CLEAR HEIGHT OF 80 INCHES, MEASURED FROM THE TOP OF THE THRESHOLD TO THE BOTTOM OF THE STOP
B) DOOR SHALL BE READILY OPENABLE FROM THE INSIDE THE DWELLING WITHOUT THE USE OF A KEY OR SPECIAL KNOWLEDGE OR EFFORT.
C) A SLOPE AT THE EXTERIOR LANDING SHALL NOT EXCEED 2%. CRC R311.3.
D) LANDING AT THE EGRESS DOOR SHALL NOT BE MORE THAN ½ INCHES LOWER THAN THE TOP OF THE THRESHOLD. LANDING SHALL NOT BE MORE THAN 7.75 INCHES LOWER THAN THE TOP OF THE THRESHOLD WHERE DOOR DOES NOT SWING OVER THE LANDING. CRC R311.3.1

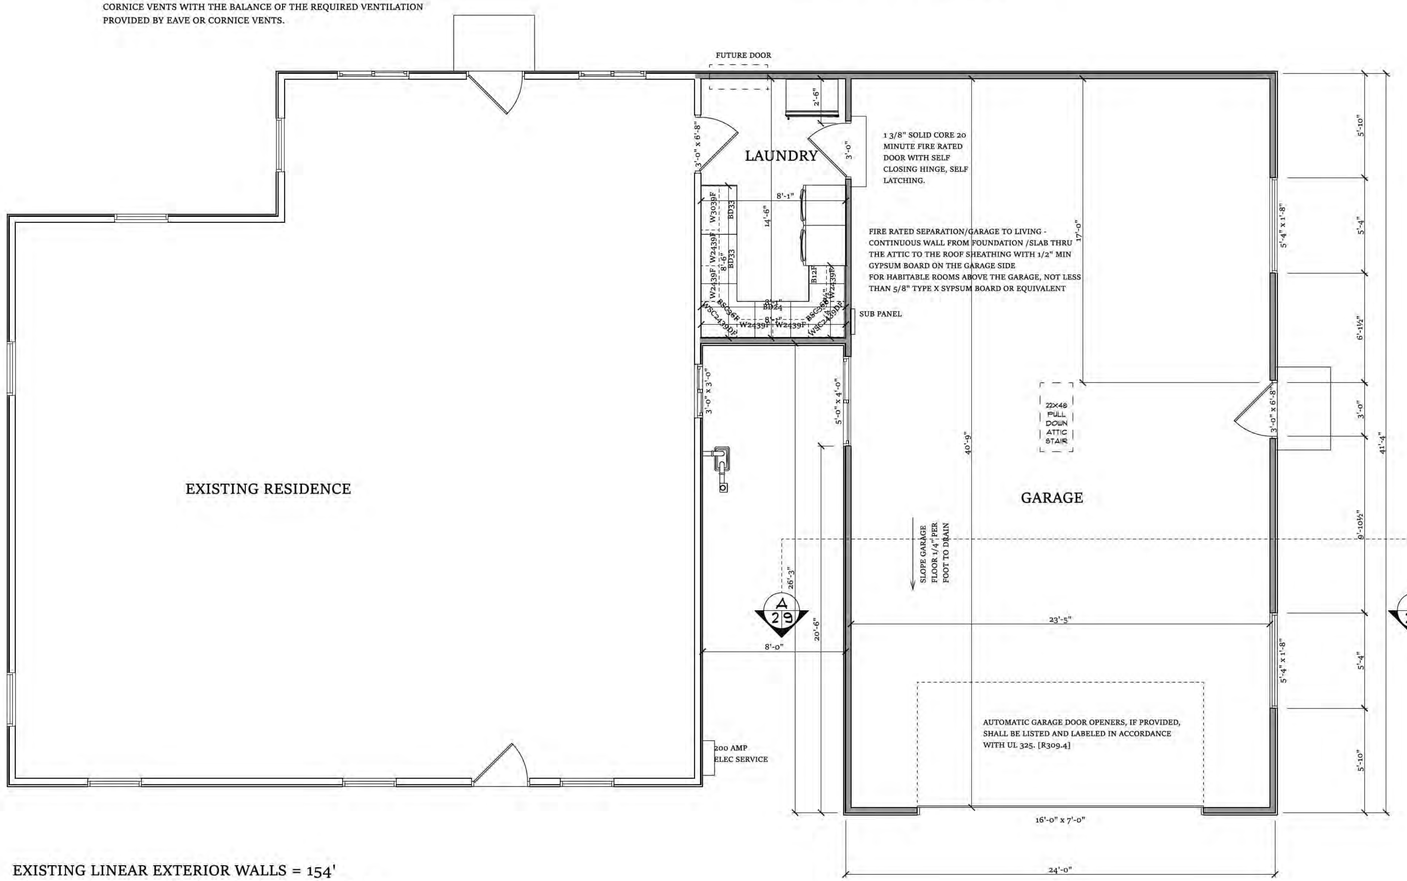

CITY STAMP AREA

EXISTING LINEAR EXTERIOR WALLS = 154'
EXTERIOR WALLS TO BE REMOVED = 15' (10%)

NO WALLS REMOVED FROM FRONT OF EXISTING HOME

NEW FLOOR PLAN

SCALE: 1/4" = 1'-0"

N

REVISIONS

REV #	DATE	BY

DESIGNERS SIGNATURE

Michelle Miner

THE PLANS, IDEAS AND DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF THE DESIGNER. DEVISED SOLELY FOR THIS PROJECT. PLANS SHALL NOT BE USED, WHOLE OR IN PART, FOR ANY OTHER PURPOSE WITHOUT THE WRITTEN PERMISSION MICHELLE MINER DESIGN

michelle miner design
18488 Prospect Rd. #6 Saratoga, CA 95070
408.396.0984 Shelminer@aol.com

14344 LA RINCONADA DRIVE LOS GATOS CA 95032

DRAWN	MM
CHECKED	MM
DATE	8/14/2024
SCALE	AS SHOWN
JOB NO.	

PAGE: 7/15

NEW FLOOR PLAN

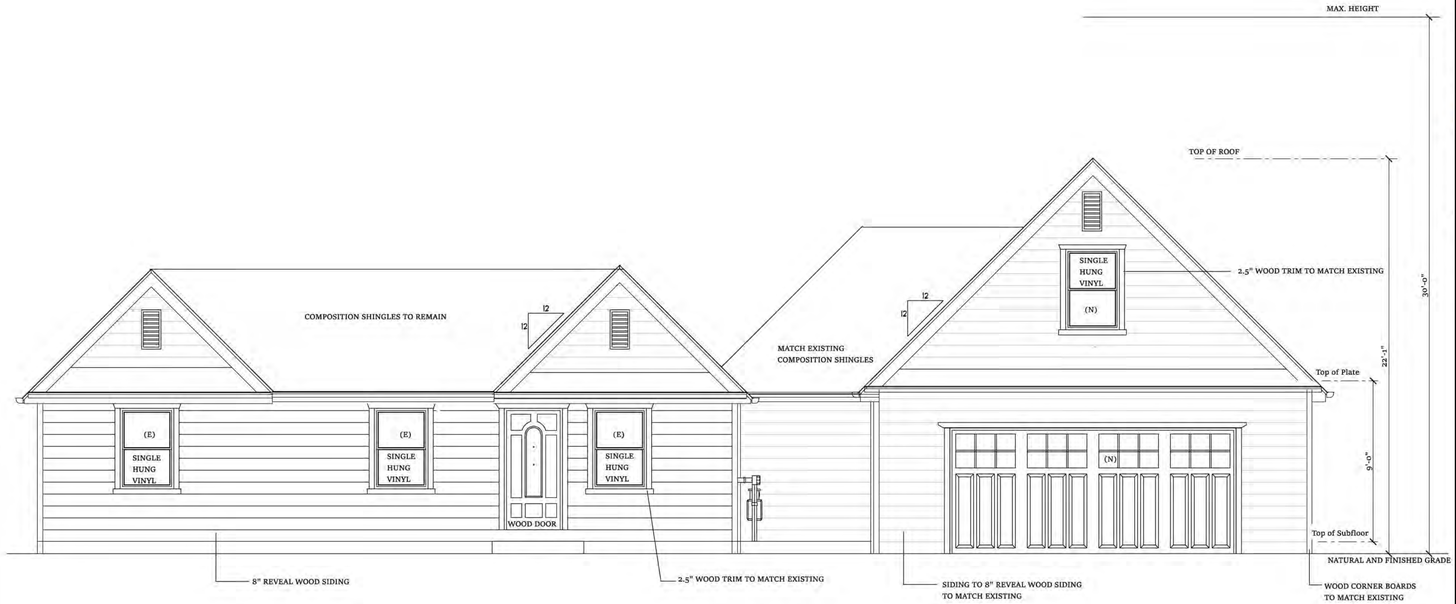

1/4" FRONT ELEVATION

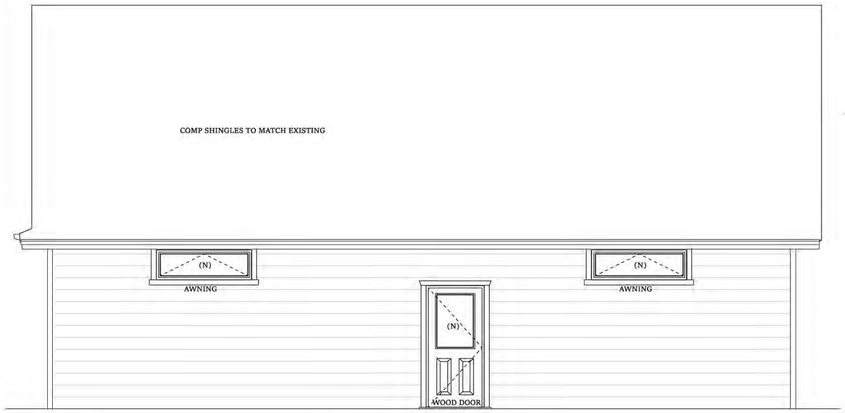

1/4" RIGHT SIDE ELEVATION

1/4" REAR ELEVATION

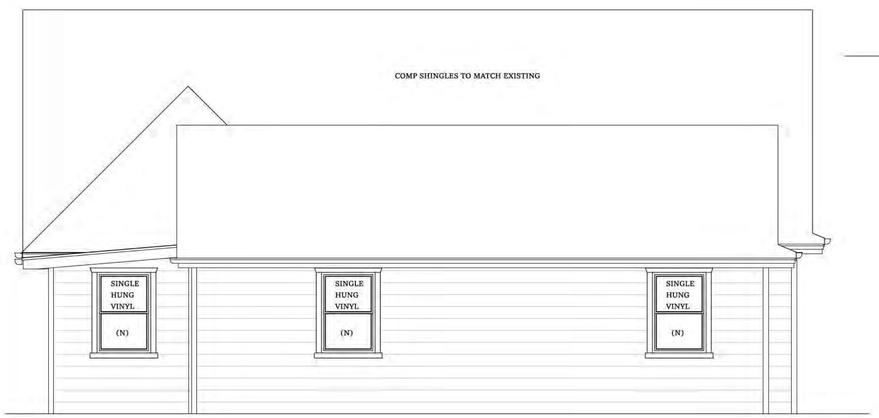

1/4" LEFT SIDE ELEVATION

REVISIONS

REV #	DATE	BY

DESIGNERS SIGNATURE

Michelle Miner

THE PLANS, IDEAS AND DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF THE DESIGNER. DEVISED SOLELY FOR THIS PROJECT. PLANS SHALL NOT BE USED, WHOLE OR IN PART, FOR ANY OTHER PURPOSE WITHOUT THE WRITTEN PERMISSION MICHELLE MINER DESIGN

michelle miner design
18488 Prospect Rd. #6 Saratoga, CA 95070
408.396.0984 Shelminer@aol.com

14344 LA RINCONADA DRIVE LOS GATOS CA 95032

DRAWN
MM
CHECKED
MM
DATE
8/14/2024
SCALE
AS SHOWN
JOB NO.

PAGE:
8/15
EXTERIOR ELEVATIONS

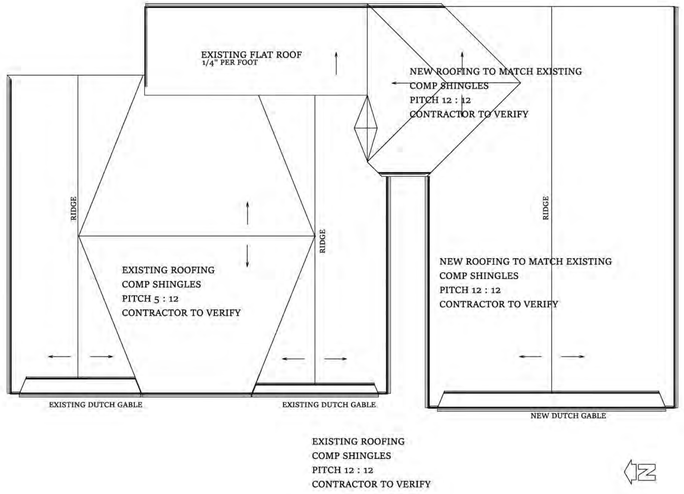

ROOF PLAN

SCALE: 1/8" = 1'-0"

ROOF PLAN NOTES

ROOFING:
CLASS "A" COMPOSITION SHINGLES, COLOR TO BE SELECTED BY OWNER.
OVER MIN.15 LB. ROOFING FELT.INSTALL PER MANUF. SPECS
ROOFING FASTENERS ARE TO BE CORROSION RESISTANT IN ACCORDANCE WITH CRC R905.2.5

BUILT-UP ROOF, CLASS "A"

28 LB BASE PLY, ATTACHED MECHANICALLY 9" OC EDGES, AND 18" OC FIELD. INNER PLIES, 11 LB. FELT W/ MIN. 25 LB. MOPPING. 78 LB. MINERAL SURFACE CAP SHEET. MIN. SLOPE AT BUILT-UP ROOF: 1/2" PER FOOT.
(WATER TO DRAIN ONTO SLOPED ROOF.)

FLASHING & COUNTERFLASHING:

26 GAUGE STEEL, U.O.N., AS REQUIRED AT JUNCTURE OF ROOF AND VERTICAL SURFACES. SEE SHEET METAL NOTES ON NOTES SHEET

VALLEY FLASHING:

26 GAUGE GALV. STEEL OVER 15 LB. FELT. CRICKETS SIMILAR.

GUTTERS & DOWNSPOUTS:

5" GALV. STEEL GUTTER O OR MATCH EXISTING STYLE IF REMODEL

2 1/4" DIA ROUND GALV. STEEL DOWN SPOUTS. PROVIDE BASKET STRAINER AND SPLASH-BLOCK AT EACH DOWNSPOUT AT GROUND LEVEL..

SKYLIGHTS:

USE VELUX RESIDENTIAL, WDMA (WINDOW AND DOOR MANUFACTURING ASSOCIATION) HALLMARK CERTIFICATION #426-H-679 (FOR VENTED) AND #426-H-675 (FOR FIXED). SEE PLAN FOR SKYLIGHT SIZE. PER CRC R308.6.9 TESTING AND LABELING:UNIT SKYLIGHTS SHALL BE TESTED BY AN APPROVED INDEPENDENT LAB, AND BEAR A LABEL IDENTIFYING MANUFACTURER, PERFORMANCE GRADE RATING, AND APPROVED INSPECTION AGENCY TO INDICATE COMPLIANCE WITH THE REQUIREMENTS OF AAMA/WDMA 101/I.S.2/NAFS.

PLUMBING VENTS:

PLUMBING WASTE VENTS SHALL TERMINATE NOT LESS THAN 10 FEEF FROM, OR NOT LESS THAN 3 FEET ABOVE AN OPENABLE WINDOW, DOOR, OPENING, AIR INTAKE, OR VENT SHAFT OR NOT LESS THAN 3 FEET IN EVERY DIRECTION FROM A LOT LINE, ALLEY AND STREET EXCEPTED. CPC 906.2

ROOF INSULATION NOTES:
MAINTAIN MIN 1" AIRSPACE BEIWEEN THERMAL BATT INSULATION AND ROOF SHEATHING. BAFFLE INSULATION AT VENTS AS NECESSARY.
AT FRAMING CAVITIES THAT CANNOT BE PROPERLY VENTED, FILL CAVITY WITH SPRAY-IN-PLACE MEDIUM-DENSITY SEMI-RIGID CLOSED-CELL POLYUREIHANE FOAM INSULATION. COMPLIES AS AIR BARRIER AND THERMAL INSULATION IN COMPLIANCE WITH CRC R806.5

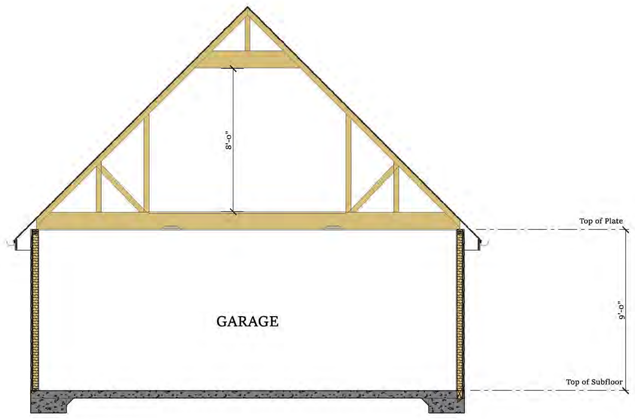

CROSS SECTION A

A 2|9

SCALE: 1/4" = 1'-0"

REVISIONS

REV #	DATE	BY

DESIGNERS SIGNATURE

Michelle Miner

THE PLANS, IDEAS AND DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF THE DESIGNER. DEVISED SOLELY FOR THIS PROJECT. PLANS SHALL NOT BE USED, WHOLE OR IN PART, FOR ANY OTHER PURPOSE WITHOUT THE WRITTEN PERMISSION MICHELLE MINER DESIGN

michelle miner design
18488 Prospect Rd. #6 Saratoga, CA 95070
408.396.0984 Shelminer@aol.com

14344 LA RINCONADA DRIVE LOS GATOS CA 95032

DRAWN	MM
CHECKED	MM
DATE	8/14/2024
SCALE	AS SHOWN
JOB NO.	
PAGE:	9/15

SECTIONS & ROOF PLAN

LED
LED
LED