



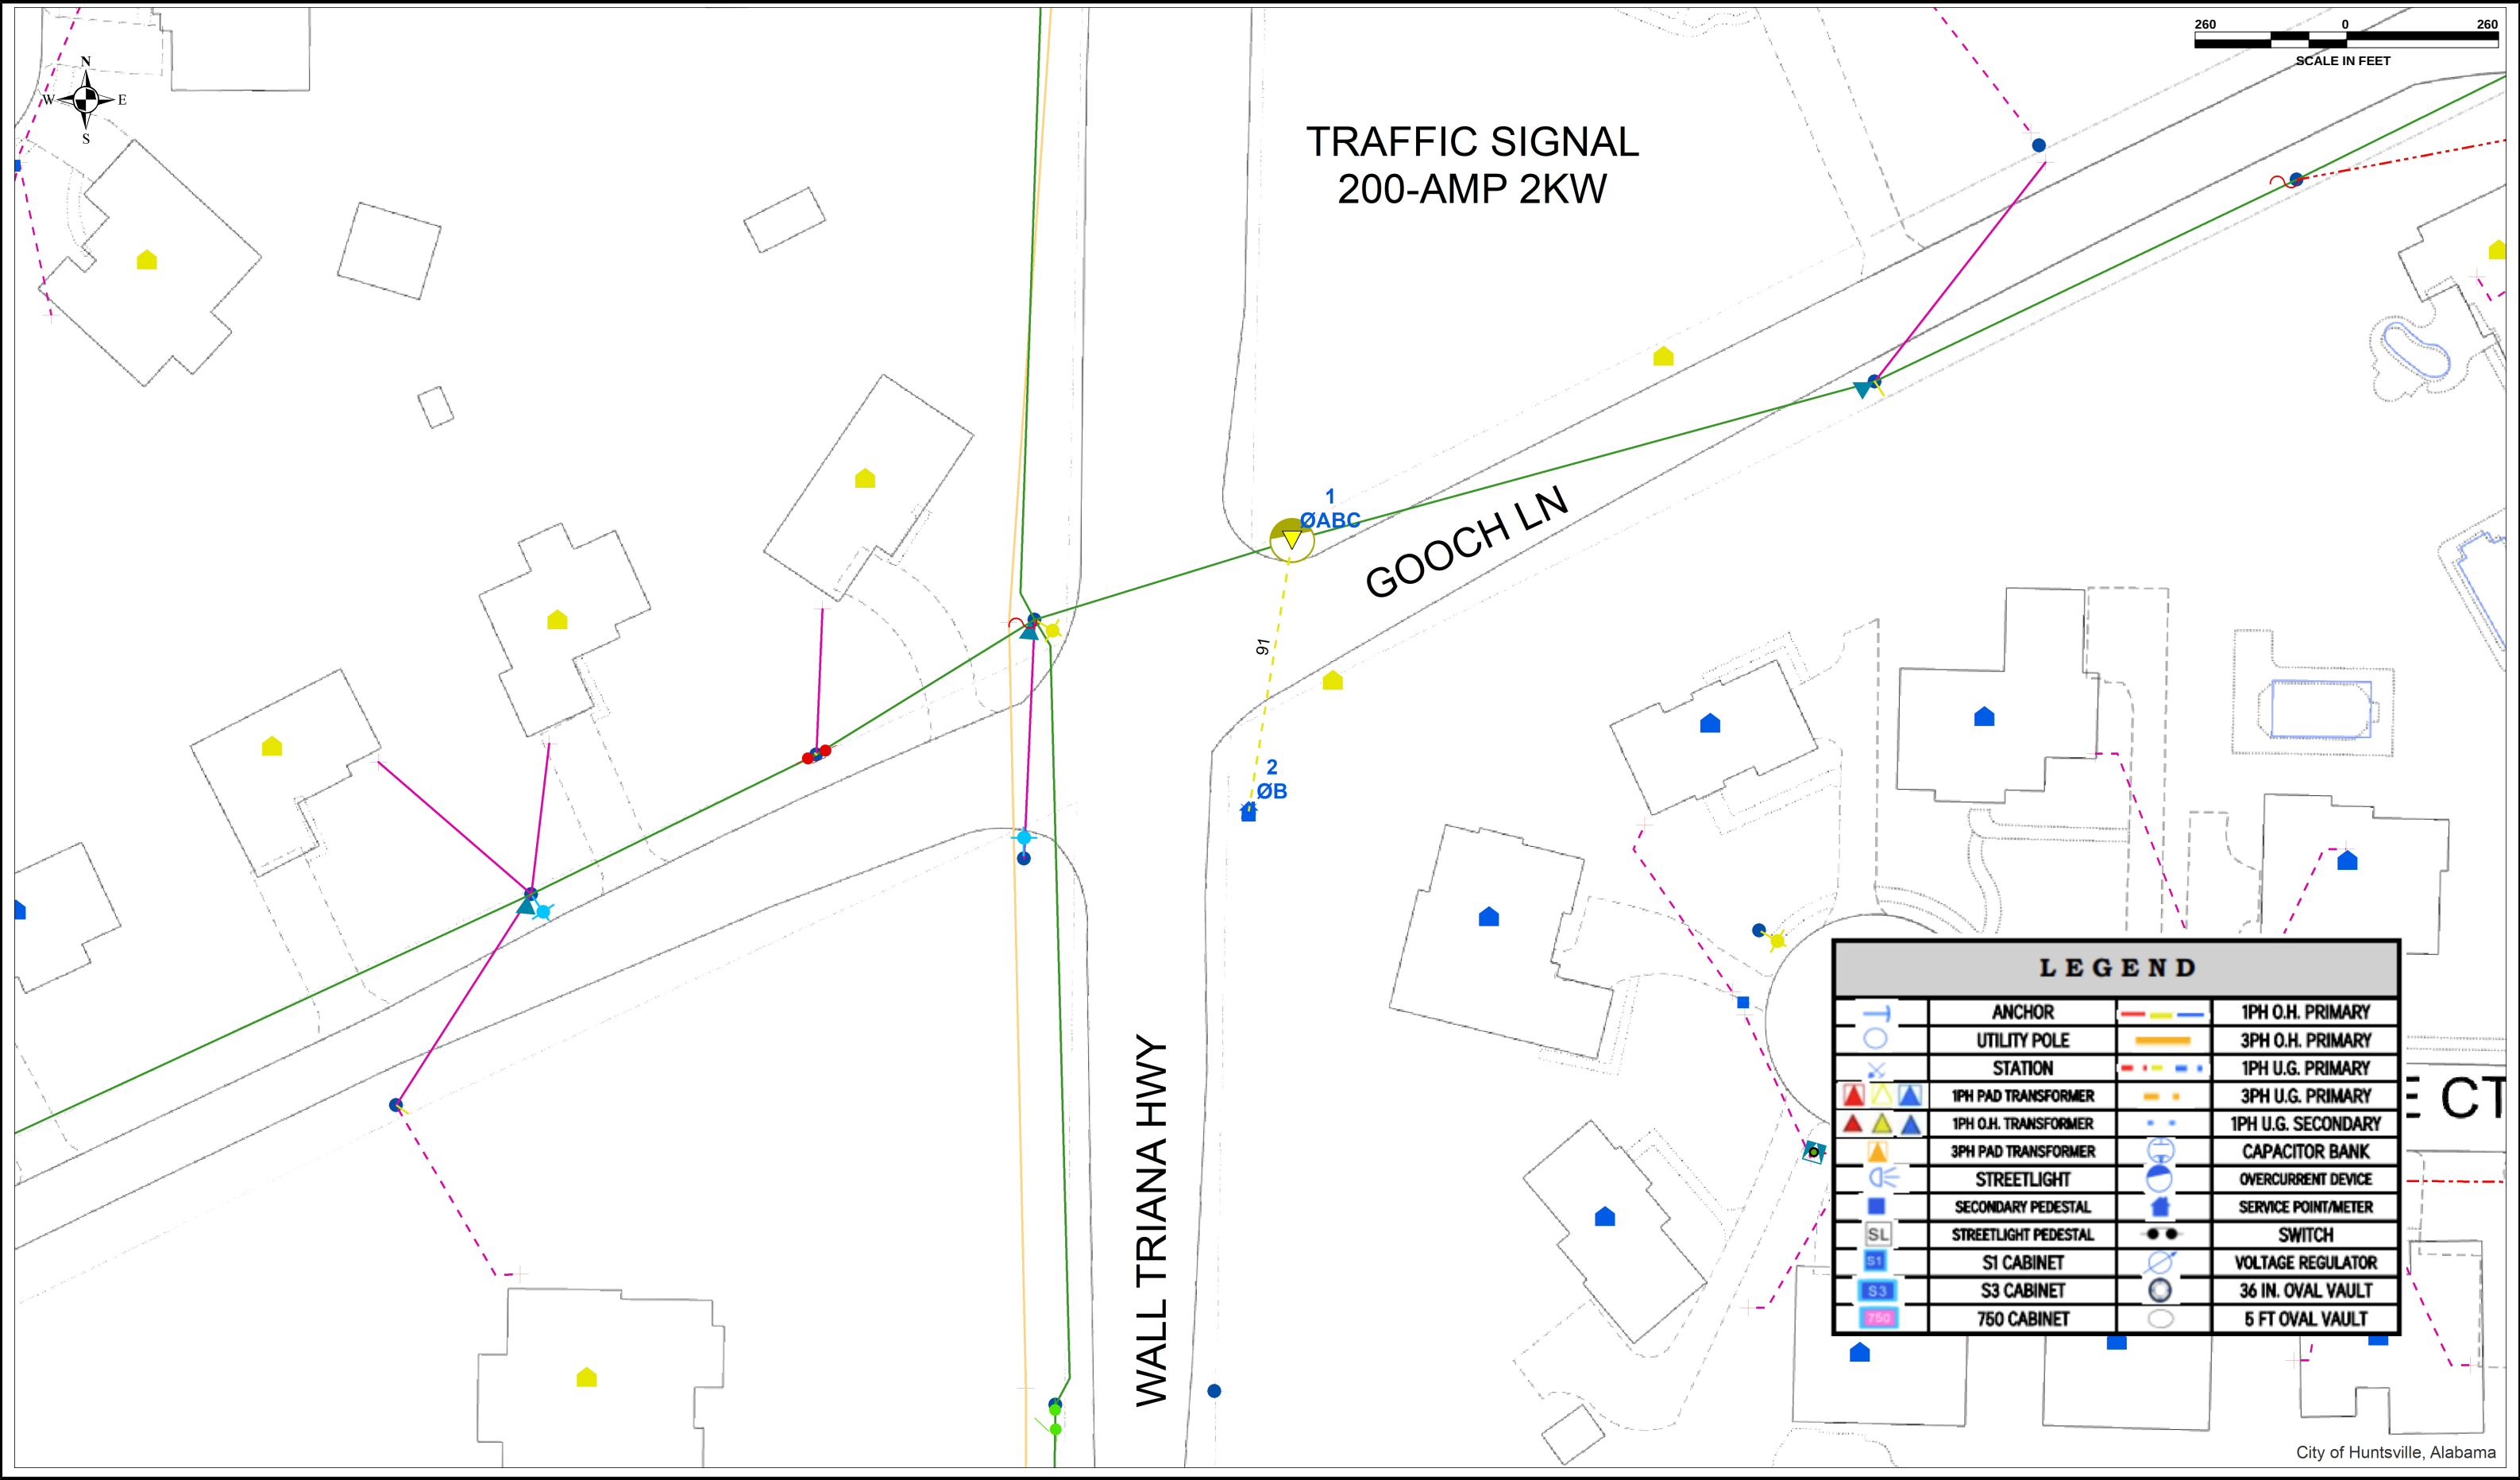

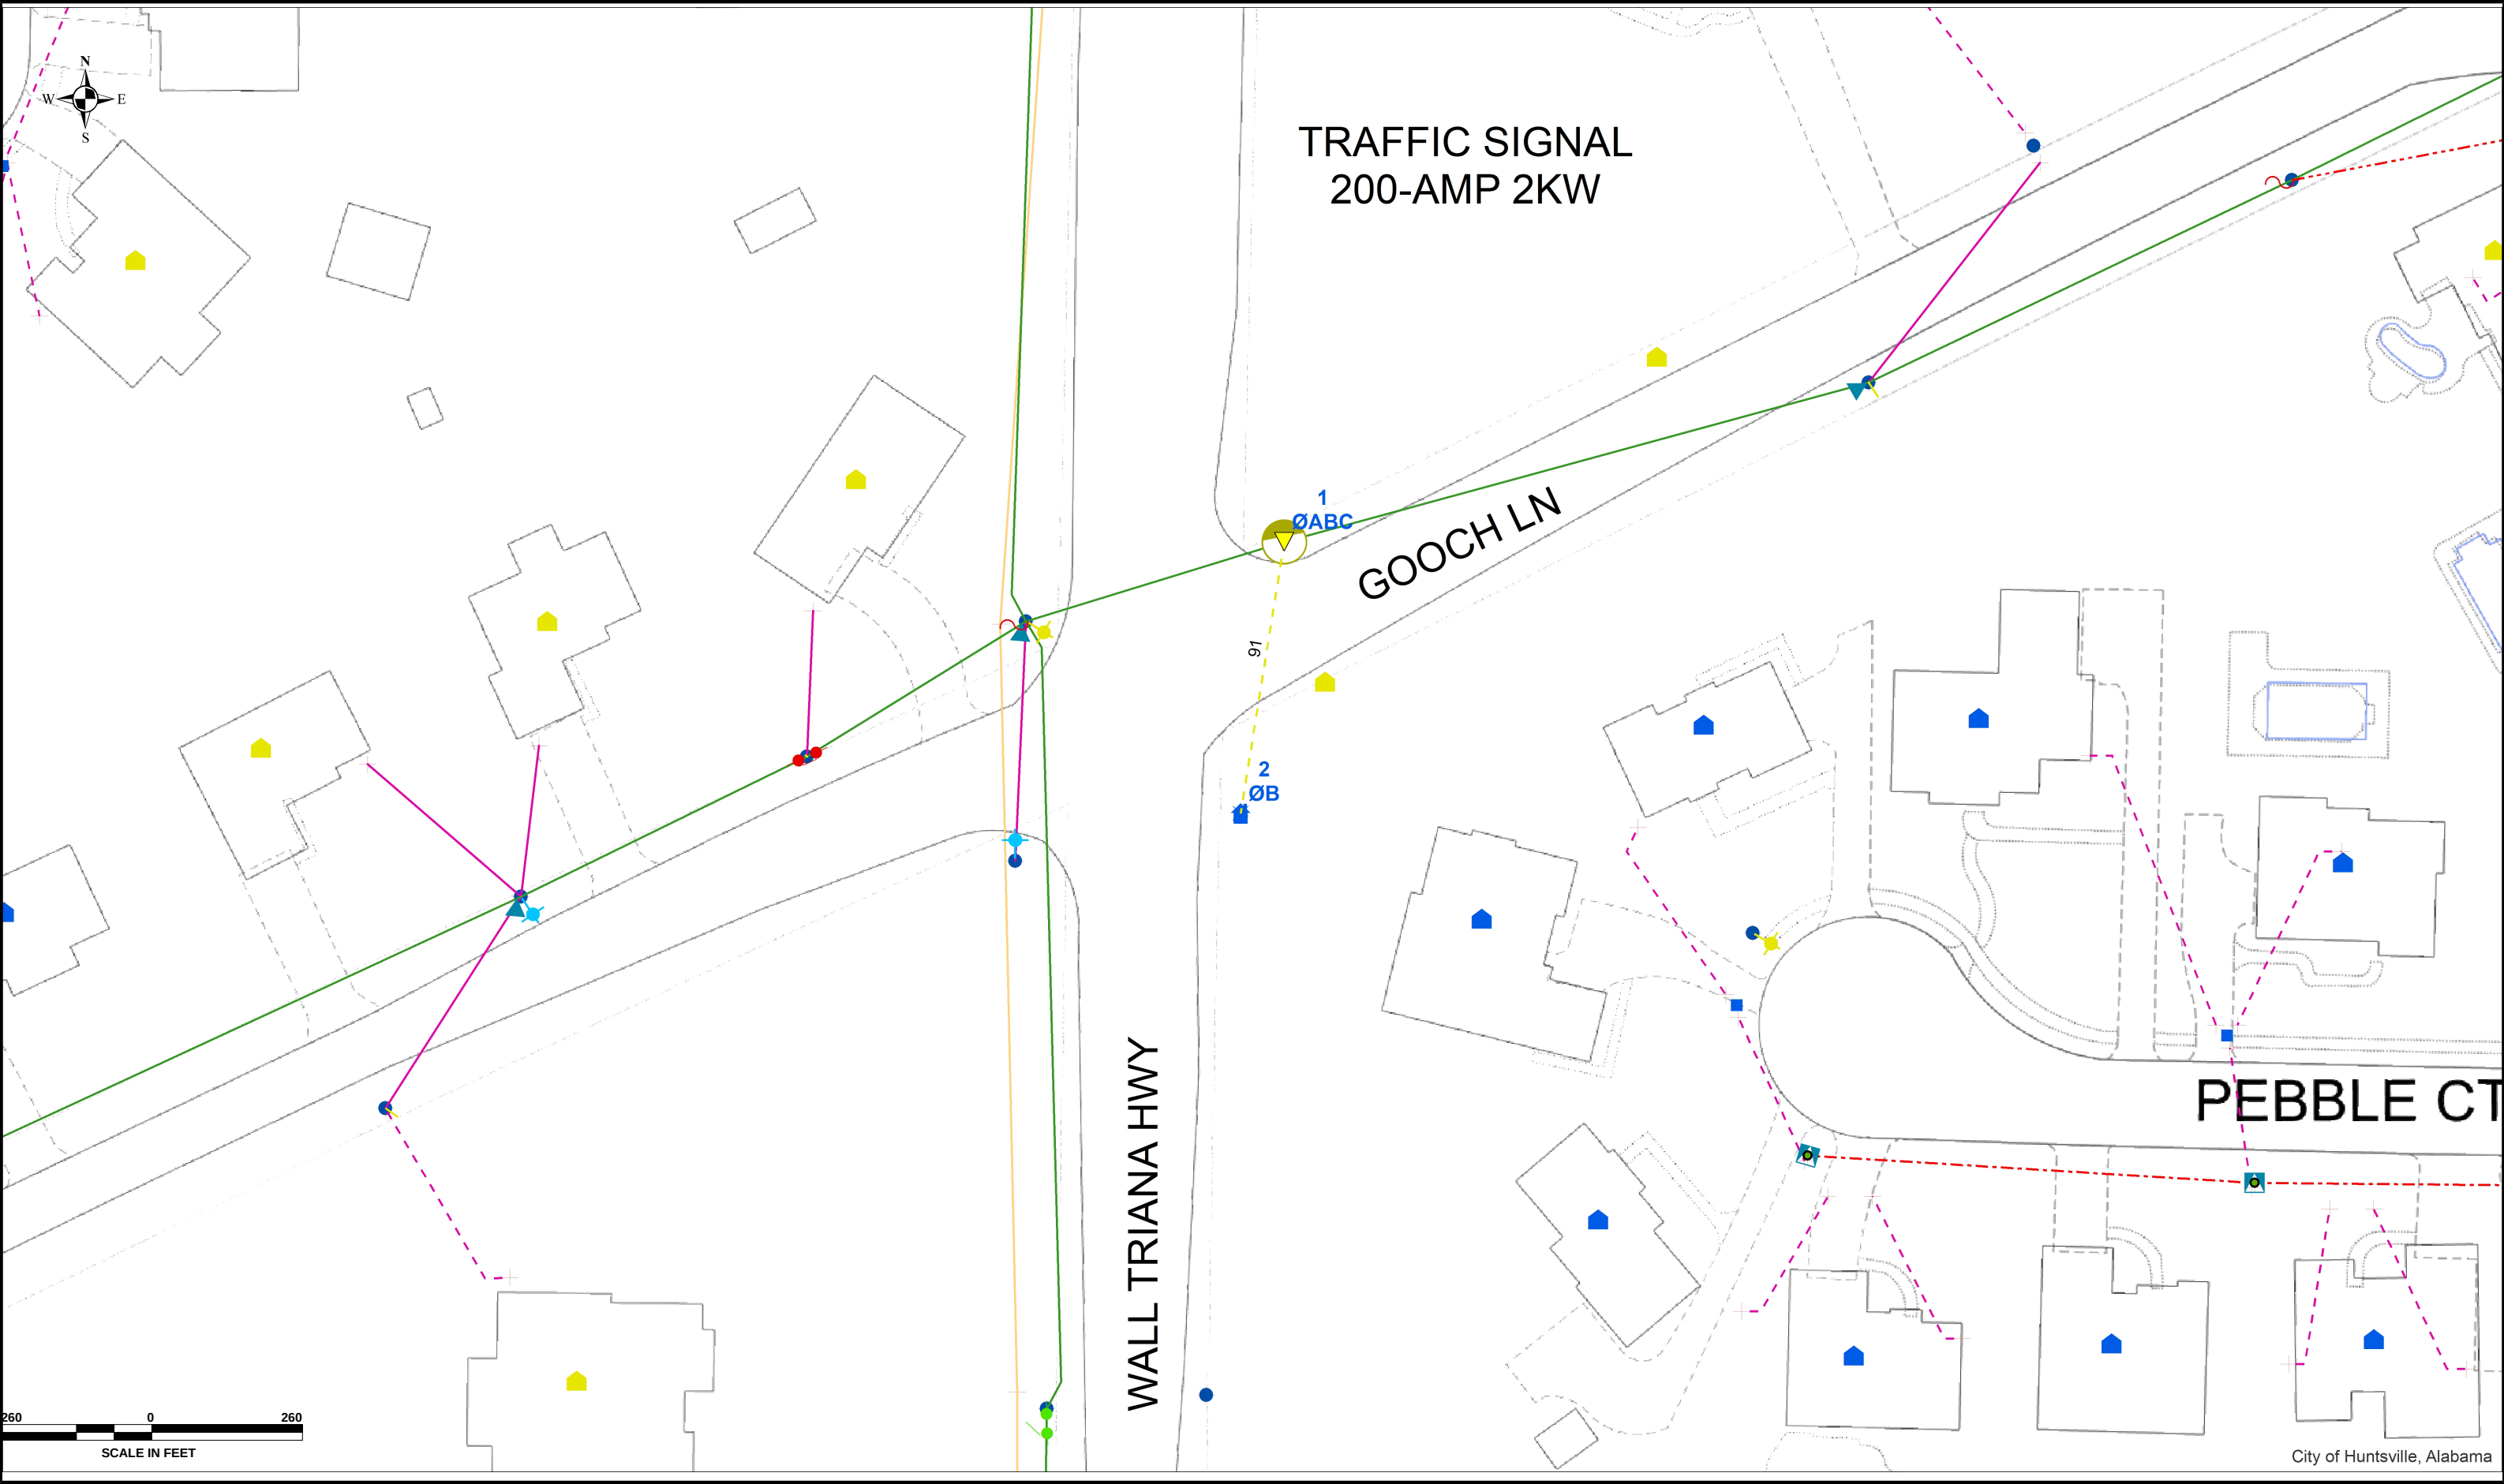

Comments: SET NEW OH XFMR - CUSTOMER TO BORE NEW UG SVC

Directions:

*	Assembly	QTY	Lines	Actual	Calc.
C	E-CABLE-4/0TPLX	91	1	91	91

Assembly Group Summary

Group	Const	Ret	Total
UG Secondary Wire	91	0	91
UG Secondary Wire Calc	91	0	91
UG Secondary Wire Act.	91	0	91
Transformer	1	0	1
Secondary	1	0	1
Meters	1	0	1

Recap

*	Units	Req.
E	E-PD45W3 - POLE,WOOD,45',CLASS 3	1
C	E-3IN-WRISE-SVC - RISER,WOOD POLE,CONDUIT,PVC,3", SVC	1
C	E-4/0T-RISWIR-SVC - CABLE,AL,600V,SEC,TRI,4/0, RISER, SVC	1
C	E-4/0T-SLK-UGSVC - CABLE,AL,600V,SEC,TRI,4/0, SLACK, UGSVC	1
C	E-408065 - 10KVA,OH,1PH,CONV,DUAL,25/15KV 120/240	1
C	E-66SLEEVE-1PH - SLEEVE,SERVICE,VCSE66,1PH	1
C	E-CABLE-4/0TPLX - CABLE,AL,600V,SEC,TRI,4/0	91
C	E-CUT_ARR-25KV - CUTOUT,100A,25KV,18KV ARR	1
C	E-FAXEG,SD,2S,CL200 - 200AMP,3WIRE,1PH METER	1
C	E-FUSE,6K - 6K FUSE LINK	1
C	E-OHXFB-CON1 - OHXFB-CON1	1
C	E-OHXFB-HDW1 - OHXFB-HDW1	1
C	E-OHXFLEAD1 - OHXFLEAD1	1
C	E-OHXFU-CON1 - OHXFU-CON1	1

Foreign Attachments

Owner	Count
ATT	1
Knology	1

Open Fields:

DEPARTMENT: Electric

INSPECTOR:

NOTES:

PERSON RESPONSIBLE: JUSTIN A SANDERS

WORK ORDER CREATED: Oct 13, 2026

PROJECT INITIATION FORM SENT: Oct 13, 2026

CUSTOMER INFO RECEIVED: Oct 13, 2026

DESIGN COMPLETED: Oct 13, 2026