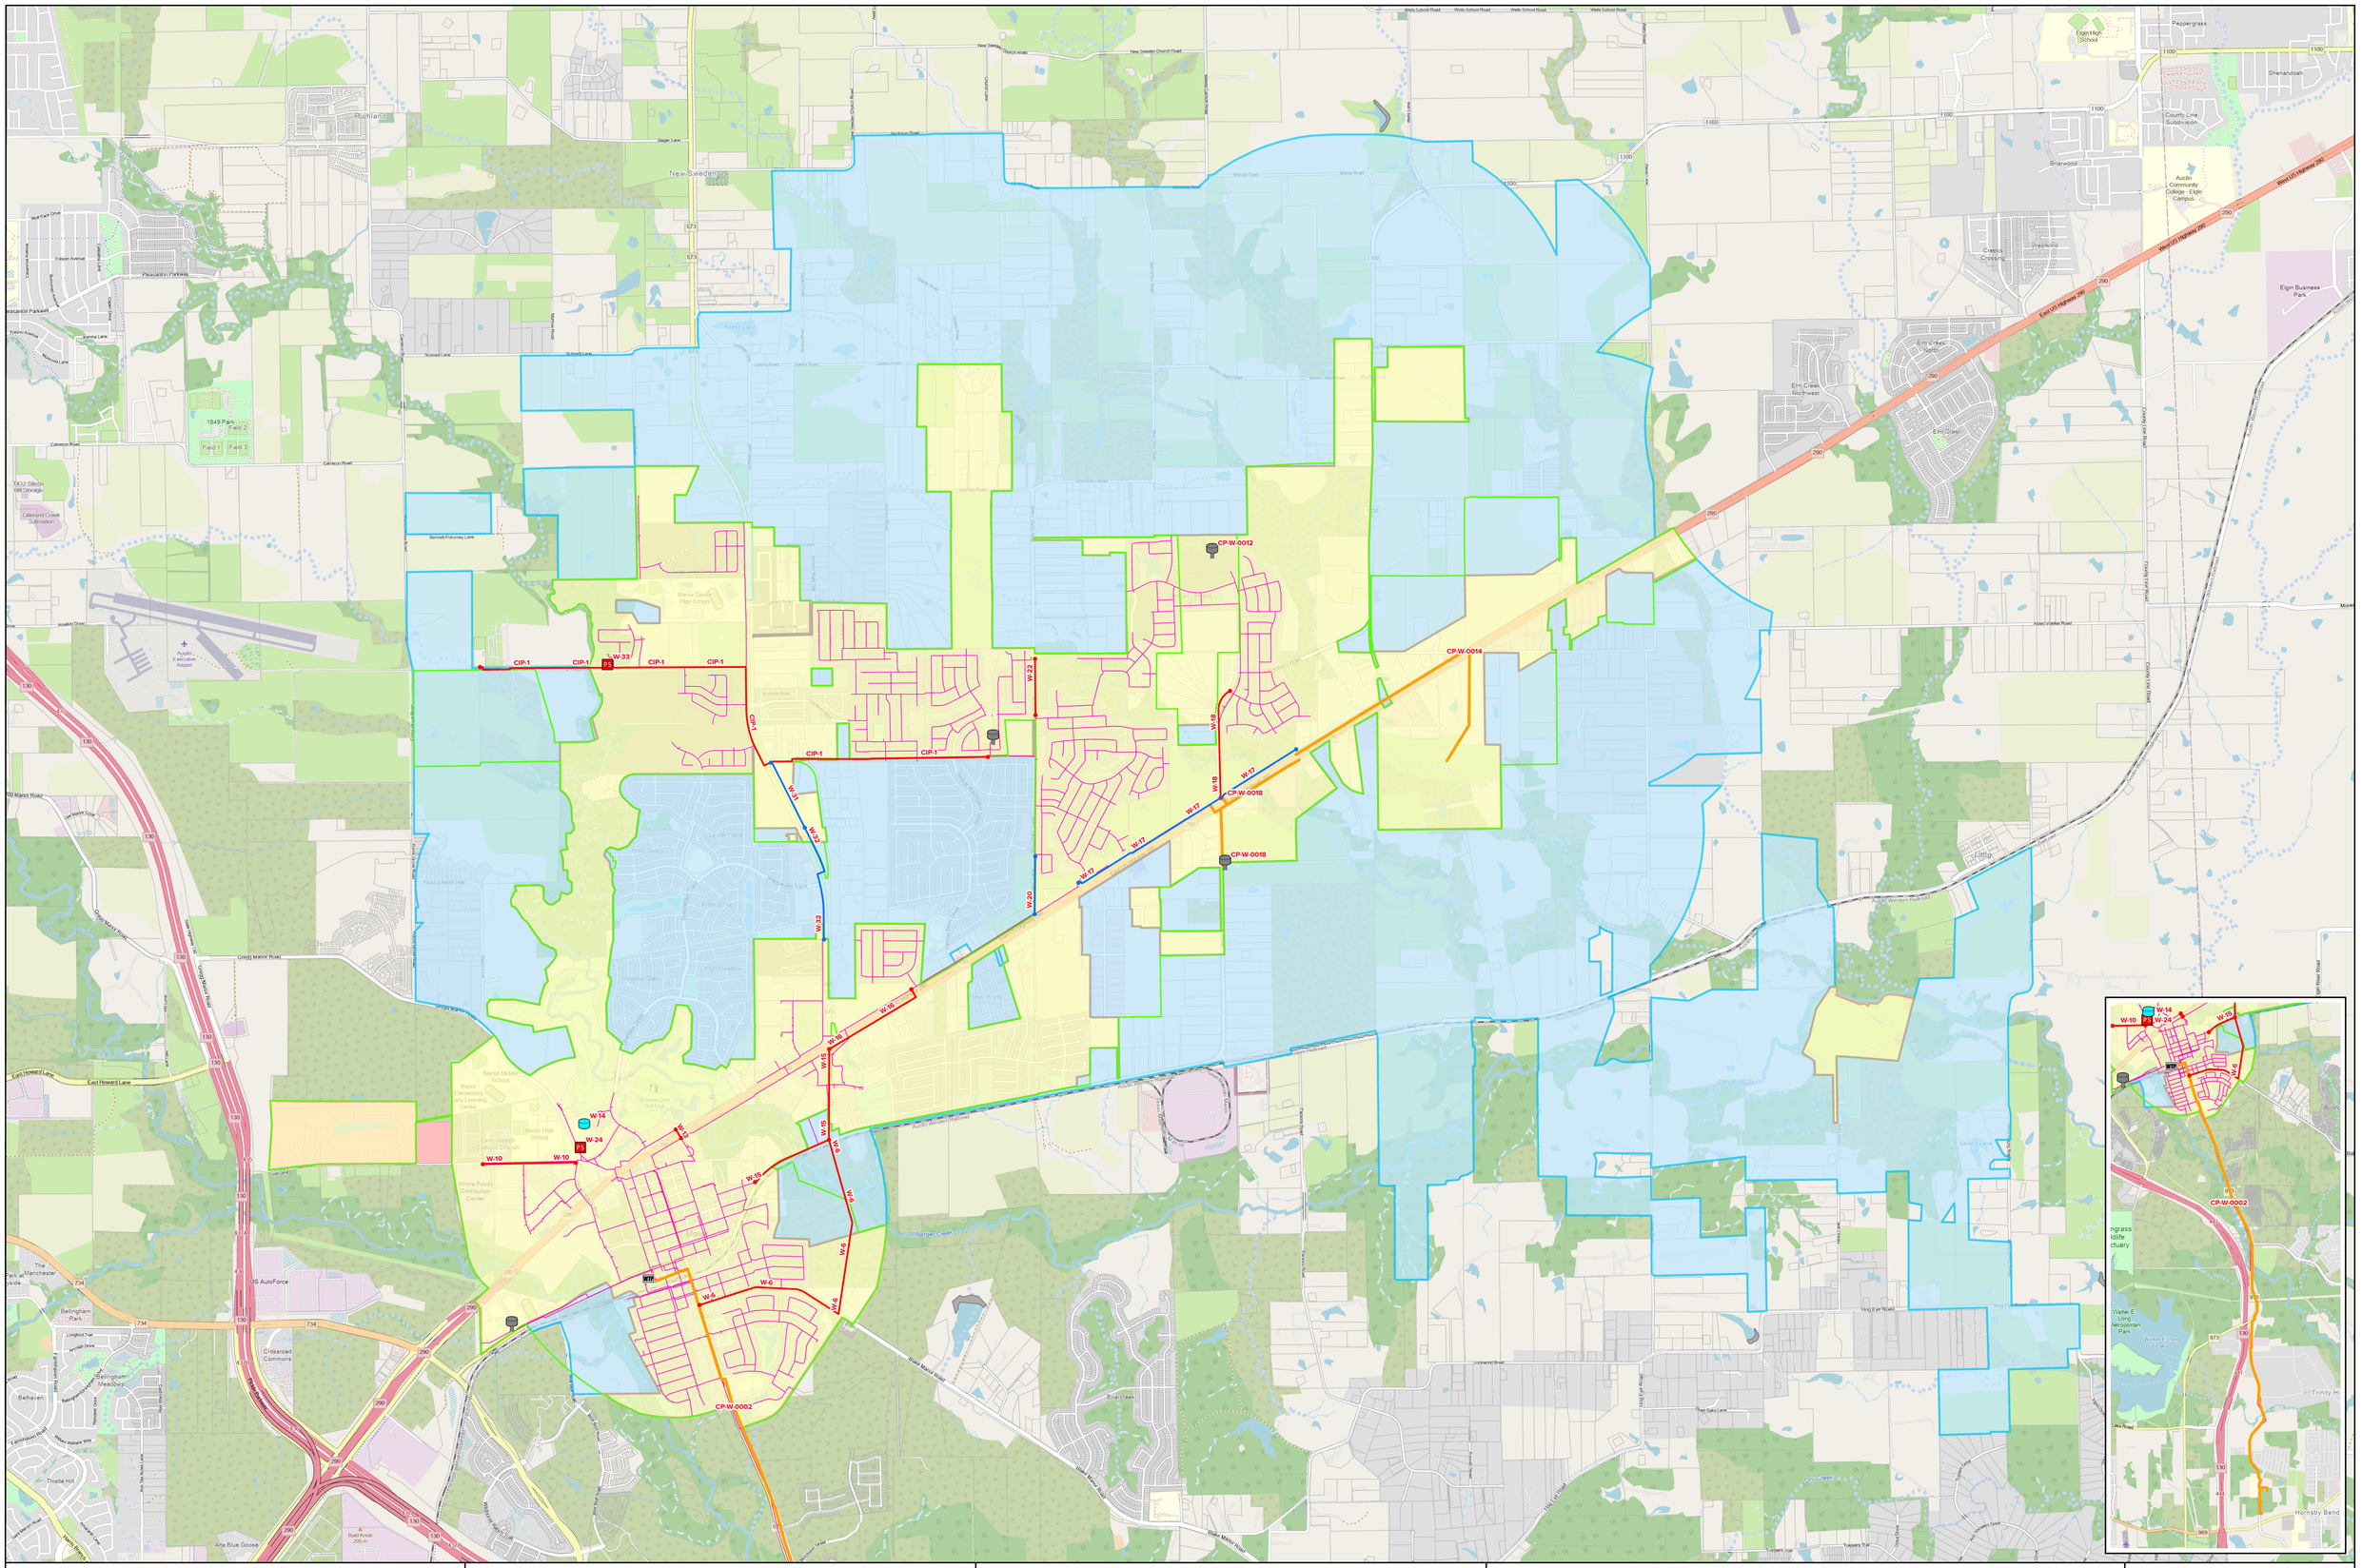

MANOR EST. TEXAS 1872

GBA

Water Master Plan CIF

Last Updated: 8/13/2026

- CIP Pump Station
- CIP Storage Tank
- CIP 12" Water Main
- CIP 16" Water Main
- 2025 CIP Projects
- Elevated Storage Tank
- Water Treatment Plant
- Service Area Boundary
- Existing Water Main
- CityLimits
- ETJ

0 1 2 Miles

Scale: 1" = 1,333'