


SITE PLAN: McNally Management

ADDRESS: 705 West Main Street, Marshall, MN 56258, 44.4519326879, -95.7963973633

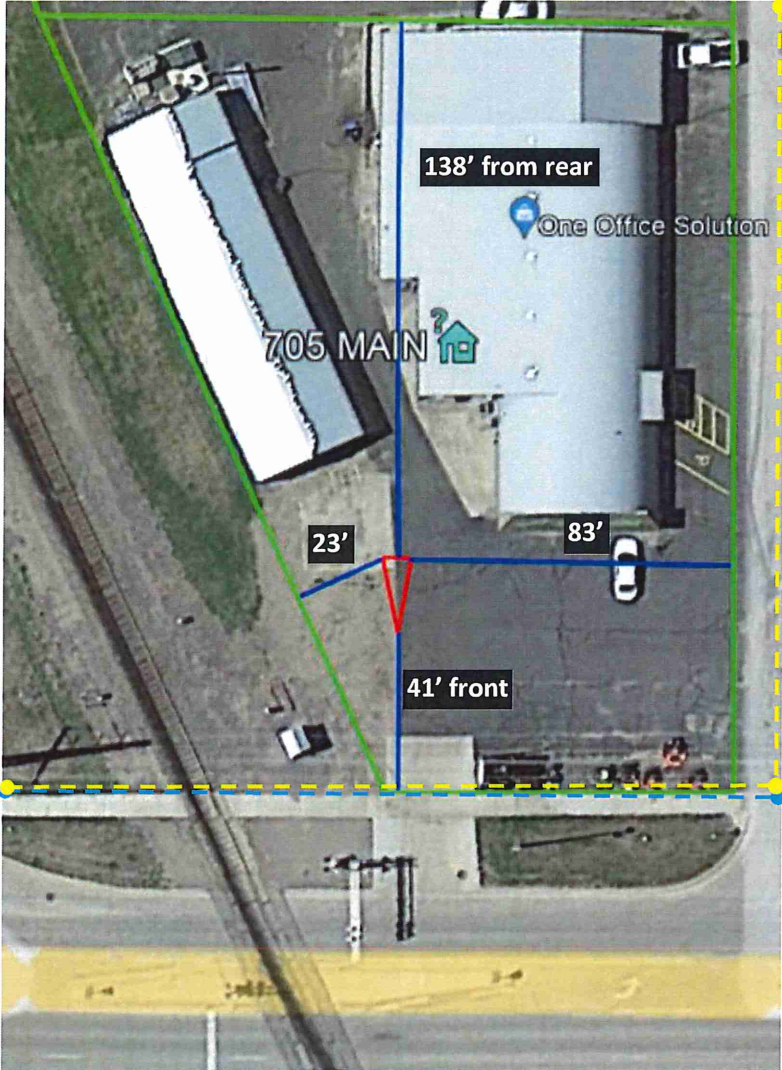

Legend:


Existing ROW: ● - - - - ●

Existing Power Line: ● - - - - ●

PANEL SCHEDULE

#	DESCRIPTION	CB AMPS	KV	NOTES
1	OUTDOOR LIGHT	20	0.10	1-100W LED FIXTURES
2	OUTDOOR LIGHT	20	0.10	1-100W LED FIXTURES

PANEL:
60 A.-120/240 VAC-SINGLE PH. 3W
2 CIRCUIT-3R ENCLOSURE
CUTLER-HAMMER CH4L125R OR EQ.

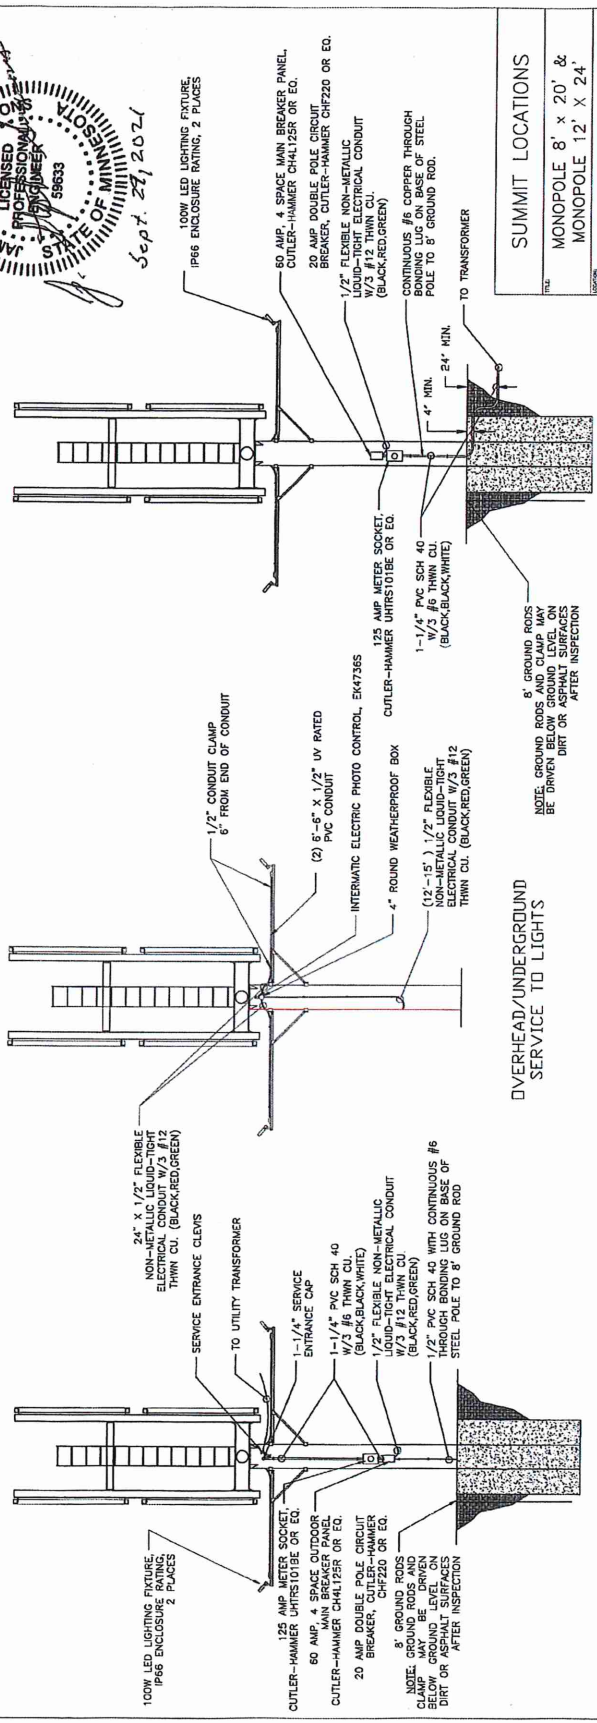

OVERHEAD SERVICE ENTRANCE

220 VAC POWER RISER DIAGRAM

UNDERGROUND SERVICE ENTRANCE

SUMMIT LOCATIONS

TYPE	MONOPOLE 8' x 20' &
LOCATION	MONOPOLE 12' x 24'
OWNER	McNALLY MANAGEMENT
ADDRESS	705 W. MAIN ST.
CITY	MARSHALL, MN 56258
DESIGNER	J. STEPHEN SIMMONS P.E. #59633
DATE	2/7/2020
SCALE	NONE
SHEET	1 OF 1

ELECTRICAL NOTES

- ALL WORK SHALL MEET OR EXCEED ALL NEC STANDARDS
- PROVIDE BONDING IN ALL APPLICABLE LOCATIONS PER NEC 250.104(C)

NO.	REVISION	DATE	BY	CHKD.
1	AS SHOWN			

NOTE: GROUND RODS AND CLAMP MAY BE DRIVEN BELOW GROUND LEVEL ON DIRT OR ASPHALT SURFACES AFTER INSPECTION

NOTE: GROUND RODS AND CLAMP MAY BE DRIVEN BELOW GROUND LEVEL ON DIRT OR ASPHALT SURFACES AFTER INSPECTION

NOTE: GROUND RODS AND CLAMP MAY BE DRIVEN BELOW GROUND LEVEL ON DIRT OR ASPHALT SURFACES AFTER INSPECTION

