

**Moberly Fire Department
May Monthly Report
2025**



City of Moberly Fire Department

Emergency Dial 911
Station #1 660-269-8705 EXT 2035
Fax# 660-263-0596
E-mail ryand@moberlyfd.com
Station #2 660-263-4121

310 N. Clark
Moberly, MO 65270-1520
Fire Chief
Don Ryan

To: Mayor and City Council
From: Don Ryan, Fire Chief
Date: June 2, 2025
Re: May Monthly Council Report:

- Last month the fire department responded to **125 incidents (26 different types)** this included: **9 fire related calls; 75 EMS Calls; 10 service calls; 14 good intent call; 7 false alarms & false calls; 5 Hazardous Condition (No Fire); 1 Severe Weather & Natural Disaster; and 4 Special incident Type.**
- The Department's three shifts combined for **439.0** training hours. The following topics were covered: Driver Training; Pump Operations (Classroom & Skills); Preplans; Street Familiarization; Team Building Skills; Fire Hose Skills & Deployments; EMS Multi-Agency Debriefing; Mayday/FF Down Training; and Health and Wellness.
- Building inspections (CFOs) and annual business inspections continue to be done on all three shifts.
- The Chief participated in a virtual meeting with Lexipol on the 1st.
- The department participated in the Meet & Greet, Pray & Eat event on the 3rd.
- We held our April Officer's Meeting on the 6th due to conflicts in scheduling last month.
- The department held a fire station tour and safety talk to a local daycare on the 6th.
- The Chief and Deputy Chief participated in the USDA Check-in meeting relating to the new station on the 6th.
- The department participated in the monthly emergency siren testing on the 7th.
- Deputy Chief Dutton participated in a virtual meeting with Vector (Target) Solutions on the 8th.
- The Chief participated in a virtual meeting with First Due covering the topic "Future Proofing Fire Reporting: Seamless NERIS Compliance, AI-Powered Documentation and More" on the 8th.
- The Chief attended the Region B (RHSOC) Equipment Showcase in Macon on the 9th.
- The department assisted at the annual Run for Her Life – Mother's Day 5K on the 11th.
- Banner Fire was here to do annual pump and ladder testing on our engines and aerial vehicles on the 13th and 14th.
- The department participated in the Healthy Community Day on the 14th.


- The Chief had a virtual meeting with IROL (a third-party reporting software company) discussing reporting of inspections.
- The Chief participated in the RHSOC – annual THIRA meeting on the 20th.
- The on-duty shift assisted placing the flags at the cemetery on the 21st.
- The shifts were given a tour of the new Good Day Farms facility on the 21st and 22nd.
- The on-duty shift participated in the Swift Foods Tour Safety Check on the 22nd.
- The Chief gave a short presentation to the Moberly Kiwanis Club on the 21st.
- The Chief attended the Region B Fire Chief’s Association Meeting on the 21st.
- We held our monthly Officer’s meeting on the 28th.
- The department participated in a de-briefing of a difficult incident call on the 29th.
- The department assisted/participated in the Combat Veterans Annual Dice Run (associated with the VFW) on the 31st.
- The department participated in the summer kick off event for the Creator Studio on the 31st.

Notice for June 2025

- The department will continue to provide business inspections for the community.
- The Chief will be participating in any Plan Review Committee Meetings during the month.
- The Deputy Chief will be attending a virtual meeting with Vector Solutions on the 3rd.
- The department will participate in the monthly siren test on the 4th.
- The Chief will have a follow-up meeting with IROL on the 5th.
- The department will participate in the Randolph County Biek Rodeo & Community Baby Shower on the 7th.
- The Chief will participate in the 24/63 Fire Chief’s Association Meeting on the 11th.
- The Chief is to attend the SEMA (ICS400) class on the 17th & 18th.
- The Chief is to attend the Fourth of July Planning Meeting on the 24th.
- We will hold our monthly Officer’s meeting on the 25th.




(2) May 2025 - FDR-NFIRS: Detailed Incident Type Breakdown with Pie Chart

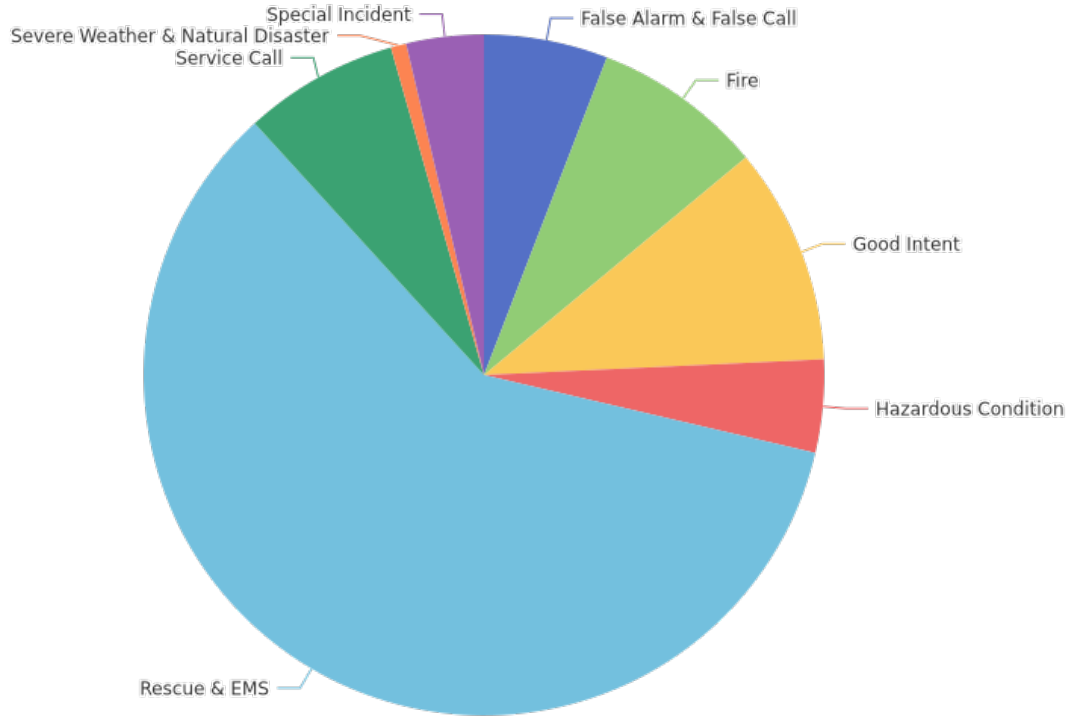

INCIDENT TYPE SERIES NAME	COUNT	PERCENT
False Alarm & False Call	8	5.88%
Fire	11	8.09%
Good Intent	14	10.29%
Hazardous Condition	6	4.41%
Rescue & EMS	81	59.56%
Service Call	10	7.35%
Severe Weather & Natural Disaster	1	0.74%
Special Incident	5	3.68%
Total	136	100.00%




(3) May 2025 - FDR-NFIRS: Incident Type Series Name Summary, Detailed with Bar Chart

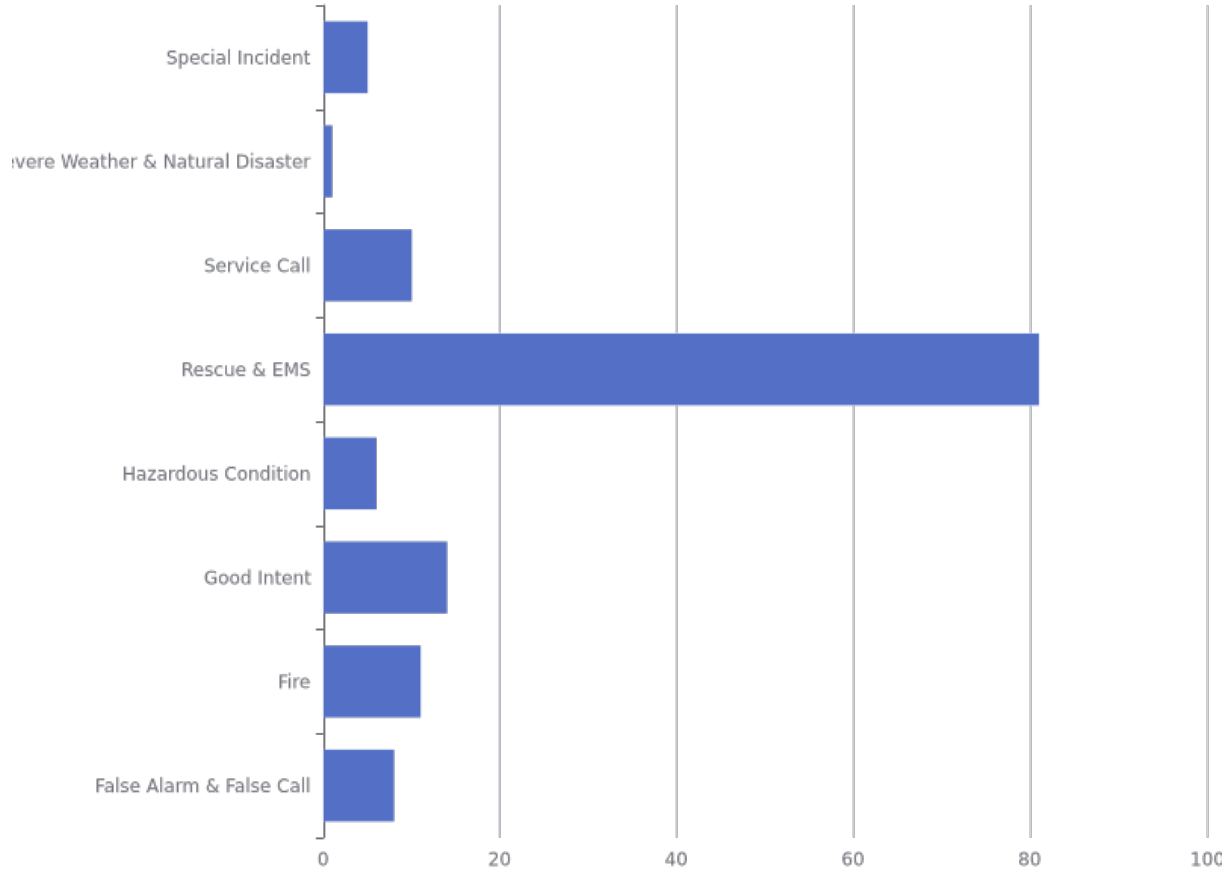

INCIDENT TYPE SERIES NAME	NUMBER OF CALLS
False Alarm & False Call	8
Fire	11
Good Intent	14
Hazardous Condition	6
Rescue & EMS	81
Service Call	10
Severe Weather & Natural Disaster	1
Special Incident	5
Total	136



(4) May 2025 - FDR-NFIRS: Incident Type Series Summary, Detailed with Pie Chart

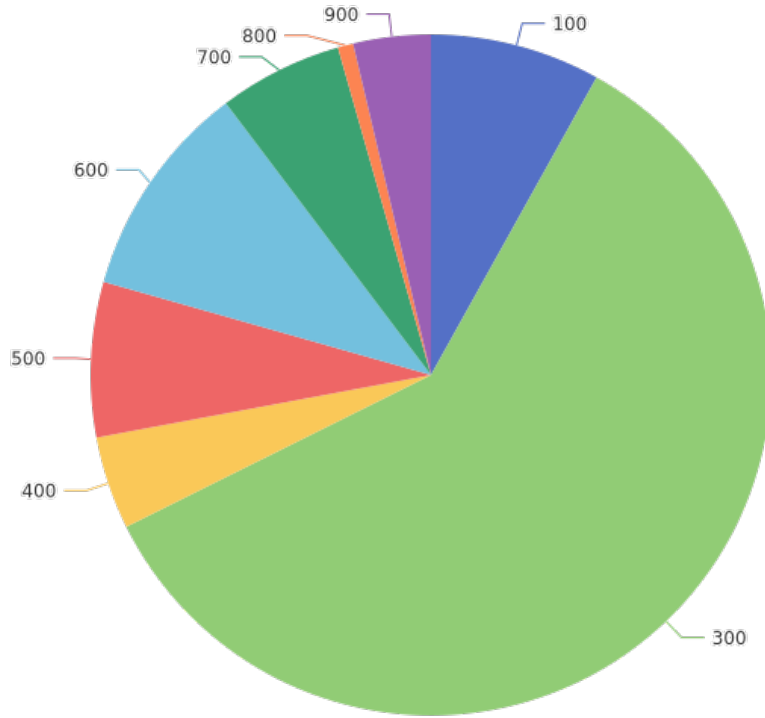

INCIDENT TYPE SERIES	NUMBER OF CALLS
100	11
300	81
400	6
500	10
600	14
700	8
800	1
900	5
Total	136

Description: Incident Type Series Summary, Detailed with Pie Chart

(4) May 2025 - FDR-NFIRS: Incident Type Series Summary, Detailed with Pie Chart


Moberly FD MO
Address: 310 N Clark St, Moberly, MO, 65270



Criteria: PSAP Call Date/Time between 2025-05-01 00:00:00 and 2025-05-31 23:59:59



(5) May 2025 - FDR-NFIRS: Incident Type Summary, Detailed with Bar Chart

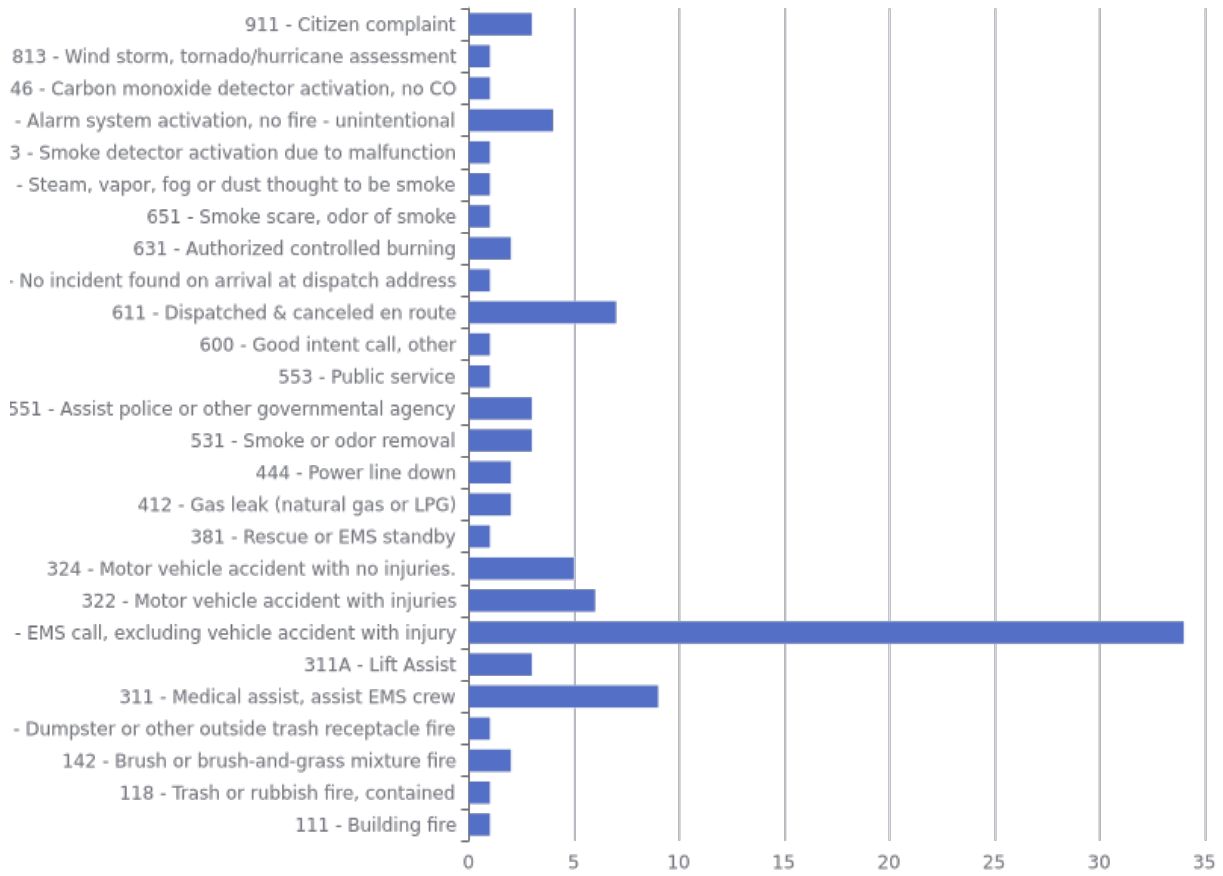

INCIDENT TYPE	NUMBER OF CALLS
111 - Building fire	1
118 - Trash or rubbish fire, contained	1
142 - Brush or brush-and-grass mixture fire	2
154 - Dumpster or other outside trash receptacle fire	1
311 - Medical assist, assist EMS crew	9
311A - Lift Assist	3
321 - EMS call, excluding vehicle accident with injury	34
322 - Motor vehicle accident with injuries	6
324 - Motor vehicle accident with no injuries.	5
381 - Rescue or EMS standby	1
412 - Gas leak (natural gas or LPG)	2
444 - Power line down	2

(5) May 2025 - FDR-NFIRS: Incident Type Summary, Detailed with Bar Chart

Moberly FD MO
Address: 310 N Clark St, Moberly, MO, 65270




INCIDENT TYPE	NUMBER OF CALLS
531 - Smoke or odor removal	3
551 - Assist police or other governmental agency	3
553 - Public service	1
600 - Good intent call, other	1
611 - Dispatched & canceled en route	7
622 - No incident found on arrival at dispatch address	1
631 - Authorized controlled burning	2
651 - Smoke scare, odor of smoke	1
652 - Steam, vapor, fog or dust thought to be smoke	1
733 - Smoke detector activation due to malfunction	1
745 - Alarm system activation, no fire - unintentional	4
746 - Carbon monoxide detector activation, no CO	1
813 - Wind storm, tornado/hurricane assessment	1
911 - Citizen complaint	3
Total	97

Description: This report counts the number of incidents within each high-level NFIRS grouping, e.g. 100-series is a "Fire." This report includes incidents where the Alarm Date/Time is between 01/01/2022 00:00:00 and 12/31/2022 23:59:59.



(6) May 2025 - FDR-NFIRS: Incident Count by Day of Week and Time of Day

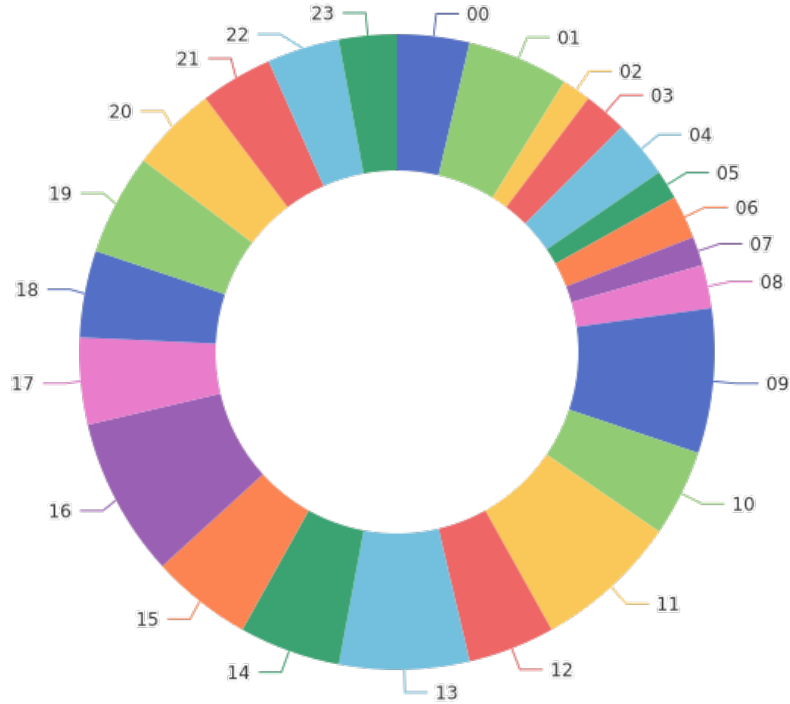

PSAP CALL DATE/TIME	MONDAY	TUESDAY	WEDNESDAY	THURSDAY	FRIDAY	SATURDAY	SUNDAY	COUNT
00			2	2		1		5
01	2		1	2	1		1	7
02	1				1			2
03			2		1			3
04				1	2	1		4
05				1		1		2
06		1			2			3
07			1			1		2
08		1				1	1	3
09	2	1	1	1	4	1		10
10	1		1	1	3			6
11	5		1	2	1	1		10

(6) May 2025 - FDR-NFIRS: Incident Count by Day of Week and Time of Day

Moberly FD MO
Address: 310 N Clark St, Moberly, MO, 65270




PSAP CALL DATE/TIME	MONDAY	TUESDAY	WEDNESDAY	THURSDAY	FRIDAY	SATURDAY	SUNDAY	COUNT
12		1	2	3				6
13	3	1		1	3	1		9
14	1		1	2	1	1	1	7
15	2	1	1	1			2	7
16		2	1	2	2	2	2	11
17		1	2	1	1	1		6
18	2			3	1			6
19	2	1			1	3		7
20	2			1	1	1	1	6
21	1	1		2		1		5
22	1			1	2	1		5
23	1		1			2		4
Total	26	11	17	27	27	20	8	136

Description: Detailed Incident Count by Time of Day



(7) May 2025 - FDR-NFIRS: Incident Count by Apparatus Summary

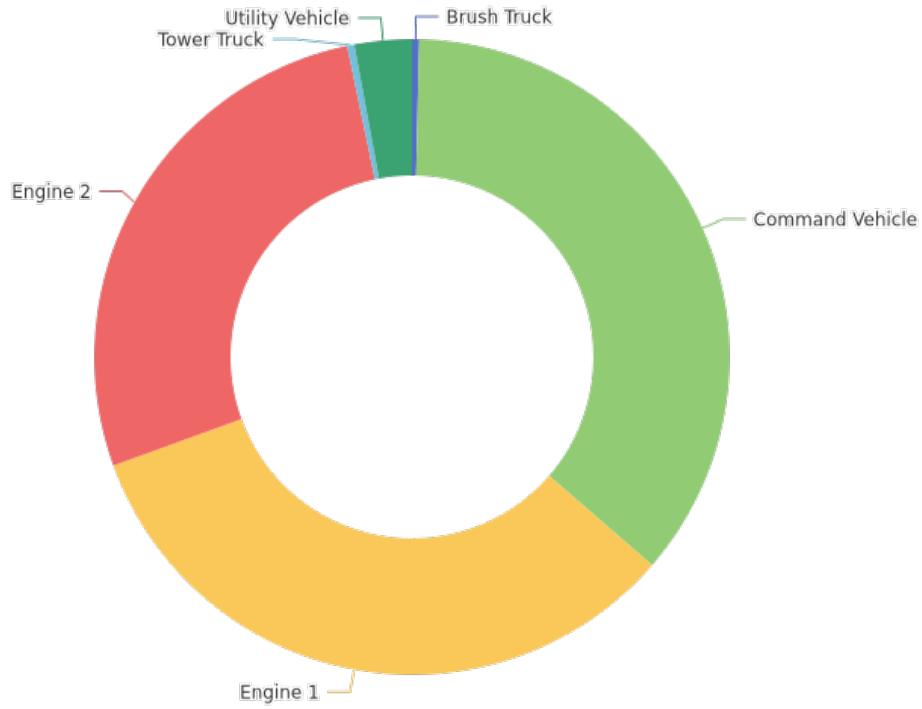

APPARATUS NAME	INCIDENT COUNT	PERCENT OF TOTAL
Brush Truck	1	0.74%
Command Vehicle	99	72.79%
Engine 1	91	66.91%
Engine 2	75	55.15%
Tower Truck	1	0.74%
Utility Vehicle	8	5.88%
Total	136	100.00%



(8) Hydrant Flow Test Results

2025-05-05		
NO VALUE		
Hyd_056		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
40.00	10.00	1982.00
Hyd_109		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
Hyd_155		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
42.00	18.00	2742.00
Hyd_187		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
35.00	10.00	1323.00
Hyd_216		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
32.00	22.00	3171.00
Hyd_261		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
36.00	20.00	2874.00
Hyd_309		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
35.00	30.00	5468.00
Hyd_311		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
40.00	30.00	3321.00
Hyd_478		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
38.00	15.00	2310.00
Hyd_537		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
35.00	10.00	1118.00
219 SUNSET DR		

(8) Hydrant Flow Test Results

Moberly FD MO
Address: 310 N Clark St, Moberly, MO, 65270



Hyd_424		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
46.00	20.00	919.00

2025-05-07

NO VALUE

Hyd_471		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE

304 S Morley St.

2W462		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
40.00	5.00	392.00

418 Woodland Ave

Hyd_221		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE

498 Woodland at Lotter St

2W465		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
35.00	5.00	365.00

520 E. Burkhart St

2W468		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
40.00	10.00	797.00

531 E Burkhart

2W467		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
45.00	20.00	1061.00

S Ault at E Logan

2W472		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE

(8) Hydrant Flow Test Results

Moberly FD MO
 Address: 310 N Clark St, Moberly, MO, 65270



35.00	10.00	753.00
-------	-------	--------

S. Morley St at E. Burkhart

2W461		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
40.00	20.00	993.00

Woodland at Gratz Brown

2W466		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
45.00	15.00	899.00

Woodland at Virginia

2W463		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
45.00	10.00	542.00

2025-05-08

118 Hurley W

Hyd_465		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
35.00	10.00	402.00

Bond & Greeley

Hyd_527		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
35.00	25.00	1321.00

Collin's & Hinkey

Hyd_640		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
35.00	10.00	402.00

Concannon & Greeley

Hyd_472		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
35.00	30.00	2037.00

Emerson & Hinton

(8) Hydrant Flow Test Results

Moberly FD MO
Address: 310 N Clark St, Moberly, MO, 65270



Hyd_048		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
35.00	25.00	1321.00
Emmerson & Collin's		
Hyd_090		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
35.00	10.00	753.00
Hwy 24 & Calhoun		
Hyd_655		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
35.00	10.00	636.00
Myra & Greeley		
Hyd_507		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
35.00	20.00	750.00
N Hinkley & Hinton		
Hyd_609		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
35.00	10.00	569.00
Sturgeon & Diltz		
Hyd_386		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
35.00	25.00	1401.00
Sturgeon & Greeley		
Hyd_459		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
35.00	25.00	1321.00
Sturgeon & Hinkley		
Hyd_421		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
35.00	30.00	2037.00
Sturgeon & Rothwell		

(8) Hydrant Flow Test Results

Moberly FD MO
Address: 310 N Clark St, Moberly, MO, 65270



Hyd_200		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
35.00	25.00	1236.00

Tedford between Collin's & Hinton

Hyd_466		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE

2025-05-15

310 N Clark St

Hyd_650		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
42.00	0.00	591.00

2025-05-16

NO VALUE

Hyd_049		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
40.00	35.00	2099.00

Hyd_086		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
45.00	40.00	2531.00

Hyd_118		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
40.00	35.00	2099.00

Hyd_296		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
40.00	15.00	576.00

Hyd_370		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
35.00	30.00	1663.00

Hyd_395		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
35.00	15.00	556.00

(8) Hydrant Flow Test Results

Moberly FD MO
Address: 310 N Clark St, Moberly, MO, 65270



Hyd_434		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
40.00	20.00	750.00
Hyd_485		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
40.00	15.00	576.00
Hyd_544		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
35.00	15.00	556.00
723 S Ault St. Moberly, MO		
Hyd_063		
STATIC PRESSURE (PSI)	RESIDUAL PRESSURE (PI)	CALCULATED FLOW RATE
40.00	15.00	576.00

Description: Hydrant Flow Test Results - Monthly Report

Criteria: Inspection Date between 2025-05-01 00:00:00 and 2025-05-31 23:59:59

