

**Moberly Fire Department
June Monthly Report
2024**



City of Moberly Fire Department

Emergency Dial 911

Station #1 660-269-8705 EXT 2035

Fax# 660-263-0596

E-mail ryand@moberlyfd.com

Station #2 660-263-4121

310 N. Clark

Moberly, MO 65270-1520

Fire Chief

Don Ryan

To: Mayor and City Council

From: Don Ryan, Fire Chief

Date: July 1, 2024

Re: June Monthly Council Report:

- Last month the fire department responded to **80 incidents (21 different types)** this included: **5 fire related calls; 56 EMS Calls; 2 service calls; 12 good intent call; 2 false alarms & false calls; 2 Hazardous Condition (No Fire); and 1 Special Incident Type.**
- The Department's three shifts combined for **569.0** training hours. The following topics were covered: Emergency Driving/EVOC Training; Natural Cover Fire Training; Aerial Training; Firefighter Basic Knowledge Training; 1st Responder/Basic EMS; Gear Drills/Power Tools Training; Driver/Operator Core; NFPA 1410 Training Evolutions; MIRMA Training; and Health and Wellness.
- All three shifts continue to provide building inspections (CFOs) and annual business inspections.
- The Chief participated in the Randolph County 911 Board Meeting on the 6th.
- The Chief will be attending the Community Health Assessment meeting on the 8th.
- The Chief attended the Region B Coordinator's Meeting on the 18th.
- The Chief attended SEMA training (G556 – Local Damage Assessment) training on the 25th.
- The Chief attended SEMA training (G557 – Rapid Needs Assessment) training on the 26th.
- The department held a recruitment test on the 22nd.
- We held our monthly Officer's meeting on the 26th.
- The Chief participated in the Civil Rights Evaluation Tool webinar on the 27th.

Notice for July 2024

- The department will continue to provide business inspections to the community.
- The department will be participating in the monthly siren test on the 3rd.
- The Chief and Lt. Wolverton will be participating in a Wide Area Search Class in Huntsville July 9th through July 11th. This is sponsored by the State Fire Division and taught by TEEX.
- We will hold our monthly officer's meeting on the 31st.




City of Moberly Fire Department

Emergency: Dial 911
Station #1: 660-269-8705 Ext: 2035
Fax: 600-263-0596
Station #2: 660-263-4121

310 N. Clark
Moberly, MO 65270-1520

Incident Reports by Incident Type Series, Detailed

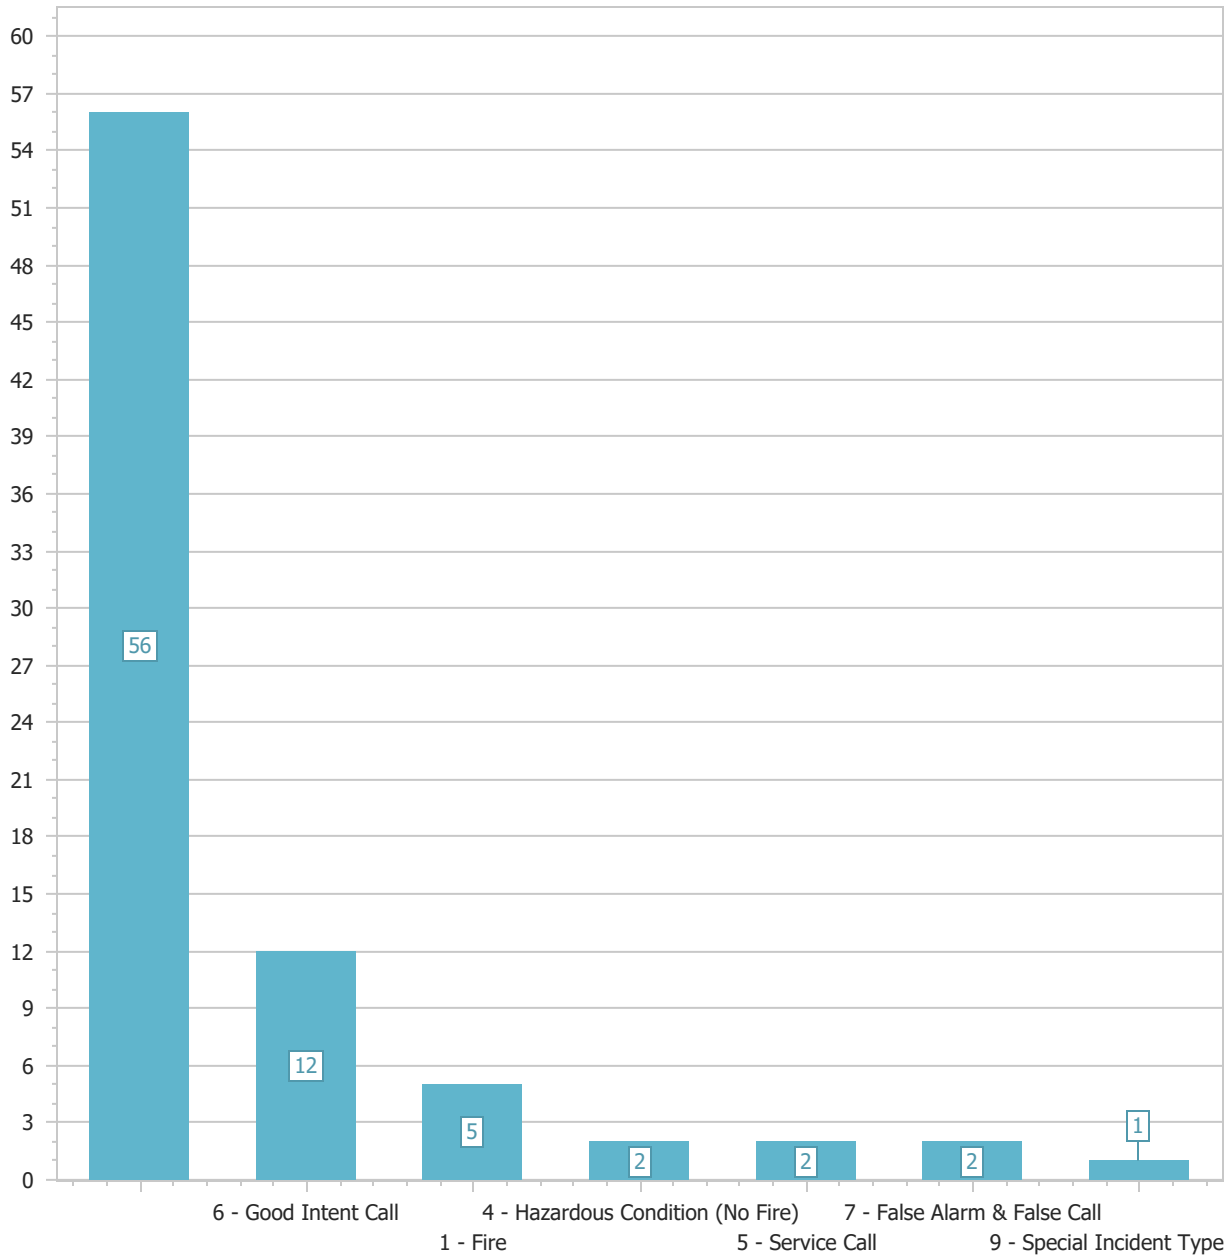

Incident Type: 1 - Fire

Incident #	Exp #	Alarm Date/Time	Address
2400531	0	6/2/2024 6:15:52 AM	312 N AULT ST #E, Moberly, MO 65270
2400537	0	6/4/2024 1:20:47 PM	1000 BLK W HIGHWAY 24, Moberly, MO 65270
2400571	0	6/15/2024 1:59:37 PM	1000 Shepherd Brothers BLVD, Moberly, MO 65270
2400572	0	6/15/2024 4:13:40 PM	1000 Shepherd Brothers BLVD, Moberly, MO 65270
2400590	0	6/21/2024 12:39:09 AM	208 Bedford ST S, Moberly, MO 65270

Total Incidents: 5

Incident Type: 3 - Rescue & Emergency Medical Service Incident

Incident #	Exp #	Alarm Date/Time	Address
2400530	0	6/1/2024 7:00:34 PM	100 JEFFERSON AVE #1, Moberly, MO 65270
2400532	0	6/2/2024 7:08:21 PM	1028 SINNOCK #31, Moberly, MO 65270
2400533	0	6/3/2024 9:55:45 AM	800 SINNOCK #27, Moberly, MO 65270
2400534	0	6/3/2024 10:43:35 AM	225 Sunset DR S, Moberly, MO 65270
2400535	0	6/3/2024 12:39:03 PM	225 Sunset DR S, Moberly, MO 65270
2400541	0	6/5/2024 6:38:39 PM	Concannon ST & Johnson ST, Moberly, MO
2400542	0	6/6/2024 12:05:08 AM	102 Collins AVE, Moberly, MO 65270
2400543	0	6/6/2024 4:14:18 PM	800 SINNOCK #17, Moberly, MO 65270
2400544	0	6/6/2024 8:39:08 PM	800 SINNOCK #5, Moberly, MO 65270
2400545	0	6/6/2024 9:15:32 PM	618 Concannon ST, Moberly, MO 65270
2400547	0	6/7/2024 2:51:14 AM	402 W CARPENTER, Moberly, MO 65270
2400548	0	6/7/2024 11:32:08 AM	220 Taylor ST, Moberly, MO 65270
2400549	0	6/7/2024 2:24:00 PM	525 LOGAN, Moberly, MO 65270

2400550	0	6/7/2024 4:54:02 PM	506 W Rollins ST, Moberly, MO 65270
2400551	0	6/8/2024 12:29:29 AM	800 SINNOCK #34, Moberly, MO 65270
2400553	0	6/8/2024 5:00:03 PM	310 5TH ST ST, Moberly, MO 65270
2400554	0	6/8/2024 5:32:07 PM	320 Halleck ST, Moberly, MO 65270
2400556	0	6/9/2024 12:32:41 PM	205 FARROR, Moberly, MO 65270
2400557	0	6/9/2024 4:49:06 PM	HIGHWAY 24, Moberly, MO 65270
2400558	0	6/10/2024 5:58:55 AM	1515 Omar Bradley DR, Moberly, MO 65270
2400559	0	6/10/2024 11:23:10 AM	S WILLIAMS ST & W Wightman ST, Moberly, MO
2400561	0	6/11/2024 5:36:57 PM	1016 W Rollins ST, Moberly, MO 65270
2400562	0	6/12/2024 4:53:15 AM	1002 West End PL W, Moberly, MO 65270
2400563	0	6/12/2024 3:11:56 PM	402 Garfield AVE, Moberly, MO 65270
2400565	0	6/13/2024 4:30:15 PM	425 Tara Park W, Moberly, MO 65270
2400567	0	6/13/2024 7:07:48 PM	101 REED, Moberly, MO 65270
2400570	0	6/15/2024 9:33:48 AM	811 S Fifth ST, Moberly, MO 65270
2400573	0	6/15/2024 7:55:48 PM	1301 N MORLEY, Moberly, MO 65270
2400574	0	6/16/2024 2:22:00 PM	613 S 4th ST, Moberly, MO 65270
2400575	0	6/17/2024 2:46:28 AM	300 N Clark ST, Moberly, MO 65270
2400576	0	6/17/2024 5:27:44 AM	200 JEFFERSON, Moberly, MO 65270
2400577	0	6/17/2024 11:04:56 AM	308 S MORLEY ST, Moberly, MO 65270
2400578	0	6/17/2024 1:59:00 PM	717 Taylor ST, Moberly, MO 65270
2400579	0	6/17/2024 6:49:10 PM	308 HIGHWAY 24, Moberly, MO 65270
2400580	0	6/18/2024 7:25:54 AM	800 SINNOCK #5, Moberly, MO 65270
2400581	0	6/18/2024 5:19:00 PM	717 Taylor ST, Moberly, MO 65270

2400582	0	6/19/2024 4:27:16 AM	800 SINNOCK #10, Moberly, MO 65270
2400585	0	6/19/2024 9:05:54 PM	301 S Morley ST, Moberly, MO 65270
2400587	0	6/20/2024 7:45:53 AM	1348 Woodridge LN, Moberly, MO 65270
2400588	0	6/20/2024 4:49:52 PM	722 Clark ST S, Moberly, MO 65270
2400589	0	6/20/2024 7:07:51 PM	300 N CLARK ST, Moberly, MO 65270
2400592	0	6/21/2024 9:56:27 PM	526 FISK, Moberly, MO 65270
2400593	0	6/22/2024 1:57:35 AM	220 TAYLOR #203, Moberly, MO 65270
2400595	0	6/23/2024 4:27:06 AM	800 SINNOCK, Moberly, MO 65270
2400596	0	6/23/2024 9:39:21 AM	400 N Morley ST, Moberly, MO 65270
2400598	0	6/23/2024 6:56:20 PM	210 BRINKERHOFF, Moberly, MO 65270
2400599	0	6/23/2024 7:01:47 PM	1347 S Morley ST, Moberly, MO 65270
2400601	0	6/24/2024 10:57:31 PM	Buchanan & Sparks AVE, Moberly, MO
2400602	0	6/25/2024 3:47:54 AM	417 E Lee ST, Moberly, MO 65270
2400603	0	6/25/2024 9:08:00 PM	1801 E Outer RD, Moberly, MO 65270
2400604	0	6/25/2024 11:26:26 PM	605 Fifth ST S, Moberly, MO 65270
2400605	0	6/26/2024 4:15:58 PM	522 N MOULTON ST N, Moberly, MO 65270
2400606	0	6/26/2024 10:53:54 PM	826 CONCANNON, Moberly, MO 65270
2400607	0	6/27/2024 10:17:20 AM	411 E Carpenter ST, Moberly, MO 65270
2400608	0	6/29/2024 3:31:14 AM	300 W ROLLINS ST, Moberly, MO 65270
2400609	0	6/30/2024 4:37:28 PM	613 S Fourth, Moberly, MO 65270

Total Incidents: 56

Incident Type: 4 - Hazardous Condition (No Fire)

Incident # Exp # Alarm Date/Time Address

2400568	0	6/13/2024 9:27:18 PM	FLOWER, Moberly, MO 65270
2400597	0	6/23/2024 12:16:27 PM	535 HIGHWAY 24, Moberly, MO 65270

Total Incidents: 2

Incident Type: 5 - Service Call

Incident #	Exp #	Alarm Date/Time	Address
2400564	0	6/12/2024 6:53:55 PM	101 Coates ST W, Moberly, MO 65270
2400600	0	6/24/2024 7:53:46 PM	1028 SINNOCK #31, Moberly, MO 65270

Total Incidents: 2

Incident Type: 6 - Good Intent Call

Incident #	Exp #	Alarm Date/Time	Address
2400536	0	6/3/2024 4:19:42 PM	sparks at hwy 24, Moberly, MO 65270
2400539	0	6/4/2024 8:25:14 PM	1332 24, Moberly, MO 65270
2400540	0	6/5/2024 4:30:00 PM	2041 Silva LN, Moberly, MO 65270
2400546	0	6/6/2024 10:26:23 PM	2041 Silva LN, Moberly, MO 65270
2400552	0	6/8/2024 2:00:26 PM	201 W Rollins ST, Moberly, MO 65270
2400560	0	6/11/2024 2:31:17 PM	1805 S Morley ST, Moberly, MO 65270
2400566	0	6/13/2024 6:29:38 PM	1442 S Morley ST, Moberly, MO 65270
2400569	0	6/14/2024 9:47:46 AM	500 Patton ST, Moberly, MO 65270
2400583	0	6/19/2024 10:08:53 AM	405 eagle, Moberly, MO 65270
2400584	0	6/19/2024 11:05:20 AM	1720 CRETE, Moberly, MO 65270
2400591	0	6/21/2024 8:26:00 AM	702 Promenade ST, Moberly, MO 65270
2400594	0	6/22/2024 6:33:02 AM	408 Reed ST W, Moberly, MO 65270

Total Incidents: 12

Incident Type: 7 - False Alarm & False Call

Incident #	Exp #	Alarm Date/Time	Address
-------------------	--------------	------------------------	----------------

2400538	0	6/4/2024 6:44:14 PM	1332 24, Moberly, MO 65270
---------	---	---------------------	----------------------------

2400555	0	6/8/2024 6:08:49 PM	522 Garfield AVE, Moberly, MO 65270
---------	---	---------------------	-------------------------------------

Total Incidents: 2

Incident Type: 9 - Special Incident Type

Incident #	Exp #	Alarm Date/Time	Address
-------------------	--------------	------------------------	----------------

2400586	0	6/19/2024 11:23:21 PM	722 W Reed ST, Moberly, MO 65270
---------	---	-----------------------	----------------------------------

Total Incidents: 1

Total Number of Distict Incidents: 80

Total Number of Distict Incident Types: 21

Report Filter Settings

Report File Name: Incident Reports by Incident Major Type, Detailed

Filter Name: Last Month

Filter Expression: [AlarmDateTime] is between '6/1/2024 12:00:00 AM' and '6/30/2024 11:59:59 PM'




Emergency: Dial 911
Station #1: 660-269-8705 Ext: 2035
Fax: 600-263-0596
Station #2: 660-263-4121

City of Moberly Fire Department

310 N. Clark
Moberly, MO 65270-1520

Incident Reports By Incident Type, Summary

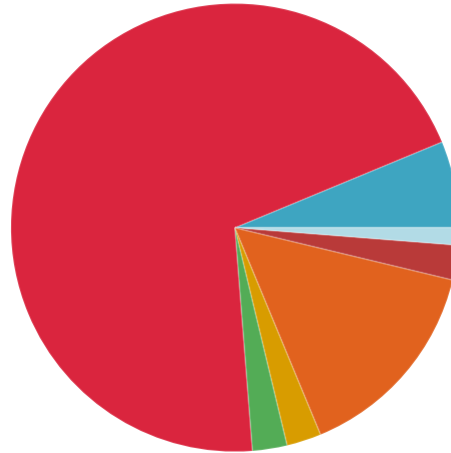

Incident Type	Total Incidents	Percent
151 - Outside rubbish, trash or waste fire	2	2.50%
1605 - Power Pole	1	1.25%
162 - Outside equipment fire	2	2.50%
311 - Medical assist, assist EMS crew	3	3.75%
3112 - Lift Assistance	10	12.50%
3113 - Standby, No care provided	7	8.75%
321 - EMS call, excluding vehicle accident with injury	31	38.75%
322 - Motor vehicle accident with injuries	1	1.25%
323 - Motor vehicle/pedestrian accident (MV Ped)	1	1.25%
324 - Motor vehicle accident with no injuries.	2	2.50%
381 - Rescue or EMS standby	1	1.25%
444 - Power line down	1	1.25%

Incident Type	Total Incidents	Percent
463 - Vehicle accident, general cleanup	1	1.25%
5311 - Report of odor with nothing found	2	2.50%
611 - Dispatched & canceled en route	7	8.75%
622 - No incident found on arrival at dispatch address	2	2.50%
631 - Authorized controlled burning	2	2.50%
6612 - EMS call where party transported by POV	1	1.25%
733 - Smoke detector activation due to malfunction	1	1.25%
745 - Alarm system activation, no fire - unintentional	1	1.25%
911 - Citizen complaint	1	1.25%

Total Number of Incidents: 80

Total Number of Incident Types: 21

Incident Type

Total Incidents

Percent

Report Filter Settings

Report File Name: Incidents by Incident Type, Summary with Major Type Graph

Filter Name: Last Calendar Month

Filter Expression: [AlarmDateTime] is between '6/1/2024 12:00:00 AM' and '6/30/2024 11:59:59 PM'




Emergency: Dial 911
Station #1: 660-269-8705 Ext: 2035
Fax: 600-263-0596
Station #2: 660-263-4121

City of Moberly Fire Department

310 N. Clark
Moberly, MO 65270-1520

Incident Reports by Time of Day, Detailed

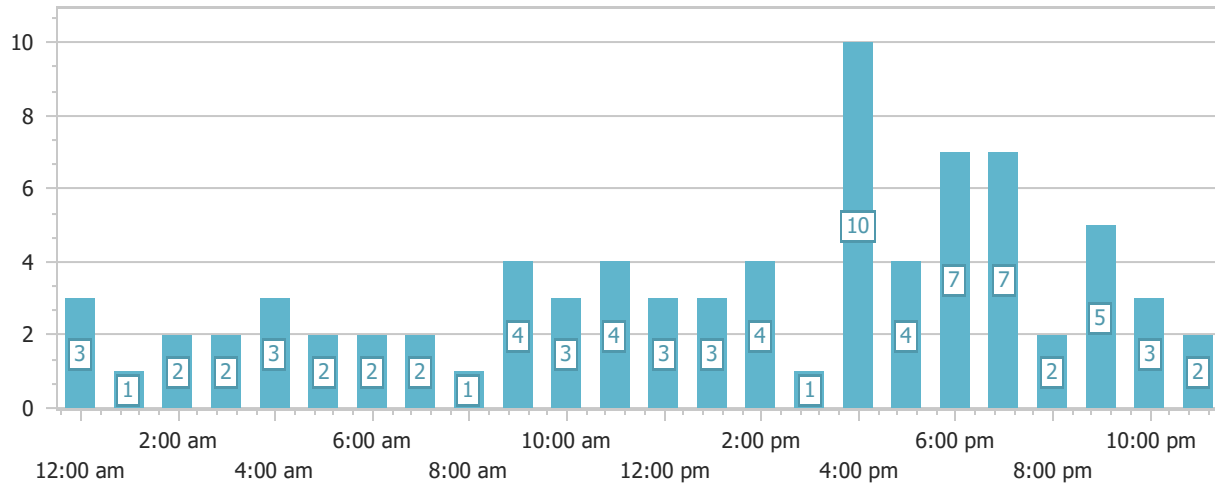

12:00 am

Incident #	Exp #	Alarm Date	Incident Type
2400542	0	6/6/2024	3113 - Standby, No care provided
2400551	0	6/8/2024	321 - EMS call, excluding vehicle accident with injury
2400590	0	6/21/2024	151 - Outside rubbish, trash or waste fire

Total Number of Incidents: 3

1:00 am

Incident #	Exp #	Alarm Date	Incident Type
2400593	0	6/22/2024	3113 - Standby, No care provided

Total Number of Incidents: 1

2:00 am

Incident #	Exp #	Alarm Date	Incident Type
2400547	0	6/7/2024	3113 - Standby, No care provided
2400575	0	6/17/2024	321 - EMS call, excluding vehicle accident with injury

Total Number of Incidents: 2

3:00 am

Incident #	Exp #	Alarm Date	Incident Type
2400602	0	6/25/2024	3112 - Lift Assistance
2400608	0	6/29/2024	321 - EMS call, excluding vehicle accident with injury

Total Number of Incidents: 2

4:00 am

Incident #	Exp #	Alarm Date	Incident Type
2400562	0	6/12/2024	321 - EMS call, excluding vehicle accident with injury
2400582	0	6/19/2024	321 - EMS call, excluding vehicle accident with injury
2400595	0	6/23/2024	311 - Medical assist, assist EMS crew

Total Number of Incidents: 3

5:00 am

Incident #	Exp #	Alarm Date	Incident Type
2400558	0	6/10/2024	321 - EMS call, excluding vehicle accident with injury
2400576	0	6/17/2024	3112 - Lift Assistance

Total Number of Incidents: 2

6:00 am

Incident #	Exp #	Alarm Date	Incident Type
2400531	0	6/2/2024	151 - Outside rubbish, trash or waste fire
2400594	0	6/22/2024	611 - Dispatched & canceled en route

Total Number of Incidents: 2

7:00 am

Incident #	Exp #	Alarm Date	Incident Type
2400580	0	6/18/2024	3113 - Standby, No care provided
2400587	0	6/20/2024	321 - EMS call, excluding vehicle accident with injury

Total Number of Incidents: 2

8:00 am

Incident #	Exp #	Alarm Date	Incident Type
2400591	0	6/21/2024	622 - No incident found on arrival at dispatch address

Total Number of Incidents: 1

9:00 am

Incident #	Exp #	Alarm Date	Incident Type
2400533	0	6/3/2024	321 - EMS call, excluding vehicle accident with injury
2400569	0	6/14/2024	631 - Authorized controlled burning
2400570	0	6/15/2024	321 - EMS call, excluding vehicle accident with injury
2400596	0	6/23/2024	321 - EMS call, excluding vehicle accident with injury

Total Number of Incidents: 4

10:00 am

Incident #	Exp #	Alarm Date	Incident Type
2400534	0	6/3/2024	311 - Medical assist, assist EMS crew
2400583	0	6/19/2024	611 - Dispatched & canceled en route
2400607	0	6/27/2024	321 - EMS call, excluding vehicle accident with injury

Total Number of Incidents: 3

11:00 am

Incident #	Exp #	Alarm Date	Incident Type
2400548	0	6/7/2024	3113 - Standby, No care provided
2400559	0	6/10/2024	324 - Motor vehicle accident with no injuries.
2400577	0	6/17/2024	321 - EMS call, excluding vehicle accident with injury
2400584	0	6/19/2024	611 - Dispatched & canceled en route

Total Number of Incidents: 4

12:00 pm

Incident #	Exp #	Alarm Date	Incident Type
2400535	0	6/3/2024	3112 - Lift Assistance
2400556	0	6/9/2024	311 - Medical assist, assist EMS crew
2400597	0	6/23/2024	463 - Vehicle accident, general cleanup

Total Number of Incidents: 3

1:00 pm

Incident #	Exp #	Alarm Date	Incident Type
2400537	0	6/4/2024	1605 - Power Pole
2400571	0	6/15/2024	162 - Outside equipment fire
2400578	0	6/17/2024	321 - EMS call, excluding vehicle accident with injury

Total Number of Incidents: 3

2:00 pm

Incident #	Exp #	Alarm Date	Incident Type
2400549	0	6/7/2024	3112 - Lift Assistance
2400552	0	6/8/2024	6612 - EMS call where party transported by POV
2400560	0	6/11/2024	631 - Authorized controlled burning
2400574	0	6/16/2024	321 - EMS call, excluding vehicle accident with injury

Total Number of Incidents: 4

3:00 pm

Incident #	Exp #	Alarm Date	Incident Type
2400563	0	6/12/2024	321 - EMS call, excluding vehicle accident with injury

Total Number of Incidents: 1

4:00 pm

Incident #	Exp #	Alarm Date	Incident Type
2400536	0	6/3/2024	611 - Dispatched & canceled en route
2400540	0	6/5/2024	611 - Dispatched & canceled en route
2400543	0	6/6/2024	321 - EMS call, excluding vehicle accident with injury

2400550	0	6/7/2024	323 - Motor vehicle/pedestrian accident (MV Ped)
2400557	0	6/9/2024	324 - Motor vehicle accident with no injuries.
2400565	0	6/13/2024	321 - EMS call, excluding vehicle accident with injury
2400572	0	6/15/2024	162 - Outside equipment fire
2400588	0	6/20/2024	321 - EMS call, excluding vehicle accident with injury
2400605	0	6/26/2024	381 - Rescue or EMS standby
2400609	0	6/30/2024	3112 - Lift Assistance

Total Number of Incidents: 10

5:00 pm

Incident #	Exp #	Alarm Date	Incident Type
2400553	0	6/8/2024	321 - EMS call, excluding vehicle accident with injury
2400554	0	6/8/2024	321 - EMS call, excluding vehicle accident with injury
2400561	0	6/11/2024	321 - EMS call, excluding vehicle accident with injury
2400581	0	6/18/2024	321 - EMS call, excluding vehicle accident with injury

Total Number of Incidents: 4

6:00 pm

Incident #	Exp #	Alarm Date	Incident Type
2400538	0	6/4/2024	745 - Alarm system activation, no fire - unintentional
2400541	0	6/5/2024	321 - EMS call, excluding vehicle accident with injury
2400555	0	6/8/2024	733 - Smoke detector activation due to malfunction
2400564	0	6/12/2024	5311 - Report of odor with nothing found
2400566	0	6/13/2024	611 - Dispatched & canceled en route
2400579	0	6/17/2024	321 - EMS call, excluding vehicle accident with injury
2400598	0	6/23/2024	321 - EMS call, excluding vehicle accident with injury

Total Number of Incidents: 7

7:00 pm

Incident #	Exp #	Alarm Date	Incident Type
2400530	0	6/1/2024	3112 - Lift Assistance

2400532	0	6/2/2024	3112 - Lift Assistance
2400567	0	6/13/2024	321 - EMS call, excluding vehicle accident with injury
2400573	0	6/15/2024	3113 - Standby, No care provided
2400589	0	6/20/2024	321 - EMS call, excluding vehicle accident with injury
2400599	0	6/23/2024	3112 - Lift Assistance
2400600	0	6/24/2024	5311 - Report of odor with nothing found

Total Number of Incidents: 7

8:00 pm

Incident #	Exp #	Alarm Date	Incident Type
2400539	0	6/4/2024	622 - No incident found on arrival at dispatch address
2400544	0	6/6/2024	321 - EMS call, excluding vehicle accident with injury

Total Number of Incidents: 2

9:00 pm

Incident #	Exp #	Alarm Date	Incident Type
2400545	0	6/6/2024	321 - EMS call, excluding vehicle accident with injury
2400568	0	6/13/2024	444 - Power line down
2400585	0	6/19/2024	3112 - Lift Assistance
2400592	0	6/21/2024	321 - EMS call, excluding vehicle accident with injury
2400603	0	6/25/2024	3113 - Standby, No care provided

Total Number of Incidents: 5

10:00 pm

Incident #	Exp #	Alarm Date	Incident Type
2400546	0	6/6/2024	611 - Dispatched & canceled en route
2400601	0	6/24/2024	322 - Motor vehicle accident with injuries
2400606	0	6/26/2024	321 - EMS call, excluding vehicle accident with injury

Total Number of Incidents: 3

11:00 pm

Incident #	Exp #	Alarm Date	Incident Type
2400586	0	6/19/2024	911 - Citizen complaint
2400604	0	6/25/2024	3112 - Lift Assistance

Total Number of Incidents: 2

Report Filter Settings

Report Name: Incident Reports by Time of Day, Detailed

Filter Name: last month

Filter Expression: [AlarmDateTime] is between '6/1/2024 12:00:00 AM' and '6/30/2024 11:59:59 PM'



Emergency: Dial 911
Station #1: 660-269-8705 Ext: 2035
Fax: 660-263-0596
Station #2: 660-263-4121

City of Moberly Fire Department

310 N. Clark
Moberly, MO 65270-1520

Incident Reports by Apparatus, Summary

Apparatus:	Total Number of Incidents Responded to:
301 Command Ford F250	41
302 - 2014 Saber	42
303- 2022 Commander	48
304 - 2002 Contender	2
305 - 2006 Sutphen Aerial	2
306 - 2011 Ford F350	1
313 - 2008 Command Vehicle	3
315 - 2007 Chevy Pickup	1
Total Number of Incidents: 79	



Emergency: Dial 911
Station #1: 660-269-8705 Ext: 2035
Fax: 600-263-0596
Station #2: 660-263-4121

City of Moberly Fire Department

310 N. Clark
Moberly, MO 65270-1520

Department Log Hours and Points, Detailed

Boeding, Matthew

	Time at Activity	Hours Paid	Points
Start Time: 6/12/2024 1:00:00 PM Activity:	04:00		4
Log Type: Training Entry Text: Drive course completion			
Total Hours and Points:	04:00	0	4

Dutton II, Kenneth Ross

	Time at Activity	Hours Paid	Points
Start Time: 6/12/2024 1:00:00 PM Activity:	04:00		4
Log Type: Training Entry Text: Drive course completion			
Total Hours and Points:	04:00	0	4

Keel, Ivan

	Time at Activity	Hours Paid	Points
Start Time: 6/12/2024 1:00:00 PM Activity:	04:00		4
Log Type: Training Entry Text: Drive course completion			
Total Hours and Points:	04:00	0	4

Stone, Slater

	Time at Activity	Hours Paid	Points
Start Time: 6/12/2024 1:00:00 PM Activity:	04:00		4
Log Type: Training Entry Text: Drive course completion			
Total Hours and Points:	04:00	0	4

Wilborn, Patrick

	Time at Activity	Hours Paid	Points
Start Time: 6/12/2024 1:00:00 PM Activity:	04:00		4
Log Type: Training Entry Text: Drive course completion			
Total Hours and Points:	04:00	0	4

Wolverton, Charles B

	Time at Activity	Hours Paid	Points
Start Time: 6/12/2024 1:00:00 PM Activity:	04:00		4
Log Type: Training Entry Text: Drive course completion			
Total Hours and Points:	04:00	0	4

Grand Total Hours and Points: 1 Day, 00: 0 24

Report Filter Settings

Report Name: Department Log Hours and Points, Detailed
Filter Name: Last Month's Training
Filter Expression: ([StartTime] is between '6/1/2024 12:00:00 AM' and '6/30/2024 11:59:59 PM') And ([LogTypeID] equals 'Training')



Emergency: Dial 911
Station #1: 660-269-8705 Ext: 2035
Fax: 600-263-0596
Station #2: 660-263-4121

City of Moberly Fire Department

310 N. Clark
Moberly, MO 65270-1520

Hydrant Flow Tests by Hydrant Number

Hydrant Number: 1W435

Location: Porter, Moberly, MO 65270

Color: Orange

District: WARD ONE

Township:

Year:

Next Test Date: 06/06/2025

Make:

FLOW TEST SUMMARY

Test Date	Test Purpose	Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
06/06/2024		1452	919	35	30	20	919

Hydrant Number: 1W436A

Location: Taylor 510, Moberly, MO 65270

Color: Green

District: WARD ONE

Township:

Year:

Next Test Date: 06/06/2025

Make:

FLOW TEST SUMMARY

Test Date	Test Purpose	Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
06/06/2024		1612	1109	40	32	25	949

Hydrant Number: 1w442

Location: 716 Taylor, Moberly, MO 65270

Color: Green

District: WARD ONE **Township:**
Next Test Date: 06/03/2025

Year:
Make:

FLOW TEST SUMMARY		Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
Test Date	Test Purpose						
06/03/2024		2002	1519	50	36	36	1007

Hydrant Number: 1W443

Location: 738 Taylor, Moberly, MO 65270
District: WARD ONE **Township:**
Next Test Date: 06/03/2025

Color: Green
Year:
Make:

FLOW TEST SUMMARY		Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
Test Date	Test Purpose						
06/03/2024		2002	1519	50	36	36	1007

Hydrant Number: 1W444

Location: Taylor, Moberly, MO 65270
District: WARD ONE **Township:**
Next Test Date: 06/03/2025

Color: Green
Year:
Make:

FLOW TEST SUMMARY		Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
Test Date	Test Purpose						
06/03/2024		1778	1368	52	40	32	1061

Hydrant Number: 1w445

Location: End Taylor, Moberly, MO 65270
District: WARD ONE **Township:**

Color: Green
Year:

Next Test Date: 06/03/2025

Make:

FLOW TEST SUMMARY		Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
Test Date	Test Purpose						
06/03/2024		1941	1493	52	40	35	1061

Hydrant Number: 1w446

Location: Taylor, Moberly, MO

Color: Green

District: WARD ONE

Township:

Year:

Next Test Date: 09/22/2017

Make:

FLOW TEST SUMMARY		Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
Test Date	Test Purpose						
06/06/2024		1275	999	55	30	25	919

Hydrant Number: 1w447

Location: Taylor, Moberly, MO

Color: Green

District: WARD ONE

Township:

Year:

Next Test Date: 09/22/2017

Make:

FLOW TEST SUMMARY		Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
Test Date	Test Purpose						
06/06/2024		1049	822	55	24	20	822

Hydrant Number: 1w448

Location: Taylor, Moberly, MO

Color: Red

District: WARD ONE

Township:

Year:

Next Test Date: 09/22/2017

Make:

FLOW TEST SUMMARY

Test Date	Test Purpose	Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
06/06/2024		919	739	60	22	15	787

Hydrant Number: 1w449**Location:** Taylor, Moberly, MO**Color:** Green**District:** WARD ONE**Township:****Year:****Next Test Date:** 09/15/2021**Make:****FLOW TEST SUMMARY**

Test Date	Test Purpose	Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
06/06/2024		1414	973	40	30	22	919

Hydrant Number: 1W450**Location:** Porter ST & Farror ST, Moberly, MO**Color:** Green**District:** WARD ONE**Township:****Year:****Next Test Date:** 08/01/2017**Make:****FLOW TEST SUMMARY**

Test Date	Test Purpose	Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
06/06/2024		2068	1423	40	34	30	978

Hydrant Number: 1w450A**Location:** 550 Farror ST, Moberly, MO 65270**Color:** Orange**District:** WARD ONE**Township:****Year:****Next Test Date:** 06/06/2025**Make:****FLOW TEST SUMMARY**

Flow at	Flow at	Static	Pitot	Actual Residual	Calculated
------------	------------	--------	-------	--------------------	------------

Test Date	Test Purpose	0 PSI	20 PSI	Pressure	Pressure	Pressure	Flow
06/06/2024		1555	1132	45	30	28	919

Hydrant Number: 1W451

Location: Farror ST & Grimes ST, Moberly, MO **Color:** Blue
District: WARD ONE **Township:** **Year:**
Next Test Date: 06/06/2025 **Make:**

FLOW TEST SUMMARY		Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
Test Date	Test Purpose	0 PSI	20 PSI	Pressure	Pressure	Pressure	Flow
06/06/2024		1842	1398	50	40	32	1061

Hydrant Number: 1W451A

Location: 739 Farror ST, Moberly, AS 65270 **Color:**
District: 1 **Township:** MOBERLY **Year:**
Next Test Date: **Make:**

FLOW TEST SUMMARY		Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
Test Date	Test Purpose	0 PSI	20 PSI	Pressure	Pressure	Pressure	Flow
06/06/2024		1291	980	50	28	25	888

Hydrant Number: 1W452

Location: **Color:** Red
District: WARD ONE **Township:** **Year:**
Next Test Date: 06/06/2025 **Make:**

FLOW TEST SUMMARY		Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
Test Date	Test Purpose	0 PSI	20 PSI	Pressure	Pressure	Pressure	Flow

1034

Hydrant Number: 1W453

Hydrant Number: 1W454

Hydrant Number: 1W455

949

Hydrant Number: 1w456**Location:** 636 Farror ST, Moberly, MO 65270**Color:** Green**District:** WARD ONE **Township:****Year:****Next Test Date:** 06/24/2025**Make:****FLOW TEST SUMMARY**

Test Date	Test Purpose	Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
06/24/2024		1464	1066	45	15	35	650

Hydrant Number: 1w457**Location:** 528 Farror ST, Moberly, MO 65270**Color:** Green**District:** WARD ONE **Township:****Year:****Next Test Date:** 06/24/2025**Make:****FLOW TEST SUMMARY**

Test Date	Test Purpose	Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
06/24/2024		1091	750	40	20	20	750

Hydrant Number: 1w458**Location:** 422 Farror ST, Moberly, MO 65270**Color:** Green**District:** WARD ONE **Township:****Year:****Next Test Date:** 06/24/2025**Make:****FLOW TEST SUMMARY**

Test Date	Test Purpose	Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
06/24/2024		1091	750	40	20	20	750

Hydrant Number: 1w459

Location: 512 Roberts ST, Moberly, MO 65270

Color: Green

District: WARD ONE

Township:

Year:

Next Test Date: 06/06/2025

Make:

FLOW TEST SUMMARY

Test Date	Test Purpose	Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
06/06/2024		967	665	40	20	15	750

Hydrant Number: 2W456

Location: E Rollins ST & S Ault ST, Moberly, MO

Color: Green

District: WARD TWO

Township:

Year:

Next Test Date: 06/24/2025

Make:

FLOW TEST SUMMARY

Test Date	Test Purpose	Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
06/24/2024		1443	993	40	35	20	993

Hydrant Number: 2W457

Location: E Rollins ST & N Morley ST, Moberly, MO

Color: Green

District: WARD TWO

Township:

Year:

Next Test Date: 06/24/2025

Make:

FLOW TEST SUMMARY

Test Date	Test Purpose	Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
06/24/2024		2099	1443	40	35	30	993

Hydrant Number: 2W459

Location: E Rollins ST & Lotter ST, Moberly, MO
District: WARD TWO **Township:**
Next Test Date: 06/24/2025

Color: Orange
Year:
Make:

FLOW TEST SUMMARY		Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
Test Date	Test Purpose						
06/24/2024		980	674	40	25	10	839

Hydrant Number: 2w461

Location: S Morley ST & E Burkhart ST, Moberly, MO
District: WARD TWO **Township:**
Next Test Date: 06/24/2025

Color: Green
Year:
Make:

FLOW TEST SUMMARY		Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
Test Date	Test Purpose						
06/24/2024		980	674	40	25	10	839

Hydrant Number: 2w462

Location: S Morley ST & Woodland AVE, Moberly, MO
District: WARD TWO **Township:**
Next Test Date: 06/24/2025

Color: Orange
Year:
Make:

FLOW TEST SUMMARY		Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
Test Date	Test Purpose						
06/24/2024		438	301	40	5	10	375

Hydrant Number: 2w463

Location: Woodland AVE & Virginia ST, Moberly, MO

Color: Orange

District: WARD TWO **Township:**
Next Test Date: 06/24/2025

Year:
Make:

FLOW TEST SUMMARY		Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
Test Date	Test Purpose						
06/24/2024		438	301	40	5	10	375

Hydrant Number: 2w464

Location: 418 Woodland AVE, Moberly, MO
District: WARD TWO **Township:**
Next Test Date: 06/17/2017

Color: Red
Year:
Make:

FLOW TEST SUMMARY		Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
Test Date	Test Purpose						
06/24/2024		438	301	40	5	10	375

Hydrant Number: 2w465

Location: 498 Woodland AVE, Moberly, MO
District: WARD TWO **Township:**
Next Test Date: 06/17/2017

Color: Red
Year:
Make:

FLOW TEST SUMMARY		Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
Test Date	Test Purpose						
06/24/2024		636	403	35	10	10	531

Hydrant Number: 2w466

Location: 541 Woodland AVE, Moberly, MO
District: WARD TWO **Township:**

Color: Orange
Year:

Next Test Date: 06/17/2016

Make:

FLOW TEST SUMMARY		Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
Test Date	Test Purpose						
06/24/2024		1943	1336	40	30	30	919

Hydrant Number: 2w467

Location: 531 E. Burkhart, Moberly, MO

Color: Orange

District: WARD TWO **Township:**

Year:

Next Test Date: 06/17/2021

Make:

FLOW TEST SUMMARY		Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
Test Date	Test Purpose						
06/24/2024		1091	750	40	20	20	750

Hydrant Number: 2w468

Location: Mid 500 E. Burkhart, Moberly, MO

Color: Orange

District: WARD TWO **Township:**

Year:

Next Test Date: 06/17/2021

Make:

FLOW TEST SUMMARY		Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
Test Date	Test Purpose						
06/24/2024		967	665	40	20	15	750

Hydrant Number: 2w469

Location: E Burkhart ST, Moberly, MO

Color: Red

District: WARD TWO **Township:**

Year:

Next Test Date: 06/17/2021

Make:

FLOW TEST SUMMARY

Test Date	Test Purpose	Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
06/24/2024		1091	750	40	20	20	750

Hydrant Number: 2w470**Location:** E Rollins ST, Moberly, MO**Color:** Orange**District:** WARD TWO**Township:****Year:****Next Test Date:** 06/17/2021**Make:****FLOW TEST SUMMARY**

Test Date	Test Purpose	Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
06/24/2024		620	426	40	10	10	531

Hydrant Number: 2w471**Location:** 209 S Ault ST, Moberly, MO**Color:** Orange**District:** WARD TWO**Township:****Year:****Next Test Date:** 06/17/2017**Make:****FLOW TEST SUMMARY**

Test Date	Test Purpose	Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
06/24/2024		438	301	40	5	10	375

Hydrant Number: 2w472**Location:** S Ault ST & E Logan ST, Moberly, MO**Color:** Orange**District:** WARD TWO**Township:****Year:****Next Test Date:** 06/17/2021**Make:****FLOW TEST SUMMARY**

Flow at	Flow at	Static	Pitot	Actual Residual	Calculated
---------	---------	--------	-------	-----------------	------------

Test Date	Test Purpose	0 PSI	20 PSI	Pressure	Pressure	Pressure	Flow
06/30/2024		570	392	40	10	5	531

Hydrant Number: 2w474

Location: E Logan ST & Virginia ST, Moberly, MO **Color:** Orange
District: WARD TWO **Township:** **Year:**
Next Test Date: 06/17/2021 **Make:**

FLOW TEST SUMMARY		Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
Test Date	Test Purpose	0 PSI	20 PSI	Pressure	Pressure	Pressure	Flow
06/30/2024		570	392	40	10	5	531

Hydrant Number: 2w475

Location: S. Morely St. & E Lee ST **Color:** Orange
District: WARD TWO **Township:** **Year:**
Next Test Date: 06/17/2021 **Make:**

FLOW TEST SUMMARY		Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
Test Date	Test Purpose	0 PSI	20 PSI	Pressure	Pressure	Pressure	Flow
06/30/2024		706	447	35	15	5	650

Hydrant Number: 2w476

Location: E Lee ST & Olive ST, Moberly, MO **Color:** Red
District: WARD TWO **Township:** **Year:**
Next Test Date: 06/30/2025 **Make:**

FLOW TEST SUMMARY		Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
Test Date	Test Purpose	0 PSI	20 PSI	Pressure	Pressure	Pressure	Flow

06/30/2024 570 392 40 10 5 531

Hydrant Number: 2w477

Location: S Morley ST, Moberly, MO **Color:** Orange
District: WARD TWO **Township:** **Year:**
Next Test Date: 06/30/2025 **Make:**

FLOW TEST SUMMARY		Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
Test Date	Test Purpose						
06/30/2024		706	447	35	15	5	650

Hydrant Number: 2w478

Location: E Carpenter ST & Promenade ST, Moberly, MO **Color:** Orange
District: WARD TWO **Township:** **Year:**
Next Test Date: 06/30/2025 **Make:**

FLOW TEST SUMMARY		Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
Test Date	Test Purpose						
06/30/2024		577	365	35	10	5	531

Hydrant Number: 2w479

Location: Cleveland AVE, Moberly, MO **Color:** Red
District: WARD TWO **Township:** **Year:**
Next Test Date: 06/30/2025 **Make:**

FLOW TEST SUMMARY		Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
Test Date	Test Purpose						
06/30/2024		258	163	35	2	5	237

Hydrant Number: 2w480**Location:** E. Carpent St. & Monroe AVE**Color:** Red**District:** WARD TWO**Township:****Year:****Next Test Date:** 06/30/2025**Make:****FLOW TEST SUMMARY**

Test Date	Test Purpose	Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
06/30/2024		636	403	35	10	10	531

Hydrant Number: 2W481**Location:** E Logan ST & Monroe AVE, Moberly, MO**Color:** Red**District:** WARD TWO**Township:****Year:****Next Test Date:** 06/30/2025**Make:****FLOW TEST SUMMARY**

Test Date	Test Purpose	Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
06/30/2024		636	403	35	10	10	531

Hydrant Number: 2W482**Location:** E Carpenter ST, Moberly, MO**Color:** Red**District:** WARD TWO**Township:****Year:****Next Test Date:** 06/30/2025**Make:****FLOW TEST SUMMARY**

Test Date	Test Purpose	Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
06/30/2024		779	493	35	15	10	650

Hydrant Number: 2W483

Location: 500 Blk McKinely St., Moberly, MO
District: WARD TWO **Township:**
Next Test Date: 07/01/2016

Color: Red
Year:
Make:

FLOW TEST SUMMARY		Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
Test Date	Test Purpose						
06/30/2024		245	155	35	2	2	237

Hydrant Number: 2W484

Location: E Carpenter ST & Garfield AVE, Moberly, MO
District: WARD TWO **Township:**
Next Test Date: 06/30/2025

Color: Red
Year:
Make:

FLOW TEST SUMMARY		Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
Test Date	Test Purpose						
06/30/2024		1452	919	35	30	20	919

Hydrant Number: 2W485

Location: 515 Garfield AVE, Moberly, MO
District: WARD TWO **Township:**
Next Test Date: 06/30/2025

Color: Orange
Year:
Make:

FLOW TEST SUMMARY		Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
Test Date	Test Purpose						
06/30/2024		1452	919	35	30	20	919

Hydrant Number: 2W486

Location: E Logan ST & Garfield AVE, Moberly, MO
District: WARD TWO **Township:**
Next Test Date: 06/30/2025

Color: Red
Year:
Make:

FLOW TEST SUMMARY		Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
Test Date	Test Purpose						
06/30/2024		1452	919	35	30	20	919

Hydrant Number: 2W487

Location: 414 Harrison, Moberly, MO
District: WARD TWO **Township:**
Next Test Date: 06/30/2025

Color: Red
Year:
Make:

FLOW TEST SUMMARY		Flow at 0 PSI	Flow at 20 PSI	Static Pressure	Pitot Pressure	Actual Residual Pressure	Calculated Flow
Test Date	Test Purpose						
06/30/2024		980	674	40	25	10	839

Report Filter Settings

Report Name: Hydrant Flow Tests by Test Date
Filter Name: Last Month
Filter Expression: [TestDate] is between '6/1/2024 12:00:00 AM' and '6/30/2024 11:59:59 PM'