



Date: July 20, 2026

To: City of Maple Plain


From: David Medina, Alex McArdle, Operators

O & M Report: June 2026


Maple Plain Operations & Maintenance


- Completed all daily rounds and reads on water plant operations.
- Completed all monthly fluoride sample collections per MDH monitoring schedule.
- Completed all Bac-T samples per MDH monitoring schedule.
- Completed all monthly water sampling and testing per MDH monitoring schedule.
- Completed all necessary maintenance on chemical mixers, pumps, and chemical mixing.
- Completed all monthly Chlorine chemical cylinder change out and performed proper PPE procedures.
- Completed all assigned work orders to water treatment facilities.
- Completed two final meter reads.
- Completed twelve locates in city limits.
- Completed all assigned work orders to all city equipment.
- Completed all tasks assigned to city parks and buildings.
- Identified and had chlorine issue fixed in treatment plant.
- Had Tree Tech remove tree at Parkview.
- Focused on completing tasks on Maintenance X.
- Removed fuel barrels in public works back lot.

Total Water Pumped - In Gallons

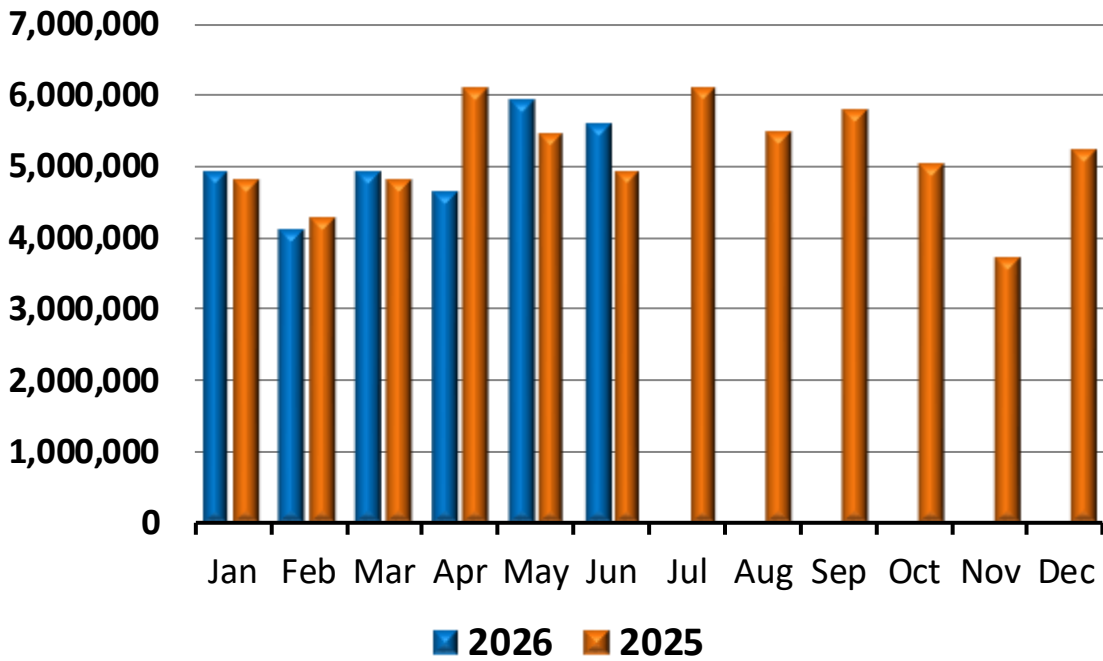

Total WasteWater to MetCouncil

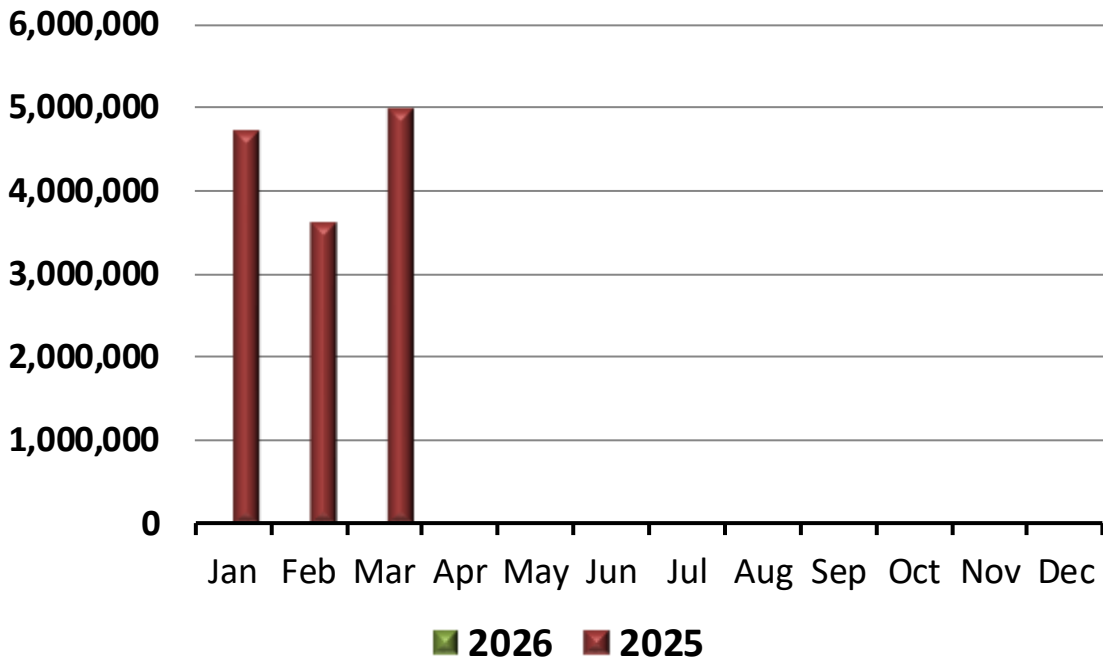

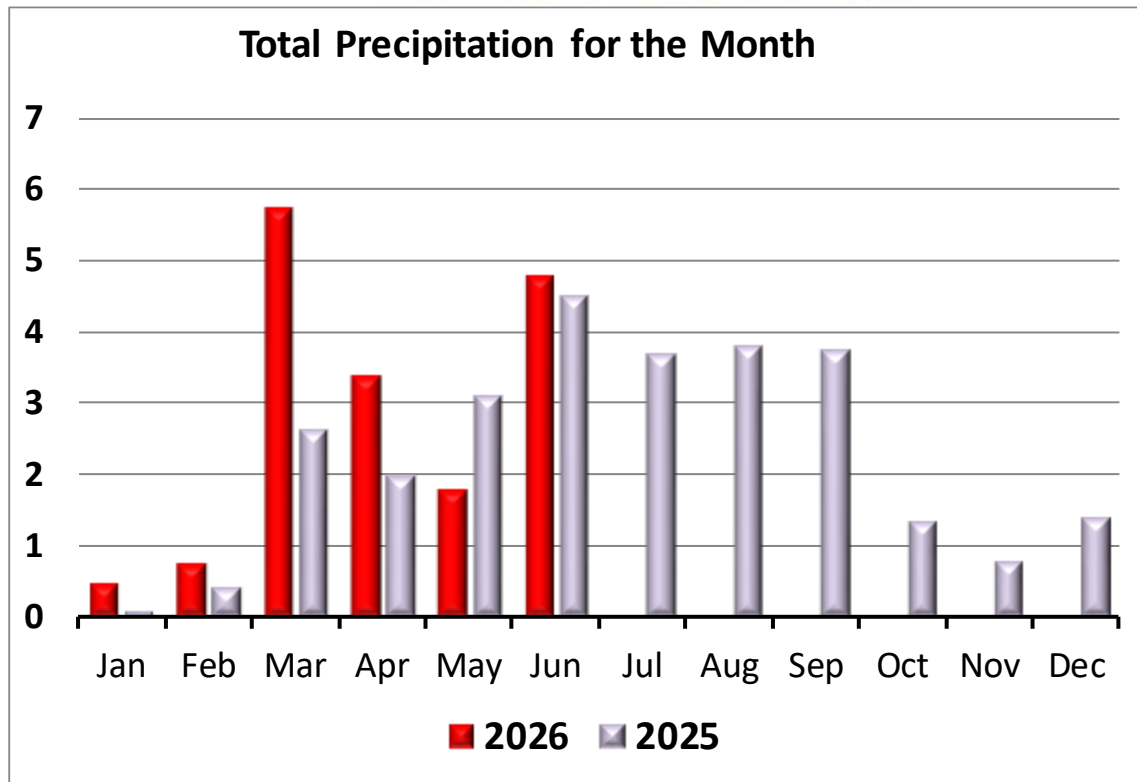

		June-26	May-26	June-25
Water	Units			
Average Daily Pumped	gallons	186,466	191,419	164,366
Maximum Daily Pumped	gallons	373,000	315,000	255,000
Total Monthly Pumped	gallons	5,594,000	5,934,000	4,931,000
Well #1 Pumped	gallons	0	0	0
Well #1 Average Pumped	gallons	0	0	0
Well #3 Pumped	gallons	2,551,000	3,000,000	251,900
Well #3 Average Pumped	gallons	85,033	96,774	83,966
Well #4 Pumped	gallons	2,519,000	2,380,000	2,412,000
Well #4 Average Pumped	gallons	83,966	76,774	80,400
Fluoride used	gallons	6.50	13.00	19.00
Fluoride Average used	gallons	0.20	0.40	0.63
Poly Phosphate used	pounds	7.60	8.40	13.80
Poly Phosphate Average used	pounds	0.25	0.20	0.46
Chlorine used	pounds	44.50	287.90	126.10
Chlorine Average used	pounds	1.40	9.20	4.20
HMO used	gallons	151.40	138.00	25.00
HMO Average used	gallons	5.00	4.40	0.83
Potassium Permanganate used	gallons	129.70	158.60	11.50
Wastewater				
Effluent Flow				
Maximum Daily Pumped Wastewater	gallons	0	0	0
Average Daily Pumped Wastewater	gallons	0	0	0
Lift Station Effluent to Met Council	gallons	0	0	0
Precipitation Monthly Total	Inches	5	2	5
Contract True-Ups - Current Contract Year				
Item	Budgeted Amount	Amount Spent	% of Budget	% of Time
Chemical Budget	\$12,169.00	\$6,969.00	57%	92%
Maintenance Budget	\$6,539.00	\$3,120.00	48%	92%
Total	\$18,708.00	\$10,089.00	54%	92%