



Date: February 9, 2026



To: City of Maple Plain

From: David Medina, Operator

O & M Report January 2026

Maple Plain Operations & Maintenance

- Completed all daily rounds and reads on water treatment plant operations.
- Completed monthly Fluoride sample collections per MDH monitoring schedule.
- Completed all Bac-T sample collections per MDH monitoring schedule.
- Completed all monthly water samples and testing per MDH monitoring schedule.
- Completed all monthly Chlorine Chemical Cylinder change outs and performed proper PPE procedures.
- Completed all necessary maintenance on chemical mixers, pumps, and chemical mixing.
- Completed all assigned work orders to water treatment facilities.
- Completed all necessary ordering of water treatment lab supplies.
- Completed a total of five locates within city limits.
- Completed a total of five final water meter reads.
- Completed WQP samples and mailed them off to MDH.
- Completed MPRS and submitted report.
- Completed the task of having annual inspections done by Quality Flow on the recycle, and sludge pumps.
- Completed two watermain break repairs, work performed by Valley Rich.
- Completed all tasks of snow removal of trails and parks.
- Completed all tasks of Maintenance on public works equipment.
- Completed the task of removing Christmas decorations.
- Completed the task of replacing all mailboxes damaged by snowplow.

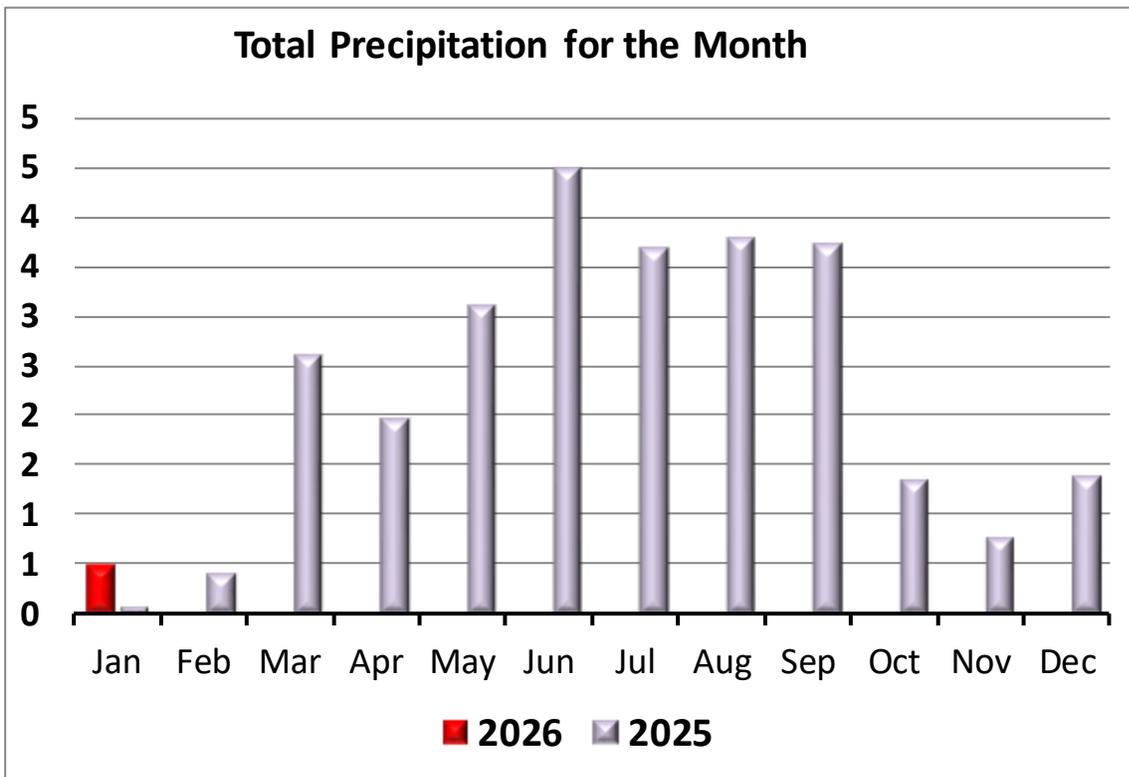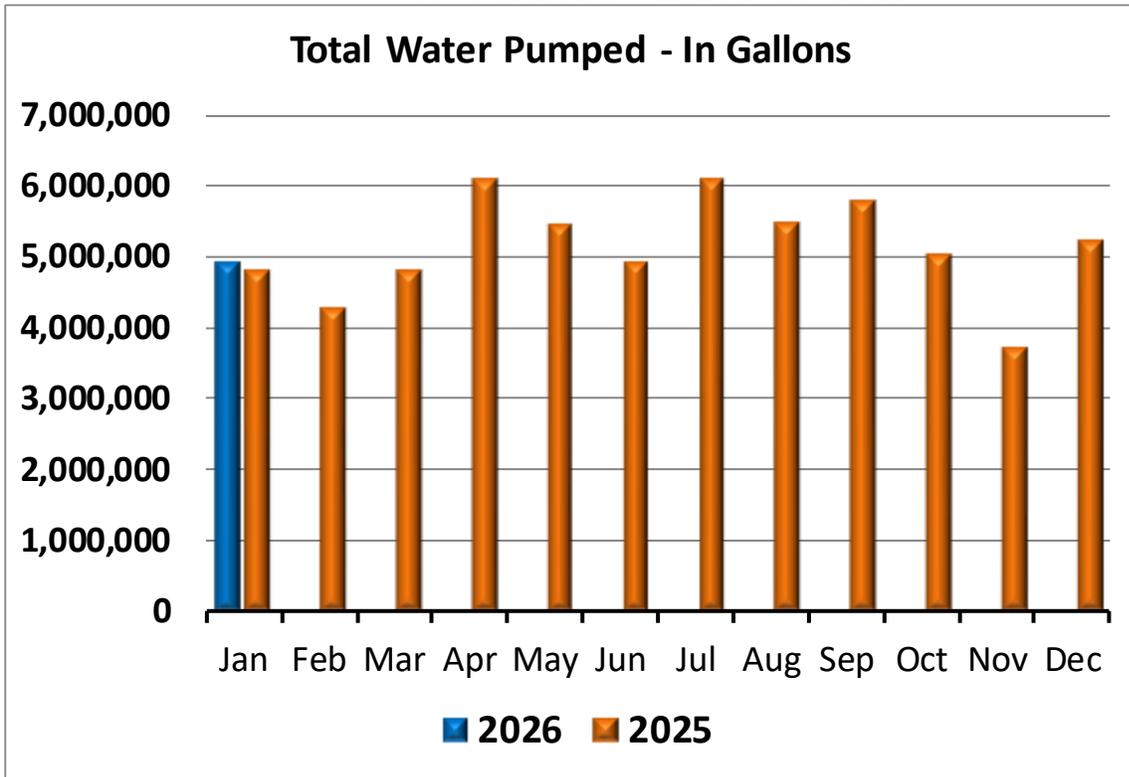

		January-26	December-25	January-25
Water	Units			
Average Daily Pumped	gallons	158,838	169,032	155,194
Maximum Daily Pumped	gallons	279,000	413,000	289,000
Total Monthly Pumped	gallons	4,924,000	5,240,000	4,811,000
Well #1 Pumped	gallons	0	0	0
Well #1 Average Pumped	gallons	0	0	0
Well #3 Pumped	gallons	2,366,000	2,534,000	2,345,000
Well #3 Average Pumped	gallons	76,322	81,741	75,645
Well #4 Pumped	gallons	2,036,000	2,167,000	2,119,000
Well #4 Average Pumped	gallons	65,677	69,903	68,355
Fluoride used	gallons	17.40	8.50	6.00
Fluoride Average used	gallons	0.50	0.20	0.19
Poly Phosphate used	pounds	6.00	7.80	6.40
Poly Phosphate Average used	pounds	0.10	0.20	0.21
Chlorine used	pounds	218.70	236.80	152.20
Chlorine Average used	pounds	7.00	7.60	4.91
HMO used	gallons	171.50	177.20	149.40
HMO Average used	gallons	5.50	5.70	4.82
Potassium Permanganate used	gallons	134.90	139.30	138.60
Wastewater				
Effluent Flow				
Maximum Daily Pumped Wastewater	gallons	0	0	215,427
Average Daily Pumped Wastewater	gallons	0	0	152,531
Lift Station Effluent to Met Council	gallons	0	0	4,728,466
Precipitation Monthly Total	Inches	0	1	0
Contract True-Ups - Current Contract Year				
Item	Budgeted Amount	Amount Spent	% of Budget	% of Time
Chemical Budget	\$12,169.00	\$4,038.00	33%	50%
Maintenance Budget	\$6,539.00	\$1,973.00	30%	50%
Total	\$18,708.00	\$6,011.00	32%	50%

