

**EUSI, LLC Operational Support Services Relating
To the
Wastewater Treatment Facility and Collection System
March 2026**

Mrs. Rainie Torrance,

Please find below a summary of our services provided associated with the operational support services for the wastewater treatment facilities for the month of March 2026.

- The daily average flow for the month of March 2026 was 0.460 MGD.
- Updated the February 2026 monthly monitoring report and compiled information for the report and submitted the report to the State.
- Conducted in-house process control testing for the SBRs.
- Sent out the weekly and monthly samples as required by the monitoring permit.
- Tested the plant lift station and plant alarm callouts.
- Administrative coordination with finance and the administrative staff at 3rd street is ongoing.
- Inspected facility perimeter fences and percolation ponds.
- Operations staff decanted the digester to limit the amount of sludge that needed to be sent to the drying beds for further processing and ultimate removal to the off-site landfill.
- Cleaned drying beds 1,3, 5, 7, 9, 11, 17, 18, 20, and 22 and placed into drying bed 24 for future removal.
- Completed routine monthly inspection of the Kubota tractor, the 4" trash pump, and the jetter.
- Preventive Maintenance Program is ongoing per operating hours of the various plant components.
- Completed the bar screen service and inspections throughout the month.
- Completed weekly inspection of the emergency generator prior to and during its weekly test runs.
- Ongoing communication with City staff regarding items associated with the overall wastewater system.
- Conduct daily morning meetings with entire team.
- Wastewater team, mainly City staff, has been keeping up on the dig alerts and locations of the sewer for all of the construction. This is comprising a good bit of staff time to keep up and respond within the required timelines.
- Wastewater team has been working on maintaining the grounds at the plant and the lift stations to keep the weeds at bay. This too is ongoing and staff will continue efforts to keep the sites looking good. See photo of the Bazoobuth lift station.
- State Water Resources Control Board performed an inspection of the treatment plant, drying beds and percolation ponds on March 30, 2026. The inspection went well and the inspector Mr. Varela indicated that she is not expecting any action items as a result of the inspection and was appreciative of the communication that we have had regarding the nitrate sample results and our responsiveness and timeliness of collecting follow-up samples. The report will be forwarded to Mrs. Torrance and for the Board's reference upon receipt.
- Fire extinguishers were tested and checked for the treatment plant, lift stations and vehicles.

Supplemental repair services, exceptional event(s) during the month of November.

- March 1, 2026 City on-call staff was called out at ~1629 hrs for water coming from a manhole on N. L Street and 4th. Staff popped the manhole and confirm proper flow in the main line with no sign of obstruction. City staff responded, no charge for this activity.
- March 2, 2026 operations staff conducted confined space entry on SBR #2 for inspection. Found obstruction in one of the mixing nozzles of the jet header and removed the obstruction, it was an old air control solenoid valve that appears to have been in this nozzle for a long time. Staff removed the end of the mixing header and jet the header out with the sewer jetter. The team will need to re-enter at a later date to remove the rocks and debris that was removed from the header. 5 man hours no charge for this activity.
- March 3, 2026 operations staff completed securing a repaired manhole lid on the hospital line to limit the potential for people to remove the lid and throw rocks into the sewer. There are a couple more lids that will require the same modifications. 2 man hours no charge for this work activity.

- March 5, 2026 operations staff had to replace sections of chain on the bar screen as there was a manhole rung that made its way up to the plant and jammed in the screen and broke the chain. See attached photos. 10 man hours no charge for this work activity.
- March 11, 2026 operations staff ordered a new motor for the bar screen as the existing motor is heavily corroded and the junction box is compromised. Staff will schedule replacement of the motor and conduit from the local control panel when the new motor arrives.
- March 13, 2026 operations staff dropped off the failed effluent EQ pump at RPM in Henderson NV for evaluation. Upon receipt of the report a decision can be made on what to do relating to repairs for the pump.
- March 16, 2026 wastewater team purchased new fridge for the weekly samples and installed the fridge. No charge for this activity.
- March 25, 2026 operations staff performed a confined space entry for inspection and cleaning of SBR #2 from the debris that was jettied out of the mixing header pipe as well as some other debris that had accumulated in the SBR over time. Hardware was inspected cleaned and painted. One bolt for the clamp on the air supply line was replaced. 12 man hours, no charge for this work activity.
- March 26, 2026 operations staff installed a new blower/fan for the biofilter for the motive wet well. 2 hours, no charge for this work activity.
- March 30, 2026 wastewater team began recoating SBR #2 motive wet well with Tnemec epoxy coating. Additional preparation is needed prior to completing the coating activities. 8 man hours no charge for this activity.


Should you have any questions regarding the monthly activity please feel free to contact me at 602-300-7946.

Sincerely,




Kris Hendricks, EUSI, LLC; Managing Member

Bar Screen repairs March 5, 2026

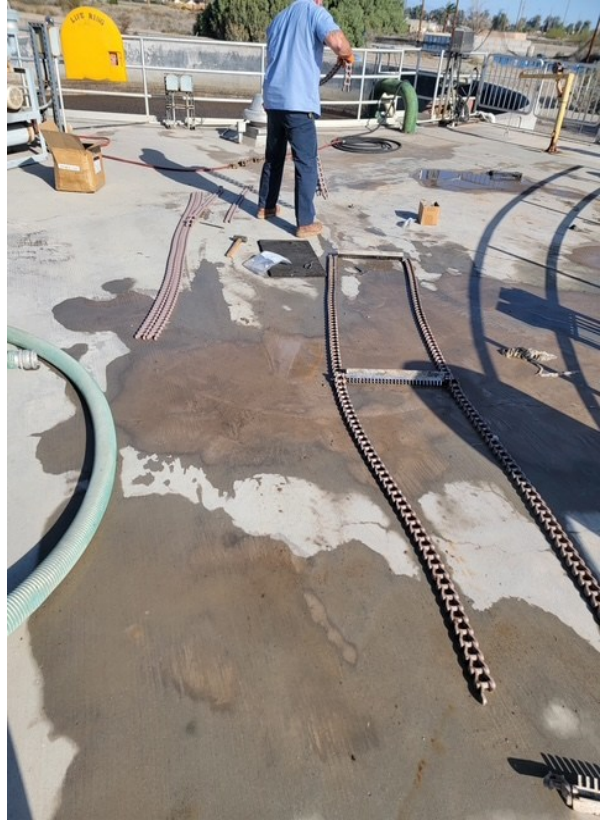

SBR 2 cleaning and inspection

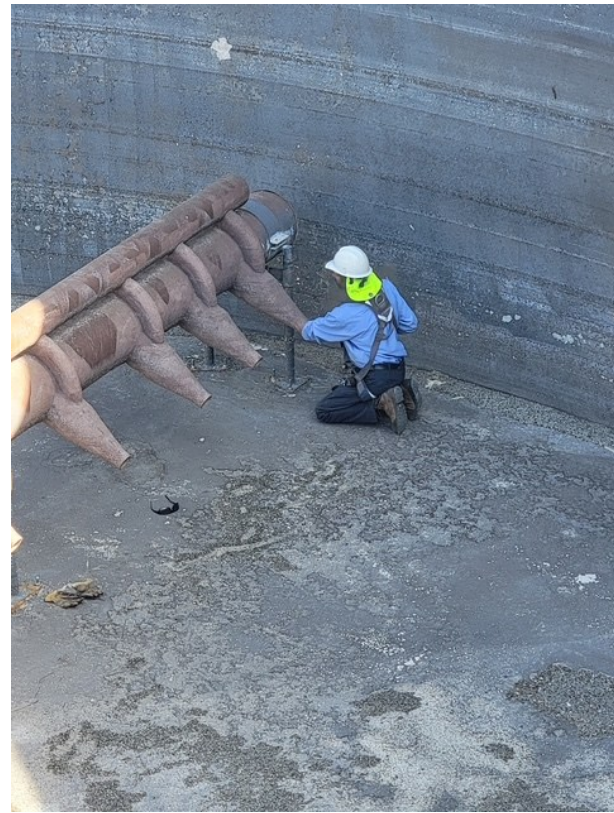

SBR #2 motive wet well preparation for new coating



Bazoobuth Lift Station site

