


House Plan Zone, LLC.

www.HPZplans.com

Phone: 601.336.3254

Email: sales@hpzplans.com

Fax: 1-800-574-1387

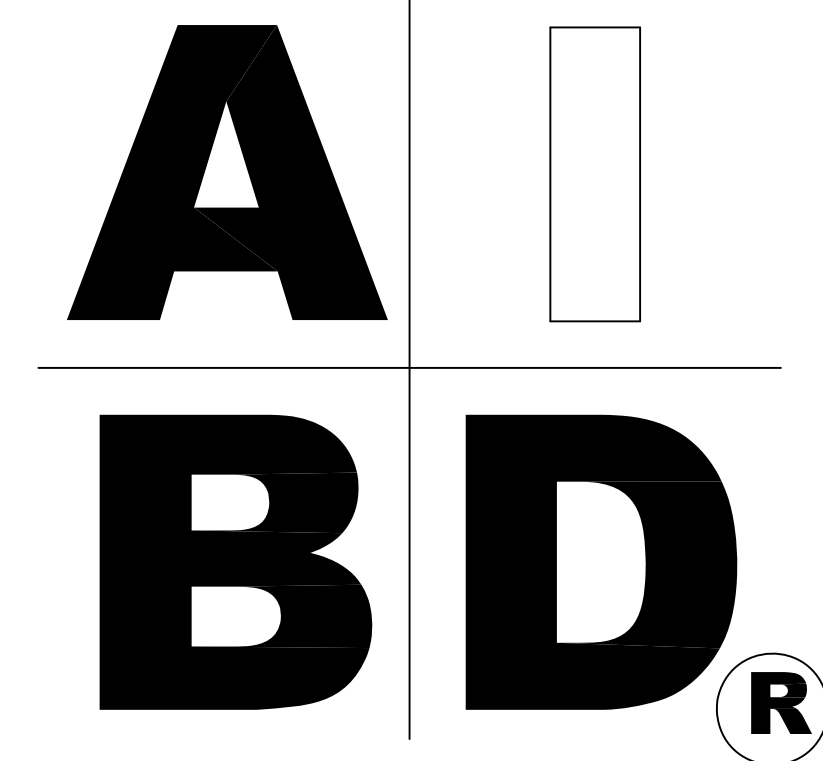

STANDARD ABBREVIATIONS

@	AT	LT.	LIGHT
#	FOUND(S)	LIN.	LINEN
APPROX.	APPROXIMATELY	MANUF.	MANUFACTURER
BASE	BASEMENT	MAS.	MASONRY
B/T	BETWEEN	MAX.	MAXIMUM
BLK.	BLOCK	MTL.	METAL
BLK'G	BLOCKING	MIN.	MINIMUM
BD.	BOARD	N.I.C.	NOT IN CONTRACT
BRD.	BOARD	O.C.	ON CENTER
BOT.	BOTTOM	O/C	ON CENTER
BLDG.	BUILDING	OPT.	OPTIONAL
CAB.	CABINET	O.S.B.	ORIENTED STRAND BOARD
CLG.	CEILING	OTS	OWNER TO SELECT
CLR.	CLEAR	O.T.S	OWNER TO SELECT
CLOS.	CLOSET	FG.	PAGE
COL.	COLUMN	FAN.	PANTRY
COLS.	COLUMNS	FL.	PLATE
CONC.	CONCRETE	F	PLATE
CMU	CONCRETE MASONRY UNIT	PLYND	PLYWOOD
C.U.	CONDENSOR UNIT	PLYND	PLYWOOD
CONN.	CONNECTION	POLY.	POLYETHYLENE
CONT.	CONTINUOUS	PSI	POUNDS PER SQUARE INCH
COVER'G	COVERING	PRE-FAB	PREFABRICATED
CS	GRAVEL SPACE	RE.	REFERENCE
DECO.	DECORATIVE	REF.	REFRIGERATOR
DET.	DETAIL	REINF.	REINFORCED
DIA.	DIAMETER	R	RESISTANCE
DWL	DISHWASHER	R.A.	RETURN AIR
DBL	DOUBLE	R.A.G.	RETURN AIR GRILLE
DF	DOUGLAS FIR	REQ'D	REQUIRED
D	DRYER	SCR.	SCREEN
EA.	EACH	SHLV'S	SHELVES
ELEV.	ELEVATION	SHR.	SHOWER
ENG.	ENGINEER	SHWR.	SHOWER
FT.	FEET	SST.	SIMPSON STRONG TIE
F.F.L.	FINISHED FLOOR LINE	SP	SOUTHERN PINE
FIN.	FINISH	SPECS.	SPECIFICATIONS
F.C.	FIRE CODE	SQ.	SQUARE
FLR.	FLOOR	S.F.	SQUARE FOOTAGE
FTG.	FOOTING	STL.	STEEL
FOUND.	FOUNDATION	THK.	THICK
FND.	FOUNDATION	THK.	THICKNESS
FR.	FREEZER	TBD.	TO BE DETERMINED
GA.	GAUGE	TR.	TRANSOM
GALV.	GALVANIZED	TYP.	TYPICAL
GYP.	GYPSUM	U.T.C.	UNDER THE COUNTER
HDR.	HEADER	UTIL.	UTILITY
HVAC	HEATING, VENTILATION & AIR CONDITIONING	VAN.	VANITY
HT.	HEIGHT	VERT.	VERTICAL
HTS.	HEIGHTS	WH	WATER HEATER
HORIZ.	HORIZONTAL	W	WASHER
IN.	INCHES	WT.	WEIGHT
INCL.	INCLUDE	WIN.	WINDOW
INSUL.	INSULATION	WM.	WIRE MESH
JT.	JOINT	W	W/TH
JST.	JOIST	W	WOOD
JSTS.	JOISTS	WFCM	WOOD FRAME CONSTRUCTION MANUAL




SHEET INDEX:

- 1 COVER SHEET
- 2 FOUNDATION PLAN
- 3 FLOOR PLAN & ELECTRICAL PLAN
- 4 EXTERIOR VIEWS
- 5 ROOF PLAN
- 6 CROSS SECTION & CABINETS

BB-1292

CODE DISCLAIMER:

1. THESE PLANS WERE DESIGNED TO MEET IRC 2018 AT THE TIME OF THEIR CREATION AND MORE SPECIFICALLY THE MINIMAL LOCAL CODES OF THE SOUTH MISSISSIPPI AREA. IT IS HIGHLY RECOMMENDED THAT THESE PLANS BE REVIEWED BY A LOCAL STRUCTURAL ENGINEER PRIOR TO CONSTRUCTION.
2. BEAMS AND FLOOR JOISTS ARE NOT SIZED DUE TO THE MANY GEOGRAPHIC LOCATIONS THESE PLANS ARE SOLD. THESE ITEMS SHALL BE SIZED BY A LOCAL ENGINEER OR MANUFACTURER.
3. ALL CEILING & FLOOR JOISTS (IF CONVENTIONAL FRAMING) SHOULD BE SIZED USING THE LATEST VERSION OF THE IRC OR APPLICABLE CODES AT SITE TO MEET THE LOCAL REQUIREMENTS SUCH AS SNOW LOADS AND OTHER FACTORS. THE CEILING JOISTS SIZES LABELED (IF PRESENT) WERE SIZED USING THE 2018 IRC AT THE TIME OF THEIR CREATION. THEY MUST BE VERIFIED AND MODIFIED AS REQUIRED TO MEET THE LATEST EDITION OF THE (IRC) INTERNATIONAL RESIDENTIAL CODE.
4. ALL FOUNDATIONS AND FOOTING DETAILS SHALL BE REVIEWED AND APPROVED BY A LOCAL ENGINEER.
5. CONTRACTOR SHALL PROVIDE ALL HIGH WIND STRAPPING AND ANCHOR BOLTS AS REQUIRED BY THE LOCAL CODE REQUIREMENTS AND THE LATEST VERSION OF THE IRC.

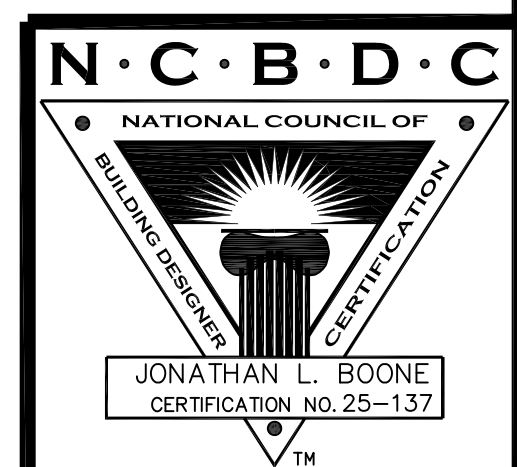


Date: 10/07/19

Drawn By: R.B.W.

Plan Number:

SHEET NUMBER


1

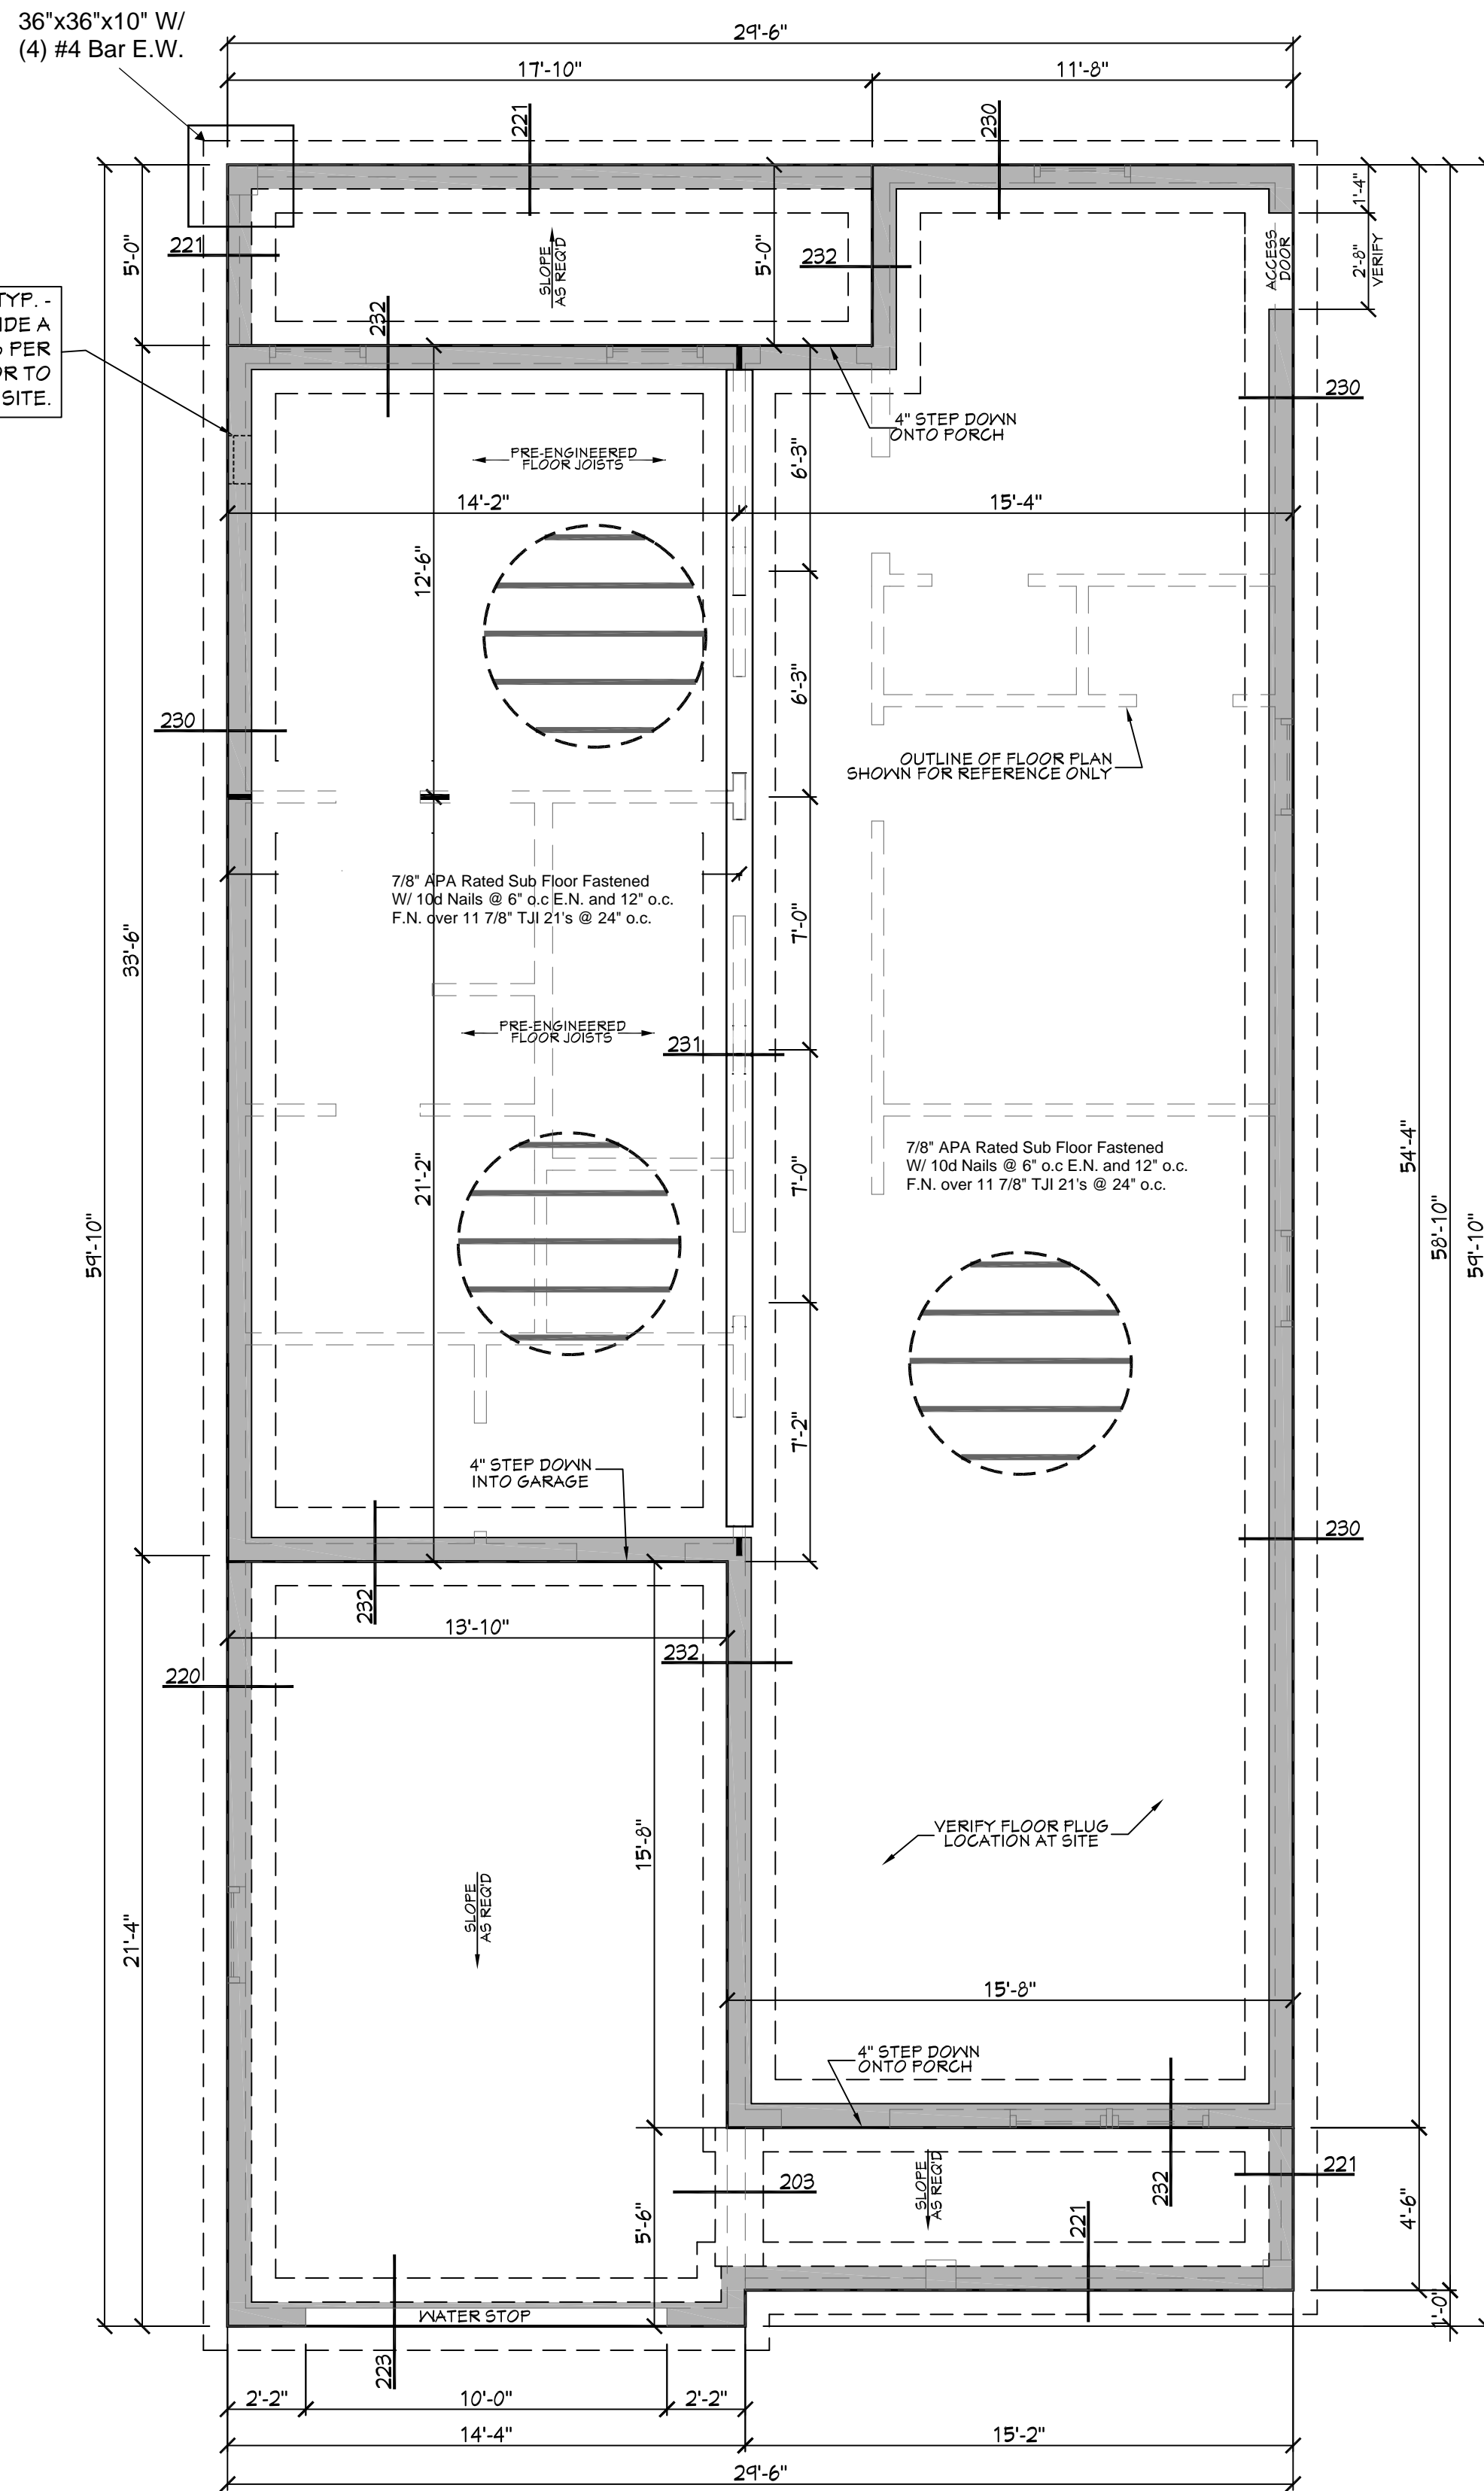


201 FOUNDATION PLAN
 SCALE: 1/4" = 1'-0"

NOTE: PRE-ENGINEERED FLOOR JOISTS ARE SHOWN. REFER TO FLOOR JOIST MANUFACTURER FOR JOIST SIZING, SPACING, CROSS BRACING REQUIREMENTS, AND BEAM SIZES.


*Maintain 30" frost depth for all footings.

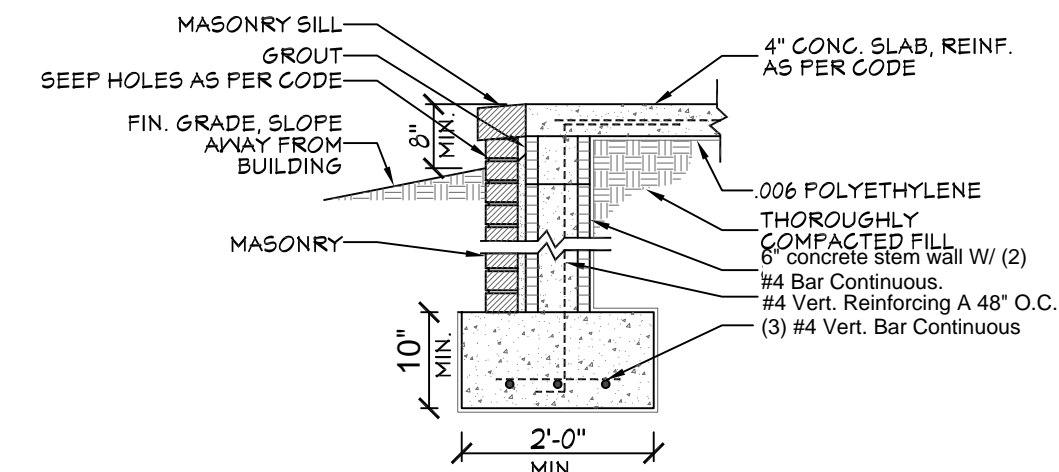


221 FTG. DET.

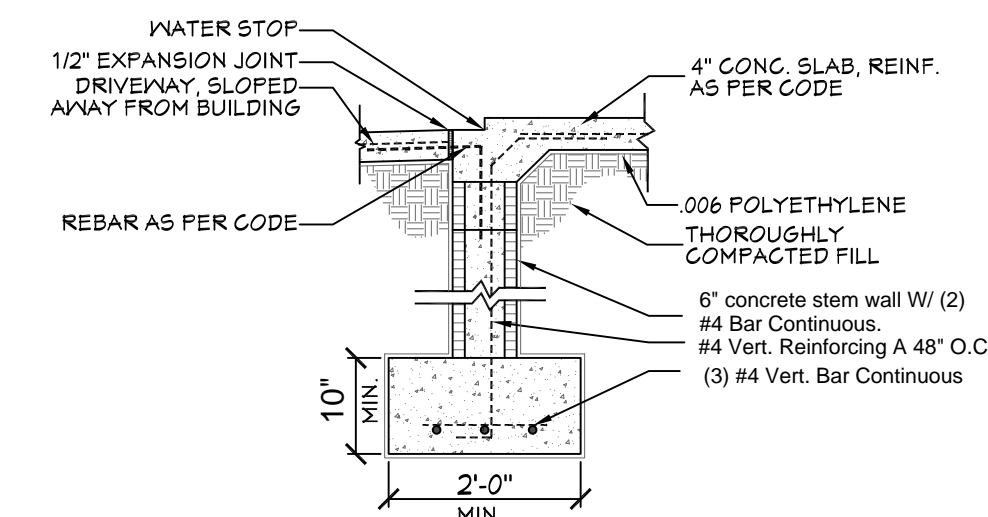


223 FTG. DET.

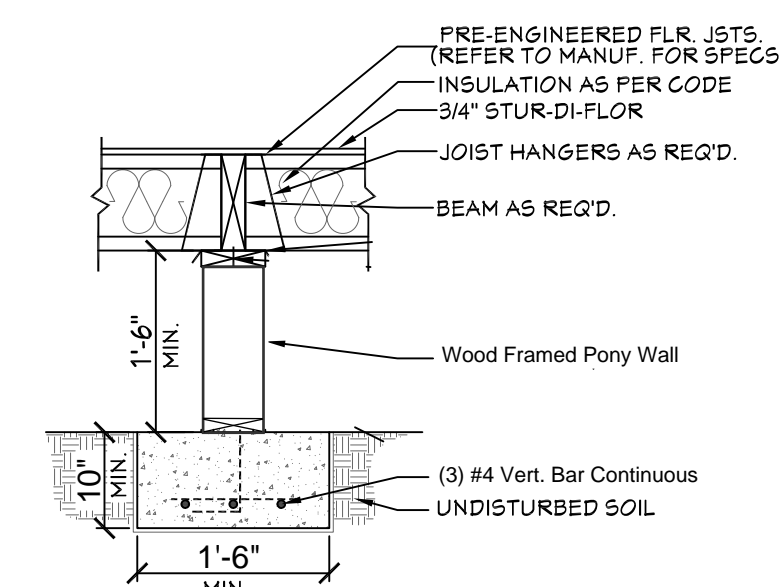


231 FTG. DET.

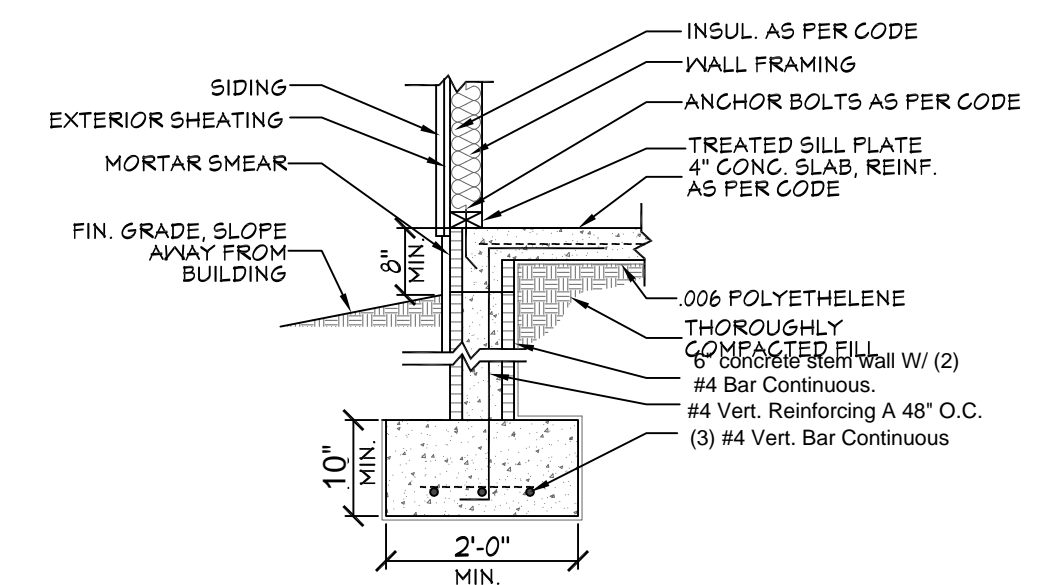

220 FTG. DET.

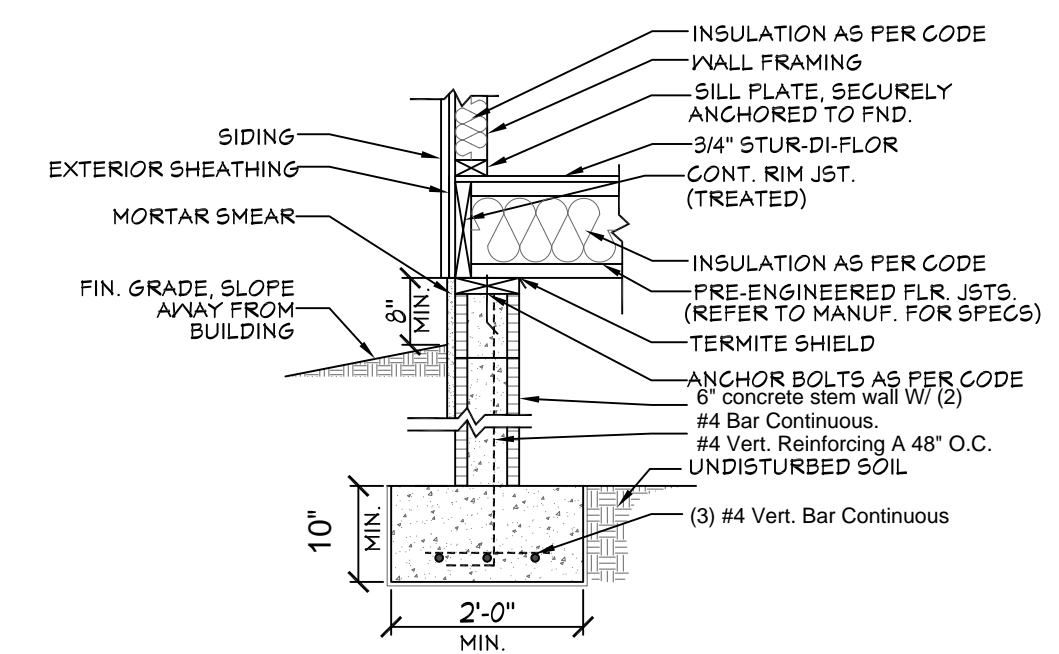

230 FTG. DET.

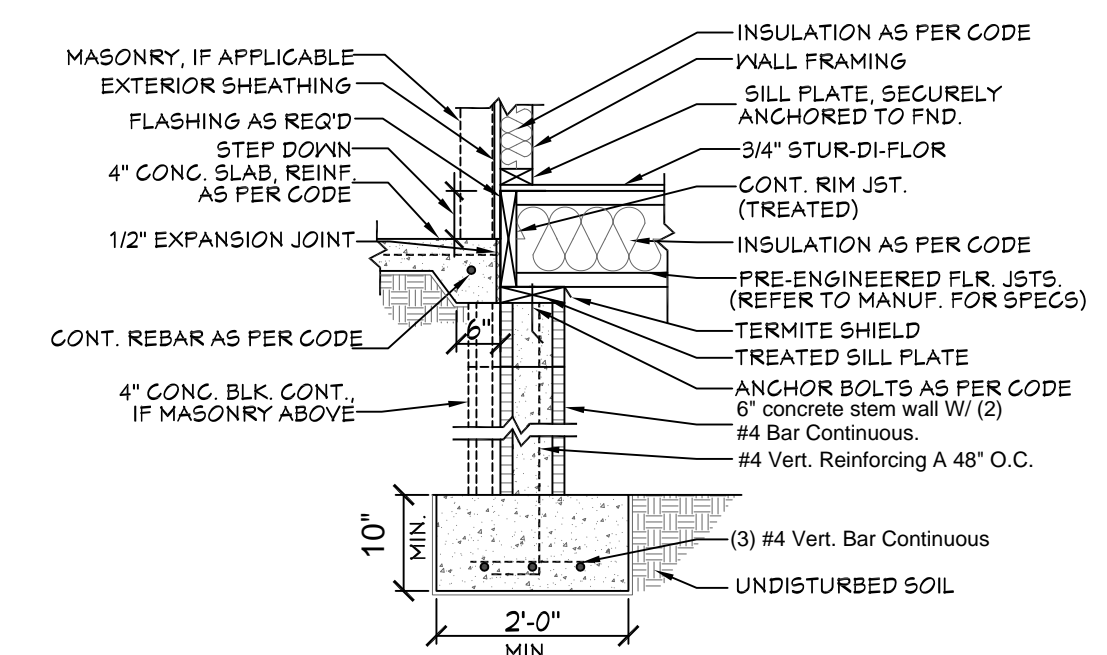


232 FTG. DET.

CRAWLSPACE FOUNDATION NOTES:

- ALL FOOTING SIZES AND LOCATIONS TO BE VERIFIED BY A LICENSED STRUCTURAL ENGINEER.
- CONTRACTOR TO ADAPT PLANS AS REQUIRED TO MEET ALL APPLICABLE CODES AT SITE.
- CONTRACTOR SHALL VERIFY ALL DIMENSIONS WITH FLOOR PLAN PRIOR TO CONSTRUCTION AND MAKE ANY NECESSARY ADJUSTMENTS.
- CONTRACTOR TO PROVIDE WATERPROOFING AS REQ'D TO MEET ALL APPLICABLE CODES AND TYPICAL BUILDING PRACTICES.
- CONCRETE SLABS TO BE 4" (3000 psi MIN.), REINFORCED AS PER CODE OR AS DETERMINED BY LICENSED ENGINEER.
- CONTRACTOR TO PROVIDE ADEQUATE DRAINAGE BASED ON EXISTING SITE CONDITIONS. VERIFY w/LOCAL CODES.
- REFER TO FLOOR JOIST MANUFACTURER FOR JOIST SIZING AND SPACING, CROSS BRACING REQUIREMENTS, AND BEAM SIZES.
- VERIFY THE QUANTITY AND LOCATION OF BRICK VENTS WITH ALL APPLICABLE CODES AT SITE.



House Plan Zone, LLC has exercised great care and effort in the development of these plans and the completion of these construction documents. However, the user assumes no responsibility for any damages, including structural failures resulting from errors, omissions or deficiencies in the design or construction. House Plan Zone, LLC highly recommends that these plans be reviewed by a licensed structural engineer in the area of construction. Other special conditions may be required by local building codes. All dimensions to be verified on site prior to construction. If a foundation plan has been included in these plans, it is general in nature and shall be verified by a licensed engineer prior to construction.

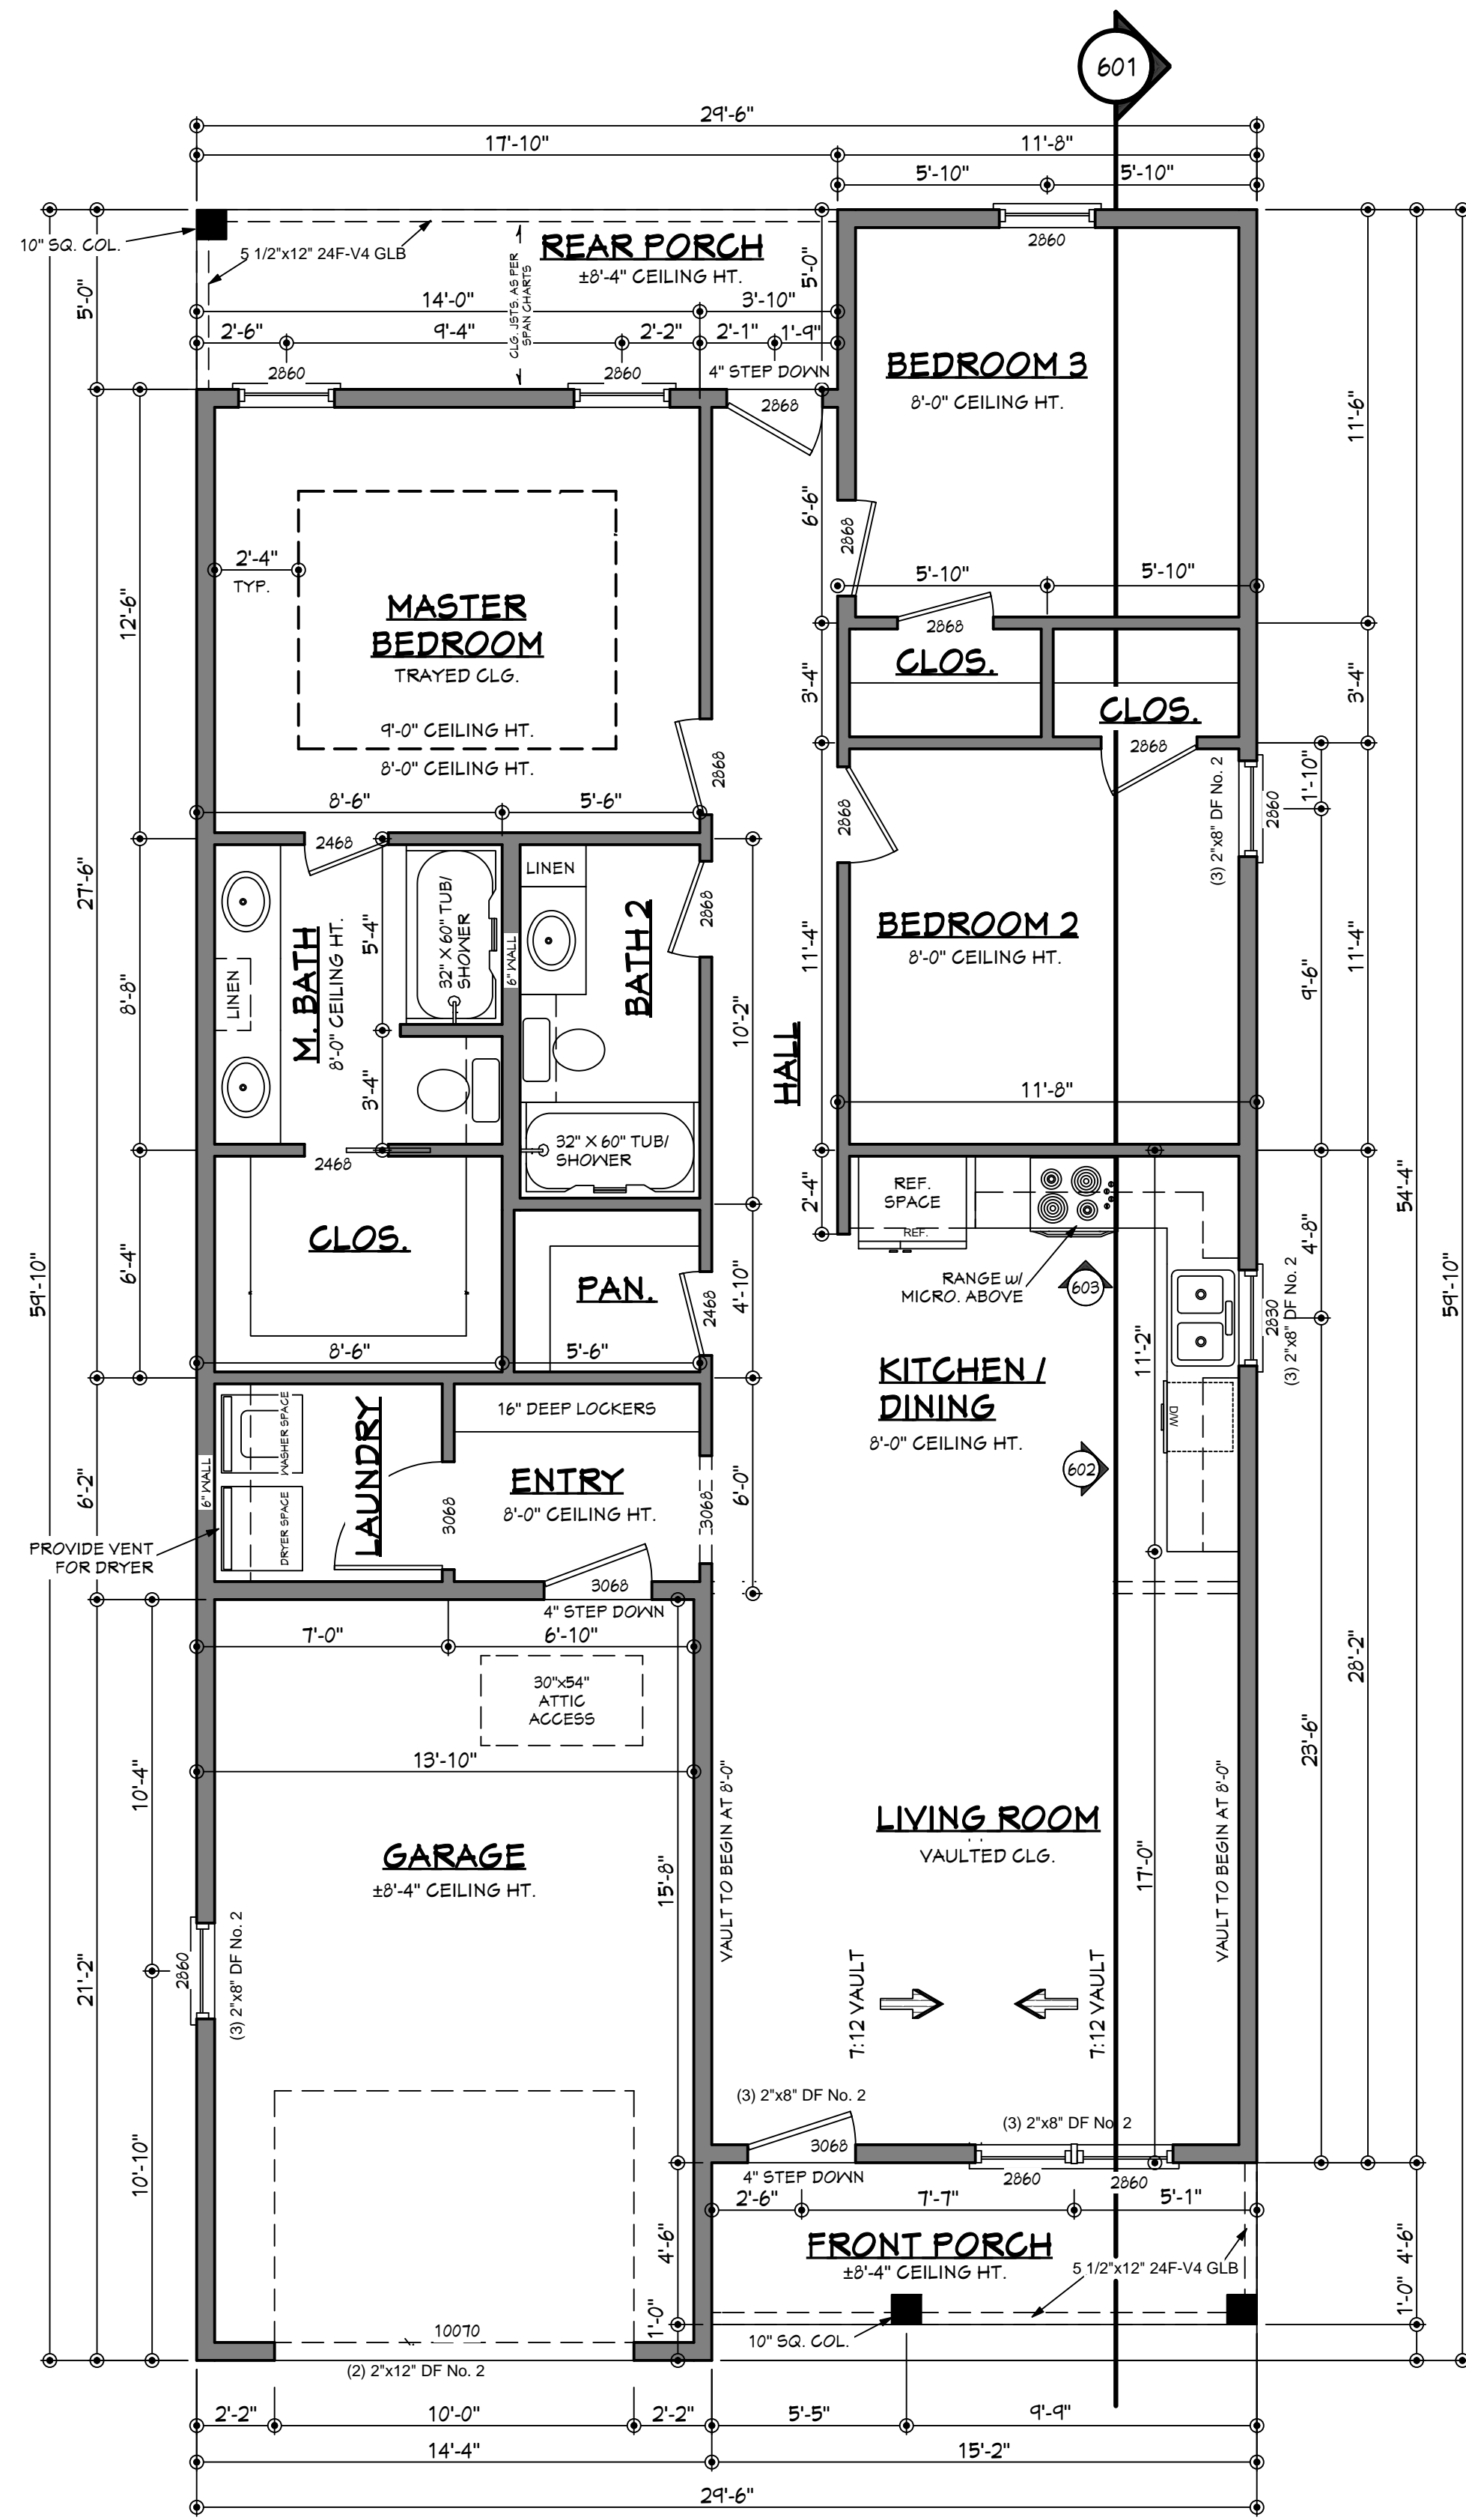

NOTES:
 1.) 2 X 6 EXTERIOR WALLS ARE SHOWN.
 2.) CONTRACTOR TO LOCATE WATER HEATER AND HVAC UNITS AT SITE.


FLOOR PLAN

SCALE: 1/4"===== 1'-0"

AREAS:	1297	S.F. HEATED
	68	S.F. UNHEATED - FRONT PORCH
	295	S.F. UNHEATED - GARAGE
	89	S.F. UNHEATED - REAR PORCH
	452	S.F. TOTAL UNHEATED
	1749	S.F. TOTAL UNDER ROOF

NOTES:

1. ALL DIMENSIONS & SITE CONDITIONS TO BE VERIFIED BY CONTRACTOR PRIOR TO CONSTRUCTION.
2. ALL FINISHES (INTERIOR & EXTERIOR) TO BE VERIFIED WITH OWNER PRIOR TO CONSTRUCTION.
3. VERIFY ALL DOOR AND WINDOW STYLES AND SIZES WITH OWNER PRIOR TO CONSTRUCTION. MANUFACTURER TO SUPPLY ALL ROUGH OPENING SIZES.
4. CONTRACTOR TO VERIFY ALL CLEARANCES OF ALL DOORS, WINDOWS AND OTHER ITEMS THAT ARE CRITICAL, PRIOR TO CONSTRUCTION.
5. CONTRACTOR TO ADAPT PLANS AS REQUIRED TO MEET ALL APPLICABLE CODES AT SITE.
6. ALL BEAMS TO BE SIZED BY A LICENSED STRUCTURAL ENGINEER.
7. PORCHES, BALCONIES OR RAISED FLOOR SURFACES LOCATED MORE THAN 30 INCHES ABOVE THE FLOOR OR GRADE BELOW AT ANY POINT WITHIN 36 INCHES HORIZONTALLY SHALL HAVE GUARDS NOT LESS THAN 36 INCHES IN HEIGHT. OPEN SIDES OF STAIRS WITH A TOTAL RISE OF MORE THAN 30 INCHES ABOVE THE FLOOR OR GRADE BELOW SHALL HAVE GUARDS NOT LESS THAN 34 INCHES IN HEIGHT MEASURED VERTICALLY FROM THE NOSING OF THE STAIRS. SCREENING SHALL NOT BE CONSIDERED AS A GUARD. IRC 2018, R312.1.1 & R312.1.2.
8. M1305.1.2 APPLIANCES IN ATTICS. ATTICS CONTAINING APPLIANCES SHALL BE PROVIDED WITH AN OPENING AND A CLEAR AND UNOBSTRUCTED PASSAGEWAY LARGE ENOUGH TO ALLOW REMOVAL OF THE LARGEST APPLIANCE, BUT NOT LESS THAN 30 INCHES HIGH AND 22 INCHES WIDE AND NOT MORE THAN 20 FEET LONG MEASURED ALONG THE CENTERLINE OF THE PASSAGEWAY FROM THE OPENING TO THE APPLIANCE. THE PASSAGEWAY SHALL HAVE CONTINUOUS SOLID FLOORING IN ACCORDANCE WITH CHAPTER 5 NOT LESS THAN 24 INCHES WIDE. A LEVEL SERVICE SPACE AT LEAST 30 INCHES DEEP AND 30 INCHES WIDE SHALL BE PRESENT ALONG ALL SIDES OF THE APPLIANCE WHERE ACCESS IS REQUIRED. THE CLEAR ACCESS OPENING DIMENSIONS SHALL BE A MINIMUM OF 20 INCHES BY 30 INCHES, AND LARGE ENOUGH TO ALLOW REMOVAL OF THE LARGEST APPLIANCE. EXCEPTIONS:
 a. THE PASSAGEWAY AND LEVEL SERVICE SPACE ARE NOT REQUIRED WHERE THE APPLIANCE CAN BE SERVICED AND REMOVED THROUGH THE REQUIRED OPENING.
 b. WHERE THE PASSAGEWAY IS UNOBSTRUCTED AND NOT LESS THAN 6 FEET HIGH AND 22 INCHES WIDE FOR ITS ENTIRE LENGTH, THE PASSAGEWAY SHALL BE NOT MORE THAN 50 FEET LONG.
9. APPLIANCE ACCESS FOR INSPECTION SERVICE, REPAIR AND REPLACEMENT. APPLIANCES SHALL BE ACCESSIBLE FOR INSPECTION, SERVICE, REPAIR AND REPLACEMENT WITHOUT REMOVING PERMANENT CONSTRUCTION, OTHER APPLIANCES, OR ANY OTHER PIPING OR DUCTS NOT CONNECTED TO THE APPLIANCE BEING INSPECTED, SERVICED, REPAIRED OR REPLACED. A LEVEL WORKING SPACE AT LEAST 30 INCHES DEEP AND 30 INCHES WIDE SHALL BE PROVIDED IN FRONT OF THE CONTROL SIDE TO SERVICE AN APPLIANCE. M1305.1.1
10. EMERGENCY ESCAPE AND RESCUE OPENINGS SHALL BE OPERATIONAL FROM THE INSIDE OF THE ROOM WITHOUT THE USE OF KEYS, TOOLS OR SPECIAL KNOWLEDGE. WINDOW OPENING CONTROL DEVICES COMPLYING WITH ASTM F 2090 SHALL BE PERMITTED FOR USE ON WINDOWS SERVING AS A REQUIRED EMERGENCY ESCAPE AND RESCUE OPENING. ALL SLEEPING ROOMS TO HAVE AN EXTERIOR ACCESS THROUGH A DOOR OR WINDOW WITH A MINIMUM OF 5.7 SQUARE FEET NET CLEAR OPENING AS PER IRC 2018, R310.2.1. EXCEPTION: GRADE FLOOR OR BELOW GRADE OPENINGS SHALL HAVE A MINIMUM NET CLEAR OPENING OF 5 SQUARE FEET. MAXIMUM SILL HEIGHT TO BE 44 INCHES. MINIMUM NET CLEAR OPENING HEIGHT TO BE 24 INCHES. MINIMUM NET CLEAR OPENING WIDTH TO BE 20 INCHES.
11. ALL RETURN AIR GRILLS ARE TO BE LOCATED TO COMPLY WITH SECTION M1602 OF THE IRC 2018.
12. ALL SQUARE FOOTAGE MEASUREMENTS ARE APPROXIMATE AND MAY DIFFER FROM ACTUAL CONSTRUCTED RESIDENCE OR BUILDING.
13. FIRE SPRINKLER SYSTEM TO BE DESIGNED AND INSTALLED (IF REQUIRED BY LOCAL CODES) AS PER THE IRC 2018 AND BY A LICENSED PROFESSIONAL IN THE AREA OF CONSTRUCTION.
14. ALL BATHROOM EXHAUST VENTS SHALL BE VENTED DIRECTLY TO THE EXTERIOR OF THE HOME AND NOT INTO THE ATTIC. IRC 2018, M1505.2

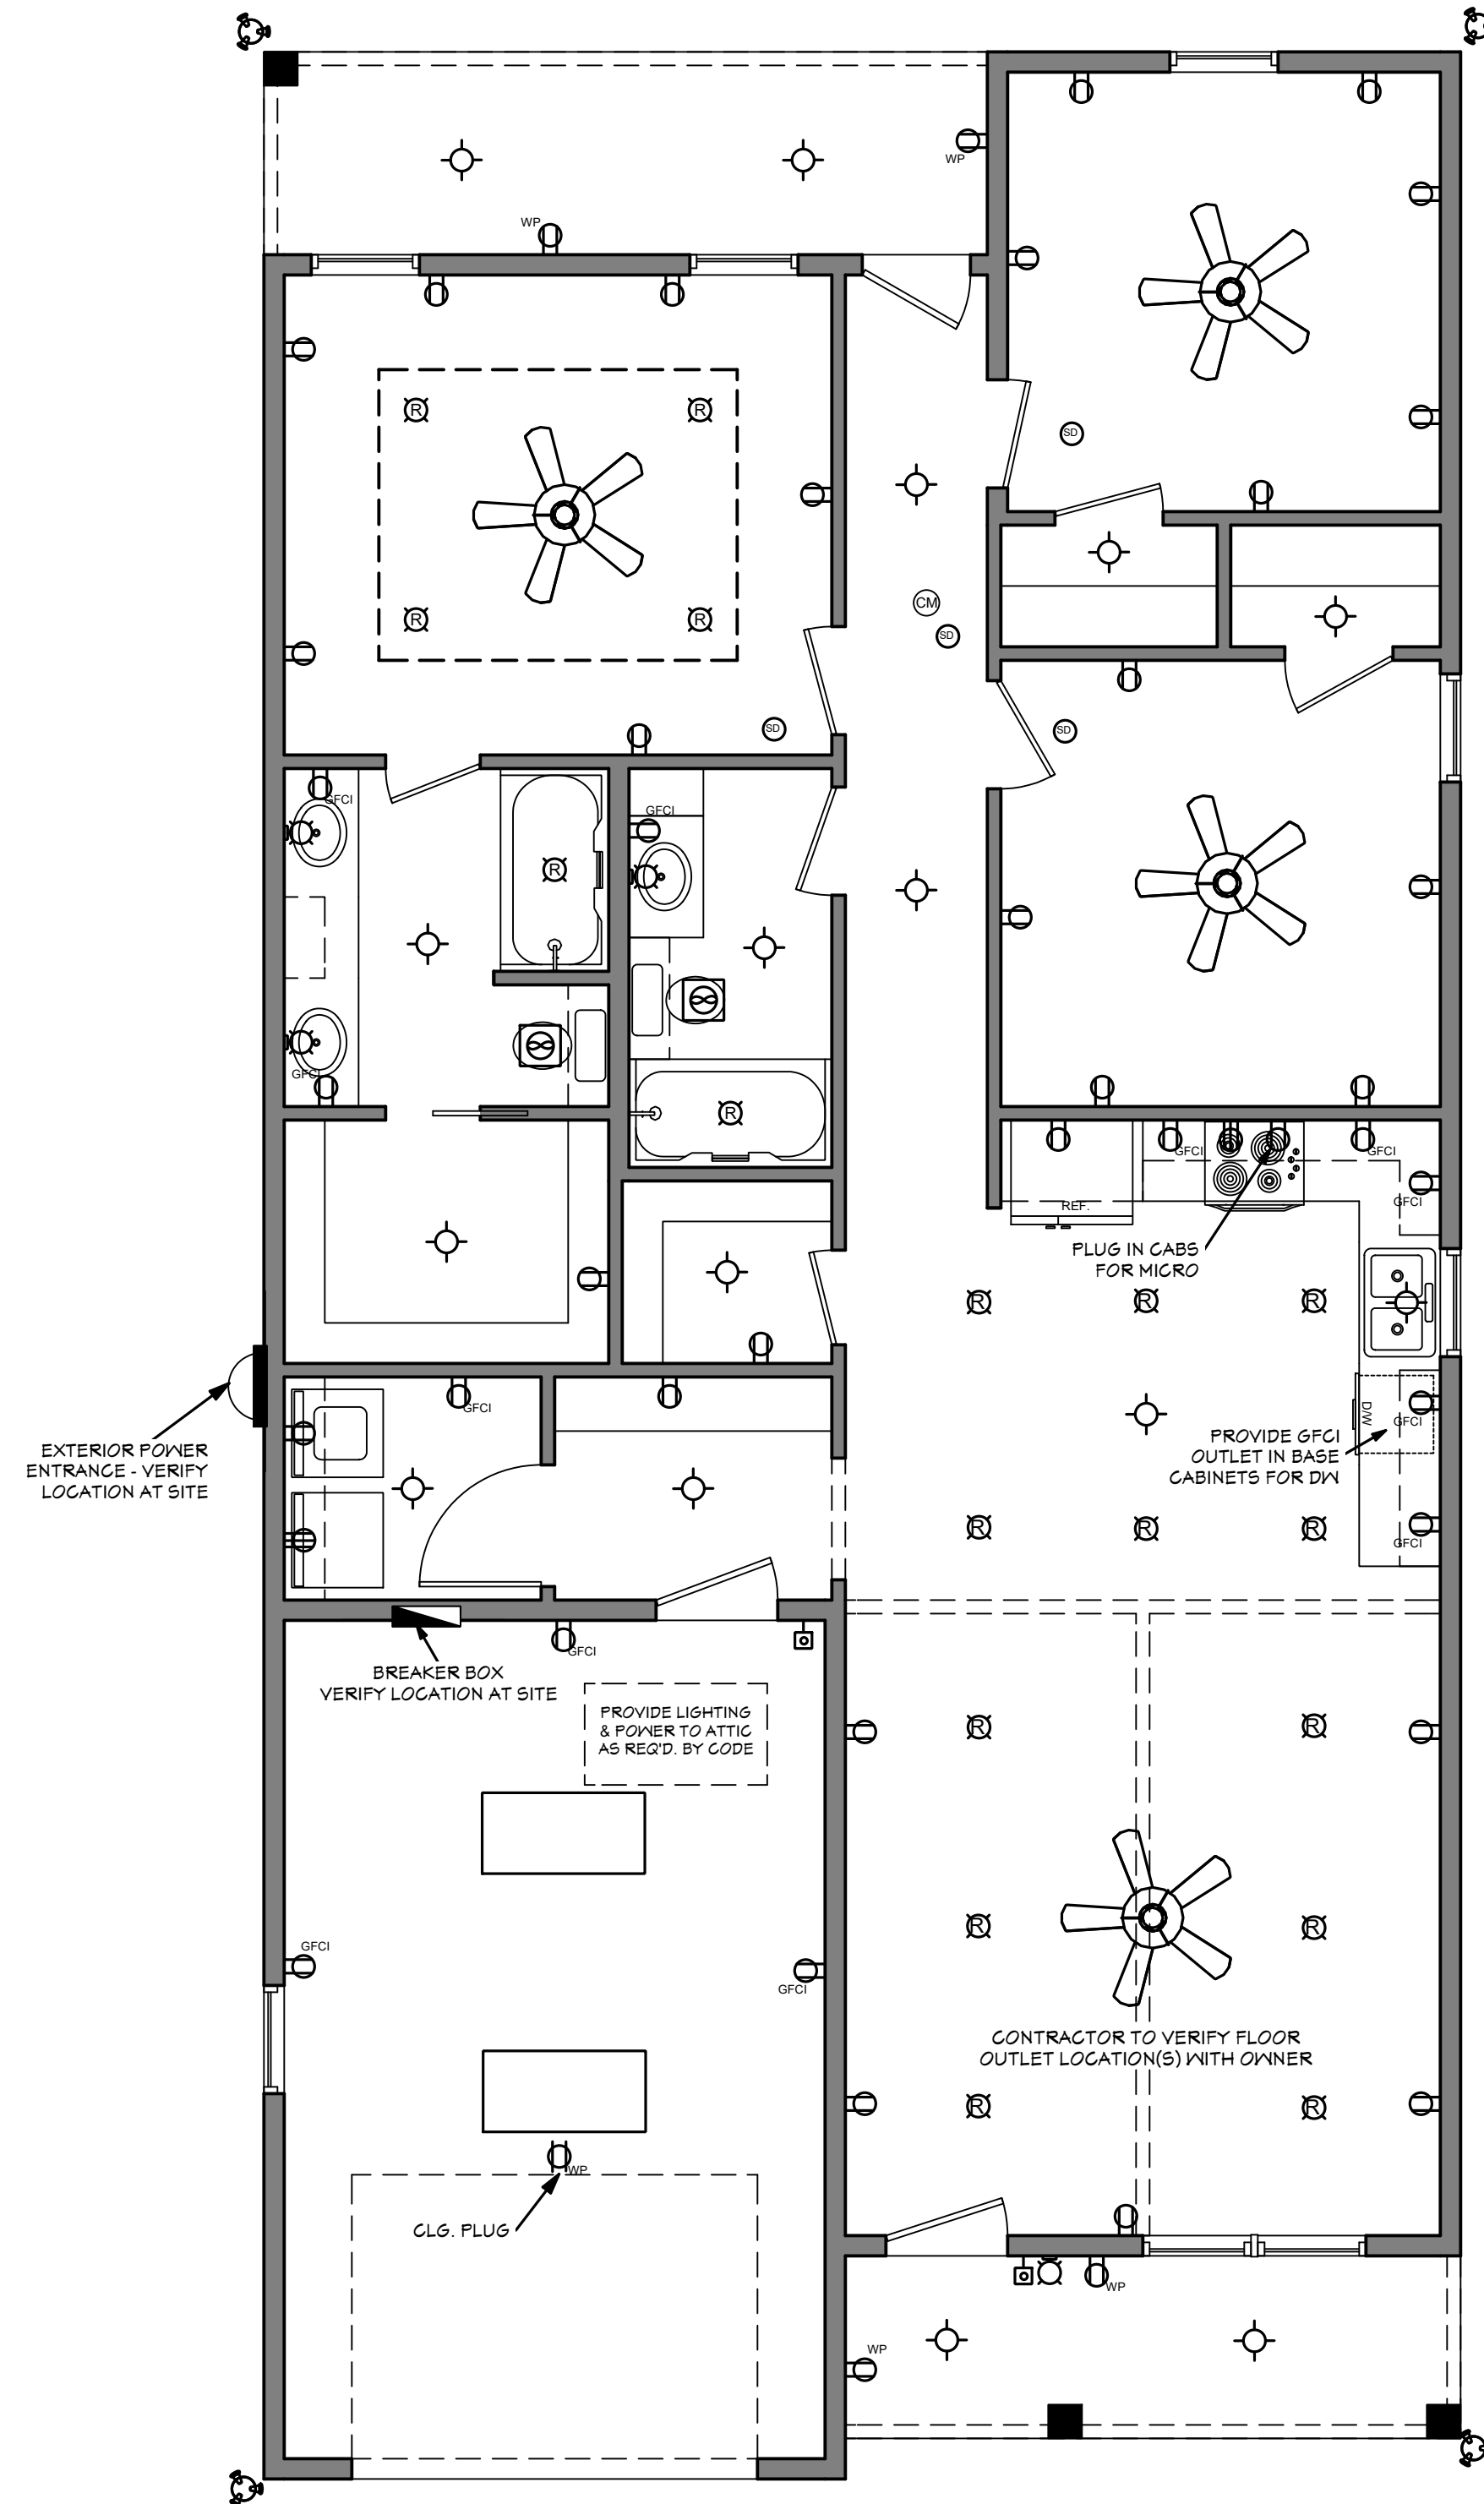

ELECTRICAL PLAN

SCALE: 1/4"===== 1'-0"

NOTE: SWITCHES AND ARCS NOT SHOWN. OWNER TO LOCATE THESE ITEMS DURING ELECTRICAL WALK-THROUGH WITH ELECTRICAL CONTRACTOR.

ELECTRICAL SYMBOLS LEGEND	
SYMBOL	DESCRIPTION
[Symbol]	110 VOLT OUTLET
[Symbol]	GROUND FAULT PROTECTED OUTLET
[Symbol]	WEATHERPROOF OUTLET
[Symbol]	220 VOLT RECEPTACLE
[Symbol]	FLOOR OUTLET (OWNER TO LOCATE)
[Symbol]	CEILING HUNG FIXTURE
[Symbol]	OVERHANG MOUNTED FLOODLIGHTS
[Symbol]	WALL MOUNTED FLOODLIGHTS
[Symbol]	RECESSED CEILING FIXTURE
[Symbol]	FLUORESCENT LIGHT
[Symbol]	CARBON MONOXIDE DETECTOR
[Symbol]	SMOKE DETECTOR
[Symbol]	SWITCH
[Symbol]	THREE WAY SWITCH
[Symbol]	WALL MOUNTED LIGHT
[Symbol]	DIMMER SWITCH (OWNER TO LOCATE)
[Symbol]	DOOR ACTIVATED SWITCH
[Symbol]	WEATHERPROOF OUTLET
[Symbol]	CATS NETWORKING JACK (OWNER TO LOCATE)
[Symbol]	TELEPHONE OUTLET (OWNER TO LOCATE)
[Symbol]	TELEVISION OUTLET (OWNER TO LOCATE)
[Symbol]	DOORBELL BUTTON (CONTRACTOR TO LOCATE)
[Symbol]	THERMOSTAT (CONTRACTOR TO LOCATE)
[Symbol]	CEILING EXHAUST FAN, VENT TO EXTERIOR
[Symbol]	TV SPEAKER
[Symbol]	RADIO SPEAKER
[Symbol]	CEILING FAN ONLY, NO LIGHT KIT
[Symbol]	CEILING FAN WITH LIGHT KIT
[Symbol]	TRACK LIGHTING (OWNER TO LOCATE)
[Symbol]	WALL SCONCE (OWNER TO LOCATE)
[Symbol]	CHANDELIER 1 (O.T.S.)
[Symbol]	CHANDELIER 2 (O.T.S.)
[Symbol]	UNDER COUNTER LIGHTING
[Symbol]	EMERGENCY LIGHTING/ EXIT SIGN

ELECTRICAL NOTES:
 1. ALL WORK SHALL COMPLY WITH ALL CODES APPLICABLE AT SITE.
 2. SMOKE ALARMS SHALL BE INSTALLED IN THE FOLLOWING LOCATIONS: EACH SLEEPING ROOM, OUTSIDE EACH SEPARATE SLEEPING AREA IN THE IMMEDIATE VICINITY OF THE DWELLING, INCLUDING BASEMENTS AND HABITABLE ATTICS. WHEN MORE THAN ONE SMOKE ALARM IS REQUIRED TO BE INSTALLED WITHIN A DWELLING THE ALARM DEVICES SHALL BE INTERCONNECTED IN SUCH A MANNER THAT THE ACTUATION OF ONE ALARM WILL ACTIVATE ALL OF THE ALARMS IN THE UNIT. SMOKE ALARMS SHALL BE HARD WIRED WITH A BATTERY BACK UP.
 3. CARBON MONOXIDE ALARMS SHALL BE INSTALLED OUTSIDE OF EACH SEPARATE SLEEPING AREA IN THE IMMEDIATE VICINITY OF THE BEDROOMS IN DWELLING UNITS WITHIN WHICH FUEL-FIRED APPLIANCES ARE INSTALLED AND IN DWELLING UNITS WITH ATTACHED GARAGES.
 4. A 125 VOLT, SINGLE PHASE, 15-20 AMPERE RATED RECEPTACLE OUTLET SHALL BE INSTALLED AT AN ACCESSIBLE LOCATION FOR THE SERVICING OF HEATING, AIR CONDITIONING AND REFRIGERATION EQUIPMENT. THE RECEPTACLE SHALL BE LOCATED ON THE SAME LEVEL AND WITHIN 25 FEET OF THE EQUIPMENT. THE RECEPTACLE OUTLET SHALL NOT BE CONNECTED TO THE LOAD SIDE OF THE HVAC EQUIPMENT DISCONNECTING MEANS.

HOUSE PLAN ZONE

Designing Homes
Building Relationships

Website:
www.HPZplans.com
 Email:
sales@hpzplans.com
 Phone:
601.336.3254
 Fax:
1.800.574.1387



Pre-Drawn Plan ID:
BB-1292

Date: 10/07/19
 Drawn By: R.B.W.
 Project Name:

SHEET NUMBER

3



Website:
www.HFZplans.com
 Email:
sales@hfpzplans.com
 Phone:
 601.336.3254
 Fax:
 1.800.574.1387





Pre-Drawn Plan ID:
BB-1292

Date: 10/07/19

Drawn By: R.B.W.

SHEET NUMBER

4

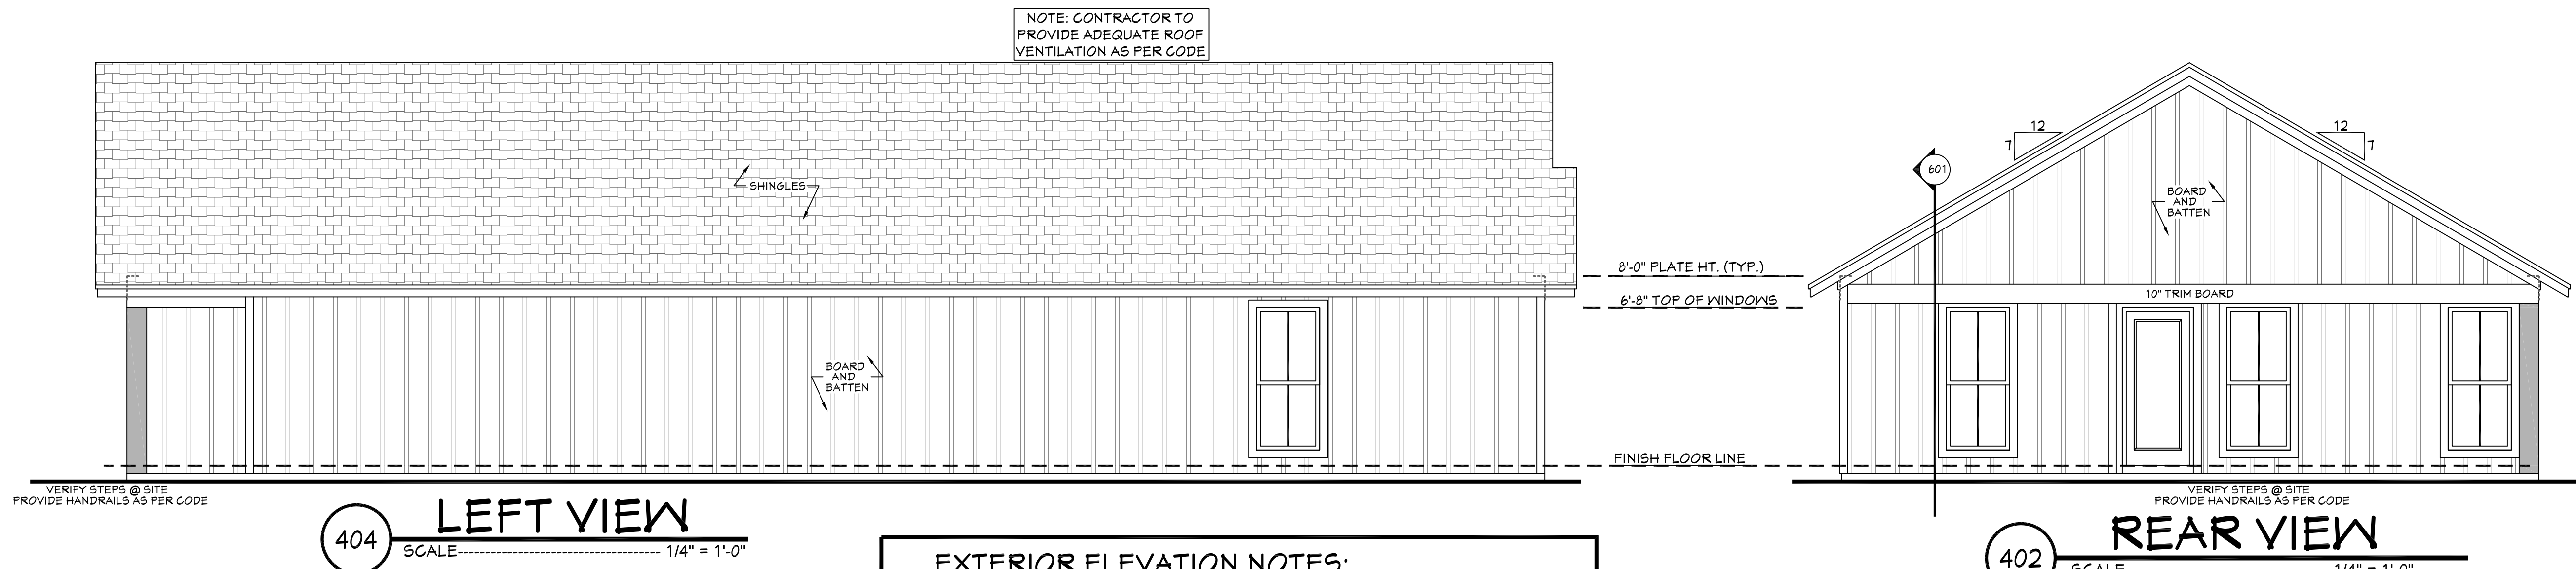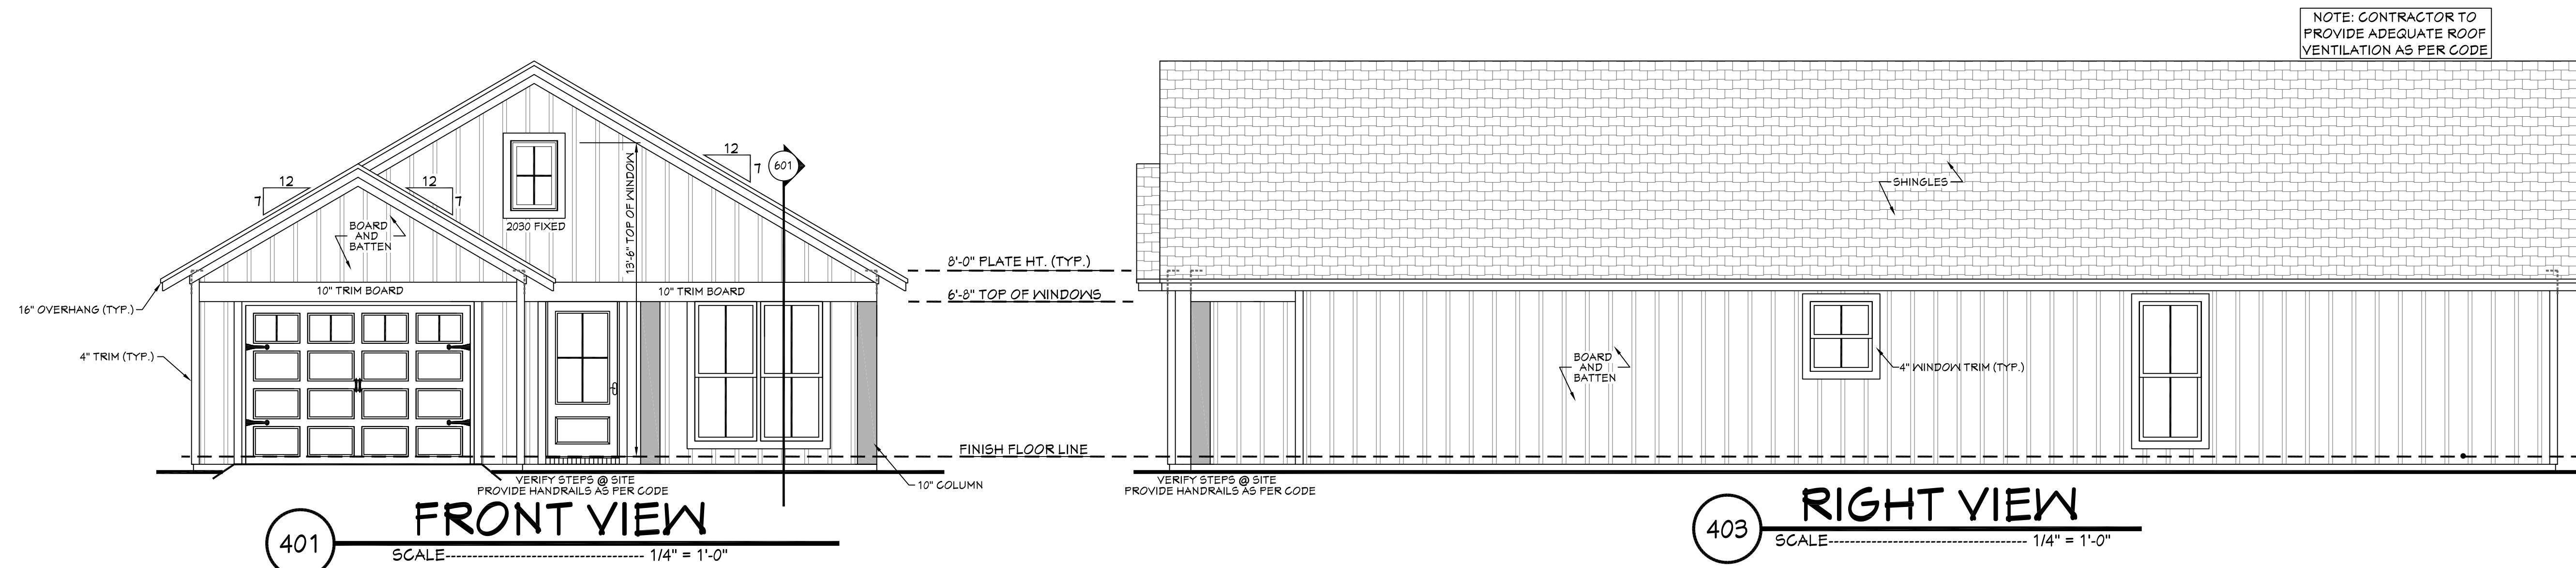


EXTERIOR ELEVATION NOTES:

1. CONTRACTOR TO VERIFY ALL WINDOW AND DOOR STYLES AND SIZES WITH OWNER PRIOR TO CONSTRUCTION.
2. PROVIDE STEPS AND GUARD RAILS AS PER CODE BASED ON SITE CONDITIONS.
3. GROUND LINES SHOWN FOR REFERENCE ONLY AND VARY DEPENDING ON SITE CONDITIONS.
4. ALL FINISH MATERIALS TO BE VERIFIED WITH OWNER PRIOR TO CONSTRUCTION.
5. REFER TO TYPICAL WALL DETAIL FOR FRAMING METHODS AND OTHER MISC. INFORMATION.
6. CONTRACTOR TO PROVIDE ADEQUATE ROOF VENTILATION AS REQ'D BY CURRENT CODES.


3068 (DOOR LABEL ON FLOOR PLAN) IS A DOOR THAT IS 3 FT 0 INCHES WIDE BY 6 FEET 9 INCHES TALL. TO FURTHER CLARIFY, THE 3068 LABEL IS TO BE READ AS FEET AND INCHES (WIDTH) AND FEET AND INCHES (HEIGHT).

DOOR SIZE

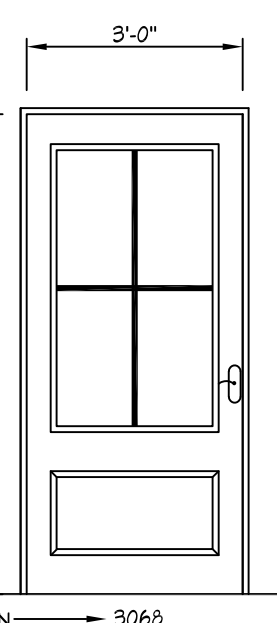


3050 (WINDOW LABEL ON FLOOR PLAN) IS A WINDOW THAT IS 3 FT 0 INCHES WIDE BY 5 FEET 9 INCHES TALL. TO FURTHER CLARIFY, THE 3050 LABEL IS TO BE READ AS FEET AND INCHES (WIDTH) AND FEET AND INCHES (HEIGHT).

WINDOW SIZE

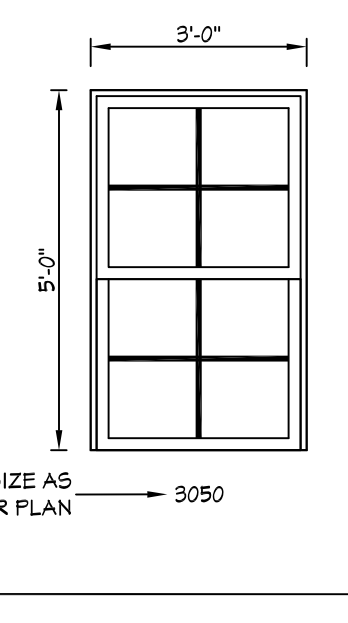

EGRESS

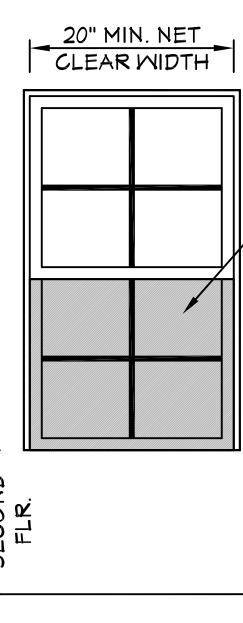

OPENING SIZES/ EGRESS

SCALE: NTS

R311.1 Means of egress. Duellings shall be provided with a means of egress in accordance with this section. The means of egress shall provide a continuous and unobstructed path of vertical and horizontal egress travel from all portions of the dwelling to the required egress door without requiring travel through a garage. The required egress door shall open directly into a public way or to a yard or court that opens to a public way.

R310.2.1 Minimum opening area. Emergency and escape rescue openings shall have a net clear opening of not less than 5.7 square feet (0.530 m²). The net clear opening dimensions required by this section shall be obtained by the normal operation of the emergency escape and rescue opening from the inside. The net clear height opening shall be not less than 24 inches (610 mm) and the net clear width shall be not less than 20 inches (508 mm). Exception: Grade floor or below grade openings shall have a net clear opening of not less than 5 square feet (0.465 m²).

R310.2.2 Window sill height. Where a window is provided as the emergency escape and rescue opening, it shall have a sill height of not more than 44 inches (1118 mm) above the floor; where the sill height is below grade, it shall be provided with a window well in accordance with Section R310.2.3.

R310.2.3 Window wells. The horizontal area of the window well shall be not less than 4 square feet (0.4 m²), with a horizontal projection and width of not less than 36 inches (914 mm). The area of the window well shall allow the emergency escape and rescue opening to be fully opened. Exception: The ladder or steps required by Section R310.2.3.1 shall be permitted to encroach not more than 6 inches (152 mm) into the required dimensions of the window well.



R310.2.3.1 Ladder and steps. Window wells with a vertical depth greater than 44 inches (1118 mm) shall be equipped with a permanently affixed ladder or steps usable with the window in the fully open position. Ladders or steps required by this section shall not be required to comply with Sections R311.7 and R311.8. Ladders or rungs shall have an inside width of not less than 12 inches (305 mm), shall project not less than 3 inches (76 mm) from the wall and shall be spaced not more than 18 inches (457 mm) on center vertically for the full height of the window well.

R312.2 Window fall protection. Window fall protection shall be provided in accordance with Sections R312.2.1 and R312.2.2.


R312.2.1 Window sills. In dwelling units, where the top of the sill of an operable window opening is located less than 24 inches (610 mm) above the finished floor and greater than 72 inches (1828 mm) above the finished grade or other surface below on the exterior of the building, the operable window shall comply with one of the following:

1. Operable windows with openings that will not allow a 4-inch-diameter (102 mm) sphere to pass through the opening where the opening is in its largest opened position.
2. Operable windows that are provided with window fall prevention devices that comply with ASTM F 2090.
3. Operable windows that are provided with window opening control devices that comply with Section R312.2.2.

R312.2.2 Window opening control devices. Window opening control devices shall comply with ASTM F 2090. The window opening control device, after operation to release the control device allowing the window to fully open, shall not reduce the net clear opening area of the window unit to less than the area required by Section R310.2.1.

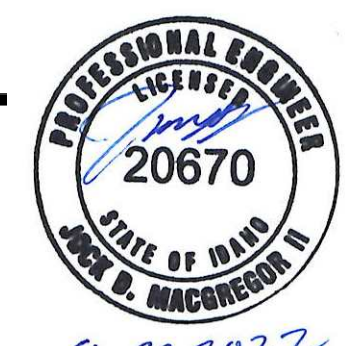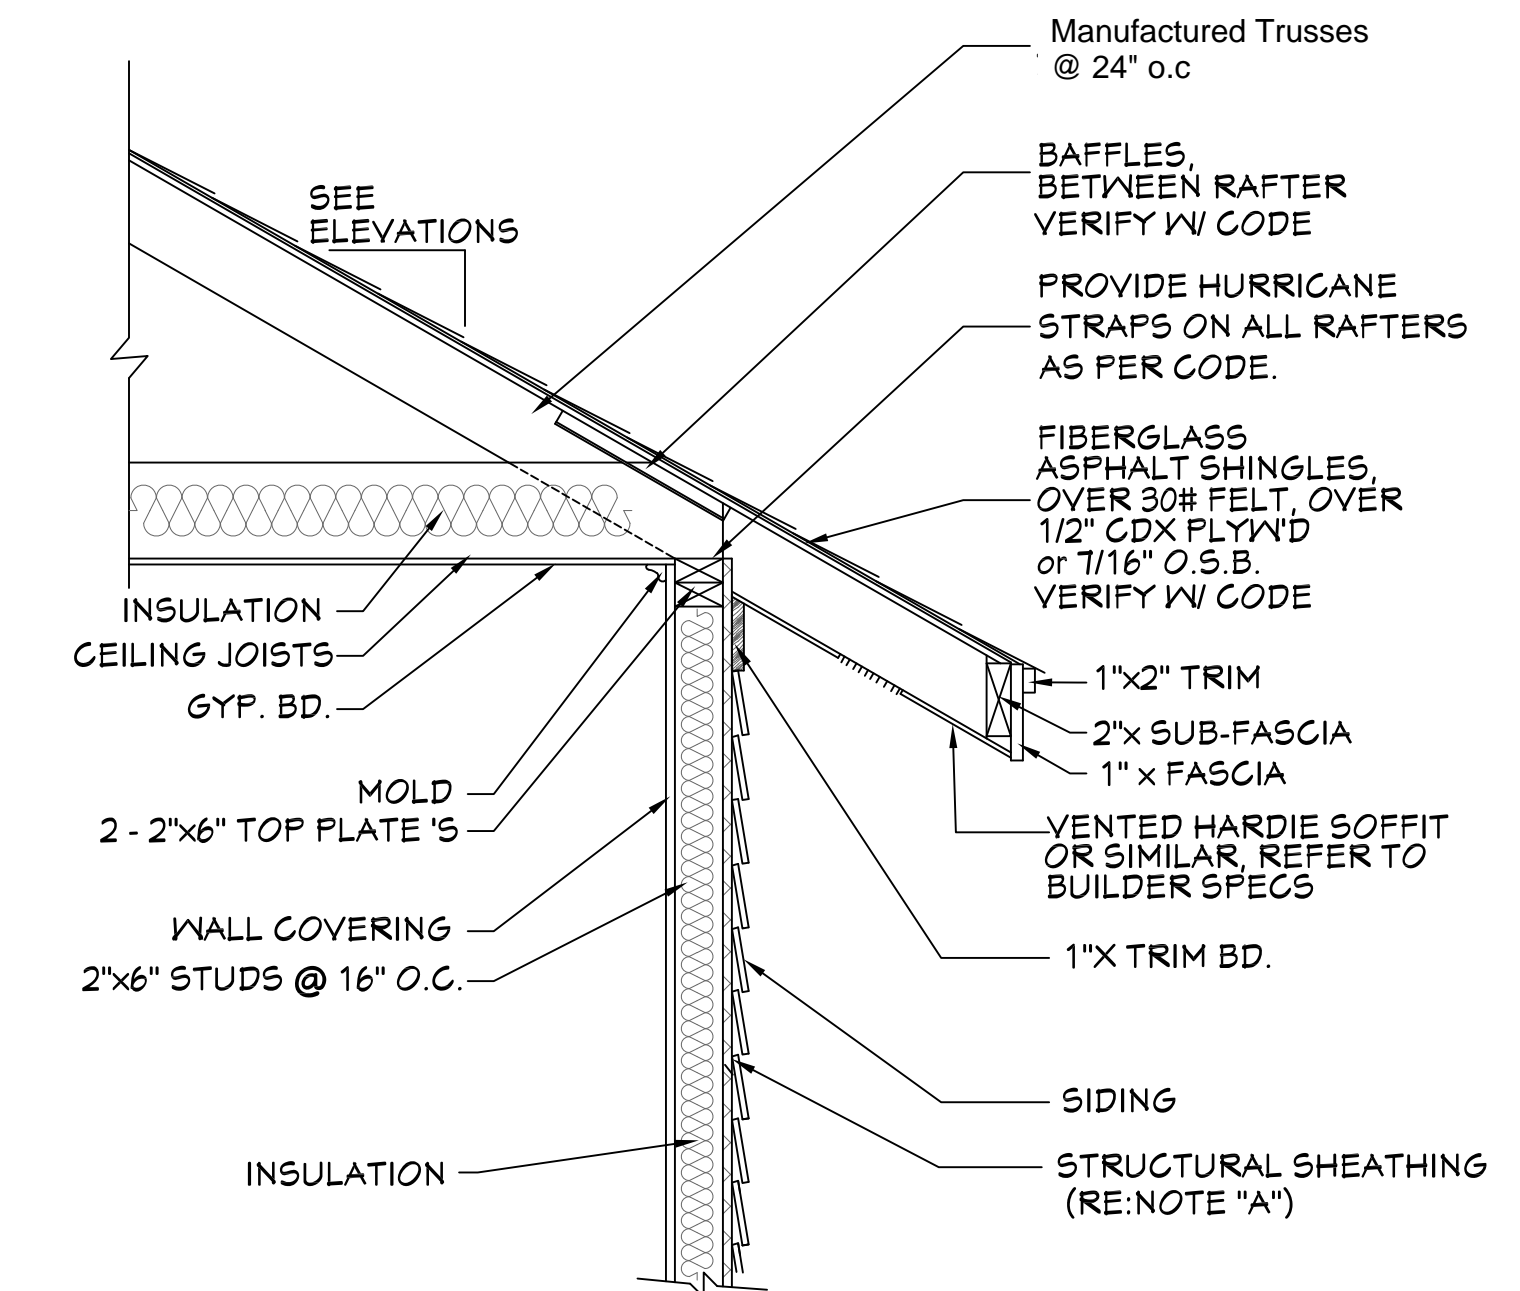


House Plan Zone, LLC, has exercised great care and effort in the development of these plans and the completion of these construction documents. However, the user assumes full responsibility for any damages, including structural failures resulting from errors, omissions or deficiencies in the design, construction or use of these plans. House Plan Zone, LLC, highly recommends that these plans be reviewed by a licensed structural engineer in the area of construction. Other special conditions required by local building codes. All dimensions to be verified on site prior to construction. If a foundation plan has been included in these plans, it is general in nature and shall be verified by a licensed engineer prior to construction.

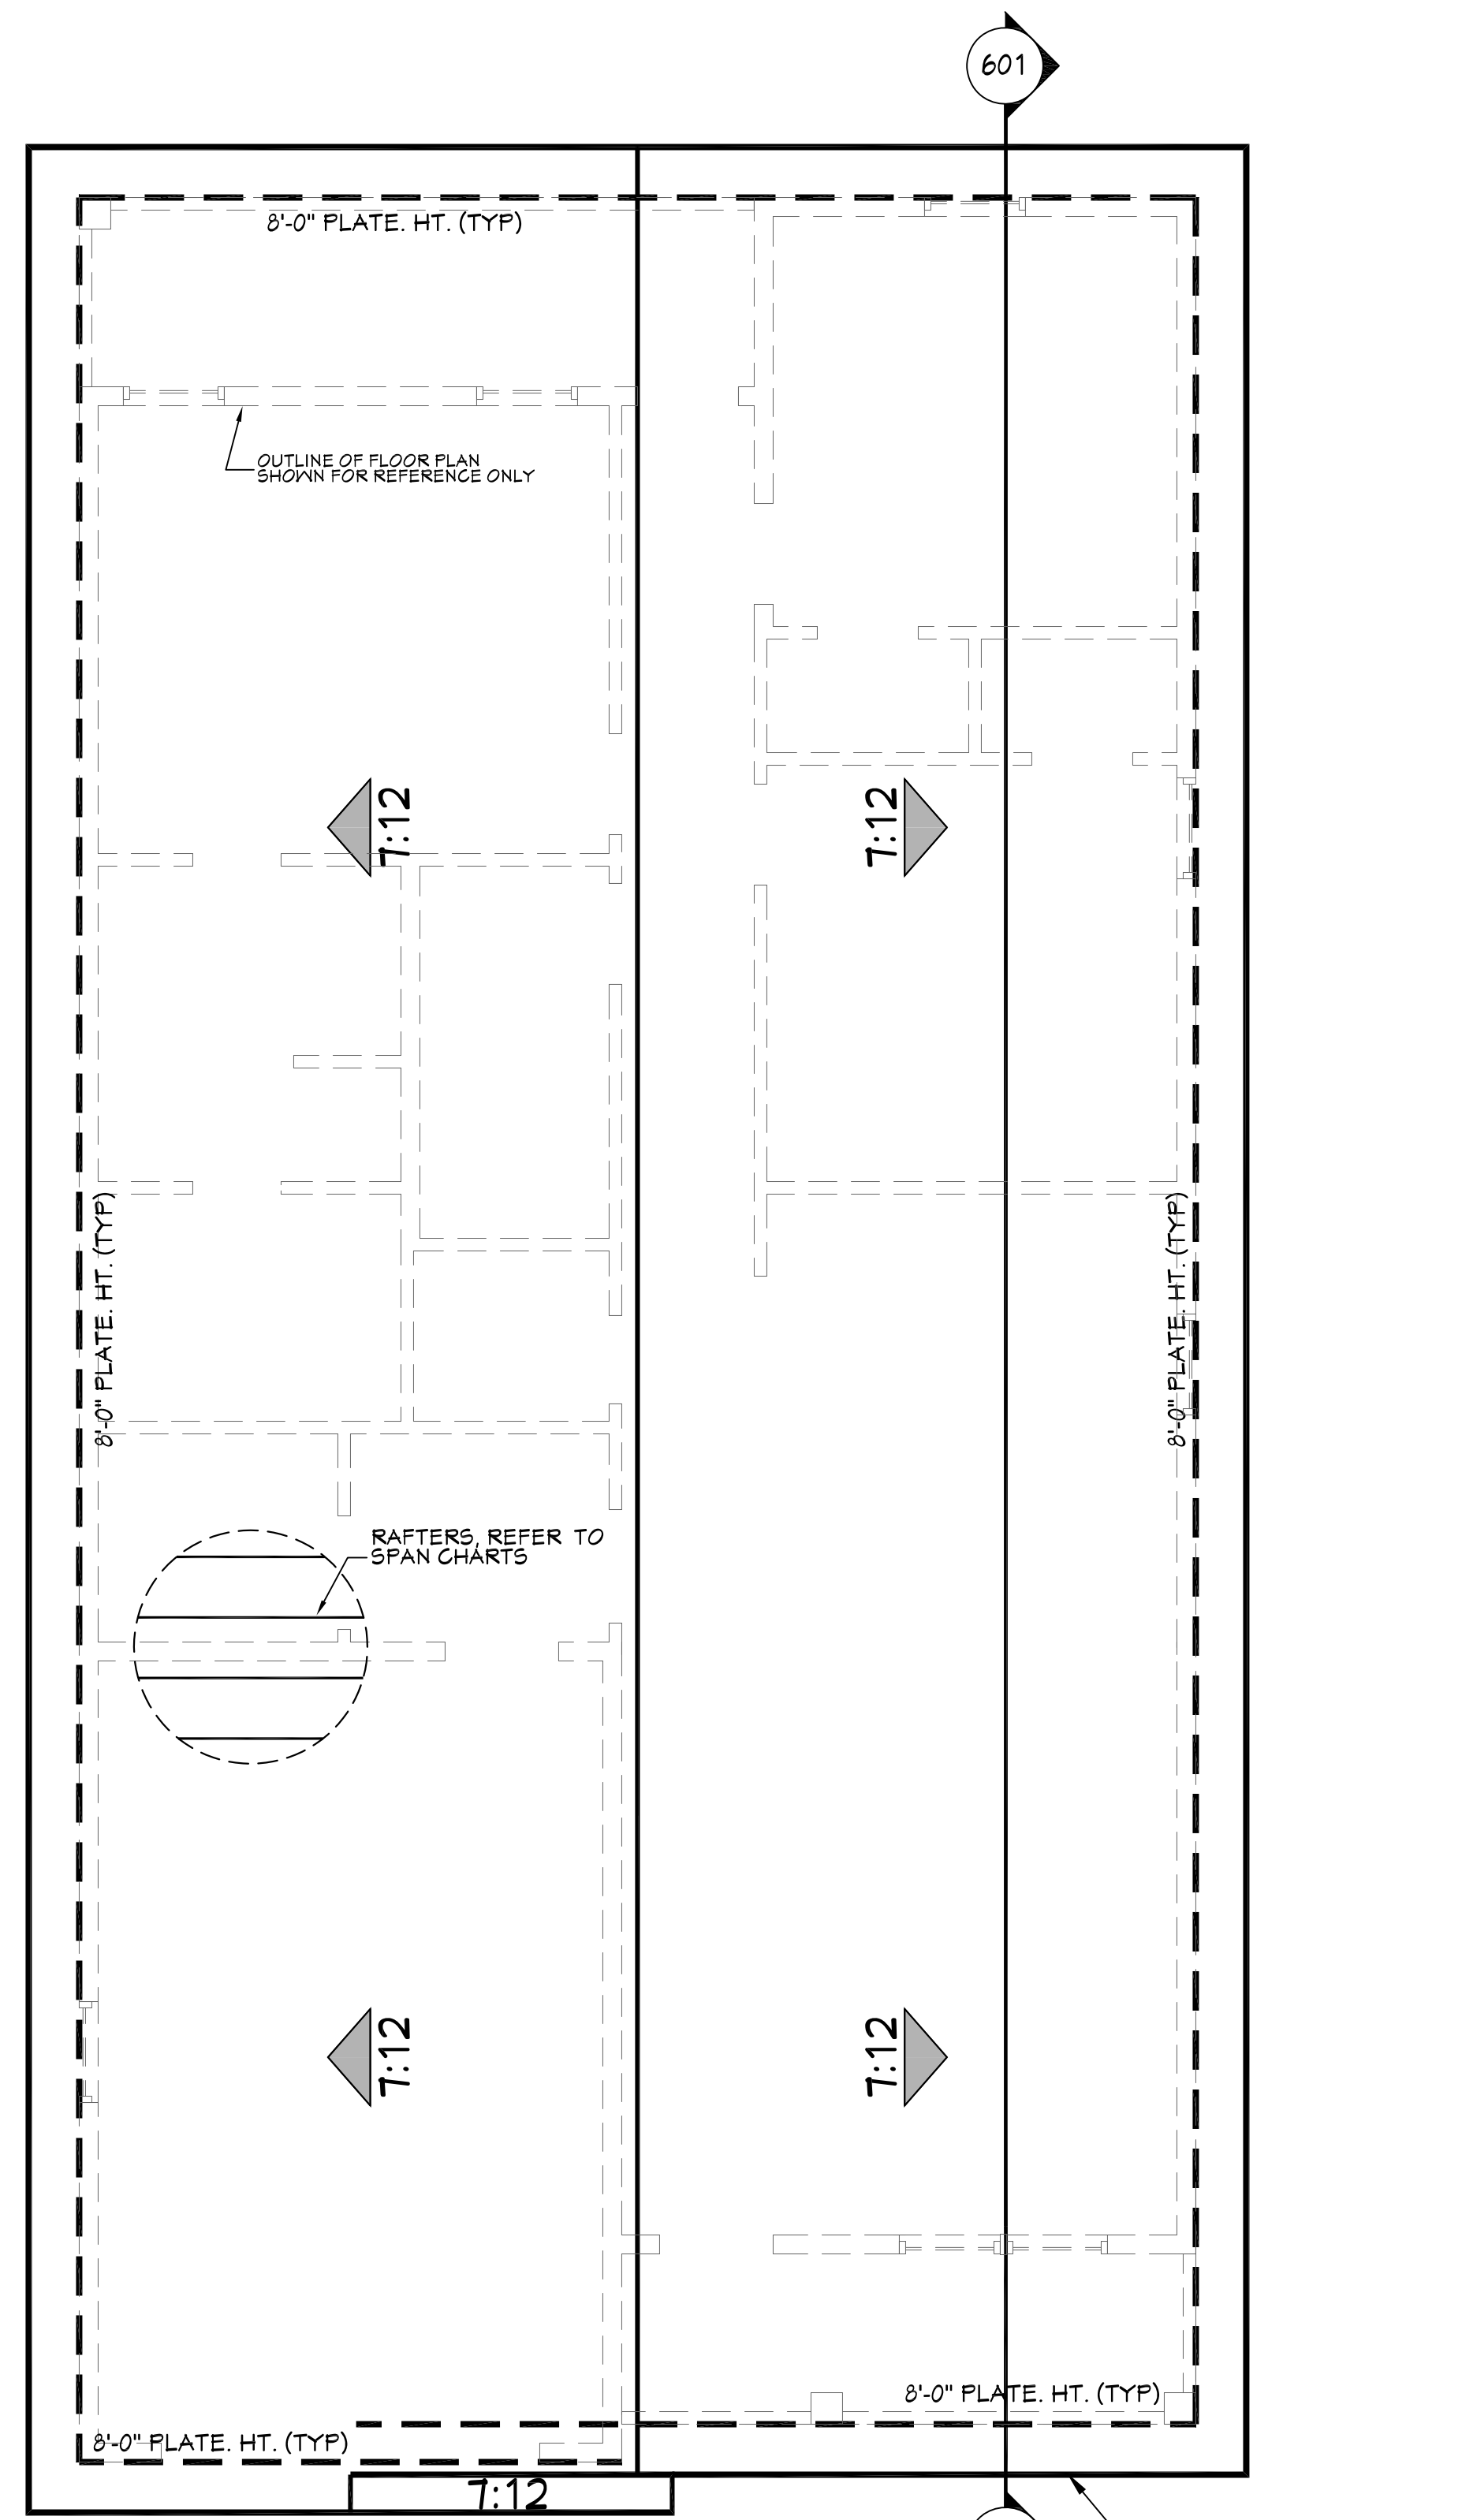


501 **ROOF PLAN**
SCALE: 1/4" = 1'-0"

ROOF PLAN NOTES:


1. CONTRACTOR SHALL COMPLY WITH ALL APPLICABLE CODES AT SITE.
2. ALL RIDGE BEAMS, HIP RAFTERS, & VALLEY RAFTERS TO BE 2" X 10", No.2 S.Y.P. OR AS REQ'D BY ENGINEER.
3. ALL RAFTERS TO BE SIZED AS PER SPAN CHART.
4. CONTRACTOR TO WATERPROOF ALL ROOF INTERSECTIONS AS PER CODE.
5. CONTRACTOR TO VERIFY ALL ROOF PITCHES WITH EXTERIOR ELEVATIONS PRIOR TO CONSTRUCTION.
6. CONTRACTOR TO PROVIDE ADEQUATE ROOF VENTILATION AS REQ'D BY CURRENT CODES.
7. ALL ROOF PENETRATIONS TO BE ON SIDES OR REAR OF RESIDENCE. ALL PVC VENTS SHALL BE PAINTED BLACK OR TO MATCH ROOFING.

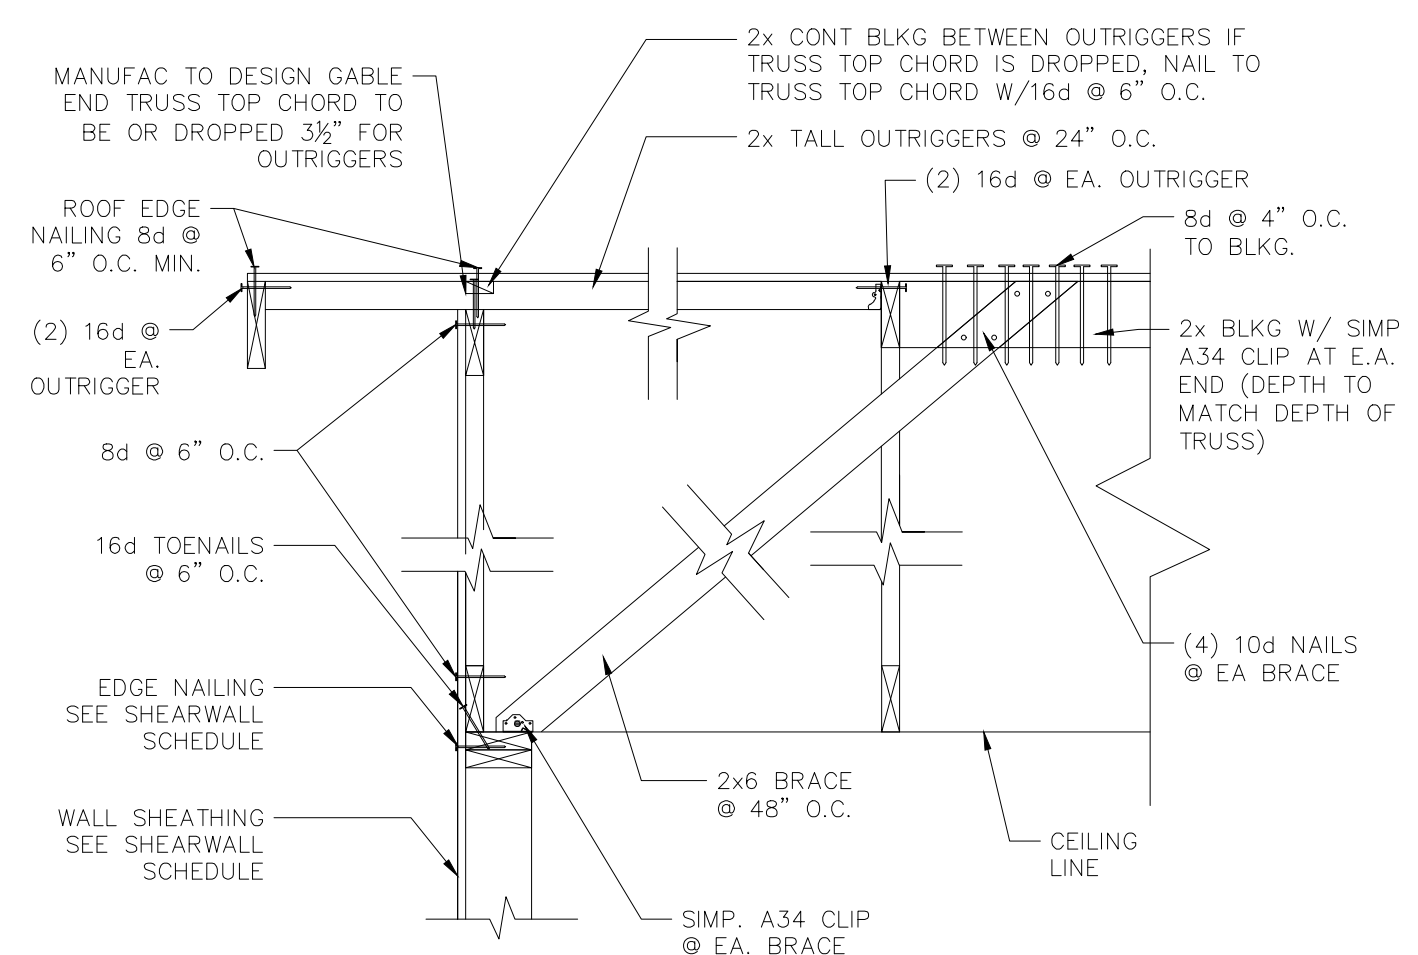


PARALLEL TRUSS TO WALL
TYP. LATERAL LOAD PATH @ N.T.S.

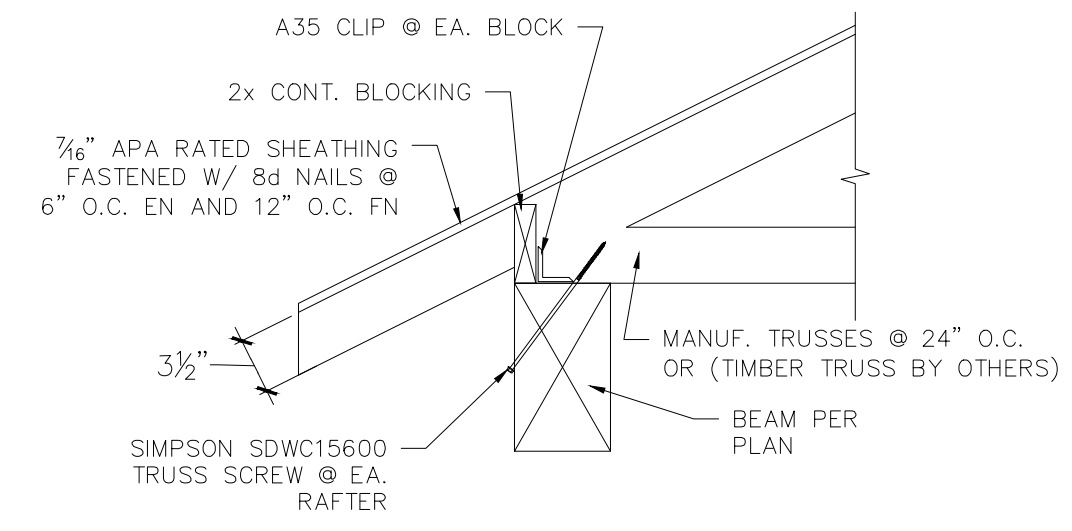

ROOF RAFT. TO BEAM
S-7 SHEARWALL N.T.S.

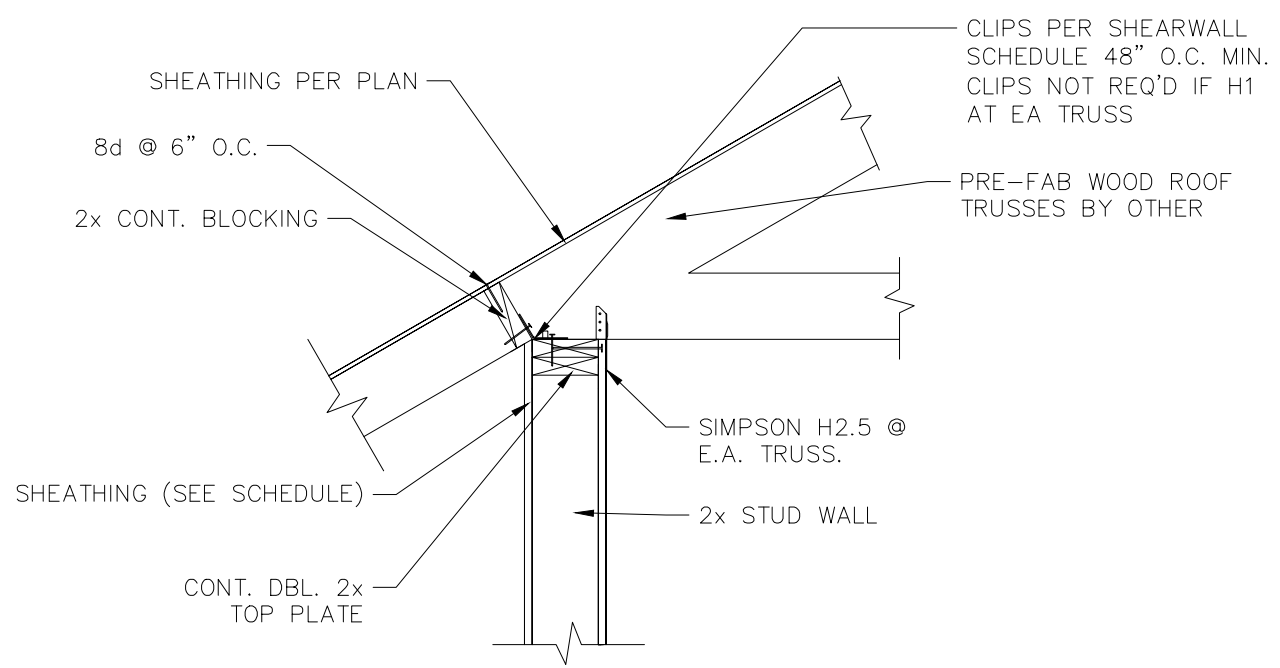

ROOF BLKG. @ TRUSSES
TYP. SHEARWALL N.T.S.

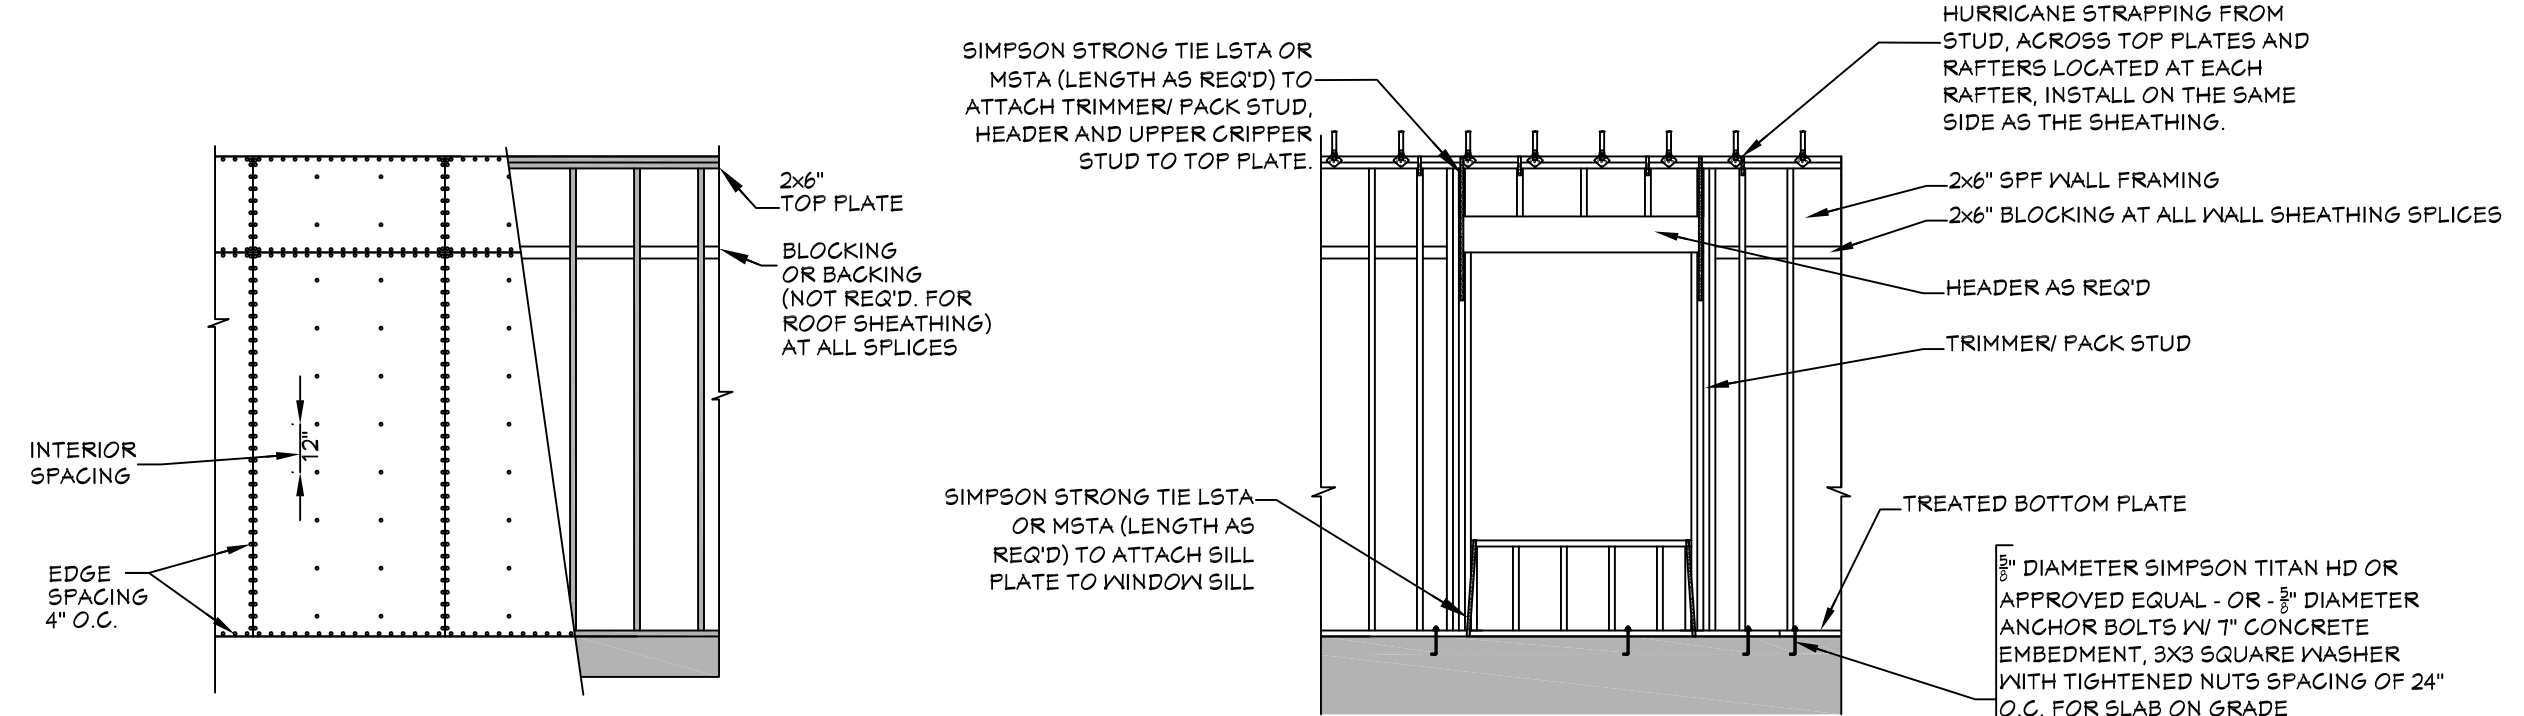


503 **WALL/ROOF FASTENING DETAILS**
SCALE: 1/4" = 1'-0"

NAIL SIZE SPACING FOR ROOF SHEATHING
8d NAILS
MIN. OF 7/16" O.S.B.
EDGE SPACING = 4" O.C.
INTERIOR SPACING = 4" O.C.

- NOTES:
1. ALL EXTERIOR SHEATHING TO EXTEND FROM BOTTOM OF BOTTOM PLATE TO THE TOP OF THE TOP PLATES.
 2. PROVIDE 2X4 OR GREATER COLLAR TIES ON EACH RAFTER IN THE UPPER THIRD OF ATTIC AND ATTACHED TO RAFTERS WITH 5 - 10d NAILS ON EACH SIDE.
 3. SHINGLES OR OTHER ROOF MATERIALS TO BE FASTENED AS PER MANUFACTURERS INSTRUCTIONS FOR HIGH WIND APPLICATIONS.
 4. EXTERIOR WALL FINISHES TO BE INSTALLED AS PER MANUFACTURERS INSTRUCTIONS BASED ON HIGH WIND APPLICATIONS.



Website:
www.HFZplans.com
Email:
sales@hfpzplans.com
Phone:
601.336.3254
Fax:
1.800.574.1387

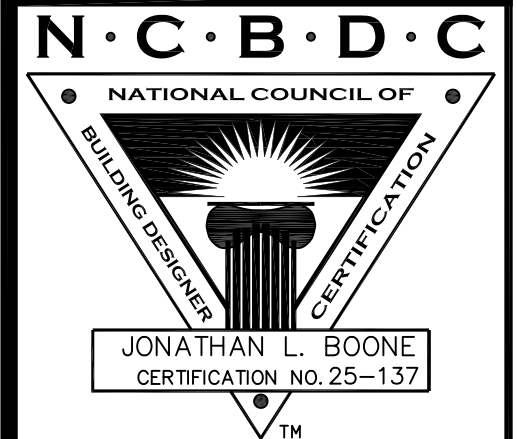

Pre-Drawn Plan ID:
BB-1292


Date:
10/07/19
Drawn By:
R.B.W.

SHEET NUMBER
5



House Plan Zone, LLC has exercised great care and effort in the development of these plans and the completion of these construction documents. However, the user assumes full responsibility for any damages, including structural failures resulting from errors, omissions or deficiencies in the design. House Plan Zone, LLC highly recommends that these plans be reviewed by a licensed structural engineer in the area of construction. Other special conditions required by local building codes. All dimensions to be verified on site prior to construction. If a foundation plan has been included in these plans, it is general in nature and shall be verified by a licensed engineer prior to construction.


Website:
 Email:
 sales@hpzplans.com
 Phone:
 601.336.3254
 Fax:
 1.800.574.1387

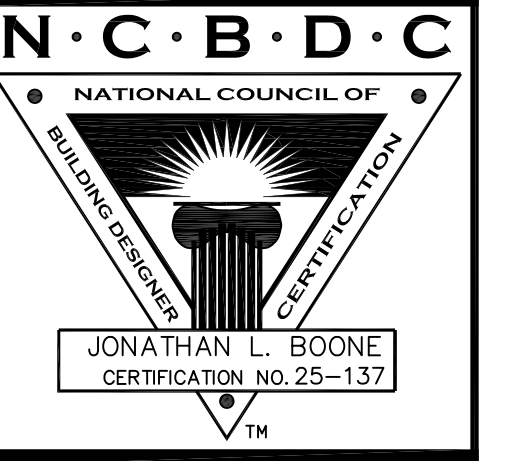

- CROSS SECTION NOTES:**
1. CONTRACTOR SHALL COMPLY WITH ALL APPLICABLE CODES AT SITE.
 2. ALL RIDGE BEAMS, HIP RAFTERS, & VALLEY RAFTERS TO BE 2" x 10", OR AS REQ'D BY ENGINEER.
 3. CONTRACTOR TO PROVIDE RAFTER BRACING TO MEET APPLICABLE CODES.
 4. CONTRACTOR TO THOROUGHLY WATERPROOF ALL EXTERIOR INTERSECTIONS AS PER CODE AND TYPICAL BUILDING PRACTICES.
 5. ALL BEAMS TO BE SIZED BY A LICENSED STRUCTURAL ENGINEER.
 6. ALL LUMBER SIZES AND SPACING TO BE VERIFIED BY CONTRACTOR PRIOR TO CONSTRUCTION.
 7. CONTRACTOR TO PROVIDE ADEQUATE ROOF VENTILATION AS REQ'D. BY CURRENT CODES.





601 CROSS SECTION
 SCALE-----3/8"=1'-0"

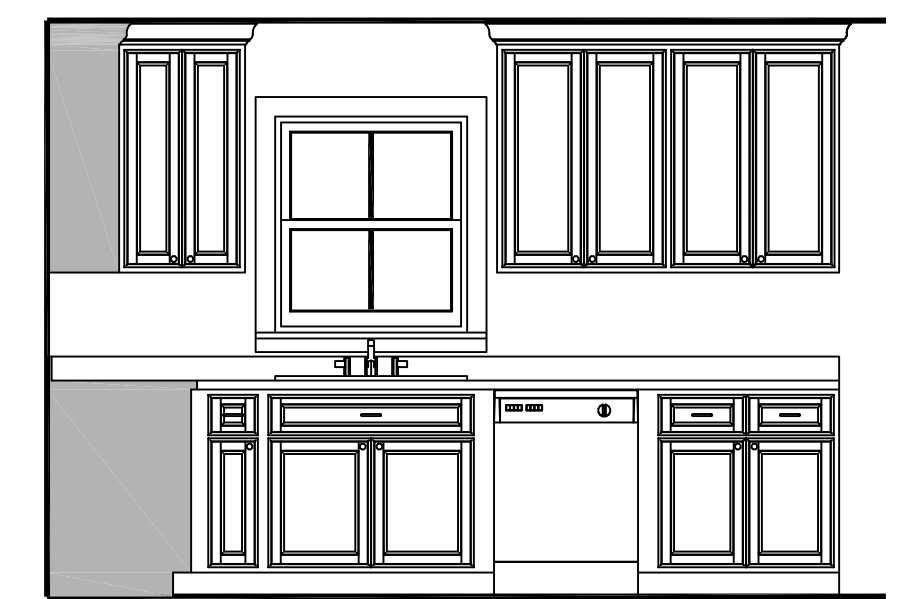


602 KITCHEN
 SCALE-----3/8"=1'-0"



603 KITCHEN
 SCALE-----3/8"=1'-0"

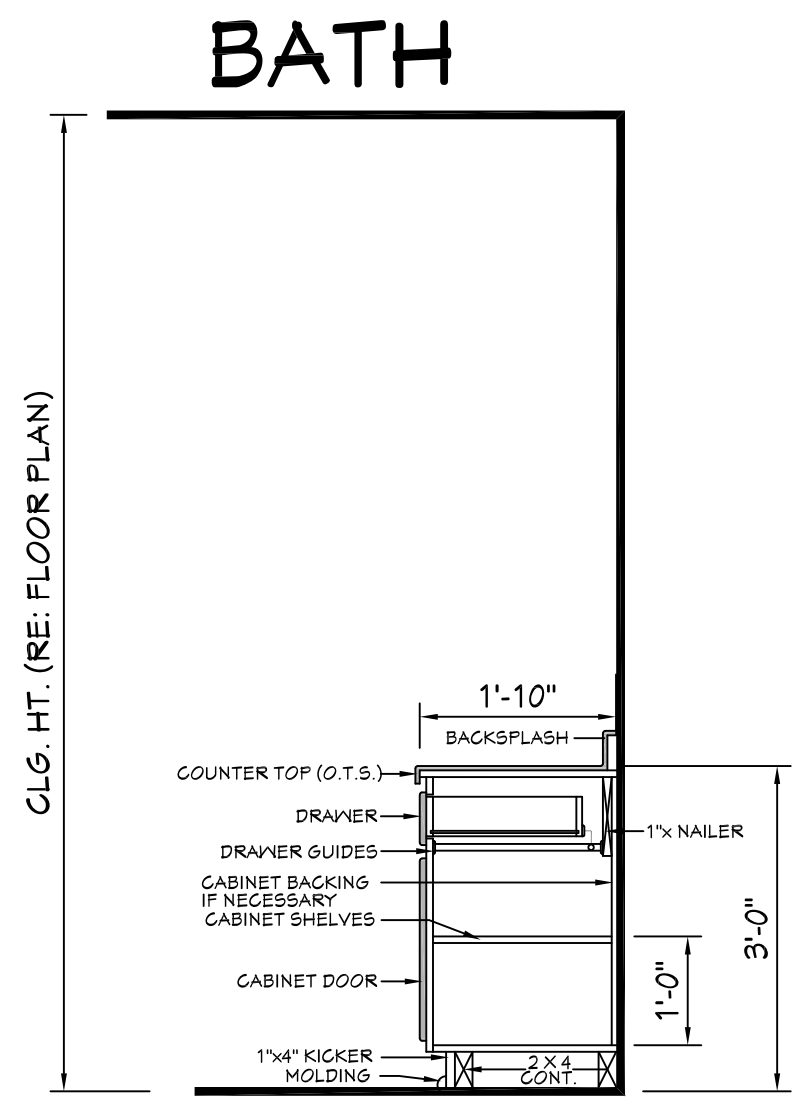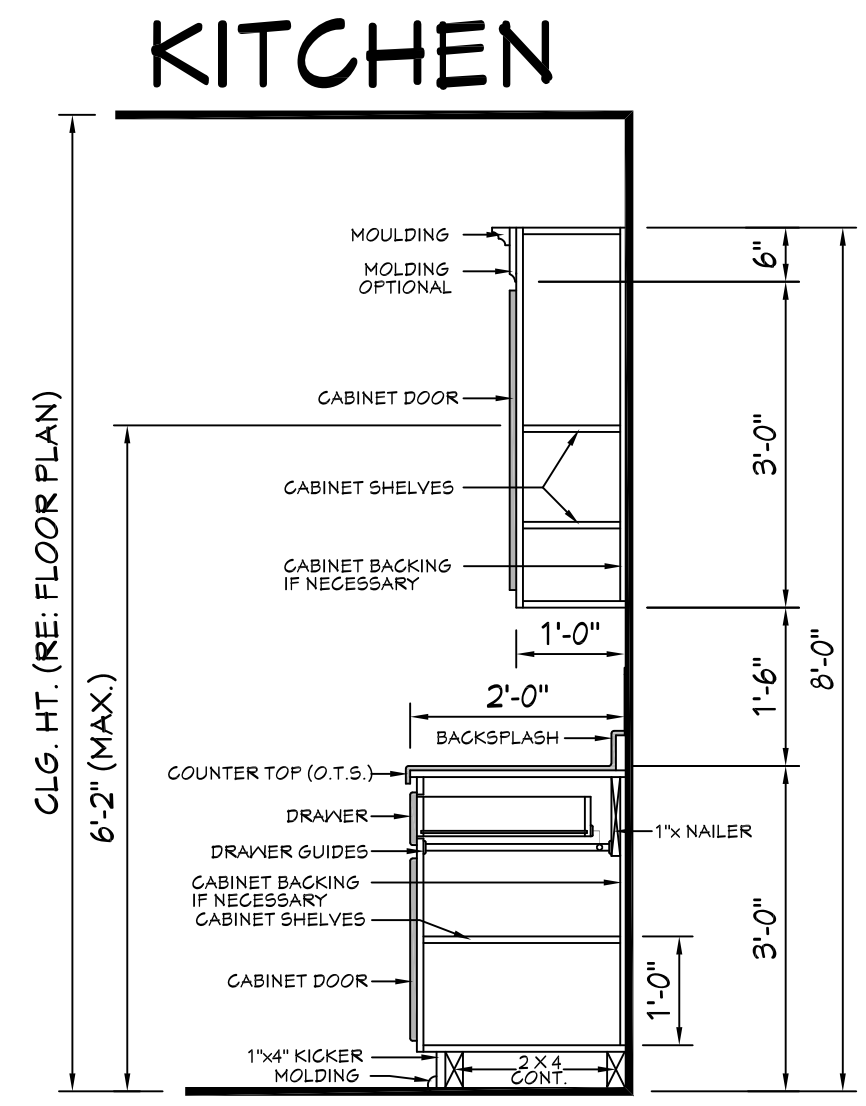

605 TYP. CAB. SECTIONS
 SCALE-----N.T.S.

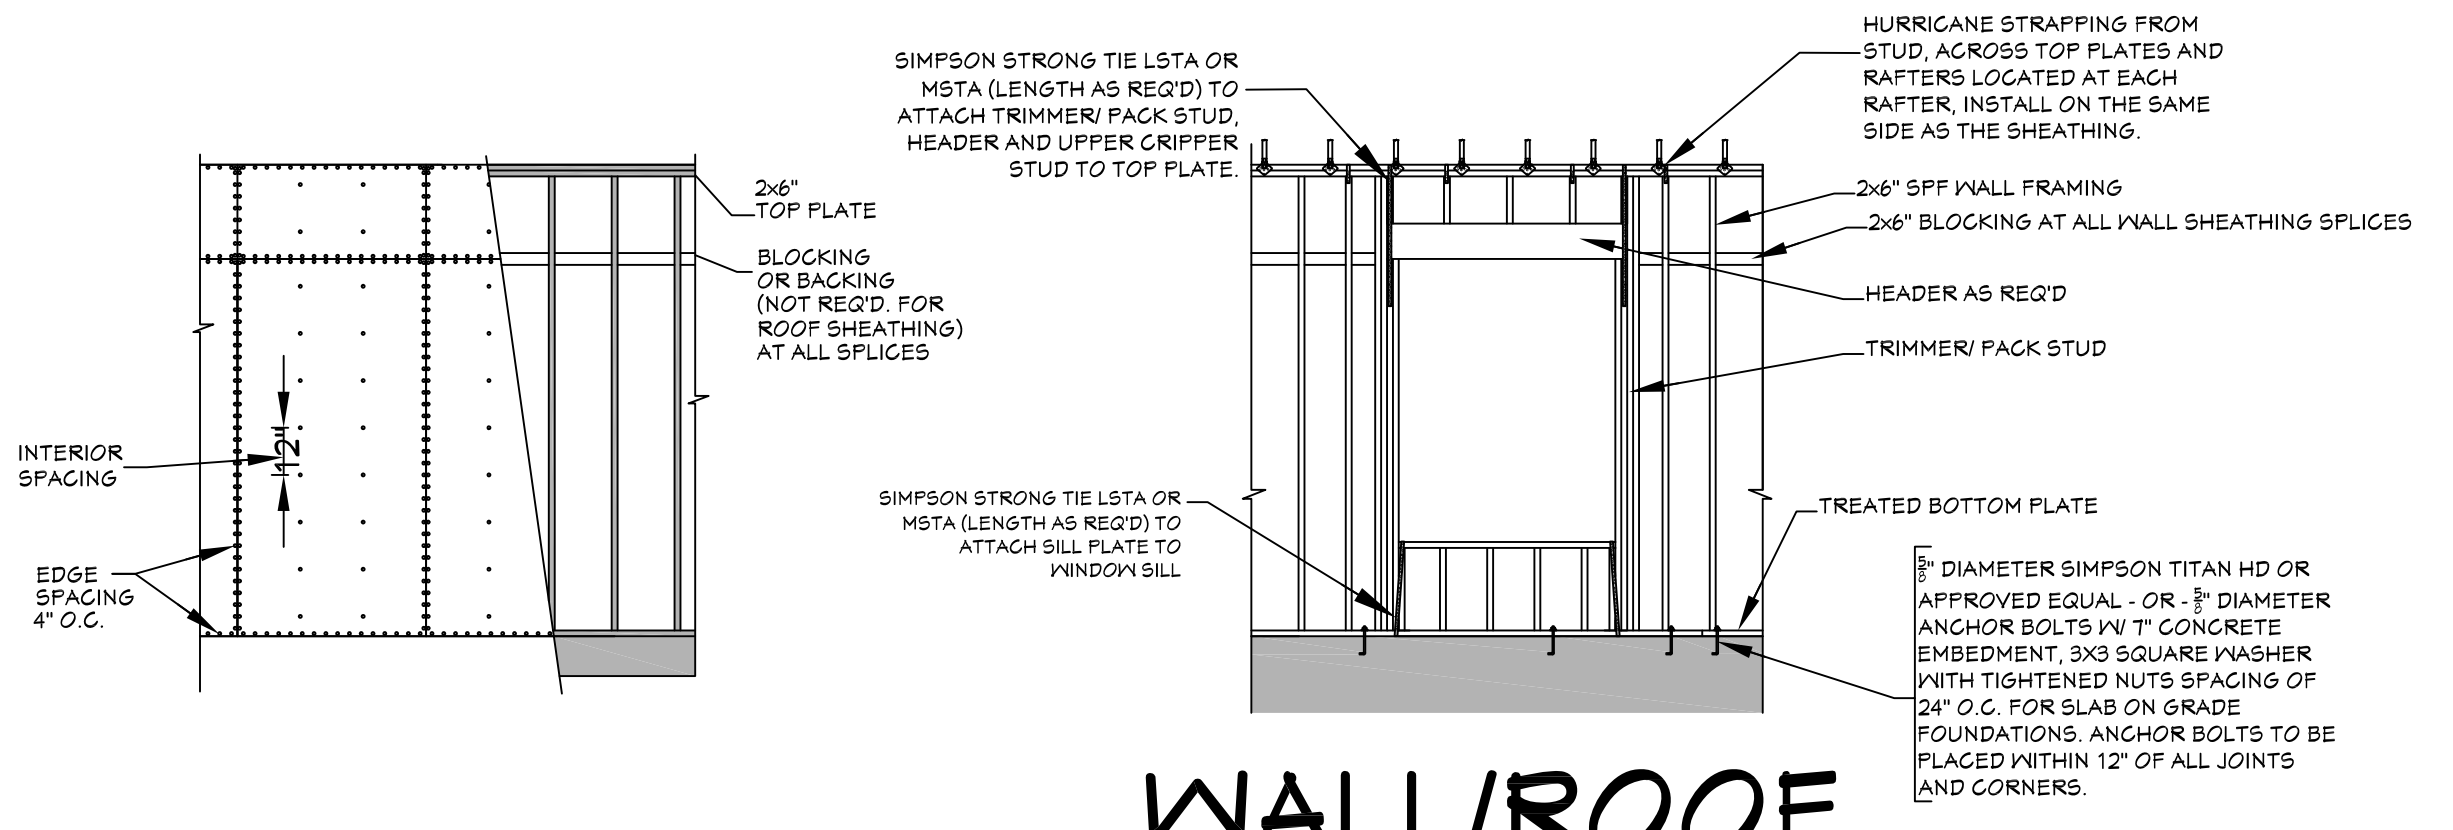

604 WALL/ROOF FASTENING DETAILS
 SCALE-----1/4"=1'-0"

NAIL SIZE SPACING FOR WALL SHEATHING

8d NAILS
 MIN. OF 7/16" O.S.B.
 EDGE SPACING = 4" O.C.
 INTERIOR SPACING = 12" O.C.

NAIL SIZE SPACING FOR ROOF SHEATHING

8d NAILS
 MIN. OF 7/16" O.S.B.
 EDGE SPACING = 4" O.C.
 INTERIOR SPACING = 4" O.C.

- NOTES:**
1. ALL EXTERIOR SHEATHING TO EXTEND FROM BOTTOM OF BOTTOM PLATE TO THE TOP OF THE TOP PLATES.
 2. PROVIDE 2X4 OR GREATER COLLAR TIES ON EACH RAFTER IN THE UPPER THIRD OF ATTIC AND ATTACHED TO RAFTERS WITH 5-10d NAILS ON EACH SIDE.
 3. SHINGLES OR OTHER ROOF MATERIALS TO BE FASTENED AS PER MANUFACTURER'S INSTRUCTIONS FOR HIGH WIND APPLICATIONS.
 4. EXTERIOR WALL FINISHES TO BE INSTALLED AS PER MANUFACTURER'S INSTRUCTIONS BASED ON HIGH WIND APPLICATIONS.

Pre-Drawn Plan ID:
BB-1292

Date:
 10/07/19
 Drawn By:
 R.B.W.


SHEET NUMBER
6

House Plan Zone, LLC, has exercised great care and effort in the development of these plans and the completion of these construction documents. However, the contractor is responsible for any damages, including structural failures resulting from errors, omissions or deficiencies in the design. House Plan Zone, LLC highly recommends that these plans be reviewed by a licensed structural engineer in the area of construction. Other special conditions required by local building codes. All dimensions to be verified on site prior to construction. If a foundation plan has been included in these plans, it is general in nature and shall be verified by a licensed engineer prior to construction.

HOLDOWN SCHEDULE^{1,2,3,4}

HOLDOWN TYPE	HOLDOWN	ANCHOR BOLT	ANCHOR DIAMETER	EMBED LENGTH	MIN. STEM-WALL WIDTH	WOOD MEMBER	CONNECTION TO WOOD MEMBER	REMARKS	ALLOWABLE LOAD
1	No Holdown								
2	HDU2	S5TB24	5/8"	20 5/8"	6"	(2) 2x6 ⁶	(6) 1/4"x2-1/2" ⁷		3,075#
3	HDU4	5B5/8x24	5/8"	18"	6"	(2) 2x6 ⁶	(10) 1/4"x2-1/2" ⁷		4,565#
4	HDU5	5B5/8x24	5/8"	18"	6"	4x6	(14) 1/4"x2-1/2" ⁷		5,645#
5	HDU8	5B7/8x24	7/8"	18"	8"	6x6	(20) 1/4"x2-1/2" ⁷		7,870#
6	HDQ8	PAB7-30	7/8"	26 3/4"	8"	6x6	(20) 1/4" x 3" ⁷		9,230#
7	HD12	PAB8-30	1"	26 3/4"	8"	6x6	(4) 1" DIA. M.B.		14,220#
8	HDU14	PAB8-30	1"	26 3/4"	8"	(1) 6x6	(36) 1/4"x2-1/2" ⁷		14,445#
9	M5TC28	N/A	N/A	N/A	N/A	(2) 2x6 ⁶	(16) - 16d Sinker		1,540#
10	M5TC40	N/A	N/A	N/A	N/A	(2) 2x6 ⁶	(32) - 16d Sinker		3,080#
11	M5TC52	N/A	N/A	N/A	N/A	(2) 2x6 ⁶	(48) - 16d Sinker		4,620#
12	M5TC66	N/A	N/A	N/A	N/A	(2) 2x6 ⁶	(64) - 16d Sinker		5,860#



Notes:
 1. Holdowns by Simpson strong-Tie Company, Inc. See Simpson catalog for proper installation.
 2. Mount all holdown anchors prior to concrete pour.
 3. Edge nail sheathing to all posts or boundary members at holdowns.
 4. Locate Holdown within 6" of end of Shear Panel.
 5. All wood members must be 'Douglas fir'.
 6. Laminate studs with 16d Nails at 12" on center staggered. Clinch tips of nails.
 7. Use Simpson SDS 1/4" dia. wood screws.
 8. 2 Holdowns required (see 'Holdowns between floors' detail this sheet).
 9. Use threaded rod + CNW coupler to attach to anchor bolt at foundation. Run threaded rod up to Holdown at lower floor and connect.

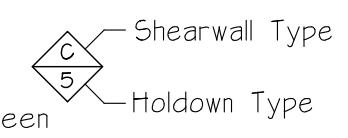


SHEAR WALL SCHEDULE

WALL TYPE	STRUCTURAL PANEL SHEATHING	PANEL EDGE NAILING	FIELD NAILING	A 35 CLIP DOUBLE TOP PLATE CONN. ⁵	SILL PLATE CONNECTION (A.B.) ¹⁶		SHEAR VALUE (PLF) DOUGLAS FR		
					1/2" DIA. x 10' LONG	5/8" DIA. x 10' LONG	WIND	SEISMIC	
A	7/16" OSB or 15/32" Plywood	0.131" Dia. x 2.5" Nails at 6" o.c.	0.131" Dia. x 2.5" Nails at 12" o.c.	20' O.C.	3'-8" O.C. ¹⁰	4'-0" O.C. ¹⁰	16d Nails at 6" o.c.	365	260
B	7/16" OSB or 15/32" Plywood	0.131" Dia. x 2.5" Nails at 4" o.c.	0.131" Dia. x 2.5" Nails at 12" o.c.	15' O.C.	2'-9" O.C. ¹⁰	4'-0" O.C. ¹⁰	16d Nails at 4-1/2" o.c.	530	380
C	7/16" OSB or 15/32" Plywood	0.131" Dia. x 2.5" Nails at 3" o.c.	0.131" Dia. x 2.5" Nails at 12" o.c.	11' O.C.	N/A	2'-9" O.C. ¹⁰	16d Nails at 3-1/2" o.c.	685	490
D	15/32" Plywood ¹¹	0.148" Dia. x 3" Nails at 3" o.c.	0.148" Dia. x 3" Nails at 12" o.c.	9' O.C.	N/A	2'-4" O.C. ¹⁰	(2) Rows 16d Nails at 6" o.c.	840	600
E	15/32" Plywood ¹¹	0.148" Dia. x 3" Nails at 2" o.c.	0.148" Dia. x 3" Nails at 12" o.c.	7' O.C.	N/A	1'-9" O.C. ¹²	N/A	1,075	770
F	1/2" GWS MIN.	5d cooler nails at 4" o.c.	5d cooler nails at 12" o.c.	24" O.C.	4'-0" O.C.	4'-0" O.C.	16d Nails at 6" o.c.	125	125
G	1/2" GWS MIN.	#6x1-1/4" screws 4" o.c. (blocked)	#6x1-1/4" screws 12" o.c.	24" O.C.	4'-0" O.C.	4'-0" O.C.	16d Nails at 6" o.c.	160	160

Notes:
 1. Block all edges of sheathing.
 2. Do not break sheathing skin by over driving nails.
 3. Pre-drill as required to avoid splitting sills, etc.
 4. Nails should be located 3/8" clear of panel edges.
 5. Use Simpson A35 clips to attach blocking to top plate at floor line. At roof line use Simpson M-1 clips at each truss (U.O.N.).
 6. Values of other standard construction fasteners will require spacing adjustments and must be approved by the engineer-of-record.
 7. Use hot dipped galvanized nails at all exterior applications.
 8. C-D, C-G sheathing, plywood panels siding, and other grades covered in APA Plywood Design Specification.
 9. Sheathing face grain can be applied perpendicular or parallel to wall studs, provided studs are spaced a maximum of 16" o.c.
 10. 3"x3"x1/4" washer required on A,B, with 2x sill plates.
 11. Framing at adjoining panel edges shall be (3) 2x studs laminated (see detail this sheet).
 12. Min. 3" nominal sill plate w/ 3"x3"x1/4" washers.
 13. Sheath entire wall (above + below) windows and doors) according to shearwall schedule. Use of 3"x3"x1/4" washers are required on all anchor bolts for these walls.
 14. Install LTPS when required at 32" o.c. per detail.
 15. All wood members must be 'Douglas Fir'.
 16. All walls not designated as shearwalls to have 1/2"x10" anchor bolts at 4'-0" o.c. maximum.
 17. Interior shearwall to extend to roof sheathing via truss or blocking panels.

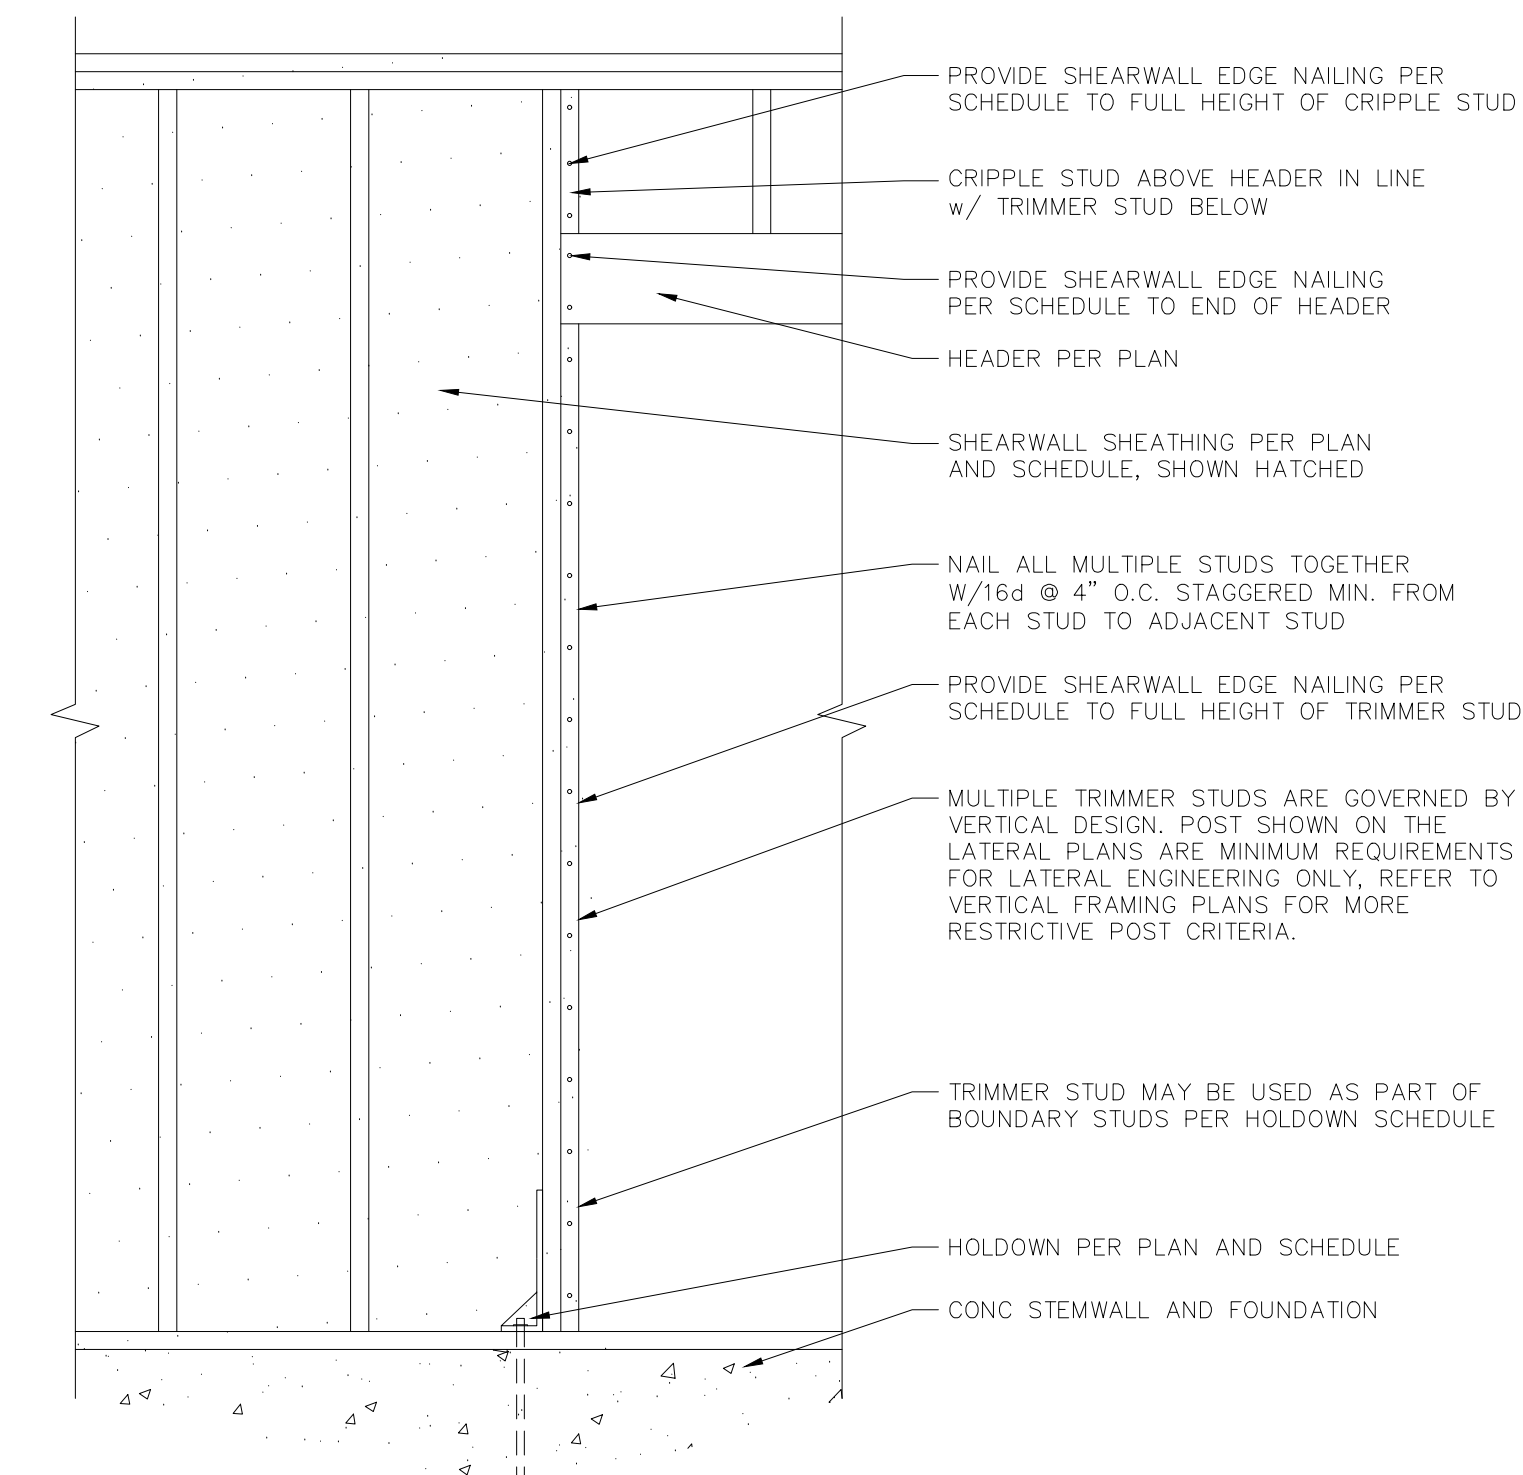


1 TYP. N.T.S.

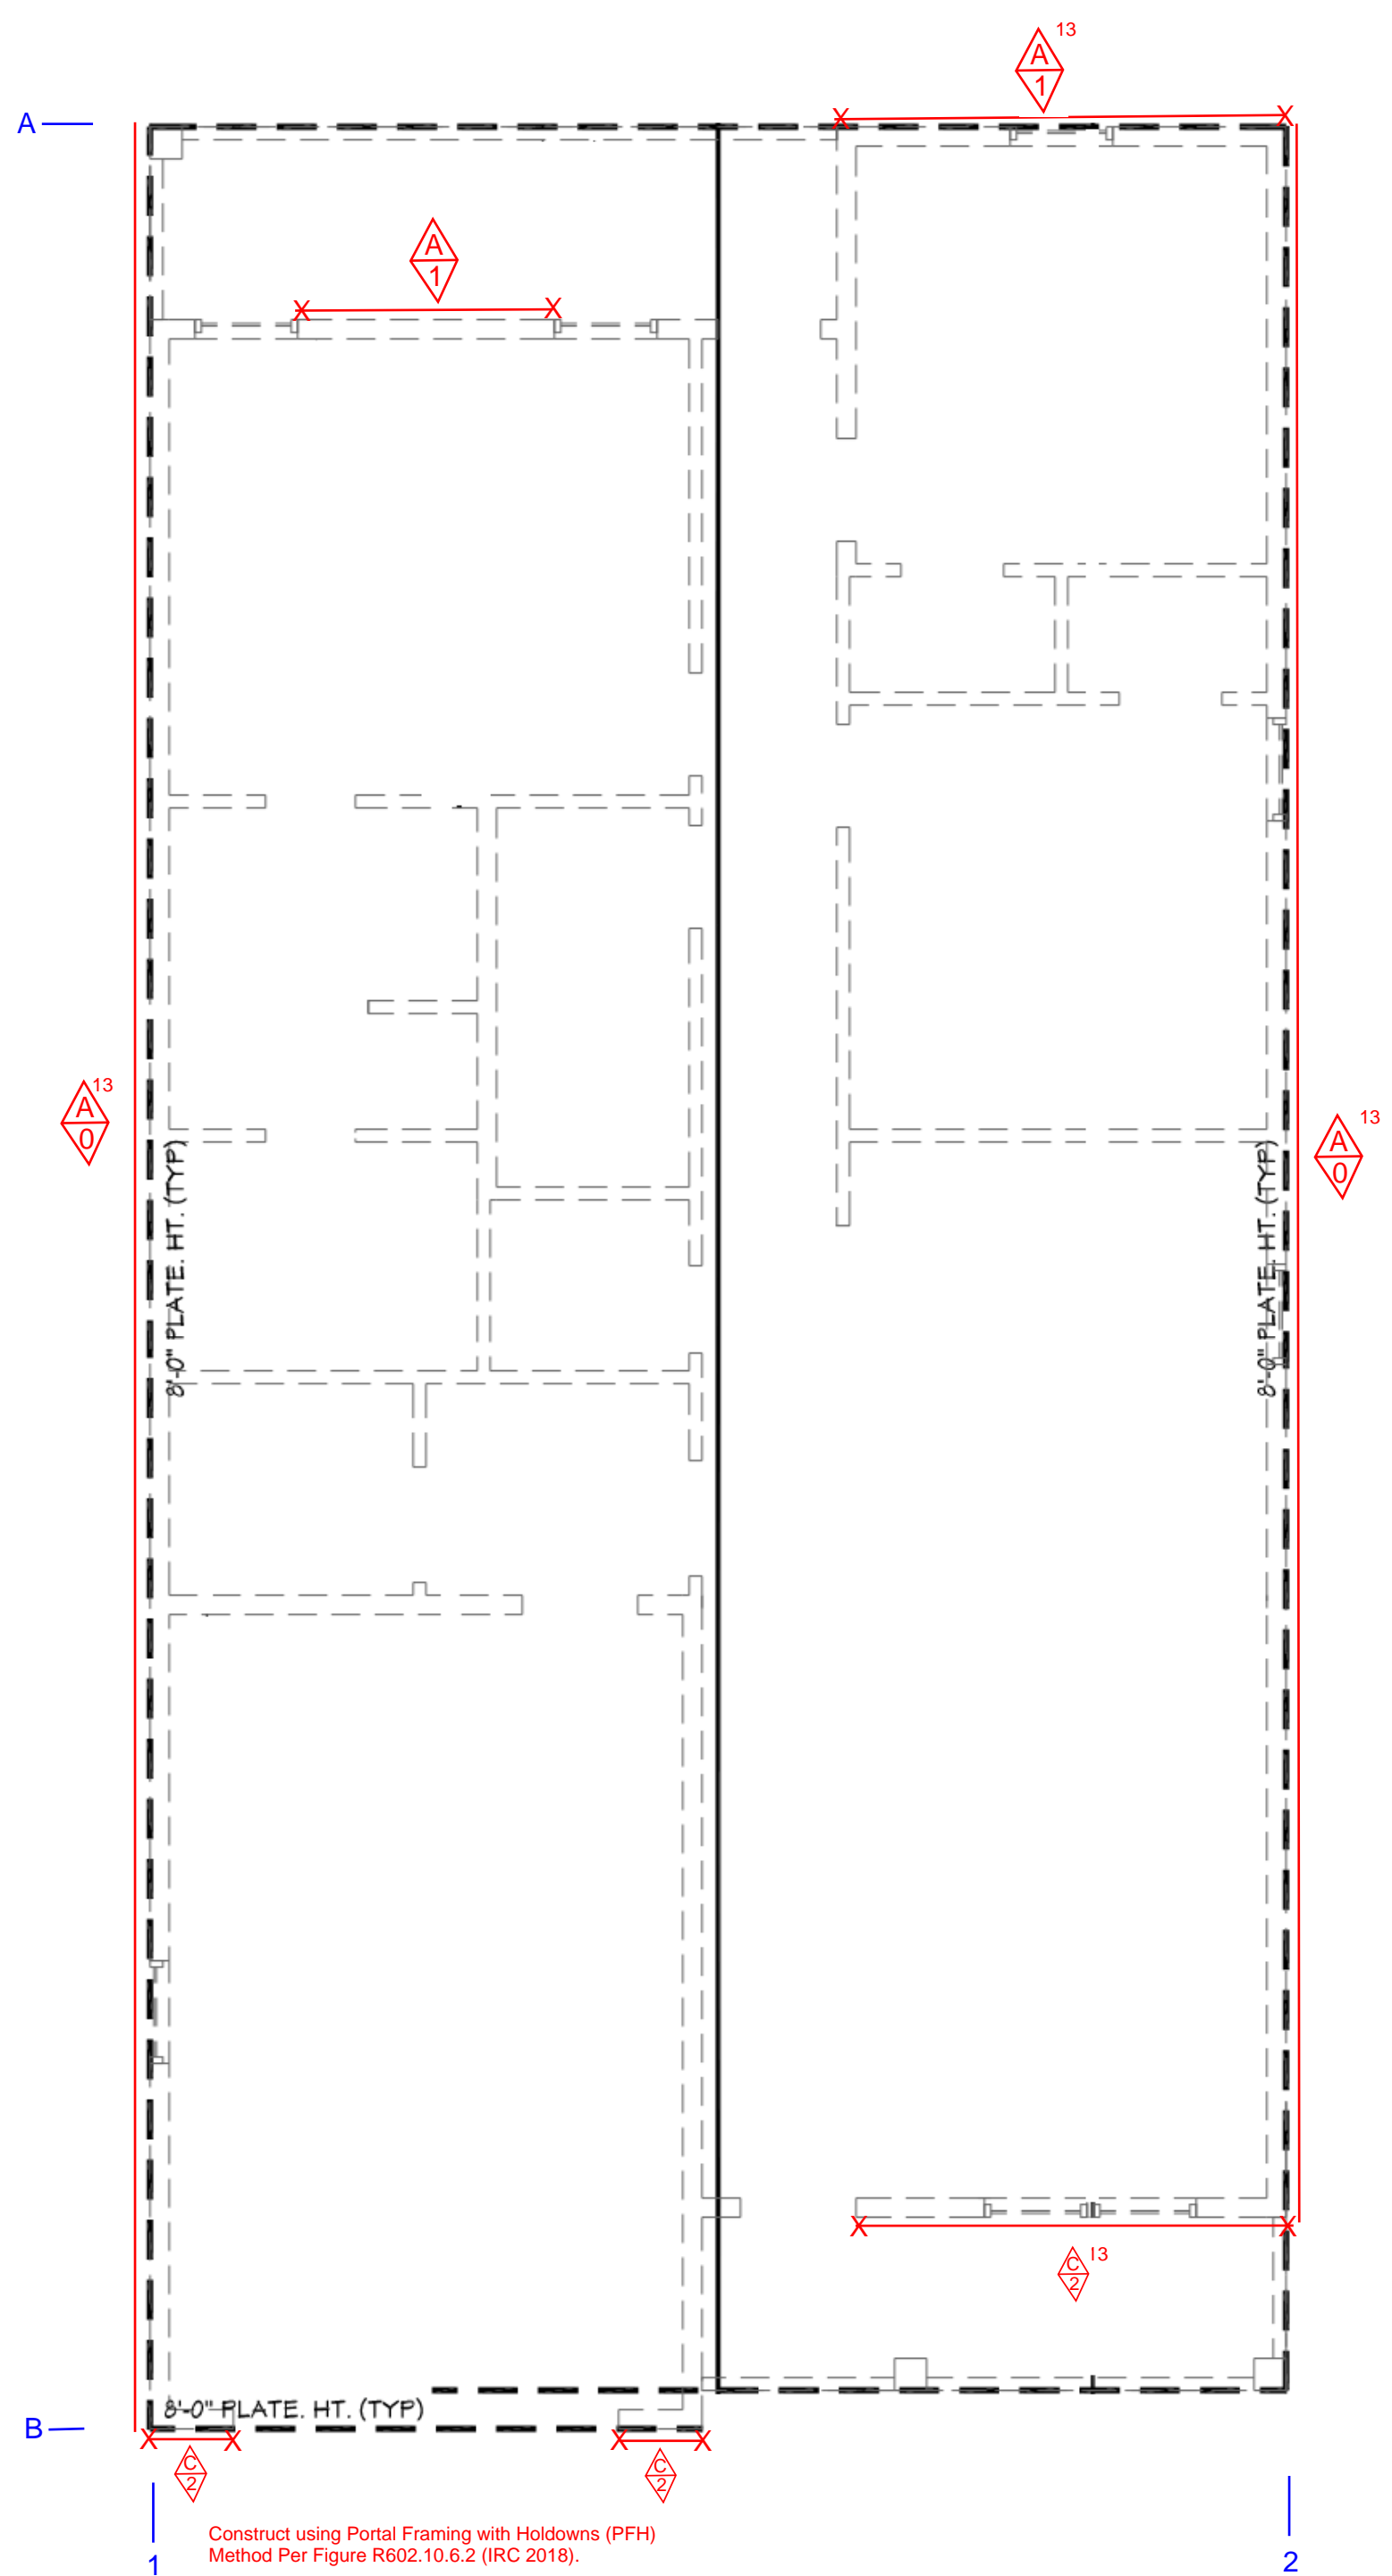

Construct using Portal Framing with Holdowns (PFH) Method Per Figure R602.10.6.2 (IRC 2018).

Shear Plan

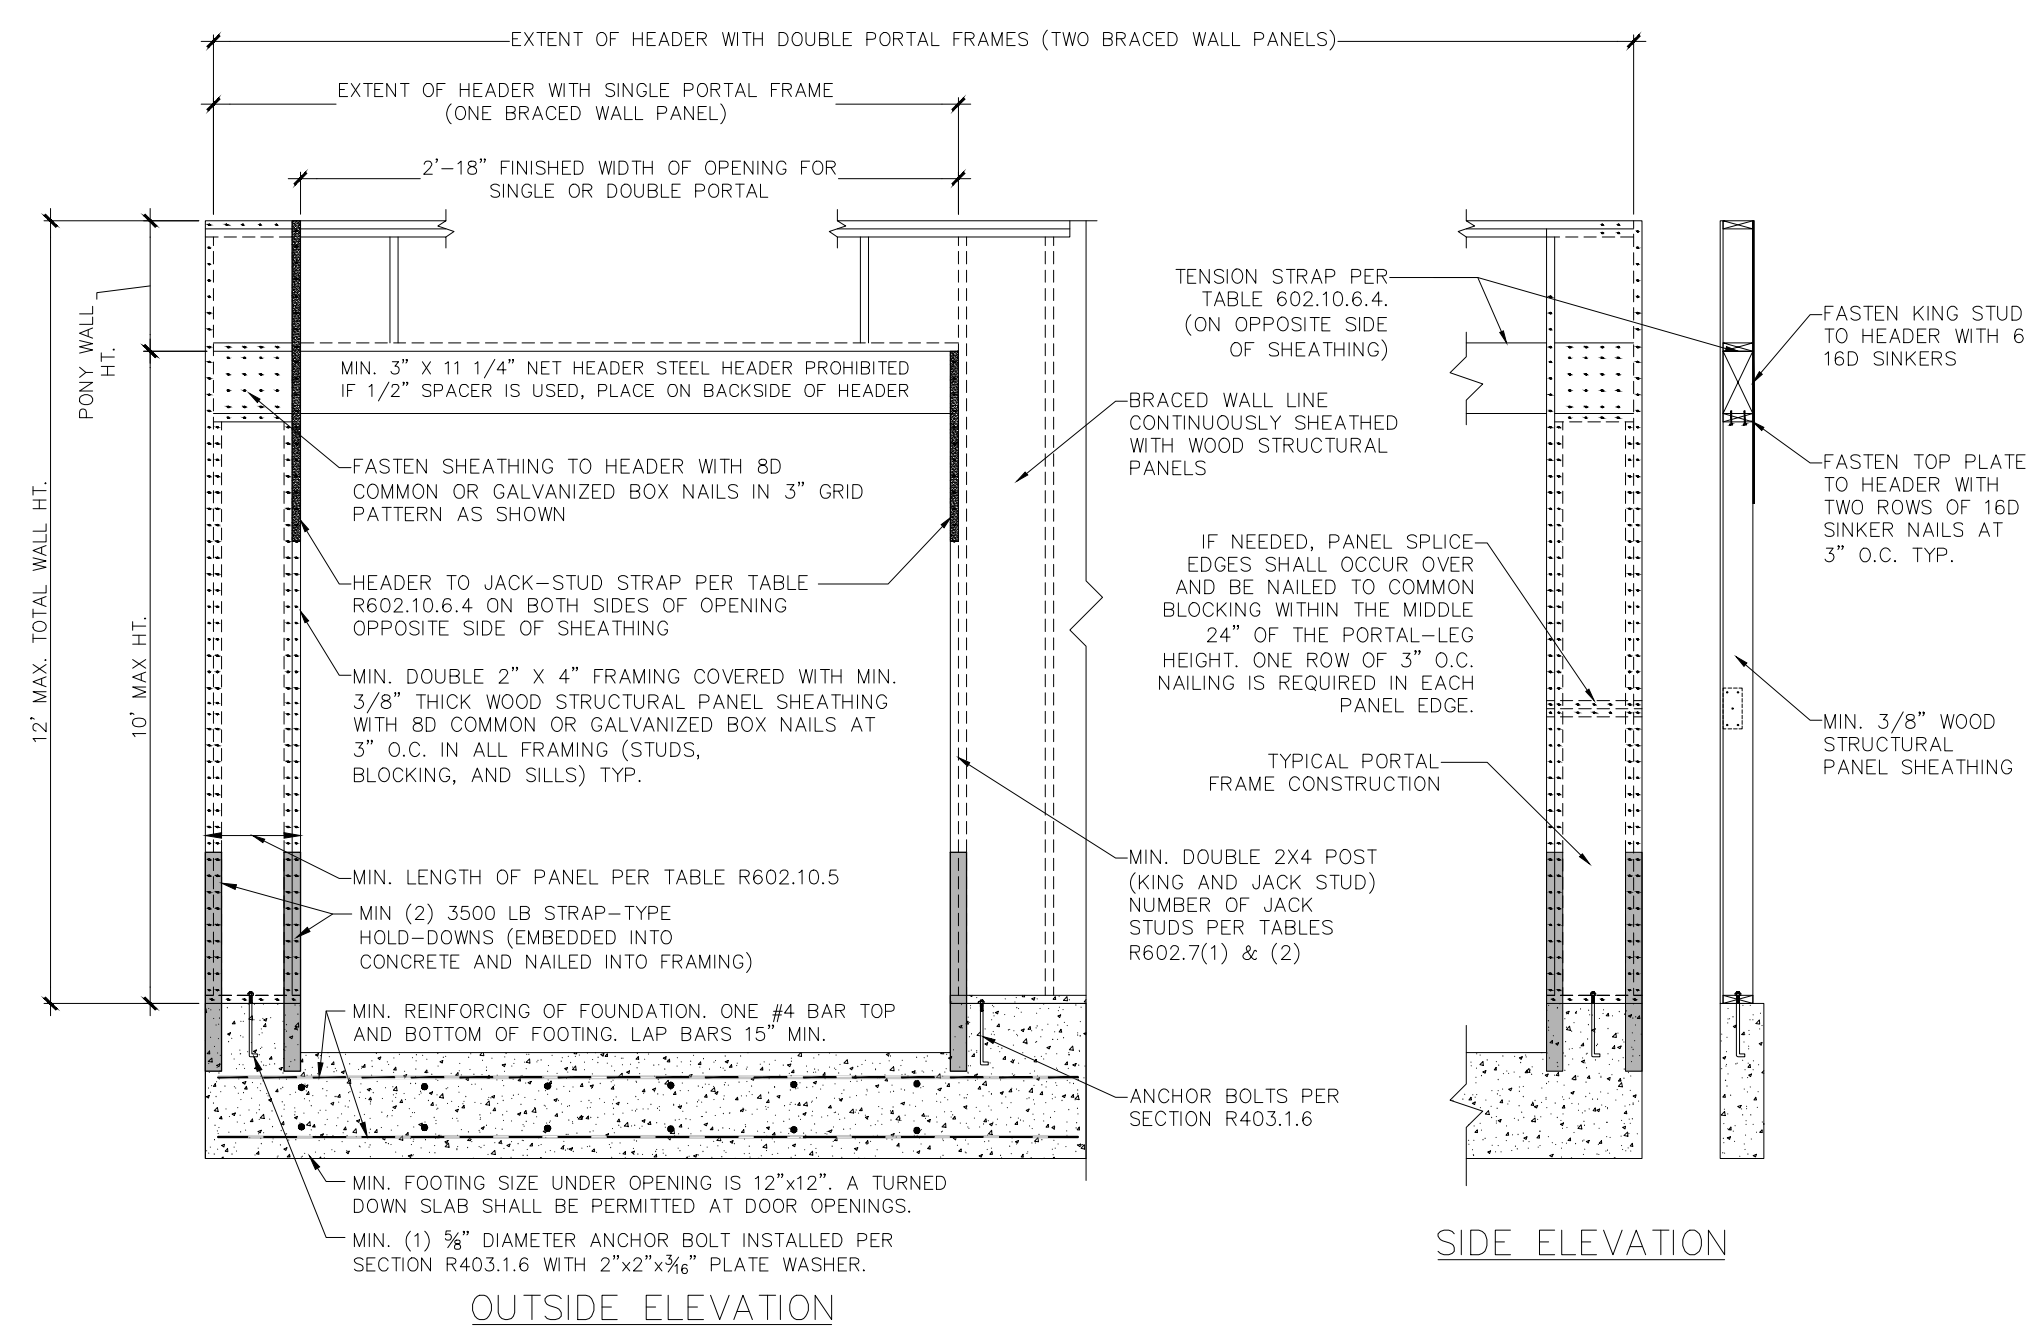

2 PORTAL FRAME WITH HOLD-DOWNS (PFH) FIGURE R602.10.6.2 N.T.S.

