



WATER • WASTEWATER • LABORATORY

2323 Fourth Street
PO Box 483
Peru, Illinois 61354
815-224-1650
800-659-4659
Faxe 815-224-1688
www.testinc.com

April 15, 2026

Client: Village of Poplar Grove
Attn: Kristi Richardson, Village President
200 Hill Street
P.O. Box 01
Poplar Grove, IL 61065

Plant Type: Wastewater Treatment Plants: North: Class II Sequential batch reactors (SBR).
South: Class I Sequential batch reactors (SBR).
Water Treatment Plants: Well Supply with Chemical Addition in all 3 locations

For the water system you will find attached the daily inspection and monitoring reports for each of the water plants and the distribution system testing record. For the wastewater side we have included the monthly DMR for both wastewater plants.

Outlined below are the processes and actions taken during March 2026 in Poplar Grove to improve the facilities equipment beyond required and routine maintenance, testing, inspection and reporting. At times we will also list upcoming needed improvements that may need attention by the Village.

We hired a new employee, so we've returned to full staff. He's been working out well and has taken a liking to the job. He previously worked in a lab, so he's familiar with a lot of the industry. He has been picking up on mechanical things quickly as well.

Lift Stations:

- Performed daily checks and maintenance.
- Cleaned grease from wood stock with a steel strainer bucket.
- Cleaned all the dust and any debris from the lift station panels, blew dust from all controls.

North WWTP:

- All standard monthly checks/maintenance/cleaning and procedures were completed.
- We decanted digesters.
- Tested all emergency wash stations.
- Cleaned out screener and cleaned spray nozzles. Cleaned out channel, raised screener and cleaned under it to ensure it's seated properly.
- Cleaned out all of the building and cleared the cobwebs.
- Calibrated all lab equipment.
- Cleaned plant.

- Performed process control sampling.
- Monthly testing of all emergency wash stations.
- Installed spare blower that will be used for the digester.
- Cleaned sludge and build up from the EQ tank from over the winter.
- Cleaned all filters on control cabinets and blew dust from all VFD's and electrical equipment.
- Changed bad float on influent screen.
- Changed float in influent lift station.
- We have received a new laptop for the plants, so in the future tech support for the Scada systems will be able to be remote in.
- We got some quotes for a crane to do some unit work and now we're just waiting for the ground to firm up so we don't get the crane stuck.

South WWTP:

- Decanted digesters.
- Removed spray nozzle from screen and cleaned them. Also ran some ice through the screen to clean out stuck debris.
- All standard monthly checks/maintenance/cleaning and producers were completed.
- Tested all emergency wash stations.
- Test ran portable generators.
- We had an issue with the cooling fans on one of VFD's. We replaced the fans and they are working as they should now.
- Drained and cleaned out UV channel before new bulb installation.
- Installed new UV bulbs.

Water System:

- Cleaned well houses.
- All daily checks have been completed.
- Monthly and quarterly sampling completed.
- Test ran big generator under load at each well to ensure everything is still working as it should.
- Changed batteries in thermostats.
- Exercised all valves and all well houses to ensure they work in the event of an emergency.

All operations and plant inspections have been performed by me or under my direct supervision. As always, if you have any questions concerning the above, please do not hesitate to contact me.

Submitted by,
Total Environmental Service Technologies, Inc.



Ion Stear
Certified Operator/Manager

Value None

Submission Note

If a parameter row does not contain any values for the Sample nor Effluent Trading, then none of the following fields will be submitted for that row: Units, Number of Excursions, Frequency of Analysis, and Sample Type.

Edit Check Errors

No errors.

Comments

Attachments

No attachments.

Report Last Saved By

POPULAR GROVE, VILLAGE OF

User:

KJOERGER

Name:

Keile Joerger

E-Mail:

kjoerger@teslinc.com

Date/Time:

2026-03-13 10:29 (Time Zone: -05:00)

Report Last Signed By

User:

IONSTEAR

Name:

Ion Stear

E-Mail:

istear@teslinc.com

Date/Time:

2026-03-24 14:47 (Time Zone: -05:00)

DMR Copy of Record

EPA may make all the information submitted through this form (including all attachments) available to the public without further notice to you. Do not use this online form to submit personal information (e.g., non-business cell phone number or non-business email address), confidential business information (CBI), or if you intend to assert a CBI claim on any of the submitted information. Pursuant to 40 CFR 2.203(a), EPA is providing you with notice that all CBI claims must be asserted at the time of submission. EPA cannot accommodate a late CBI claim to cover previously submitted information because efforts to protect the information are not administratively practicable since it may already be disclosed to the public. Although we do not foresee a need for persons to assert a claim of CBI based on the types of information requested in this form, if persons wish to assert a CBI claim we direct submitters to contact the [NEPDES Reporting Help Desk](#) for further guidance. Please note that EPA may contact you after you submit this report for more information.

This collection of information is approved by OMB under the Paperwork Reduction Act, 44 U.S.C. 3501 et seq. (OMB Control No. 2040-0004). Responses to this collection of information are mandatory in accordance with this permit and EPA NPDES regulations 40 CFR 122.41(i)(4)(vi). An agency may not conduct or sponsor, and a person is not required to respond to, a collection of information unless it displays a currently valid OMB control number. The public reporting and recordkeeping burden for this collection of information are estimated to average 2 hours per outlet. Send comments on the Agency's need for this information, the accuracy of the provided burden estimates and any suggested methods for minimizing respondent burden to the Regulatory Support Division Director, U.S. Environmental Protection Agency (26211), 1200 Pennsylvania Ave., NW, Washington, D.C. 20460, include the OMB control number in any correspondence. Do not send the completed form to this address.

Permit #: IL0023451	Permittee: POPLAR GROVE, VILLAGE OF	Facility: POPLAR GROVE - NORTH WWTP - VILLAGE OF
Major: No	Permittee Address: 200 NORTH HILL STREET POPLAR GROVE, IL 61065	Facility Location: 205 EDSON RD POPLAR GROVE, IL 61065
Permitted Features: INF Influent Structure	Discharge: INF-L INFLUENT MONITORING	
Report Dates & Status	DMR Due Date: 03/25/26	Status: NetDMR Validated
Monitoring Period: From 02/01/26 to 02/28/26		
<i>Considerations for Form Completion</i>		
BOW ID: W0070150007	Title: Certified Operator	Telephone: 815-224-1650
Principal Executive Officer		
First Name: Ion		
Last Name: Stear		
No Data Indicator (NDD):		
Form NDD:		
00310 BOD, 5-day, 20 deg. C	G - Raw Sewage Influent	0 -
00530 Solids, total suspended	G - Raw Sewage Influent	0 -
50050 Flow, in conduit or thru treatment plant	G - Raw Sewage Influent	0 -

Sample	Parent Conc. Value NDD	Parent Conc. Value NDD	Parent Conc. Value NDD	Parent Conc. Value NDD	Parent Conc. Value NDD	Quality or Concentration Value 1	Quality or Concentration Value 2	Quality or Concentration Value 3	Units	# of EA	Frequency of Analysis	Sample Type
00310						96.25			19 - mg/L	0	02/DA - 2 Days Every Week	CP - Composita
						Req Mon MD AVG			19 - mg/L	0	02/DA - 2 Days Every Week	CP - Composita
00530						78.25			19 - mg/L	0	02/DA - 2 Days Every Week	CP - Composita
						Req Mon MD AVG			19 - mg/L	0	02/DA - 2 Days Every Week	CP - Composita
50050						0.167			03 - MGD	0	99/99 - Continuous	CP - Composita
						Req Mon MO AVG			03 - MGD	0	99/99 - Continuous	CP - Composita

Submission Note
If a parameter row does not contain any values for the Sample nor Effluent Trading, then none of the following fields will be submitted for that row: Units, Number of Excursions, Frequency of Analysis, and Sample Type.

Edit Check Errors
No errors.

Comments

Attachments
No attachments.


Report Last Saved By
POPLAR GROVE, VILLAGE OF

User: KJOERGER
Name: Katie Joerger
E-Mail: kjoerger@testinc.com
Date/Time: 2026-03-13 10:29 (Time Zone: -05:00)

Report Last Signed By
User: IONSTEAR
Name: Ion Stear
E-Mail: istear@testinc.com

Date/Time:

2026-03-24 14:47 (Time Zone: -05:00)

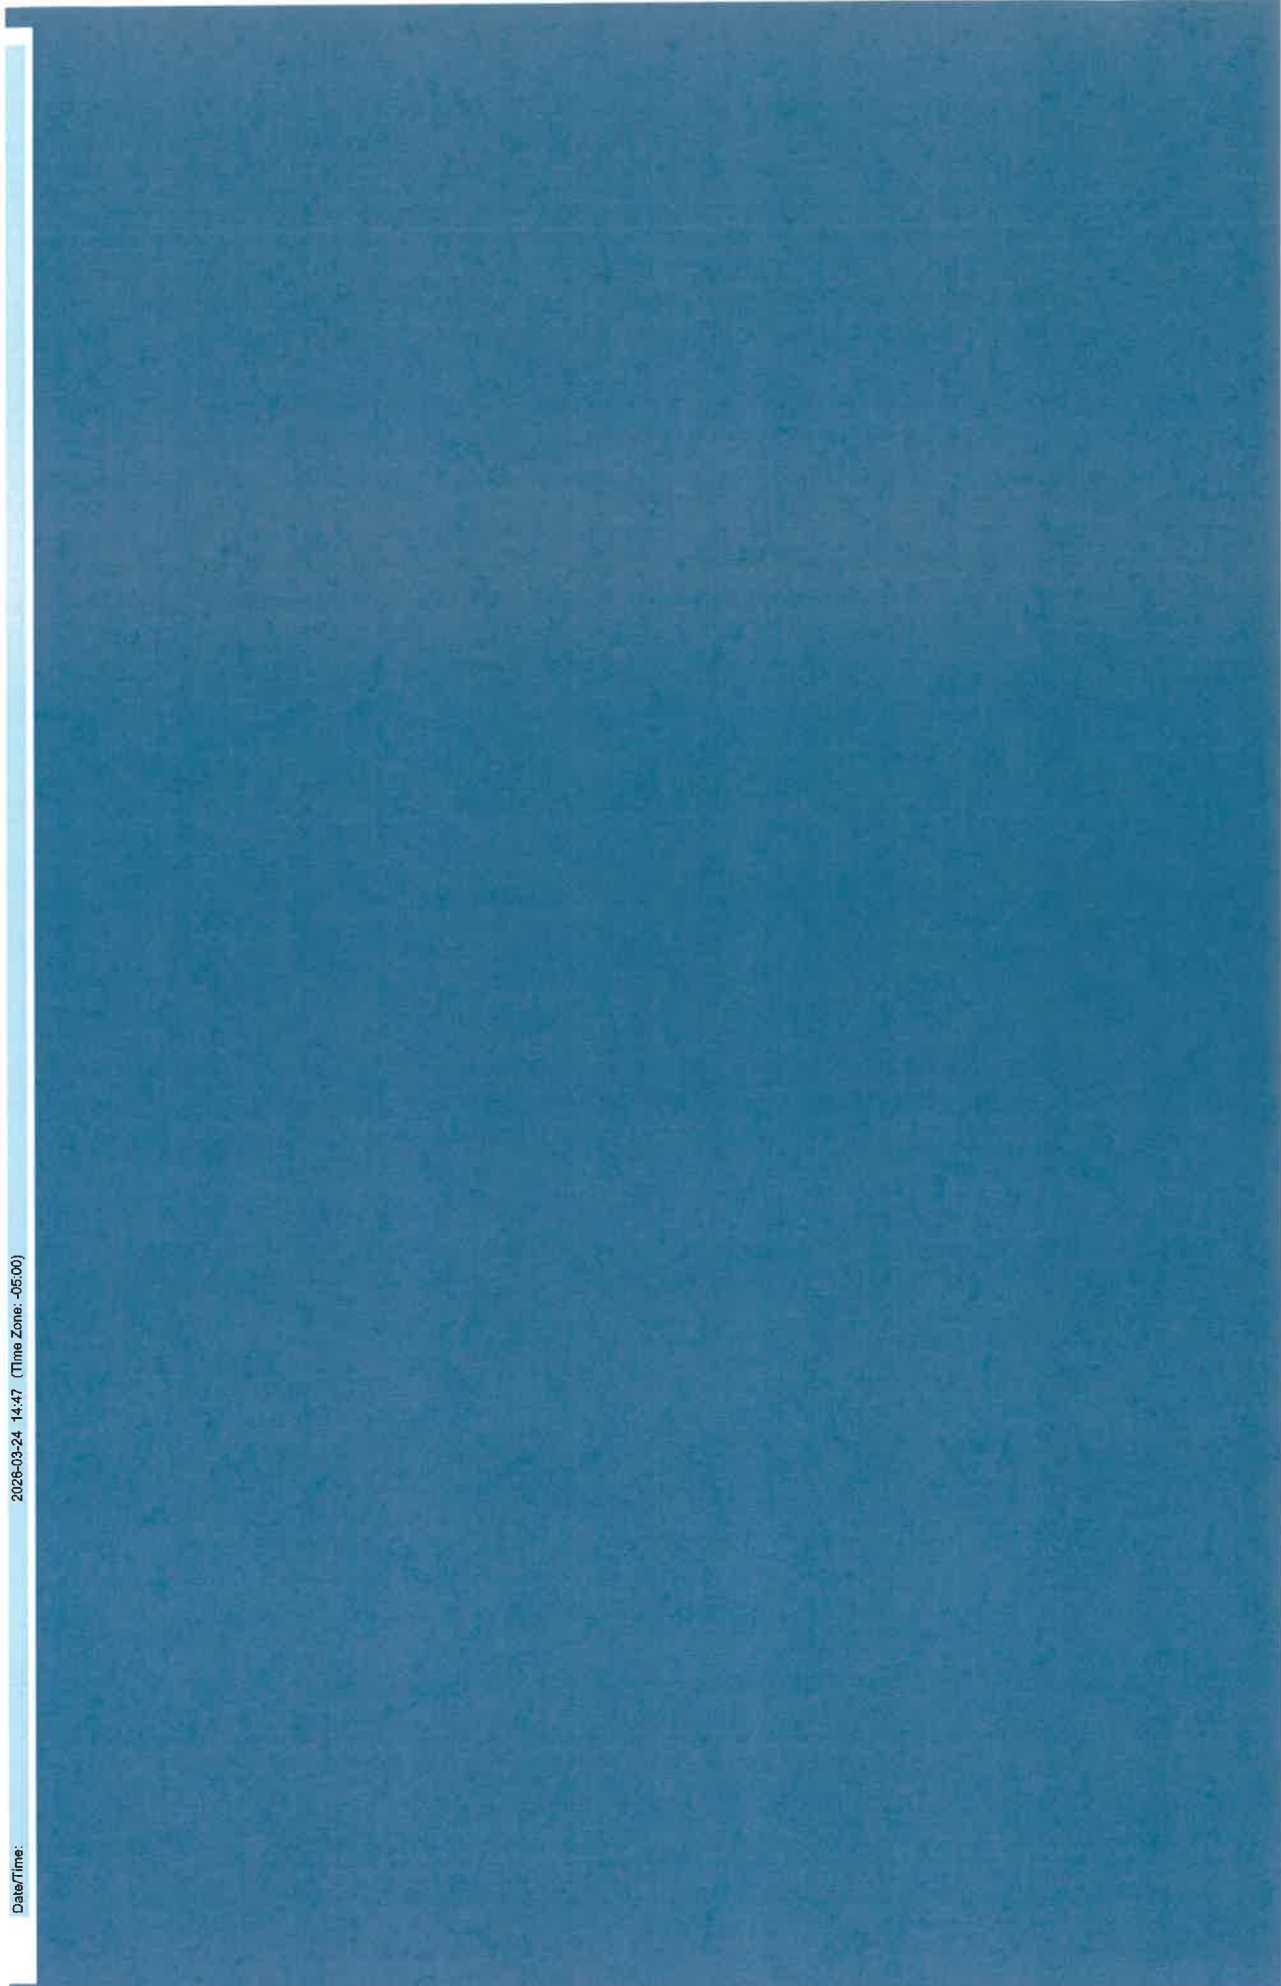

DMR Copy of Record


EPA may make all the information submitted through this form (including all attachments) available to the public without further notice to you. Do not use this online form to submit personal information (e.g., non-business cell phone number or non-business email address), confidential business information (CBI), or if you intend to assert a CBI claim on any of the submitted information. Pursuant to 40 CFR 2.203(a), EPA is providing you with notice that all CBI claims must be asserted at the time of submission. EPA cannot accommodate a late CBI claim to cover previously submitted information because efforts to protect the information are not administratively practicable since it may already be disclosed to the public. Although we do not foresee a need for persons to assert a claim of CBI based on the types of information requested in this form, if persons wish to assert a CBI claim we direct submitters to contact the [NEDES Reporting Help Desk](#) for further guidance. Please note that EPA may contact you after you submit this report for more information.

This collection of information is approved by OMB under the Paperwork Reduction Act, 44 U.S.C. 3501 et seq. (OMB Control No. 2040-0004). Responses to this collection of information are mandatory in accordance with this permit and EPA NPDES regulations 40 CFR 122.41(i)(4)(i). An agency may not conduct or sponsor, and a person is not required to respond to, a collection of information unless it displays a currently valid OMB control number. The public reporting and recordkeeping burden for this collection of information are estimated to average 2 hours per outlet. Send comments on the Agency's need for this information, the accuracy of the provided burden estimates and any suggested methods for minimizing respondent burden to the Regulatory Support Division Director, U.S. Environmental Protection Agency (2821T), 1200 Pennsylvania Ave., NW, Washington, D.C. 20460. Include the OMB control number in any correspondence. Do not send the completed form to this address.

Permit #:	IL0071447	Permittee:	POPLAR GROVE, VILLAGE OF	Facility:	POPLAR GROVE SOUTH STP, VILLAGE OF	Sample Type				
Major:	Yes	Permittee Address:	200 HILL STREET, P.O. BOX 1 POPLAR GROVE, IL 61065	Facility Location:	12211 STATE ROUTE 76 POPLAR GROVE, IL 61065	Frequency of Analysis				
Permitted Feature:	001 External Outfall	Discharge:	001-0 STP OUTFALL	Status:	NetDMR Validated					
Report Dates & Status	From 02/01/26 to 02/28/26	DMR Due Date:	03/25/26	Telephone:	815-224-1650					
Monitoring Period:	From 02/01/26 to 02/28/26	DMR Due Date:	03/25/26							
Considerations for Form Completion	BOW ID: W0070150006, DMF LOAD LIMITS DISPLAYED.									
Principal Executive Officer	Ion	Stear	Stear	Stear	Stear	Stear				
First Name:	Ion	Stear	Stear	Stear	Stear	Stear				
Last Name:	Stear	Stear	Stear	Stear	Stear	Stear				
No Data Indicator (NOD)	No Data Indicator (NOD)									
Form NOD:	No Data Indicator (NOD)									
00300 Oxygen, dissolved [DO]	1 - Effluent Gross	1	-	Sample Permit Req. Value NOD	8.629	8.403	7.9	19 - mg/L	03DW - 3 Days Every Week	GR - Grab
00400 pH	1 - Effluent Gross	0	-	Sample Permit Req. Value NOD	>=	4.5 MN WK AV	4.0 DAILY MN	19 - mg/L	03DW - 3 Days Every Week	GR - Grab
00500 Solids, total suspended	1 - Effluent Gross	0	-	Sample Permit Req. Value NOD	2.702	2.25	6.0	19 - mg/L	03DW - 3 Days Every Week	GR - Grab
00600 Nitrogen, total [as N]	1 - Effluent Gross	0	-	Sample Permit Req. Value NOD	0.12	0.1	0.1	19 - mg/L	01R0 - Monthly	CP - Composite
00610 Nitrogen, ammonia total [as N]	8 - Other Treatment, Process Complete	2	-	Sample Permit Req. Value NOD	0.233	0.194	1.0	19 - mg/L	03DW - 3 Days Every Week	CP - Composite
00665 Phosphorus, total [as P]	1 - Effluent Gross	0	-	Sample Permit Req. Value NOD	2.10	1.0	1.0	19 - mg/L	03DW - 3 Days Every Week	CP - Composite

Date/Time:

2026-03-24 14:47 (Time Zone: JST00)

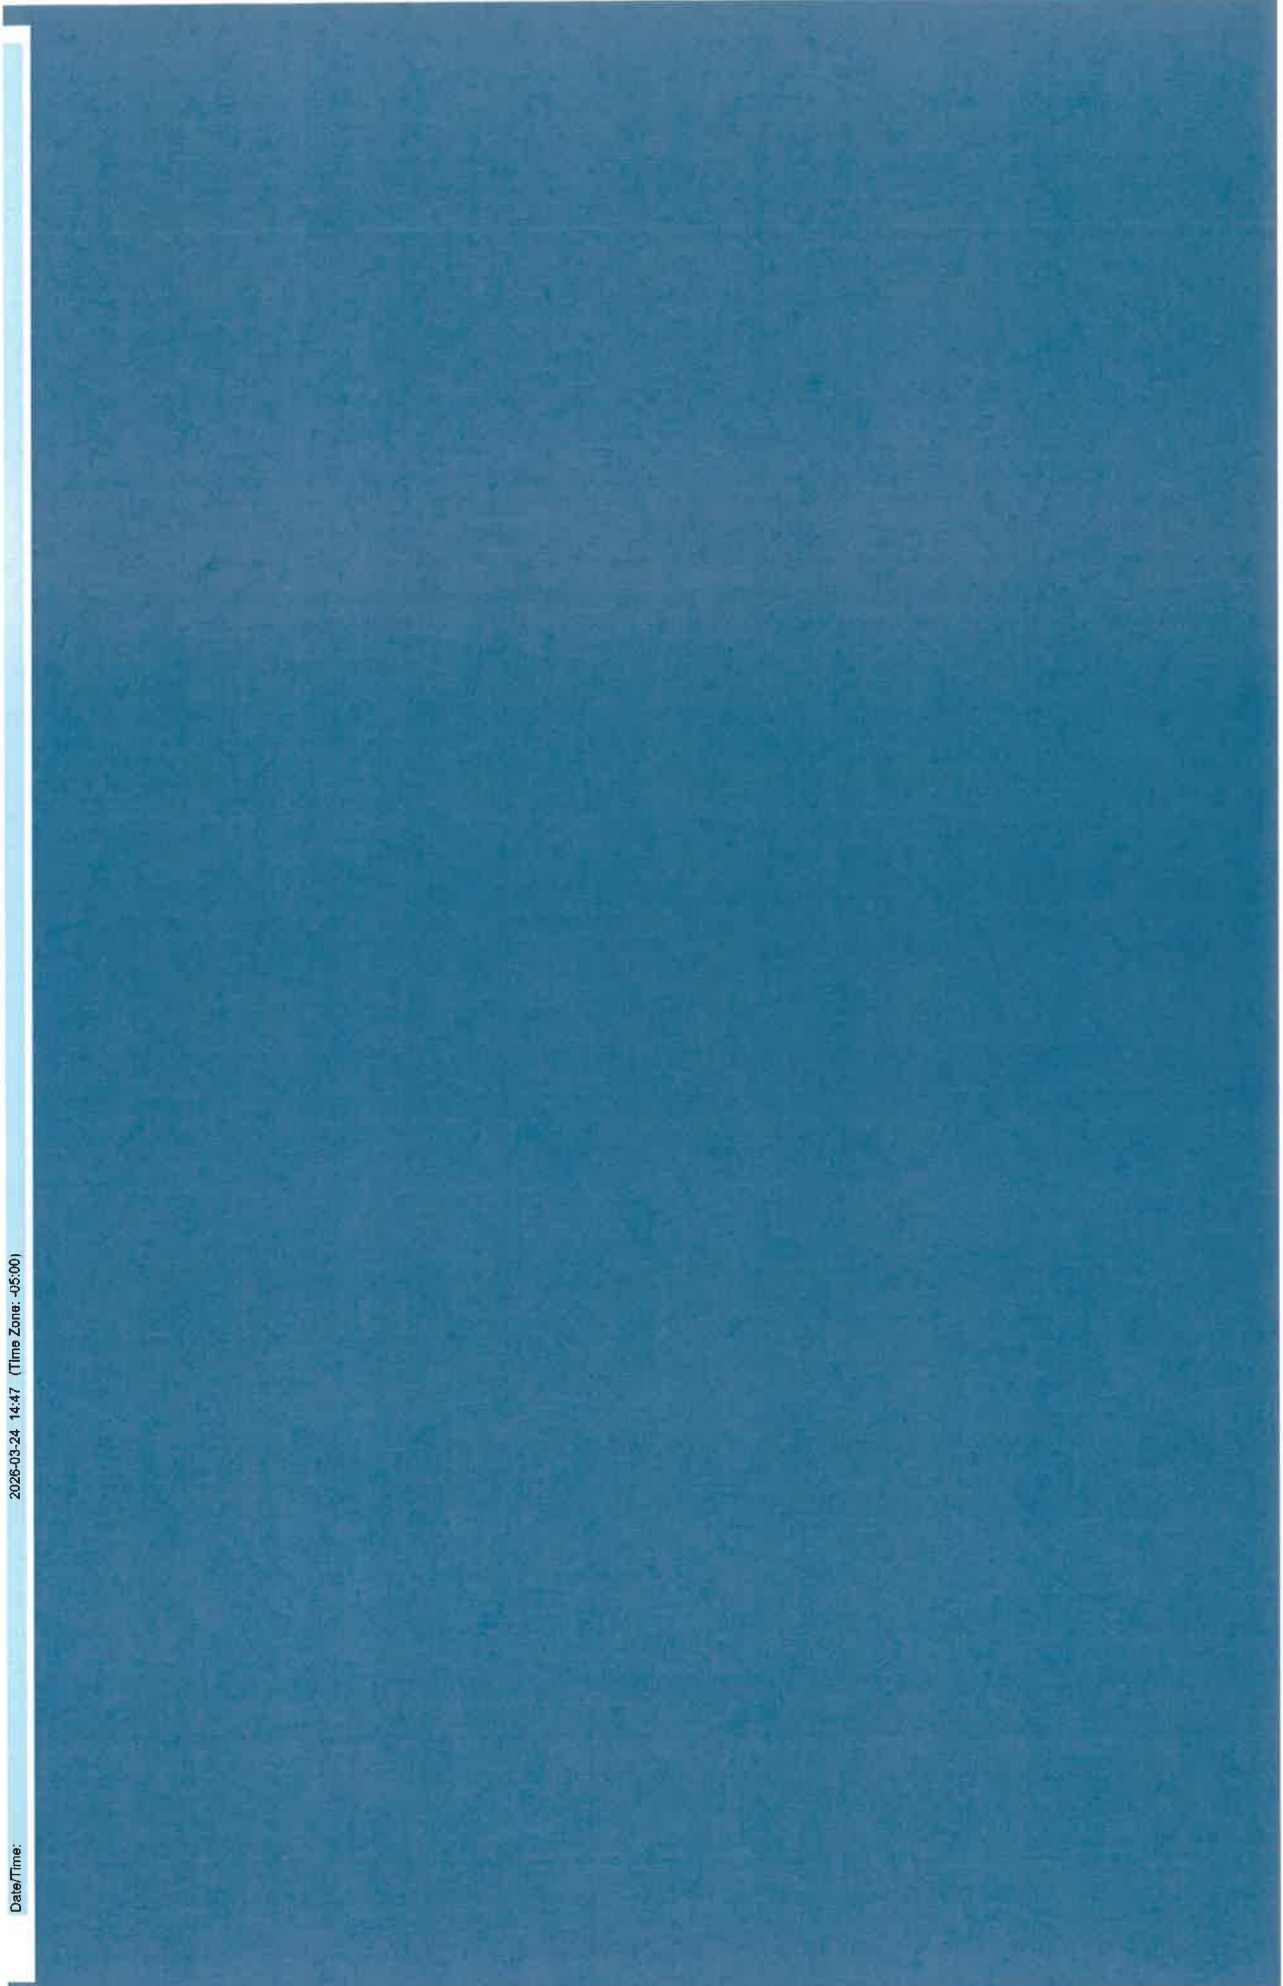

VILLAGE OF POPLAR GROVE - NORTH
IL-0070150
MONTHLY OPERATING REPORT
FOR THE MONTH OF Feb. 2026
ILLINOIS ENVIRONMENTAL PROTECTION AGENCY
DIVISION OF PUBLIC WATER SUPPLIES

Date	Time	Flow Meter		Hour Meter Well 2		Hour Meter Well 3		Chlorine Feed		Phosphate Feed		Flouride Feed		Operator Initials
		Reading	Pumpage	Reading	Hours	Reading	Hours	Scale	lbs Used	Free	Scale	lbs Used	PO4 mg/L	
31-Jan	10:00	526692		10065.7		37554.70		125.00		0.77	104		43.00	JH
1-Feb	10:00	526808	120	10065.7	0	37560.80	6.50	125.00	1.0	0.39	100	8.00	42.50	JH
2-Feb	10:01	526928	105	10065.7	0	37567.30	5.70	124.00	0.0	1.00	92	4.00	42.00	JH
3-Feb	10:10	527033	108	10065.7	0	37573.00	5.70	124.00	1.0	0.72	88	6.00	42.00	JH
4-Feb	10:10	527141	104	10065.7	0	37578.70	5.70	123.00	1.0	1.34	82	4.00	42.00	JH
5-Feb	10:15	527245	124	10065.7	0	37584.40	6.60	122.00	2.0	0.74	78	8.00	41.00	JH
6-Feb	10:55	527369	104	10065.7	0	37591.00	5.60	120.00	0.0	1.00	70	4.00	41.00	JH
7-Feb	10:40	527473	112	10065.7	0	37596.60	6.00	120.00	0.0	0.65	66	6.00	40.50	As
8-Feb	09:55	527585	84	10065.7	0	37602.60	7.60	120.00	1.0	0.67	60	10.00	40.00	As
9-Feb	00:00	527669	159	10065.7	0	37610.20	5.50	119.00	1.0	1.00	50	6.00	40.00	JH
10-Feb	10:05	527828	108	10065.7	0	37615.70	5.80	118.00	0.0	0.69	44	4.00	39.50	JH
11-Feb	09:45	527936	104	10065.7	0	37621.50	5.60	118.00	0.0	0.27	40	8.00	39.00	JH
12-Feb	10:02	528040	81	10065.7	0	37627.10	4.30	118.00	0.0	1.09	32	2.00	39.00	JH
13-Feb	07:05	528121	123	10065.7	0	37631.40	6.70	118.00	0.0	0.44	30	6.00	39.00	As
14-Feb	11:11	528244	83	10065.7	0	37638.10	5.80	118.00	2.0	0.69	24	6.00	38.00	JH
15-Feb	10:32	528327	123	10065.7	0	37643.90	7.10	116.00	1.0	0.58	18 / 120	8.00	38.00	JH
16-Feb	11:11	528450	151	10065.7	0	37651.00	6.20	115.00	0.0	0.70	112	6.00	37.50	JH
17-Feb	11:11	528601	93	10065.7	0.1	37657.20	5.00	115.00	1.0	0.68	106	4.00	37.00	JH
18-Feb	09:15	528694	113	10065.8	0	37662.20	6.10	114.00	1.0	1.15	102	2.00	36.50	As
19-Feb	10:05	528807	92	10065.8	0	37668.30	5.00	113.00	0.0	0.82	100	10.00	36.00	JH
20-Feb	10:05	528899	105	10065.8	0	37673.30	5.60	113.00	1.0	0.98	90	8.00	36.00	JH
21-Feb	10:37	529004	97	10065.8	0	37678.90	5.20	112.00	1.0	0.73	82	6.00	36.00	JH
22-Feb	08:35	529101	141	10065.8	0	37684.10	7.60	111.00	0.0	0.65	76	6.00	35.50	JH
23-Feb	10:30	529242	105	10065.8	0	37691.70	5.70	111.00	1.0	0.41	70	6.00	35.00	JH
24-Feb	11:11	529347	105	10065.8	0	37697.40	5.70	110.00	0.0	0.71	64	6.00	35.00	JH
25-Feb	11:11	529452	105	10065.8	0	37703.10	4.40	110.00	1.0	1.04	58	6.00	34.75	JH
26-Feb	11:11	529557	95	10065.8	0	37707.50	6.30	109.00	1.0	0.51	52	2.00	34.00	JH
27-Feb	11:11	529652	100	10065.8	0	37713.80	5.40	108.00	1.0	0.65	50	8.00	34.00	JH
28-Feb	09:45	529752	126	10065.8	0	37719.20	5.80	107.00	0.0	0.43	42	8.00	33.50	As
1-Mar	10:30	529878		10065.8		37725.00		107.00		0.41	34		33.00	As
TOT			3070				164			21.91				
AVE			110				6			0.73				
MAX			159				8			1.34				
MIN			84				4			0.27				

SIGNATURE:  Iron Stear
PHONE: 815-224-1650

VILLAGE OF POPLAR GROVE - WEST
IL0070350
MONTHLY OPERATING REPORT
FOR THE MONTH OF Feb. 2026
ILLINOIS ENVIRONMENTAL PROTECTION AGENCY
DIVISION OF PUBLIC WATER SUPPLIES

Date	Time	Flow Meter		Hour Meter Well 4		Chlorine Feed		Phosphate Feed		Flouride Feed		Operator Initials
		Reading	Pumpage	Reading	Hours	Scale	lbs Used	Free	Scale	lbs Used	PO4 mg/L	
31-Jan	10:35	441853		10016.1		110.00		0.66	44		372.20	JH
1-Feb	10:35	441948	95	10019	1.04	108.00	3.0	0.71	40	6.00	369.50	J
2-Feb	10:10	442043	71	10021.4	1.81	105.00	1.0	1.48	34	4.00	366.90	JH
3-Feb	09:52	442114	94	10023.2	2.4	104.00	2.0	1.51	30	4.00	364.90	JH
4-Feb	10:04	442208	73	10025.6	1.06	102.00	2.0	1.91	26	2.00	362.50	JH
5-Feb	10:35	442281	93	10026.7	3.18	100.00	1.0	1.93	24 / 110	110.00	360.50	JH
6-Feb	10:35	442374	93	10029.9	2.36	99.00	3.0	2.01	106	4.00	357.70	JH
7-Feb	09:00	442467	95	10032.2	2.39	96.00	3.0	2.24	102	4.00	355.50	As
8-Feb	09:20	442562	119	10034.6	3.06	93.00	0.0	2.12	98	6.00	352.80	As
9-Feb	11:33	442681	96	10037.7	2.45	92.00	1.0	1.90	92	4.00	349.50	JH
10-Feb	10:27	442777	94	10040.1	2.39	90.00	2.0	2.08	88	4.00	346.90	JH
11-Feb	11:11	442871	95	10042.5	2.42	88.00	3.0	2.17	84	4.00	344.90	JH
12-Feb	10:50	442966	73	10045	1.83	85.00	1.0	1.78	80	2.00	341.90	JH
13-Feb	07:30	443039	115	10046.8	2.97	84.00	2.0	1.84	78	6.00	339.90	As
14-Feb	11:25	443154	95	10049.8	2.42	82.00	2.0	1.34	72	4.00	336.80	JH
15-Feb	09:55	443249	120	10052.2	3.05	80.00	2.0	2.03	68	6.00	334.30	JH
16-Feb	10:10	443369	96	10055.2	2.46	78.00	2.0	1.07	62	4.00	331.40	JH
17-Feb	10:30	443465	94	10057.7	2.33	76.00	2.0	1.60	58	2.00	328.80	JH
18-Feb	09:45	443559	94	10060	2.47	74.00	1.0	1.66	56	6.00	326.20	As
19-Feb	10:35	443653	90	10062.5	2.39	73.00	2.0	1.50	50	6.00	324.50	JH
20-Feb	10:24	443743	88	10064.9	2.21	71.00	1.0	1.72	44	4.00	322.10	JH
21-Feb	10:28	443831	80	10067.1	1.99	70.00	1.0	1.50	40	2.00	320.00	JH
22-Feb	09:47	443911	114	10069.1	1.61	69.00	3.0	1.54	38	6.00	318.00	JH
23-Feb	10:45	444025	76	10070.7	3.23	66.00	1.0	1.37	32	2.00	315.00	JH
24-Feb	10:59	444101	98	10073.9	2.49	65.00	2.0	1.44	30	6.00	313.10	JH
25-Feb	10:39	444199	67	10076.4	1.73	63.00	1.0	1.42	24 / 100	2.00	310.30	JH
26-Feb	11:01	444266	45	10078.1	1.07	62.00	0.0	1.15	98	2.00	308.60	JH
27-Feb	10:34	444311	67	10079.2	1.78	62.00	1.0	0.67	96	2.00	307.30	JH
28-Feb	09:15	444378	69	10081	1.75	61.00	2.0	1.62	94	4.00	305.50	AS
1-Mar	10:50	444447		10082.7		59.00		1.59	90		303.80	As
TOT			2499					46.49				
AVE			89					1.60				
MAX			120					2.24				
MIN			45					0.66				

SIGNATURE: _____
 PHONE: 815-224-1650
 Ion Stear

IL0070300
MONTHLY OPERATING REPORT
VILLAGE OF POPLAR GROVE - SOUTH
FOR THE MONTH OF Feb. 2026
ILLINOIS ENVIRONMENTAL PROTECTION AGENCY
DIVISION OF PUBLIC WATER SUPPLIES

Date	Flow Meter		Hour Meter Well 5		Hour Meter Well 6		Chlorine Feed		Phosphate Feed		Flouride Feed		Operator Initials		
	Reading	Pumpage	Reading	Hours	Reading	Hours	Scale	lbs Used	Free	Scale	lbs Used	PO4 mg/L		Scale	lbs Used
31-Jan	665882		5370		4758.32		143.00		0.93	56		1.00	329.80		JH
1-Feb	665970	85	5371.5	1.3	4758.32	0	140.00	0.0	1.15	50	4.00	1.40	327.80	0.00	JH
2-Feb	666055	59	5372.8	1.3	4758.32	0	140.00	1.0	1.13	46	4.00	0.99	327.80	1.60	JH
3-Feb	666114	60	5374.1	0.6	4758.32	0	139.00	1.0	0.91	42	2.00	1.04	326.20	2.20	JH
4-Feb	666174	60	5374.7	1	4758.32	0	138.00	1.0	1.06	40	4.00	0.65	324.00	1.20	JH
5-Feb	666234	61	5375.7	0.9	4758.32	0	137.00	1.0	0.98	36	2.00	1.44	322.80	-0.20	JH
6-Feb	666295	60	5376.6	0.9	4758.32	0	136.00	1.0	1.26	34	4.00	1.42	323.00	2.80	JH
7-Feb	666355	58	5377.5	1	4758.32	0	135.00	1.0	1.17	30	4.00	1.36	320.20	1.80	As
8-Feb	666413	91	5378.5	1.4	4758.32	0	134.00	1.0	1.38	26	4.00	1.36	318.40	1.40	As
9-Feb	666504	61	5379.9	0.9	4758.32	0	133.00	1.0	1.10	22 / 100	2.00	0.70	317.00	0.60	JH
10-Feb	666565	60	5380.8	1	4758.32	0	132.00	0.0	1.05	98	4.00	1.66	316.40	1.40	JH
11-Feb	666625	59	5381.8	0.9	4758.32	0	132.00	1.0	0.90	94	4.00	1.48	315.00	1.20	JH
12-Feb	666684	59	5382.7	0.9	4758.32	0	131.00	1.0	1.40	90	2.00	2.01	313.80	1.60	JH
13-Feb	666743	91	5383.6	1.4	4758.32	0	130.00	1.0	1.08	88	4.00	1.67	312.20	2.00	JH
14-Feb	666834	60	5385	1	4758.32	0	129.00	1.0	0.91	84	4.00	1.11	310.20	1.00	JH
15-Feb	666894	61	5386	0.9	4758.32	0	128.00	1.0	0.93	80	2.00	1.85	309.20	1.40	JH
16-Feb	666955	59	5386.9	1	4758.32	0	127.00	1.0	1.00	78	4.00	1.73	307.80	1.00	JH
17-Feb	667014	59	5387.9	0.9	4758.32	0	126.00	1.0	1.04	74	4.00	1.94	306.80	1.00	JH
18-Feb	667073	59	5388.8	0.9	4758.32	0	125.00	1.0	1.06	70	2.00	1.76	305.80	3.40	As
19-Feb	667132	59	5389.7	0.9	4758.32	0	124.00	1.0	1.24	68	4.00	1.40	302.40	0.80	JH
20-Feb	667191	59	5390.6	1	4758.32	0	123.00	0.0	1.05	64	4.00	1.58	301.60	3.00	J
21-Feb	667250	61	5391.6	0.9	4758.32	0	123.00	1.0	0.97	60	4.00	1.43	298.60	2.00	JH
22-Feb	667311	91	5392.5	1.4	4758.32	0	122.00	1.0	0.47	56	6.00	1.25	296.60	2.20	JH
23-Feb	667402	59	5393.9	1	4758.32	0	121.00	1.0	0.88	50	2.00	1.40	294.40	1.00	JH
24-Feb	667461	58	5394.9	0.9	4758.32	0	120.00	1.0	0.79	48	4.00	2.07	293.40	1.00	JH
25-Feb	667519	58	5395.8	0.9	4758.32	0	119.00	1.0	0.92	44	4.00	1.74	292.40	2.00	JH
26-Feb	667577	62	5396.7	0.9	4758.32	0	118.00	0.0	0.98	40	2.00	1.97	290.40	0.40	JH
27-Feb	667639	56	5397.6	0.9	4758.32	0	118.00	1.0	0.89	38	2.00	1.58	290.00	1.20	JH
28-Feb	667695	91	5398.5	1.5	4758.32	0	117.00	2.0	1.09	36	6.00	1.86	288.80	3.00	As
1-Mar	667786		5400		4758.32		115.00		1.18	30		1.33	285.80		As
TOT		1816				0			30.90			44.18			
AVE		65				0			1.03			1.47			
MAX		91				0			1.40			2.07			
MIN		56				0			0.47			0.65			

SIGNATURE: _____
 PHONE: 815-224-1650
 Ion Stear

DAILY DISTRIBUTION MONITORING REPORT

**VILLAGE OF POPLAR GROVE
FOR THE MONTH OF Feb 2026
ILLINOIS ENVIRONMENTAL PROTECTION AGENCY
DIVISION OF PUBLIC WATER SUPPLIES**

Date	North System (Wells 2 & 3)			West System (Well 4)			South System (Wells 5 & 6)			Flouride Analysis								
	Site #	Free Cl ₂	Total Cl ₂	PO ₄	Site #	Free Cl ₂	Total Cl ₂	PO ₄	Site #	Free Cl ₂	Total Cl ₂	PO ₄	Operator Initials	Slope Standard	Well #2	Well #3	Well #4	Well#5-6
1														99.00				
2	Village	0.7		2.39	Gas	1.13		1.04	Tower	1		1.04	JH			0.47	0.53	0.48
3	Village	0.47		2.5	Gas	0.9		1.03	Tower	0.83		1.2	JH			0.64	0.67	0.77
4	Post	0.69		2.2	Gas	0.84		1	Tower	0.69		1.1	JH			1.00	0.73	0.83
5	School	0.76		2.3	Gas	1.13		0.93	Tower	0.88		0.56	JH			0.68	0.76	0.67
6	Arturo's	1.1		2.4	Gas	1		0.86	Tower	0.83		1.2	JH			0.62	0.77	0.71
7																0.61	0.88	0.65
8																0.71	1.10	0.70
9	Village	0.27		2.62	Gas	1.08		1.09	Tower	0.67		0.99	JH			0.72	1.00	0.71
10	Post	0.63		1.6	Gas	1.3		1.99	Tower	1		1.42	JH			0.76	1.00	0.69
11	Village	0.92		2.48	Gas	0.87		1.08	Tower	0.76		1.11	JH			0.65	0.75	0.50
12	Village	0.52		2.33	Gas	0.98		1	Tower	0.82		1.02	JH	86.00		0.62	0.83	0.72
13	Village	0.32		2.41	Gas	1.2		1.17	Tower	1.04		0.62	JH			0.51	0.96	0.70
14																0.50	0.67	0.51
15																0.50	0.53	0.52
16	Village	0.25		2.48	Gas	0.74		1.74	Tower	0.74		1.21	JH			0.47	0.48	0.42
17	Village	0.37		2.22	Gas	0.74		0.86	Tower	0.64		1.00	JH			0.70	0.67	0.40
18	School	0.95		1.45	Garage	0.64		0.71	Tower	0.79		1.96	As			0.69	0.68	0.60
19	Village	0.68		2.41	Gas	0.52		0.98	Tower	0.81		1.13	JH	89.00		0.67	0.69	0.66
20					Gas	0.8		1.34	Tower	0.75		1.25	JH			0.76	0.90	0.55
21																0.38	0.82	1.00
22																0.55	0.49	1.30
23	Village	0.26		0.85	Gas	0.7		0.96	Tower	0.52		1	JH			0.33	0.41	0.77
24	Post	0.5		2.1	Garage	1.16		1.25	Tower	0.76		1.77	JH			1.30	1.70	0.58
25	Village	0.52		2.34	Gas	0.72		1.45	Tower	0.69		1.2	JH			0.99	1.00	0.96
26	Post	0.89		1.22	Gas	0.32		1.1	Tower	0.67		1.04	JH			0.81	0.90	0.95
27																0.75	0.90	0.62
28														85.00		0.88	1.00	0.50
																0.64	1.00	0.59

Signature:  Ion Stear
PHONE: 815-224-1650