




Map #1
Existing Configuration
City of Sanger
2020 - 2024 Distribution Study

- Circuit Breaker
- Fuse
- ⊕ Capacitor
- ⊖ Closed Switch
- ⊕ Open Switch
- ⊗ Regulator
- Recloser
- ◇ Sectionalizer
- ⊠ Junction Box
- ⊡ Primary Meter



- | Overhead Transformer | Padmount Transformer |
|----------------------|----------------------|
| ⊙ A Phase | ⊠ A Phase |
| ⊙ B Phase | ⊠ B Phase |
| ⊙ C Phase | ⊠ C Phase |
| ⊙ AB Phase | ⊠ AC Phase |
| ⊙ AC Phase | ⊠ ABC Phase |
| ⊙ BC Phase | |
| ⊙ ABC Phase | |

- Overhead Conductor**
- | Feeder | # of Phases |
|--------|-------------|
| — 1205 | — 1 Phase |
| — 1206 | — 2 Phase |
| — 1207 | — 3 Phase |
| — 1208 | |

- Underground Conductor**
- | Feeder | # of Phases |
|--------|-------------|
| ⋯ 1205 | ⋯ 1 Phase |
| ⋯ 1206 | ⋯ 2 Phase |
| ⋯ 1207 | ⋯ 3 Phase |
| ⋯ 1208 | |

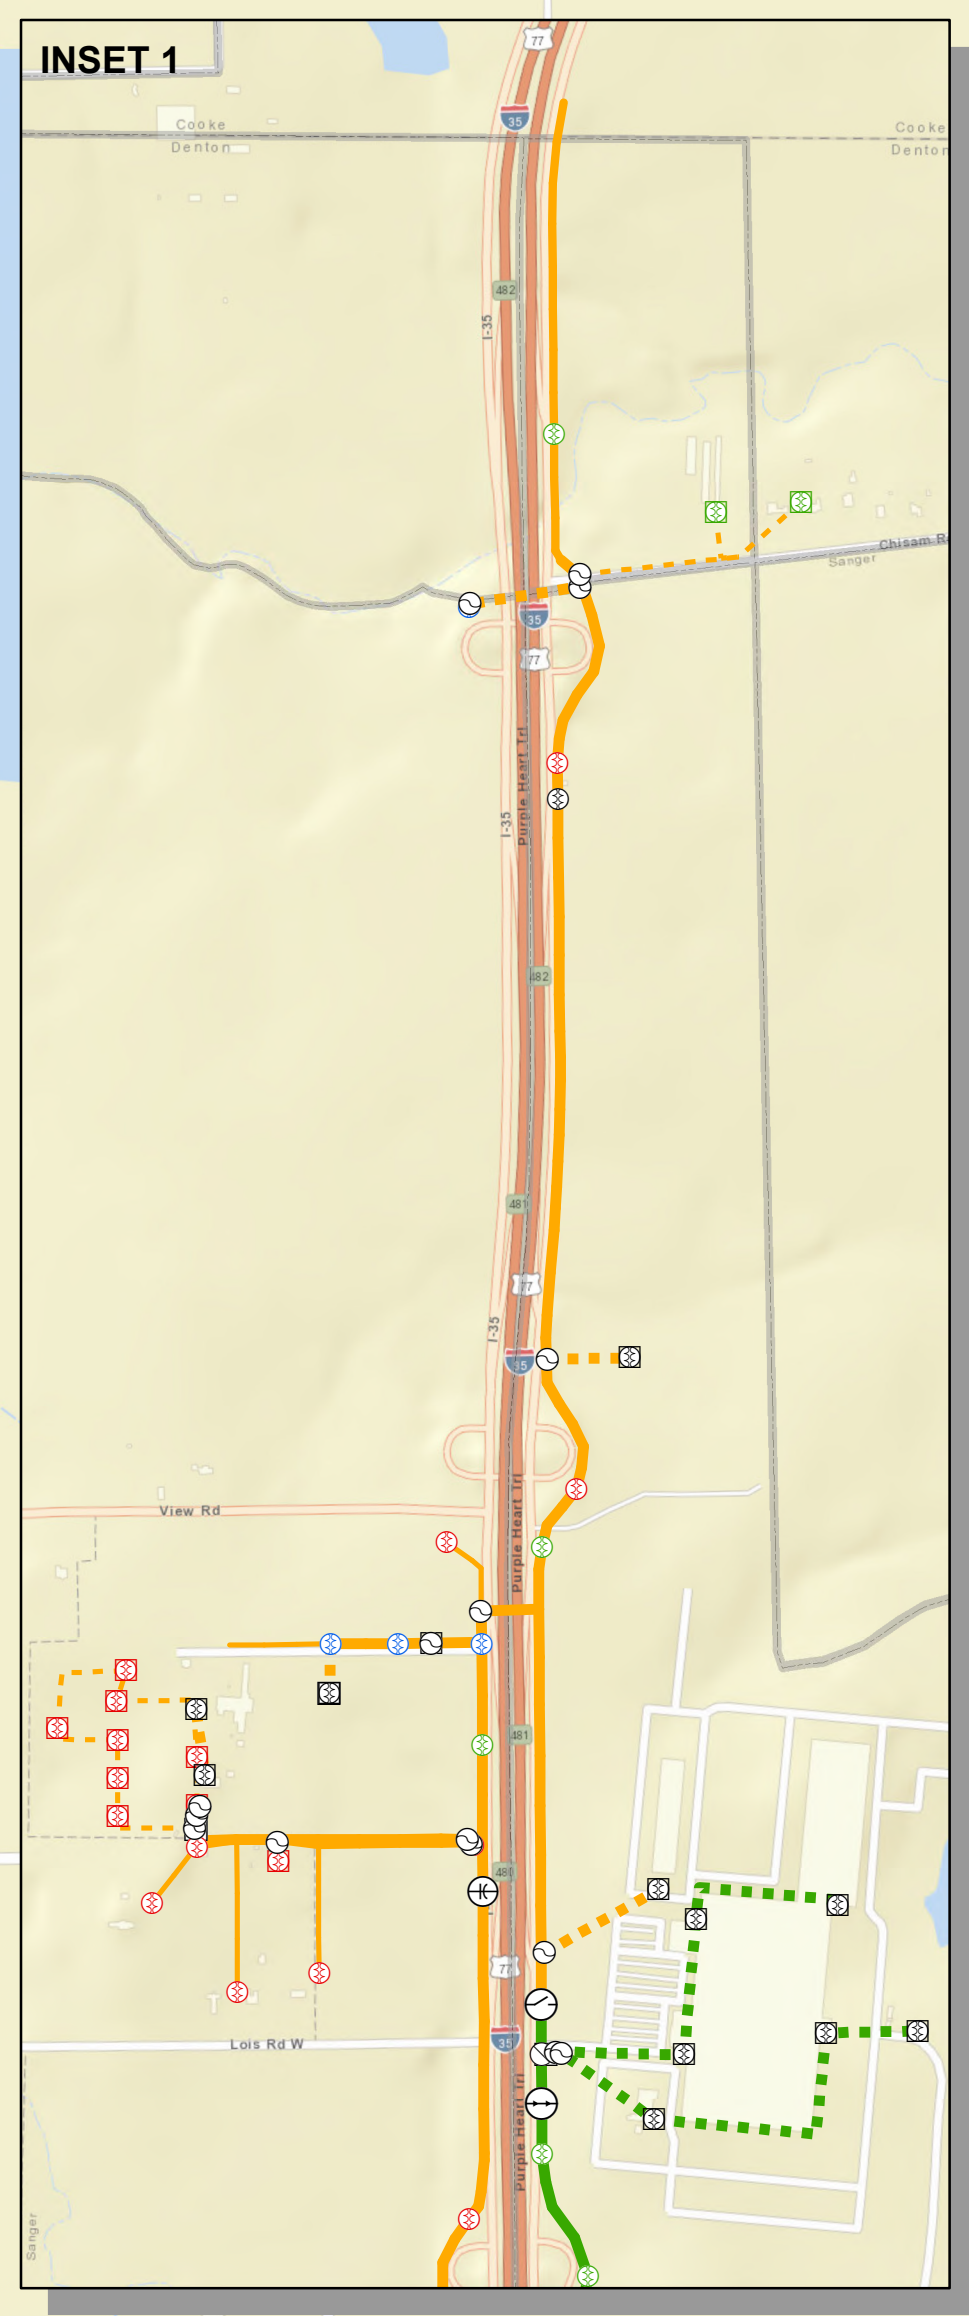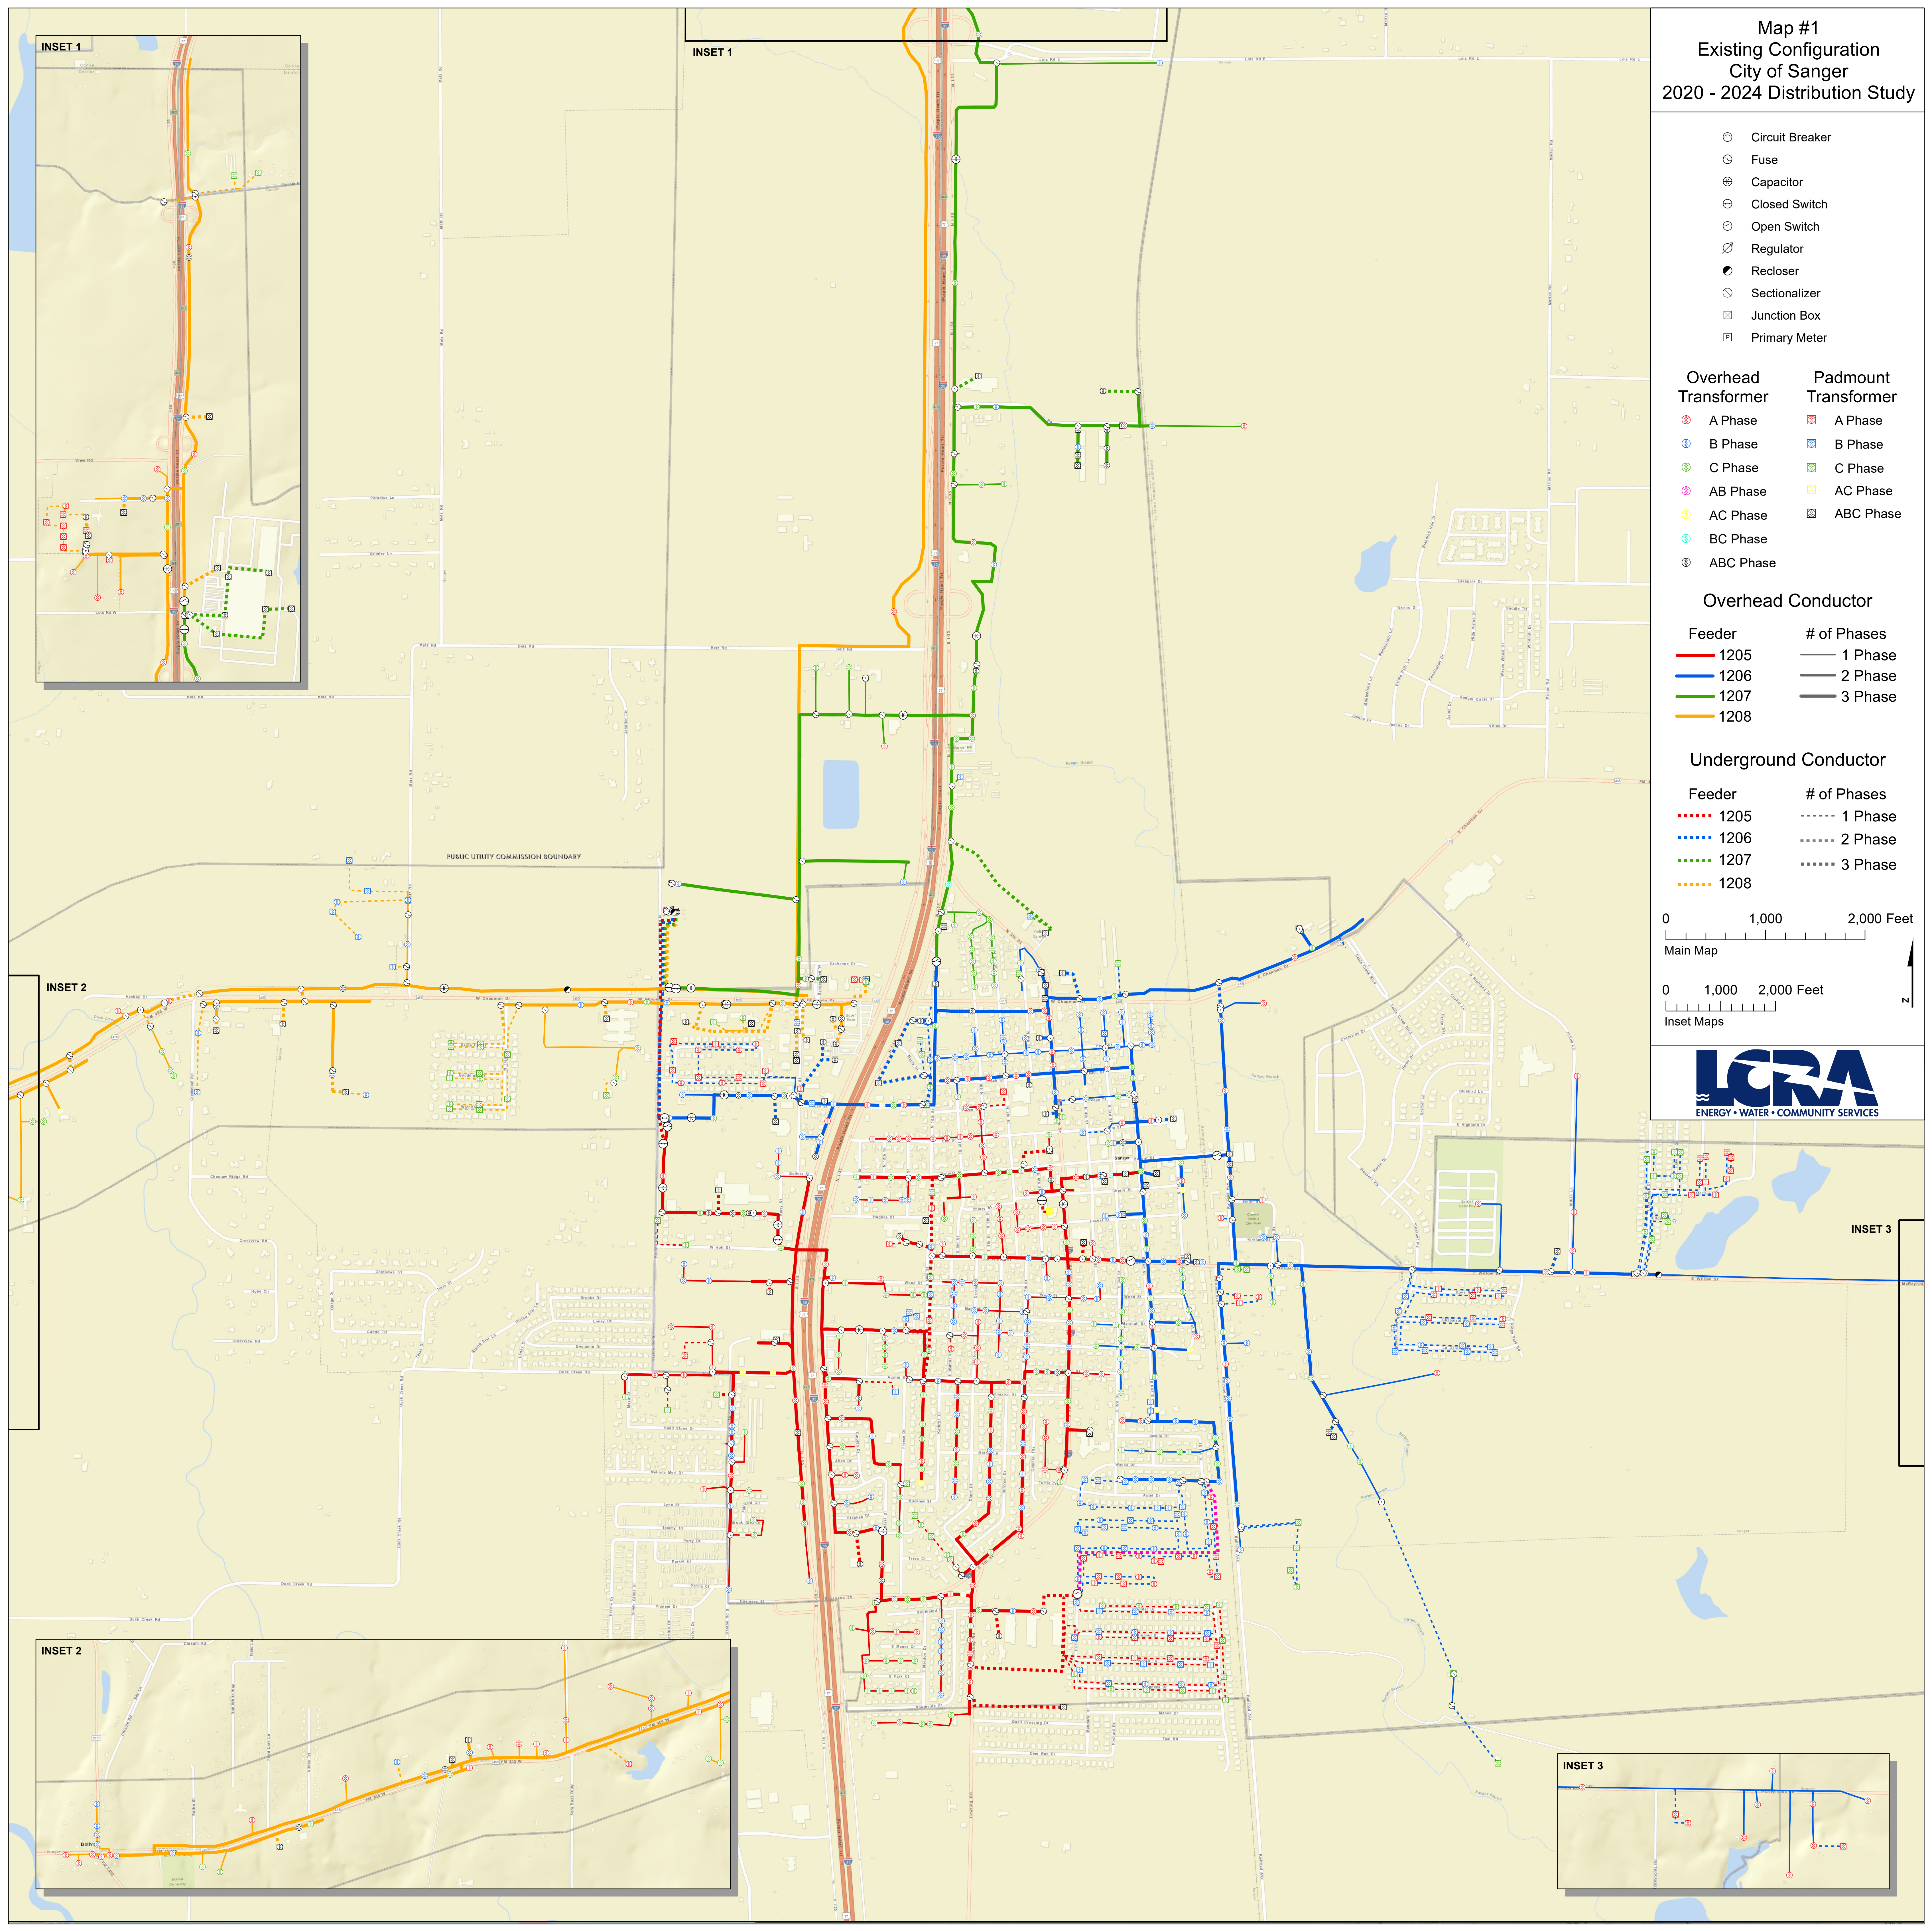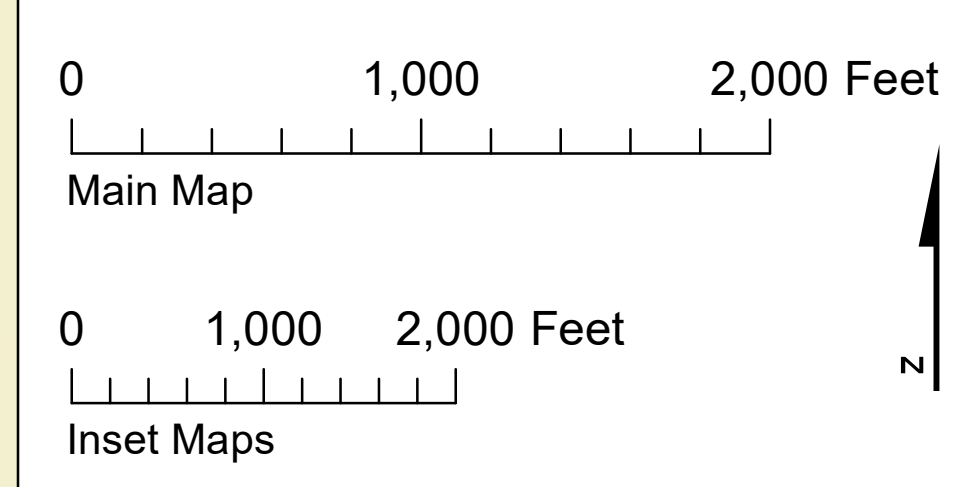

INSET 1

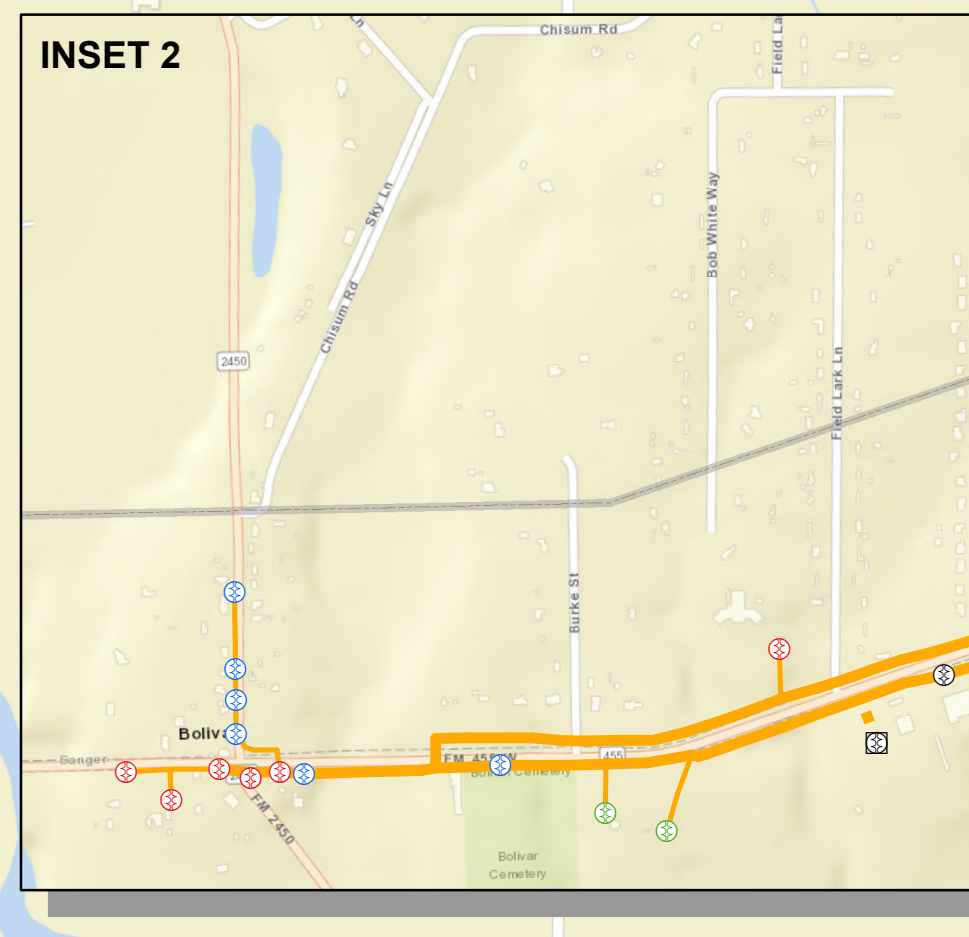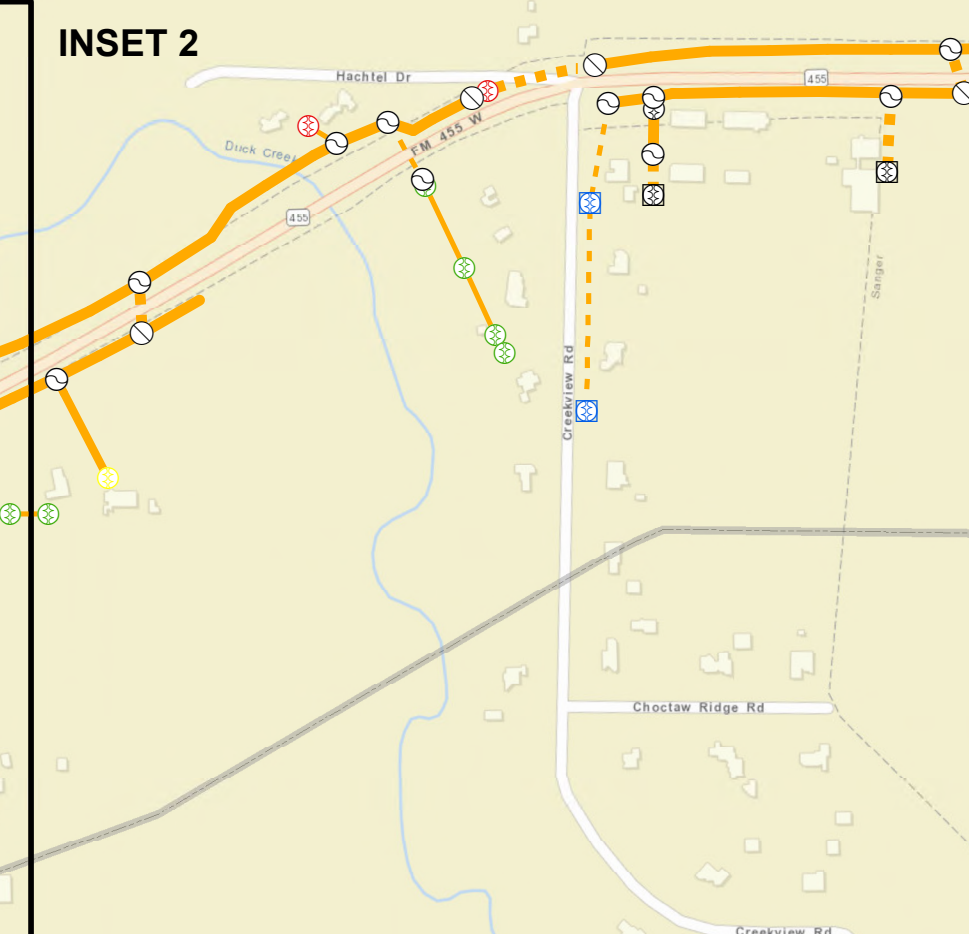

INSET 3

