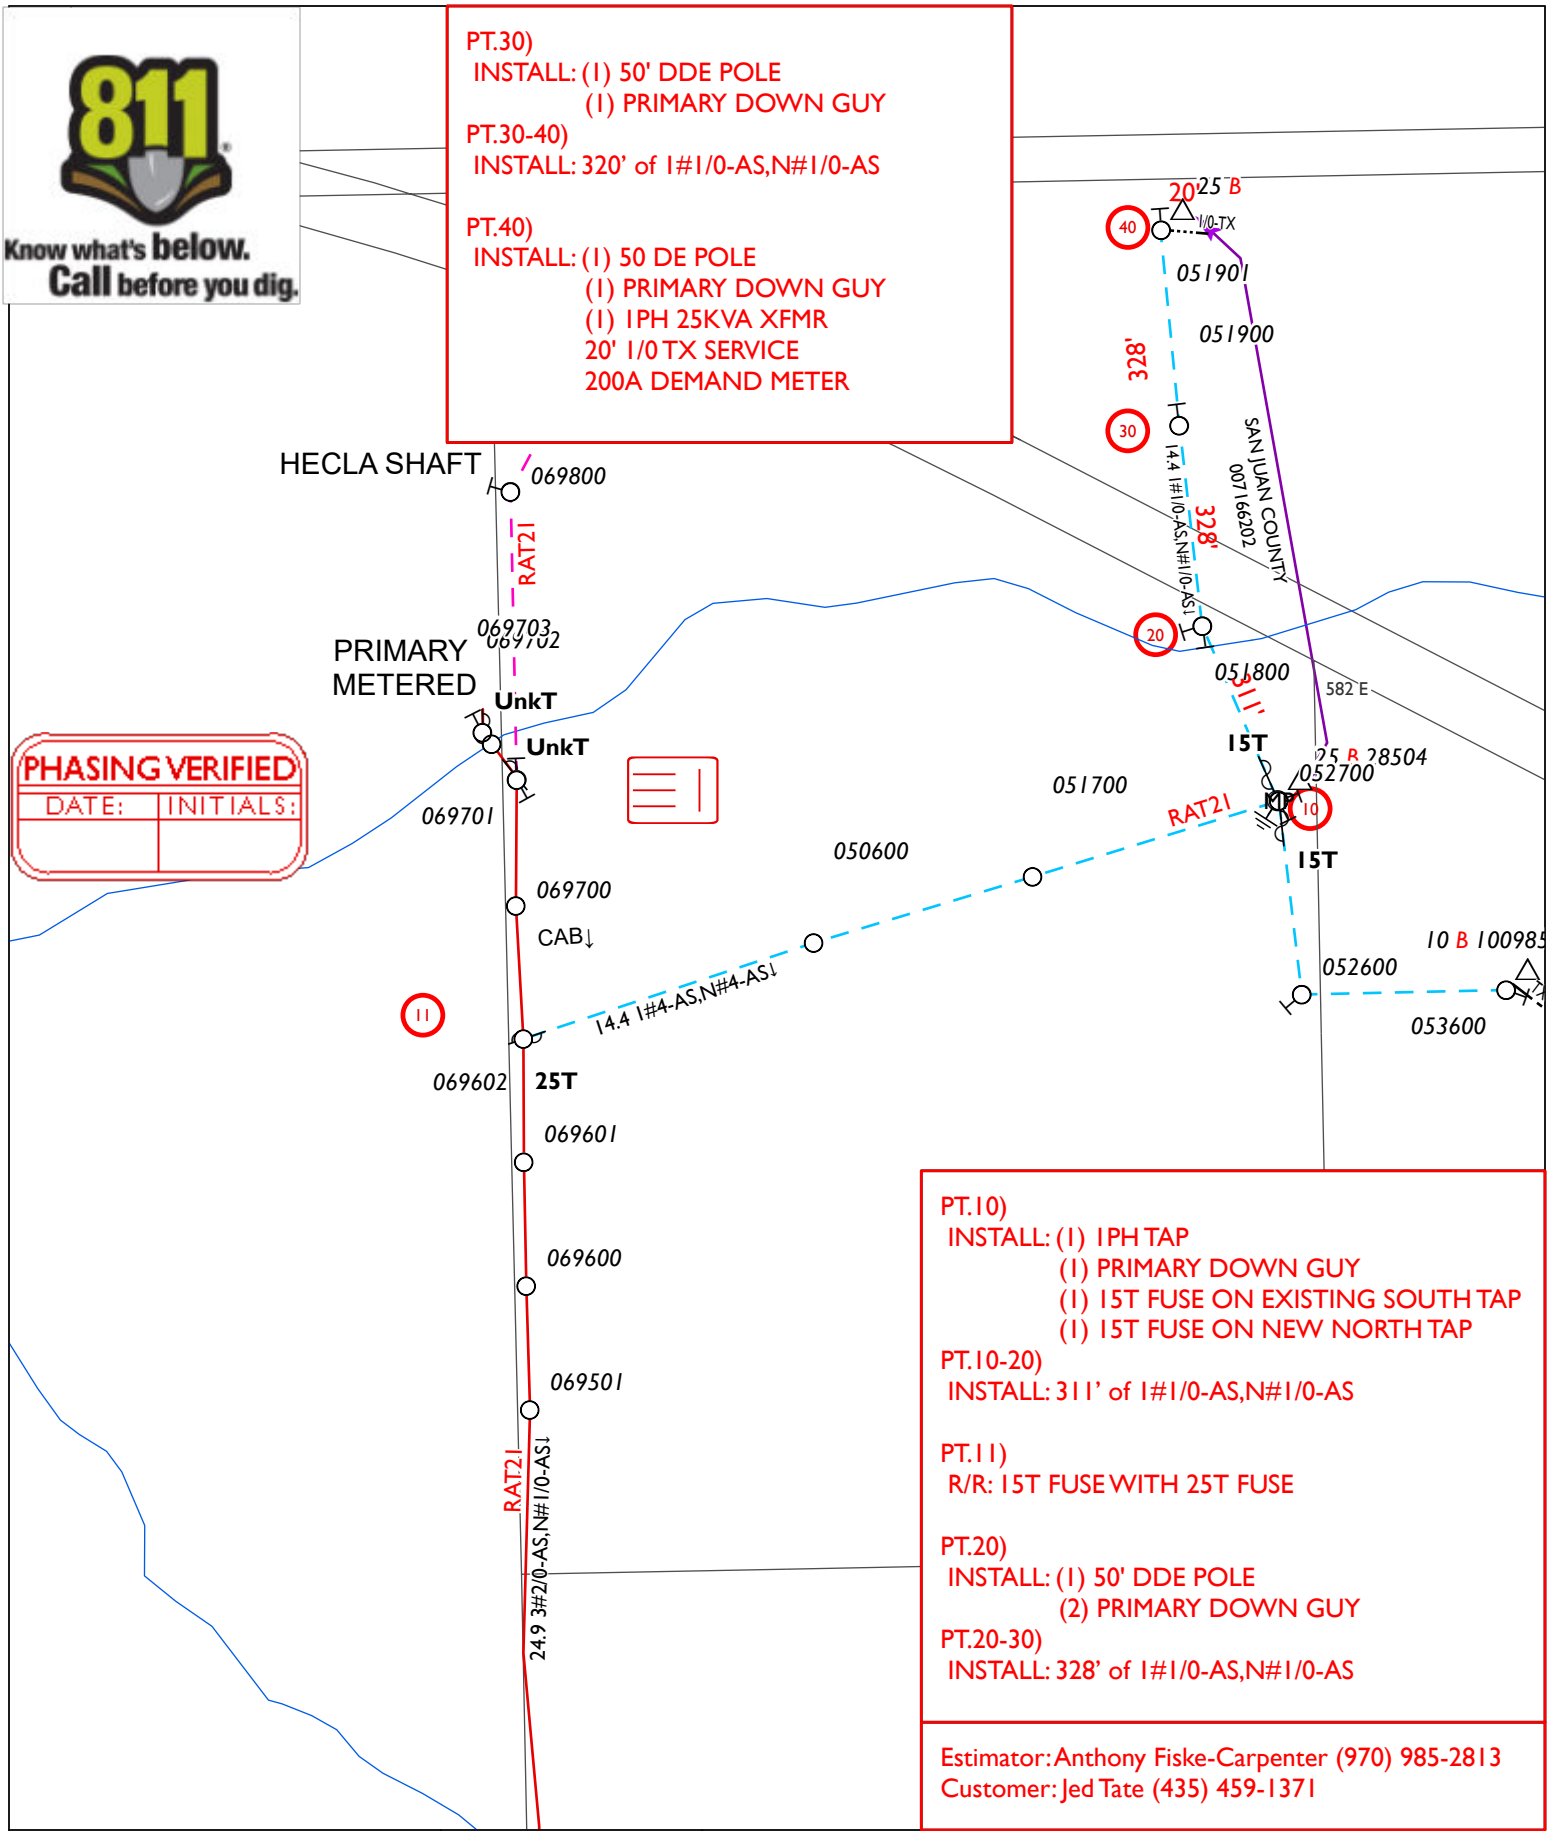
PT.30)
INSTALL: (1) 50' DDE POLE
(1) PRIMARY DOWN GUY
PT.30-40)
INSTALL: 320' of 1#1/0-AS,N#1/0-AS
PT.40)
INSTALL: (1) 50 DE POLE
(1) PRIMARY DOWN GUY
(1) 1PH 25KVA XFMR
20' 1/0 TX SERVICE
200A DEMAND METER
Know what's below. Call before you dig.
811
HECLA SHAFT
069800
RAT21
069703
069702
PRIMARY METERED
UnkT
UnkT
PHASING VERIFIED
DATE:
INITIALS:
069701
069700
CAB↓
069602
25T
069601
069600
069501
RAT21
24.9 3#2/0-AS,N#1/0-AS↓
14.4 1#4-AS,N#4-AS↓
051901
051900
328'
14.4 1#1/0-AS,N#1/0-AS↓
328'
SAN JUAN COUNTY
00716202
051800
311'
582 E
15T
051700
052700
RAT21
15T
050600
052600
053600
PT.10)
INSTALL: (1) 1PH TAP
(1) PRIMARY DOWN GUY
(1) 15T FUSE ON EXISTING SOUTH TAP
(1) 15T FUSE ON NEW NORTH TAP
PT.10-20)
INSTALL: 311' of 1#1/0-AS,N#1/0-AS
PT.11)
R/R: 15T FUSE WITH 25T FUSE
PT.20)
INSTALL: (1) 50' DDE POLE
(2) PRIMARY DOWN GUY
PT.20-30)
INSTALL: 328' of 1#1/0-AS,N#1/0-AS
Estimator: Anthony Fiske-Carpenter (970) 985-2813
Customer: Jed Tate (435) 459-1371
Foreman
Emp #
Job Start Date
CC# 11406
WO# / REQ# 007166202
Map String 11429024.0
Job Comp Date
N W E S
PACIFICORP
A BERKSHIRE HATHAWAY ENERGY COMPANY
Page 1 of 1
Customer: san juan county
Address: 9 LA SAL TRANSFER STATION RD, LA SAL, UT 84530
Circuit RAT21
Post Jobs
RQII
Posted
EST ID# P61559
Print Date 1/3/2024
Scale 1 in = 313'