

EXTERIOR CAMERA SYMBOL			
CAMERA NUMBER # AND SYMBOL	CAMERAS	PART NUMBER	QTY
(11)	AXIS P3265-LV	0237-001	11
(12)	AXIS P3738-PL	02635-001	11

Note: SEE SPECIFICATION SECTION 26 05 01 FOR MORE INFORMATION. PROVIDE ALL HARDWARE AS NEEDED.



4
E1.0 EXTERIOR CAMERA SCHEDULE
SCALE: NTS

SECURITY CAMERA KEY PLAN	
(11)	SECURITY CAMERA - DIRECTIONAL - LINES REPRESENT WALL OR POLE MOUNTED NO LINES REPRESENT CEILING MOUNTED (TYPICAL)
(12)	SECURITY CAMERA - 90°
(13)	SECURITY CAMERA - 180°
(14)	SECURITY CAMERA - 270°
(15)	SECURITY CAMERA - 360°

- GENERAL NOTES**
- UNLESS SHOWN OTHERWISE, ALL WIRING SHOWN IS (2)#10 AND #10 GROUND IN 1" PVC.
 - INSTALL PULL CORD IN ALL EMPTY CONDUITS.
 - PROVIDE CONCRETE BASE ROUGH-IN FIXTURES PER DETAIL 3/E1.0.
 - UNLESS SHOWN OTHERWISE, ALL CONDUITS BURIED 2'-6" BELOW FINISHED GRADE.
 - BRING SITE EXCAVATION AND TOPPING BACK TO ORIGINAL CONDITION IF TRENCHING IS DONE ON COMPACTED SURFACES.
 - ALL CONDUITS STUBBED OUT OF BUILDINGS SHALL BE DONE PER DETAIL 3/E6.0.
 - FOR EXTERIOR CAMERA INSTALLATION, SEE DETAIL 4/E4.4.
 - FOR EXTERIOR CAMERA SCHEDULE, SEE DETAIL 4/E1.0 FOR TYPE AND PART NUMBER.

PLAN NOTES


- CONTROL THROUGH BAS SYSTEM. ROUTE THROUGH RELAY PER DETAIL 3/E6.1.
- PROVIDE 3" CONCRETE POLE BASE PER DETAIL 3/E1.0.
- PROVIDE ELECTRICAL CONNECTION TO DIGITAL SIGN. CONFIRM LOCATION AND REQUIREMENTS WITH OWNER.
- TYPICAL LIGHT DISTRIBUTION OF 0.5 FOOT CANDLES. TYPICAL FOR ALL LIGHT FIXTURES OF THIS TYPE.
- EXISTING FLAG POLE TO REMAIN. FOR INSTALLATION OF NEW FLAG POLE LIGHTING SEE DETAIL 7/E6.1.
- LOCATE TYPE FP FIXTURE IN GRASS AREA. ADJUST FIXTURE TO LIGHT UP FLAG POLE. PROVIDE CONCRETE BASE PER DETAIL 9/E5.1.
- WIRE USING 2#10, #10 GND IN 1" PVC.
- WALL MOUNT CAMERA AT ELEVATION OF 112'-0" TO CENTER.

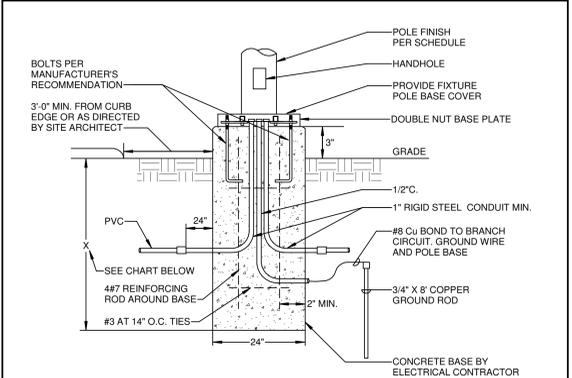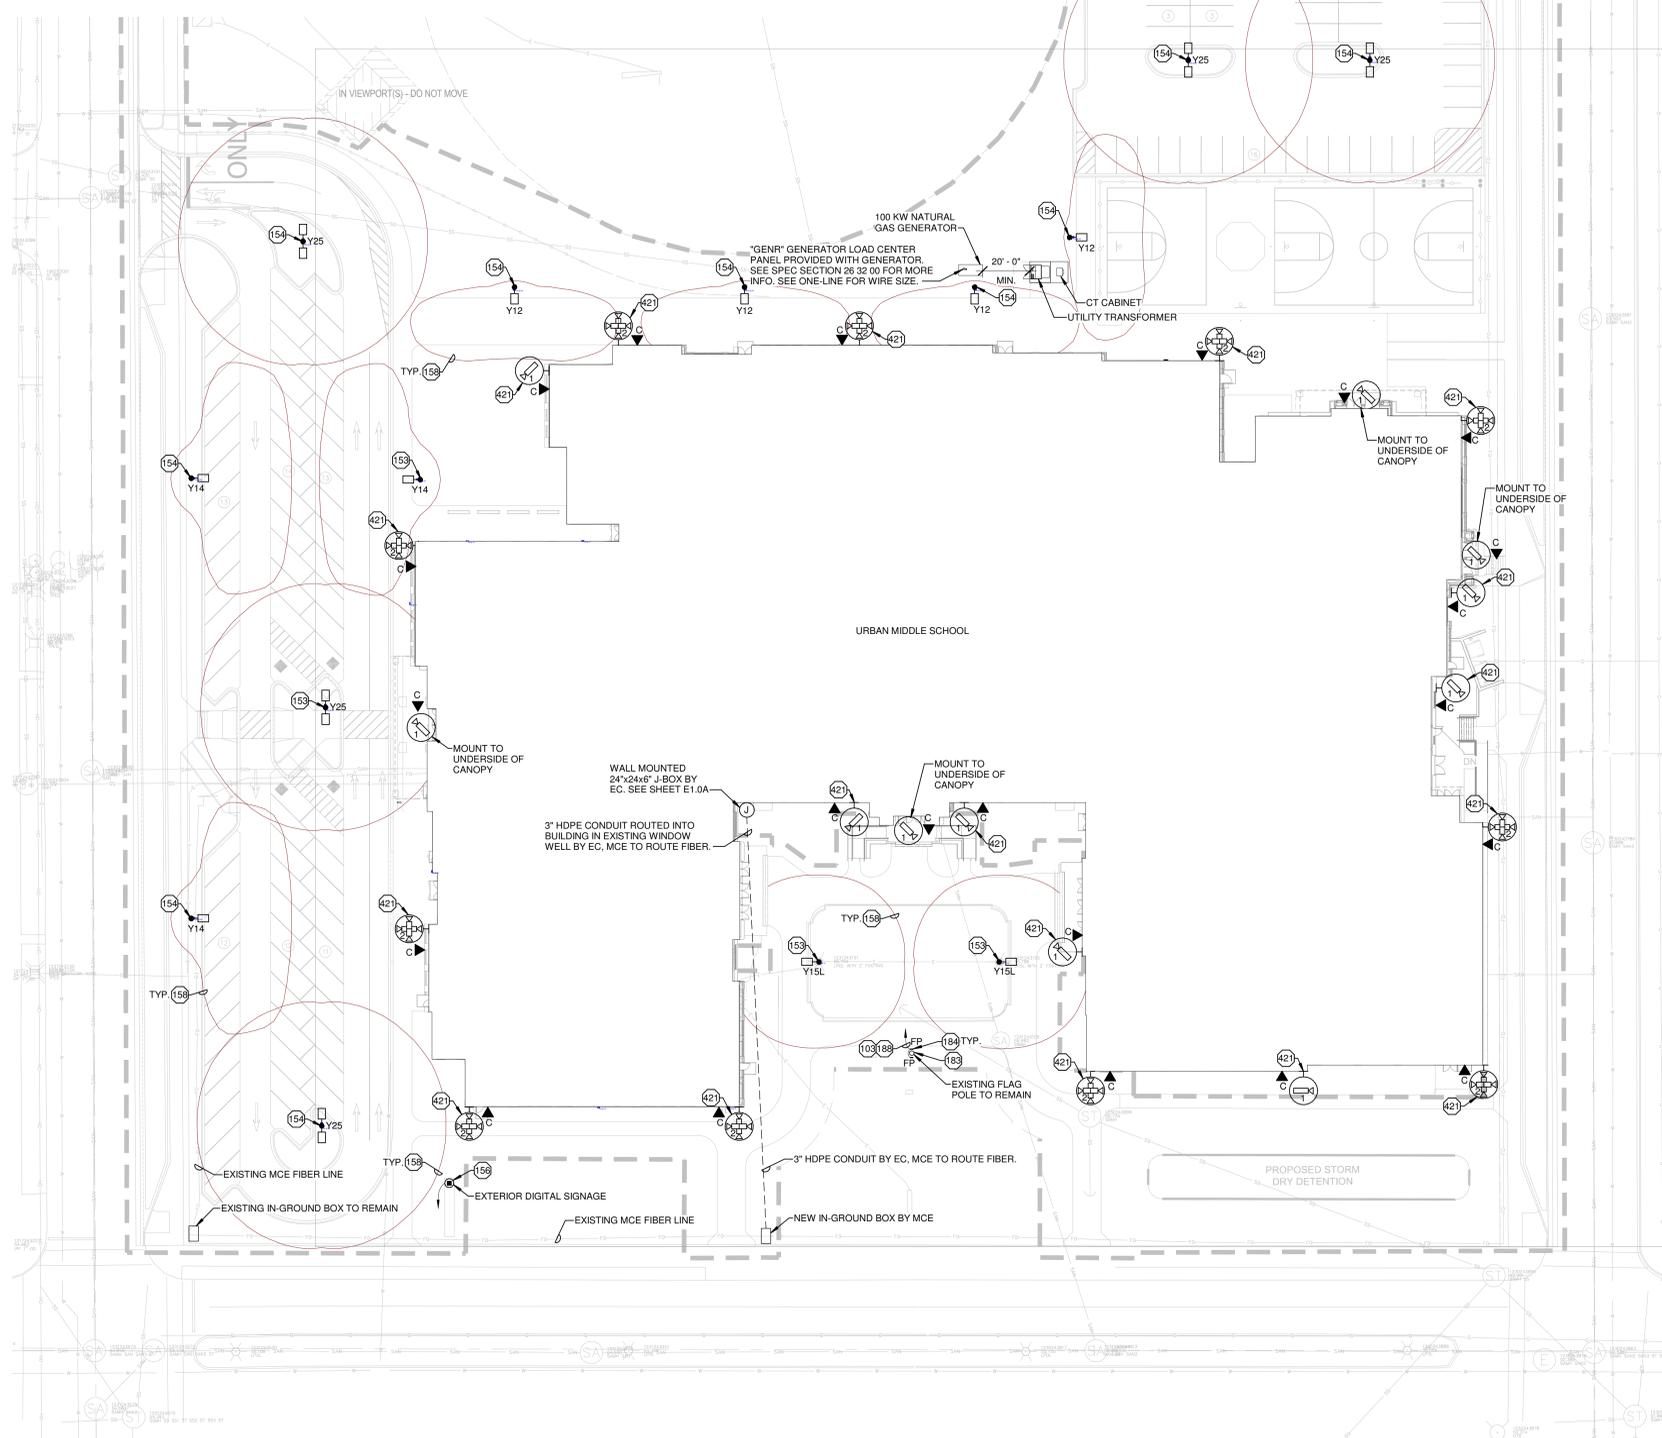

- NOTES:**
- IN UNDISTURBED EARTH, EXCLUDING FILL MATERIAL, A 2'-0" DIA. HOLE WHICH SHALL BE USED AS THE FORM FOR THE CONCRETE BASE SHALL BE DRILLED.
 - IN EXCAVATED AREAS OR IN EXISTING SOIL CONTAINING FILL OF OBJECTIONABLE MATERIAL BACKFILL AROUND CONCRETE BASE WITH COMPACTED GRANULAR BACKFILL A MIN. OF 2'-0" IN ALL DIRECTIONS.

POLE HEIGHT IN FEET	BASE DEPTH IN INCHES BELOW GRADE
10'-0"	X = 60" (INCHES)
15'-0"	X = 60" (INCHES)
20'-0"	X = 60" (INCHES)
25'-0"	X = 72" (INCHES)
30'-0"	X = 72" (INCHES)
35'-0"	X = 72" (INCHES)
40'-0"	X = 96" (INCHES)
45'-0"	X = 96" (INCHES)
50'-0"	X = 108" (INCHES)

3
E1.0 3" EXTERIOR LIGHTING CONCRETE BASE DETAIL
SCALE: NTS

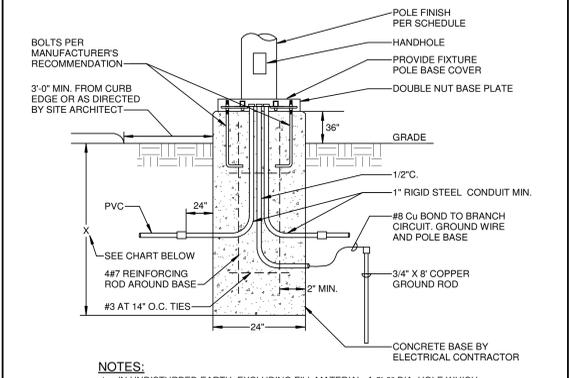


- NOTES:**
- IN UNDISTURBED EARTH, EXCLUDING FILL MATERIAL, A 2'-0" DIA. HOLE WHICH SHALL BE USED AS THE FORM FOR THE CONCRETE BASE SHALL BE DRILLED.
 - IN EXCAVATED AREAS OR IN EXISTING SOIL CONTAINING FILL OF OBJECTIONABLE MATERIAL BACKFILL AROUND CONCRETE BASE WITH COMPACTED GRANULAR BACKFILL A MIN. OF 2'-0" IN ALL DIRECTIONS.

POLE HEIGHT IN FEET	BASE DEPTH IN INCHES BELOW GRADE
10'-0"	X = 60" (INCHES)
15'-0"	X = 60" (INCHES)
20'-0"	X = 60" (INCHES)
25'-0"	X = 72" (INCHES)
30'-0"	X = 72" (INCHES)
35'-0"	X = 72" (INCHES)
40'-0"	X = 96" (INCHES)
45'-0"	X = 96" (INCHES)
50'-0"	X = 108" (INCHES)

2
E1.0 36" EXTERIOR LIGHTING CONCRETE BASE DETAIL
SCALE: NTS

1
E1.0 ELECTRICAL SITE PLAN - NEW
Scale: 1" = 30'-0"

Autodesk Docs:3415 - Sheboygan ASD\00377213 Urban MS Elec R25.rvt
 11/15/2026 12:26:50 PM

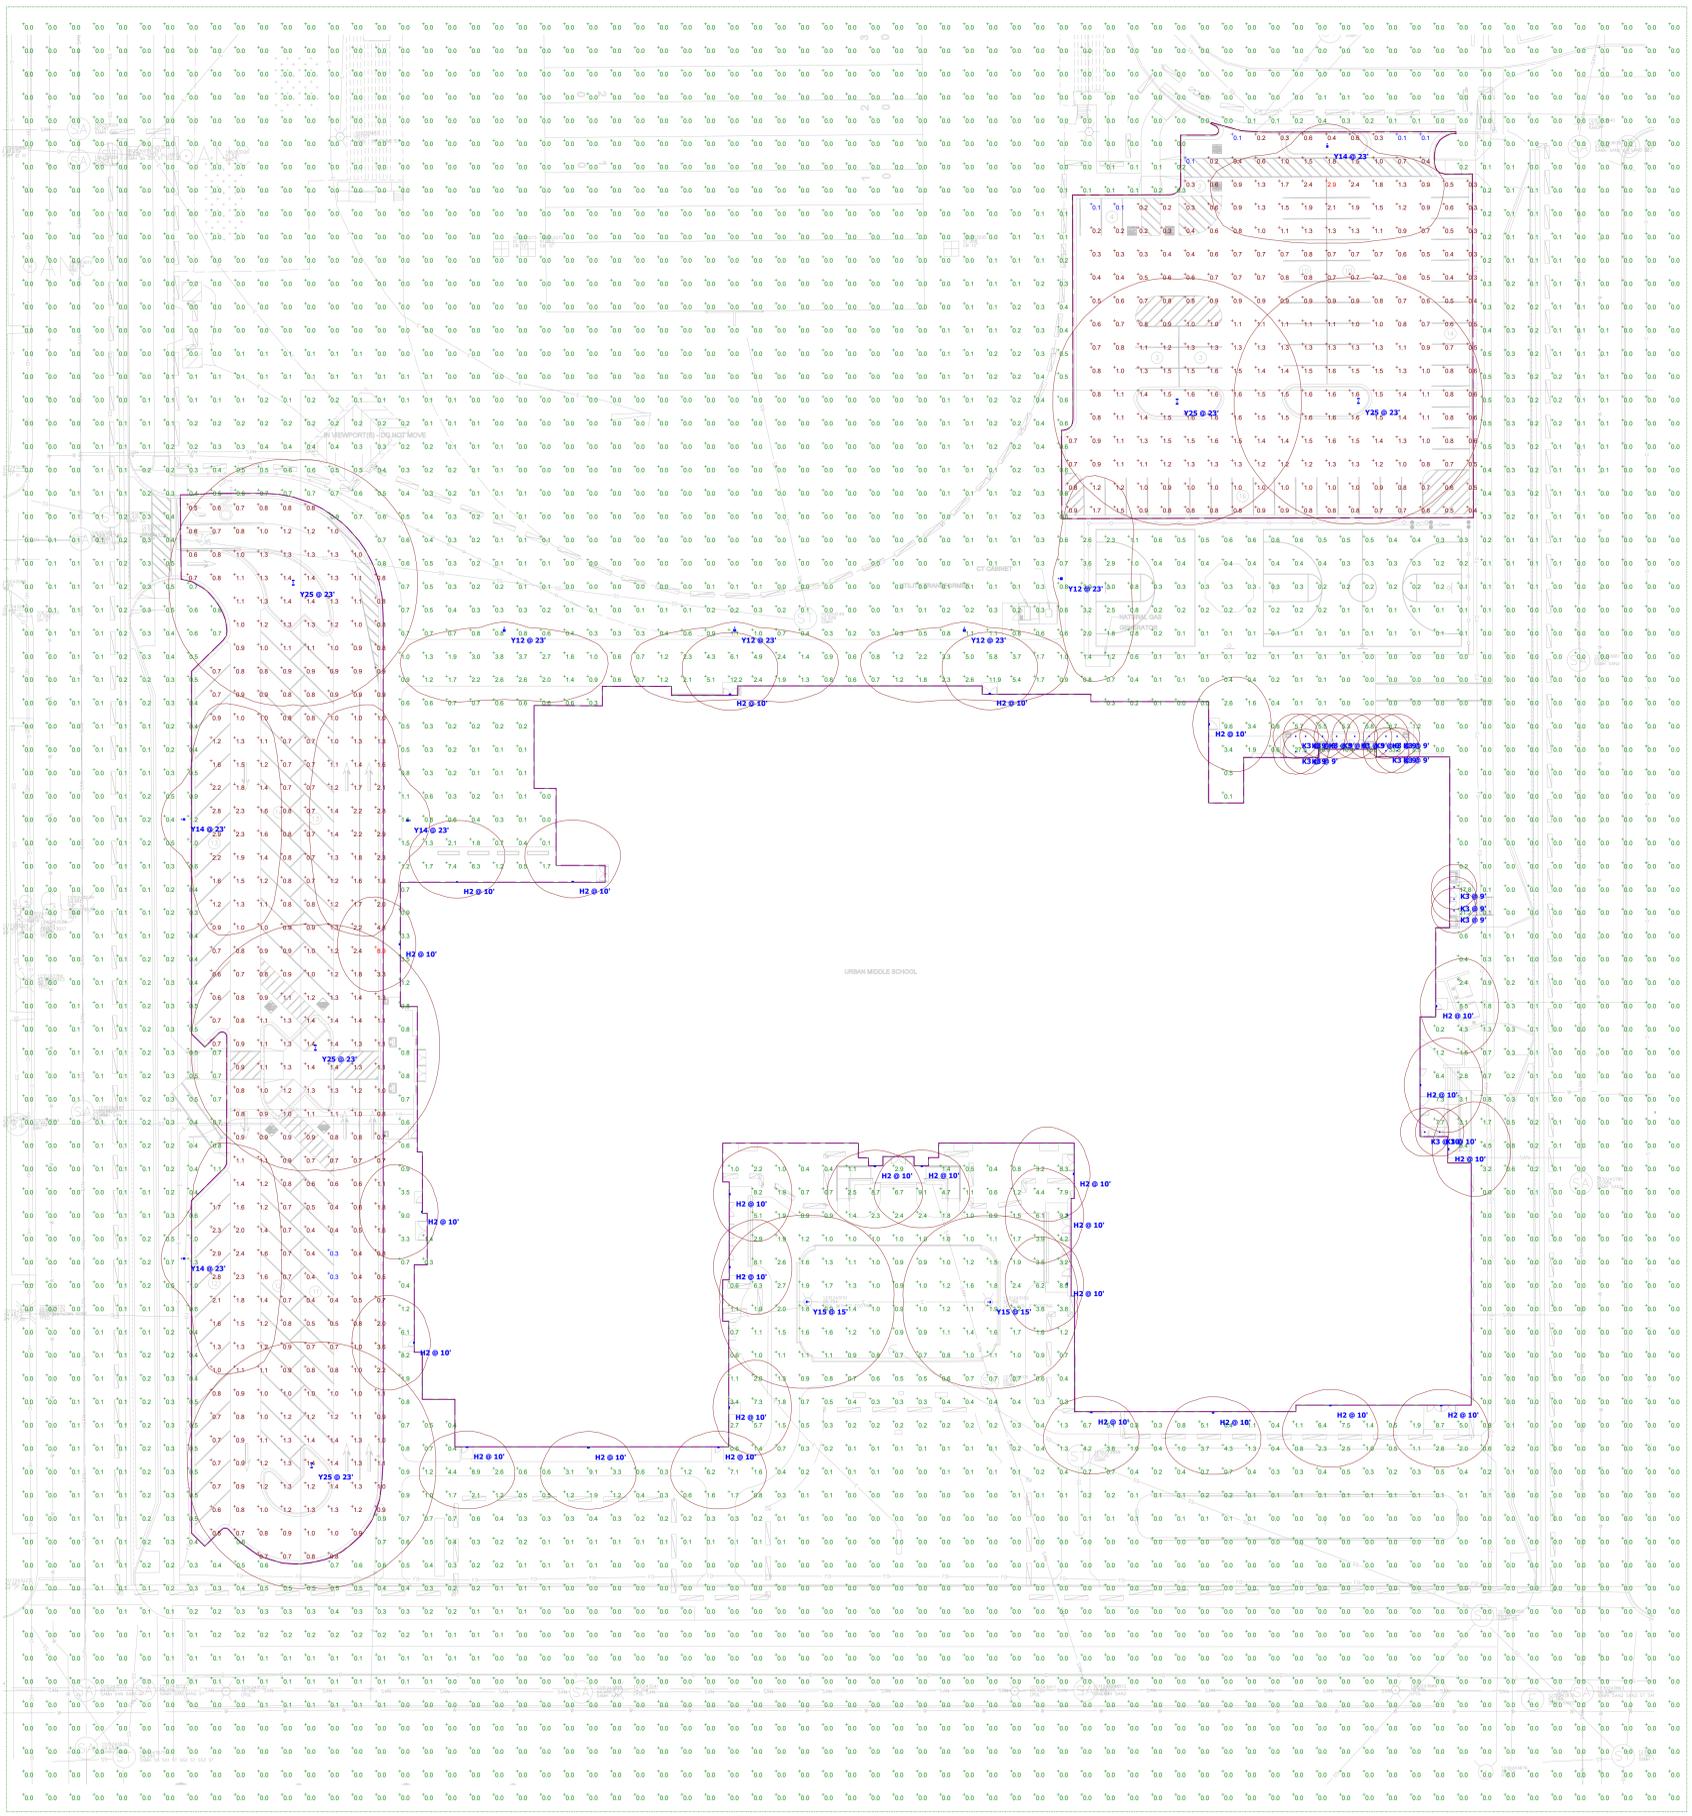

Plan View
 Scale: 1" = 30ft

Symbol	Label	Image	Quantity	Manufacturer	Catalog Number	Description	Number Lamps	Lumens Per Lamp	Light Loss Factor	Wattage
□	Y12		4	Lithonia Lighting	RSX1 LED P1 50K R2 HS	RSX LED Area Luminaire Size 1 P1 Lumen Package 5000K CCT Type R2 Distribution with HS shield	1	5384	0.9	51.34
□	Y13		0	Lithonia Lighting	RSX1 LED P4 50K R3 HS	RSX LED Area Luminaire Size 1 P4 Lumen Package 5000K CCT Type R3 Distribution with HS shield	1	11482	0.9	133.14
□	Y15		2	Lithonia Lighting	RSX1 LED P1 50K R5	RSX Area Fixture Size 1 P1 Lumen Package 5000K CCT Type R5 Distribution	1	7285	0.9	51.34
□	Y25		5	Lithonia Lighting	RSX1 LED P1 50K R5	RSX Area Fixture Size 1 P1 Lumen Package 5000K CCT Type R5 Distribution	1	7285	0.9	102.68
□	H2		26	Lithonia Lighting	ARC2 LED P3 50K	ARC2 LED WITH P3 - PERFORMANCE PACKAGE, 5000K	1	3410	0.9	23.7345
○	K3		17	Lithonia Lighting	LR6 AL01 (750LM) 30W1 (5000K) AR LSS MWD 80CRI	LR6 Retrofit 750LM 5000K Clear Semi-Specular Medium Wide 80CRI	1	957	1.35	9.06

Statistics						
Description	Symbol	Avg	Max	Min	Max/Min	Avg/Min
NORTH PARKING LOT	+	1.0 fc	2.9 fc	0.1 fc	29.0:1	10.0:1
SITE	+	0.3 fc	33.8 fc	0.0 fc	N/A	N/A
WEST PARKING LOT	+	1.2 fc	8.9 fc	0.3 fc	29.7:1	4.0:1