



LEGEND

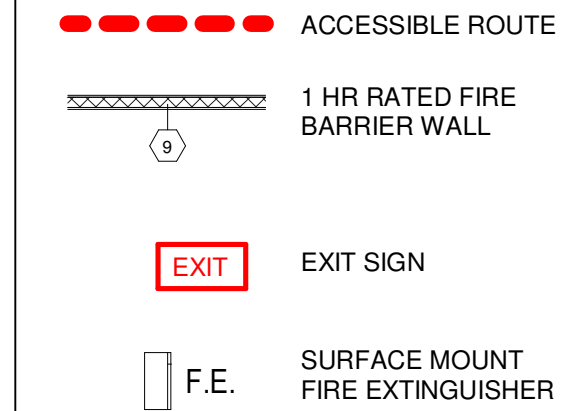

OCCUPANCY LOAD

MAIN FLOOR	96
UPPER FLOOR	100
TOTAL	196 PATRONS

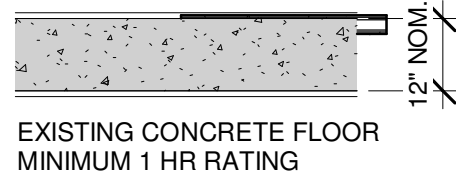

OCCUPANCY LOAD CHART - 15 SF/PP MAIN FLOOR

Level	TAG	ROOM	Area	Occupancy/15 sf	Designed Occupant Load	Travel Dist.LF
MAIN FLOOR LEVEL	101	TRASH/RECYCLE	87 SF	6	6	75
MAIN FLOOR LEVEL	114	MENS	131 SF	9	3	51
MAIN FLOOR LEVEL	118	WOMENS	133 SF	9	3	45
MAIN FLOOR LEVEL	119	MECH	85 SF	6	2	65
MAIN FLOOR LEVEL	120	STORAGE	42 SF	3	1	75
MAIN FLOOR LEVEL	121	COOLER	39 SF	2	2	70
MAIN FLOOR LEVEL	122	LIFT	29 SF	2	2	65
MAIN FLOOR LEVEL	124	CUST.	41 SF	1	1	34
MAIN FLOOR LEVEL	125	KITCHEN	224 SF	15	5	28
MAIN FLOOR LEVEL	126	BAR / MAIN DINING	1505 SF	104	70	32 OR 27
MAIN FLOOR LEVEL	132	OUTDOOR SEATING	914 SF	N/A	0	N/A
MAIN FLOOR LEVEL	133	OUTDOOR STORAGE	169 SF	N/A	0	N/A
MAIN FLOOR LEVEL	135	BAR STORAGE	140 SF	8	1	57
MAIN FLOOR LEVEL	142	WAIT STATION	37 SF	2	2	20

OCCUPANCY LOAD CHART - 15 SF/PP SECOND FLOOR

Level	Tag	Room	Area	Occupancy/15 sf	Designed Occupant Load	Travel Distance
UPPER LEVEL	202	MECH	65 SF	4	2	32
UPPER LEVEL	203	MENS	128 SF	9	3	37
UPPER LEVEL	204	WOMENS	131 SF	9	3	46
UPPER LEVEL	205	BAR	173 SF	11	9	53
UPPER LEVEL	206	UPPER DINING	1592 SF	124	60	98
UPPER LEVEL	207	KARAOKE	152 SF	10	6	60
UPPER LEVEL	208	KARAOKE	152 SF	10	6	50
UPPER LEVEL	209	KARAOKE	134 SF	9	6	41
UPPER LEVEL	210	WAIT STATION	81 SF	15	2	40
UPPER LEVEL	211	LIFT	33 SF	2	2	15
UPPER LEVEL	212	A.O.R.	14 SF	1	1	4

2 UPPER LEVEL LIFE SAFETY PLAN
3/16" = 1'-0"



1 MAIN LEVEL LIFE SAFETY PLAN
3/16" = 1'-0"

REVISION DATE
DEC 31, 2025


SEARD
723 NEW YORK AVE
SHEBOYAN, WI 53081

A100


DATE DEC 31, 2025
PROJECT NUMBER
DRAWN BY
CHECKED BY
Copyright 2025

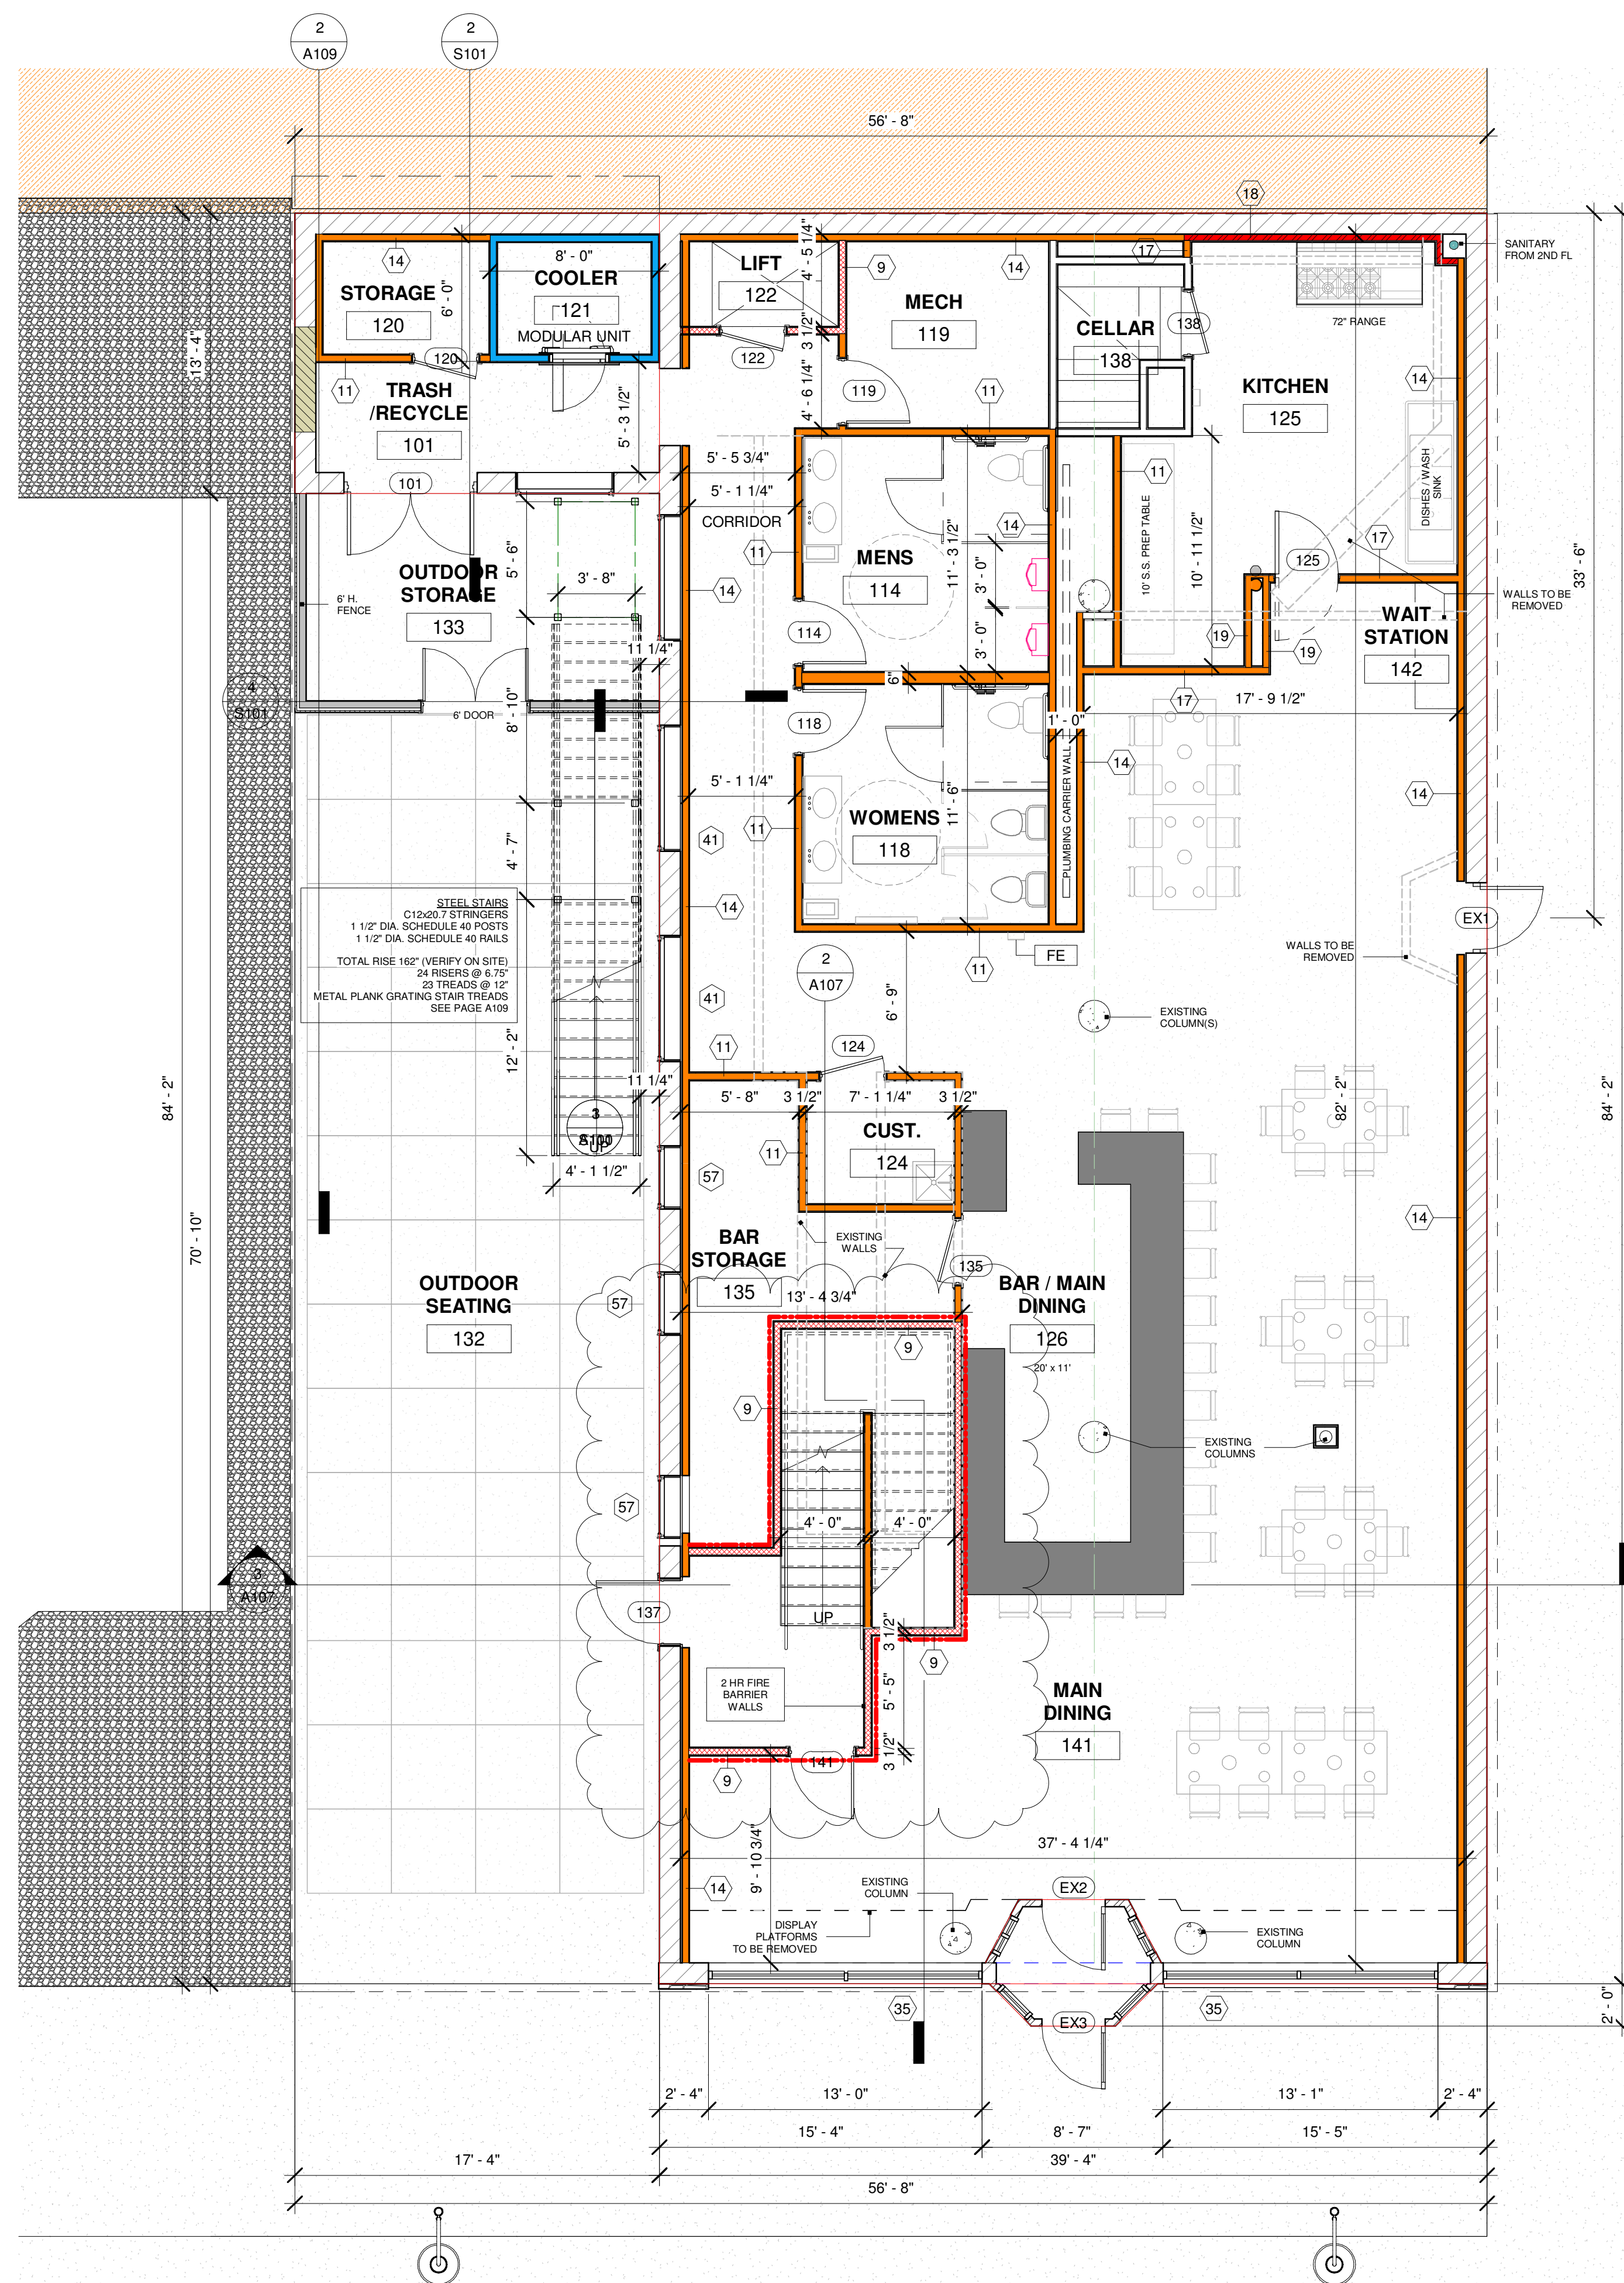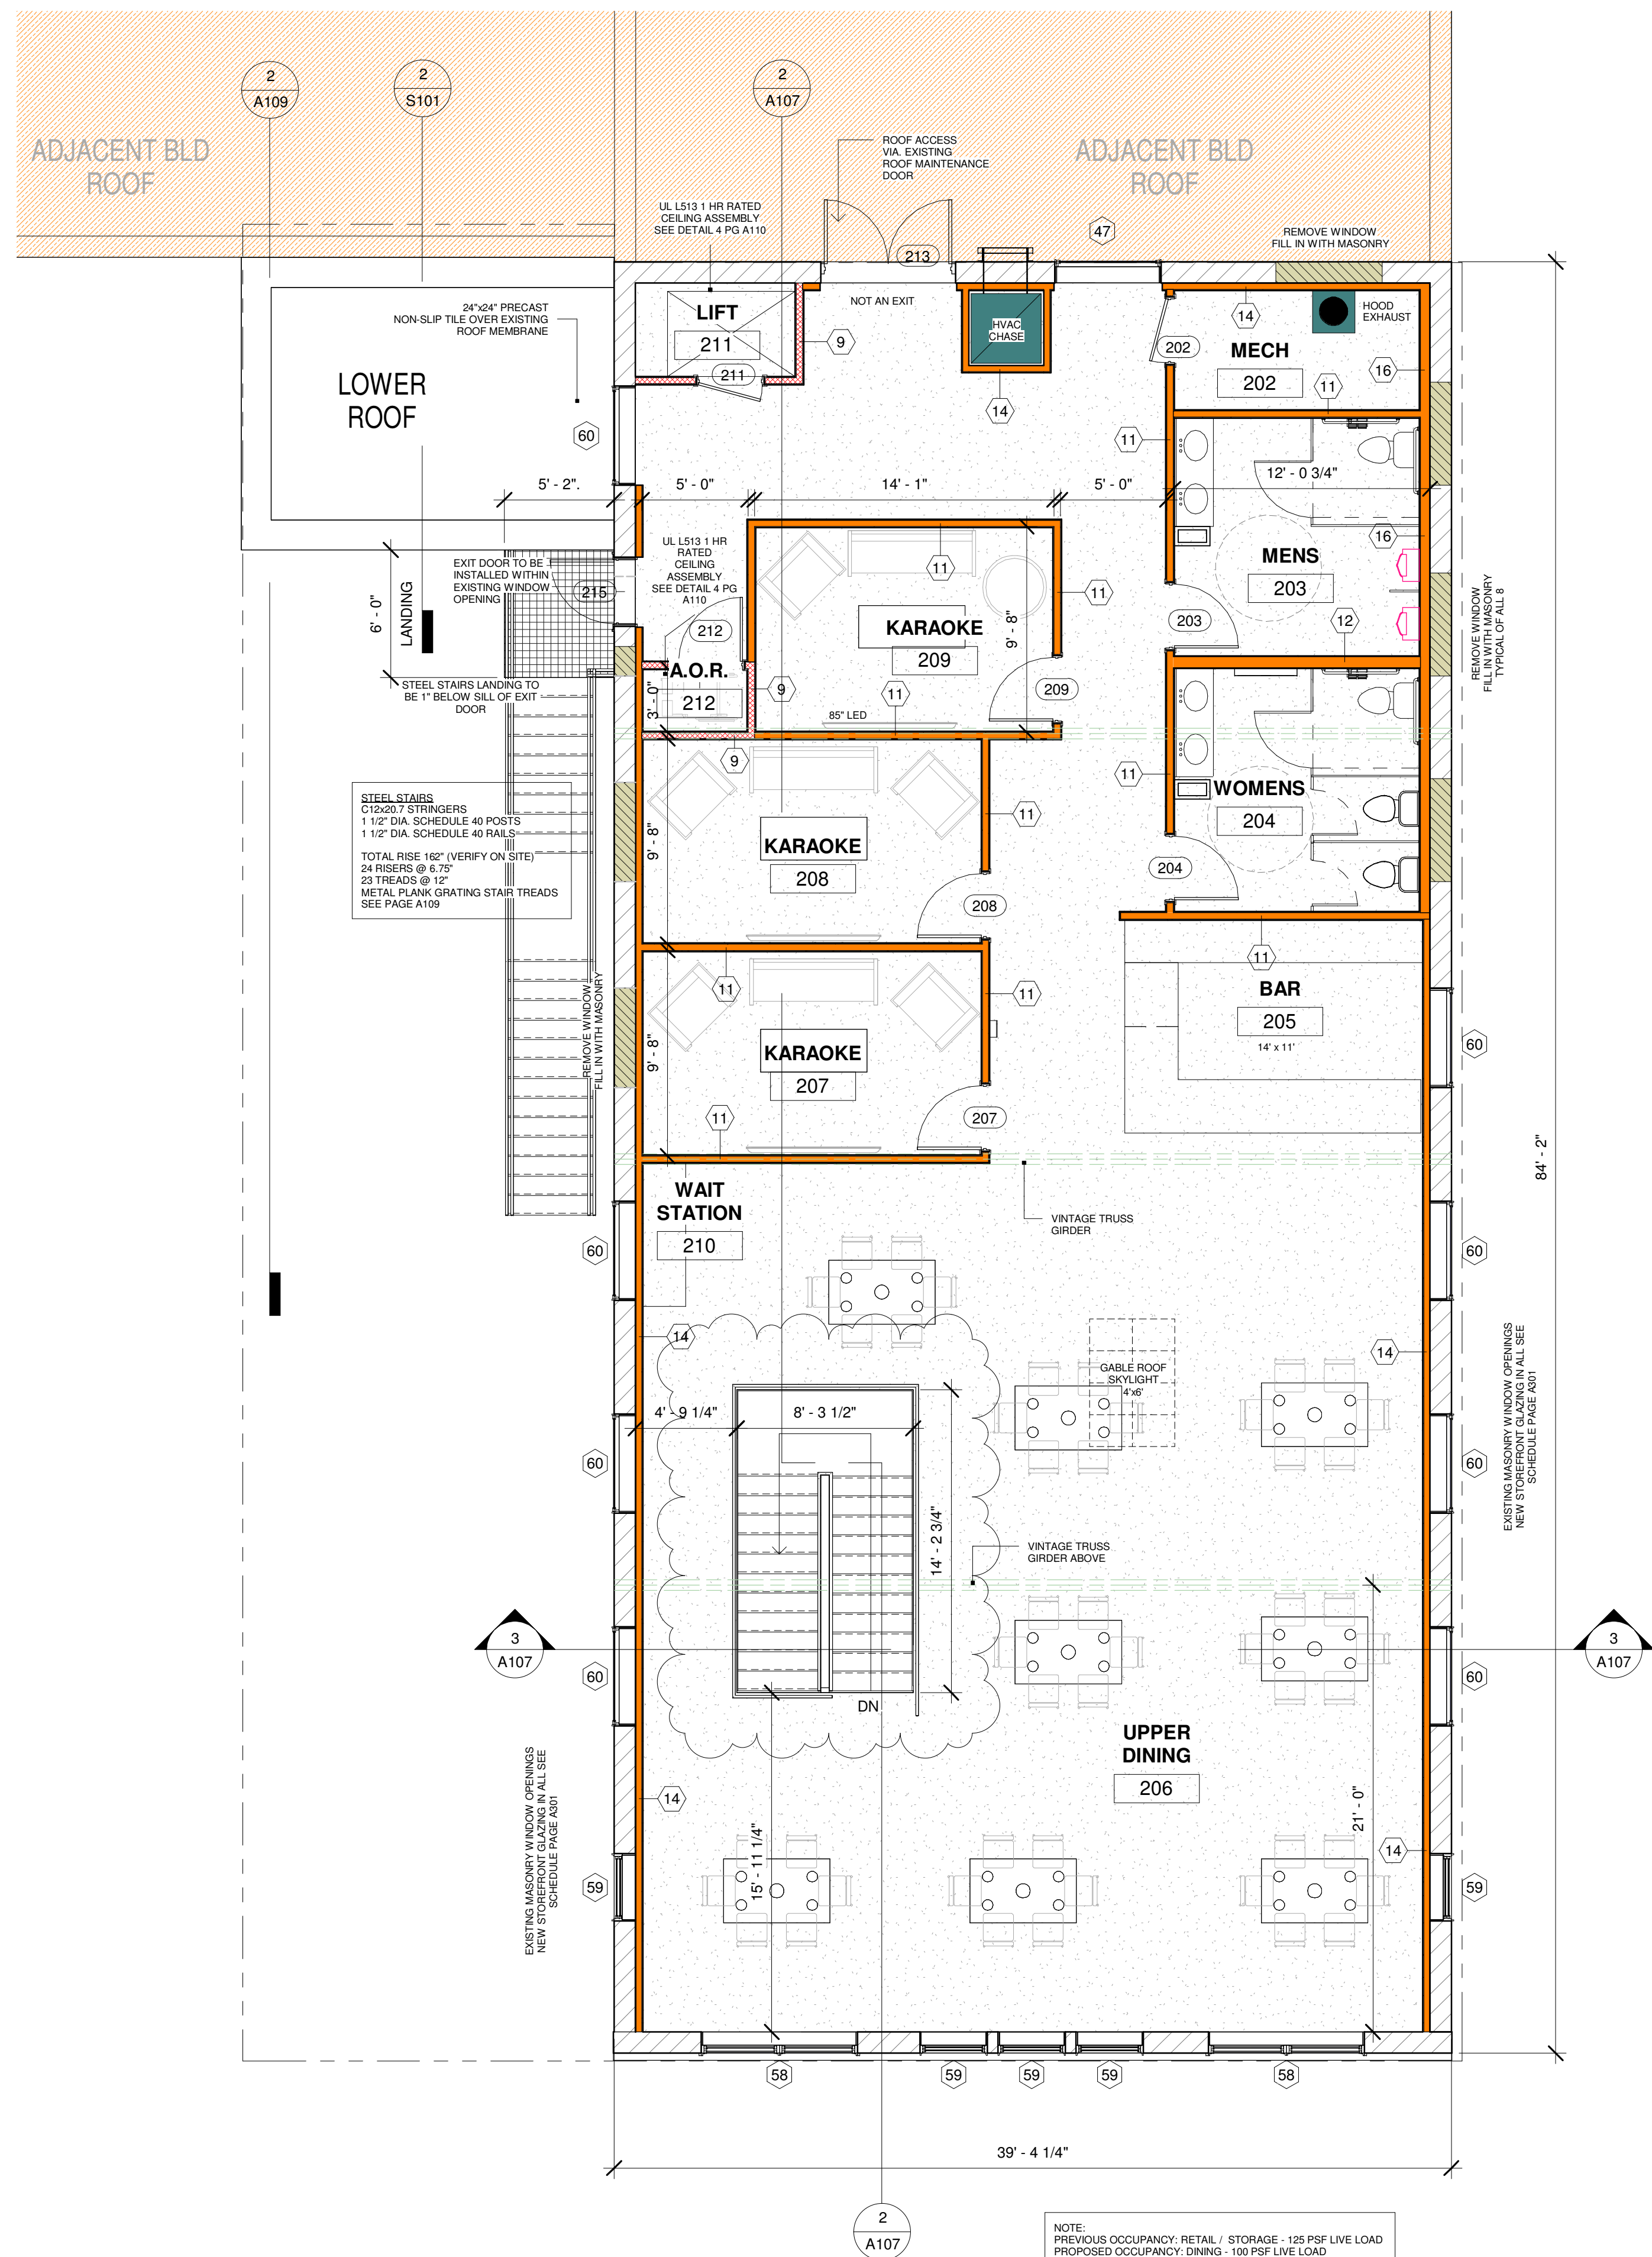

SEE PG A100
FOR FIRE BARRIER
LOCATION

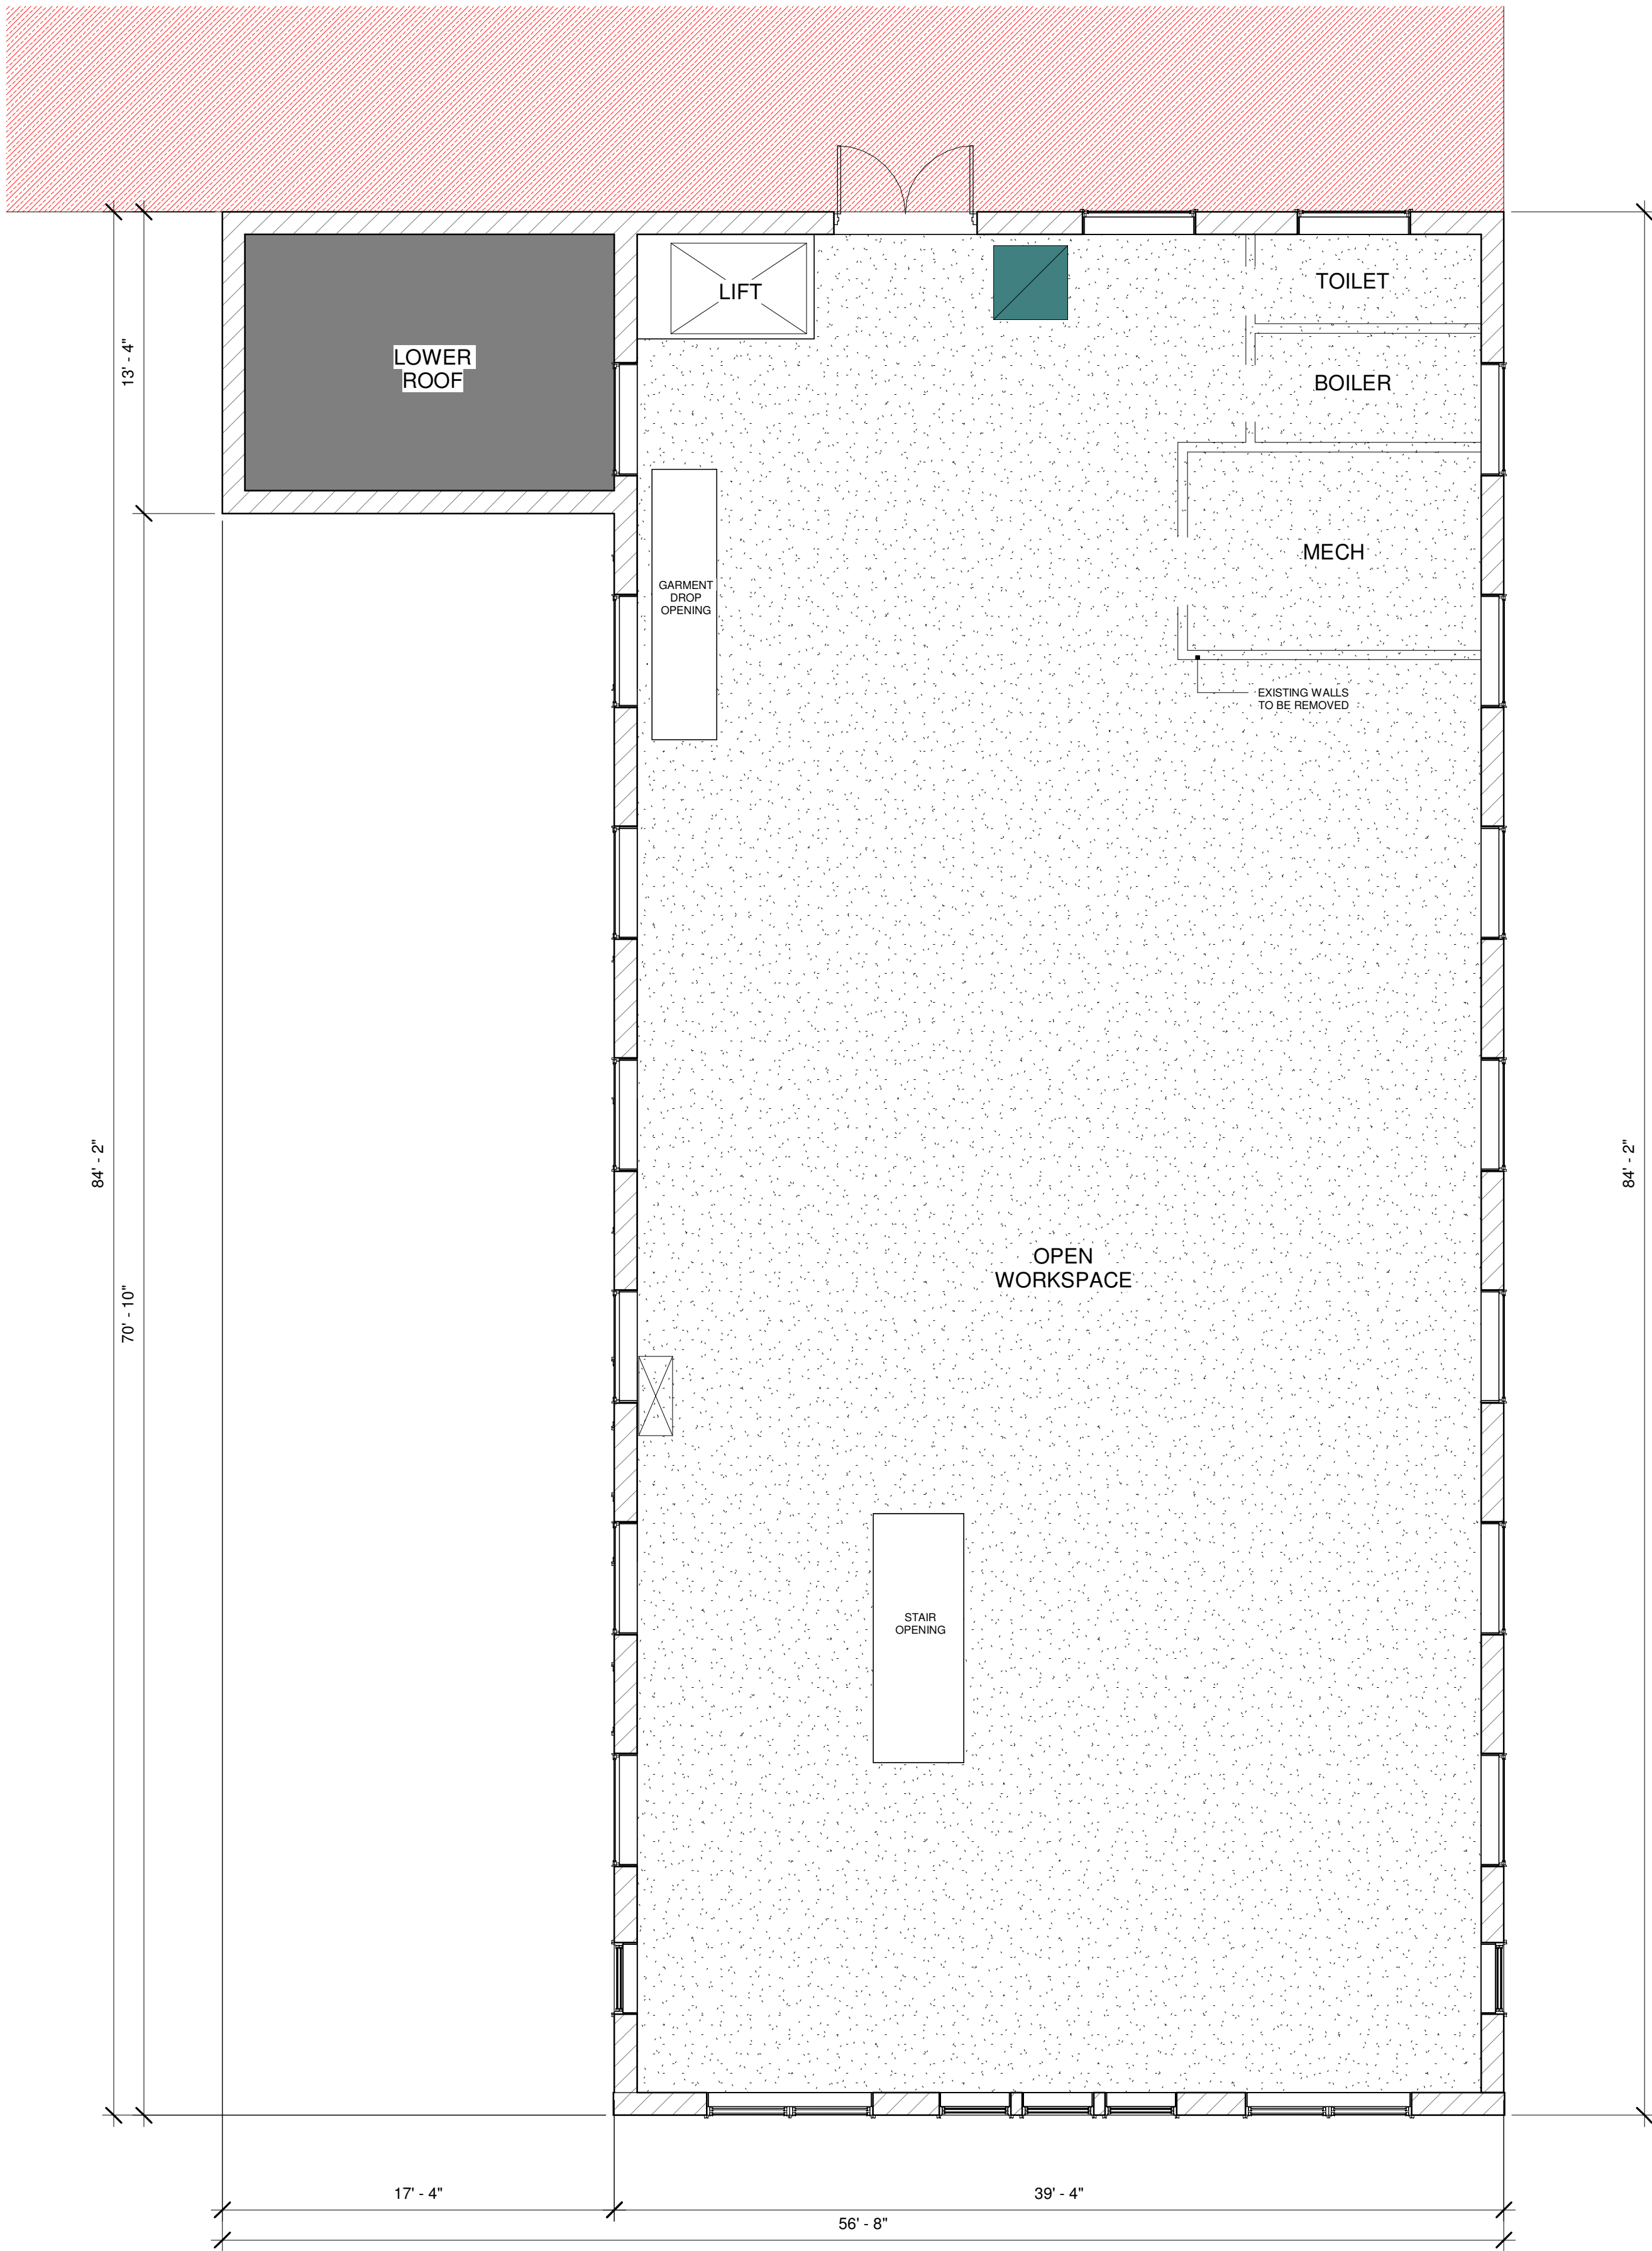

① UPPER LEVEL PLAN - EXISTING
3/16" = 1'-0"

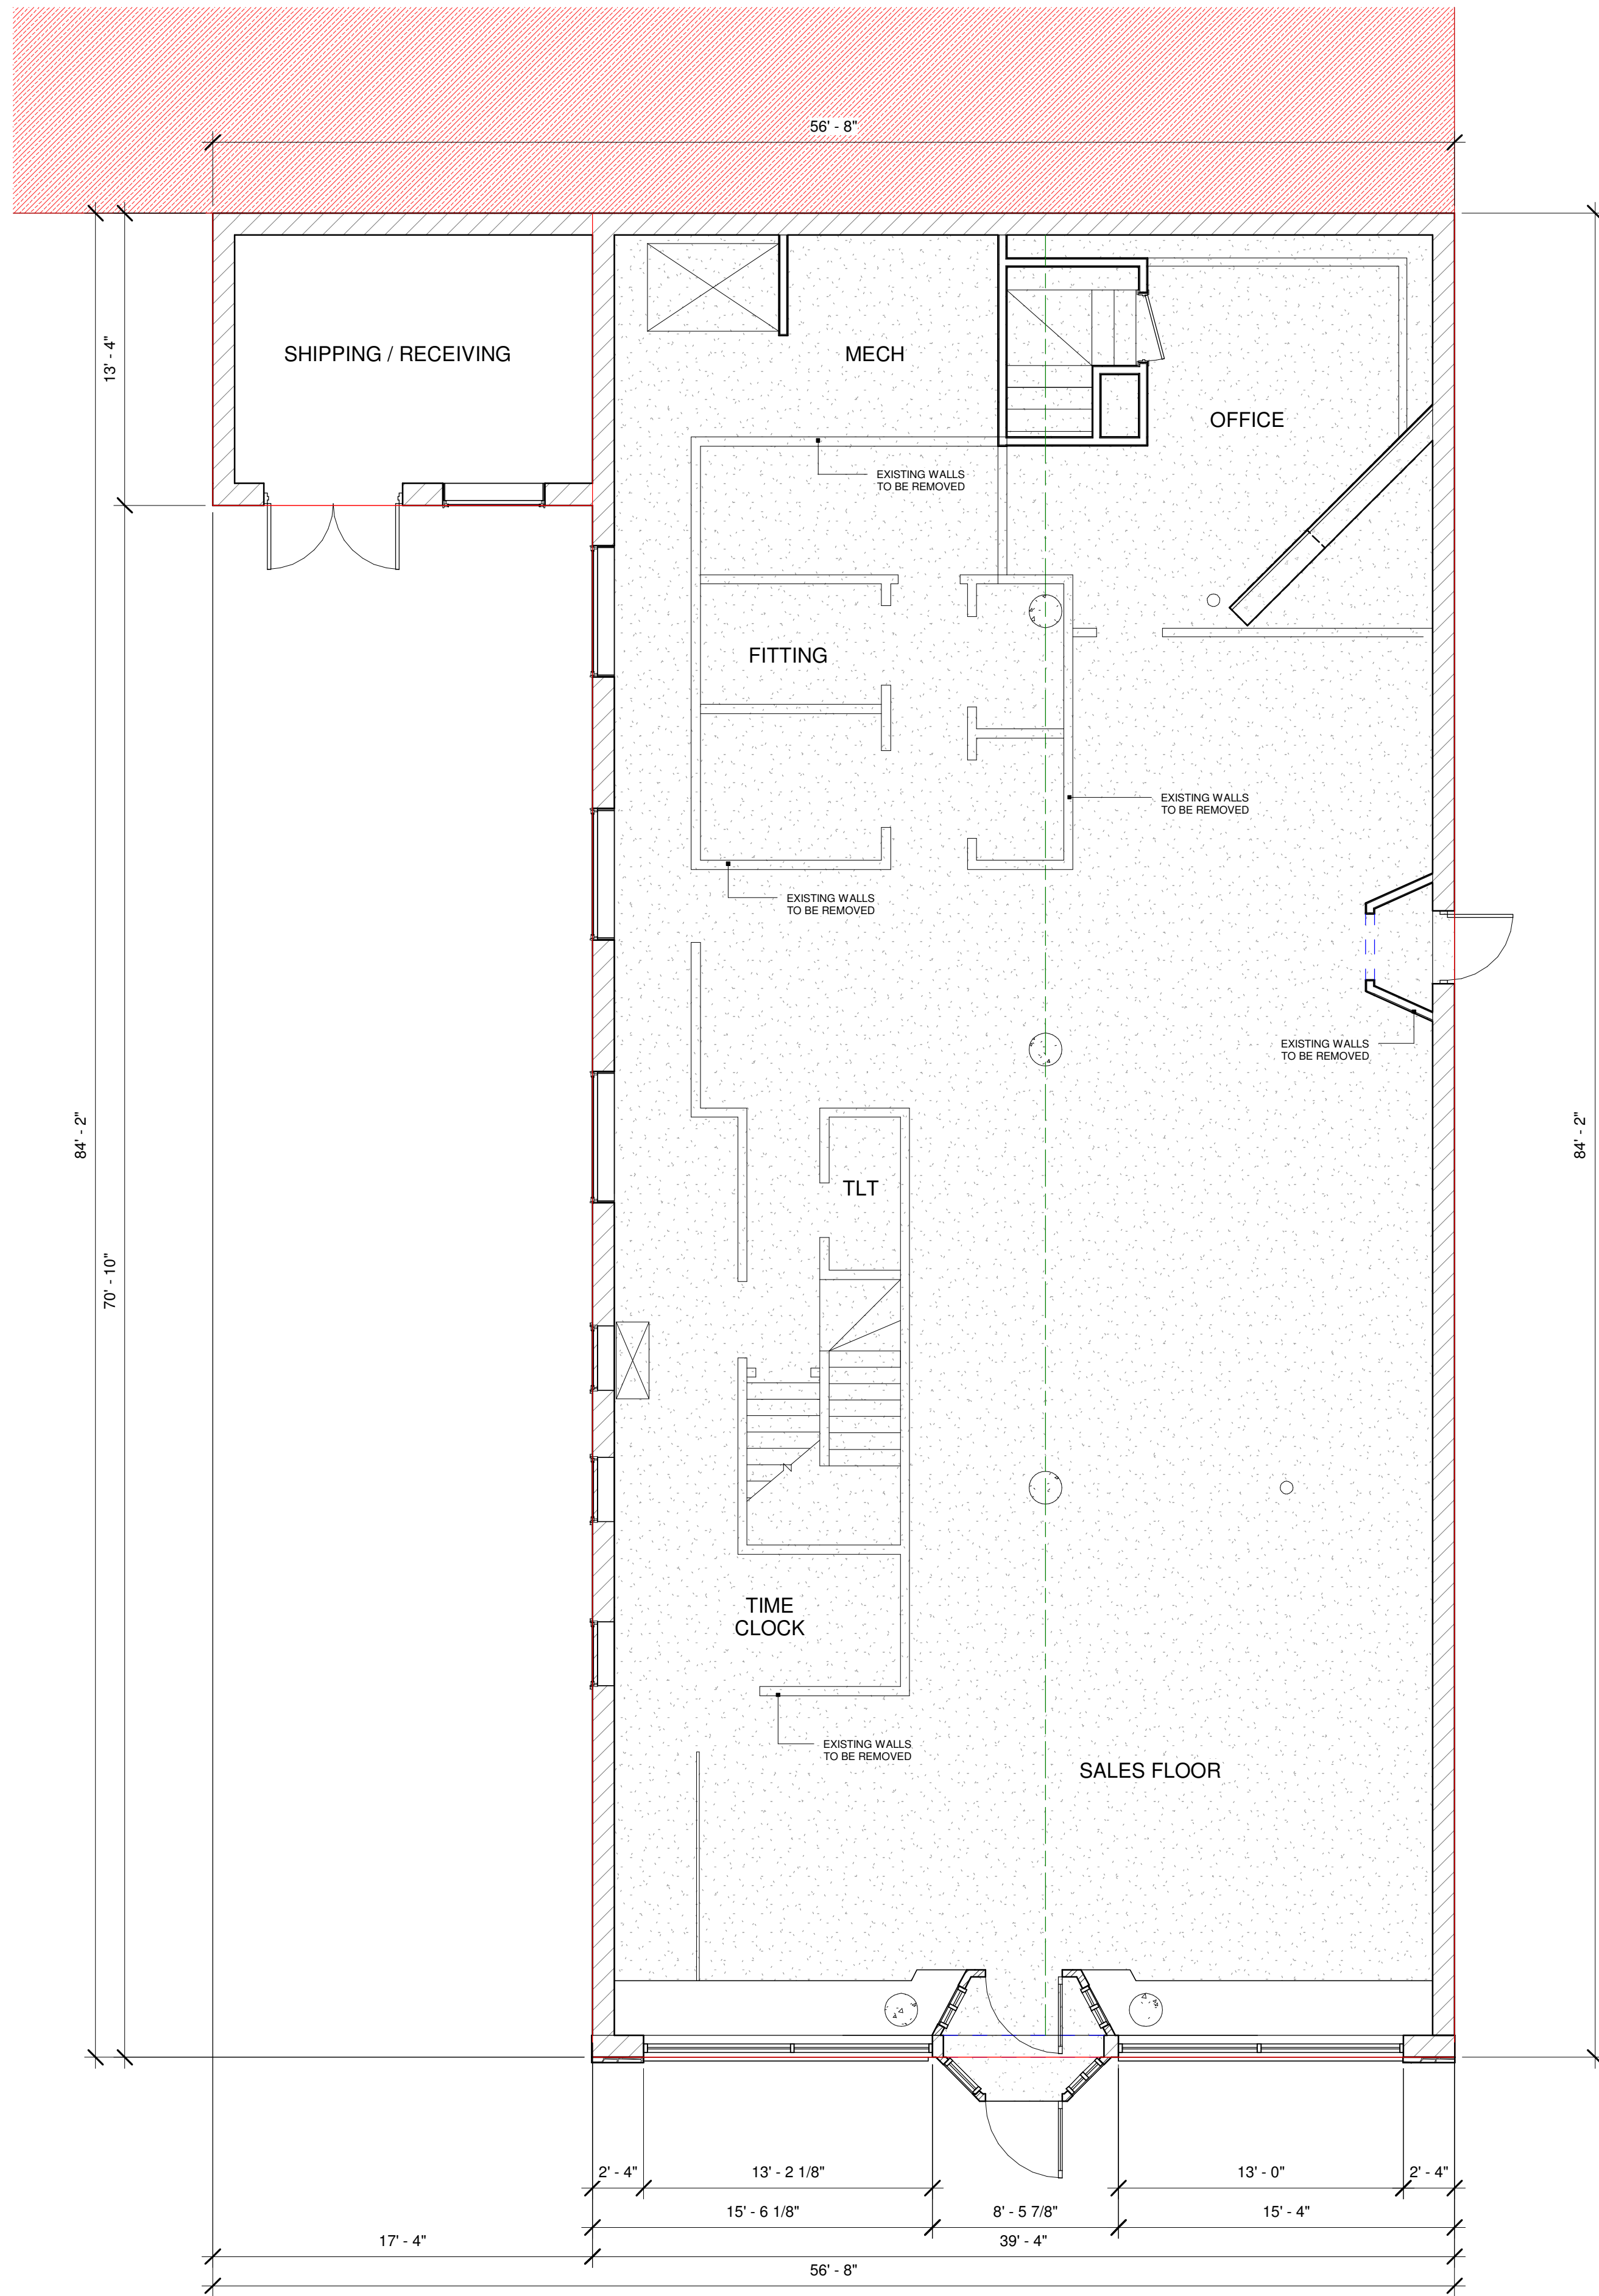



② MAIN LEVEL PLAN - EXISTING
3/16" = 1'-0"


REVISION DATE
AUG 12, 2025

SEAR'D RESTAURANT AND BAR
723 NEW YORK AVENUE
SHEBOYAN, WI 53081

A102


DATE	AUG 12, 2025
PROJECT NUMBER	88
DRAWN BY	NB
CHECKED BY	NB
Copyright 2024	

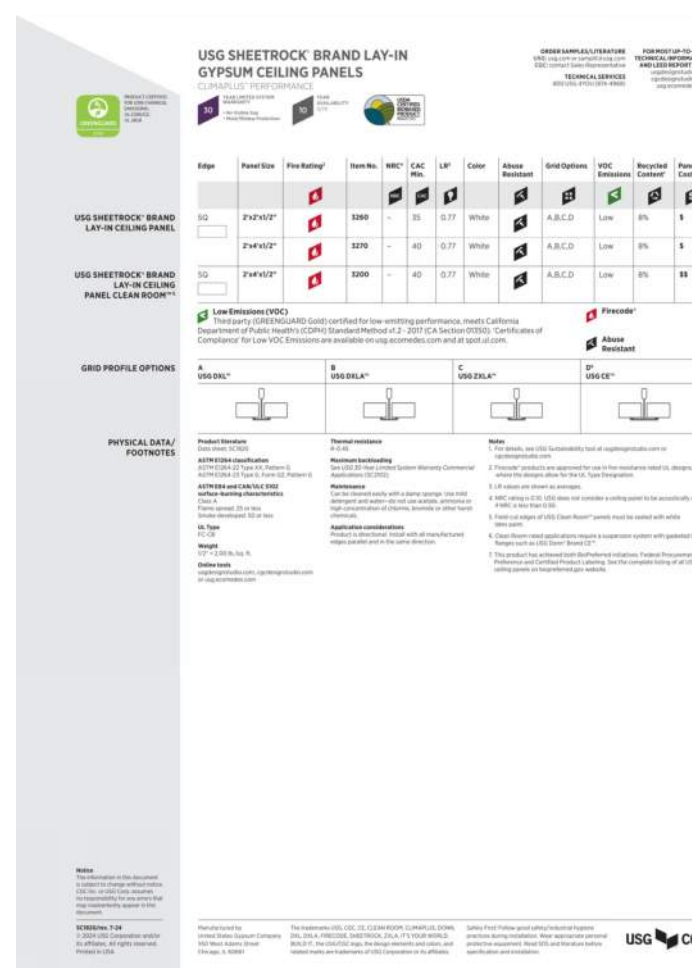

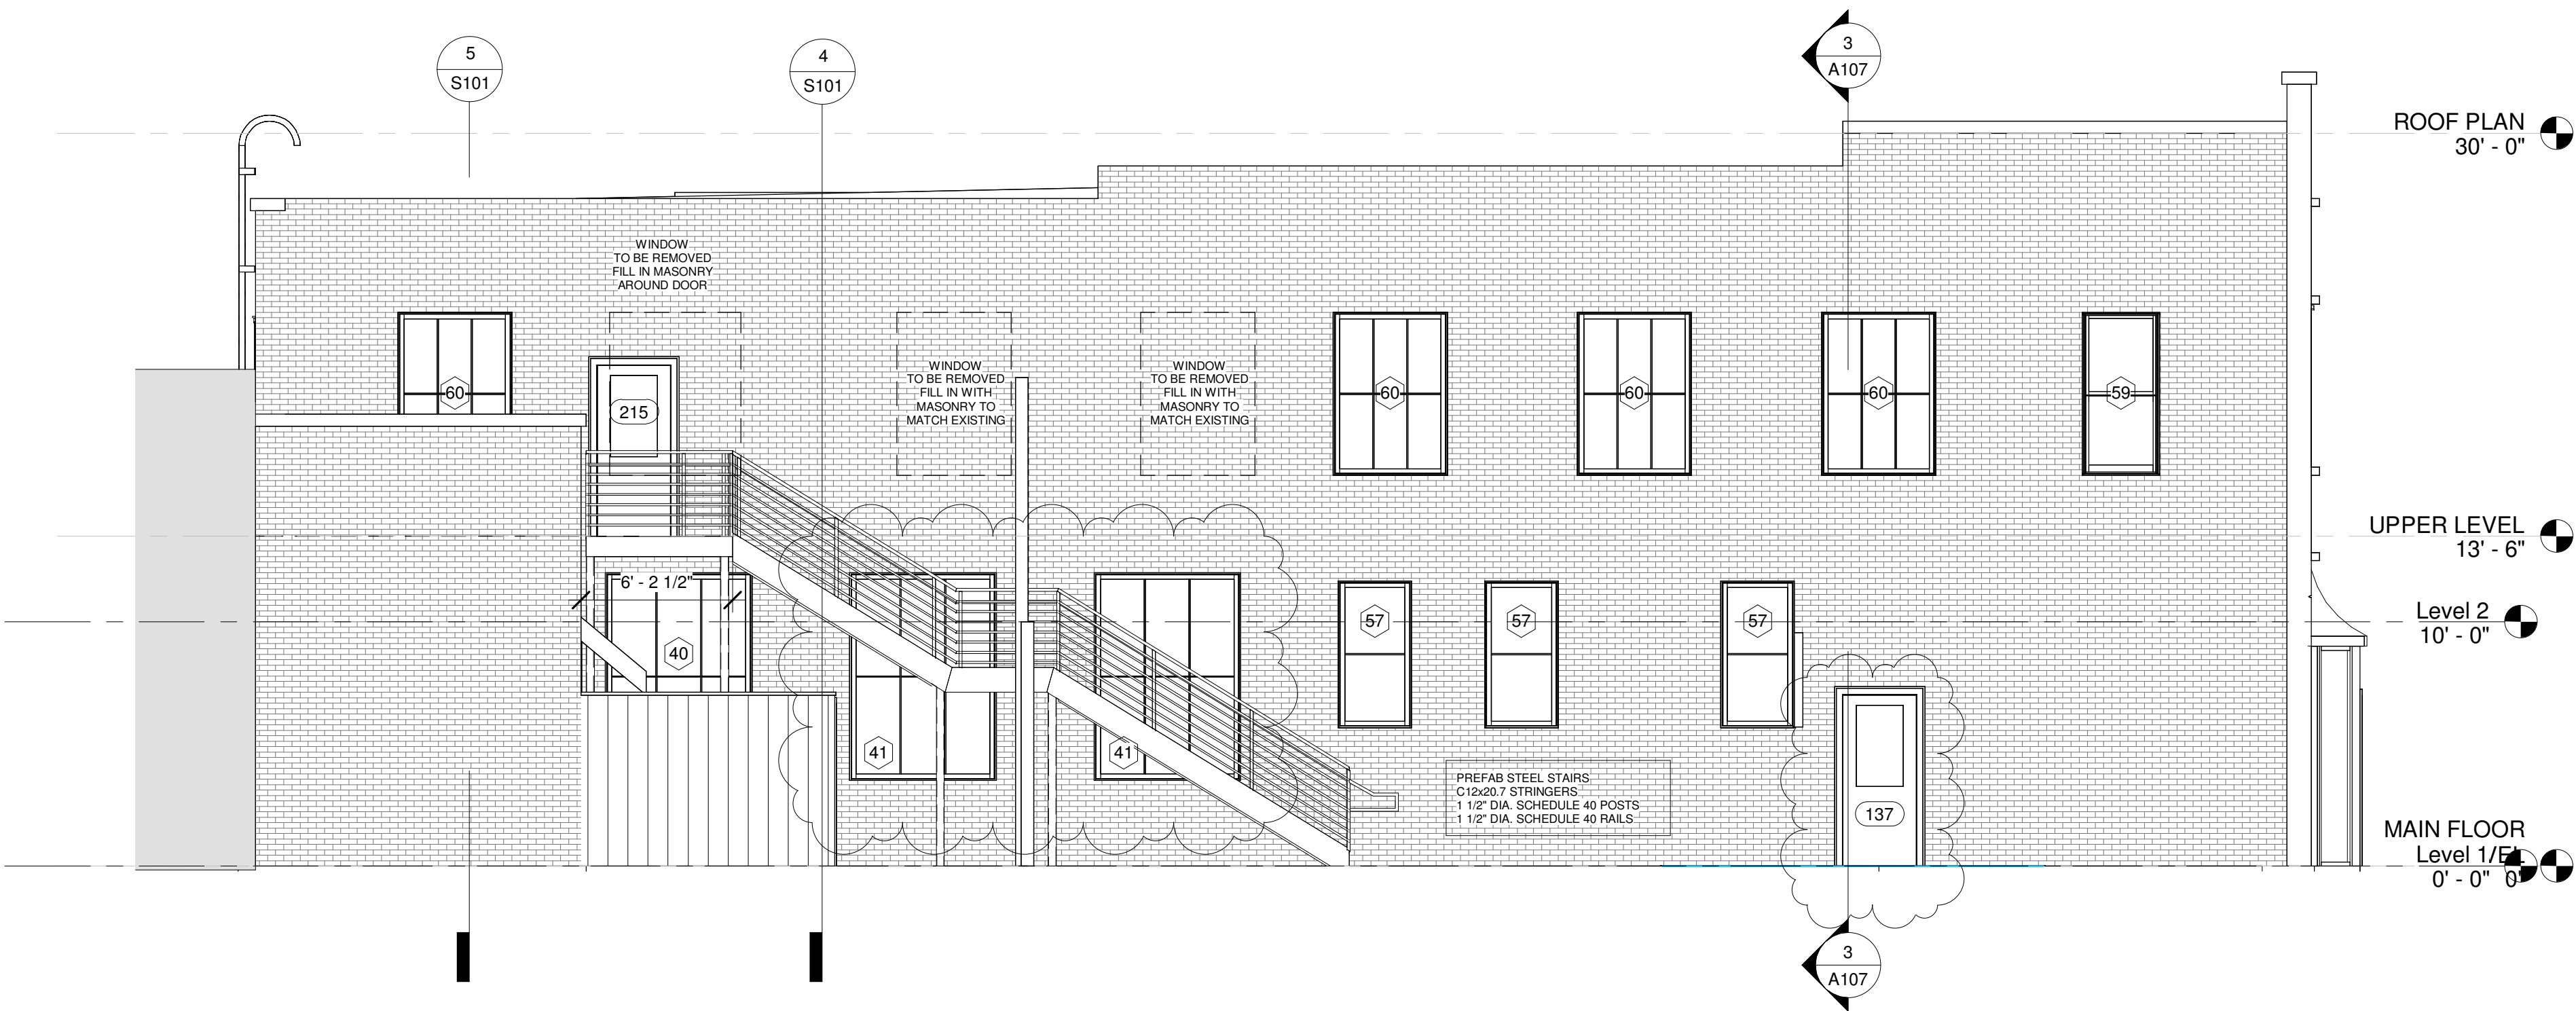

① NORTH ELEVATION - STREET VIEW
3/16" = 1'-0"

④ EAST ELEVATION
3/16" = 1'-0"


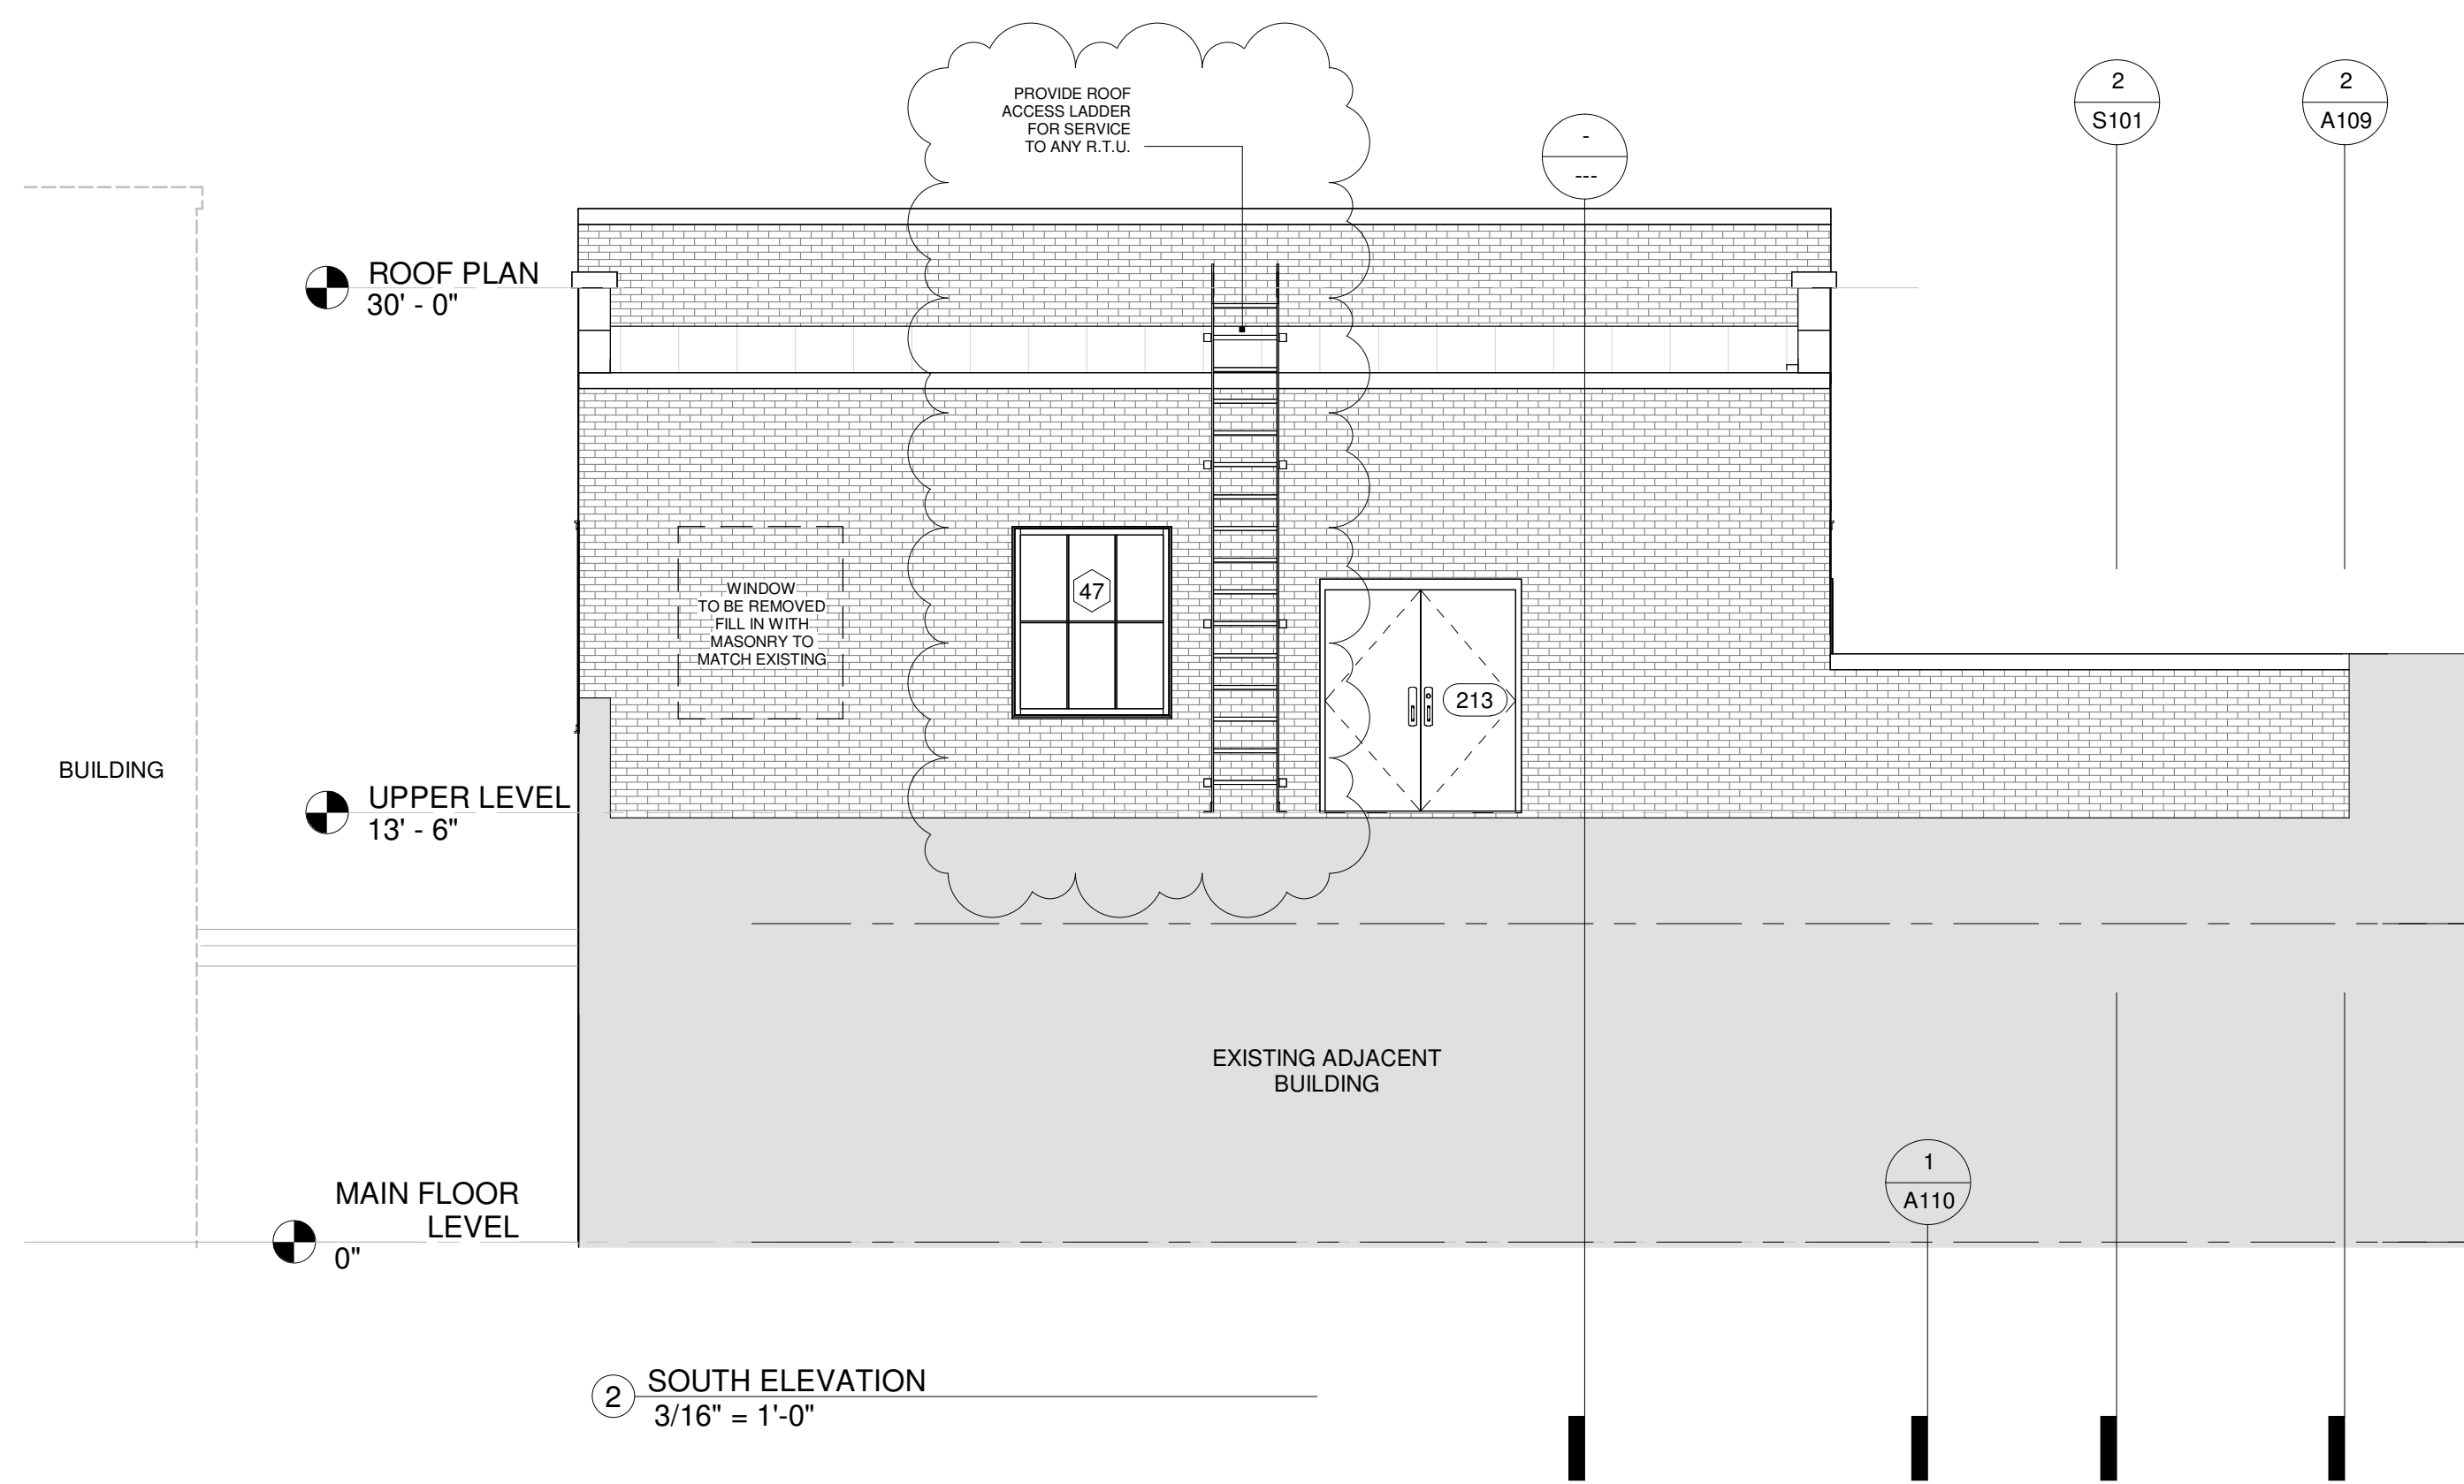




② SOUTH ELEVATION
3/16" = 1'-0"



③ WEST ELEVATION
3/16" = 1'-0"


REVISION DATE
DEC 31, 2025



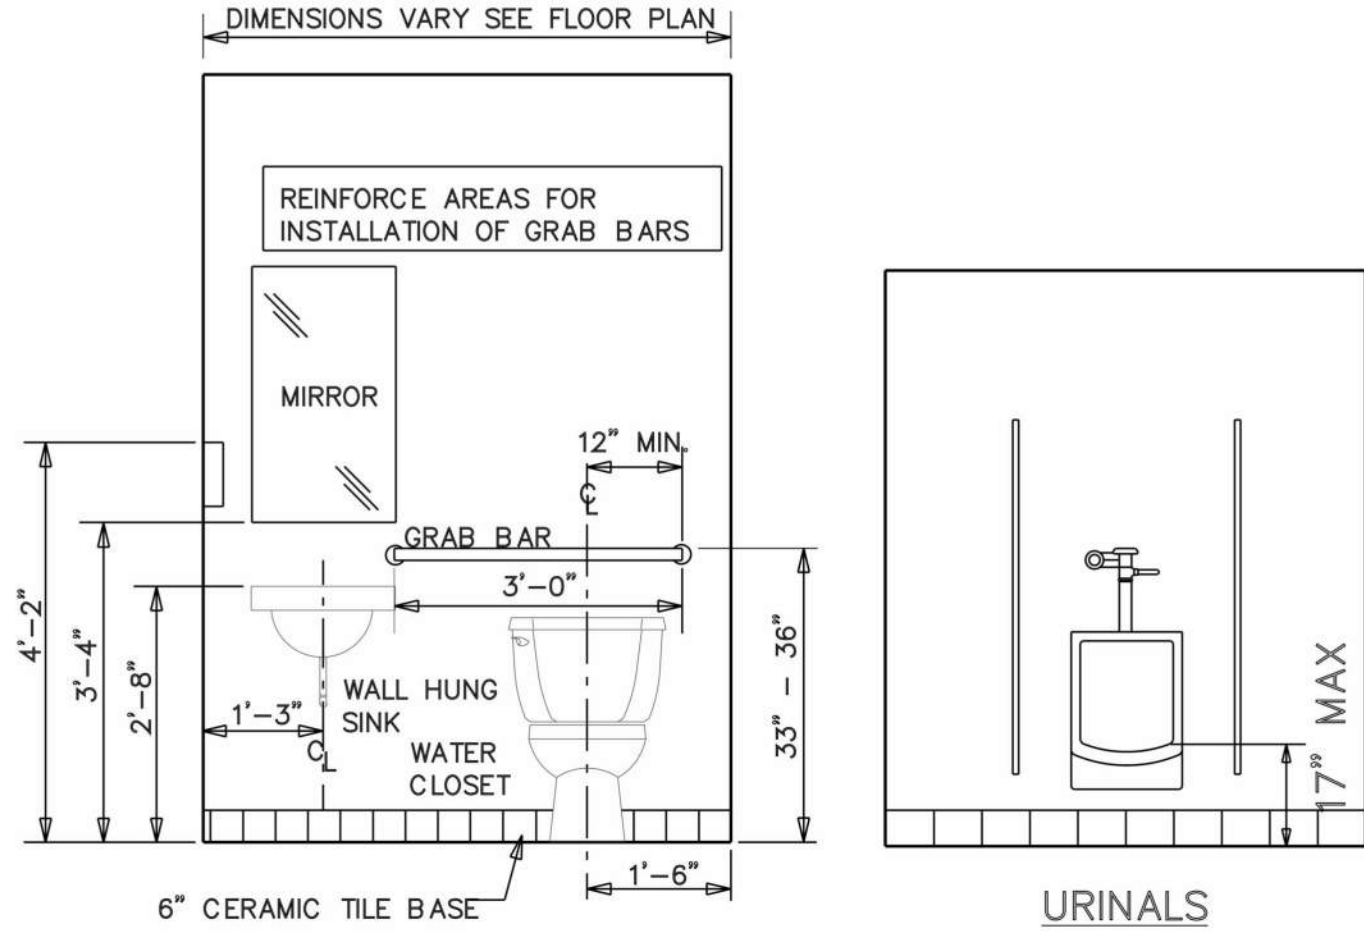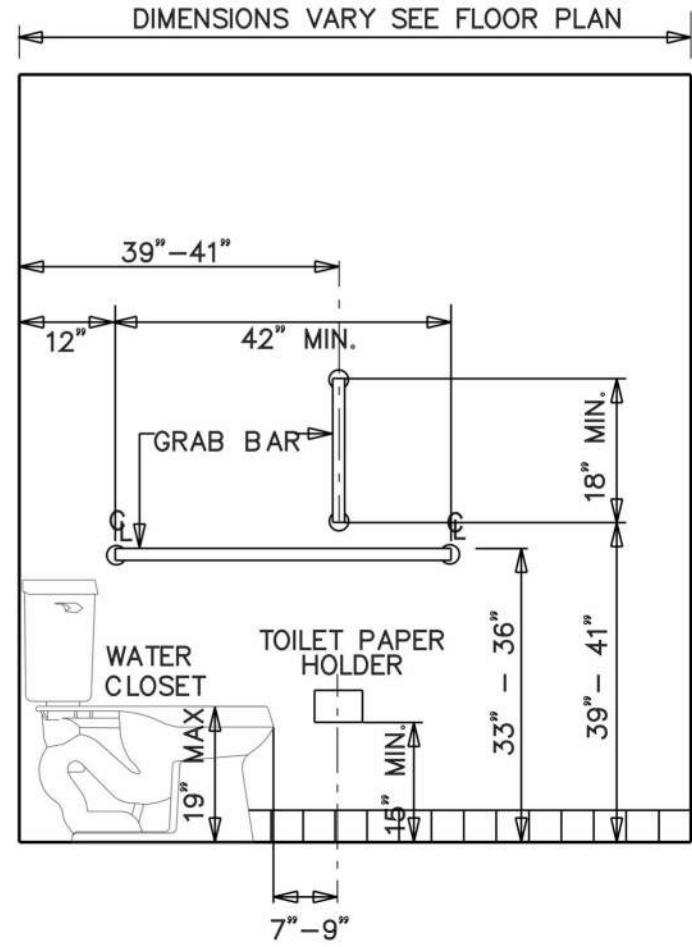

NOTE:
ALL EXPOSED PIPES TO BE
INSULATED TO PREVENT BURNS FOR H.C. USERS
WALLS WITHIN 2'-0" OF URINALS AND WATER CLOSETS
SHALL HAVE A SMOOTH HARD NON ABSORBENT SURFACE
TO A HEIGHT OF 4'-0" ABOVE THE FLOOR.

TYPICAL USABLE RESTROOM PER ANSI A-117.1-2009
SCALE: 1/4" = 1'-0"

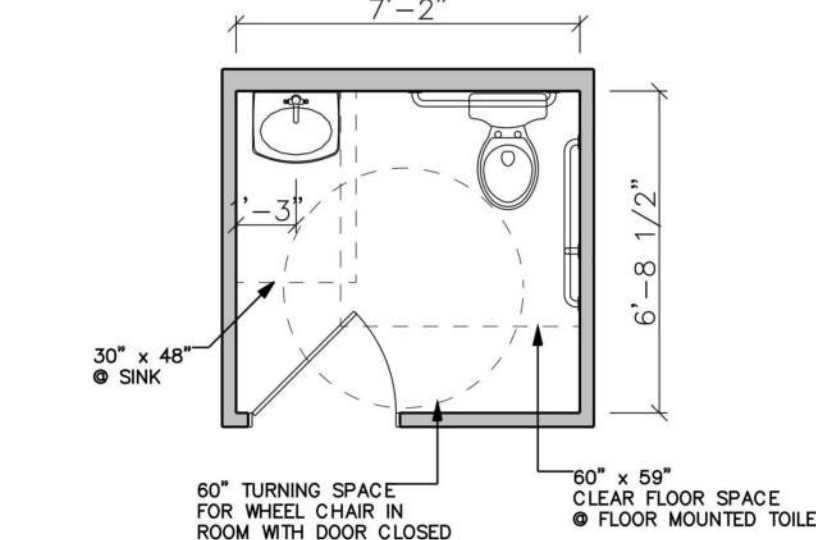

REINFORCE AREAS FOR INSTALLATION OF GRAB BARS
GRAB BARS TO BE GAMCO OR EQ. 1 1/4" DIA.
WITH SNAP FLANGE MOUNT COVERS

REACH RANGES AND MOUNTING HEIGHTS for restroom accessories may vary within a facility depending on the location of individual accessories and the direction of reach required for their use. To allow use by people with limited reach range, it is required that accessories be mounted with their operable parts or dispensing mechanisms, start buttons, coin slots, or dispenser openings located no more than 48 inches (1220mm) above the finish floor (Fig. 1a.). Where accessories are mounted over obstructions such as counters, depending on the nature and depth of the obstruction it is required that they be located between 44 inches and 48 inches (1120 and 1220mm) maximum above the finish floor. The operable portions of any accessory should be mounted no lower than 15 inches (380mm) above the floor. However, the 2003 ICC/ANSI Standards limit the operable portions of dispensers in toilet compartments to no lower than 18 inches (455mm). When determining the mounting location of restroom accessories, make sure to account for side and forward approaches.

Fig. 1 Mounting Heights for Restroom Accessories.


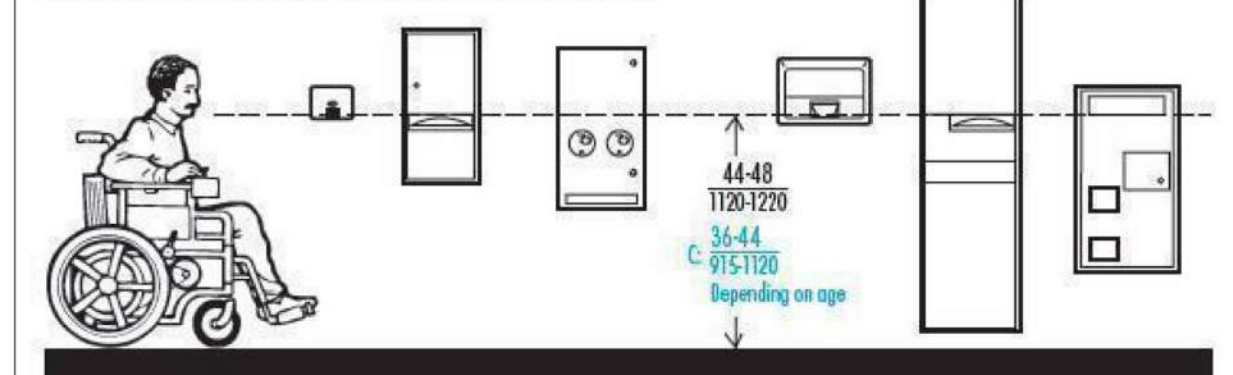


Fig. 1a Upper Range of Mounting Heights for Restroom Accessories with Operable Parts.

- Signage Requirements:
IBC 1111.1 - Required accessible elements shall be identified by the International Symbol of Accessibility at the following locations:
1. Accessible parking spaces req'd by Section 1106.1 N/A for 4 or less parking spaces.
 2. Accessible parking spaces req'd by Section 1106.2
 3. Accessible passenger loading zones
 4. Accessible rooms where multiple single user toilet or bathing rooms are clustered at a single location
 5. Accessible entrances where not all entrances are accessible
 6. Accessible check out aisles where not all aisles are accessible
 7. Family or assisted-use toilet and bathing rooms
 8. Accessible dressing, fitting and locker rooms where not all such rooms are accessible
 9. Accessible areas of refuge in accordance with Section 1009.9
 10. Exterior areas of refuge in accordance with Section 1009.9
 11. In recreational facilities, lockers that are required to be accessible in accordance with Section 1009.9
- where multiple single-user toilet or bathing rooms are clustered at a single location, unisex toilet and bathing rooms, and dressing, fitting, and locker rooms where not all such rooms are accessible. The signage shall be provided and in compliance with ICC/ANSI A117.1.
- Directional signage indicating the route to the nearest like accessible element shall be provided per IBC 1111.2


703.3.11 Location. Where a tactile sign is provided at a door, the sign shall be alongside the door at the latch side. Where a tactile sign is provided at double doors with one active leaf, the sign shall be located on the inactive leaf. Where a tactile sign is provided at double doors with two active leaves, the sign shall be to the right of the right-hand door. Where there is no wall space on the latch side of a single door, or to the right side of double doors, signs shall be on the nearest adjacent wall.

Signs containing tactile characters shall be located so that a clear floor area 18 inches (455 mm) minimum by 18 inches (455 mm) minimum, centered on the tactile characters, is provided beyond the arc of any door swing between the closed position and 45 degree open position. EXCEPTION: Signs with tactile characters shall be permitted on the push side of doors with closers and without hold-open devices.

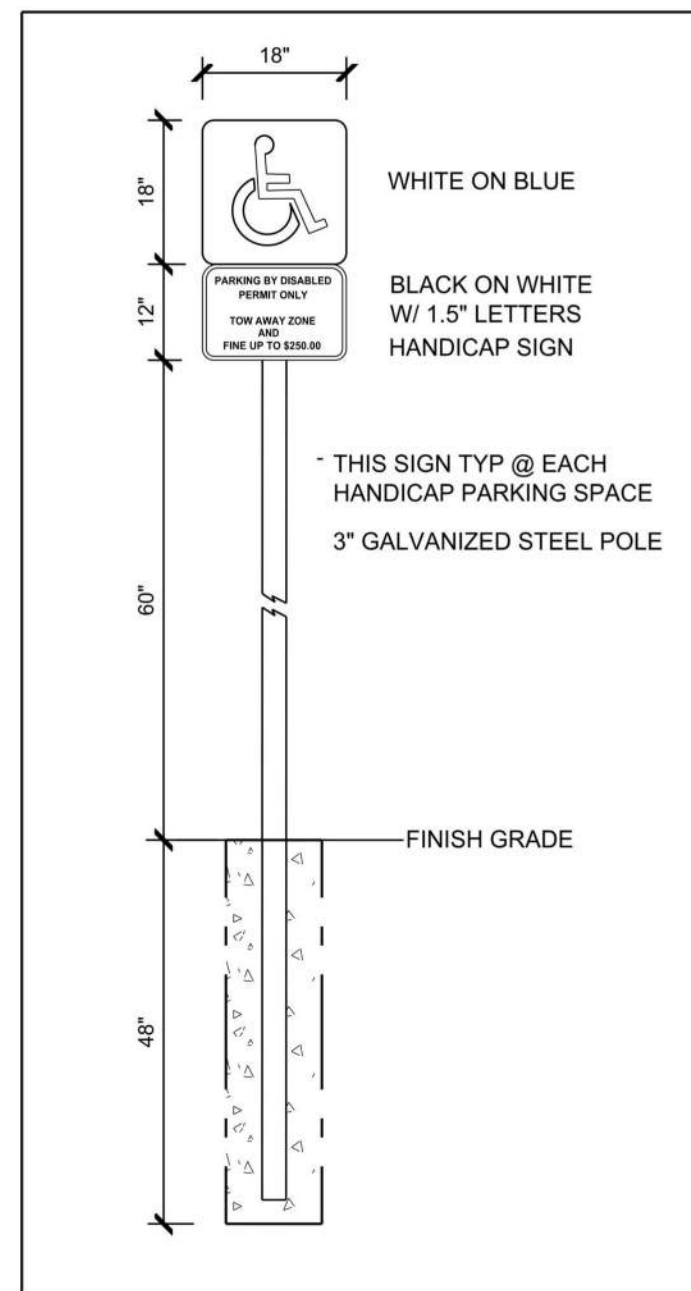

HANDICAP PARKING SIGN

AMERICANS WITH DISABILITIES ACT (ADA) PARKING SIGN

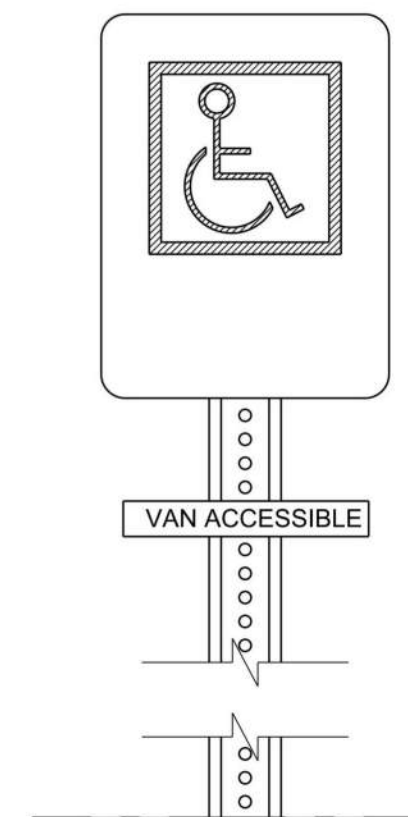

METAL SIGN BLANK WITH 1"-RADIUS CORNERS

INTERNATIONAL SYMBOL OF ACCESSIBILITY (BLUE SYMBOL ON WHITE BACKGROUND)

STANDARD GALVANIZED METAL CHANNEL SIGN POST

(WHERE APPLICABLE)

NOTE:
INSTALL SIGN IN 1'-0" x 1'-6" CONCRETE FOOTING

NOTE:
DETAIL IS MEANT AS A GENERAL GUIDELINE.
REFER TO LOCAL MUNICIPALITY FOR SIGN TYPE, VERBAGE AND DIMENSIONS.

NOTE:
SIGNS SHALL BE LOCATED SO THAT THEY CANNOT BE OBSCURED BY A VEHICLE PARKED IN THE SPACE.

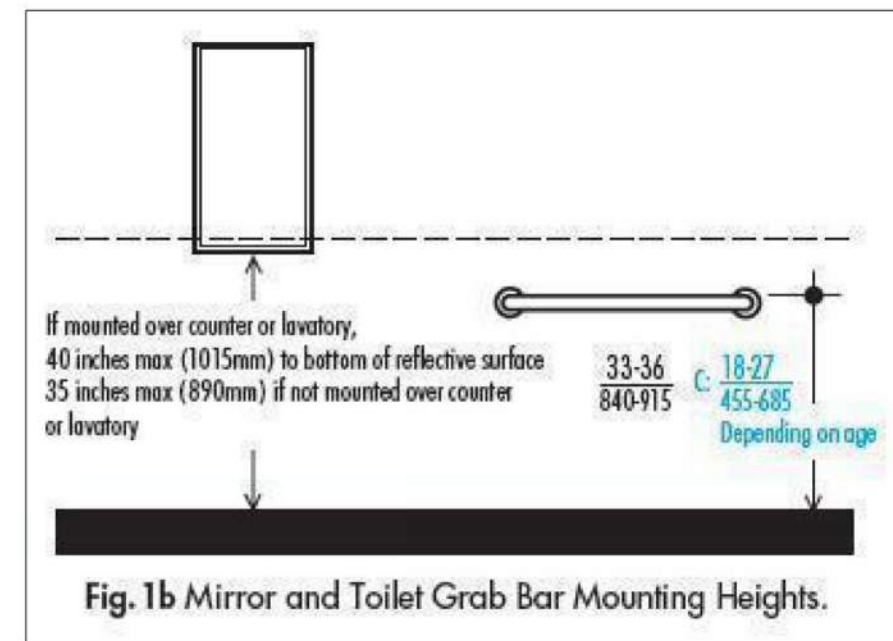


Fig. 1b Mirror and Toilet Grab Bar Mounting Heights.


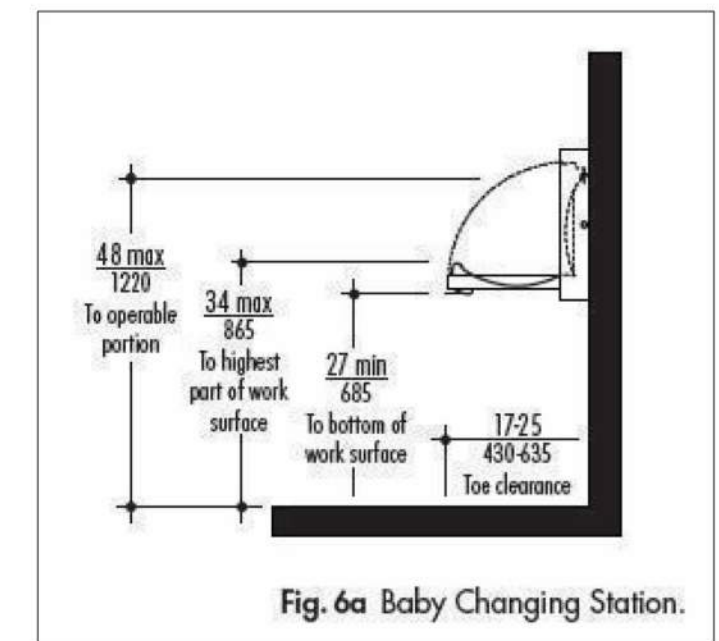


Fig. 6a Baby Changing Station.


SALES AND SERVICE COUNTERS shall comply with Section 904.3.1 or 904.3.2 of ANSI ICC A117.1-2009. The accessible portion of the counter surface shall extend the same depth as the sales and service counter surface.

PARALLEL APPROACH counter surfaces shall be provided with a portion of the counter surface 36 inches minimum in length and 36 inches maximum in height above the floor. Where the counter is less than 36 inches in length, the entire counter surface shall be 36 inches maximum height above the floor. A clear floor space complying with Section 305 positioned for a parallel approach adjacent to the counter shall be provided.


FORWARD APPROACH counter surfaces shall be provided with a portion of the counter surface 30 inches minimum in length and 36 inches maximum height above the floor. A clear floor space complying with Section 305 positioned for a forward approach shall be provided. Knee and toe clearance complying with Section 306 shall be provided under the accessible counter.

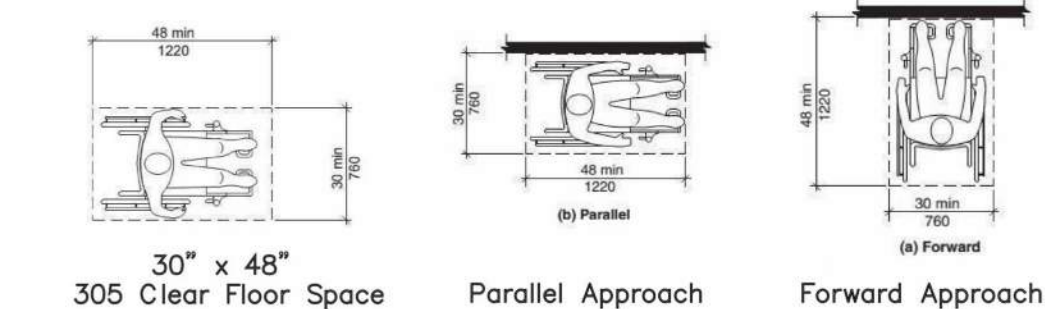



305 Clear Floor Space Parallel Approach Forward Approach

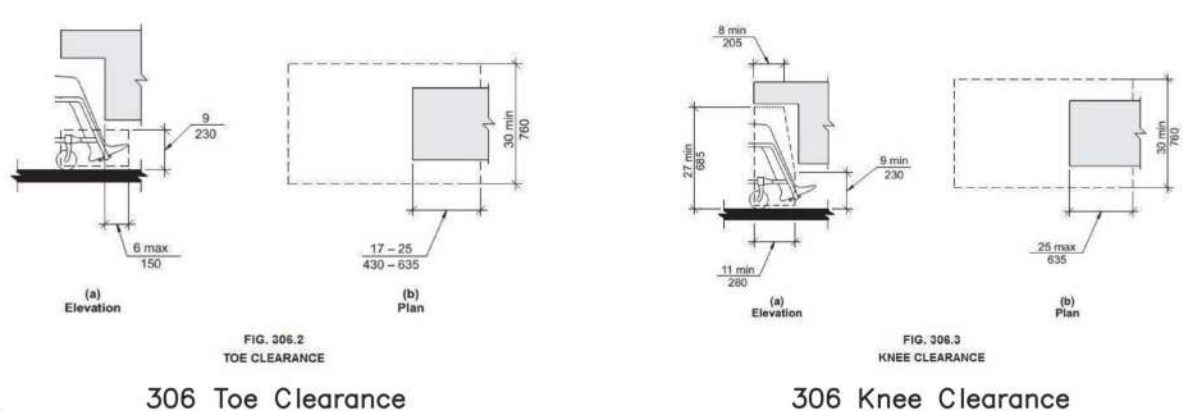

306 Toe Clearance 306 Knee Clearance

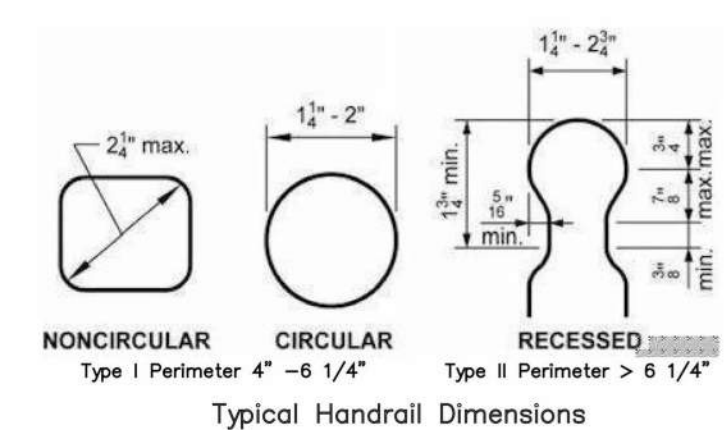


Typical Handrail Dimensions

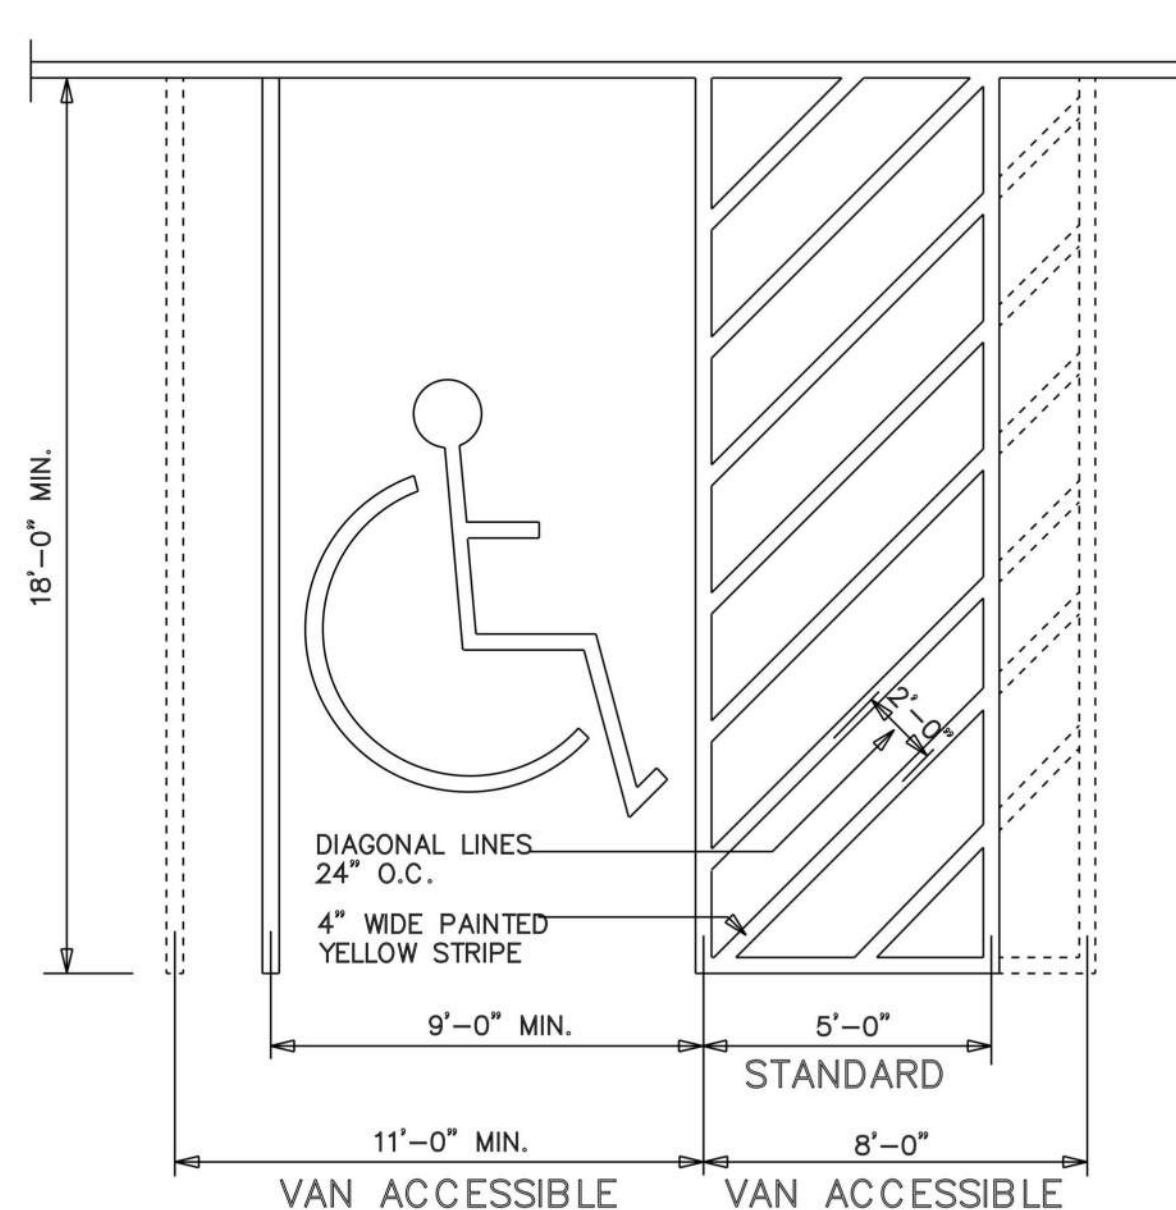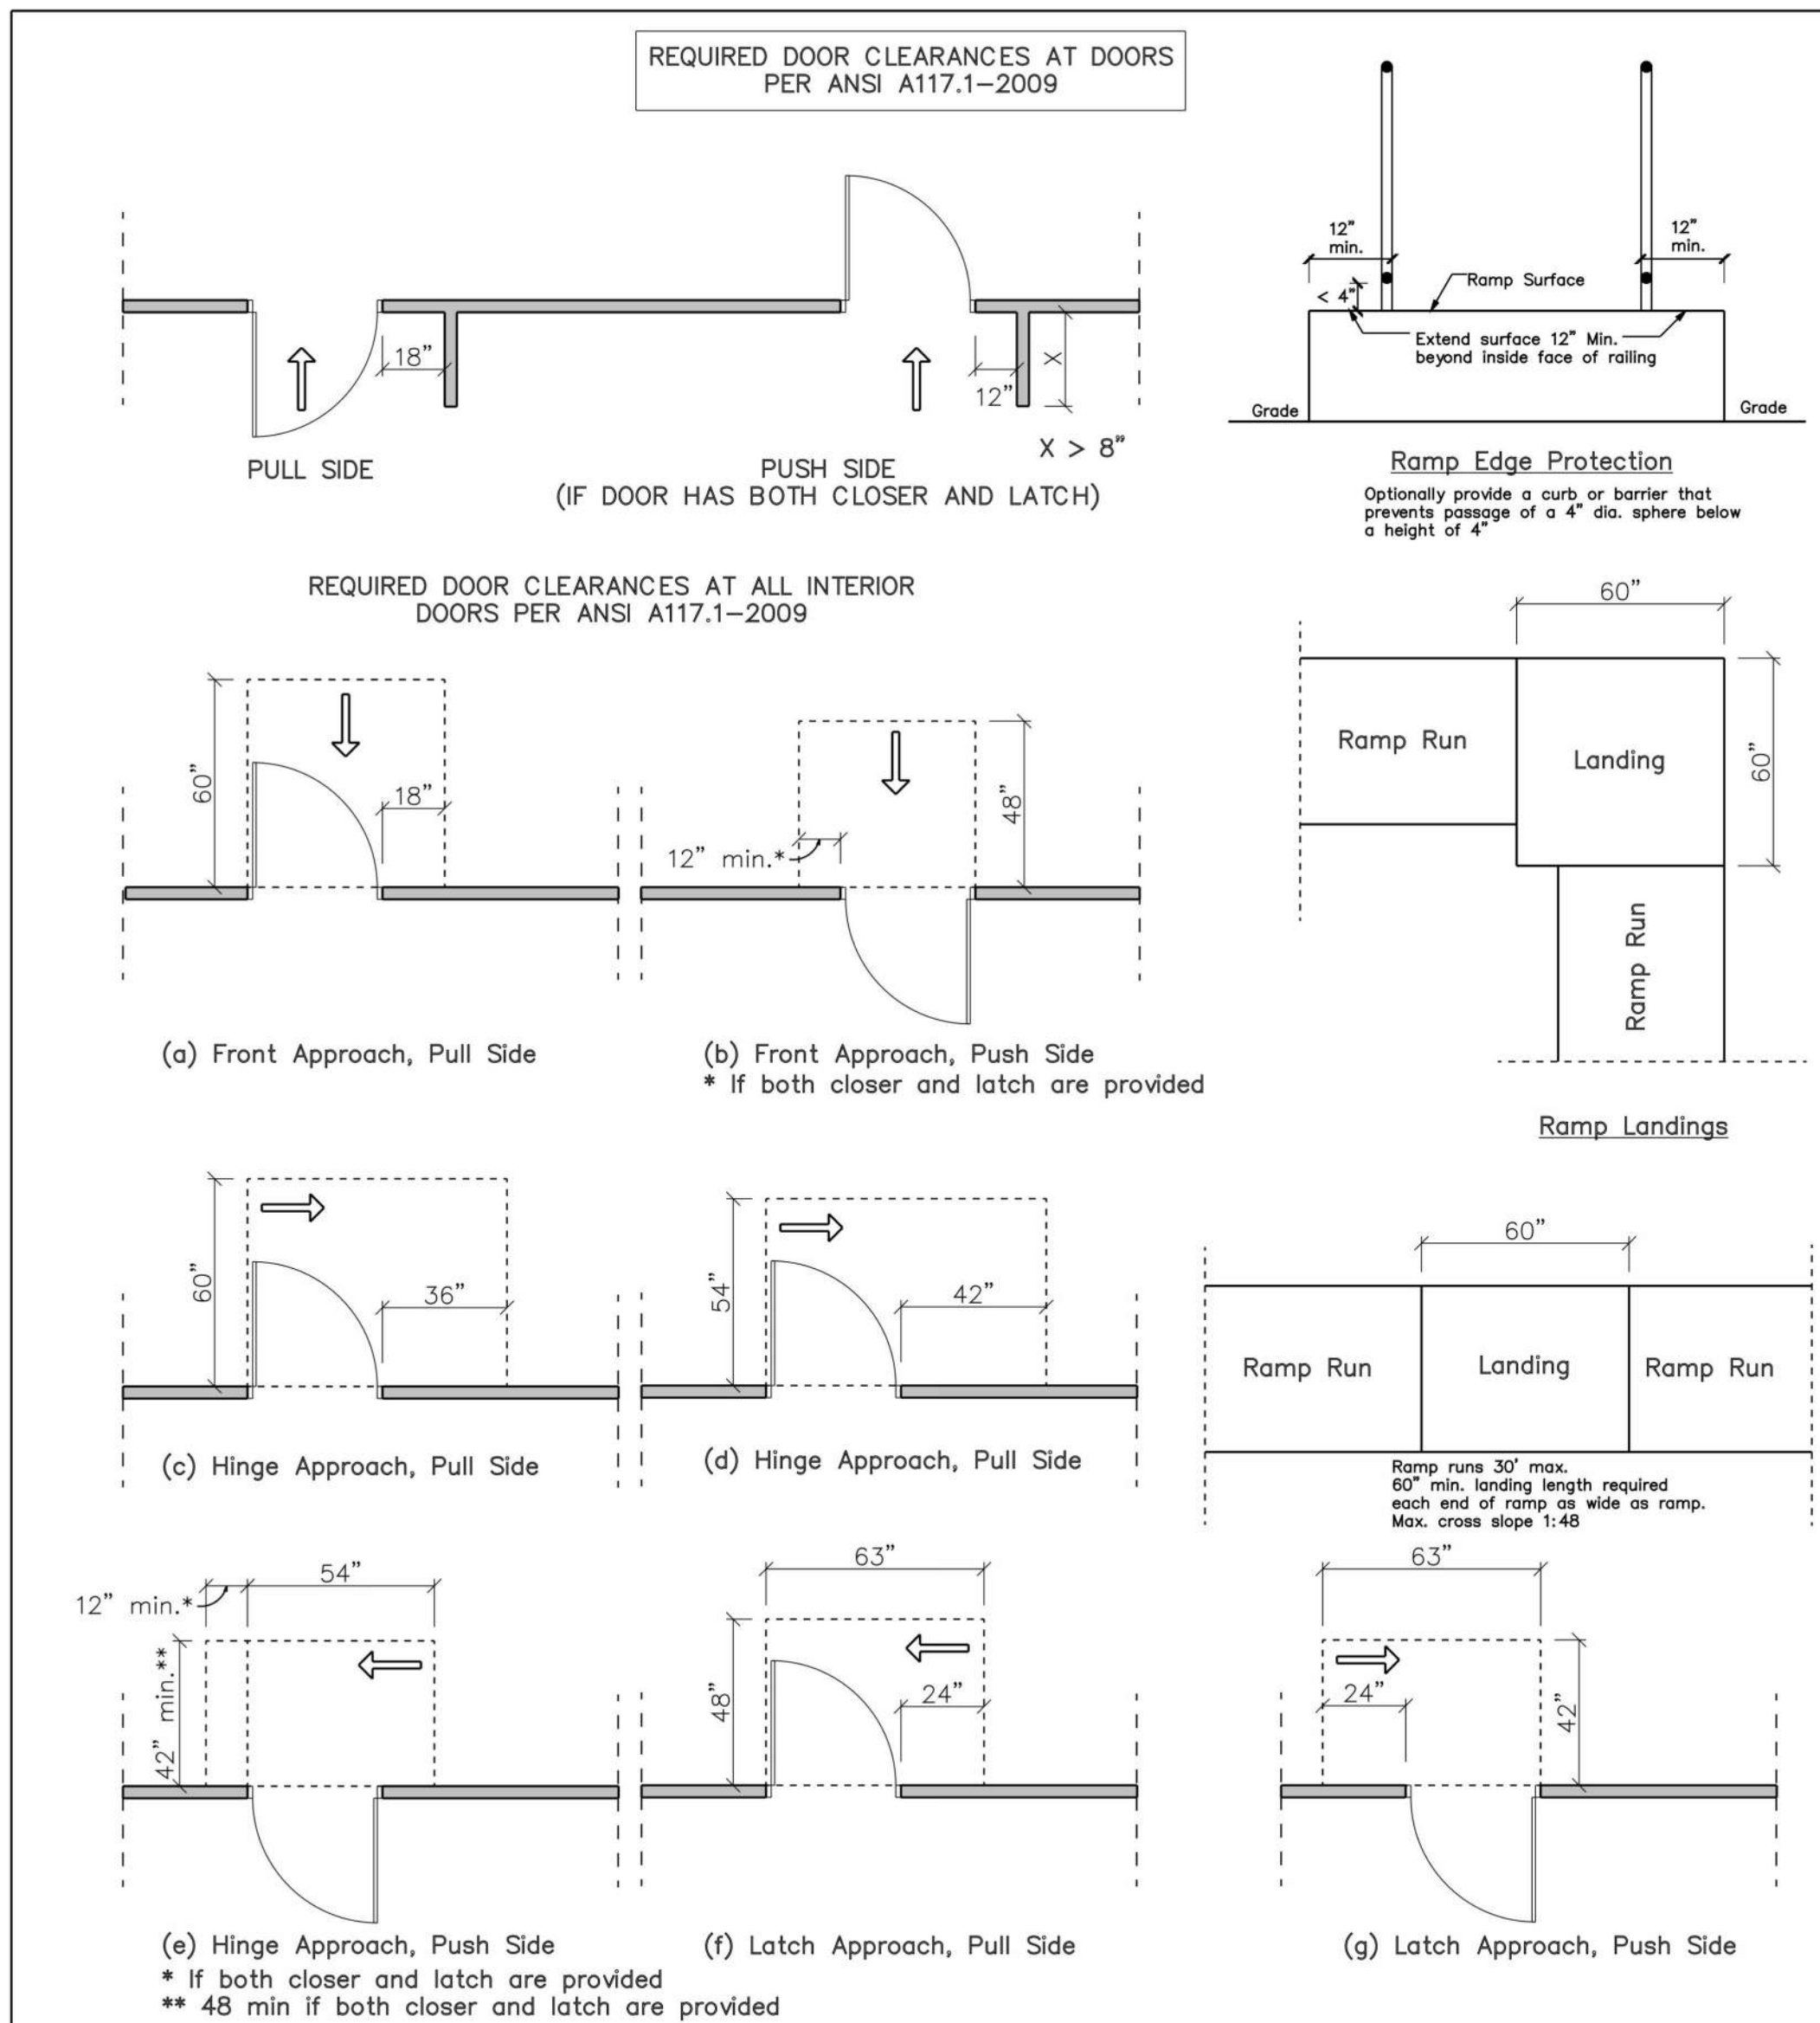

HANDICAP PARKING & ACCESS AISLES

IBC 1104.1 - At least one accessible route within the site shall be provided from public transportation stops, accessible parking, accessible passenger loading zones, and public streets or sidewalks to the accessible building entrance served.

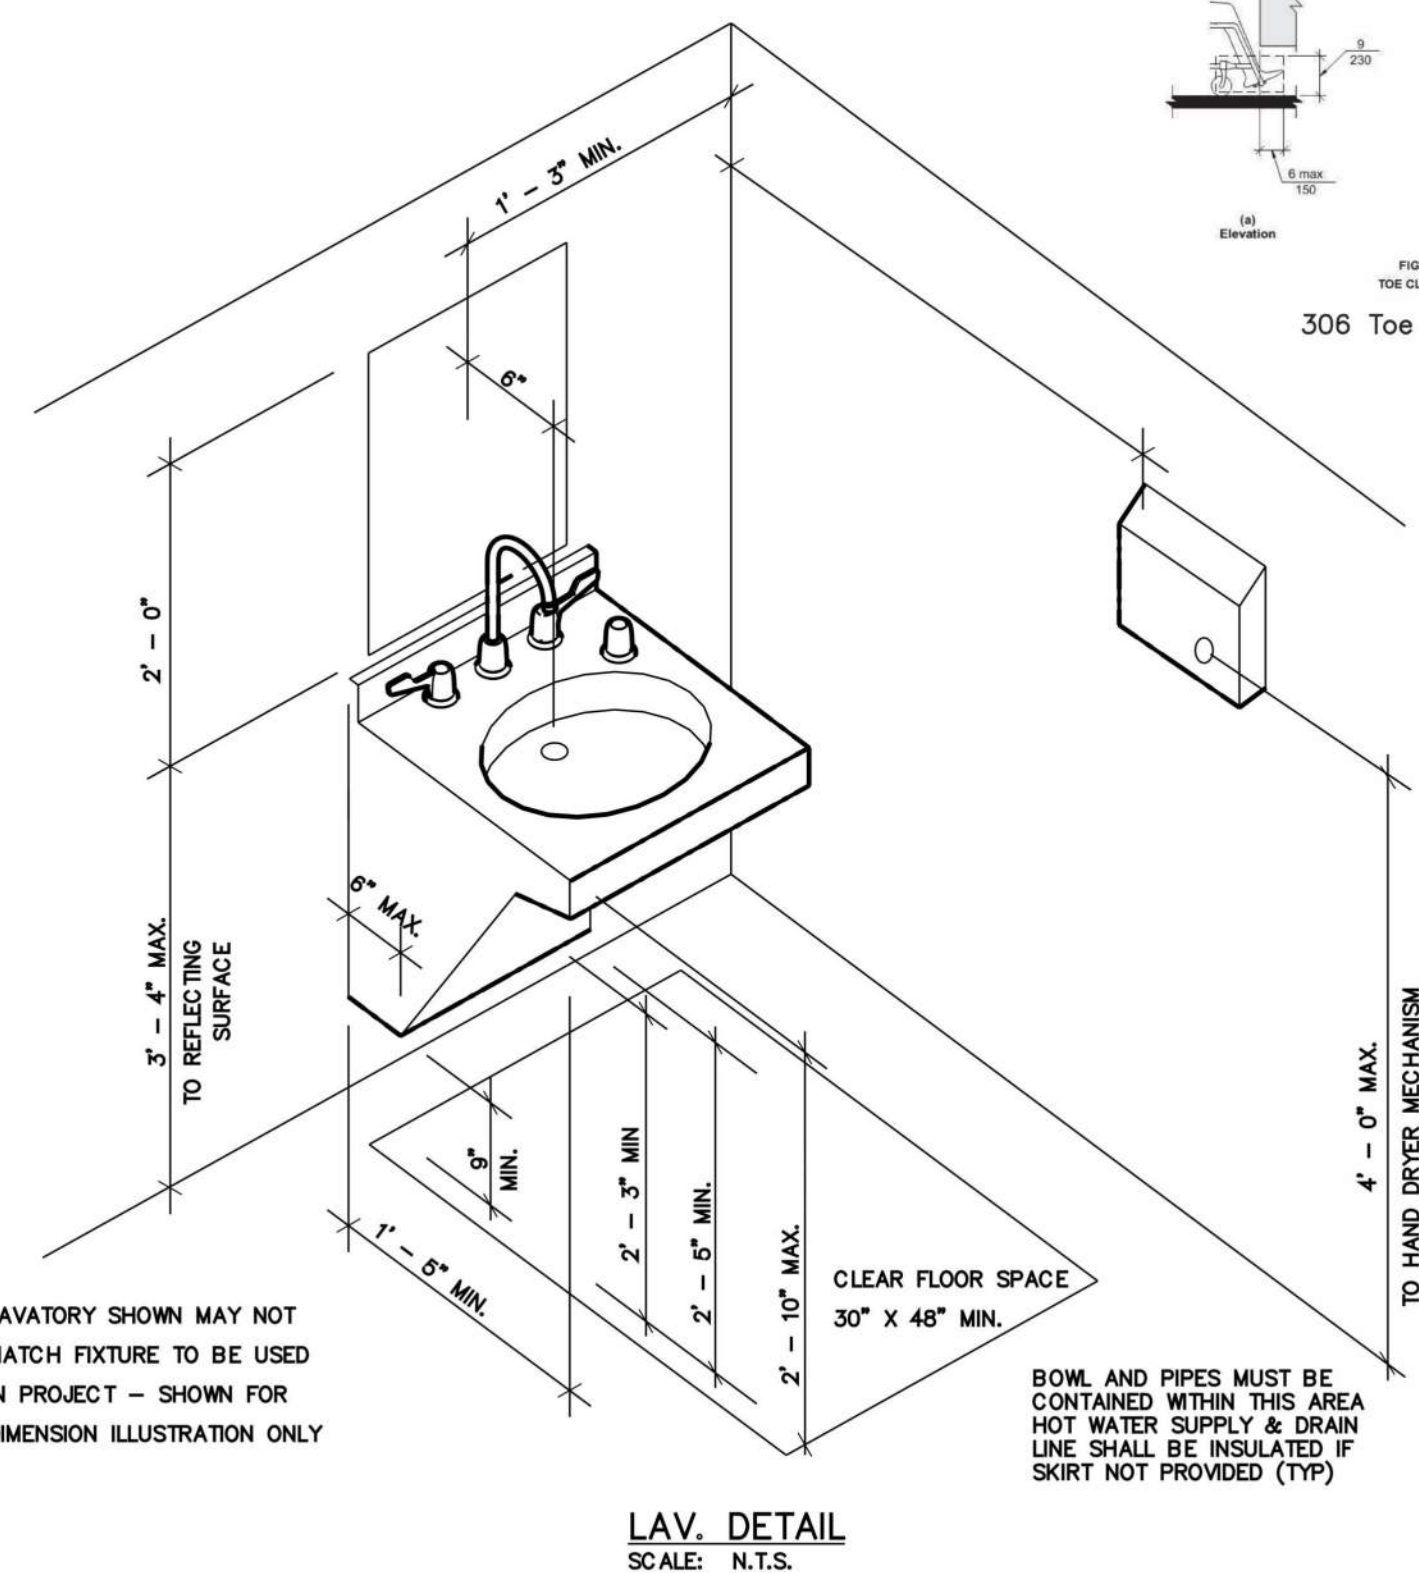

LAV. DETAIL
SCALE: N.T.S.

Marathon Technical Services LLC
1699 Schofield Ave. Suite 115
Schofield, WI 54476
Phone & Fax (715) 843-7292
www.mtsllc.net

ICC/ANSI A117.1 - 2009
ACCESSIBILITY STANDARDS


REVISION DATE:

DEC 31, 2025


SEAR'D
723 NEW YORK AVE
SHEBOYAN, WI 53081

A108

DATE: DEC 31, 2025
PROJECT NUMBER:
DRAWN BY: BB
CHECKED BY: NB
Copyright 2025

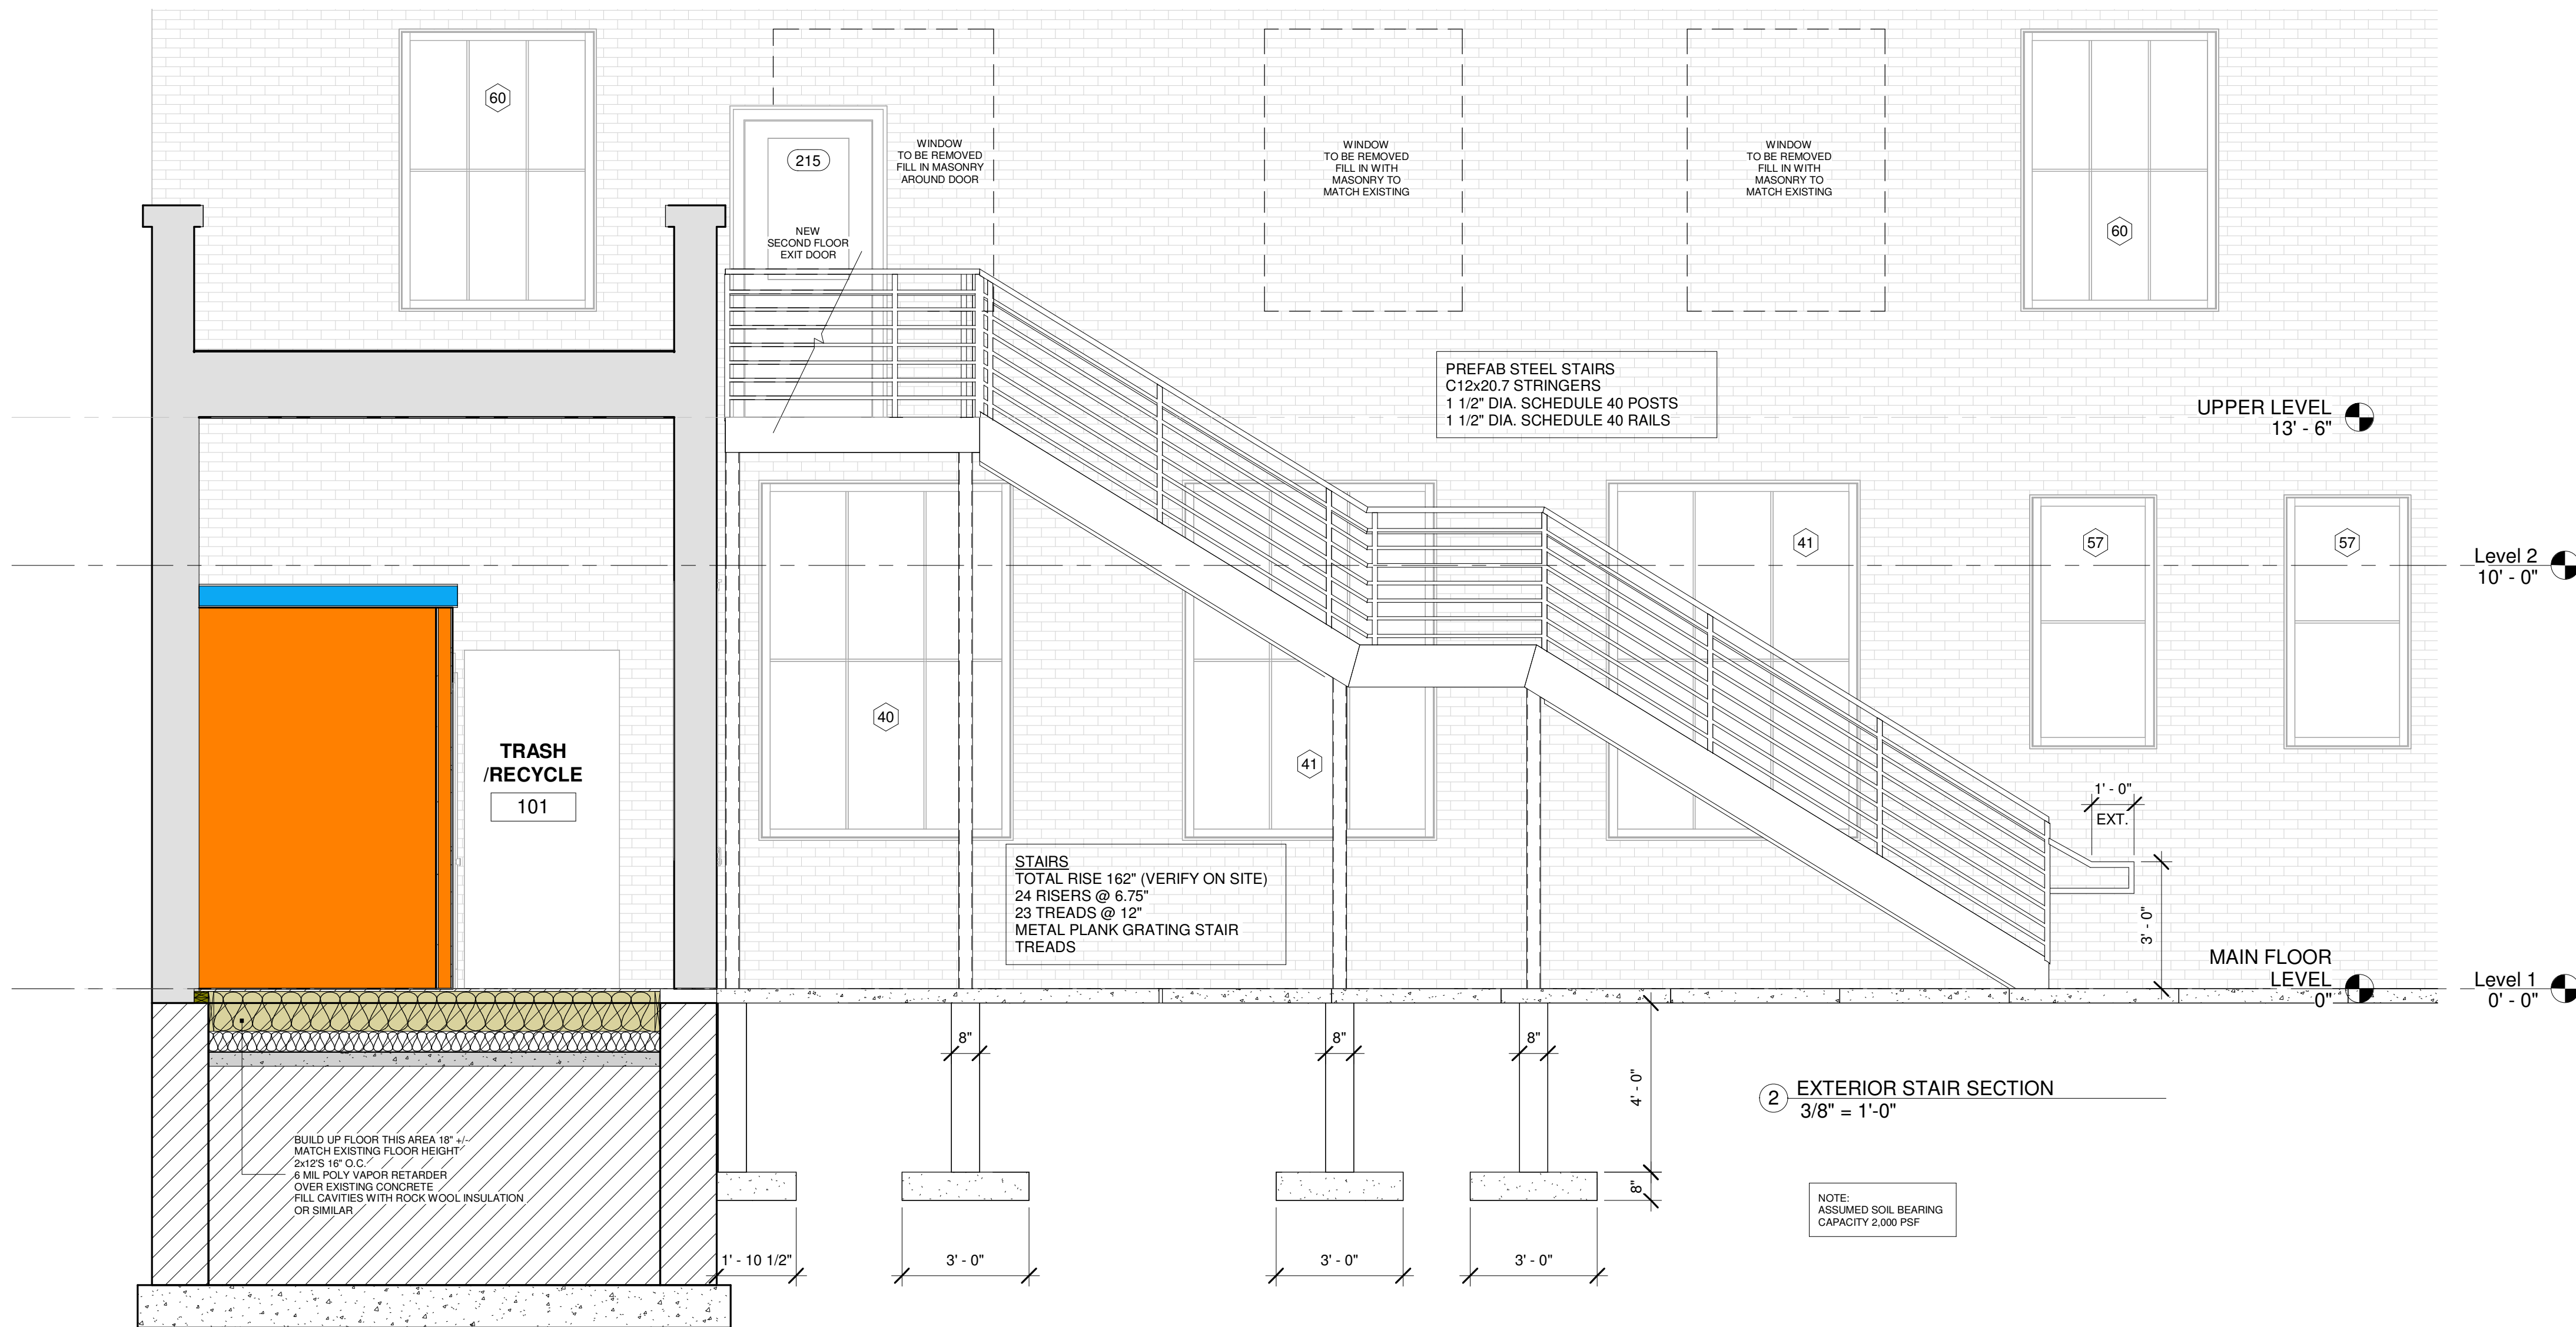

2 EXTERIOR STAIR SECTION
3/8" = 1'-0"

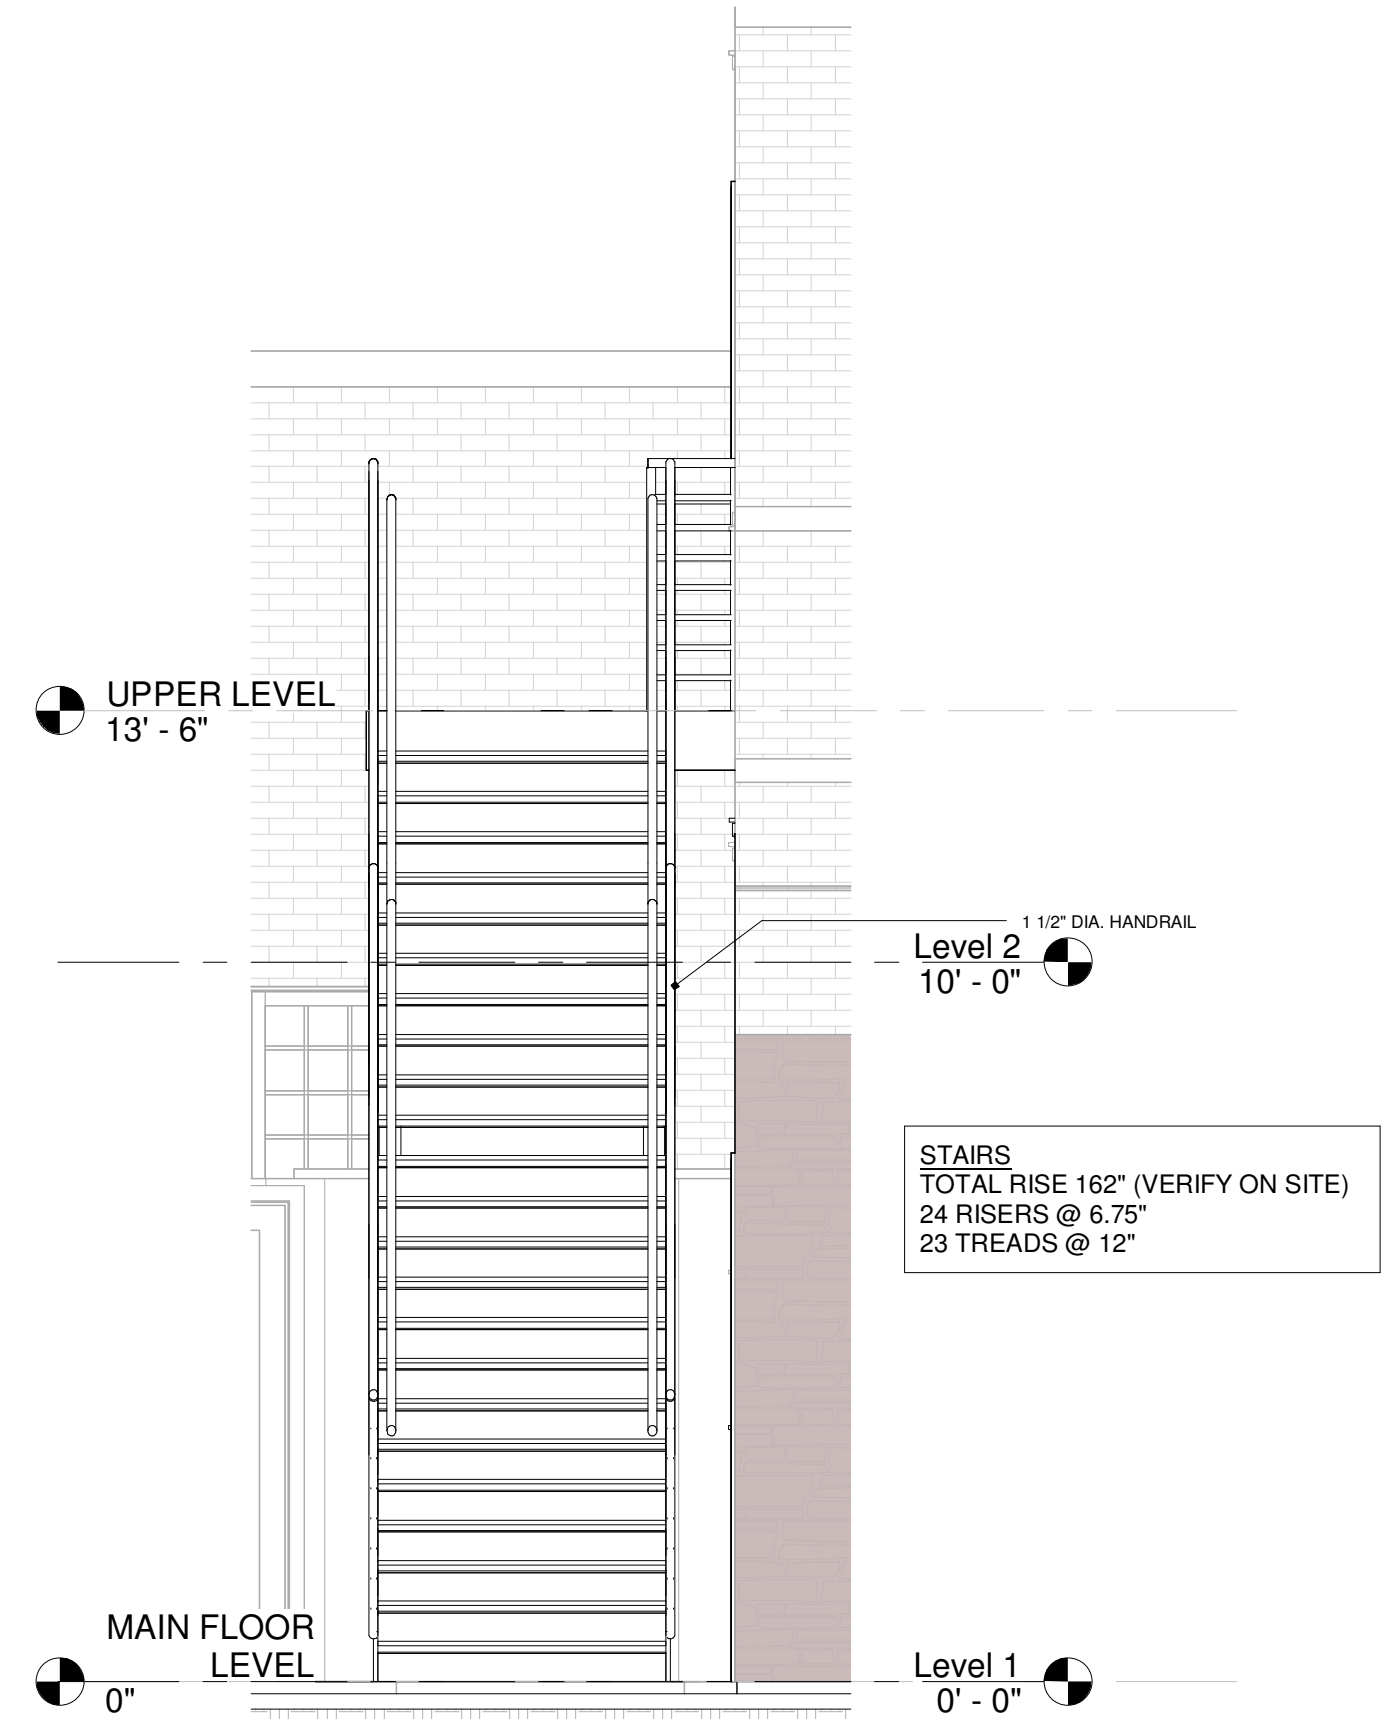


3 EXTERIOR STAIR ELEVATION
3/8" = 1'-0"

DOOR SCHEDULE										
TAG	WIDTH	HEIGHT	TYPE	SLAB TYPE	DOOR CONSTRUCTION	GLAZING VALUES	ASSEMBLY FIRE RATING	HARDWARE GROUP	HEADER / LINTEL	DESCRIPTION
101	6'- 0"	7'- 0"	EXISTING	FLUSH	STEEL			GROUP 4	EXISTING	EXISTING STEEL INSULATED DOOR IN STEEL FRAME
114	3'- 0"	7'- 0"	NEW	FLUSH	WOOD			GROUP 8	2X8 FRAMING	INTERIOR FLUSH PREHUNG DOOR IN WOOD FRAME
118	3'- 0"	7'- 0"	NEW	FLUSH	WOOD			GROUP 8	2X8 FRAMING	INTERIOR FLUSH PREHUNG DOOR IN WOOD FRAME
119	3'- 0"	7'- 0"	NEW	FLUSH	WOOD			GROUP 3	2X8 FRAMING	INTERIOR FLUSH PREHUNG DOOR IN WOOD FRAME
120	3'- 0"	7'- 0"	NEW	FLUSH	WOOD			GROUP 1	2X8 FRAMING	INTERIOR FLUSH PREHUNG DOOR IN WOOD FRAME
122	3'- 0"	7'- 0"	NEW	FLUSH	WOOD			GROUP 9	2X8 FRAMING	INTERIOR FLUSH PREHUNG DOOR IN WOOD FRAME
124	3'- 0"	7'- 0"	NEW	FLUSH	WOOD			GROUP 1	2X8 FRAMING	INTERIOR FLUSH PREHUNG DOOR IN WOOD FRAME
125	3'- 0"	7'- 0"	NEW	FLUSH	WOOD			GROUP 7	2X8 FRAMING	DOUBLE ACTING INTERIOR DOOR WITH PUSH PULL HARDWARE
135	3'- 0"	7'- 0"	NEW	FLUSH	WOOD		60 MIN.	GROUP 1	2X8 FRAMING	INTERIOR FLUSH PREHUNG DOOR IN WOOD FRAME
137	3'- 0"	7'- 0"	NEW	HALF LT	STEEL	INSULATED		GROUP 6	STEEL LINTEL	PREFINISHED STEEL HALF LITE DOOR WITH CLAD FRAME AND LOW PROFILE SILL
138	3'- 0"	7'- 0"	NEW	FLUSH	WOOD			GROUP 3	2X8 FRAMING	INTERIOR FLUSH PREHUNG DOOR IN WOOD FRAME
141	3'- 0"	7'- 0"	NEW	FLUSH	WOOD		90 MIN.	GROUP 6	2X8 FRAMING	INTERIOR FLUSH PREHUNG DOOR IN WOOD FRAME
202	3'- 0"	7'- 0"	NEW	FLUSH	WOOD			GROUP 2	2X8 FRAMING	INTERIOR FLUSH PREHUNG DOOR IN WOOD FRAME
203	3'- 0"	7'- 0"	NEW	FLUSH	WOOD			GROUP 8	2X8 FRAMING	INTERIOR FLUSH PREHUNG DOOR IN WOOD FRAME
204	3'- 0"	7'- 0"	NEW	FLUSH	WOOD			GROUP 8	2X8 FRAMING	INTERIOR FLUSH PREHUNG DOOR IN WOOD FRAME
207	3'- 0"	7'- 0"	NEW	FLUSH	WOOD			GROUP 8	2X8 FRAMING	INTERIOR FLUSH PREHUNG DOOR IN WOOD FRAME
208	3'- 0"	7'- 0"	NEW	FLUSH	WOOD			GROUP 8	2X8 FRAMING	INTERIOR FLUSH PREHUNG DOOR IN WOOD FRAME
209	3'- 0"	7'- 0"	NEW	FLUSH	WOOD			GROUP 8	2X8 FRAMING	INTERIOR FLUSH PREHUNG DOOR IN WOOD FRAME
211	3'- 0"	7'- 0"	NEW	FLUSH	WOOD			GROUP 9	2X8 FRAMING	INTERIOR FLUSH PREHUNG DOOR IN WOOD FRAME
212	3'- 0"	7'- 0"	NEW	FLUSH	WOOD		20 MIN.	GROUP 3	2X8 FRAMING	INTERIOR FLUSH PREHUNG DOOR IN WOOD FRAME
213	6'- 0"	7'- 0"	EXISTING	FLUSH	STEEL			N/A	EXISTING	EXISTING STEEL INSULATED DOOR IN STEEL FRAME
215	3'- 0"	7'- 0"	NEW	HALF LT	STEEL	INSULATED		GROUP 6	STEEL LINTEL	PREFINISHED STEEL HALF LITE DOOR WITH CLAD FRAME AND LOW PROFILE SILL
EX1	3'- 0"	7'- 0"	EXISTING	FULL LT	ALUMINUM	INSULATED		GROUP 4	EXISTING	EXISTING ALUMINUM STOREFRONT DOOR
EX2	3'- 0"	7'- 0"	EXISTING	FULL LT	ALUMINUM	INSULATED		GROUP 4	EXISTING	EXISTING ALUMINUM STOREFRONT DOOR
EX3	3'- 0"	7'- 0"	EXISTING	FULL LT	ALUMINUM	INSULATED		GROUP 4	EXISTING	EXISTING ALUMINUM STOREFRONT DOOR

HARDWARE GROUPS

GROUP 1 = STORAGE LOCK, B.B. HINGES AND WALL BUMPER WHERE OPENS AGAINST WALL
GROUP 2 = PRIVACY LOCK, B.B. HINGES, WALL BUMPER WHERE OPENS AGAINST WALL
GROUP 3 = PASSAGE LOCK, B.B. HINGES, WALL BUMPER WALL STOP WHERE OPENS AGAINST WALL
GROUP 4 = ENTRANCE LOCK, PUSH/PULL, B.B. HINGES, WALL BUMPER WALL STOP WHERE OPENS AGAINST WALL
GROUP 5 = OFFICE/ENTRANCE LOCK, B.B. HINGES, WALL BUMPER WALL STOP WHERE OPENS AGAINST WALL
GROUP 6 = RIM LATCH PANIC DEVICE, B.B. HINGES, WALL BUMPER WALL STOP WHERE OPENS AGAINST WALL
GROUP 7 = CAFE DOUBLE ACTING SPRING HINGES WITH PUSH PLATE ON BOTH SIDES OF DOOR
GROUP 8 = PUSH/PULL, B.B. HINGES, WALL BUMPER WALL STOP WHERE OPENS AGAINST WALL
GROUP 9 = ELECTRONIC LOCK LEVER HARDWARE BY LIFT MANUFACTURER


TYPICAL LEVER HANDLE DOOR HARDWARE

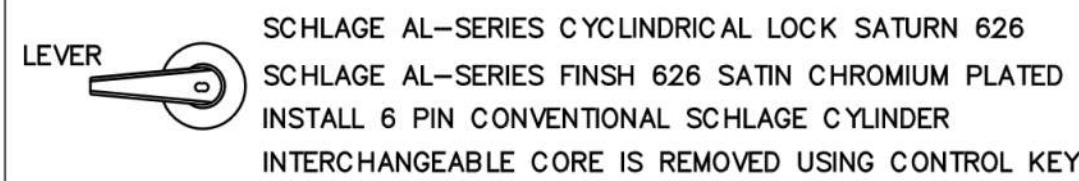

ALL DOORS TO BE KEYED WITH MASTER KEY CAPABILITIES
CONTRACTOR TO COORDINATE LOCKSETS & KEYING WITH OWNER

ATTENTION - PLEASE NOTE:

1. ALL ACCESSIBLE LEVEL DOORS REQUIRE ADA LEVER TYPE HARDWARE. ROCKWOOD OR EQUAL PULLS, PLATES & WALL BUMPERS
2. ALL DOOR HINGES TO BE BALL BEARING (B.B.) TYPE
3. ALL FINISHES, TRIM & HARDWARE SELECTED BY OWNER FROM SAMPLES PROVIDED BY CONTIRACTOR
4. ALL DOOR HEADERS IN WOOD BEARING WALLS WHICH SPAN GREATER THAN 72" REQUIRE (2) SHOULDER STUDS
5. ALL EXTERIOR WALL HEADERS TO BE INSULATED
6. ALL DOOR CLOSING DEVICES TO BE NORTON, LCN, KAWNEER OR EQUAL
7. VERIFY UNDERCUT OR AIRFLOW GRILLE REQUIREMENTS FOR RESTROOM DOORS WITH HVAC DESIGN

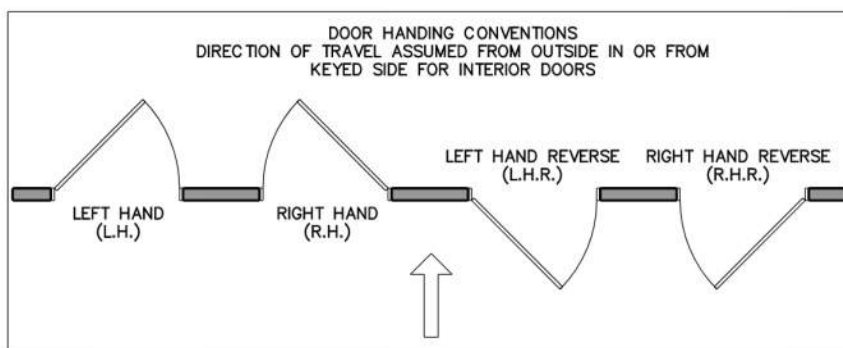


WINDOW SCHEDULE					
TAG	UNIT DIMENSION		Comments	SAFETY GLAZING	GLAZING VALUE
	Width	Height			
40	6'- 0"	8'- 6"	EXISTING WINDOWS TO REMAIN		
41	6'- 0"	8'- 6"	STOREFRONT GLAZING CUSTOM FIT TO MASONRY OPENING	YES	
47	5'- 0"	6'- 0"	STOREFRONT GLAZING CUSTOM FIT TO MASONRY OPENING		
46	4'- 8"	6'- 8"	EXISTING WINDOWS TO REMAIN		
57	3'- 0"	6'- 0"	STOREFRONT GLAZING CUSTOM FIT TO MASONRY OPENING		
58	3'- 4"	6'- 8"	EXISTING WINDOWS TO REMAIN		
59	3'- 2"	6'- 8"	EXISTING WINDOWS TO REMAIN		
60	4'- 8"	6'- 8"	STOREFRONT GLAZING CUSTOM FIT TO MASONRY OPENING		
Grand total: 23					


Grand total: 23

EXISTING GLASS STOREFRONT SCHEDULE								
TAG	Count	Family and Type	Length	Height	Area	Glazing Values	Type Finish Description	Comments
1		Curtain Wall: STOREFRONT CURTAIN WALL D1	13' - 2 3/4"	7' - 0"	91 SF		DARK BRONZE ALUM.	EXISTING
1		Curtain Wall: STOREFRONT CURTAIN WALL D1	13' - 2 3/4"	7' - 0"	91 SF		DARK BRONZE ALUM.	EXISTING
1		Curtain Wall: STOREFRONT CURTAIN WALL AIR LOCK	2' - 0"	9' - 0"	18 SF		DARK BRONZE ALUM.	EXISTING
1		Curtain Wall: STOREFRONT CURTAIN WALL AIR LOCK	2' - 0"	9' - 0"	18 SF		DARK BRONZE ALUM.	EXISTING
1		Curtain Wall: STOREFRONT CURTAIN WALL AIR LOCK	2' - 0"	9' - 0"	18 SF		DARK BRONZE ALUM.	EXISTING
1		Curtain Wall: STOREFRONT CURTAIN WALL AIR LOCK	2' - 0"	9' - 0"	18 SF		DARK BRONZE ALUM.	EXISTING

Grand total: 6

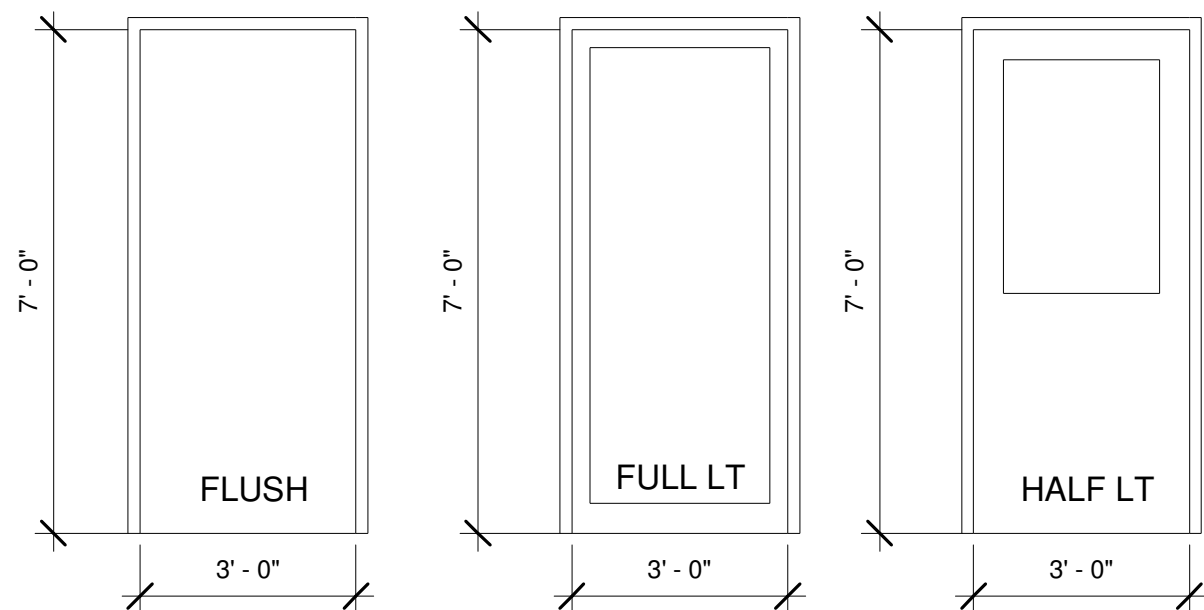

REVISION DATE
DEC 31, 2025

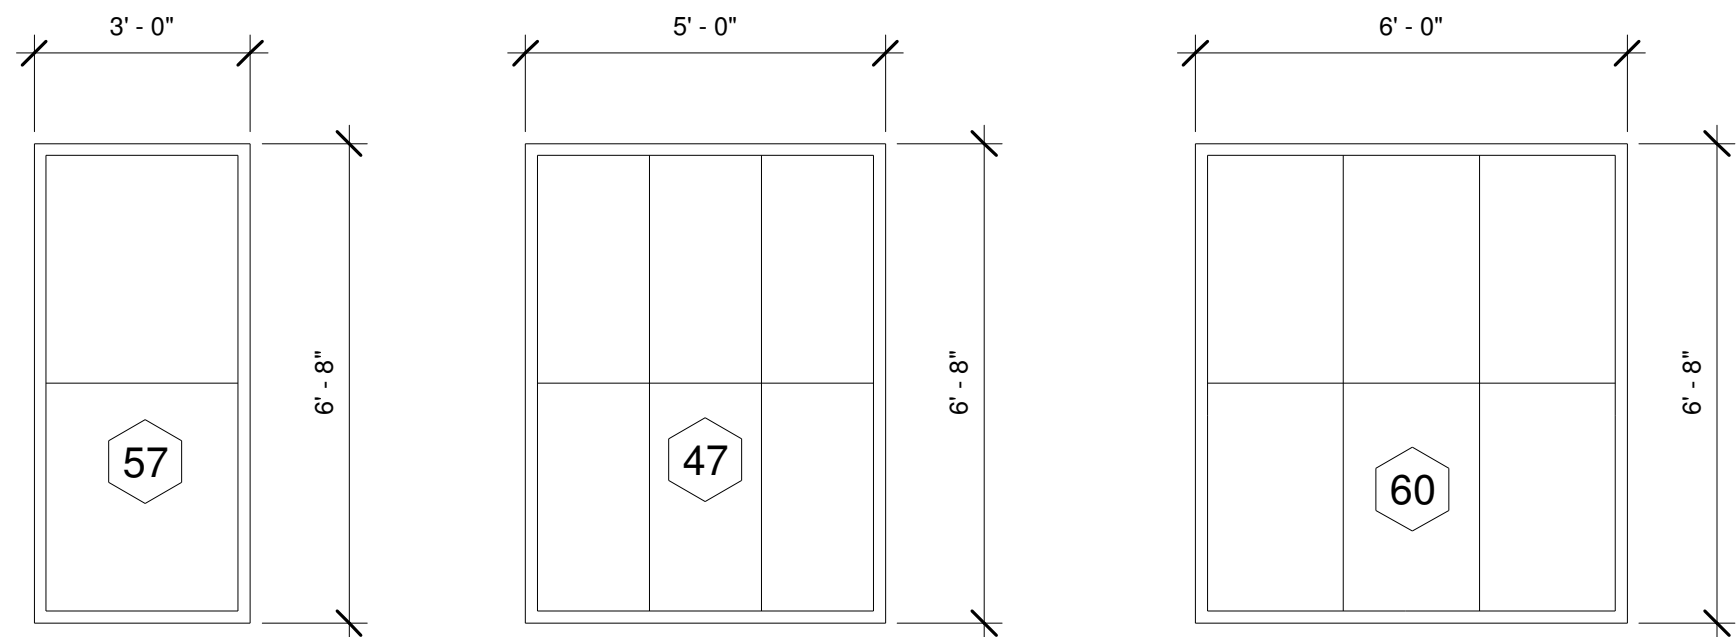

① WINDOW DETAILS
3/8" = 1'-0"

ROOM FINISH SCHEDULE							
TAG	ROOM	FLOOR FINISH	BASE	WALL FINISH	CEILING TYPE	CEILING HT.	COMMENTS
101	TRASH /RECYCLE	EXISTING CONCRETE SLAB	4" VINYL BASE	EXISTING BRICK EXTERIOR	N/A		6
114	MENS	TILE	4" VINYL BASE	5/8" DRYWALL, TAPED, TEXTURED, PAINTED	2x2' ACT	9'- 0"	3
118	WOMENS	TILE	4" VINYL BASE	5/8" DRYWALL, TAPED, TEXTURED, PAINTED	2x2' ACT	9'- 0"	3
119	MECH	EXISTING CONCRETE SLAB	4" VINYL BASE	5/8" DRYWALL, TAPED, TEXTURED, PAINTED	OPEN	10'- 6"	2
120	STORAGE	EXISTING CONCRETE SLAB	4" VINYL BASE	5/8" DRYWALL, TAPED, TEXTURED, PAINTED	2x2' ACT	9'- 0"	1
121	COOLER	SEALED CONCRETE	4" VINYL BASE	INSULATED MODULAR PANELS	INSULATED MODULAR PANEL ROOF		2
122	LIFT	COMMERCIAL LVP	4" VINYL BASE	5/8" DRYWALL, TAPED, TEXTURED, PAINTED	MATTE BLACK PAINTED CEILING FRAMING		2
124	CUST.	COMMERCIAL LVP	4" VINYL BASE	5/8" DRYWALL, TAPED, TEXTURED, PAINTED	2x2' ACT	9'- 0"	1
125	KITCHEN	SEALED CONCRETE	4" VINYL BASE	FPR PANEL OVER 5/8" DRYWALL, TAPED AND PRIMED	2x2' CLEAN ROOM VINYL FACE CEILING TILE	10'- 0"	5
126	BAR / MAIN DINING	COMMERCIAL LVP	4" VINYL BASE	5/8" DRYWALL, TAPED, TEXTURED, PAINTED	2x2' ACT	10'- 6"	70
132	OUTDOOR SEATING	EXISTING CONCRETE SLAB	N/A	EXISTING BRICK EXTERIOR	N/A		0
133	OUTDOOR STORAGE	EXISTING CONCRETE SLAB	N/A	EXISTING BRICK EXTERIOR	N/A		0
135	BAR STORAGE						1
138	CELLAR	EXISTING CONCRETE SLAB	N/A	N/A	N/A		
142	WAIT STATION	COMMERCIAL LVP	4" VINYL BASE	5/8" DRYWALL, TAPED, TEXTURED, PAINTED	2x2' ACT	10'- 6"	2
202	MECH	EXISTING CONCRETE SLAB	N/A	5/8" DRYWALL, TAPED, TEXTURED, PAINTED	2x2' ACT	9'- 0"	2
203	MENS	COMMERCIAL LVP	4" VINYL BASE	5/8" DRYWALL, TAPED, TEXTURED, PAINTED	2x2' ACT	9'- 0"	3
204	WOMENS	COMMERCIAL LVP	4" VINYL BASE	5/8" DRYWALL, TAPED, TEXTURED, PAINTED	2x2' ACT	9'- 0"	3
205	BAR	COMMERCIAL LVP	4" VINYL BASE	5/8" DRYWALL, TAPED, TEXTURED, PAINTED	MATTE BLACK PAINTED CEILING FRAMING	12'- 0"	9
206	UPPER DINING	COMMERCIAL LVP	4" VINYL BASE	5/8" DRYWALL, TAPED, TEXTURED, PAINTED	MATTE BLACK PAINTED CEILING FRAMING	12'- 0"	60
207	KARAOKE	CARPET	4" VINYL BASE	5/8" DRYWALL, TAPED, TEXTURED, PAINTED	2x2' ACT	10'- 0"	6
208	KARAOKE	CARPET	4" VINYL BASE	5/8" DRYWALL, TAPED, TEXTURED, PAINTED	2x2' ACT	10'- 0"	6
209	KARAOKE	CARPET	4" VINYL BASE	5/8" DRYWALL, TAPED, TEXTURED, PAINTED	2x2' ACT	10'- 0"	6
210	WAIT STATION	COMMERCIAL LVP	4" VINYL BASE	5/8" DRYWALL, TAPED, TEXTURED, PAINTED	MATTE BLACK PAINTED CEILING FRAMING	12'- 0"	2
211	LIFT	COMMERCIAL LVP	4" VINYL BASE	5/8" DRYWALL, TAPED, TEXTURED, PAINTED	MATTE BLACK PAINTED CEILING FRAMING	12'- 0"	2
212	A.O.R.						1
B01	PARTIAL BASEMENT	EXISTING CONCRETE SLAB	N/A	N/A	N/A		

