
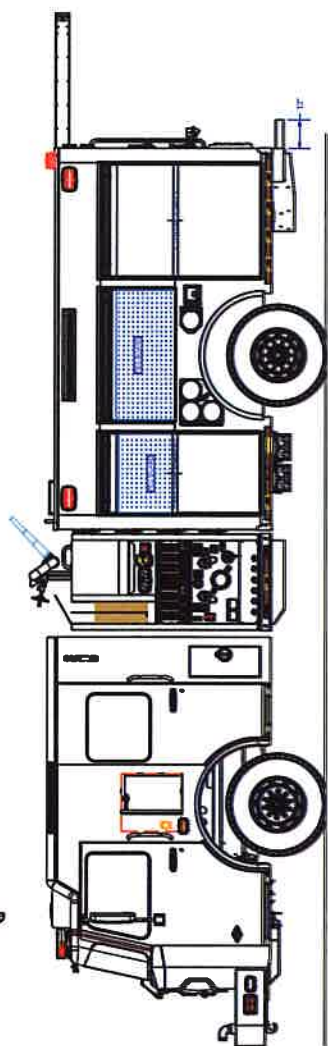
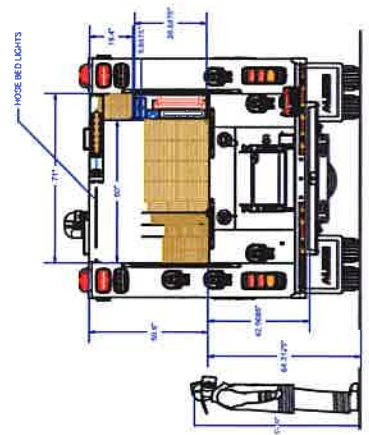
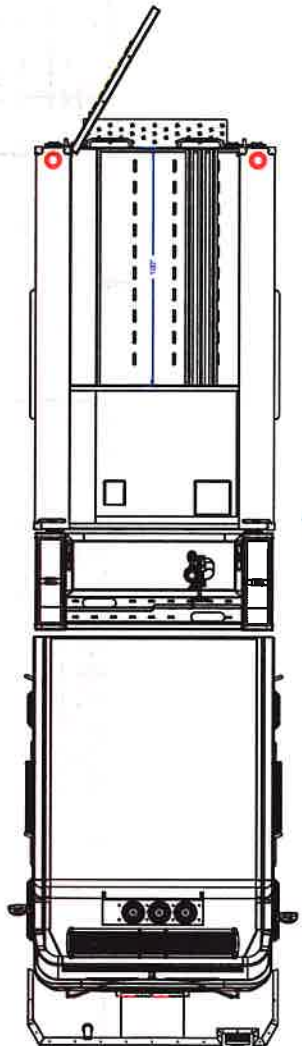
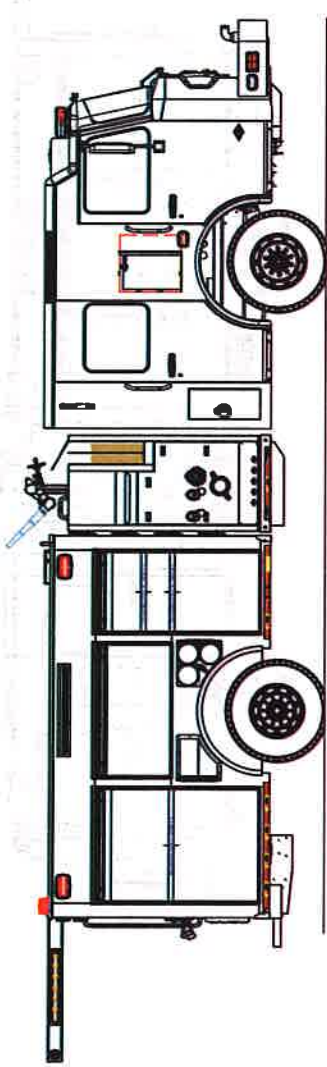


TOMBALL-0001

DATE

CUSTOMER APPROVAL SIGNATURE

IN THE EVENT THERE ARE DISCREPANCIES BETWEEN THE DRAWING AND THE SPECIFICATIONS THE SPECIFICATIONS SHALL PREVAIL

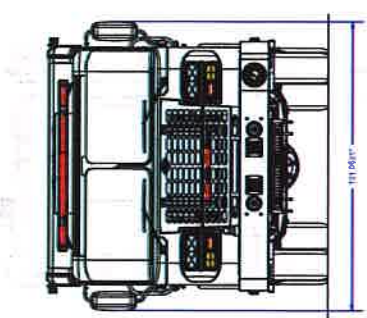

ALEXIS FIRE EQUIPMENT CO.
P.O. BOX 409 ALEXIS, TEXAS 75822

SIDE CONTROL PUMPER
TOMBALL FIRE DEPARTMENT
TOMBALL, TX

DATE 7/26/22
BY J. HENNING
P-A22

COMPARTMENT DIMENSIONS

COMP #	DOOR OPENING SIZES
1 & 2	33" WIDE X 5'4" HIGH X 1'10" DEEP
3 & 4	54" WIDE X 2'7" HIGH X 1'1" DEEP
5 & 6	40" WIDE X 4'4" HIGH X 1'2" DEEP
7 & 8	4'7" WIDE X 3'5" HIGH X 2'2" DEEP

Part #	Approximate Type	Approximate Weight
1	Engine	2000
2	Water Tank	2000
3	Water Tank	2000
4	Water Tank	2000
5	Water Tank	2000
6	Water Tank	2000
7	Water Tank	2000
8	Water Tank	2000

Part #	Approximate Type	Approximate Weight
1	Engine	2000
2	Water Tank	2000
3	Water Tank	2000
4	Water Tank	2000
5	Water Tank	2000
6	Water Tank	2000
7	Water Tank	2000
8	Water Tank	2000

