

ORDINANCE NO. 1453-21

AN ORDINANCE RELATING TO THE STORMWATER MASTER PLAN; AMENDING THE TUALATIN COMPREHENSIVE PLAN; AND AMENDING TUALATIN DEVELOPMENT CODE SECTIONS 74.630 and 74.640 (PTA 21-0001).

WHEREAS, the City updated its Stormwater Master Plan;

WHEREAS, the Council wishes to amend the Tualatin Comprehensive Plan and Tualatin Development Code to adopt Stormwater Master Plan (2019) and establish new goals and policies related to stormwater;

WHEREAS, upon the application of Community Development Department, a public hearing was held before the City Council of the City of Tualatin, to consider adopting the proposed amendments to the Tualatin Comprehensive Plan and Tualatin Development Code;

WHEREAS, the City provided notice of proposed amendments to the Oregon Department of Land Conservation and Development, as provided in ORS 197.610;

WHEREAS, the City provided notice of the public hearing, as required by TDC 32.250 and TDC 33.070;

WHEREAS, at the public hearing, the Council heard and considered the testimony and evidence presented by City staff, and those appearing at the public hearing, and approved the proposed amendments; and

WHEREAS, the Council finds the proposed amendments to be in the best interest of the residents and inhabitants of the City and the public, the public interest will be served by adopting the amendments at this time, and the amendments conform to the Tualatin Community Plan and Tualatin Development Code.

THE CITY OF TUALATIN ORDAINS AS FOLLOWS:

**Section 1.** The “Tualatin Drainage Plan and Surface Water Management” section of Chapter 9 (Public Facilities and Services) of the Tualatin Comprehensive Plan is retitled “Stormwater Management” and amended to read as follows:

**DRAINAGE PLAN AND SURFACE WATER STORMWATER MANAGEMENT**

~~The Tualatin Drainage Plan is the City's drainage plan. It was originally prepared by Robert A. Wright, Consulting Engineers in 1972 and adopted in 1975 (Ord. 280-75) and in 1979 as an element of the Tualatin Community Plan (Ord. 491-79). The Tualatin Drainage Plan is referenced in the Technical Memoranda. With the supporting technical material, the Tualatin Drainage Plan provides an overall view of the drainage system, its major problems and their solutions, and is the City's stormwater and surface water drainage policy.~~

~~The Tualatin Drainage Plan was updated in the fall of 1995 by the Hedges Creek Subbasin Plan. The HCS Plan is outlined in Chapter 1 of the HCSS Report and implements the recommended drainage and stormwater management activities and facilities. The HCS Plan relies on the technical data and analysis documented in the HCSS report. The HCSS Report and the HCS Plan identify the critical importance of the Hedges Creek Marsh to drainage, stormwater management and water quality in the subbasin. The HCS Plan provides for drainage improvements, stormwater detention requirements and a number of non-structural activities for better management of water quantity and water quality in the Hedges Creek Subbasin.~~

~~Map 14-1 is from Figure I-1 of the HCS Plan. It shows the drainage pattern revisions and drainage system improvements for the Hedges Creek Subbasin. The drainage pattern revisions and drainage system improvements shown in Map 14-1 are incorporated into the Tualatin Drainage Plan.~~

~~The HCSS Report is a comprehensive technical document that provides data and analysis of stormwater drainage in the Hedges Creek Subbasin. From an analysis of several alternatives, the report recommended specific management activities and facilities to control water quantity and quality problems associated with urban stormwater runoff in the Hedges Creek Subbasin. The HCS Plan incorporates the report's recommended activities and facilities.~~

~~The Northwest Tualatin Concept Plan 2005 identifies stormwater drainage options for the area west of Cipole Road and south of Pacific Highway 99W.~~

~~The Southwest Tualatin Concept Plan 2010 identifies stormwater drainage options for the area south of SW Tualatin-Sherwood Road and east of SW 124th Avenue. Goals and Policies.~~

The Stormwater Master Plan (2019) is adopted as a background document to the Comprehensive Plan as seen in Part II. Capital projects and related information is contained in the Stormwater Master Plan. The Plan supports regulatory directives under Clean Water Services (CWS).

Goal 9.3 Provide a plan for routing surface drainage through the City, utilizing the natural drainages where possible. Update the plan as needed with drainage studies of problem areas and to respond to changes in the drainage pattern caused by urban development.

Policy 9.3.1 Coordinate the City's ~~Drainage Plan~~ and Stormwater Management regulations with the City's Floodplain District, Wetland Protection District and Natural Resource Protection Overlay District regulations, and with the plans of USA Clean Water Services and other regional, state, and federal agencies to achieve consistency among the plans.

Policy 9.3.2 Protect areas of the city with observed and/or reported instream erosion and hydromodification risk by requiring development to implement controls related to flow control.

Policy 9.3.3 Increase water quality treatment throughout the City by expanding treatment area coverage through water quality retrofits and enhancing the level of treatment provided. Continue working with state and regional agencies on surface water management and water quality. Reduce sediment and other pollutants reaching the public storm and surface water system by implementing the Oregon Department of Environmental Quality (DEQ) and USA requirements for surface water management and water quality in the Tualatin River basin. Reduce soil erosion, manage surface water runoff and improve surface water quality.

Policy 9.3.4 Identify and solve existing problems in the drainage system and plan for construction of drainage system improvements that support future development.

Policy 9.3.5 Provide standards for surface water management and water quality by which development will be reviewed and approved. Review and update the standards as needed.

Policy 9.3.6 Clearly indicate responsibilities for maintaining stormwater management and water quality facilities.

Policy 9.3.7 Enforce drainage and stormwater management standards.

Policy 9.3.8 Route stormwater runoff from the upper Hedges Creek Subbasin through the Wetland Protected Area marsh which as a wetland provides important drainage, stormwater management and water quality benefits.

Policy 9.3.9 Protect the Wetland Protected Area marsh and its important drainage, stormwater management and water quality functions in the Hedges Creek Subbasin.

Policy 9.3.10 Require new development to provide onsite pollution reduction facilities when necessary to treat stormwater runoff prior to entering Hedges Creek and protect the marsh from urban stormwater pollutants.

Policy 9.3.11 To reduce sedimentation and erosive stormwater flow volumes, require onsite stormwater detention facilities for new development in the Hedges Creek Subbasin upstream from the Wetland Protected Area marsh.

Policy 9.3.12 Consider opportunities to construct regional pollution reduction facilities to treat stormwater runoff prior to entering Hedges Creek and protect the marsh from urban stormwater pollutants.

Policy 9.3.13 Restrict beaver dam activity in the Wetland Protected Area marsh to retain the drainage flow through the marsh area and to reduce flooding between Teton Avenue and Tualatin Road. Implement beaver management techniques to selectively encourage/discourage beaver activity based on the characteristics of the stormwater drainage systems, topography, and vegetation.

Policy 9.3.14 As outlined in the HCS Plan, the City will a Coordinate with CWS with non-structural activities including to implement public education programs and water quality and management activity monitoring.

Policy 9.3.15 Comply with Metro's Urban Growth Management Functional Plan, Title 3.

Policy 9.3.16 Develop and support a program for continual public water quality facility maintenance, including both routine maintenance and larger system restoration and redesign as needed.

Policy 9.3.17 Validate and construct water quality retrofits, prioritizing project opportunities based on annual inspection efforts.

**Section 2.** Map 9-3 of Comprehensive Plan is adopted as set forth in Exhibit 1, which is attached and incorporated by reference.

**Section 3.** TDC 74.630 (Storm Drainage System) is amended to read as follows:

TDC 74.630. - Storm Drainage System.

(1) Storm drainage lines must be installed to serve each property in accordance with City standards and Clean Water Services standards. Storm drainage construction plans and calculations must be submitted to the City Manager for review and approval prior to construction.

(2) The storm drainage calculations must confirm that adequate capacity exists to serve the site. The discharge from the development must be analyzed in accordance with the City's Storm and Surface Water Regulations and Clean Water Services standards.

(3) If there are undeveloped properties adjacent to the proposed development site which can be served by the storm drainage system on the proposed development site, the applicant must extend storm drainage lines to the common boundary line with these properties. The lines must be sized to convey expected flows to include all future development from all up stream areas that will drain through the lines on the site, in accordance with the adopted Stormwater Master Plan Tualatin Drainage Plan in TDC Chapter 14.

**Section 4.** TDC 74.640 (Water Quality, Storm Water Detention and Erosion Control.) is amended to read as follows:

TDC 74.650. - Water Quality, Storm Water Detention and Erosion Control.

(1) All Applications. The applicant must comply with the water quality, stormwater detention, and erosion control requirements in the Surface Water Management Ordinance Tualatin Municipal Code Chapter 3-5 (Soil Erosion, Surface Water Management, Water Quality Facilities, and Building and Sewers) and Clean Water Services standards. If required:

~~(1) On subdivision and partition development applications, prior to approval of the final plat, the applicant must arrange to construct a permanent on-site water quality facility and storm water detention facility and submit a design and calculations indicating that the requirements of the Surface Water Management Ordinance will be satisfied and obtain a Stormwater Connection Permit from Clean Water Services; or~~

(2) Subdivisions and Partitions. Prior to approval of the final plat, an application for subdivision and partition development must:

(a) Submit a stormwater facilities design with calculations to satisfy the requirements of the Tualatin Municipal Code Chapter 3-5 (Soil Erosion, Surface Water Management, Water Quality Facilities, and Building And Sewers) and applicable Clean Water Services standards;

(b) Obtain a Stormwater Connection Permit from Clean Water Services; and

(c) Either construct a permanent on-site water quality facility and stormwater detention facility; or enter into an agreement with the City, as provided in TDC 36.320 and TMC 3-5-390, recorded against the property, to guarantee construction of a permanent on-site water quality facility and stormwater detention facility.

~~(2) On all other development applications, prior to issuance of any building permit, the applicant must arrange to construct a permanent on-site water quality facility and storm water detention facility and submit a design and calculations indicating that the requirements of the Surface Water Management Ordinance will be met and obtain a Stormwater Connection Permit from Clean Water Services.~~

(3) All Development, Except Subdivisions and Partitions. Prior to issuance of any building permit, an applicant for any development, except Subdivisions and Partitions, must:

(a) Submit a stormwater facilities design with calculations to satisfy the requirements of the Tualatin Municipal Code Chapter 3-5 (Soil Erosion, Surface Water Management, Water Quality Facilities, and Building And Sewers);

(b) Obtain a Stormwater Connection Permit from Clean Water Services; and

(c) Either construct a permanent on-site water quality facility and stormwater detention facility; or enter into an agreement with the City, as provided in TMC 3-5-390, recorded against the property, to guarantee construction of a permanent on-site water quality facility and stormwater detention facility.

(3) On-Site Private and Regional Non-Residential Facilities. For on-site private and regional non-residential public facilities, the applicant must:

(a) ~~submit~~ Enter into a stormwater facility agreement, as provided in TMC 3-5-390, recorded against the property. The stormwater facility agreement which will

include an operation and maintenance plan, provided by the City and consistent with Clean Water Services requirements, for the water quality facility ~~for the City's review and approval.~~

~~(b) The applicant must~~ submit an erosion control plan prior to issuance of a Public Works Permit, consistent with TMC 3-5 and Clean Water Services standards. No construction or disturbing of the site must occur until the erosion control plan is approved by the City and the required measures are in place and approved by the City.

**Section 5. Findings.** The Council adopts the Findings as set forth in Exhibit 2, which are attached and incorporated by reference.

**Section 6. Severability.** If any section, subsection, sentence, clause, or phrase of this ordinance is for any reason held to be invalid or unconstitutional, such decision does not affect the validity of the remaining portions of this ordinance.

**Section 7. Effective Date.** As provided in the Tualatin Charter, this ordinance is effective 30 days from the date of adoption.

ADOPTED by the City Council this \_\_\_\_ day of \_\_\_\_\_, 2021.

CITY OF TUALATIN, OREGON

BY \_\_\_\_\_  
Mayor


APPROVED AS TO FORM

ATTEST:

BY \_\_\_\_\_  
City Attorney

BY \_\_\_\_\_  
City Recorder

# Exhibit 1 to Ordinance No. 1453-21 - Comprehensive Plan Map 9-3

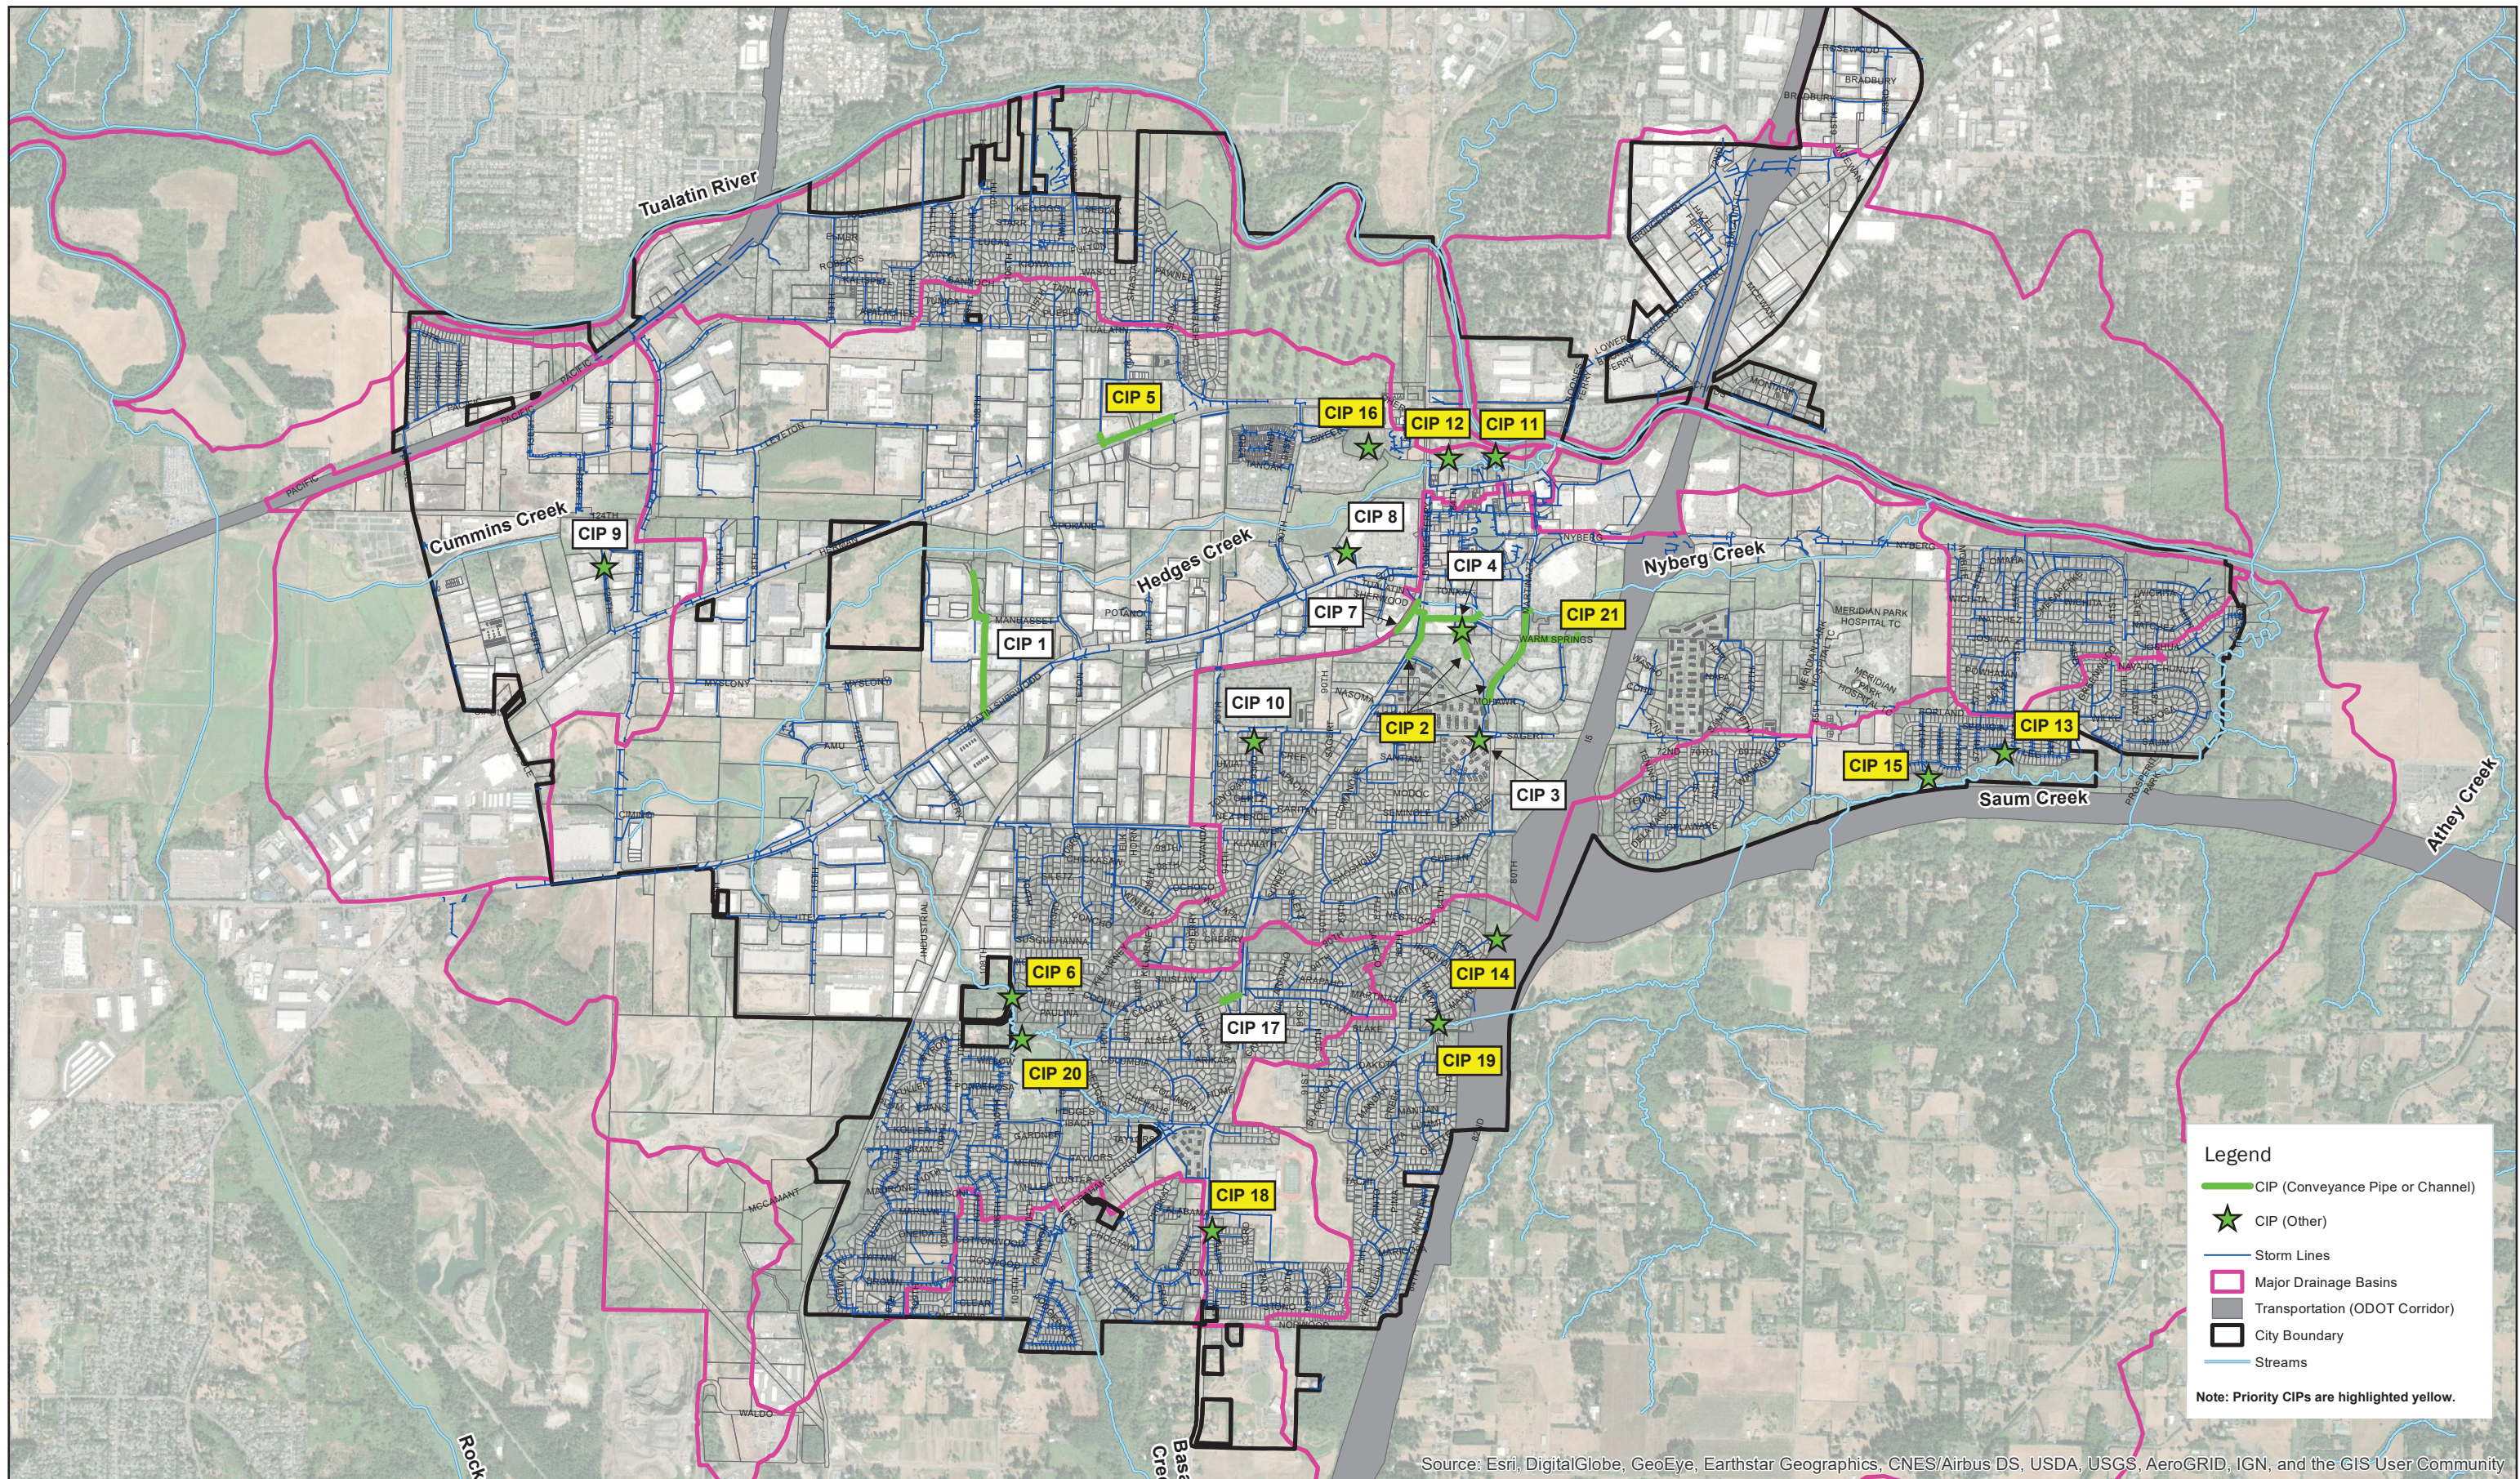

**Legend**


- CIP (Conveyance Pipe or Channel)
- ★ CIP (Other)
- Storm Lines
- Major Drainage Basins
- Transportation (ODOT Corridor)
- City Boundary
- Streams

Note: Priority CIPs are highlighted yellow.

Source: Esri, DigitalGlobe, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community



**City of Tualatin**  
**Stormwater Master Plan**  
 Date: April 2019  
 Project: Project 149233



Notes:  
 1. Projection: NAD 1983 State Plane Oregon North (feet)

**Comprehensive Plan Map 9-3**  
**Capital Project Location Overview**



February 8, 2021

## Analysis and Findings

---

Case #: PTA 21-0001  
 Project: Stormwater Master Plan

### TABLE OF CONTENTS

- I. INTRODUCTION ..... 2
  - A. Applicable Criteria ..... 2
  - B. Project Description ..... 2
  - C. Previous Land Use Actions..... 2
  - D. Site Description and Surrounding Uses ..... 2
  - E. Exhibit List..... 2
- II. FINDINGS ..... 3
  - A. Oregon Statewide Planning Goals ..... 3
  - B. Oregon Administrative Rules ..... 6
  - C. Metro Code ..... 15
  - D. Tualatin Comprehensive Plan ..... 17
  - E. Tualatin Development Code..... 18



## I. INTRODUCTION

### A. Applicable Criteria

Applicable Statewide Planning Goals; Division 11 of the Oregon Administrative Rules Chapter 660; Metro Chapter 3.02 (Waste Water Management Plan); City of Tualatin Comprehensive Plan Chapter 13; City of Tualatin Development Code, Section 33.070, Plan Amendments.

### B. Project Description

Plan Text Amendment (PTA) 20-0001 proposes amendments to the Tualatin Comprehensive Plan Chapters 1 and 9 to reflect the updated version of the Stormwater Master Plan (2020) as well as reference changes in Tualatin Development Code Chapter 74.

The proposed amendments would facilitate future development of stormwater management projects throughout the City and aid development by providing reliable information in the City's development code.

### C. Exhibit List

Exhibit A – Stormwater Master Plan (2019)

Exhibit B – Stormwater Master Plan (2019) Appendices A-D

Exhibit C – Stormwater Master Plan (2019) Appendices E-I

Exhibit D -- The Washington County—City of Tualatin Urban Planning Area Agreement (2019)

Exhibit E -- City of Tualatin-Clackamas County Urban Growth Management Agreement (1992)

### D. Proposed Amendments

The following Text Amendments have been proposed:

Tualatin Comprehensive Plan:

- Addition of Stormwater Master Plan reference in Technical Memoranda section, acknowledging the Master Plan as a support document adopted as part of the Comprehensive Plan.
- Revisions to Chapter 9—Public Facilities and Services, deleting references to previous drainage plan and revising goals and policies consistent with the updated Master Plan.
- Adopting Figure 7-1 of the Stormwater Master Plan (Capital Project Location Overview) as Map 9-3 of the Tualatin Comprehensive Plan.

Tualatin Development Code:

- Revision to Chapter 74, Public Improvement Requirements to clarify language and correct references.

## II. FINDINGS

### A. The following Oregon Statewide Planning Goals are applicable to the proposed amendments:

#### **Goal 1 – Citizen Involvement**

**To develop a citizen involvement program that insures the opportunity for citizens to be involved in all phases of the planning process.**

##### **Finding:**

The draft Stormwater Master Plan was opened for a public comment period in December 2020. An online “open house” featuring project information and synopsis video were available, and staff received public comments via email, and online comment form, and social media.

Proposed changes the Tualatin Comprehensive Plan and Development Code were additionally discussed at the Tualatin Planning Commission in their capacity as an advisory body on January 21, 2021 with additional time allotted for public comment and discussion. The proposed changes are being vetted at a public hearing with opportunity for additional public testimony before City Council in February 2021. The proposed amendments conform to Goal 1.

#### **Goal 2 – Land Use Planning**

**To establish a land use planning process and policy framework as a basis for all decision and actions related to use of land and to assure an adequate factual base for such decisions and actions.**

[...]

##### **Finding:**

The proposed amendments have been reviewed pursuant to the City’s established land use planning process and procedures. The Stormwater Master Plan provides an updated factual basis relevant to stormwater capacity and demand, and acts in tandem with other adopted technical memoranda as described in the Comprehensive Plan to form the overall factual basis for the Plan. The existing land use plan references previous documents including the Tualatin Drainage Plan (1979) and Hedges Creek Subbasin Plan, and it is appropriate to incorporate changes into the Comprehensive Plan. The proposed amendments conform to Goal 2.

#### **Goal 6 – Air, Water and Land Resources Quality**

##### **Finding:**

A functioning stormwater management system is in the best interest of water quality and the protection of other natural resources. The Stormwater Master Plan has been developed in coordination with the applicable regional agencies, including Clean Water Services. The proposed amendments conform to Goal 6.

## **Goal 11 – Public Facilities and Services**

### **Finding:**

The Stormwater Master Plan is intended to serve the needs of present and future development. No extension of services is proposed beyond the Tualatin Urban Planning Area, which is within the Urban Growth Boundary. The proposed amendments conform to Goal 11.

### **B. The following Oregon Administrative Rules (OAR) are applicable to the proposed amendments:**

#### **Chapter 660-011-0000 Public Facilities Planning**

#### **660-011-0010 The Public Facility Plan**

#### **(1) The public facility plan shall contain the following items:**

- (a) An inventory and general assessment of the condition of all the significant public facility systems which support the land uses designated in the acknowledged comprehensive plan;**
- (b) A list of the significant public facility projects which are to support the land uses designated in the acknowledged comprehensive plan. Public facility project descriptions or specifications of these projects as necessary;**
- (c) Rough cost estimates of each public facility project;**
- (d) A map or written description of each public facility project's general location or service area;**
- (e) Policy statement(s) or urban growth management agreement identifying the provider of each public facility system. If there is more than one provider with the authority to provide the system within the area covered by the public facility plan, then the provider of each project shall be designated;**
- (f) An estimate of when each facility project will be needed; and**
- (g) A discussion of the provider's existing funding mechanisms and the ability of these and possible new mechanisms to fund the development of each public facility project or system.**

**(2) Those public facilities to be addressed in the plan shall include, but need not be limited to those specified in [OAR 660-011-0005 \(Definitions\)](#)(5). Facilities included in the public facility plan other than those included in [OAR 660-011-0005 \(Definitions\)](#)(5) will not be reviewed for compliance with this rule.**

**(3) It is not the purpose of this division to cause duplication of or to supplant existing applicable facility plans and programs. Where all or part of an acknowledged comprehensive plan, facility master plan either of the local jurisdiction or appropriate special district, capital improvement program, regional functional plan, similar plan or any combination of such plans meets all or some of the requirements of this division, those plans, or programs may be incorporated by reference into the public facility plan required by this division. Only those referenced portions of such documents shall be considered to be a part of the public facility plan and shall be subject to the administrative procedures of this division and ORS Chapter 197 (Comprehensive Land Use Planning).**

**Finding:**

The Stormwater System Master Plan (2019) contains information regarding the condition of current stormwater management systems, anticipated capital investments, and details such as location and associated costs. A map and additional descriptions of anticipated capital improvements is included in the plan and proposed to be adopted as Map 9-3 of the Comprehensive Plan. Public facilities have been planned in conjunction with other relevant agencies, especially Clean Water Services. Funding mechanisms including System Development Charges and utility rates is also discussed within the Plan.

Separate sections of the Tualatin Comprehensive Plan address transportation, potable water, and sanitary sewer. No changes to these sections are being proposed with this Plan Text Amendment.

These standards are met.

**Rule 660-011-0015**

**Responsibility for Public Facility Plan Preparation**

**(1) Responsibility for the preparation, adoption and amendment of the public facility plan shall be specified within the urban growth management agreement. If the urban growth management agreement does not make provision for this responsibility, the agreement shall be amended to do so prior to the preparation of the public facility plan. In the case where an unincorporated area exists within the Portland Metropolitan Urban Growth Boundary which is not contained within the boundary of an approved urban planning area agreement with the County, the County shall be the responsible agency for preparation of the facility plan for that unincorporated area. The urban growth management agreement shall be submitted with the public facility plan as specified in OAR 660-011-0040 (Date of Submittal of Public Facility Plans).**

**(2) The jurisdiction responsible for the preparation of the public facility plan shall provide for the coordination of such preparation with the city, county, special districts and, as necessary, state and federal agencies and private providers of public facilities. The Metropolitan Service District is responsible for public facility plans coordination within the District consistent with ORS 197.190 and [268.390 \(Planning for activities and areas with metropolitan impact\)](#).**

**(3) Special districts, including port districts, shall assist in the development of the public facility plan for those facilities they provide. Special districts may object to that portion of the facilities plan adopted as part of the comprehensive plan during review by the Commission only if they have completed a special district agreement as specified under ORS 197.185 and [197.254 \(Bar to contesting acknowledgment, appealing or seeking amendment\)](#)(3) and (4) and participated in the development of such portion of the public facility plan.**

**(4) Those state agencies providing funding for or making expenditures on public facility systems shall participate in the development of the public facility plan in accordance with their state agency coordination agreement under [ORS 197.180 \(State agency planning responsibilities\)](#) and [197.712 \(Commission duties\)](#)(2)(f).**

**Finding:**

The City of Tualatin is within both Clackamas and Washington Counties and has separate agreements that function as the applicable urban growth management agreement. The City of Tualatin-Clackamas County Urban Growth Management Agreement (1992) (Exhibit E) recognizes the City's authority for public facilities planning within the UGB in accordance with this administrative rule. The Washington County—City of Tualatin Urban Planning Area Agreement (2019) (Exhibit D) likewise acknowledges that the City is responsible for the preparation, adoption, and amendment of the public facility plan required by this section. The City has coordinated with Clean Water Services and applicable partners in the development of the Plan proposed for adoption and relevant text amendments. These standards are met.

**Rule 660-011-0020**

**Public Facility Inventory and Determination of Future Facility Projects**

**(1) The public facility plan shall include an inventory of significant public facility systems. Where the acknowledged comprehensive plan, background document or one or more of the plans or programs listed in [OAR 660-011-0010 \(The Public Facility Plan\)](#) (3) contains such an inventory, that inventory may be incorporated by reference. The inventory shall include:**

- (a) Mapped location of the facility or service area;**
- (b) Facility capacity or size; and**
- (c) General assessment of condition of the facility (e.g., very good, good, fair, poor, very poor).**

**(2) The public facility plan shall identify significant public facility projects which are to support the land uses designated in the acknowledged comprehensive plan. The public facility plan shall list the title of the project and describe each public facility project in terms of the type of facility, service area, and facility capacity.**

**(3) Project descriptions within the facility plan may require modifications based on subsequent environmental impact studies, design studies, facility master plans, capital improvement programs, or site availability. The public facility plan should anticipate these changes as specified in [OAR 660-011-0045 \(Adoption and Amendment Procedures for Public Facility Plans\)](#).**

**Finding:**

The Stormwater Master Plan updates the City's inventory of public facility systems. This inventory includes location data, as well as information about the condition and size of existing facilities. The updated Comprehensive Plan will incorporate this updated inventory information by reference. The Stormwater Master Plan additionally identifies significant projects needed to support further growth and development in Tualatin consistent with the acknowledged Comprehensive Plan. The amendments are consistent with these standards.

**Rule 660-011-0025**

**Timing of Required Public Facilities**

**(1) The public facilities plan shall include a general estimate of the timing for the planned public facility projects. This timing component of the public facilities plan can be met in several ways depending on whether the project is anticipated in the short term or long term. The timing of projects may be related directly to population growth, e.g., the expansion or new construction of water treatment facilities. Other facility projects can be related to a measure of the facility’s service level being met or exceeded, e.g., a major arterial or intersection reaching a maximum vehicle-per-day standard. Development of other projects may be more long term and tied neither to specific population levels nor measures of service levels, e.g., sewer projects to correct infiltration and inflow problems. These projects can take place over a long period of time and may be tied to the availability of long-term funding. The timing of projects may also be tied to specific years.**

**(2) Given the different methods used to estimate the timing of public facilities, the public facility plan shall identify projects as occurring in either the short term or long term, based on those factors which are related to project development. For those projects designated for development in the short term, the public facility plan shall identify an approximate year for development. For those projects designated for development over the long term, the public facility plan shall provide a general estimate as to when the need for project development would exist, e.g., population level, service level standards, etc. Timing provisions for public facility projects shall be consistent with the acknowledged comprehensive plan’s projected growth estimates. The public facility plan shall consider the relationships between facilities in providing for development.**

**(3) Anticipated timing provisions for public facilities are not considered land use decisions as specified in [ORS 197.712 \(Commission duties\)](#)(2)(e), and, therefore, cannot be the basis of appeal under [ORS 197.610 \(Submission of proposed comprehensive plan or land use regulation changes to Department of Land Conservation and Development\)](#)(1) and (2) or [197.835 \(Scope of review\)](#)(4).**

**Finding:**

The Stormwater Master Plan includes information on whether anticipated capital projects are “High Priority (2019-2029) or “Lower Priority (Future)” as seen in Table 7-1. This determination is in relationship to identified system capacity needs. These standards are met.

**Rule 660-011-0030**

**Location of Public Facility Projects**

**(1) The public facility plan shall identify the general location of the public facility project in specificity appropriate for the facility. Locations of projects anticipated to be carried out in the short term can be specified more precisely than the locations of projects anticipated for development in the long term.**

**(2) Anticipated locations for public facilities may require modifications based on subsequent environmental impact studies, design studies, facility master plans, capital improvement programs, or land availability. The public facility plan should anticipate those changes as specified in [OAR 660-011-0045 \(Adoption and Amendment Procedures for Public Facility Plans\)](#).**

**Rule 660-011-0035**

**Determination of Rough Cost Estimates for Public Facility Projects and Local Review of Funding Mechanisms for Public Facility Systems**

**(1) The public facility plan shall include rough cost estimates for those sewer, water, and transportation public facility projects identified in the facility plan. The intent of these rough cost estimates is to:**

**(a) Provide an estimate of the fiscal requirements to support the land use designations in the acknowledged comprehensive plan; and**

**(b) For use by the facility provider in reviewing the provider’s existing funding mechanisms (e.g., general funds, general obligation and revenue bonds, local improvement district, system development charges, etc.) and possible alternative funding mechanisms. In addition to including rough cost estimates for each project, the facility plan shall include a discussion of the provider’s existing funding mechanisms and the ability of these and possible new mechanisms to fund the development of each public facility project or system. These funding mechanisms may also be described in terms of general guidelines or local policies.**

**(2) Anticipated financing provisions are not considered land use decisions as specified in [ORS 197.712 \(Commission duties\)](#)(2)(e) and, therefore, cannot be the basis of appeal under [ORS 197.610 \(Submission of proposed comprehensive plan or land use regulation changes to Department of Land Conservation and Development\)](#)(1) and (2) or [197.835 \(Scope of review\)](#)(4).**

**Finding:**

The Stormwater Master Plan includes information about the proposed location of specific capital projects. The Plan also includes cost estimates, including SDC eligible costs associated with the separate projects. The Plan includes additional discussion of funding mechanisms. These standards are met.

**Rule 660-011-0040**

**Date of Submittal of Public Facility Plans**

The public facility plan shall be completed, adopted, and submitted by the time of the responsible jurisdiction’s periodic review. The public facility plan shall be reviewed under [OAR chapter 660, division 25, “Periodic Review”](#) with the jurisdiction’s comprehensive plan and land use regulations. Portions of public facility plans adopted as part of comprehensive plans prior to the responsible jurisdiction’s periodic review will be reviewed pursuant to [OAR chapter 660, division 18, “Post Acknowledgment Procedures.”](#)

**Rule 660-011-0045**

**Adoption and Amendment Procedures for Public Facility Plans**

**(1) The governing body of the city or county responsible for development of the public facility plan shall adopt the plan as a supporting document to the jurisdiction’s comprehensive plan and shall also adopt as part of the comprehensive plan:**

**(a) The list of public facility project titles, excluding (if the jurisdiction so chooses) the descriptions or specifications of those projects;**

**(b) A map or written description of the public facility projects’ locations or service areas as specified in sections (2) and (3) of this rule; and**

**(c) The policy(ies) or urban growth management agreement designating the provider of each public facility system. If there is more than one provider with the authority to provide the system within the area covered by the public facility plan, then the provider of each project shall be designated.**

**(2) Certain public facility project descriptions, location or service area designations will necessarily change as a result of subsequent design studies, capital improvement programs, environmental impact studies, and changes in potential sources of funding. It is not the intent of this division to:**

**(a) Either prohibit projects not included in the public facility plans for which unanticipated funding has been obtained;**

**(b) Preclude project specification and location decisions made according to the National Environmental Policy Act; or**

**(c) Subject administrative and technical changes to the facility plan to [ORS 197.610 \(Submission of proposed comprehensive plan or land use regulation changes to Department of Land Conservation and Development\)](#)(1) and (2) or [197.835 \(Scope of review\)](#)(4).**

**(3) The public facility plan may allow for the following modifications to projects without amendment to the public facility plan:**

**(a) Administrative changes are those modifications to a public facility project which are minor in nature and do not significantly impact the project’s general description, location, sizing, capacity, or other general characteristic of the project;**

**(b) Technical and environmental changes are those modifications to a public facility project which are made pursuant to “final engineering” on a project or those that result from the findings of an Environmental Assessment or Environmental Impact Statement conducted under regulations implementing the procedural provisions of the National Environmental Policy Act of 1969 (40 CFR Parts 1500–1508) or any federal or State of Oregon agency project development regulations consistent with that Act and its regulations.**

**(c) Public facility project changes made pursuant to subsection (3)(b) of this rule are subject to the administrative procedures and review and appeal provisions of the regulations controlling the study (40 CFR Parts 1500–1508 or similar regulations) and are not subject to the administrative procedures or review or appeal provisions of [ORS Chapter 197 \(Comprehensive Land Use Planning\)](#), or [OAR chapter 660](#) division 18.**

**(4) Land use amendments are those modifications or amendments to the list, location or provider of, public facility projects, which significantly impact a public facility project identified in the comprehensive plan and which do not qualify under subsection (3)(a) or (b) of this rule. Amendments made pursuant to this subsection are subject to the administrative procedures and review and appeal provisions accorded “land use decisions” in [ORS Chapter 197 \(Comprehensive Land Use Planning\)](#) and those set forth in [OAR chapter 660](#) division 18.**

**Finding:**

The proposed Stormwater Master Plan modifies the existing Public Facilities component of Tualatin’s acknowledged Comprehensive Plan. Consistency with urban growth management policies is considered in Section C detailing consistency with applicable Metro Code. The proposed amendments are consistent with these standards.



### **Rule 660-011-0050**

#### **Standards for Review by the Department**

The Department of Land Conservation and Development shall evaluate the following, as further defined in this division, when reviewing public facility plans submitted under this division:

- (1)** Those items as specified in [OAR 660-011-0010 \(The Public Facility Plan\)](#)(1);
- (2)** Whether the plan contains a copy of all agreements required under [OAR 660-011-0010 \(The Public Facility Plan\)](#) and [660-011-0015 \(Responsibility for Public Facility Plan Preparation\)](#); and
- (3)** Whether the public facility plan is consistent with the acknowledged comprehensive plan.

#### **Finding:**

As discussed above, the proposed amendments to adopt the Stormwater Master Plan (2019) broaden the extent to which the Public Facilities component of the Comprehensive Plan contains current information consistent with the requirements of OAR 660-011-0010. The City of Tualatin works in close partnership with Clean Water Services in implementing stormwater management practices as is further documented with this plan. Consistency with the acknowledged comprehensive plan is further discussed

#### **C. The following Chapter and Titles of Metro Code are applicable to the proposed amendments:**

##### **Title 3: Water Quality and Flood Management**

###### **3.07.310 Intent**

To protect the beneficial water uses and functions and values of resources within the Water Quality and Flood Management Areas by limiting or mitigating the impact on these areas from development activities and protecting life and property from dangers associated with flooding. [Ord. 97-715B, Sec. 1. Ord. 98-730C, Sec. 1. Ord. 00-839, Sec. 1. Ord. 05- 1077C, Sec. 6.]

###### **3.07.320 Applicability**

###### **(a) Title 3 applies to:**

**(1) Development in Water Quality Resource and Flood Management Areas.**

**(2) Development which may cause temporary or permanent erosion on any property within the Metro Boundary.**

**(b) Title 3 does not apply to work necessary to protect, repair, maintain, or replace existing structures, utility facilities, roadways, driveways, accessory uses and exterior improvements in response to emergencies provided that after the emergency has passed, adverse impacts are mitigated in accordance with the performance standards in Section 3.07.340. [Ord. 97-715B, Sec. 1. Ord. 98-730C, Sec. 1. Ord. 00-839, Sec. 1. Ord. 02-972A, Sec. 1. Ord. 05-1077C, Sec. 6.]**

###### **3.07.330 Implementation Alternatives for Cities and Counties**

###### **(a) Cities and counties shall comply with this title in one of the following ways:**

**(1) Amend their comprehensive plans and implementing ordinances to adopt all or part of the Title 3 Model Ordinance or code language that substantially complies with the performance standards in Section 3.07.340 and the intent of this title, and adopt either the Metro Water Quality and Flood**

**Management Area Map or a map which substantially complies with the Metro map. Cities and counties may choose one of the following options for applying this section:**

**(A) Adopt code language implementing this title which prevails over the map and uses the map as reference; or**

**(B) Adopt a city or county field verified map of Water Quality and Flood Management Areas based on the Metro Water Quality and Flood Management map implementing this title which prevails over adopted code language. Field verification is a process of identifying or delineating Protected Water Features, Water Quality Resource Areas and Flood Management Areas shown on the Metro Water Quality and Flood Management Areas map. This process includes examination of information such as site visit reports, wetlands inventory maps, aerial photographs, and public input and review. The field verification process shall result in a locally adopted Water Quality and Flood Management Areas map which:**

**(i) Applies the Title 10 definitions of Protected Water Feature, Water Quality Resource Areas and Flood Management Areas to all those protected areas on the Metro Water Quality and Flood Management Areas map to show the specific boundaries of those protected areas on the locally adopted Water Quality and Flood Management Areas map; and**

**(ii) Is subject to amendment by applying adopted code language to add Protected Water Features, Water Quality Resource Areas and Flood Management Areas and to correct errors in the local Water Quality and Flood Management Areas map consistent with Section 3.07.330(d).**

**(2) Demonstrate that existing city and county comprehensive plans and implementing ordinances substantially comply with the performance standards in Section 3.07.340 and the intent of this title.**

**(3) Any combination of (1) and (2) above that substantially complies with all performance standards in Section 3.07.340.**

**(b) Cities and counties shall hold at least one public hearing prior to adopting comprehensive plan amendments, ordinances and maps implementing the performance standards in Section 3.07.340 of this title or demonstrating that existing city or county comprehensive plans and implementing ordinances substantially comply with Section 3.07.340, to add Protected Water Features, and wetlands which meet the criteria in Section 3.07.340(e)(3), to their Water Quality and Flood Management Area map. The proposed comprehensive plan amendments, implementing ordinances and maps shall be available for public review at least 45 days prior to the public hearing.**

**(c) Cities and counties shall conduct a review of their Water Quality and Flood Management Areas map concurrent with local periodic review required by ORS 197.629.**

**(d) Some areas which would otherwise be mapped as Protected Water Features, Water Quality Resource Areas and Flood Management Areas do not appear on the Metro Water Quality and Flood Management Areas map because streams had been culverted, wetlands had been filled or a fill permit had been approved, or the area was demonstrated to have existing conflicting water dependent uses, or existing plans or agreements for such uses, or the area was developed or committed to other uses. Notwithstanding any other provision of this title, cities and counties are not required to establish Protected Water Features, Water Quality Resource Areas and Flood Management Areas through adopted code provisions or mapping for areas which were examined but not included on the Water**

**Quality and Flood Management Areas map adopted by the Metro Council. [Ord. 97-715B, Sec. 1. Ord. 98-730C, Sec. 1. Ord. 00-839, Sec. 1. Ord. 02-972A, Sec. 1. Ord. 15-1357.]**

### **3.07.340 Performance Standards**

#### **(a) Flood Management Performance Standards.**

**(1) The purpose of these standards is to reduce the risk of flooding, prevent or reduce risk to human life and property, and maintain functions and values of floodplains such as allowing for the storage and conveyance of stream flows through existing and natural flood conveyance systems.**

**(2) All development, excavation and fill in the Flood Management Areas shall conform to the following performance standards:**

**(A) Development, excavation and fill shall be performed in a manner to maintain or increase flood storage and conveyance capacity and not increase design flood elevations.**

**(B) All fill placed at or below the design flood elevation in Flood Management Areas shall be balanced with at least an equal amount of soil material removal.**

**(C) Excavation shall not be counted as compensating for fill if such areas will be filled with water in non-storm winter conditions.**

**(D) Minimum finished floor elevations for new habitable structures in the Flood Management Areas shall be at least one foot above the design flood elevation.**

**(E) Temporary fills permitted during construction shall be removed.**

**(F) Uncontained areas of hazardous materials as defined by DEQ in the Flood Management Area shall be prohibited.**

**(3) The following uses and activities are not subject to the requirements of subsection(2):**

**(A) Excavation and fill necessary to plant new trees or vegetation.**

**(B) Excavation and fill required for the construction of detention facilities or structures, and other facilities such as levees specifically designed to reduce or mitigate flood impacts. Levees shall not be used to create vacant buildable lands.**

**(C) New culverts, stream crossings, and transportation projects may be permitted if designed as balanced cut and fill projects or designed to not significantly raise the design flood elevation. Such projects shall be designed to minimize the area of fill in Flood Management Areas and to minimize erosive velocities. Stream crossing shall be as close to perpendicular to the stream as practicable. Bridges shall be used instead of culverts wherever practicable.**

#### **(b) Water Quality Performance Standards.**

**(1) The purpose of these standards is to: 1) protect and improve water quality to support the designated beneficial water uses as defined in Title 10, and 2) protect the functions and values of the Water Quality Resource Area which include, but are not limited to:**

**(A) Providing a vegetated corridor to separate Protected Water Features from development;**

**(B) Maintaining or reducing stream temperatures;**

- (C) Maintaining natural stream corridors;**
- (D) Minimizing erosion, nutrient and pollutant loading into water;**
- (E) Filtering, infiltration and natural water purification; and**
- (F) Stabilizing slopes to prevent landslides contributing to sedimentation of water features.**

**(2) Local codes shall require all development in Water Quality Resource Areas to conform to the following performance standards:**

**(A) The Water Quality Resource Area is the vegetated corridor and the Protected Water Feature. The width of the vegetated corridor is specified in Table 3.07-3. At least three slope measurements along the water feature, at no more than 100-foot increments, shall be made for each property for which development is proposed. Depending on the width of the property, the width of the vegetated corridor will vary.**

**(B) Water Quality Resource Areas shall be protected, maintained, enhanced or restored as specified in Section 3.07.340(b)(2).**

**(C) Prohibit development that will have a significant negative impact on the functions and values of the Water Quality Resource Area, which cannot be mitigated in accordance with subsection (2)(F).**

**(D) Native vegetation shall be maintained, enhanced or restored, if disturbed, in the Water Quality Resource Area. Invasive nonnative or noxious vegetation may be removed from the Water Quality Resource Area. Use of native vegetation shall be encouraged to enhance or restore the Water Quality Resource Area. This shall not preclude construction of energy dissipaters at outfalls consistent with watershed enhancement, and as approved by local surface water management agencies.**

**(E) Uncontained areas of hazardous materials as defined by DEQ in the Water Quality Resource Area shall be prohibited.**

**(F) Cities and counties may allow development in Water Quality Resource Areas provided that the governing body, or its designate, implement procedures which: (i) Demonstrate that no practicable alternatives to the requested development exist which will not disturb the Water Quality Resource Area; and (ii) If there is no practicable alternative, limit the development to reduce the impact associated with the proposed use; and (iii) Where the development occurs, require mitigation to ensure that the functions and values of the Water Quality Resource Area are restored.**

**(G) Cities and counties may allow development for repair, replacement or improvement of utility facilities so long as the Water Quality Resource Area is restored consistent with Section 3.07.340(b)(2)(D).**

**(H) The performance standards of Section 3.07.340(b)(2) do not apply to routine repair and maintenance of existing structures, roadways, driveways, utilities, accessory uses and other development.**

**(3) For lots or parcels which are fully or predominantly within the Water Quality Resource Area and are demonstrated to be unbuildable by the vegetative corridor regulations, cities and**

counties shall reduce or remove vegetative corridor regulations to assure the lot or parcel will be buildable while still providing the maximum vegetated corridor practicable. Cities and counties shall encourage landowners to voluntarily protect these areas through various means, such as conservation easements and incentive programs.

**(c) Erosion and Sediment Control.**

**(1) The purpose of this section is to require erosion prevention measures and sediment control practices during and after construction to prevent the discharge of sediments.**

**(2) Erosion prevention techniques shall be designed to prevent visible and measurable erosion as defined in Title 10.**

**(3) To the extent erosion cannot be completely prevented, sediment control measures shall be designed to capture, and retain on-site, soil particles that have become dislodged by erosion.**

**(d) Implementation Tools to Protect Water Quality and Flood Management Areas.**

**(1) Cities and counties shall either adopt land use regulations, which authorize transfer of permitted units and floor area to mitigate the effects of development restrictions in Water Quality and Flood Management Areas, or adopt other measures that mitigate the effects of development restrictions.**

**(2) Metro encourages local governments to require that approvals of applications for partitions, subdivisions and design review actions be conditioned upon one of the following:**

**(A) Protection of Water Quality and Flood Management Areas with a conservation easement;**

**(B) Platting Water Quality and Flood Management Areas as common open space; or**

**(C) Offer of sale or donation of property to public agencies or private non-profits for preservation where feasible.**

**(3) Additions, alterations, rehabilitation or replacement of existing structures, roadways, driveways, accessory uses and development in the Water Quality and Flood Management Area may be allowed provided that:**

**(A) The addition, alteration, rehabilitation or replacement is not inconsistent with applicable city and county regulations, and**

**(B) The addition, alteration, rehabilitation or replacement does not encroach closer to the Protected Water Feature than the existing structures, roadways, driveways or accessory uses and development, and**

**(C) The addition, alteration, rehabilitation or replacement satisfies Section 3.07.340(c) of this title.**

**(D) In determining appropriate conditions of approval, the affected city or county shall require the applicant to:**

**(i) Demonstrate that no reasonably practicable alternative design or method of development exists that would have a lesser impact on the Water Quality Resource Area than the one proposed; and**

**(ii) If no such reasonably practicable alternative design or method of development exists, the project should be conditioned to limit its disturbance and impact on the Water Quality Resource to the minimum extent necessary to achieve the proposed addition, alteration, restoration, replacement or rehabilitation; and**

**(iii) Provide mitigation to ensure that impacts to the functions and values of the Water Quality Resource Area will be mitigated or restored to the extent practicable.**

**(4) Cities and counties may choose not to apply the Water Quality and Flood Management Area performance standards of Section 3.07.340 to development necessary for the placement of structures when it does not require a grading or building permit.**

**(5) Metro encourages cities and counties to provide for restoration and enhancement of degraded Water Quality Resource Areas through conditions of approval when development is proposed, or through incentives or other means.**

**(6) Cities and counties shall apply the performance standards of this title to Title 3 Wetlands as shown on the Metro Water Quality and Flood Management Areas Map and locally adopted Water Quality and Flood Management Areas maps. Cities and counties may also apply the performance standards of this title to other wetlands.**

**(e) Map Administration. Cities and counties shall amend their comprehensive plans and implementing ordinances to provide a process for each of the following:**

**(1) Amendments to city and county adopted Water Quality and Flood Management Area maps to correct the location of Protected Water Features, Water Quality Resource Areas and Flood Management Areas. Amendments shall be initiated within 90 days of the date the city or county receives information establishing a possible map error.**

**(2) Modification of the Water Quality Resource Area upon demonstration that the modification will offer the same or better protection of water quality, the Water Quality and Flood Management Area and Protected Water Feature.**

**(3) Amendments to city and county adopted Water Quality and Flood Management Area maps to add Title 3 Wetlands when the city or county receives significant evidence that a wetland meets any one of the following criteria:**

**(A) The wetland is fed by surface flows, sheet flows or precipitation, and has evidence of flooding during the growing season, and has 60 percent or greater vegetated cover, and is over one-half acre in size; or The wetland qualifies as having "intact water quality function" under the 1996 Oregon Freshwater Wetland Assessment Methodology; or**

**(B) The wetland is in the Flood Management Area, and has evidence of flooding during the growing season, and is five acres or more in size, and has a restricted outlet or no outlet; or The wetland qualifies as having "intact hydrologic control function" under the 1996 Oregon Freshwater Wetland Assessment Methodology; or**

**(C) The wetland or a portion of the wetland is within a horizontal distance of less than one-fourth mile from a water body which meets the Department of Environmental Quality definition of "water quality limited" water body in OAR Chapter 340, Division 41. Examples of significant evidence that a wetland exists that may meet the criteria above are a wetland assessment**

**conducted using the 1996 Oregon Freshwater Wetland Assessment Methodology, or correspondence from the Division of State Lands that a wetland determination or delineation has been submitted or completed for property in the city or county.**

**(4) Cities and counties are not required to apply the criteria in Section 3.07.340(e)(3) to water quality or stormwater detention facilities. [Ord. 97-715B, Sec. 1. Ord. 98-730C, Sec. 1. Ord. 00-839, Sec. 1. Ord. 02-972A, Sec. 1. Ord. 05- 1077C, Sec. 6. Ord. 15-1357.]**

### **3.07.360 Metro Model Ordinance Required**

**Metro shall adopt a Water Quality and Flood Management Areas Model Ordinance and map. The Model Ordinance shall represent one method of complying with this title. The Model Ordinance shall be advisory, and cities and counties are not required to adopt the Model Ordinance, or any part thereof, to substantially comply with this title. However, cities and counties which adopt the Model Ordinance in its entirety and a Water Quality and Flood Management Areas Map shall be deemed to have substantially complied with the requirements of this title. [Ord. 97-715B, Sec. 1. Ord. 98-730C, Sec. 2. Ord. 00-839, Sec. 1. Ord. 05-1077C, Sec. 6.]**

[...]

#### **Finding:**

Compliance with Title 3 is administered in Tualatin by Clean Water Services. Future development in Tualatin will be comply with Clean Water Services' Design and Construction Standards & Service Provider Letters (SPLs) requirements. Sensitive areas such as vegetated corridors surrounding streams and wetland habitat are identified, protected and maintained by Clean Water Services. The proposed amendments are consistent with Title 3.

#### **D. The following Chapters of the Tualatin Comprehensive Plan are applicable to the proposed amendments:**

##### **Chapter 9---Public Facilities and Services**

#### **Finding:**

The adoption of the Stormwater Master Plan (2019) and updated policies is largely relevant to Chapter 9—Public Facilities and Services, which is in turn updated by the plan. The range of proposed amendments remains consistent with the *Goal 9.3, to provide a plan for routing surface drainage through the City, utilizing natural drainages when possible. Update the plan as needed with drainage studies of problem areas and to respond to changes in the drainage pattern caused by urban development.* The proposed Master Plan inherently poses an update to the existing plan with updated data reflecting the present development patterns and addressing problem areas, and provides a plan for managing stormwater flows.

Specific policies are updated to reflect current data as studied in the Stormwater Master Plan and reflect current administrative practices and partnerships. Other than where it is appropriate to update said Comprehensive Plan policies, the changes remain consistent with the Comprehensive Plan.

**E. The following Chapters of the Tualatin Development Code are applicable to the proposed amendments:**

**Chapter 33: Applications and Approval Criteria**

**Section 33.070 Plan Amendments**

[...]

**(2) Applicability. Quasi-judicial amendments may be initiated by the City Council, the City staff, or by a property owner or person authorized in writing by the property owner. Legislative amendments may only be initiated by the City Council.**

**Finding:**

A Plan Text Amendment and Plan Map Amendment are proposed. This proposal is legislative in nature and therefore has been processed consistent with the Type IV-B procedures in Chapter 32. This criterion is met.

[...]

**(5) Approval Criteria.**

**a.) Granting the amendment is in the public interest.**

**b.) The public interest is best protected by granting the amendment at this time.**

**Finding:**

The amendment would adopt and implement the Stormwater Master Plan. In order to ensure that the Tualatin Development Code accurately reflects the current Sewer Master Plan for future implementation, it is necessary to update the corresponding maps and text contained therein.

Without these updates, the development of important infrastructure could be stymied. A functioning sewer system is in the interest of public health, safety, and local prosperity. Criteria (a) and (b) are met.

**c.) The proposed amendment is in conformity with the applicable objectives of the Tualatin Comprehensive Plan.**

The applicable goals and policies of the Tualatin Comprehensive Plan have been considered, and are discussed above in Section D. Criterion (c) is met.

**d.) The following factors were consciously considered:**

- i. The various characteristics of areas in the City.**
- ii. The suitability of the area for particular land uses and improvements.**
- iii. Trends in land improvement and development.**
- iv. Property values.**
- v. The needs of economic enterprises and the future development of the area; needed right-of-way and access for and to particular sites in the area;**
- vi. Natural resources of the City and the protection and conservation of said resources.**
- vii. Prospective requirements for the development of natural resources in the City.**



- viii. **The public need for healthful, safe, aesthetic surroundings and conditions.**
- ix. **Proof of change in a neighborhood or area, or a mistake in the Plan Text or Plan Map for the property under consideration are additional relevant factors to consider.**

**Finding:**

The proposed amendments to the plan text do not change any land use designation or zoning, and do not have a direct impact on the mix of allowed uses. A functioning stormwater management system is however important to supporting citywide development potential and property value. The Stormwater Master Plan proposes a coordinated approach to managing infrastructure improvements that will be needed to support new development in Tualatin, preserve development, and allow for daily activities such as transportation to continue in a healthy and safe manner. Furthermore, while the incorporation of the Stormwater Master Plan does not change the City's inventory of natural resources and existing regulations, a functioning stormwater management system is critical to protecting natural resources, limiting the extent to which pollutants enter waterways.

Criterion (d) is met.

**e.) If the amendment involves residential uses, then the appropriate school district or districts must be able to reasonably accommodate additional residential capacity by means determined by any affected school district.**

**Finding:**

The amendment does not involve residential uses. Criterion (e) does not apply.

**f.) Granting the amendment is consistent with the applicable State of Oregon Planning Goals and applicable Oregon Administrative Rules, including compliance with the Transportation Planning Rule TPR (OAR 660-012-0060).**

**Finding:**

Section C details findings for the Oregon Planning Rules. Criterion (f) is met.

**g.) Granting the amendment is consistent with the Metropolitan Service District's Urban Growth Management Functional Plan.**

**Finding:**

The amendments to Chapters 1 and 9 of the Comprehensive Plan and Chapter 74 of the Tualatin Development Code do not affect any portion of the Urban Growth Functional Management Plan. Criterion (g) is met.

**h.) Granting the amendment is consistent with Level of Service F for the p.m. peak hour and E for the one-half hour before and after the p.m. peak hour for the Town Center 2040 Design Type (TDC Map 9-4), and E/E for the rest of the 2040 Design Types in the City's planning area.**

**Finding:**

Amendments to Chapters 1 and 9 of the Comprehensive Plan are not anticipated to add automobile traffic. Criteria (h) is met.

**i.) Granting the amendment is consistent with the objectives and policies regarding potable water, sanitary sewer, and surface water management pursuant to TDC 12.020, water management issues are adequately addressed during development or redevelopment anticipated to follow the granting of a plan amendment.**

**Finding:**

The amendments have implications for surface water management, which are discussed in Section B. Criterion (i) is met.

**j.) The applicant has entered into a development agreement. This criterion applies only to an amendment specific to property within the Urban Planning Area (UPA), also known as the Planning Area Boundary (PAB), as defined in both the Urban Growth Management Agreement (UGMA) with Clackamas County and the Urban Planning Area Agreement (UPAA) with Washington County. TDC Map 9-1 illustrates this area.**

**Finding:**

The proposed amendments are not property specific and this criterion does not apply.

**III. RECOMMENDATION**

*Based on the application and the above analysis and findings, the proposed annexation complies with applicable Oregon Administration Rules, Metro Code, and TDC. Accordingly, staff recommends City Council approval of File No. PTA 21-0001.*


**Brown AND Caldwell**

Prepared for City of Tualatin Oregon

City of Tualatin  
**Stormwater  
Master Plan**



April 2019 | DRAFT-FINAL

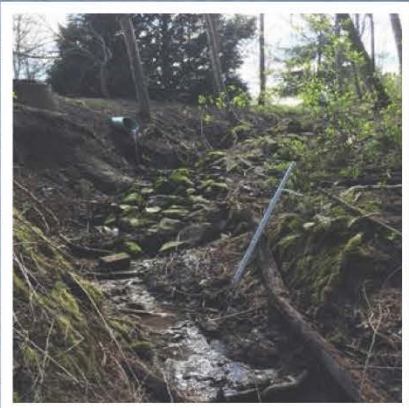

This page intentionally left blank.



*City of Tualatin*

## Stormwater Master Plan

---

Prepared for  
City of Tualatin, Oregon  
April 2019

DRAFT-FINAL



6500 SW Macadam Avenue, Suite 200  
Portland, OR 97239  
T: 503.244.7005

This page intentionally left blank.

# Table of Contents

Executive Summary .....	vii
1. Introduction .....	1-1
1.1 Stormwater Master Plan Objectives .....	1-1
1.2 Background and Related Studies .....	1-2
1.3 Stormwater Master Plan Development Process .....	1-3
1.4 Document Organization .....	1-4
2. Study Area Characteristics .....	2-1
2.1 Location .....	2-1
2.2 Future Planning Areas .....	2-2
2.3 Topography .....	2-2
2.4 Soils .....	2-3
2.5 Land Use .....	2-3
2.6 Climate and Rainfall .....	2-5
2.7 Natural Systems .....	2-5
2.8 Stormwater Infrastructure System .....	2-5
2.9 Water Quality and Regulatory Drivers .....	2-6
2.9.1 National Pollutant Discharge Elimination System (NPDES) Permit Program .....	2-7
2.9.2 Total Maximum Daily Load (TMDL) and 303(d) Listings .....	2-7
2.10 Stormwater Program Management .....	2-8
2.10.1 Maintenance Obligations .....	2-8
2.10.2 Program Operations .....	2-9
2.10.3 Staffing and Program Funding .....	2-9
3. Planning Process .....	3-1
3.1 Project Needs Identification .....	3-1
3.1.1 Water Quality Opportunities .....	3-1
3.2 Project Development Workshop .....	3-3
4. Storm System Capacity Evaluation .....	4-1
4.1 Modeling Approach .....	4-1
4.2 Planning Criteria and Design Standards .....	4-2
4.3 Hydrologic Model Development and Results .....	4-3
4.4 Hydraulic Model Development and Results .....	4-3
4.4.1 Hydraulic Model Development .....	4-3
4.4.2 Capacity Evaluation Results .....	4-5
4.5 Capital Project Development .....	4-8
5. Stream Assessment .....	5-1
5.1 Stream System Overview .....	5-1

5.2 Objectives..... 5-2

5.3 Methodology..... 5-2

5.4 Findings and Results ..... 5-3

    5.4.1 Vegetation ..... 5-3

    5.4.2 Riparian Condition ..... 5-3

    5.4.3 Channel Erosion and Incision ..... 5-4

5.5 Additional Investigations ..... 5-4

5.6 Capital Project and Program Development..... 5-4

    5.6.1 Capital Project Needs..... 5-5

    5.6.2 Program Needs..... 5-5

    5.6.3 Policy Considerations ..... 5-5

6. System Maintenance and Programmatic Assessment..... 6-1

    6.1 Maintenance Overview ..... 6-1

    6.2 Programmatic Activity Workshop ..... 6-2

        6.2.1 Conveyance System Condition Deficiencies..... 6-3

        6.2.2 Public/Private Water Quality Facility Inspection and Maintenance ..... 6-3

        6.2.3 Water Quality Facility Retrofits ..... 6-4

    6.3 Capital Project and Program Development..... 6-5

        6.3.1 Capital Project Needs..... 6-5

        6.3.2 Program Needs..... 6-6

7. Capital Improvement Plan ..... 7-1

    7.1 Summary of Recommended Actions ..... 7-1

    7.2 Capital Project Recommendations ..... 7-1

        7.2.1 Integrated Project Development..... 7-7

        7.2.2 Sizing and Design Assumptions ..... 7-7

        7.2.3 Cost Assumptions..... 7-8

    7.3 Program Recommendations ..... 7-8

8. Implementation ..... 8-1

    8.1 Staffing Analysis..... 8-1

        8.1.1 Capital Project Staffing Assumptions..... 8-1

        8.1.2 Program Staffing Assumptions ..... 8-2

    8.2 Project Prioritization ..... 8-3

    8.3 Level of Service..... 8-5

    8.4 Funding Evaluation ..... 8-5

9. References ..... 9-1

10. Limitations ..... 10-1

Appendix A: CIP Fact Sheets..... A-1

Appendix B: Data Compilation and Preliminary Stormwater Project Development (TM1)..... B-1

Appendix C: Hydrology and Hydraulic Modeling Methods and Results (TM2) .....C-1





Appendix D: Nyberg Creek Flood Reduction Modeling (TM3) ..... D-1

Appendix E: Capital Project Modeling Results..... E-1

Appendix F: Stream Assessment (TM4)..... F-1

Appendix G: CIP Detailed Cost Estimates ..... G-1

Appendix H: Staffing Analysis ..... H-1

Appendix I: Clean Water Services Review Comments ..... I-1

## List of Figures

---

Figure ES-1. Capital Project location overview ..... x

Figure 1-1. Stormwater Master Plan approach ..... 1-3

Figure 2-1. Location overview ..... 2-1

Figure 2-2. Project area overview ..... 2-10

Figure 2-3. Topography and soils ..... 2-10

Figure 2-4. Land use ..... 2-10

Figure 2-5. Stream ownership ..... 2-10

Figure 2-6. Stormwater system overview ..... 2-10

Figure 3-1. Stormwater project opportunity areas ..... 3-1

Figure 4-1. Model system overview ..... 4-8

Figure 5-1. Stream assessment overview ..... 5-6

Figure 6-1. Example of buried outlet control structure at the Green Lot Swale ..... 6-4

Figure 7-1. Capital Project location overview ..... 7-11



# List of Tables

---

Table ES-1. Capital Project Summary ..... ix

Table 1-1. Existing Stormwater Planning Documentation and Reports ..... 1-2

Table 2-1. Soil Type within the City and Planning Areas..... 2-3

Table 2-2. Land Use Categories and Impervious Percentages ..... 2-4

Table 2-3. Major Drainage Basins and Contributing Drainage Area..... 2-5

Table 2-4. System Asset Inventory–Pipes and Open Channels, Public ..... 2-6

Table 2-5. Major Drainage Features (Counts)..... 2-6

Table 2-6. TMDL and 303(d) Summary for Tualatin..... 2-8

Table 3-1. City of Tualatin Stormwater Project Opportunities ..... 3-5

Table 4-1. Drainage Standards and Design Criteria ..... 4-2

Table 4-2. Capacity Evaluation Result Summary and Capital Project Development Approach ..... 4-6

Table 5-1. Summary of Stream Reach Conditions..... 5-3

Table 5-2. Priority Locations for Vegetation Management..... 5-5

Table 6-1. City Maintenance Activities..... 6-2

Table 6-2. Existing Program Funding (2018-19)..... 6-3

Table 7-1. City of Tualatin Stormwater Capital Project Summary..... 7-3

Table 7-2. Programmatic Activities and Cost Estimates..... 7-9

Table 8-1. Maintenance Staff Time Summary ..... 8-2

Table 8-2. Annual Program Staffing Needs ..... 8-3

Table 8-3. Prioritization Criteria ..... 8-4

Table 8-4. Capital Project Costs and Priorities..... 8-4

Table 8-5. Current and Recommended Level of Service (Criteria) ..... 8-5



## List of Abbreviations

1D	one-dimensional	NRCS	National Resources Conservation Service
2D	two-dimensional		
AACE	Association for the Advancement of Cost Engineering	ODFW	Oregon Department of Fish and Wildlife
ac	acre	O&M	operations and maintenance
BC	Brown and Caldwell	OSP	open space
BMP	best management practice	PCB	polychlorinated biphenyl
CB	catch basin	Permit	NPDES Permit
CCTV	closed-circuit television	Plan	2019 Tualatin Stormwater Master Plan
CIP	capital improvement projects	PW	City's Public Works Standards
City	City of Tualatin	ROW	right-of-way
COM	commercial zoning	R/R	repair and replacement
CWA	Clean Water Act	SBUH	Santa Barbara Urban Hydrograph
CWS	Clean Water Services	SDC	stormwater development charge
DEQ	Department of Environmental Quality	sf	square foot/feet
DDE	dichlorodiphenyldichloroethylene	SMP	2019 Tualatin Stormwater Master Plan
DDT	dichlorophenyltrichloroethane	SWMP	Stormwater Management Plan
District	Clean Water Services District	TDC	Tualatin Development Code
EPA	U.S. Environmental Protection Agency	TM	technical memorandum
FTE	full-time equivalent	TMDL	total maximum daily load
GI	green infrastructure	VAC	vacant development
GIS	geographic information system	WPA	Wetlands Protection Area
H/H	hydrologic and hydraulic	WQ	water quality
HSG	hydrologic soil groups	XPSWMM	XP-Storm Water Management Model
I-5	Interstate 5		
I-205	Interstate 205		
IGA	intergovernmental agreement		
IND	industrial zoning		
INS	institutional zoning		
LIDA	low impact development applications		
LIDAR	Light Detection and Ranging		
LF	linear foot/feet		
LOS	level of service		
mg	milligram(s)		
MH	manhole(s)		
NPDES	National Pollutant Discharge Elimination System		

This page intentionally left blank.

# Executive Summary

In 2016, the City of Tualatin (City) initiated development of a multi-objective stormwater master plan to guide stormwater project and program priorities over a 10-year planning period. Efforts were initiated due to the outdated nature of the City's previous stormwater plan (dated 1972), the changing regulatory environment for the City, new and redevelopment activities and annexations, and observed system deficiencies warranting additional study.

This 2019 Stormwater Master Plan (Plan or SMP) provides an overview of system improvements needed to address future growth, water quality, maintenance/system condition issues, and capacity issues.

The SMP development process included:

- Identifying and investigating known capacity and maintenance-related problem areas and water quality project opportunity areas.
- Developing hydrologic and hydraulic models to evaluate system capacity for targeted problem areas or systems.
- Evaluating stream channel conditions with respect to erosion and development impacts.
- Assessing current maintenance obligations and stormwater program needs to support identified problem areas.
- Developing an integrated stormwater system capital improvement program, including project and program recommendations and costs.
- Evaluating stormwater utility rates and stormwater development charges (SDC) to implement priority project and program recommendations.
- Developing a Master Plan document that is useful and easy to read, reference, and update.

## Master Plan Technical Analyses

Developing this SMP included the following technical analyses to evaluate stormwater system deficiencies and define project and program needs.

**Project Needs Identification.** This effort included distributing surveys and questionnaires to City staff, GIS data review, site visits and, workshops. Information collected helped with developing a robust inventory of stormwater problem areas specific to stormwater infrastructure, stormwater facilities, outfalls, and natural systems. Stormwater problem areas were reviewed to identify locations in need of further analysis or study.

**Water Quality Assessment.** Water quality opportunity areas were initially identified using GIS to assess vacant/public lands, high pollutant-generating land use areas (i.e., industrial or commercial), and existing stormwater facility placement. Site visits were conducted in conjunction with identified water quality opportunity areas and identified stormwater problem areas to see if an integrated approach to stormwater management (i.e., installing water quality facilities to mitigate stormwater runoff) could help address the reported issue.

**Targeted Stormwater System Capacity Evaluation.** Hydrologic and hydraulic (H/H) modeling to simulate rainfall and runoff characteristics was conducted for targeted areas of the city. The models simulate stormwater flow through pipe networks, drainage ditches, and culverts to identify capacity limitations for both current and future development conditions.

**Targeted Stream Assessment.** A stream assessment was conducted to evaluate specific stream reaches in the city reported to have erosion, invasive vegetation, and hillslope stability issues. The assessment provided baseline information regarding existing physical stream conditions and informed project, program, and policy recommendations.

**Maintenance Assessment.** A maintenance assessment was conducted to evaluate current City maintenance obligations and maintenance-related stormwater problem areas likely addressed with increased maintenance efforts or activities. Conveyance system deficiencies and public/private water quality facility deficiencies were highlighted and used to support project and program recommendations.

## General Recommendations

Project, program and policy recommendations in this SMP are proposed to improve and enhance drainage infrastructure and water resources throughout the city, as summarized by the following general recommendations:

- Implement identified system capacity improvements (i.e., reconfiguration, rerouting, upsizing) to manage more frequent, nuisance system flooding.
- Increase water quality treatment throughout the city by expanding treatment area coverage through water quality retrofits and enhancing the level of treatment provided.
- Conduct proactive maintenance of the City's stormwater infrastructure. Use system condition data currently collected (i.e., stormwater facility inspections, closed-circuit television [CCTV]) to evaluate needs and priorities.
- Consider the topographic limitations and flat grade of the City's conveyance network with regard to system maintenance activities. Sediment removal and vegetation management are key maintenance needs to ensure conveyance capacity.
- Continue coordination with Clean Water Services to ensure updates to the Tualatin Development Code (TDC) and Public Works (PW) Standards are in line with regulatory drivers and protect stream health.
- Ensure timely implementation of capital projects and programs by establishing updated funding mechanisms and rates. Additional funding is needed to adequately manage the drainage system as material costs increase, flows increase, and the drainage system deteriorates with age and use.

## Capital Improvement Program Summary

Project and program recommendations represent an integrated strategy to address stormwater needs in the city. Recommendations include 21 capital projects and six programmatic efforts. Policy recommendations stemming from the stream assessment have also been identified.

## Project Summary

Capital improvement projects (CIP) have been developed to address the following objectives:

- Increases capacity (flood control)
- Address erosion
- Increase water quality treatment (retrofit)
- Improve water quality (through existing site or facility modifications/restoration to address a pollutant source issue or improve treatment function)
- Address maintenance needs

Table ES-1 below summarizes the identified capital projects, estimated costs, and priorities.

Figure ES-1 shows the location of the proposed CIPs, with priority projects identified. Detailed fact sheets for each CIP can be found in Appendix A.

Table ES-1. Capital Project Summary			
Priority Project	CIP Number	CIP Name	Cost estimates
	1	Manhasset Storm System Improvements	\$1,581,000
X (Phase 1) <sup>a</sup>	2	Nyberg Creek Stormwater Improvements	\$3,412,000
	3	Sandalwood Water Quality Retrofit	\$107,000
	4	Mohawk Apartments Stormwater Improvements	\$295,000
X	5	Herman Road Storm System	\$1,023,000
X	6	Blake St Culvert Replacement	\$552,000
	7	Boones Ferry Railroad Conveyance Improvements	\$515,000
	8	89th Avenue Water Quality Retrofit	\$262,000
	9	125th Court Water Quality Retrofit	\$206,000
	10	93rd Avenue Green Street	\$224,000
X	11	Juanita Pohl Water Quality Retrofit	\$156,000
X	12	Community Park Water Quality Retrofit	\$158,000
X	13	Water Quality Facility Restoration - Venetia	\$65,000
X	14	Water Quality Facility Restoration - Piute Court	\$104,000
X	15	Water Quality Facility Restoration - Sequoia Ridge	\$83,000
X	16	Water Quality Facility Restoration - Sweek Drive Pond	\$103,000
	17	Siuslaw Water Quality Facility Retrofit	\$454,000
X	18	Water Quality Facility Restoration - Waterford	\$180,000
X	19	Saum Creek Hillslope Repair	\$171,000
X	20	Hedges Creek Stream Repair	\$327,000
X	21	Nyberg Water Quality Retrofit	\$2,037,000
Total			\$12,015,000
Total (Priority projects only)			\$6,482,000

a. CIP 2, Nyberg Creek Stormwater Improvements includes three phases of development. Phase I implementation is considered priority.

## Programmatic Summary

In addition to the identified capital projects, the following stormwater program needs and/or refinements have been identified to address ongoing maintenance deficiencies and proactively address long-term system replacement and water quality improvements:

- **Pipe Repair and Replacement (R/R) Program.** Establishes an annual funding mechanism to repair and replace piped stormwater infrastructure throughout the city over a 100-year planning period. Efforts will include evaluating CCTV results to prioritize locations requiring R/R.
- **Structure R/R Program.** Establishes an annual funding mechanism to repair and replace stormwater structures throughout the city over a 100-year planning period.
- **Public Water Quality Facility Maintenance Program.** Increases existing annual funding for public stormwater facility maintenance to address both routine and restorative maintenance activities. Efforts will prioritize locations identified during annual inspection efforts.
- **Public Water Quality Facility Retrofit Program.** Establishes an annual funding mechanism to identify and construct opportunistic water quality retrofits. Retrofits may include rehabilitating existing facilities to promote enhanced treatment or installing green streets in conjunction with transportation improvement projects.
- **Stream Vegetation Management.** Establishes an annual funding mechanism to conduct instream or riparian vegetation management activities to remove invasive vegetation and assess physical condition changes to stream channels.
- **Single Family LIDA Inspection Program.** Increases staff resources to support an expanded private stormwater facility inspection program targeting low impact development applications (LIDA) on single-family residential properties.

## Policy Recommendations

The Stream Assessment identified two policy recommendations the City may consider in order to improve instream channel health and mitigate the potential for localized flooding and erosion.


- **Flow Control Standards.** Protect select areas of the city with observed and/or reported instream erosion and hydromodification risk by requiring development to implement controls related to flow control. The City may incorporate flow control requirements in accordance with areas identified and experiencing channel erosion and incision through the adoption of Clean Water Services' (CWS) updated Design and Construction Standards, which include standards for water quantity control and hydromodification.
- **Beaver Management Guidelines.** Implement (via internal directive or codification) beaver management techniques to selectively encourage/discourage beaver activity based on the characteristics of the stormwater drainage systems, topography, and vegetation.

## Implementation

Capital project and program cost information developed as part of this SMP were used to develop a financial plan for the City that outlines stormwater utility rate and SDCs necessary for the City to implement its stormwater capital improvement program while meeting other financial obligations. Capital project costs, program costs, and associated staffing needs were collectively used in the financial plan.

Implementing priority capital projects and programs associated with a 10-year planning period as outlined in this Plan will require a rate increases and adjustments to SDCs. The financial plan has not been directly included in this Plan, pending future City Council approval.



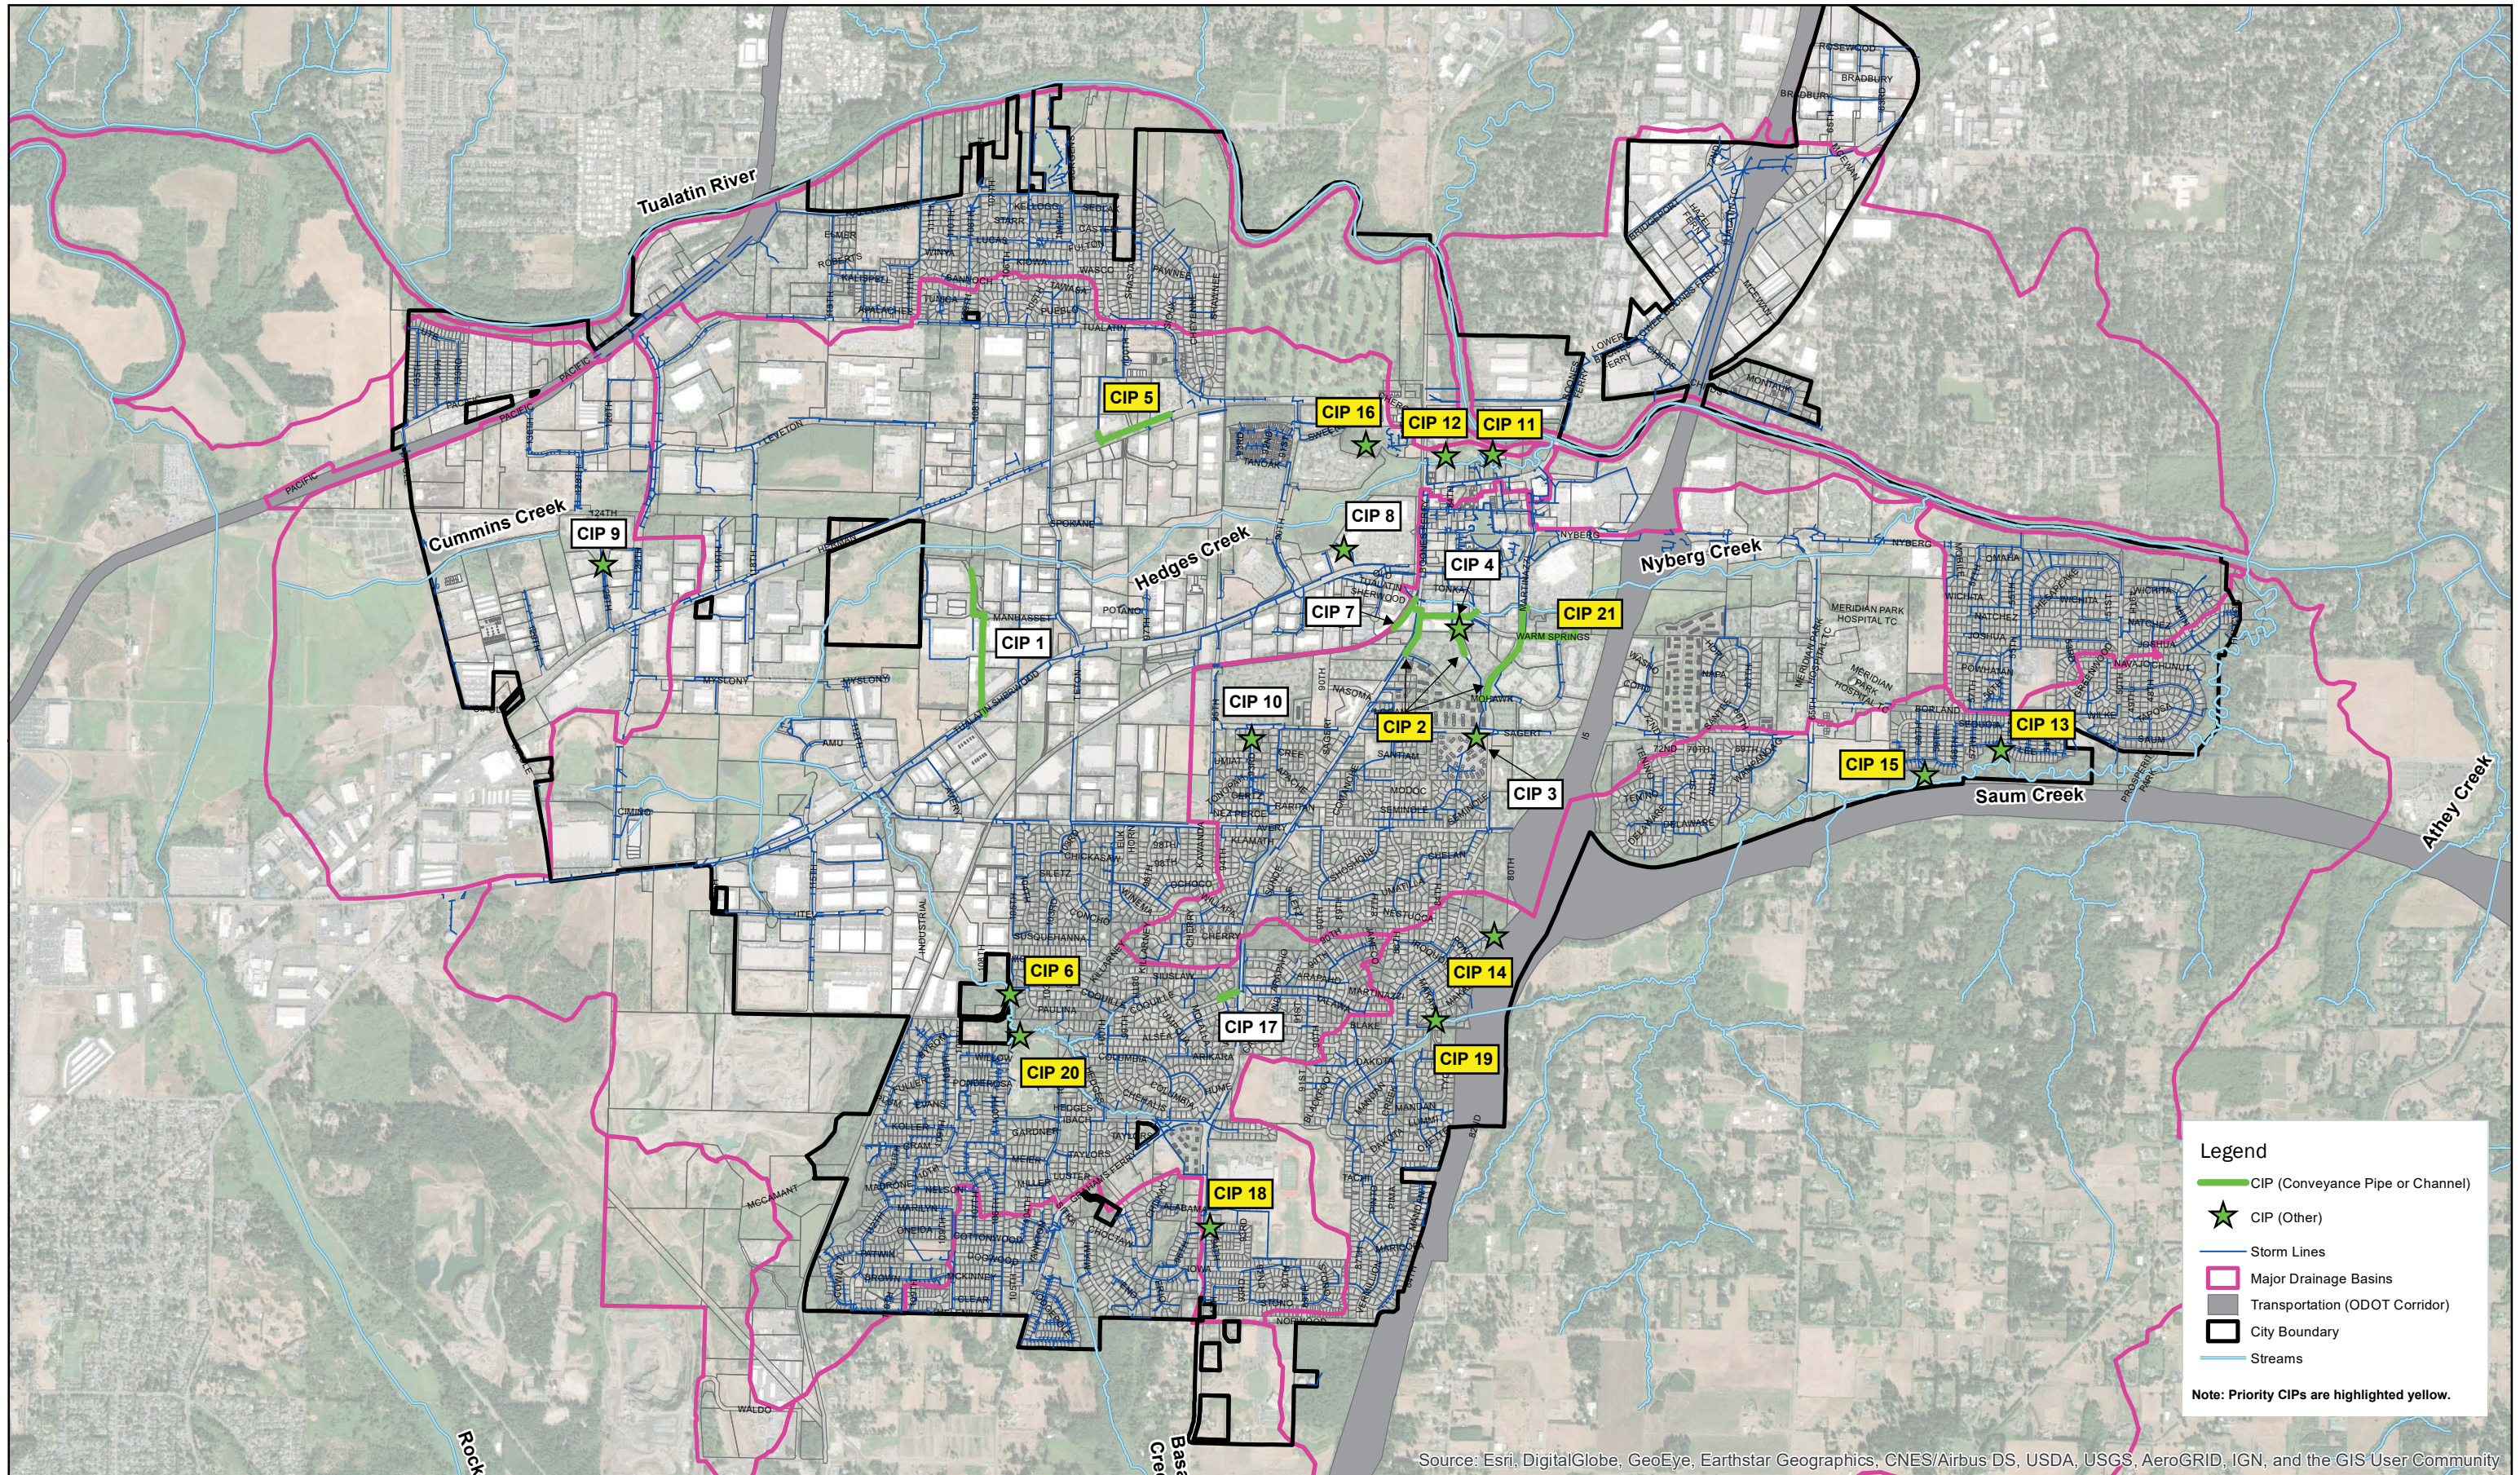

**Legend**

- CIP (Conveyance Pipe or Channel)
- ★ CIP (Other)
- Storm Lines
- Major Drainage Basins
- Transportation (ODOT Corridor)
- City Boundary
- Streams


Note: Priority CIPs are highlighted yellow.

Source: Esri, DigitalGlobe, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community



**City of Tualatin  
Stormwater Master Plan**

Date: April 2019  
Project: Project 149233



Notes:  
1. Projection: NAD 1983 State Plane Oregon North (feet)



## Section 1

# Introduction

The City of Tualatin (City) developed this citywide Stormwater Master Plan (SMP or Plan) to guide stormwater capital project and program decisions over a 10-year planning period. This SMP addresses both water quantity and quality for constructed systems under the City's management.

The City manages approximately 93 miles of piped and open channel stormwater infrastructure. The City has experienced rapid growth and development over the last 20 years that thus has a relatively new collection and conveyance system. However, development rates and projections indicate that the stormwater system will require expansion and upgrades to accommodate future growth. The City needs a proactive plan to address capacity needs, replace failing infrastructure, and address regulatory drivers related to water quality improvement.

This Plan documents the process and methods used to evaluate the City's drainage infrastructure and natural systems. Results of the evaluation provide the City with projects and programmatic stormwater actions for implementation. The study area for this Plan includes all areas within the city limits and three planning areas (Northwest Concept Area, Southwest Concept Area, Basalt Creek Concept Area). Major receiving water bodies include Nyberg Creek, Hedges Creek, Saum Creek and the Tualatin River mainstem.

## 1.1 Stormwater Master Plan Objectives

The City's overarching goal for this SMP is to guide stormwater infrastructure improvements for the natural and built environment over a 10-year implementation period. Improvements must address future growth, water quality, maintenance/system condition issues, and capacity issues. Outcomes from this effort include a prioritized project list, subsequent program recommendations, and a financial analysis that includes rate recommendations to support the implementation of projects and programs.

Specific objectives related to development of this SMP include:

- Establishing a foundation for evaluating stormwater system needs in Tualatin and soliciting information from staff and stakeholders to inform the targeted and integrated identification of project needs and improvements.
- Identifying existing problem areas and providing project solutions related to collection, conveyance, treatment and detention. This includes:
  - Developing hydrologic and hydraulic (H/H) models to evaluate system capacity limitations and assess the frequency of nuisance flooding based on current system information as obtained from the City's GIS and survey.
  - Identifying water quality treatment opportunities throughout the city to be accomplished through water quality retrofits and existing system improvements.
  - Assessing stream health and physical conditions to develop a baseline condition assessment for future evaluations and identify project and program needs.
- Developing programs to support proactive maintenance of infrastructure.

- Reviewing current stormwater program funding, including rates and system development charges, and establishing an updated funding strategy and rates to manage the drainage system and construct recommended (priority) improvements.
- Establishing baseline cost estimates (Association for the Advancement of Cost Engineering [AACE] Class 5) for recommended stormwater improvements for use in planning and budgeting.

This Plan is intended to support regulatory directives under Clean Water Services’ (CWS or District’s) watershed-based National Pollutant Discharge Elimination System (NPDES) permit (Permit), of which the City is a co-implementor. The City is required to meet stormwater-related obligations and programs as documented in CWS’ Stormwater Management Plan (SWMP) and referenced in intergovernmental agreements (IGA). Identifying water quality improvement and stormwater retrofits is a focus of the current (2016) Permit and SWMP.

In addition, the City values its natural systems and open spaces that are available to the community. Protecting natural systems (wetlands, stream channels, riparian corridors, and vegetated buffers) is important for maintaining a livable and healthy city. This Plan was also developed to support management of these natural resources and support their beneficial uses.

## 1.2 Background and Related Studies

The City’s last stormwater master plan was completed in 1972 and does not reflect the current condition or configuration of the City’s stormwater infrastructure. The City does not have a capital project list that directly reflects current development activities, population growth, and regulatory drivers. Updated project and program strategies included in this Plan represent priority needs for future budgeting.

The city is one of the fastest growing communities in Oregon, which has prompted the need to invest in infrastructure and consider long-range planning and policy decisions to support businesses and residential life. Copies of various planning-level reports and studies prepared since the last stormwater master plan were obtained to help inform areas of high growth potential and to identify stormwater system deficiencies and needs. Reports and studies reviewed and considered for this master plan update are detailed in Table 1-1.

Table 1-1. Existing Stormwater Planning Documentation and Reports		
Report	Date	Summary and Application to the SMP
Tualatin Drainage Plan Report	1972	Provides background information and historic basis for the need to update the SMP.
Hedges Creek Wetlands Master Plan	2002	Provides stormwater management recommendations (culvert upsizing under Tualatin Road, sediment removal) related to the 29-acre Hedges Creek Wetlands.
Bridgeport Area Stormwater Master Plan	2005	Provides stormwater system information and a subbasin delineation in the Bridgeport Development Area.
Southwest Tualatin Concept Plan	2010	Provides guidance for industrial development in southwest Tualatin. Planning district/zoning designation is available.
Basalt Creek Existing Conditions Report	2014	Provides surrounding land use and demographic information for the Basalt Creek Planning Area. Does not provide official planning district/zoning designation or proposed transportation corridors.
Hedges Creek Stream Assessment	2018	Independent stream assessment from SW Ibach Street to SW 105 <sup>th</sup> Avenue. Results were used to supplement the stream assessment conducted as part of this SMP.
Basalt Creek Concept Plan	2018	Provides preferred land use and recommends high-level concepts for transportation and infrastructure planning for the Basalt Creek Planning Area.



### 1.3 Stormwater Master Plan Development Process

The approach used to develop this Plan is provided in Figure 1-1.

This process leveraged City staff knowledge and existing data (see Planning Process in Figure 1-1) to conduct focused evaluations on areas/infrastructure where additional investigation is likely to inform capital projects and programs. This approach focused resources on the areas currently identified as problems. The overall process was implemented as follows:

1. Data reconnaissance and solicitation of input from City staff and stakeholders was conducted at the beginning of the project to identify stormwater problem areas (Planning Process). Targeted locations requiring modeling or stream assessment to inform project/program needs were identified.
2. A water quality assessment was conducted to identify water quality project opportunities and supplement stormwater problem areas and preliminary project needs (Planning Process).
3. A capacity evaluation (H/H modeling) and a stream assessment were completed to further define project and program solutions (Capacity Evaluation and Stream Assessment).
4. Project Opportunity Areas were defined geographically from identified stormwater problem areas and water quality opportunity areas and vetted based on evaluations/assessments, field visits, and workshops.
5. A maintenance assessment was conducted to define current maintenance obligations and programmatic activity needs (Maintenance Assessment).
6. Capital project and program descriptions and cost estimates were developed and vetted with City staff for inclusion in the Plan (Capital Improvement Program).
7. Staffing analysis, project prioritization, and development of other cost information to support the financial evaluation (rate and system development charges) were completed.
8. Documentation of the master planning approach and project and program descriptions and costs was completed at the end of the process.

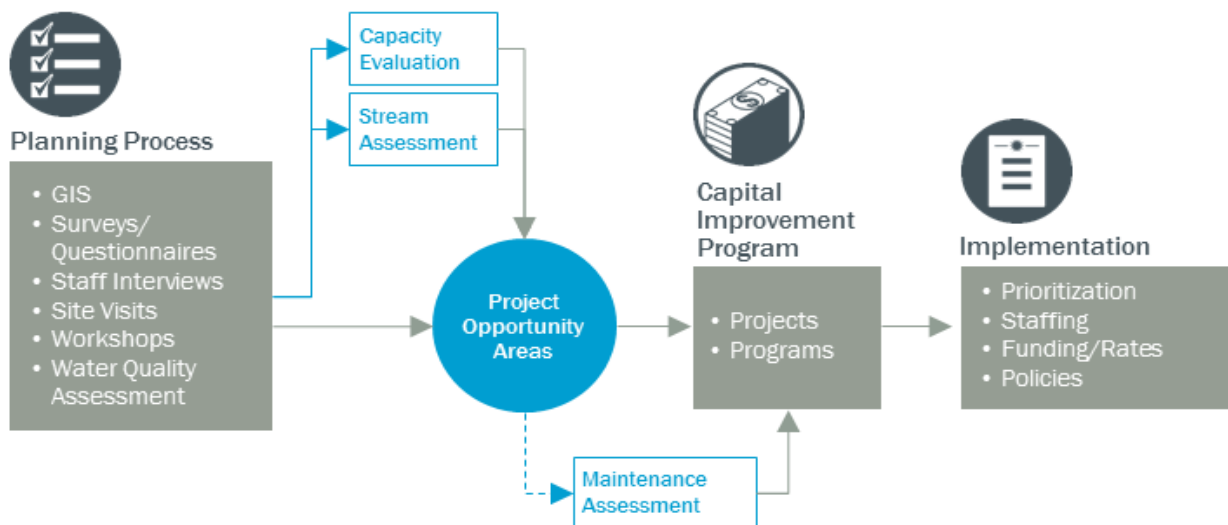


Figure 1-1. Stormwater Master Plan approach

## 1.4 Document Organization

Following this introductory Section 1, this SMP is organized as follows:

- Section 2 includes a description of the study area characteristics.
- Section 3 summarizes the planning process, which includes preliminary identification of problem areas, water quality opportunities, modeling needs, and stream assessment needs. Project Opportunity Areas stemming from the planning process are identified.
- Section 4 describes H/H modeling methods and results of the stormwater capacity evaluation and includes identifying capacity-related capital projects.
- Section 5 describes the stream assessment methods and results and identifies capital project, program, and policy recommendations stemming from field observations.
- Section 6 describes the maintenance assessment, including results of the Programmatic Activity Workshop. Capital project and program recommendations stemming from the maintenance assessment are identified.
- Section 7 summarizes the overall capital improvement program recommendations, including the final capital projects, programs and respective cost estimates.
- Section 8 provides an overview of the implementation elements of the capital improvement program, including a summary of staffing needs to support proposed projects and programs, the project prioritization process, level of service determination, and financial evaluation results.

## Section 2

# Study Area Characteristics

This section provides an overview of study area characteristics and stormwater system operations, including location, topography, soils, land use, drainage system configuration, and stormwater program activities.

Referenced figures reflecting study area characteristics are located at the end of this section.

### 2.1 Location

The City of Tualatin is located 13 miles southwest of Portland, Oregon. Most of the city is in Washington County, with a small portion of area along the eastern city limits located in Clackamas County (Figure 2-1). Neighboring areas include the cities of Tigard, King City and Durham to the north; the City of Wilsonville to the south; unincorporated Washington County, including the Tualatin River National Wildlife Refuge, to the west; and unincorporated Clackamas County, commonly referred to as the Stafford Triangle, to the east.

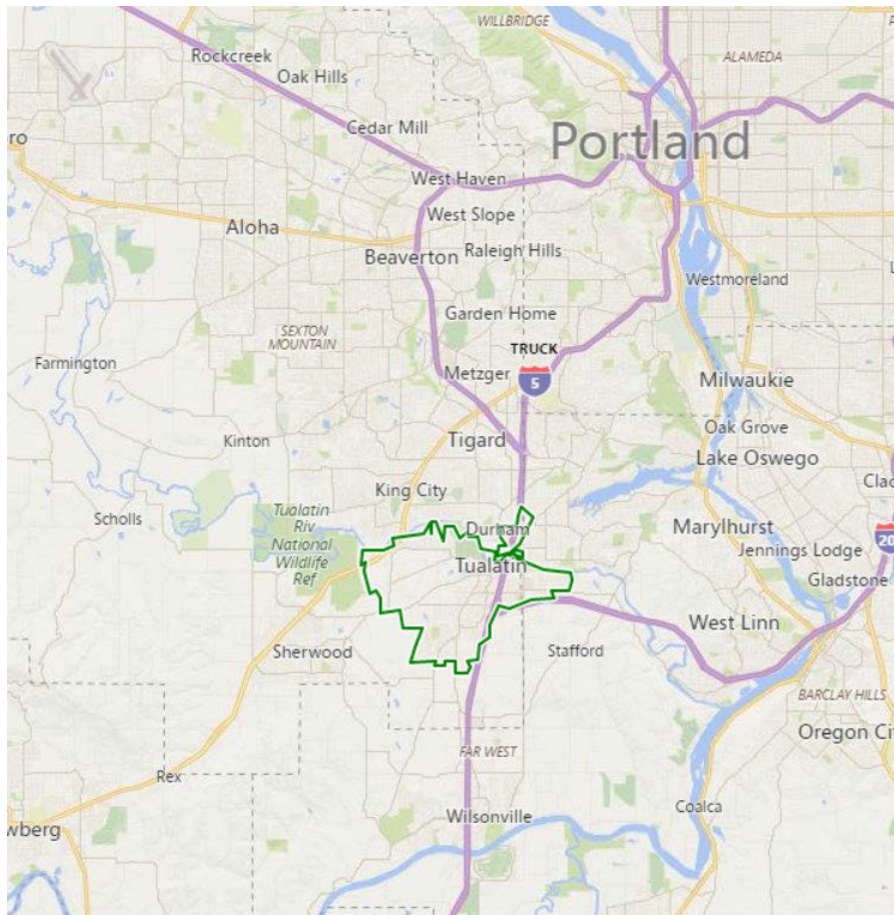


Figure 2-1. Location overview

Interstate 5 (I-5) runs north-south through the city, attributing to the large commercial corridor along the I-5 right-of-way (ROW). The intersection of I-5 and Interstate 205 (I-205) is in the southeast area of the city. Oregon Highway 99W intersects the City in the northwest corner. The city boasts a strong commercial and industrial economy, and prominent waterways access and parks, which make the city one of the most livable communities in the Portland metro area.

The city is approximately eight square miles in area, with an additional 1.2 square miles associated with planning areas outside of the city limits (Figure 2-2). The majority (approximately 97 percent) of the city discharges to the Tualatin River and tributaries. Major tributaries include Nyberg Creek, Hedges Creek, Cummins Creek, and Saum Creek. Area along the northern portion of the city discharges north directly to the Tualatin River, whereas the tributaries generally run east-west across the city before discharging into the Tualatin River. The remainder (approximately 3 percent) of the city discharges to Basalt Creek, a tributary located in the southern portion of the City, which runs south to Coffee Lake Creek in the City of Wilsonville before discharging to the Middle Willamette River.

## 2.2 Future Planning Areas

There are three future planning areas in the city: The Southwest Concept Plan Area, the Northwest Concept Plan Area and the Basalt Creek Planning Area (Figure 2-2).

Concept plans for these areas have been developed to guide future development and expansion as the City grows. These areas have yet to undergo significant development or redevelopment. Concept plans help facilitate communication with citizens and stakeholders by laying out how the area might be developed with respect to land use, transportation, natural resources and utility planning. Concept plans also aid in determining future financial implications and the level of potential investment required to develop and provide infrastructure throughout the planning area.

Detail related to these three future planning areas are as follows:

- **Southwest Concept Plan Area:** The Southwest (SW) Concept Plan was completed in August 2005 to guide industrial development of a 614-acre area located south of Tualatin-Sherwood Road between SW 115th and 124th avenues. The area is near the Tigard Sand and Gravel Quarry. In 2011, the SW Concept Plan was updated and adopted into the Tualatin Development Code (TDC). The portion of the planning area within the urban growth boundary and north of Tonquin Road (approximately 431 acres) was included in this SMP.
- **Northwest Concept Plan Area:** The Northwest (NW) Tualatin Concept Plan was completed in March 2005 and incorporated into the City's Development Code in June 2005. The NW concept planning area is 14 acres, located in the northwest corner of the city, and mostly developed. This planning area was included in this SMP.
- **Basalt Creek Planning Area:** The Basalt Creek Concept Plan was adopted by City Council in August 2018. The Plan was developed as a joint effort between the cities of Tualatin and Wilsonville. The area is located between the southern boundary of the Tualatin and northern boundary of Wilsonville. The total planning area encompasses 847 acres. Tualatin's portion of the planning area (approximately 356 acres) was included in this SMP.

## 2.3 Topography

Tualatin's topography is characterized as relatively flat with gentle slopes (Figure 2-3). The elevation in the city varies from 368 feet at the highest point to 96 feet at the lowest point. The lowest elevation areas are along the northern border of the city at the Tualatin River. The highest elevation areas are near SW Boones Ferry Road and SW Norwood Road.



The flat topography results in limited slope in the stormwater collection system, which contributes to standing water in pipes, backwater conditions, and high sediment accumulation. The average slope in the stormwater collection system ranges from 0.5 percent to 6.5 percent. There are significant wetland areas within the city, particularly along Hedges Creek and the downstream portion of Nyberg Creek, further attributed to the flat topography, high groundwater levels, and proximity to the Tualatin River.

More significant grade changes are observed in the southeast portion of the city, north of Saum Creek, where a steep ridge defines the northern stream bank and the southwest part of the city, adjacent to the SW Concept Plan Area.

## 2.4 Soils

The National Resources Conservation Service (NRCS) Soil Survey online tool was used to gather soils information for Tualatin. Soils are an important watershed characteristic for evaluating potential runoff rates and volumes. Soils are generalized into four categories or hydrologic soil groups (HSG), which approximate soil runoff potential. These groups are A, B, C, and D, where A soils are characterized by high rates of infiltration and low runoff potential and D soils are characterized by low rates of infiltration and high potential for runoff. HSG conditions are reflected on Figure 2-3.

Most of the soils in Tualatin are HSG Type C soils with pockets of A, B, C/D and D type soils. Table 2-1 shows the NRCS hydrologic soils group by percent coverage within the city limits and planning areas.

Hydrologic Soil Group	Acres	Percent
A	181	3
B	708	12
C	3,820	63
C/D	876	15
D	423	7
Total	6,008	100

There are saturated soils and wetland soil conditions along stream reaches and throughout the city. The City maintains a Wetlands Protection Area (WPA) GIS inventory that includes riparian areas along Hedges Creek, Nyberg Creek, and Saum Creek.

## 2.5 Land Use

Tualatin is a community that has experienced significant growth over the last 20 years. The population of Tualatin is approximately 27,500 as of July 1, 2017. The population has increased 5.2 percent between 2010 and 2017.

The city is primarily composed of industrial and residential land use, with significant areas of commercial development along the I-5 corridor and Tualatin-Sherwood Road. Large tracts of open space area (parks, greenways, natural areas, wetlands) are scattered throughout the city. Vacant lands with potential for development are located primarily in the western portion of the city.

Land use coverage was developed in GIS as part of this SMP to evaluate stormwater drainage conditions in the city. Land use coverage was based on City-provided GIS coverage of planning districts (zoning), open space areas, and developable lands. A detailed summary of the process to develop the City's land use coverage and associated impervious area estimates is provided in Technical Memorandum 1 (TM1), included in this SMP in Appendix B. Land use coverage is shown on Figure 2-4. Land use categories and impervious assumptions are reflected in Table 2-2.

**Table 2-2. Land Use Categories and Impervious Percentages**

Planning District Designation	Modeled Land Use Category	Impervious % (Existing)	Impervious % (Future)
Low-Density Residential	Low-density residential	43	53
Medium Low-Density Residential	Medium-density residential (MDR)	45	55
Medium High-Density Residential			
High-Density Residential	High-density residential	50	60
High-Density High Rise Residential			
General Commercial	Commercial (COM)	78	78
Central Commercial			
Medical Commercial			
Office Commercial			
Recreational Commercial			
General Manufacturing	Industrial (IND)	74	74
Light Manufacturing			
Manufacturing Business Park			
Manufacturing Park			
Institutional	Institutional (INS)	35	35
	Vacant, developable (VAC) <sup>a</sup>	5	Consistent with the underlying land use designation
	Open Space (OSP), undevelopable – Parks, greenways, natural areas, private <sup>b</sup>	5	5
	OSP, undevelopable – WPA, setbacks, Natural Resource Preservation Overlay, wetlands <sup>b</sup>	4	4
	Transportation (Oregon Department of Transportation corridor)	46	46
	Basalt Creek/rural residential	7	7

a. Vacant land use reflects area with new or infill development potential. Future development conditions assume development of vacant lands consistent with their associated planning district designation.

b. Open space land use reflects area with no foreseeable development potential.

Future growth for purposes of evaluating stormwater drainage infrastructure is based on projected development (i.e., vacant lands) (see Figure 2-4). Future industrial, primarily in the western half of the city, and commercial and multi-family residential development, is expected. Residential infill development is also anticipated. For the Basalt Creek planning area, future growth and development is expected but the timeframe is unknown. For purposes of this plan, future development conditions were not evaluated or assessed hydrologically for this area.

## 2.6 Climate and Rainfall

The northern Willamette Valley climate is characterized by cool wet winters and warm dry summers. Most rainfall occurs between October and April. On average, November is the wettest month with an average of 9.3 inches of rainfall. July and August are the warmest and driest months with average high temperatures above 80 degrees Fahrenheit and less than 1 inch of rain per month. The average annual precipitation for the Portland metropolitan area ranges from 37 to 43 inches, with an average of 1.8 inches of snowfall annually.

In December 2015, the Portland metro area experienced a large rainfall event that delivered more than 5 inches of rain over a 3-day period and 2.81 inches in one 24-hour period. This event was estimated to be between a 50- and 100-year frequency event because of the intensity and nature of the rainfall. These “severe” events are expected to occur more frequently as the earth undergoes climate change.

## 2.7 Natural Systems

Tualatin drains to six major waterbodies: The Tualatin River, Cummins Creeks, Hedges Creek, Nyberg Creek, Saum Creek and Basalt Creek. These waterbodies and their associated drainage basins are shown on Figure 2-5. Cummins Creek, Hedges Creek, Nyberg Creek, and Saum Creek are tributaries to the Tualatin River. Basalt Creek is a tributary to the Willamette River. Contributing city area and planning area by drainage basin is summarized in Table 2-3.

**Table 2-3. Major Drainage Basins and Contributing Drainage Area**

Major Drainage Basin	City Area (ac)	Planning Area (ac)
Tualatin River (direct)	906	0
Cummins Creek	313	13
Hedges Creek	2,277	288
Nyberg Creek	863	0
Saum Creek	514	34
Basalt Creek	170	318

ac = acre

Each major waterbody has unique characteristics and is being impacted by development in different ways. In general, the natural systems within the city are considered highly modified. They have been affected by historic development activities conducted without the inclusion of stormwater management facilities to address water quality and increased flow and runoff volumes. An overview of stream channel conditions is provided in Section 5.

Ownership of the natural system has been identified based on adjacent property ownership (Figure 2-5). Ownership status limits activities the City can conduct to maintain and preserve the waterbody’s integrity.

## 2.8 Stormwater Infrastructure System

The City manages approximately 93 miles (approximately 486,800 linear feet [LF]) of stormwater drainage pipe and 1.5 miles (7,700 LF) of roadside drainage ditches. There are six major receiving waters located throughout the city. As a result, most of the City’s drainage infrastructure consists of small dispersed systems rather than large trunk lines. There are 386 mapped outfalls from the piped systems to receiving waters. The majority of pipe in the city is 12-inch concrete pipe.

Tables 2-4 and 2-5 summarize pipe characteristics and major drainage system features in the city as mapped in GIS. Major drainage features include manholes, catch basins, discharge points (outfalls), public water quality facilities (swales), public ponds (detention, dry ponds), and underground injection control wells. Figure 2-6 provides an overview of the stormwater collection and conveyance system.

<b>Table 2-4. System Asset Inventory–Pipes and Open Channels, Public (mapped in GIS)</b>	
<b>Diameter</b>	<b>Length (ft)</b>
Not documented in GIS	11,684.1
0-6	27,891.1
8-12	244,648.3
14-18	102,535.4
20-24	57,762.1
27-30	21,681.0
36	14,519.0
42	1,146.2
48	3,952.9
54	0.0
60	728.4
66	0.0
72	229.2
Mapped Open Channels	7,735.3
<b>Total (Pipe)</b>	<b>494,513.0</b>

<b>Table 2-5. Major Drainage Features (Counts)</b>	
<b>Major Drainage Feature</b>	<b>Number)</b>
Manholes	1,929
Catch basins	3,072
Outfalls	386
Public water quality facilities (swales)	32
Public ponds (detention, dry ponds)	52

Although most development in the city has occurred over the last 25 to 30 years, proactive system inspection and maintenance is needed to ensure continued performance. The City currently has limited information regarding underground utility condition and age. As the city continues to grow and expand, pipe and infrastructure will be added to the City’s asset inventory that will need to be managed and maintained.

## 2.9 Water Quality and Regulatory Drivers

The Oregon Department of Environmental Quality (DEQ) is responsible for implementing provisions of the federal Clean Water Act (CWA) pertaining to stormwater discharges and surface water quality. DEQ conducts permitting for activities that discharge to surface waters, establishes water quality criteria for waterbodies based on designated use, and conducts studies and evaluations to

determine whether a waterbody adheres to water quality standards. Water quality is a specific focus of this SMP.

### **2.9.1 National Pollutant Discharge Elimination System (NPDES) Permit Program**

The NPDES Municipal Separate Storm Sewer permit program regulates discharges of stormwater to receiving waters from urban areas and requires permitted municipalities to develop and implement stormwater control measures to address stormwater quality.

The City is a co-implementer on the CWS watershed-based NPDES permit, along with 12 other jurisdictions in Washington County, for managing stormwater runoff. CWS' NPDES permit was reissued in May 2016 for a 5-year permit term.

Implementation of CWS' NPDES permit is outlined in the CWS SWMP. Stormwater activities or best management practices (BMP) are outlined to address the elements of the permit including public education, public involvement, illicit discharge detection/elimination, construction site management, post-construction stormwater management, industrial/commercial facility inspections, good housekeeping practices for municipal operations, and operations and maintenance (O&M) activities for stormwater management facilities.

In addition to the permit elements listed above, the reissued NPDES permit requires CWS and co-implementers to prepare a stormwater retrofit strategy, prepare a hydromodification assessment (to address instream channel erosion and modifications), and develop TMDL pollutant load reduction benchmarks. These additional requirements prompted the City to incorporate stormwater retrofits for water quality improvement into its capital project development (see Section 3.1.1) and evaluate instream channel conditions to support future hydromodification assessments (see Section 5).

Coordination efforts between the City and CWS are identified in the SWMP and outlined in detail in IGAs between the City and CWA. The City maintains IGAs with CWS for erosion and sediment control and select system O&M activities.

### **2.9.2 Total Maximum Daily Load (TMDL) and 303(d) Listings**

Section 303(d) of the CWA requires states to develop a list of water bodies that do not meet water quality standards. DEQ develops this list for Oregon, which is used to identify and prioritize water bodies for development of TMDLs. A TMDL identifies the assimilation capacity of a water body for specific pollutants and establishes pollutant load allocations for sources of discharge to the water body.

The Willamette and Tualatin rivers are the major receiving waters for Tualatin. These rivers and corresponding tributaries are on the 303(d) list for various parameters of concern and hold TMDLs for specific sources of pollutant loading. CWS is the identified discharge management agency in the Tualatin Subbasin and Willamette Basin TMDLs, and the City is identified as a contributing municipality associated with CWS. Table 2-6 summarizes the TMDL and 303(d) parameters relevant to the City.

Table 2-6. TMDL and 303(d) Summary for Tualatin					
Watershed/ Major Basin	Subbasin(s)	TMDL Year	Applicable TMDL parameters	TMDL surrogate parameters	Applicable 303(d) parameters <sup>a</sup>
Willamette River	Middle Willamette	2006	<ul style="list-style-type: none"> <li>Mercury</li> <li>Bacteria (<i>E. coli</i>)</li> <li>Temperature</li> </ul>	<ul style="list-style-type: none"> <li>Effective shade (surrogate for temperature)</li> </ul>	<ul style="list-style-type: none"> <li>Aldrin</li> <li>Biological criteria</li> <li>DDT/DDE</li> <li>Dieldrin</li> <li>Iron</li> <li>Polychlorinated biphenyls (PCB)</li> </ul>
Tualatin River	Tualatin	2001 and 2012 (update)	<ul style="list-style-type: none"> <li>Bacteria (<i>E. coli</i>)</li> <li>Chlorophyll a</li> <li>pH</li> <li>Dissolved oxygen</li> <li>Temperature</li> </ul>	<ul style="list-style-type: none"> <li>Total phosphorus (surrogate for chlorophyll a and pH)</li> <li>Total suspended solids (equivalent parameter for settleable volatile solids [SVS], a surrogate for dissolved oxygen)</li> <li>Effective shade (surrogate for temperature)</li> </ul>	<ul style="list-style-type: none"> <li>Ammonia</li> <li>Biological criteria</li> <li>Copper</li> <li>Iron</li> <li>Lead</li> <li>Zinc</li> </ul>

a. The 2016 303(d) list for Oregon was approved by DEQ in January 2019. It is the effective list for Oregon.

## 2.10 Stormwater Program Management

Stormwater program management includes maintenance, program operations, and program funding as described in the following subsections. This SMP includes an evaluation of maintenance activities and recommended program improvements to supplement capital project needs (see Section 6).

### 2.10.1 Maintenance Obligations

Maintenance of the City's assets is important to ensure that the full life expectancy is realized. The City allocates six, full-time equivalent (FTE) staff for utility system maintenance in the Public Works Department. Utility system maintenance includes stormwater system maintenance. Utility maintenance crews share responsibilities for multiple utility and infrastructure assets.

As mentioned, the City is a co-implementer on the CWS watershed-based NPDES permit for managing stormwater runoff. Maintenance obligations are outlined in the effective SWMP, dated 2016. Maintenance activities occur on a scheduled basis and in response to citizen and staff requests and are documented annually in the CWS stormwater annual report. Typical maintenance activities include:

- Pipeline inspection (CCTV) and cleaning
- Manhole repair
- Catch basin cleaning
- Public water quality facility inspection and maintenance (water quality manholes, vegetated stormwater facilities, proprietary filter systems). Public ponds are not routinely inspected and maintained by the City.
- Street sweeping

### 2.10.2 Program Operations

Programmatic stormwater activities are generally implemented to comply with NPDES permit requirements and may be conducted by utility maintenance staff or engineering staff in the Public Works Department.

The City employs two full-time equivalent staff engineers, three engineering associates, and two engineering technicians all responsible for a variety of engineering needs, including stormwater. Program implementation is documented annually in the CWS NPDES annual report. Program activities conducted by the City include:

- Private stormwater quality facility tracking and inspections. Annual notices are mailed to facility owners reminding them of their maintenance obligations.
- Stormwater development review.
- Illicit discharge detection and elimination, including spill response.
- Promotion of regional stormwater public outreach materials and campaigns.

CWS performs erosion control inspections and enforcement on the City's behalf in accordance with an IGA.

### 2.10.3 Staffing and Program Funding


The stormwater program is funded primarily through stormwater utility fees. Utility fee revenue for the 2019–2020 fiscal year is approximately \$3.4 million. CWS serves as the lead storm utility agency and implements selected program activities on behalf of the city.

A financial evaluation was conducted as part of this master planning effort to determine an annual stormwater utility rate and stormwater development charge (SDC) increase to support the proposed capital improvement program and ensure adequate funding levels to support implementation needs (see Section 8).

Staffing levels to implement the City's stormwater program are considered adequate to implement current project and program needs; however, additional staff resources will be required to ensure timely project implementation and expanded program activities. Detail related to current and projected staffing needs is included in Section 8.1.

This page intentionally left blank.



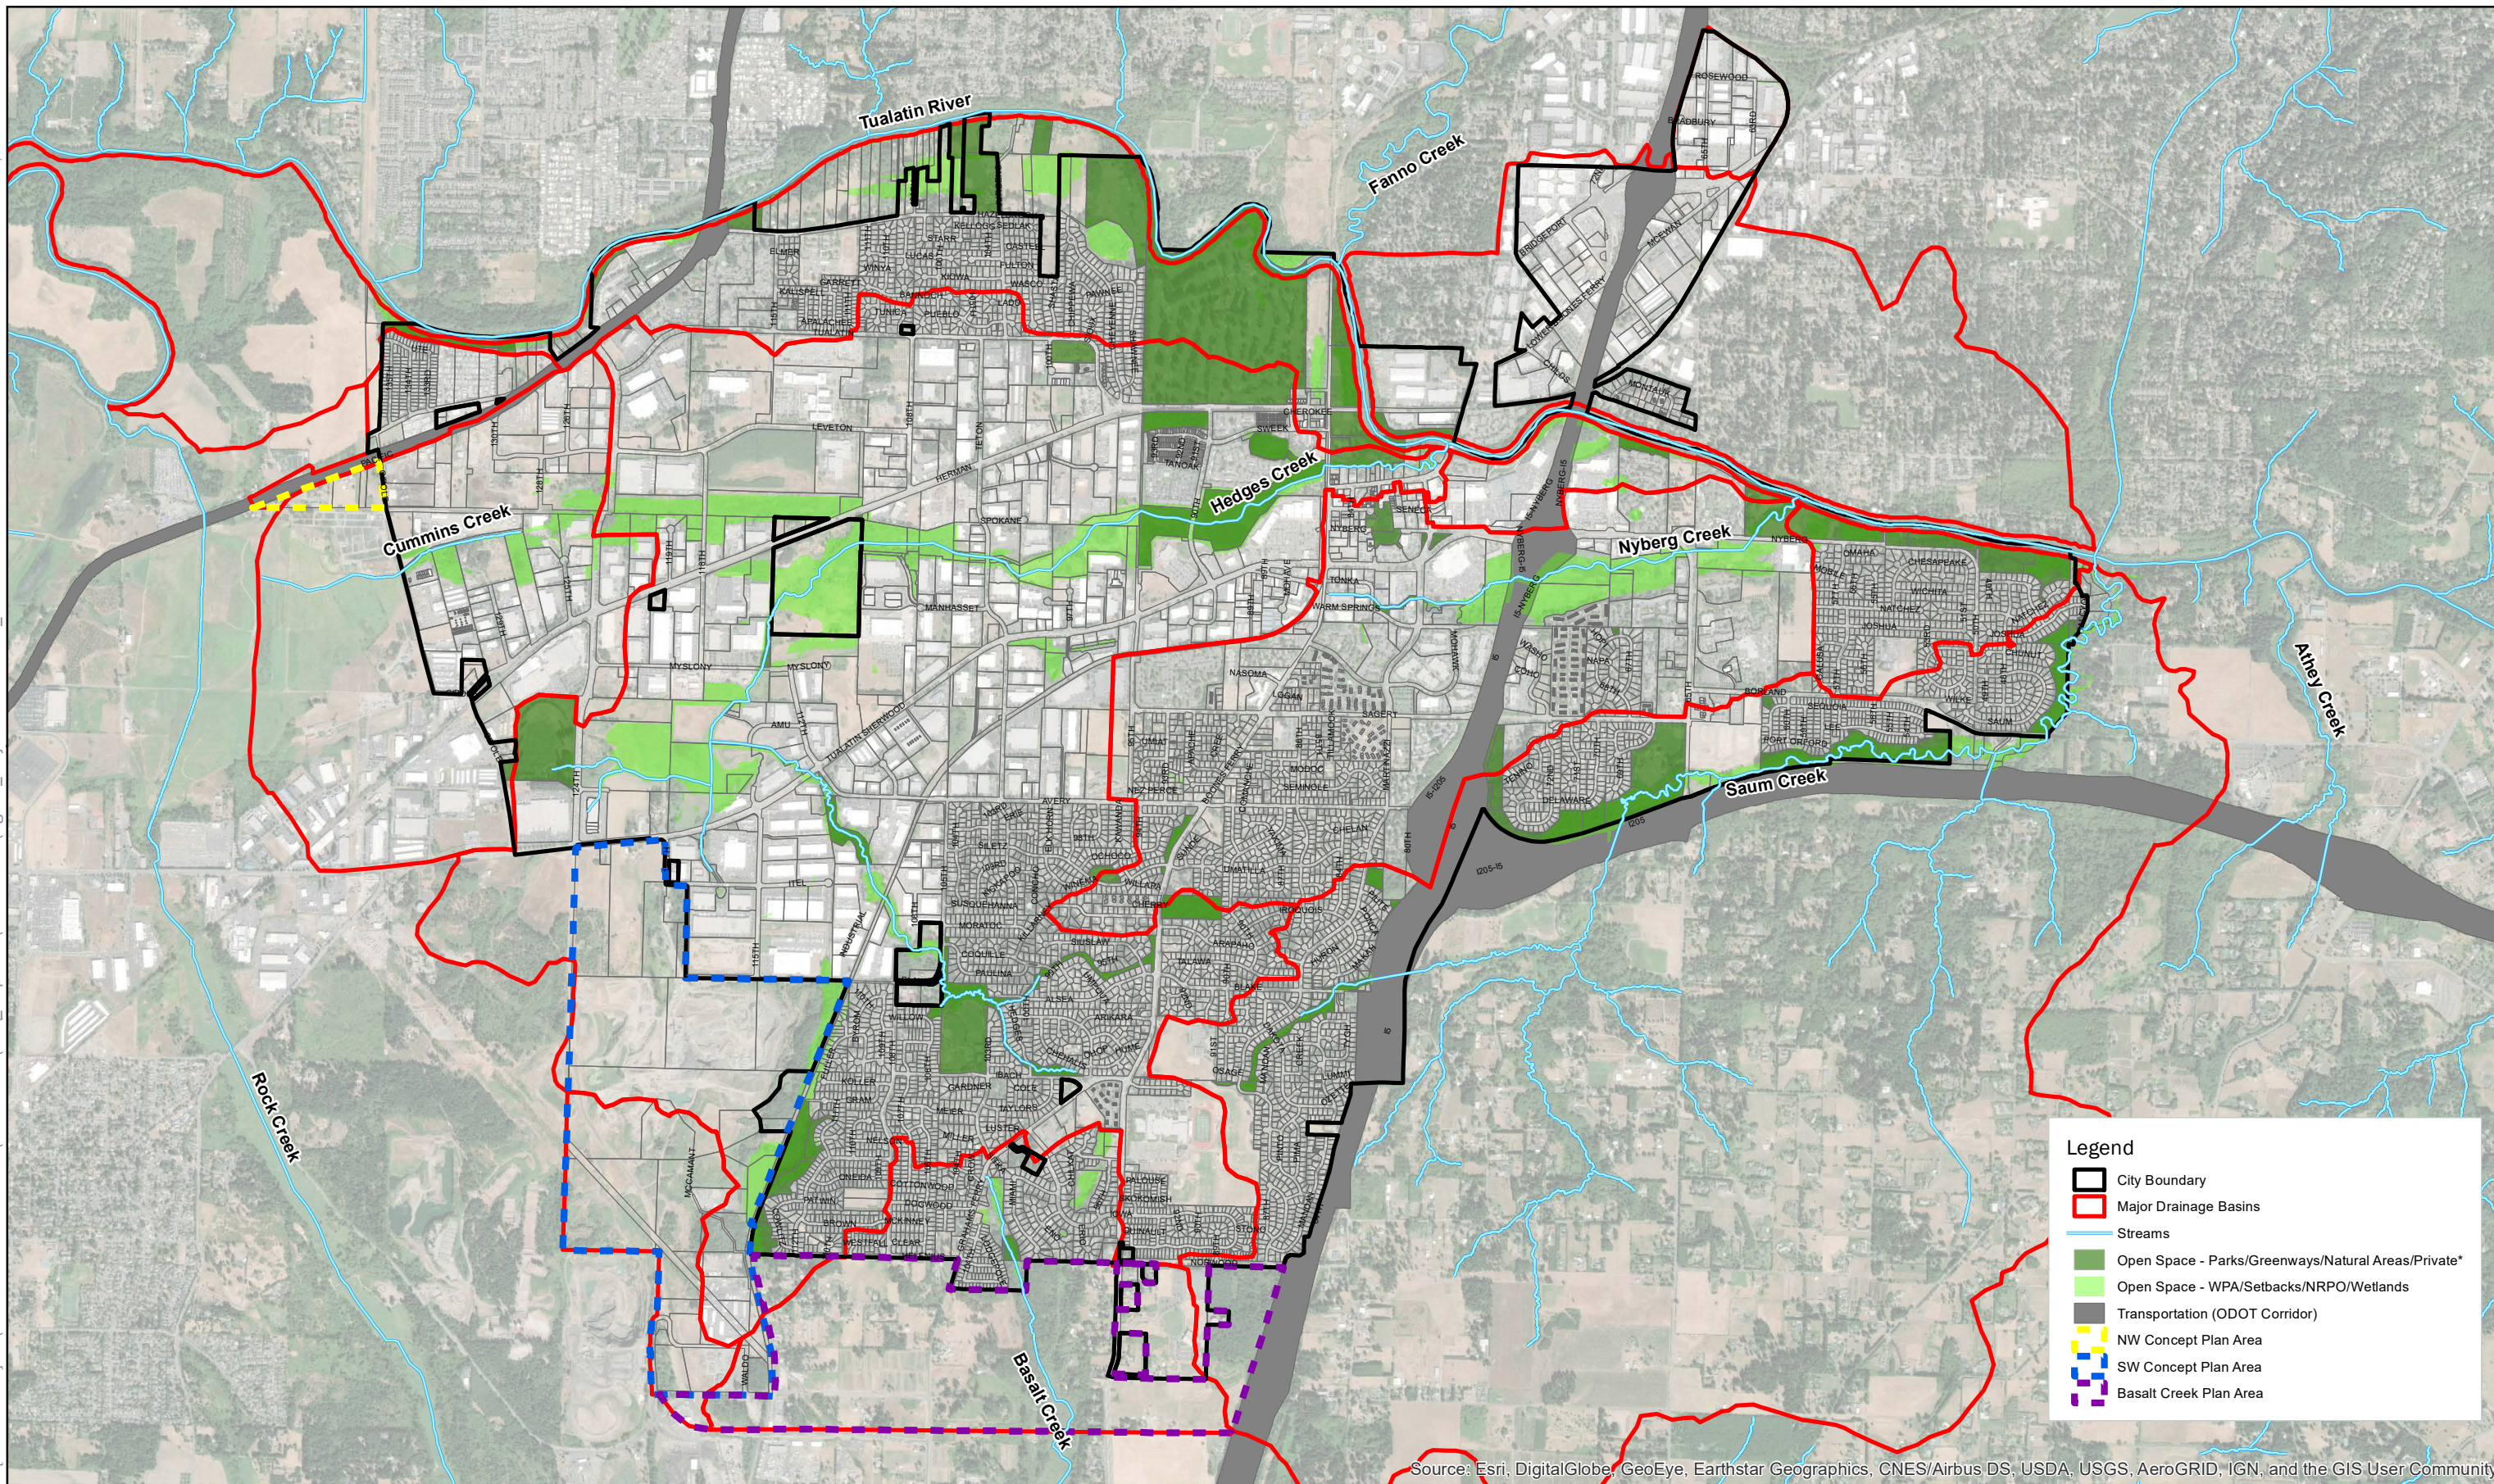


Source: Esri, DigitalGlobe, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community



**City of Tualatin**  
**Stormwater Master Plan**


Date: April 2019  
 Project: Project 149233



Notes:  
 1. Projection: NAD 1983 State Plane Oregon North (feet)

**Figure 2-2**  
**Project Area Overview**



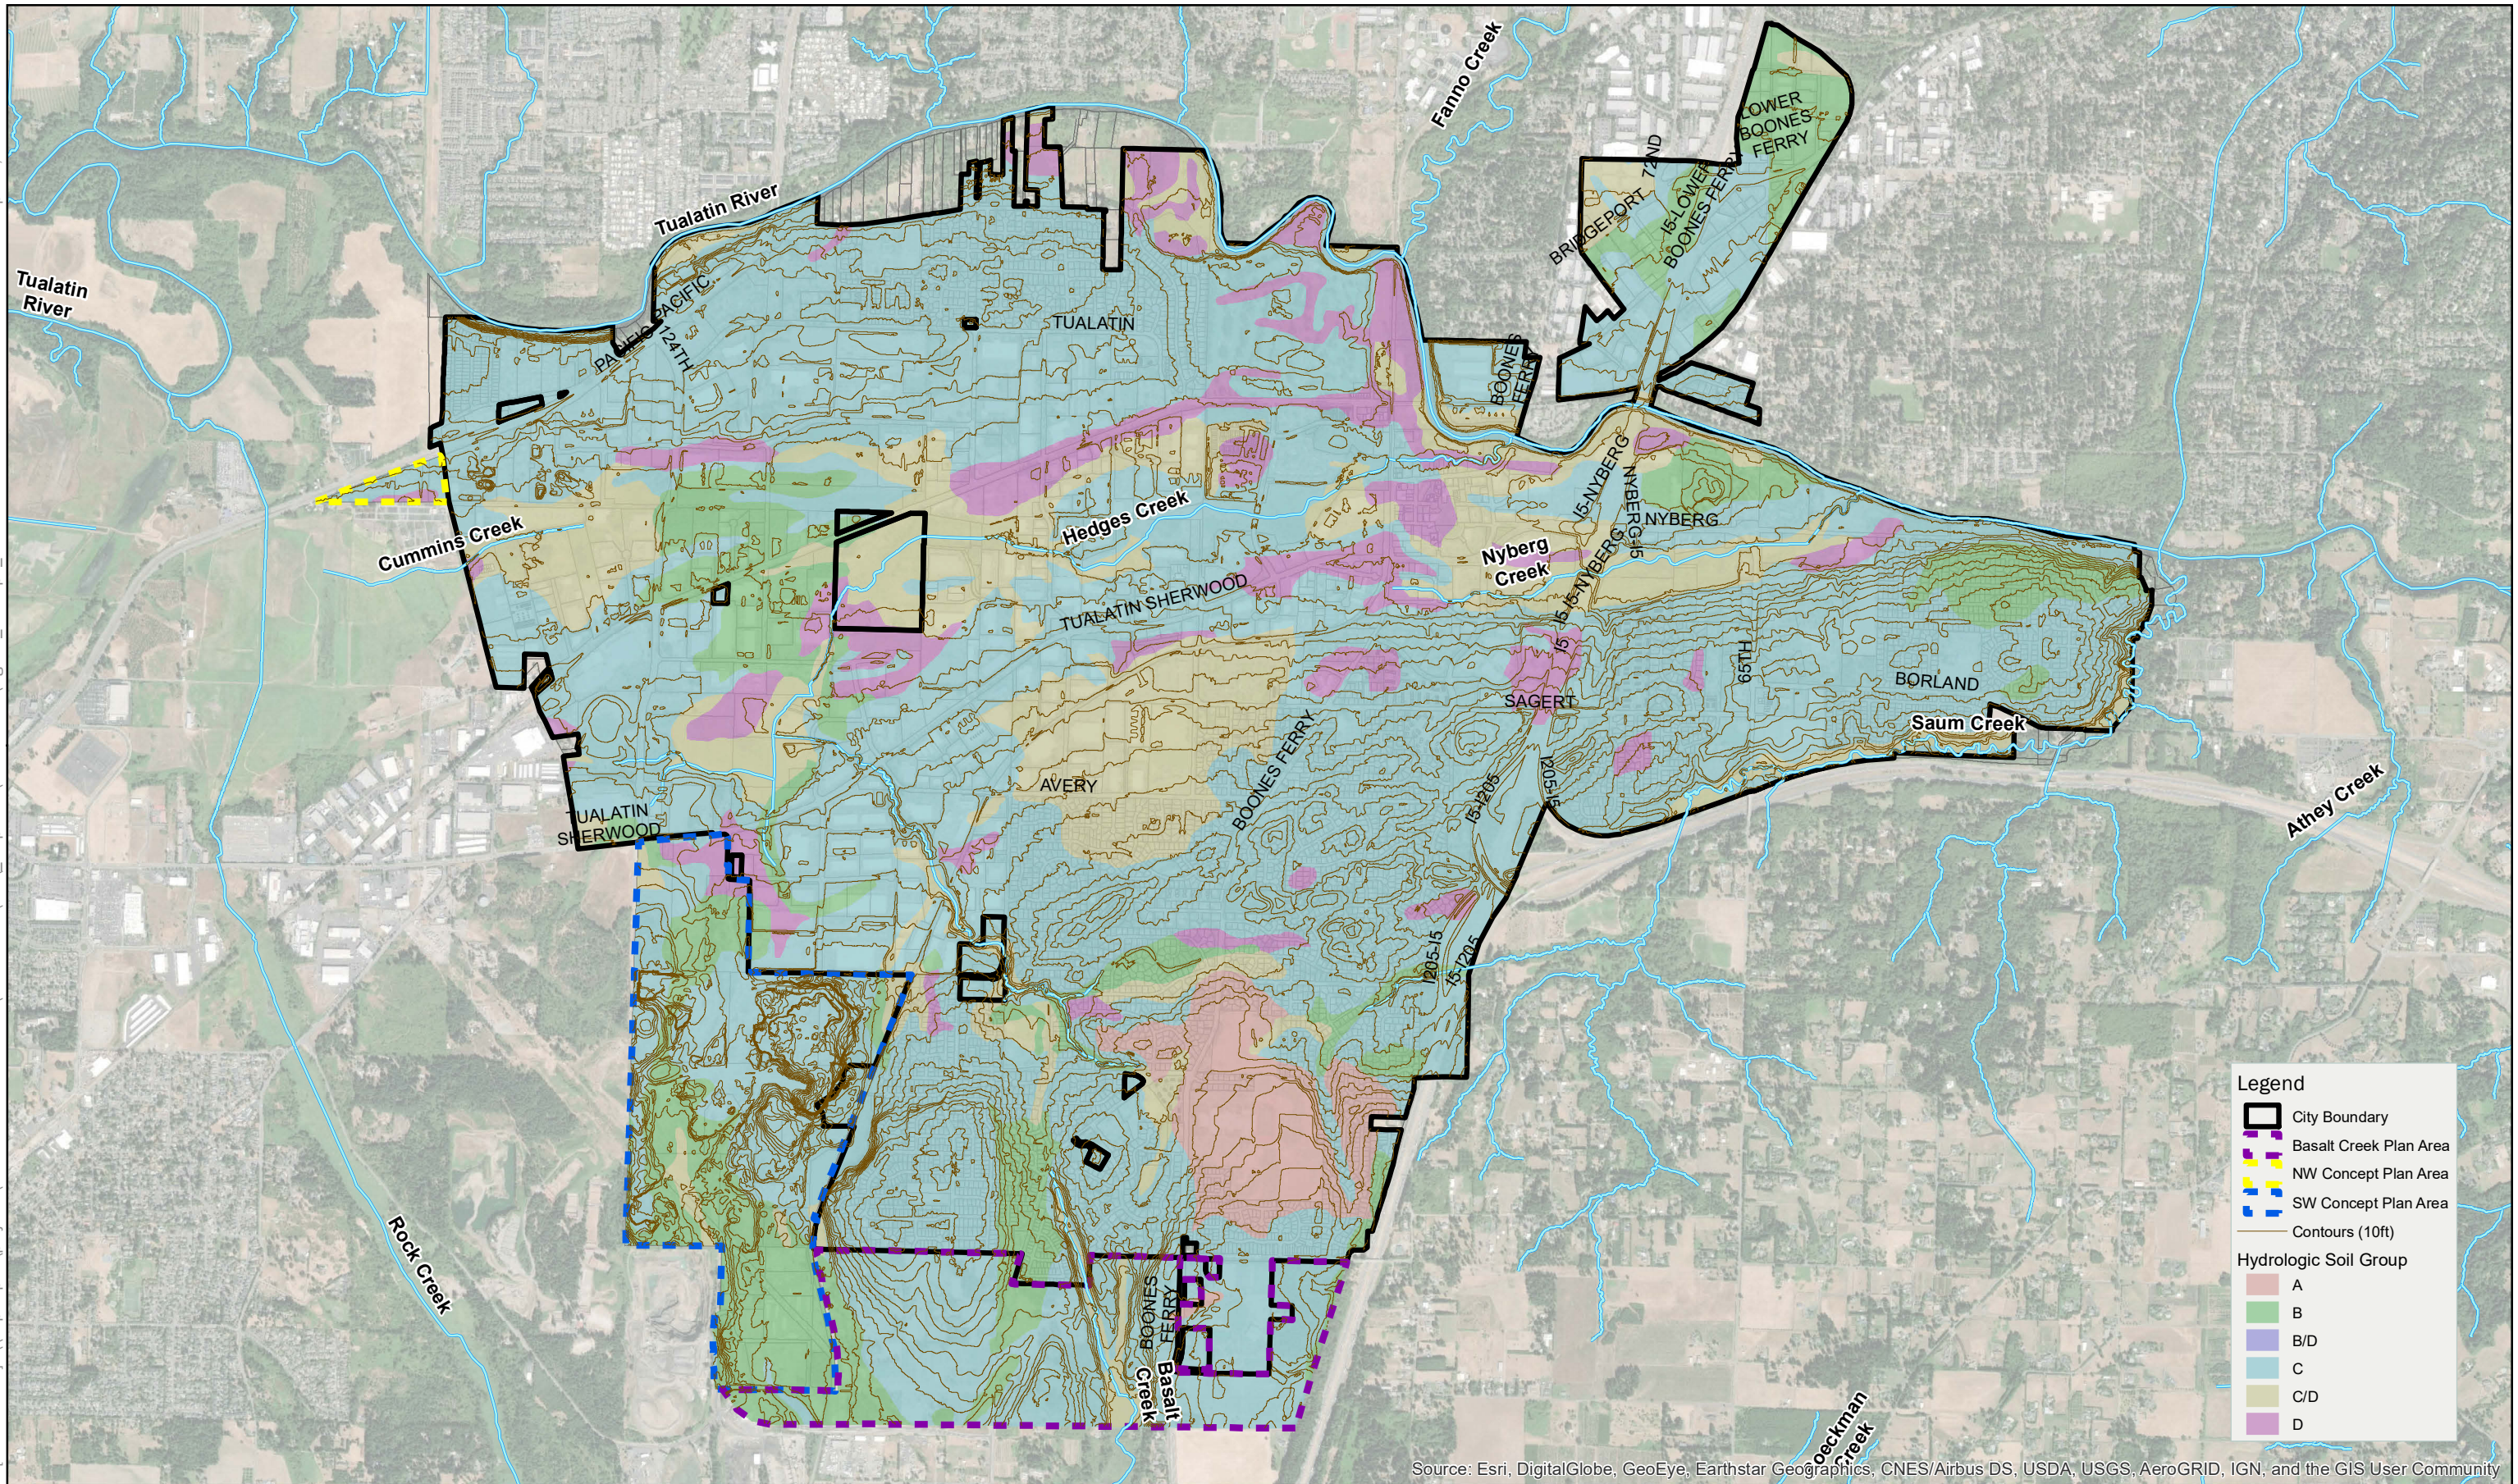


Source: Esri, DigitalGlobe, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community



**City of Tualatin**  
**Stormwater Master Plan**


Date: April 2019  
 Project: Project 149233



Notes:  
 1. Projection: NAD 1983 State Plane Oregon North (feet)

**Figure 2-3**  
**Topography and Soils**



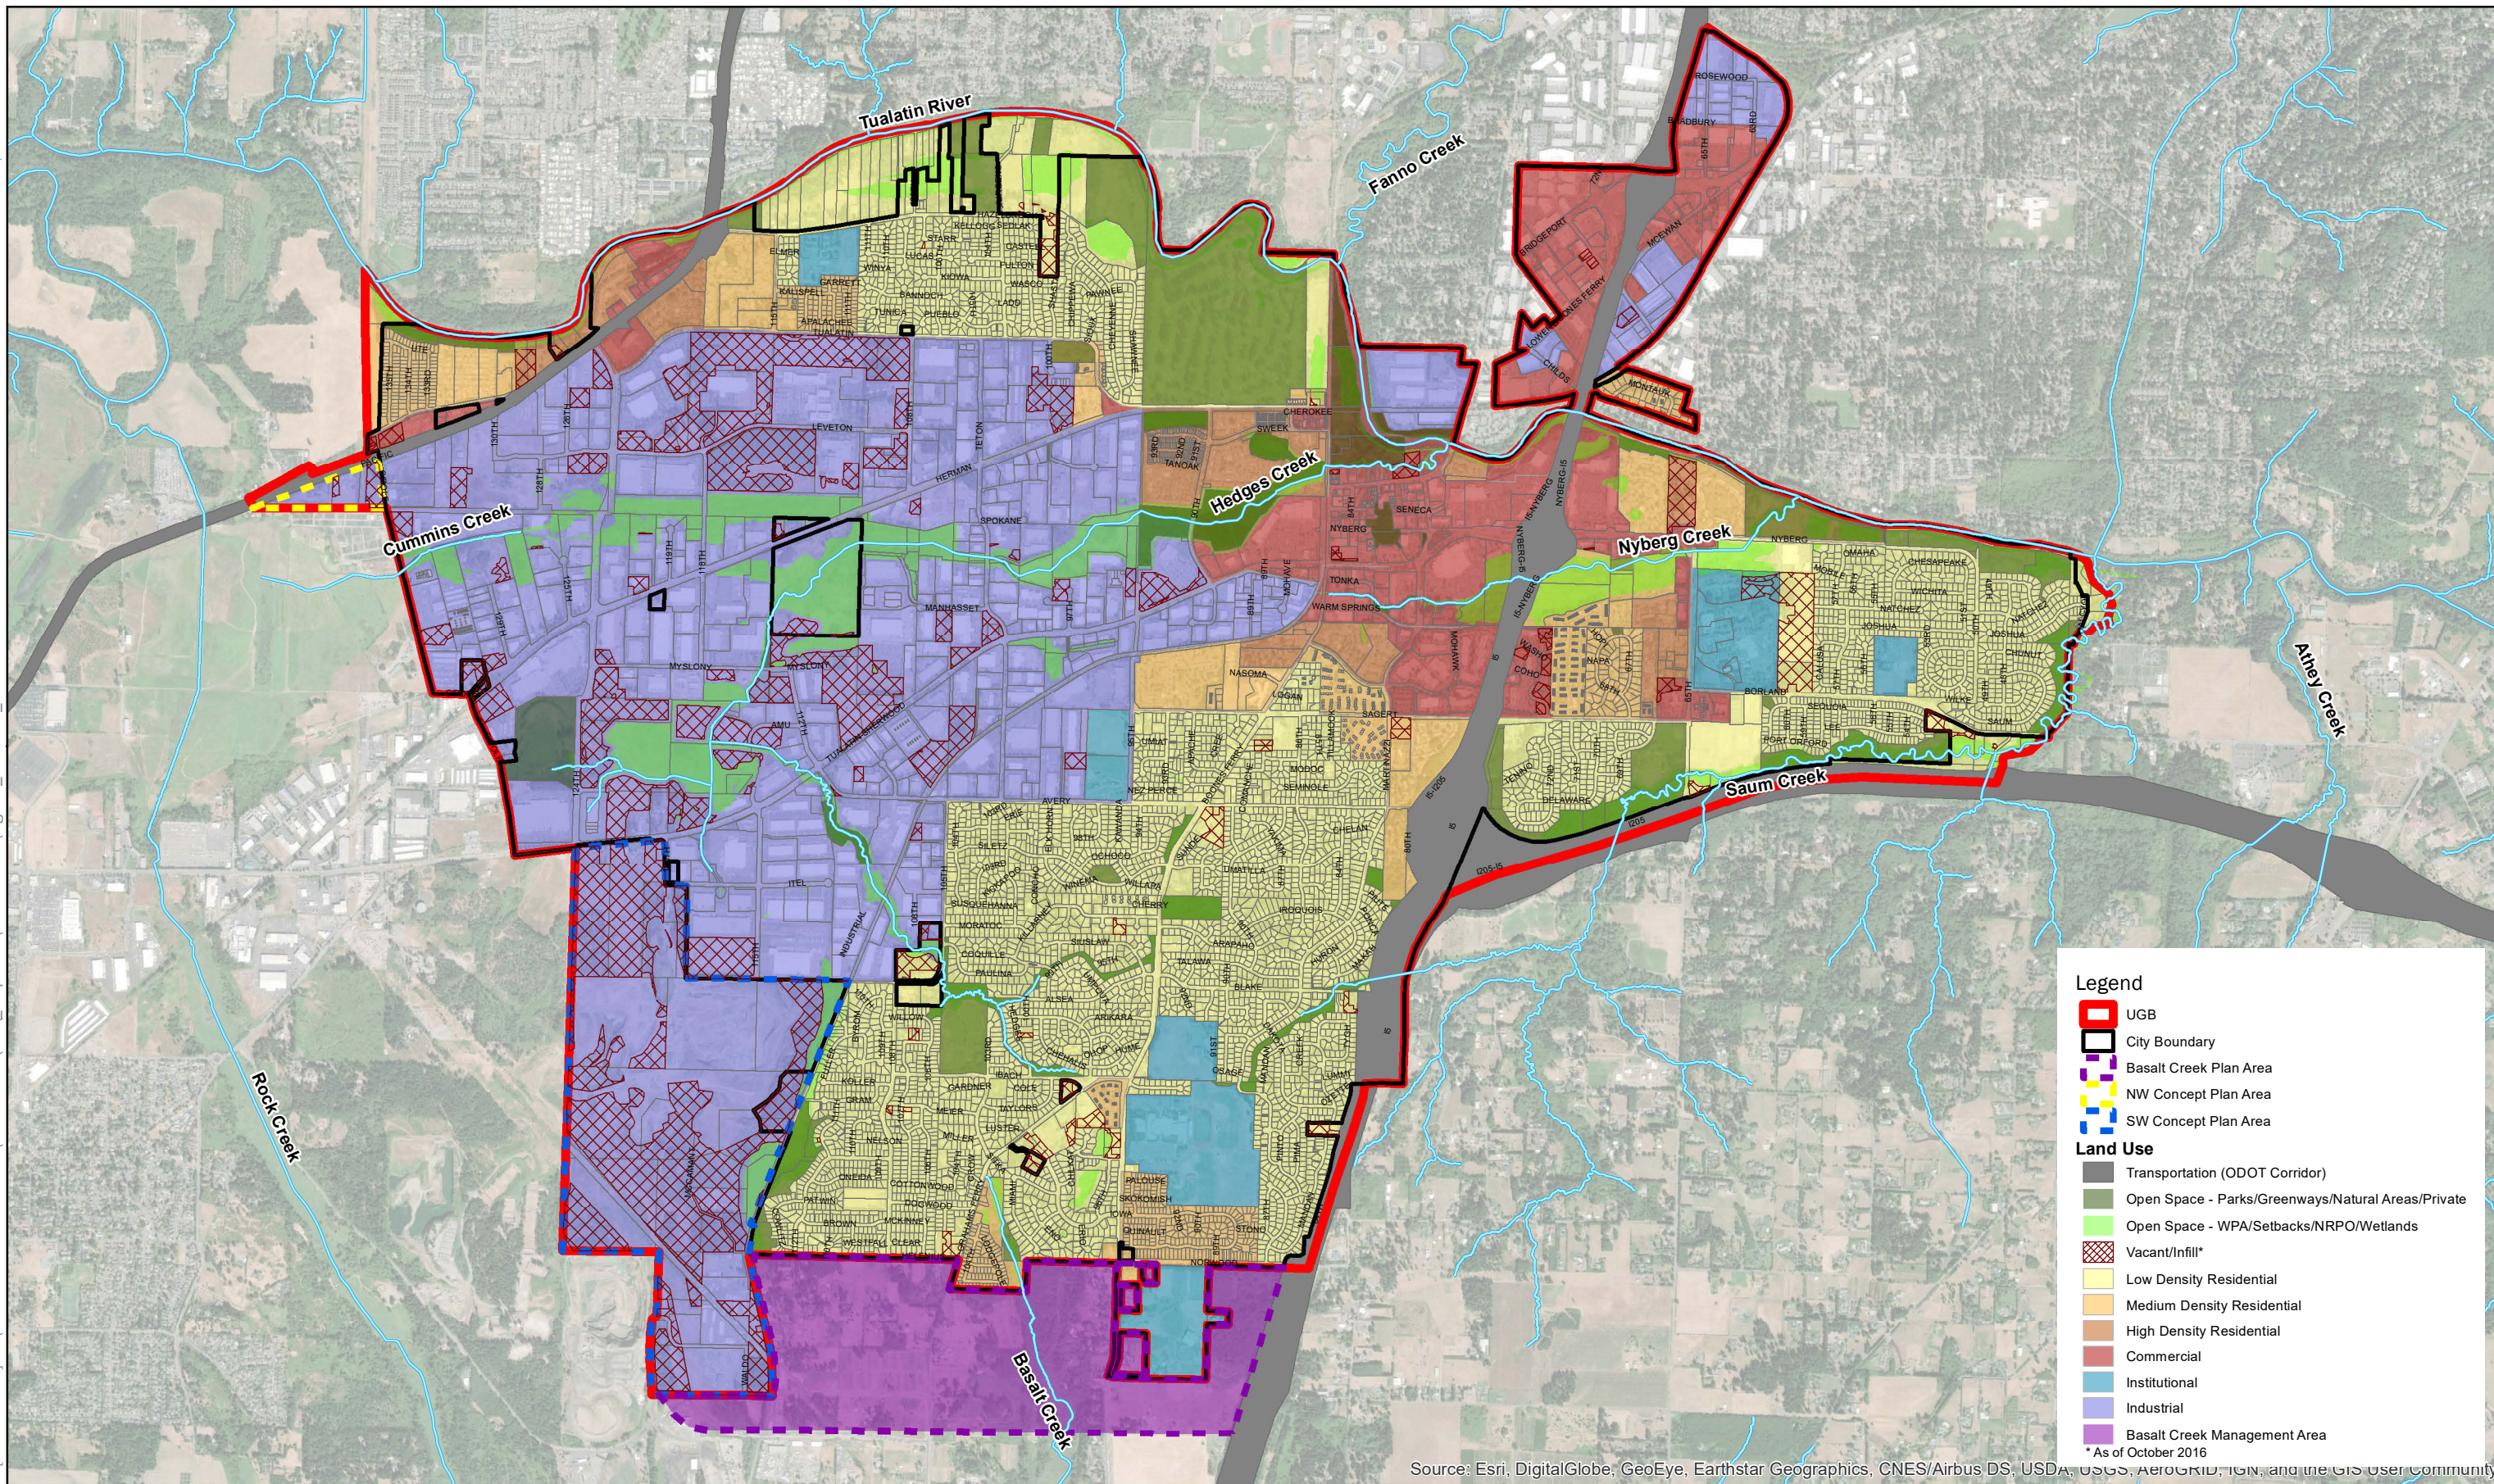

**Legend**

- UGB
- City Boundary
- Basalt Creek Plan Area
- NW Concept Plan Area
- SW Concept Plan Area

**Land Use**

- Transportation (ODOT Corridor)
- Open Space - Parks/Greenways/Natural Areas/Private
- Open Space - WPA/Setbacks/NRPO/Wetlands
- Vacant/Infill\*
- Low Density Residential
- Medium Density Residential
- High Density Residential
- Commercial
- Institutional
- Industrial
- Basalt Creek Management Area


\* As of October 2016

Source: Esri, DigitalGlobe, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community



**City of Tualatin**  
**Stormwater Master Plan**


Date: April 2019  
Project: Project 149233



Notes:  
1. Projection: NAD 1983 State Plane Oregon North (feet)

**Figure 2-4**  
**Land Use**



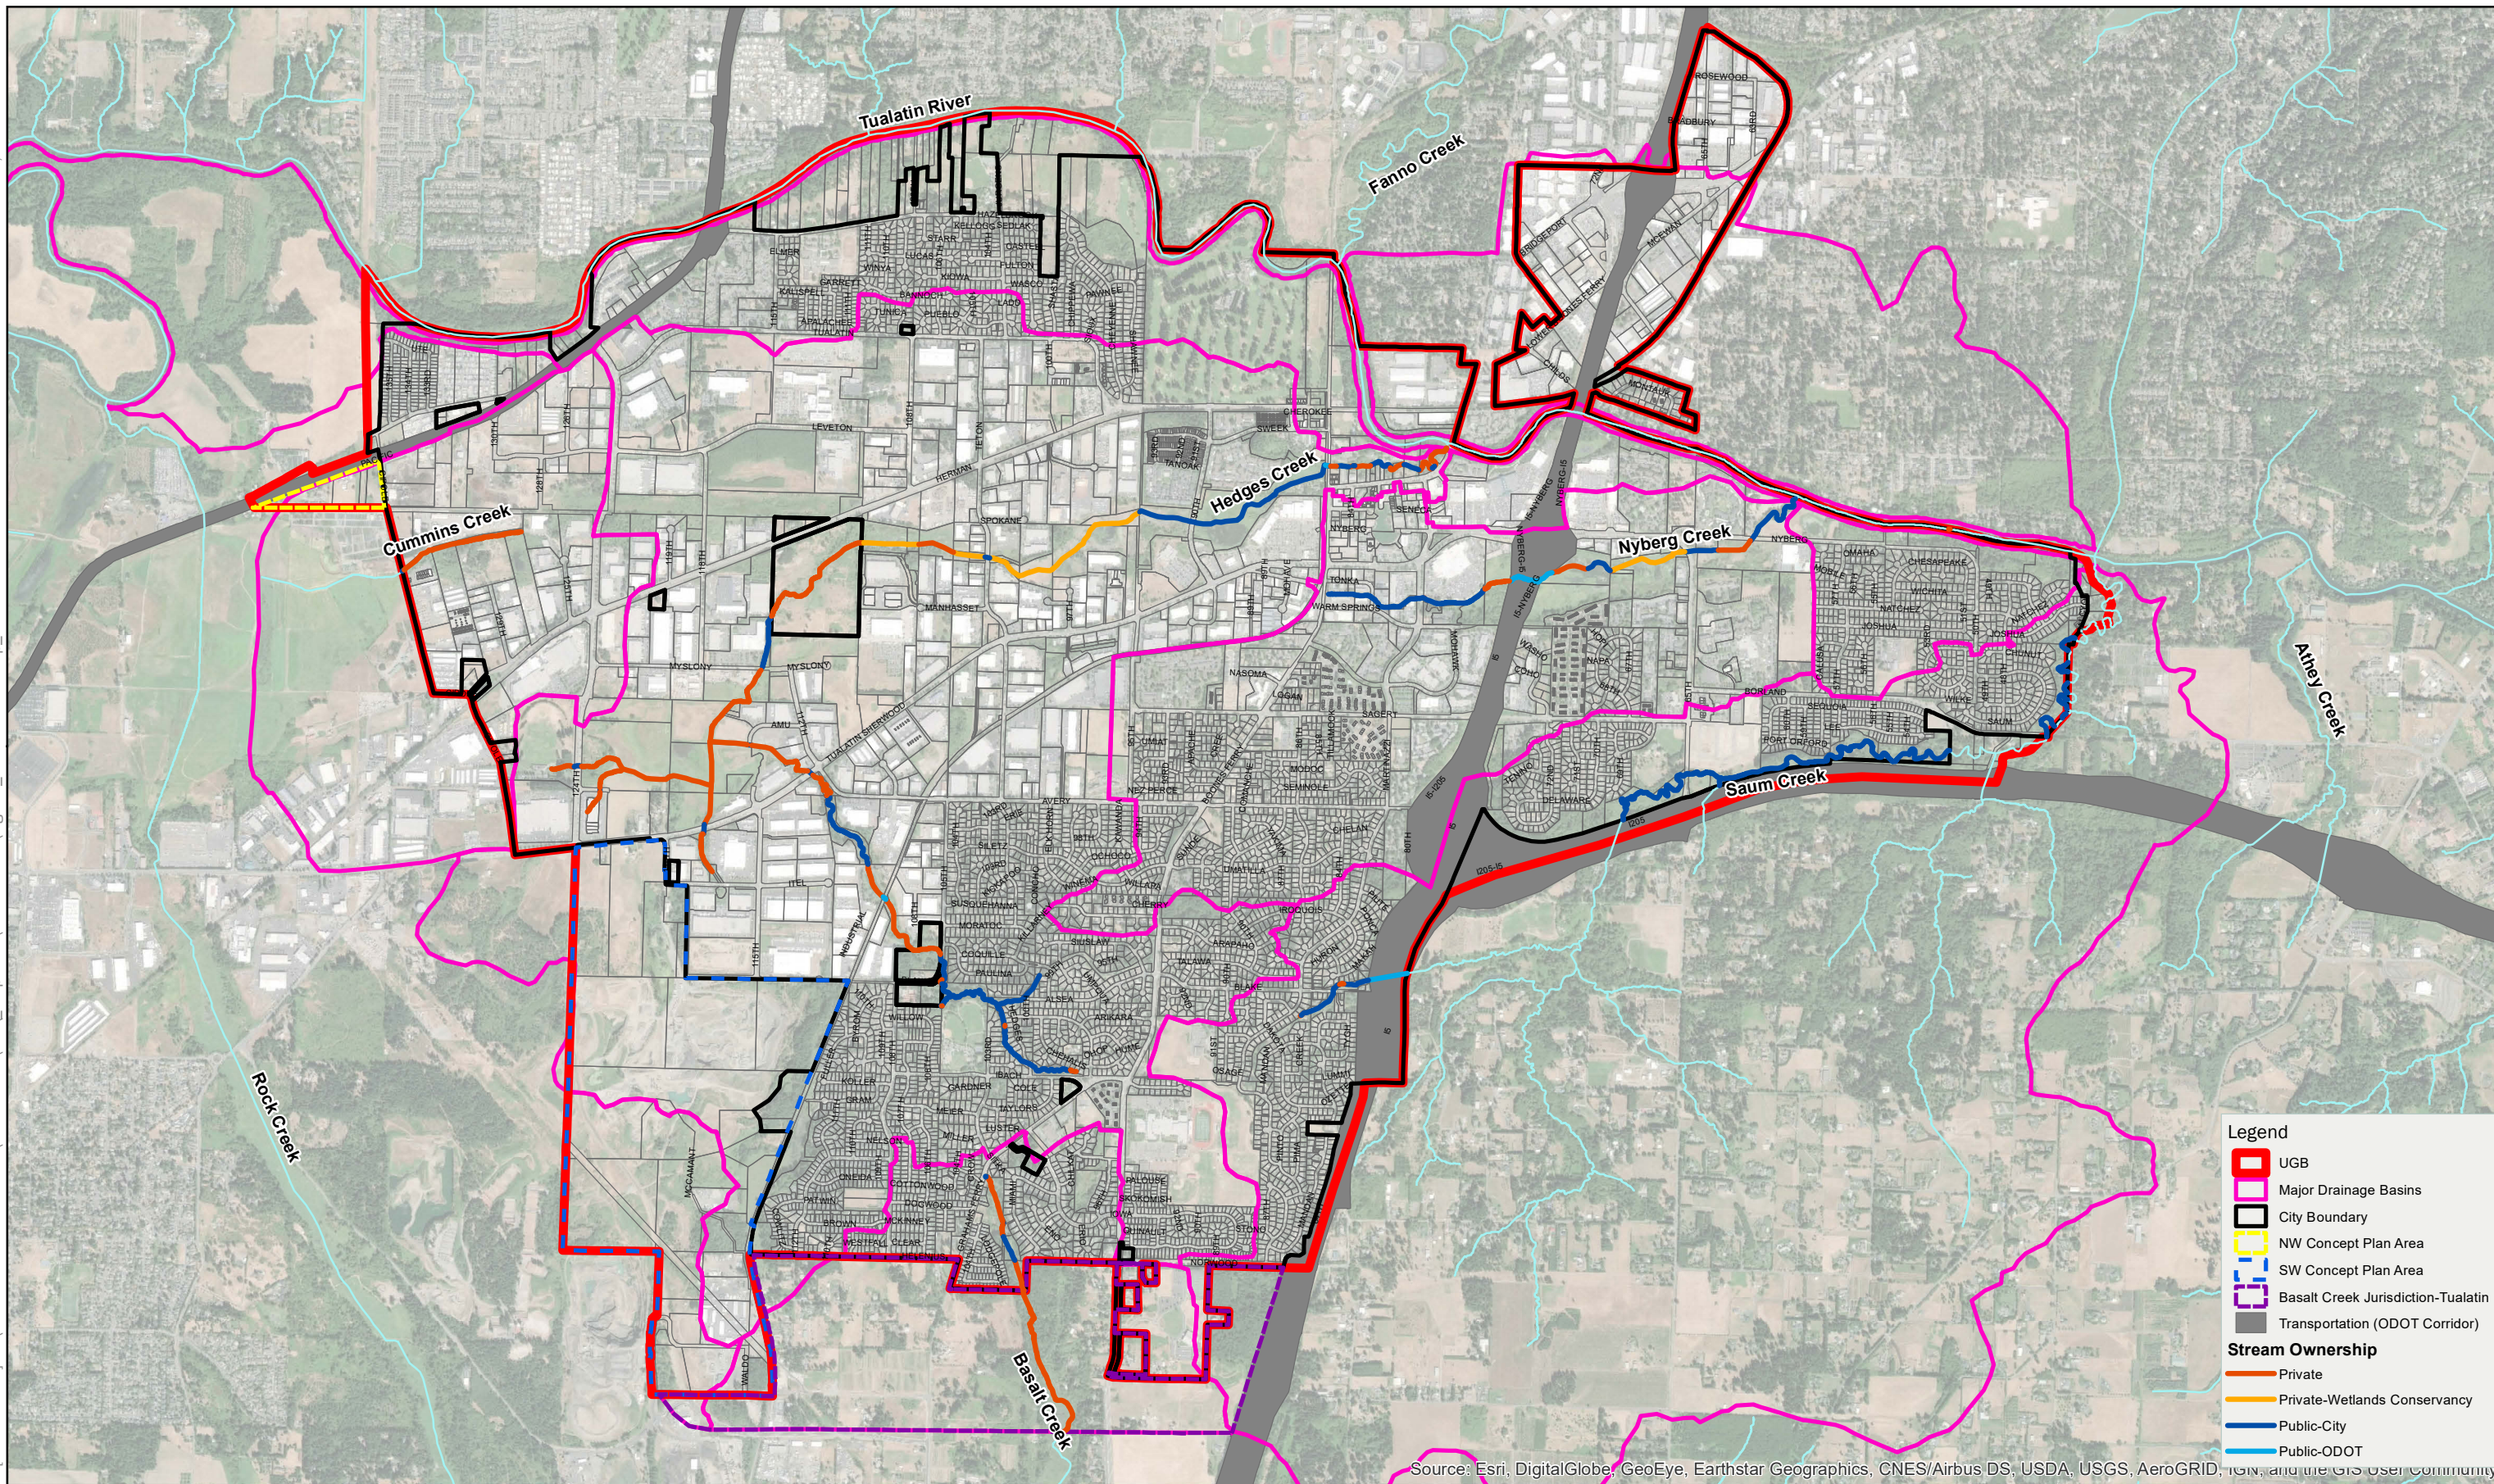


Source: Esri, DigitalGlobe, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community



**City of Tualatin**  
**Stormwater Master Plan**

Date: April 2019  
Project: Project 149233




Notes:  
1. Projection: NAD 1983 State Plane Oregon North (feet)

**Figure 2-5**  
**Stream Ownership**





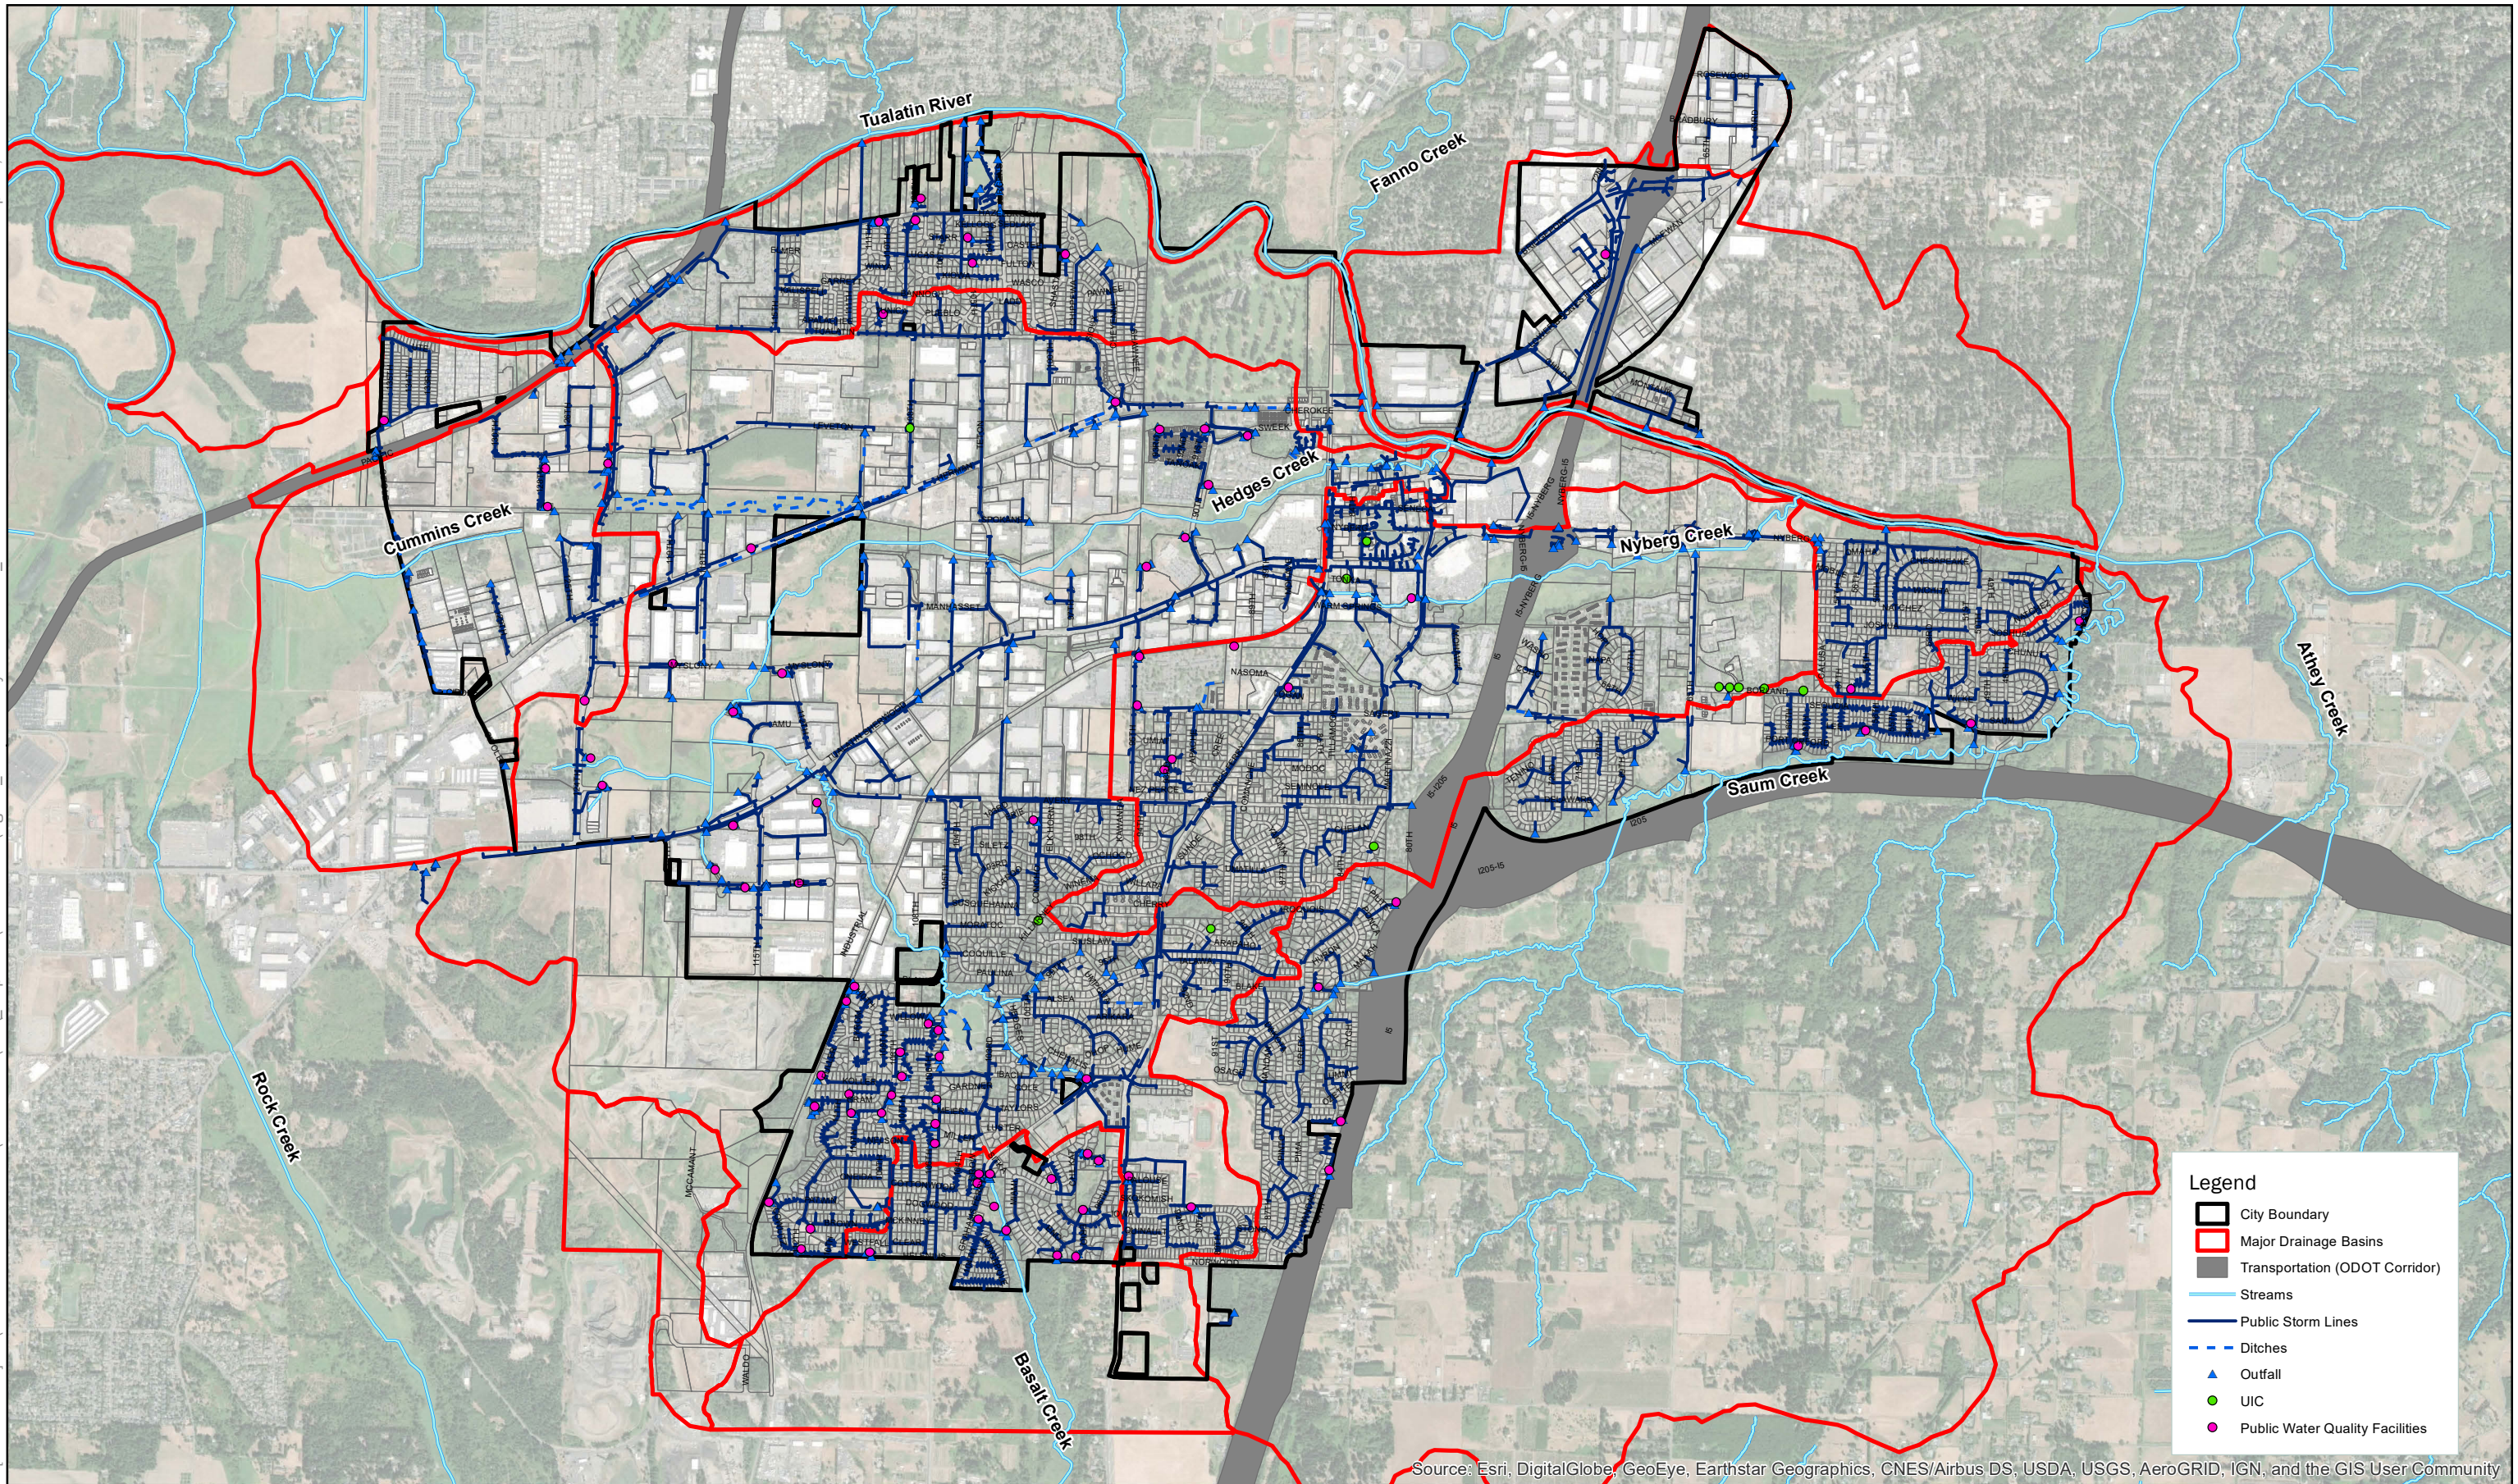

**Legend**


- City Boundary
- Major Drainage Basins
- Transportation (ODOT Corridor)
- Streams
- Public Storm Lines
- Ditches
- Outfall
- UIC
- Public Water Quality Facilities

Source: Esri, DigitalGlobe, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community



**City of Tualatin  
Stormwater Master Plan**

Date: April 2019  
Project: Project 149233



Notes:  
1. Projection: NAD 1983 State Plane Oregon North (feet)

**Figure 2-6  
Stormwater System Overview**



## Section 3

# Planning Process

This section provides background information related to the initial identification of Stormwater Project Opportunity Areas, which were used to inform capital project and program development efforts. As part of this preliminary effort, areas requiring additional evaluation, including H/H modeling and/or field investigations, were also identified.

Stormwater Project Opportunity Areas were identified based on a variety of data collection and field reconnaissance efforts. This process allowed the City to focus resources and develop information for areas and projects likely to be prioritized in a capital improvement program.

Additional detail related to this process is provided in TM1, included in this SMP as Appendix B. Table 3-1 and Figure 3-1, both at the end of this section, summarize the Stormwater Project Opportunity Areas.

### 3.1 Project Needs Identification

Stormwater project needs were initially identified through a collaborative process with the City's engineering, planning, and operations staff to assess known stormwater system problems and identify areas where infrastructure improvement, replacement, or retrofit could address observed issues.

From June through December 2016, reconnaissance efforts were conducted to identify current stormwater problems. Questionnaires were distributed to engineering and maintenance staff to document the type and location of reported and observed stormwater system deficiencies. The City's GIS inventory of reported drainage problems was reviewed. Two site visits were conducted to confirm the source of reported stormwater problems and validate whether the problems should be evaluated and addressed in the context of the SMP. Stormwater problem areas identified based on a stream capacity issue (bank overtopping) were generally omitted as a project opportunity, as stream capacity and natural system flooding was not an SMP objective.

Reported stormwater problems and project needs were consolidated by geographic area into defined Stormwater Project Opportunity Areas.

#### 3.1.1 Water Quality Opportunities

Throughout this SMP planning process, expanded coverage of water quality treatment was a priority. An assessment of water quality project opportunities and potential water quality retrofits was conducted to supplement identified stormwater problem areas and project needs. Detail related to this effort is provided in Appendix B.

In the city and throughout the CWS NPDES permit coverage area there is increased emphasis on methods for improving stormwater quality. One method involves identifying opportunities to install water quality treatment facilities, particularly in developed areas of a city with high pollutant load potential (by land use) and limited potential for development and redevelopment (such that treatment requirements per development standards would be triggered). Such water quality retrofits can address stormwater regulatory requirements under the CWS NPDES permit and improve stream health and habitat citywide. Identifying retrofit opportunities can be challenging, particularly in

developed areas where space is limited for installing above ground, vegetated treatment facilities as promoted in the NPDES permit.

The initial assessment of water quality project opportunity areas included a review of water-quality-related capital improvement projects per the City's 2017-2021 Capital Improvement Plan and review of available vacant/public lands that would support a new treatment facility. Available public lands are considered those not subject to the Tualatin City Charter, Chapter XI provisions, and generally included larger public parking areas or areas within the ROW<sup>1</sup>. Locations associated with high pollutant generating land use (i.e., industrial or commercial) and high imperviousness were prioritized for project development.

Reported capacity and maintenance-related stormwater problem areas were also reviewed to see if an integrated approach to stormwater management (i.e., installing water quality facilities to also mitigate stormwater runoff) could help address the reported issue (see Section 6).

Table 3-1 identifies Stormwater Project Opportunity Areas resulting from the assessment of water quality project opportunities. Water quality retrofit potential was identified for each opportunity area.

### 3.1.2 System Modeling Needs

Five stormwater problem areas were identified that required hydraulic modeling of the storm system to inform the source of capacity limitations and associated project development. These areas included:

1. Manhassat Drive (Stormwater Project Opportunity Area 4)
2. Boones Ferry Road at Tonka Road (Stormwater Project Opportunity Area 5)
3. Herman Road (Stormwater Project Opportunity Area 7)
4. Sagert Street at the Shenandoah Apartments (Stormwater Project Opportunity Area 9)
5. Mohawk Apartments at Warm Springs Road (Stormwater Project Opportunity Area 10)

Detail related to the H/H modeling methodology, model results, and associated project development is included in Section 4.

### 3.1.3 Stream Assessment Needs

Bank erosion, channel incision, sediment accumulation, and invasive vegetation are reported in reaches of the City's open channel conveyance system. To investigate these issues and develop a baseline assessment to evaluate stream condition in the future, a field stream assessment was initiated in September 2017.

The City identified and prioritized reaches of Suam Creek, Hedges Creek, and Nyberg Creek under "public ownership" (see Figure 2-5) that have not been previously evaluated but where there are reported problems.

Detail related to the stream assessment effort and associated project and program development is included in Section 5.

---

<sup>1</sup> Tualatin City Charter, Chapter XI limits the use of publicly owned parks, greenways, and natural areas to be used outside of their original intent without a public vote. The City has interpreted this provision to include using the property to facilitate installation of stormwater facilities.

## 3.2 Project Development Workshop

A project development workshop was held in October 2017 to finalize project development priorities and identify program needs/activities. Stormwater Project Opportunity Areas stemming from the preliminary project identification effort were presented and initial project concepts discussed.

Results from the hydraulic modeling effort were reviewed to confirm locations where flooding and surcharging have been observed. Project alternatives were discussed with the City to determine preferences related to routing and system configuration (i.e., piped versus open channel). Preliminary results from the stream assessment effort were also reviewed to validate project needs.

In some cases, an identified Stormwater Project Opportunity Area was determined to be better addressed as part of a routine maintenance activity instead of through implementing a standalone capital project. Relevant program needs for the City were discussed and included a pipe repair and replacement program, public water quality facility maintenance programs, and a stream vegetation management program. Section 6 addresses maintenance-related project and program needs.

During the workshop, City staff requested additional water quality-related project opportunities be considered and evaluated. As a result, the water quality opportunity areas were revisited, and additional public properties were identified, specifically parking lots, that could support water quality or LIDA facility installation. Site visits were conducted November 10 and December 17, 2017, to verify opportunities for additional water quality retrofit applications.

## 3.3 Results

Table 3-1 documents the list of final Stormwater Project Opportunity Areas used to develop capital projects and programs for this SMP. Figure 3-1 identifies each Stormwater Project Opportunity Area by ID (a numeric identifier) and primary project category—capacity/infrastructure need, erosion control, maintenance/condition assessment, and water quality. Multiple project categories may be relevant to one project opportunity, but the predominant category was used for mapping.

Twenty-six individual Stormwater Project Opportunity Areas and three citywide opportunities were identified, which reflects an expanded list of water quality retrofit locations following the project development workshop. Table 3-1 also includes a summary of the citywide preliminary project/program concepts.

It should be noted that not all Stormwater Project Opportunity Areas result in a capital project or program recommendation. Follow-up site visits conducted in November and December 2017 determined that two potential water quality retrofit locations were not viable for a facility installation. Additionally, City staff determined that the ability to retrofit select core parking areas of the City would require Board approval, and these areas should not be considered for proposed projects at this time.

This page intentionally left blank.

**Table 3-1. City of Tualatin Stormwater Project Opportunities**

SW Project Opportunity Area ID	Location	Basin/Waterbody	Problem/Project Category	Source	Water Quality (WQ) Retrofit Opportunity	Problem/Project Area Description	Preliminary Project Concepts and Observations (per site visits)	Additional Data Collection/City Input (following Project Development Workshop)	Project Development		
									Project Need	Programmatic Activity	No Project
1	Martinazzi Ave (near Tualatin-Sherwood Rd)	Nyberg Creek	<ul style="list-style-type: none"> <li>Maintenance/Condition Assessment</li> <li>Capacity (pipe grade)</li> </ul>	<ul style="list-style-type: none"> <li>Staff Questionnaire</li> <li>City GIS</li> </ul>		<ul style="list-style-type: none"> <li>Over curb flooding in heavy rain events. Flooding originally thought to be a backwater issue from Nyberg Creek.</li> <li>System includes high flow bypass pipe down Martinazzi to Izzy's Pond (12") and a low flow pipe (42") to the downstream end of culvert under Martinazzi that is almost fully submerged.</li> <li>Anticipated to be addressed per current CWS project to remove sediment and improve capacity in Nyberg Creek.</li> </ul>	<ul style="list-style-type: none"> <li>Flat grade and submerged pipe attributes to sediment accumulation in the pipe down Martinazzi</li> <li>Alternatives include:                             <ul style="list-style-type: none"> <li>Pipe replacement (parallel pipe) or reconfiguration/rerouting.</li> <li>Development of an asset management/maintenance related CIP for continuous sediment removal.</li> </ul> </li> </ul>	<ul style="list-style-type: none"> <li>Given orientation and current backwater, more frequent maintenance likely only means to address this problem area in the near term.</li> <li>City requested expanded model development from Martinazzi to Nyberg Road along Nyberg Creek. Follow up modeling (initiated July 2018) conducted to determine project need.</li> <li>Programmatic activities to be included in Master Plan and rate evaluation.</li> </ul>	TBD	X	
	Tualatin Sherwood Ave (near Martinazzi Ave)										
2	Venetia WQ Facility (Lee between 56th and 57th)	Saum Creek	<ul style="list-style-type: none"> <li>Maintenance/Condition Assessment</li> </ul>	<ul style="list-style-type: none"> <li>City GIS</li> </ul>		<ul style="list-style-type: none"> <li>Facility overgrown with large bushes and trees but functional.</li> <li>As-builts available. Facility design is a U-shaped swale with a total flowline of 172 LF and a slope of 1%. The bottom width of the swale is 4' with 4:1 side slopes. Top width is 15' and the water treatment level is 5.7".</li> <li>Flow control MH installed directly upstream of the swale with a 24" bypass directly to the creek for high flow events.</li> </ul>	<ul style="list-style-type: none"> <li>No access to inlet/outlet.</li> <li>Limited maintenance access; the existing access path is partially washed out.</li> <li>Steep grade. High flow bypass outfall should be checked and repaired as needed</li> <li>Project needs include:                             <ul style="list-style-type: none"> <li>vegetation trim and thinning, removal of invasives</li> <li>replanting as needed</li> <li>regrading as needed</li> </ul> </li> </ul>	Keep as a maintenance-related project.	X		
3	Blake St outfall at Saum Creek	Saum Creek	<ul style="list-style-type: none"> <li>Erosion Control</li> <li>Maintenance (Debris accumulation)</li> </ul>	<ul style="list-style-type: none"> <li>City GIS</li> </ul>		<ul style="list-style-type: none"> <li>Outfall experiences bank erosion (citizen complaints). Further erosion could impact the adjacent home.</li> <li>Culvert under Blake may be undersized and cause backwater upstream.</li> </ul>	<ul style="list-style-type: none"> <li>The bank is steep and appears to be unstable and eroding.</li> <li>Bank instability may not solely be due to the outfall. Adjacent bank instability and groundwater seepage was observed 100' downstream. Further geotechnical investigation may be warranted.</li> <li>The upstream system appears in good order.</li> <li>Project needed to retrofit existing outfall to creek, which is hanging out over the creek and exposed and minimize erosion of the channel.</li> <li>Bank rehabilitation may include:                             <ul style="list-style-type: none"> <li>rock buttress</li> <li>pillow wall with plantings to stabilize bank</li> <li>other based on geotechnical guidance</li> </ul> </li> </ul>	<ul style="list-style-type: none"> <li>Storm pipe upstream of outfall requires replacement due to structural deficiencies.</li> <li>Include outfall pipe replacement (existing failure) from road and private fence replacement in cost estimate.</li> <li>Cost estimate to include geotechnical evaluation of stream reach.</li> </ul>	X		
4	Manhasset Dr (near 10550 SW Manhasset Dr)	Hedges Creek	<ul style="list-style-type: none"> <li>Capacity/Infrastructure Need</li> </ul>	<ul style="list-style-type: none"> <li>Staff Questionnaire</li> <li>Storm Area Hot Spots</li> <li>City GIS</li> <li>Stormwater CIP</li> <li>WQ retrofit evaluation</li> </ul>	X	<ul style="list-style-type: none"> <li>Frequent flooding of drainage channel between private properties from T-S Rd to Manhasset.</li> <li>Drainage channel has limited capacity and observed debris accumulation.</li> <li>Preliminary modeling indicates that the open channel is undersized for the contributing drainage area.</li> <li>Some contributing pipes are undersized and surcharging during the 25-yr design storm.</li> <li>Retrofit (WQ) opportunity - adjacent undeveloped land that has transportation and warehouse land draining to it.</li> <li>No city easement exists along alignment.</li> </ul>	<ul style="list-style-type: none"> <li>CIP needed to alleviate private property flooding and reconfigure collection system</li> <li>System configuration options presented during the workshop include maintaining the open channel and piping the entire alignment.</li> </ul>	<ul style="list-style-type: none"> <li>Modified system hydrology needed on upstream industrial parcel. The NE corner of the parcel does not discharge to the system. BC to evaluate with updated hydrology.</li> <li>Piped system requires less maintenance and is preferred.</li> <li>System surcharging is permissible due to flat grade and areas of backslope on the discharge pipe.</li> </ul>	X		

**Table 3-1. City of Tualatin Stormwater Project Opportunities**

SW Project Opportunity Area ID	Location	Basin/Waterbody	Problem/Project Category	Source	Water Quality (WQ) Retrofit Opportunity	Problem/Project Area Description	Preliminary Project Concepts and Observations (per site visits)	Additional Data Collection/City Input (following Project Development Workshop)	Project Development		
									Project Need	Programmatic Activity	No Project
5	Boones Ferry Rd (19417 SW Boones Ferry Rd)	Nyberg Creek	<ul style="list-style-type: none"> <li>Capacity/Infrastructure Need</li> <li>Maintenance (gravel ballast)</li> </ul>	<ul style="list-style-type: none"> <li>Storm Area Hot Spots</li> <li>City GIS</li> </ul>	X	<ul style="list-style-type: none"> <li>Problem location extends down Boones Ferry, the railroad culvert behind Jiffy Lube, and west along Tonka Avenue. Specific problem locations include:                             <ul style="list-style-type: none"> <li>The inlet along the RR tracks (maintenance issue). Gravel is transported and redeposited downstream.</li> <li>StormFilter catchbasins along Boones Ferry are located at a roadway sag and clog, resulting in flooding.</li> <li>The conveyance system along Tonka, Warm Springs and Boones Ferry contributes to flooding.</li> </ul> </li> </ul>	<ul style="list-style-type: none"> <li>CIP needed for source control and improved conveyance.</li> <li>Gravel transportation mitigation needed to control railroad ballast.</li> <li>Site visit confirmed two existing offline, single cartridge configuration of Storm Filter catchbasins. Additional sediment control or relocation may be needed to improve StormFilter performance.</li> <li>Rerouting of conveyance on Warm Spring, Tonka and Boones Ferry may improve conveyance and alleviate flooding.</li> <li>Preliminary modeling and system configuration alternatives presented during Workshop include revisions to the RR conveyance channel and Boones Ferry routing alternatives.</li> </ul>	<ul style="list-style-type: none"> <li>City requested expanded model development from Martinazzi to Nyberg Road along Nyberg Creek (initiated July 2018), which may impact project development.</li> <li>StormFilter relocation needed.</li> <li>Due to project size and scope, project development may require separate projects and/or phasing.</li> <li>Follow up site visit 12/14/17 indicates the most viable option for a StormFilter is upstream along Boones Ferry.</li> </ul>	X		
6	Alea/BF Rd 99th/Siuslaw Greenway	Hedges Creek	<ul style="list-style-type: none"> <li>Capacity/Infrastructure Need</li> <li>Water Quality</li> </ul>	<ul style="list-style-type: none"> <li>Staff Questionnaire</li> <li>WQ retrofit evaluation</li> </ul>	X	<ul style="list-style-type: none"> <li>Dual corrugated pipe has the bottom rusted out. No apparent capacity deficiency.</li> <li>High levels of sediment accumulation are observed.</li> <li>Retrofit (WQ and FC) opportunity- This long linear greenway may provide an opportunity for WQ treatment for contributing drainage area (City confirms ok per charter).</li> </ul>	<ul style="list-style-type: none"> <li>Project to include replacement of parallel pipes from Boones Ferry to MH upstream of parallel pipes</li> <li>Project to include sediment trap.</li> <li>Area is upstream of observed instream erosion at Alea Ct. Regrading/amending channel between Siuslaw Ln and 98th Ave would improve downstream erosion issues.</li> </ul>	<ul style="list-style-type: none"> <li>Include pipe replacement, sediment trap, and bioswale in cost estimate.</li> <li>Project meets retrofit requirement and promotes stormwater infiltration/retention.</li> <li>City to review upstream system to define upstream limit of replacement.</li> </ul>	X		
7	Herman Rd	Hedges Creek	<ul style="list-style-type: none"> <li>Capacity/Infrastructure Need</li> </ul>	<ul style="list-style-type: none"> <li>Staff Questionnaire</li> <li>WQ retrofit evaluation</li> </ul>	X	<ul style="list-style-type: none"> <li>System has flat grade. Half the road drains to roadside ditch and the other half to a ditch along railroad ROW.</li> <li>System lacks required drainage infrastructure. City wishes to install piped/below ground infrastructure.</li> <li>Survey shows negative pipe slopes for the culverts passing under Herman Road. Survey also indicates pipes under RR are deep relative to upstream and downstream pipes.</li> <li>Preliminary modeling indicates that culverts crossing Herman Road leads to backwater effects and flooding in the ditch/culvert system on the north side of Herman Road.</li> </ul>	<ul style="list-style-type: none"> <li>CIP needed to install additional conveyance infrastructure.</li> <li>Preliminary modeled alternatives suggest the system will backwater upstream of the railroad crossing.</li> <li>Piping to be sized with maximum slope possible to limit sedimentation</li> <li>Potential water quality retrofit locations at SE corner of Herman Road and 95th Avenue.</li> </ul>	<ul style="list-style-type: none"> <li>Modified system hydrology needed. Golf course does not discharge to system.</li> <li>Preferred configuration is piped system in middle of roadway.</li> <li>Culverts under tracks are frequently maintained.</li> <li>System surcharging is permissible due to flat grade.</li> <li>No water quality treatment needed/not a retrofit opportunity now. Stormwater treatment will be accommodated as part of the roadway widening.</li> </ul>	X		
8	Curves at Blake/105 and 108th	Hedges Creek	<ul style="list-style-type: none"> <li>Capacity/Infrastructure Need</li> <li>Erosion</li> </ul>	<ul style="list-style-type: none"> <li>Staff Questionnaire</li> </ul>		<ul style="list-style-type: none"> <li>Roadway lacks collection system and pedestrian access. City is currently in planning stages for roadway update (concept plan in place) but no budget for project yet.</li> <li>Culvert alignment may play a role in design and cost estimate.</li> <li>Current drainage from Coquille/Paulina and 105th is an open channel ditch to culvert inlet.</li> <li>Specific problem locations include:                             <ul style="list-style-type: none"> <li>Stream channel experiences 90° bends on both sides of culvert.</li> <li>Culvert is undersized</li> <li>Existing roadway embankments are steep and drainage updates are needed for the roadway.</li> </ul> </li> </ul>	<ul style="list-style-type: none"> <li>Culvert design to incorporate a sizing and length based on the hydrology and ideal alignment.</li> <li>Observed (during stream assessment) retaining wall deficiencies along the roadway. Assume improvements as part of roadway redesign and not culvert replacement.</li> </ul>	<ul style="list-style-type: none"> <li>Per Oregon Department of Fish and Wildlife (ODFW) feedback (1/25/17) culvert fish passage design not necessary.</li> <li>Culvert sizing and construction estimate needed as part of the CIP. Roadway drainage to be addressed with roadway update.</li> <li>Assume configuration of culvert to align with historic channel orientation and not current orientation.</li> <li>Culvert to be sized based on 100-yr flows at point of inlet.</li> </ul>	X		



**Table 3-1. City of Tualatin Stormwater Project Opportunities**

SW Project Opportunity Area ID	Location	Basin/Waterbody	Problem/Project Category	Source	Water Quality (WQ) Retrofit Opportunity	Problem/Project Area Description	Preliminary Project Concepts and Observations (per site visits)	Additional Data Collection/City Input (following Project Development Workshop)	Project Development		
									Project Need	Programmatic Activity	No Project
9	Sagert St. - Shenandoah Apts (Sandalwood)	Nyberg Creek	<ul style="list-style-type: none"> <li>Erosion Control</li> <li>Capacity/Infrastructure Need</li> </ul>	<ul style="list-style-type: none"> <li>Storm Area Hot Spots</li> <li>WQ retrofit evaluation</li> </ul>	X	<ul style="list-style-type: none"> <li>Reported flooding during Oct and Dec 2015 storms.</li> <li>Retrofit (WQ) opportunity by converting existing open channel to WQ facility.</li> <li>Preliminary modeling indicates that the existing pipes upstream of the open channel are undersized and are surcharging during the 25-yr design storm, but no flooding is reported.</li> </ul>	<ul style="list-style-type: none"> <li>System flooding may be due to debris from nearby tree limiting capacity of ditch inlet.</li> <li>Limited pipe cover through greenspace.</li> <li>Channel sloughing observed upstream of Sagert St.</li> <li>WQ and detention should be incorporated into this project if possible (project location is upstream of WQ Opportunity Area #10).</li> </ul>	<ul style="list-style-type: none"> <li>City easement exists.</li> <li>CIP development to be completed independent of Nyberg system. Surcharging is acceptable.</li> <li>Relocate ditch inlet (away from tree).</li> <li>Maintain open channel conveyance options to qualify as a water quality retrofit.</li> </ul>	X		
10	Mohawk Apts	Nyberg Creek	<ul style="list-style-type: none"> <li>Capacity/Infrastructure Need</li> <li>Maintenance/Condition Assessment</li> </ul>	<ul style="list-style-type: none"> <li>Storm Area Hot Spots</li> </ul>		<ul style="list-style-type: none"> <li>Conveyance capacity affecting Opportunity Area #5.</li> <li>Inlet behind Mohawk Apts is inundated, resulting in overland flow through adjacent property and flooding Tonka and Warm Springs at the Elks Lodge.</li> <li>City is unaware of any easements that may facilitate correcting the issue.</li> </ul>	<ul style="list-style-type: none"> <li>Limited freeboard available prior to overtopping at the inlet. Grate structure installed at inlet likely reducing capacity.</li> <li>Alternatives include:                             <ul style="list-style-type: none"> <li>Update/replace inlet and embankment to reduce/remove flooding</li> <li>Pipe open section through apartments and remove inlet</li> <li>Update both inlet and channel to enhance natural function/remove invasive vegetation</li> </ul> </li> </ul>	<ul style="list-style-type: none"> <li>City unable to access pipe upstream of open channel for CCTV. Need to include CCTV cost into CIP development.</li> <li>CIP to include installation of access locations (manholes) along piped system upstream of open channel.</li> <li>CIP to include replacement of ditch inlet at downstream end of open channel and corrugated metal pipe downstream of open channel.</li> <li>City to confirm easement along open channel alignment.</li> <li>City prefers piping over maintaining open channel.</li> </ul>	X		
11	Piute Ct. WQ Facility	Saum Creek	<ul style="list-style-type: none"> <li>Maintenance/Condition Assessment</li> </ul>	<ul style="list-style-type: none"> <li>Storm Area Hot Spots</li> </ul>		<ul style="list-style-type: none"> <li>Public WQ facility is failing. Sediment and invasive vegetation accumulation.</li> <li>As-builts available. Facility design is approx. 7' deep, 400 square foot (sf) bottom, 3:1 side slope.</li> <li>No access road. Easement status is unknown.</li> </ul>	<ul style="list-style-type: none"> <li>Site visit was unable to locate outlet structure. System appears to discharge towards I-205.</li> <li>Potential maintenance access along backside of facility. Installation of access road needed.</li> <li>CIP to include facility regrading with sediment and vegetation removal and replanting.</li> <li>Existing easement available between two houses on Piute Ct. but does not appear to be established or used.</li> </ul>	<ul style="list-style-type: none"> <li>Keep as a maintenance project.</li> <li>The outfall structure should be inspected and repaired as needed.</li> <li>City owns easement between two private properties off Piute Ct. Assume construction of a permanent access road off Piute Ct.</li> </ul>	X		
12	Sequoia Ridge WQ Facility	Saum Creek	<ul style="list-style-type: none"> <li>Maintenance/Condition Assessment</li> </ul>	<ul style="list-style-type: none"> <li>Stormwater CIP</li> </ul>		<ul style="list-style-type: none"> <li>Facility is overgrown with malfunctioning outlet structure and standing water.</li> <li>As-builts available. Facility design reflects pond volume of 14,250 cubic feet (cf) but was built to 15,500 cf. Pond bottom is approx. 4,000 sf and 5' deep with side slopes of 3:1. Facility was designed in 1997.</li> <li>Outlet structure has a 2" orifice for low flow and a high flow inlet to bypass low flow orifice.</li> <li>Trail connects facility to Saum Creek, resulting in increased public attention.</li> </ul>	<ul style="list-style-type: none"> <li>Large cottonwood trees need to be removed</li> <li>Outfall structure needs engineering review.</li> <li>Due to the standing water, there is little beneficial vegetation and will likely need to be fully replanted.</li> <li>As-builts reference recommended maintenance requirements including sediment removal once it exceeds 6" in depth. Mow 2x/yr. Watering in times of drought. Inspections 3x/yr.</li> <li>Project needs include:                             <ul style="list-style-type: none"> <li>Replacement of outlet structure</li> <li>Removal of trees</li> <li>Amendment of soils</li> <li>Replanting of vegetation</li> </ul> </li> </ul>	<ul style="list-style-type: none"> <li>Keep as a maintenance project.</li> <li>The outfall structure should be inspected and repaired as needed.</li> </ul>	X		
13	Sweek Dr WQ Facility	Hedges Creek	<ul style="list-style-type: none"> <li>Maintenance/Condition Assessment</li> </ul>	<ul style="list-style-type: none"> <li>Stormwater CIP</li> </ul>		<ul style="list-style-type: none"> <li>Facility is overgrown.</li> <li>No as-builts available.</li> </ul>	<ul style="list-style-type: none"> <li>Large cottonwood trees need to be removed,</li> <li>No outlet structure observed, and facility appears to freely drain.</li> <li>Project needs include:                             <ul style="list-style-type: none"> <li>Removal of trees</li> </ul> </li> </ul>	<ul style="list-style-type: none"> <li>Keep as a maintenance project.</li> </ul>	X		



**Table 3-1. City of Tualatin Stormwater Project Opportunities**


SW Project Opportunity Area ID	Location	Basin/Waterbody	Problem/Project Category	Source	Water Quality (WQ) Retrofit Opportunity	Problem/Project Area Description	Preliminary Project Concepts and Observations (per site visits)	Additional Data Collection/City Input (following Project Development Workshop)	Project Development		
									Project Need	Programmatic Activity	No Project
							<ul style="list-style-type: none"> <li>Amendment of soils</li> <li>Replanting of vegetation</li> </ul>				
14	Waterford WQ Facility	Hedges Creek	<ul style="list-style-type: none"> <li>Maintenance/Condition Assessment</li> </ul>	<ul style="list-style-type: none"> <li>Stormwater CIP</li> <li>WQ retrofit evaluation</li> </ul>	X	<ul style="list-style-type: none"> <li>Maintenance needed due to sediment build up and limited access to outlet structure.</li> <li>As-builts available. Facility is approx. 4' deep, 2,500 sf bottom. Facility was designed in 1993. Original design included WQ swale graded around the pond for preliminary treatment.</li> <li>The existing outlet structure in the pond needs to be removed and relocated so maintenance can be performed during high water events.</li> <li>Facility is upstream of observed instream erosion, so flow/volume control may benefit.</li> </ul>	<ul style="list-style-type: none"> <li>The WQ swale no longer exists and needs to be regraded into the facility.</li> <li>No vegetation is visible and high sediment accumulation observed.</li> <li>The inlet riprap needs to be replaced.</li> <li>Project needs include:                             <ul style="list-style-type: none"> <li>Relocation and redesign of outfall structure to maximize flow control.</li> <li>Invasive removal.</li> <li>Excavate and regrade WQ swale. Include amended soils and replant</li> <li>Replace inlet structure.</li> </ul> </li> </ul>	<ul style="list-style-type: none"> <li>Flow control/flow duration sizing to be referenced in project description.</li> <li>Project to assume maintenance consistent with other public WQ facility.</li> </ul>	X		
15	89th Ave/Tualatin-Sherwood Rd Stormwater Outfall	Hedges Creek	<ul style="list-style-type: none"> <li>Water Quality</li> </ul>	<ul style="list-style-type: none"> <li>Stormwater CIP</li> <li>WQ retrofit evaluation</li> </ul>	X	<ul style="list-style-type: none"> <li>Project identified in City's 2017-2021 CIP. Project is a WQ manhole (MH) installation to prevent debris from discharging into wetlands.</li> <li>CWS retrofit program driver. Per review of CWS Permit and SWMP, appears to be viable as an outfall retrofit project.</li> </ul>	<ul style="list-style-type: none"> <li>Limited opportunity for green infrastructure or any facility with drop requirement. Water surface elevation in adjacent wetlands prohibits use of any facility with large internal drop requirement.</li> <li>Due to a small head drop across the structure conveyance pipe from the structure and a new outfall may need to be constructed.</li> </ul>	<ul style="list-style-type: none"> <li>Facility sizing and installation to be included as project</li> </ul>	X		
16	125th to Herman Rd	Cummins Creek	<ul style="list-style-type: none"> <li>Water Quality</li> </ul>	<ul style="list-style-type: none"> <li>Stormwater CIP</li> <li>WQ retrofit evaluation</li> </ul>	X	<ul style="list-style-type: none"> <li>Project identified in City's 2017-2021 CIP. Project is a WQ MH installation to treat 143 ac contributing area with no upstream treatment.</li> <li>CWS retrofit program driver. Per review of CWS Permit and SWMP, appears to be viable as an outfall retrofit project.</li> <li>Identifying catchment area challenging due to the railway along south side of SW Herman Road and unknown conveyance pathways.</li> </ul>	<ul style="list-style-type: none"> <li>Limited opportunity for green infrastructure or any facility with drop requirement. Water surface elevation in adjacent wetlands prohibits use of any facility with large internal drop requirement.</li> <li>Due to a small head drop across the structure conveyance pipe from the structure and a new outfall may need to be constructed.</li> <li>Catchment delineation and facility placement to be determined during detailed design due to private property constraints.</li> </ul>	<ul style="list-style-type: none"> <li>Facility sizing and installation to be included as project</li> </ul>	X		
17	93rd Ave	Nyberg Creek	<ul style="list-style-type: none"> <li>Water Quality</li> <li>Infrastructure need</li> </ul>	<ul style="list-style-type: none"> <li>Staff Questionnaire</li> <li>WQ retrofit evaluation</li> </ul>	X	<ul style="list-style-type: none"> <li>Potential for green street pilot project to provide treatment in roadside planters to Avery St.</li> <li>GIS indicates collection system exists, so no new infrastructure required.</li> </ul>	<ul style="list-style-type: none"> <li>Current conveyance is provided in street side ditch primarily on the west side of 93rd.</li> <li>Project to include curb and gutter where 93rd is currently unimproved. Roadside planters to be incorporated and sized based on the catchment area draining to the north end of the road to Avery.</li> </ul>	<ul style="list-style-type: none"> <li>New project opportunity area following Workshop.</li> <li>Project extends on the west side of 93<sup>rd</sup> Avenue to SW Umiat St. and on the east side to SW Tonopah St (one inlet will need to be removed in front of 20232 SW 93rd)</li> </ul>	X		
18	Green Parking Lot (approx. 18725 SW Boones Ferry Rd)	Hedges Creek	<ul style="list-style-type: none"> <li>Water Quality</li> <li>Capacity (bank overtopping)</li> </ul>	<ul style="list-style-type: none"> <li>City GIS</li> <li>WQ retrofit evaluation</li> </ul>	X	<ul style="list-style-type: none"> <li>Potential WQ retrofit.</li> <li>Reported flooding of lot due to proximity to Hedges Creek and floodplain. Flooding due to stream capacity issue and not to be addressed by Master Plan.</li> <li>Vegetated swale (unmaintained) already exists adjacent to Hedges Creek; collecting parking lot runoff.</li> <li>Parking lot properties are considered public but are governed by a separate board that oversees improvements.</li> </ul>	<ul style="list-style-type: none"> <li>Per site visit, there are several locations where existing planters could be retrofit for additional WQ treatment. Would require relocation of inlet and potentially lose a parking stall depending on facility sizing needs.</li> </ul>	<ul style="list-style-type: none"> <li>New project opportunity area following Workshop.</li> <li>Area is already being treated by a water quality facility. Maintenance of the swale is recommended.</li> <li>Follow up from City in December 2017 indicates the need for board approval to retrofit core area parking will present an implementation challenge. No dedicated project need now.</li> </ul>			X

**Table 3-1. City of Tualatin Stormwater Project Opportunities**

SW Project Opportunity Area ID	Location	Basin/Waterbody	Problem/Project Category	Source	Water Quality (WQ) Retrofit Opportunity	Problem/Project Area Description	Preliminary Project Concepts and Observations (per site visits)	Additional Data Collection/City Input (following Project Development Workshop)	Project Development		
									Project Need	Programmatic Activity	No Project
19	Yellow Parking Lot (Seneca and 84 <sup>th</sup> )	Hedges Creek	• Water Quality	• WQ retrofit evaluation	X	<ul style="list-style-type: none"> <li>• Potential WQ retrofit.</li> <li>• Parking lot properties are considered public but are governed by a separate board that oversees improvements.</li> </ul>	<ul style="list-style-type: none"> <li>• Per site visit, there are several locations where the existing planters could be retrofit for WQ treatment. Would require relocating inlet and potentially losing a parking stall depending on facility sizing needs.</li> <li>• There are light poles in the planters.</li> </ul>	<ul style="list-style-type: none"> <li>• New project opportunity area following Workshop.</li> <li>• Follow up from City in December 2017 indicates the need for board approval to retrofit core area parking will present an implementation challenge. No dedicated project need now.</li> </ul>			X
20	Juanita Pohl Parking Lot	Hedges Creek	• Water Quality	• WQ retrofit evaluation	X	<ul style="list-style-type: none"> <li>• Potential WQ retrofit at City-owned, parking lot.</li> <li>• Significant impervious surface area and limited existing WQ treatment.</li> </ul>	<ul style="list-style-type: none"> <li>• Per site visit, there are several locations where the existing islands that could be retrofit for WQ treatment. Would require relocation of inlet and potentially lose a parking stall depending on facility sizing needs.</li> </ul>	<ul style="list-style-type: none"> <li>• New project opportunity area following Workshop.</li> </ul>	X		
21	White Parking Lot	Hedges Creek	• Water Quality	• WQ retrofit evaluation	X	<ul style="list-style-type: none"> <li>• Potential WQ retrofit.</li> <li>• Parking lot properties are considered public but are governed by a separate board that oversees improvements.</li> </ul>	<ul style="list-style-type: none"> <li>• Per site visit, parking lot currently drains to middle ditch/swale that could be retrofit to provide significant treatment. Some light grading, soil augmentation and planting would be needed. Existing inlets would need to be removed.</li> </ul>	<ul style="list-style-type: none"> <li>• New project opportunity area following Workshop.</li> <li>• Follow up from City in December 2017 indicates the need for board approval to retrofit core area parking will present an implementation challenge. No dedicated project need now.</li> </ul>			X
22	Community Park Parking Lot	Hedges Creek	• Water Quality	• Site Visit	X	<ul style="list-style-type: none"> <li>• Potential WQ retrofit at City-owned, parking lot.</li> <li>• Significant impervious surface area and limited existing WQ treatment.</li> </ul>	<ul style="list-style-type: none"> <li>• Per site visit, there are several locations where the existing islands that could be retrofit for WQ treatment. Would require relocation of inlet and potentially lose a parking stall depending on facility sizing needs.</li> </ul>	<ul style="list-style-type: none"> <li>• New project opportunity area following Workshop.</li> </ul>	X		
23	Blue Parking Lot (Boones Ferry Rd and Tualatin Rd)	Hedges Creek	<ul style="list-style-type: none"> <li>• Water Quality</li> <li>• Capacity (bank overtopping)</li> </ul>	<ul style="list-style-type: none"> <li>• City GIS</li> <li>• WQ retrofit evaluation</li> </ul>	X	<ul style="list-style-type: none"> <li>• Potential WQ retrofit.</li> <li>• Reported flooding of lot due to proximity to Hedges Creek and floodplain. Flooding due to stream capacity issue and not to be addressed by Master Plan.</li> <li>• Properties are considered public but are governed by a separate board that oversees improvements.</li> </ul>	<ul style="list-style-type: none"> <li>• Hedges Creek floods the parking lot during routine rain events.</li> <li>• Per site visit, standing water onsite and parking lot is at grade with Hedges Creek.</li> <li>• Not a recommended opportunity to retrofit for WQ.</li> </ul>	<ul style="list-style-type: none"> <li>• New project opportunity area following Workshop.</li> <li>• Follow up from City in December 2017 indicates the need for board approval to retrofit core area parking will present an implementation challenge. No dedicated project need now.</li> </ul>			X
24	City Operations Yard	Hedges Creek	• Water Quality	• WQ retrofit evaluation	X	<ul style="list-style-type: none"> <li>• Potential WQ retrofit at City-owned, municipal property.</li> <li>• Significant impervious surface area.</li> </ul>	<ul style="list-style-type: none"> <li>• Per site visit, the parking lot adjacent to Herman Road currently has WQ treatment. The parking lot adjacent to the building does not, and access was limited.</li> <li>• Little opportunity for WQ retrofit at this location.</li> </ul>	<ul style="list-style-type: none"> <li>• New project opportunity area following Workshop.</li> <li>• No recommended project per follow up site visits.</li> </ul>			X
25	Jurgens Park Parking Lot	Tualatin River	• Water Quality	• Site Visit	X	<ul style="list-style-type: none"> <li>• Potential WQ retrofit at City-owned, parking lot.</li> </ul>	<ul style="list-style-type: none"> <li>• Per site visit, there is little opportunity for a water quality retrofit due to catch basin placement. The northern portion of the parking area is already paved with porous pavers.</li> </ul>	<ul style="list-style-type: none"> <li>• New project opportunity area following Workshop.</li> <li>• No recommended project per follow up site visits.</li> </ul>			X
26	Hedges Creek at SW 106 <sup>th</sup> Ave and Willow Str	Hedges Creek	• Erosion Control	• Stream Assessment		<ul style="list-style-type: none"> <li>• Active stream bank erosion occurring adjacent to, upstream, and downstream of an exposed sanitary manhole.</li> <li>• Separate evaluation conducted by the Park Department (Hedges Creek Stream Assessment, February 2018) also observed active erosion in vicinity.</li> </ul>	<ul style="list-style-type: none"> <li>• Limited upstream flow control results in high runoff velocities that appear to have eroded the stream channel.</li> <li>• Results of the Stream Assessment (Section 5 and TM3 of the SMP) outline specific observed conditions in reach.</li> </ul>	<ul style="list-style-type: none"> <li>• New project opportunity area following Workshop.</li> <li>• Project scope and cost information to be based on recommendations outlined in the Hedges Creek Stream Evaluation, February 2018.</li> <li>• Ongoing vegetation maintenance program needs.</li> </ul>	X	X	

**Table 3-1. City of Tualatin Stormwater Project Opportunities**

SW Project Opportunity Area ID	Location	Basin/Waterbody	Problem/Project Category	Source	Water Quality (WQ) Retrofit Opportunity	Problem/Project Area Description	Preliminary Project Concepts and Observations (per site visits)	Additional Data Collection/City Input (following Project Development Workshop)	Project Development		
									Project Need	Programmatic Activity	No Project
City wide	Repair and Replacement Program	City wide	<ul style="list-style-type: none"> <li>Capacity/Infrastructure Need</li> <li>Maintenance/Condition Assessment</li> </ul>	<ul style="list-style-type: none"> <li>Staff Questionnaire</li> </ul>		<ul style="list-style-type: none"> <li>Select storm lines and infrastructure throughout City may need more frequent maintenance to ensure function.</li> <li>There is no proactive pipe or structure replacement program.</li> </ul>	<ul style="list-style-type: none"> <li>Development of repair and replacement program for infrastructure (pipes and structures) requiring increased maintenance frequency. Include proactive infrastructure replacement.</li> </ul>	<ul style="list-style-type: none"> <li>Programmatic activities to be included in Master Plan and rate evaluation. May require multiple programmatic activities.</li> </ul>		X	
City wide	Public WQ Facility Maintenance	City wide	<ul style="list-style-type: none"> <li>Maintenance/Condition Assessment</li> <li>Water Quality</li> </ul>	<ul style="list-style-type: none"> <li>Staff Questionnaire</li> <li>WQ retrofit evaluation</li> </ul>		<ul style="list-style-type: none"> <li>City staff has been receiving complaints from homeowners unaware that a public WQ facility is near their residence.</li> <li>Re-engineering and/or retrofit of existing WQ facilities may be required.</li> </ul>	<ul style="list-style-type: none"> <li>Develop a program to review/investigate existing system design and function.</li> </ul>	<ul style="list-style-type: none"> <li>Programmatic activities to be included in Master Plan and rate evaluation.</li> </ul>		X	
City wide	Vegetation Management	City wide	<ul style="list-style-type: none"> <li>Water Quality</li> <li>Maintenance</li> </ul>	<ul style="list-style-type: none"> <li>Stream Assessment</li> </ul>		<ul style="list-style-type: none"> <li>Excessive invasive vegetation reported along stream reaches throughout the City.</li> </ul>	<ul style="list-style-type: none"> <li>Develop a program to remove invasive/replace/restore vegetation along stream channels.</li> <li>Results of the Stream Assessment (Section 5 and TM3 of the SMP) outline specific observed conditions in reach.</li> </ul>	<ul style="list-style-type: none"> <li>Programmatic activities to be included in Master Plan and rate evaluation.</li> </ul>		X	

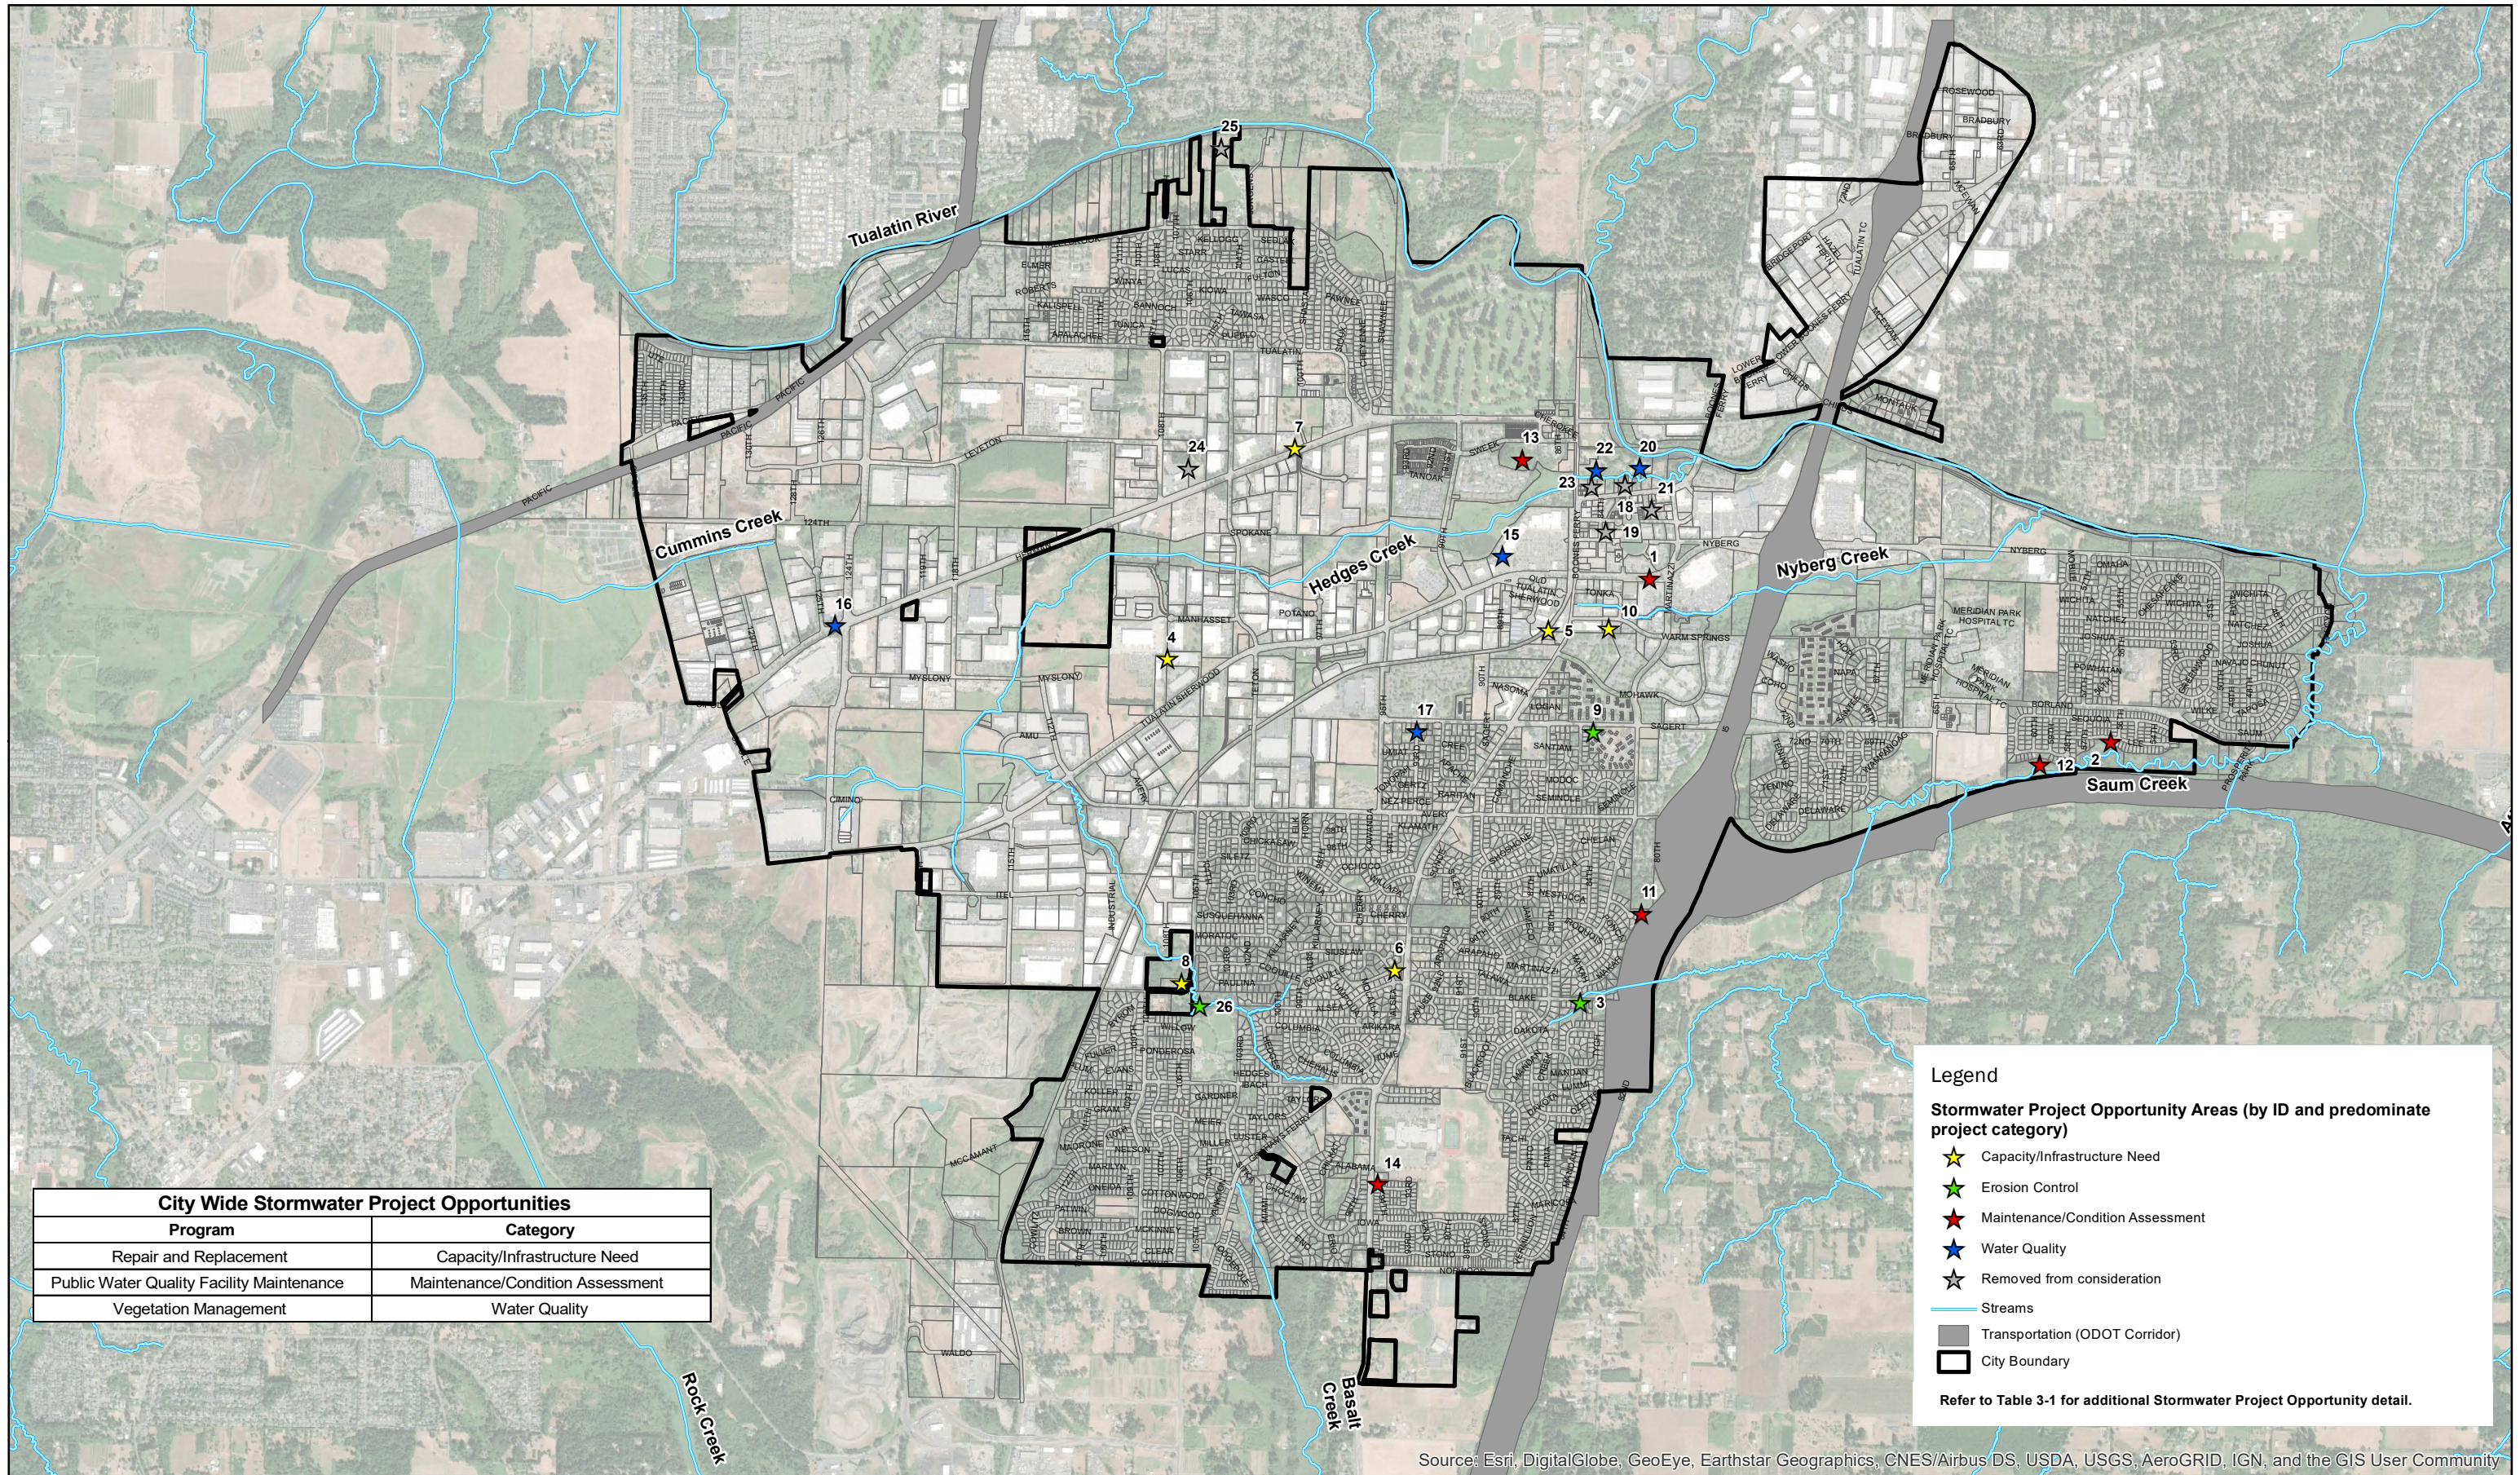

City Wide Stormwater Project Opportunities	
Program	Category
Repair and Replacement	Capacity/Infrastructure Need
Public Water Quality Facility Maintenance	Maintenance/Condition Assessment
Vegetation Management	Water Quality

**Legend**

**Stormwater Project Opportunity Areas (by ID and predominate project category)**

- ★ Capacity/Infrastructure Need
- ★ Erosion Control
- ★ Maintenance/Condition Assessment
- ★ Water Quality
- ★ Removed from consideration
- Streams
- Transportation (ODOT Corridor)
- City Boundary


Refer to Table 3-1 for additional Stormwater Project Opportunity detail.

Source: Esri, DigitalGlobe, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community



**City of Tualatin  
Stormwater Master Plan**

Date: April 2019  
Project: Project 149233



Notes:  
1. Projection: NAD 1983 State Plane Oregon North (feet)

**Figure 3-1  
Stormwater Project Opportunity Areas**



## Section 4

# Storm System Capacity Evaluation

Stormwater conveyance is the primary function of the City's stormwater infrastructure. This section outlines the H/H system modeling approach and results for select areas of the city that were used to inform observed capacity limitations and develop project solutions.

System modeling needs were identified as part of the project needs identification effort (Section 3.1.2) and reflect targeted areas of the city requiring hydraulic modeling to analyze existing and future system capacity. Capital project recommendations were developed for each modeled area after verifying capacity limitations and assessing project alternatives. A total of six capital project recommendations stemmed from results of the H/H modeling effort.

The system capacity evaluation is described in additional detail in TM2 and in TM3, included in this SMP as Appendix C and Appendix D, respectively. Model results and figures related to the capital project development are included in this SMP as Appendix E.

## 4.1 Modeling Approach

H/H modeling was conducted for targeted areas of the city with known capacity limitations and where flooding is frequently observed. This targeted modeling approach was executed to focus resources on specific areas of the city where additional information is needed to quantify system flooding and develop project solutions.

H/H modeling was predominately conducted in the downstream portions of the stormwater collection system that exhibit high flow but are relatively flat. A few areas do not discharge/outfall freely due to high tailwater conditions, resulting in backwater of the conveyance system and flooding. The City does not require detention for new and redevelopment, so as development occurs, there is typically an increase in stormwater flow and runoff volume, and as a result, existing infrastructure capacity may be insufficient to convey the increase in stormwater runoff.

For this SMP, the following modeling approach was used to evaluate stormwater conveyance capacity:

1. Compile a list of known and suspected problem areas and evaluate which areas will require modeling to inform corrective measures (see Section 3.1.2)
2. Review available data (via GIS, as-builts, etc.) to identify data gaps and data required for model development and to inform survey needs
3. Conduct field survey work to supplement data gaps in the City's GIS for the targeted portions of the City's stormwater conveyance system
4. Delineate subbasins and develop a citywide hydrologic model to estimate stormwater runoff generated for existing and future development conditions
5. Develop targeted or system-specific hydraulic models
6. Validate modeled flooding using anecdotal information (photographs, City records)
7. Verify capacity constraints and identify potential sources or causes
8. Use the validated hydraulic models to simulate alternative conveyance system design and develop potential solutions to capacity problems.

## 4.2 Planning Criteria and Design Standards

Planning criteria related to the analysis of the City's stormwater collection system are documented in the City's Public Works Standards (PW) Standards (2013), the CWS Design and Construction Standards (2007), and the CWS LIDA Handbook (2009).

Planning criteria and design standards are used to identify system capacity limitations and establish the basis of design for water quality and capacity-related projects. A summary of applicable planning criteria and design standards is provided in Table 4-1. Please note that some deviation from established design standards occurs on a case-by-case basis, particularly where slope or pipe cover design constraints exist.

Criteria	Source	Value
Water Quality Facility Design	PW Standards (206.8)	Design to requirements of CWS Design and Construction Standards and CWS LIDA Handbook. Specific to the PW Standards, facilities are required to have 4' or 6' vinyl coated chain link fencing.
Water Quantity Facility Design	PW Standards (206.8) CWS Design and Construction Standards	Design to requirements of CWS Design and Construction Standards. Match pre- and post-development flow for the 2-, 10-, and 25-yr, 24-hr storm events.
Pipe, Culvert Design Storm <sup>a</sup>	PW Standards (206.3)	Design to the 25-yr storm event. Surcharge during the 25-yr is not permissible. <sup>b</sup>
Open Channel and Ditch Design Storm	PW Standards (206.3)	Design to the 25-yr storm event. Surcharge during the 25-yr is not permissible. <sup>c</sup>
Pipe Size	PW Standards (206.4)	10" minimum diameter for pipe from catch basins to the main in the public ROW. 12" minimum diameter for mains in the public ROW.
Manning's Roughness	PW Standards (Table 206-8)	Varies by material and shape.
Pipe Material	PW Standards (206.4)	Concrete, PVC, ductile iron, and aluminum spiral rib pipe.
Pipe Cover	CWS Design and Construction Standards	Table 5-2, varies by pipe material.
Structure Spacing	PW Standards (206.4)	250' maximum for 10" pipe; 400' maximum for 12" pipe.
Manhole Size	PW Standards (206.6)	48" diameter minimum.

a. The City's PW standards reference the rational method for conveyance design. Santa Barbara Urban Hydrograph (SBUH) was an approved equivalent as discussed with the City during the July 28, 2016, meeting.

b. Per discussion with City staff, surcharge is acceptable for capital project design.

c. Due to the consequence of failure (potential road washout), capital project design for culverts used the 100-year peak flow.

In conjunction with the reissued NPDES permit, CWS is in the process of updating its Design and Construction Standards. CWS released updated standards in April 2017 to address the size of development that requires water quality treatment (impervious area threshold) and the prioritization of LIDA and green infrastructure (GI) facilities to provide treatment. Additional updates were finalized in April 2019 to establish strategies and priorities for addressing effects of hydromodification. These updates have not affected the City's design of capital projects under this SMP.

Additional discussion of stream erosion in accordance with hydromodification risk is provided in Section 5.



### 4.3 Hydrologic Model Development and Results

A citywide hydrologic model was developed using XP-Storm Water Management Model (XPSWMM) version 2016.1. Within the model, the SBUH method was used to estimate hydrology. The input parameters for the SBUH method include subbasin areas, impervious percentages, pervious curve numbers, and time of concentration. The hydrology routine in XPSWMM converts rainfall into stormwater runoff as a function of the design storm parameters (e.g., volume and intensity of rainfall); subbasin characteristics including topography, land use, vegetation, and soil types.

The hydrology modeling effort, particularly the delineation of subbasin areas, considered locations where the hydrology input is needed for the hydraulic model, such as at system junctions, changes in system slope, or locations where there are changes in conveyance pipe or channel size.

Hydrologic model results are tabulated in TM2 (Appendix C). Results are displayed by subbasin as the maximum flow for each design storm, the change in peak flow, and the percent increase in peak flow between the existing and future development conditions. Overall, the hydrologic model results show minimal to no increases in future flows for subbasins that are fully developed, such as in the Nyberg Creek and Tualatin River (direct) watersheds. The largest increases in flow are in subbasins with larger amounts of vacant land, such as in the Hedges Creek watershed.

### 4.4 Hydraulic Model Development and Results

There are six Stormwater Project Opportunity Areas where hydraulic models were developed as part of this SMP:

1. Stormwater Project Opportunity Area 1, Martinazzi Avenue at Tualatin-Sherwood Road
2. Stormwater Project Opportunity Area 4, Manhassat Drive
3. Stormwater Project Opportunity Area 5, Boones Ferry Road at Tonka Road
4. Stormwater Project Opportunity Area 7, Herman Road
5. Stormwater Project Opportunity Area 9, Sagert Street at the Shenandoah Apartments
6. Stormwater Project Opportunity Area 10, Mohawk Apartments at Warm Springs Road

Five of the Stormwater Project Opportunity Areas (Nos. 4, 5, 7, 9, and 10) were identified during the project needs identification effort. Additional hydraulic modeling was initiated in July 2018 to evaluate lower Nyberg Creek and the contributing stormwater collection system east of Martinazzi Avenue (Stormwater Project Opportunity Area 1). Modeling efforts focused on capacity and backwater effects of Nyberg Creek on stormwater infrastructure (Lower Nyberg Creek System).

Due to proximity and connectivity of the proposed modeled system, three of the areas (Nos. 5, 9, and 10) were combined into one hydraulic model system (Upper Nyberg Creek System).

Hydraulic model extents, including contributing subbasins, are shown on Figure 4-1 at the end of this section.

#### 4.4.1 Hydraulic Model Development

XPSWMM was used to simulate the hydraulic performance of the select pipe and open-channel systems to calculate peak flows, water surface elevations, and velocities for established design storms. The hydraulic model extents were established upstream and downstream of the identified problem areas to verify the extent and severity of the problem location and develop potential alternatives to correct or mitigate the deficiency.

One-dimensional (1D) XPSWMM hydraulic models were developed based on existing geographic information system (GIS) data provided by the City, field survey collected as part of this master

planning effort, and site visits. A two-dimensional (2D) XPSWMM model was developed for the Lower Nyberg Creek System, from Martinazzi Avenue east to Nyberg Lane, based on Light Detection and Ranging (LiDAR), field observations from stream walks, aerial photos, and survey data.

A description of each modeled system is provided below:

- **Manhassat Drive System:** The Manhassat Drive system includes Stormwater Project Opportunity Area 4. The City frequently responds to flooding of the open channel system, starting from Tualatin-Sherwood Road to Manhasset Drive. Based on field reconnaissance, feedback from City staff, and initial system review in GIS, the open channel system is capacity limited. The hydraulic model for the Manhassat Drive system includes the culvert under Tualatin-Sherwood Road and the piped and open channel system running north to the outfall into Hedges Creek.
- **Herman Road System:** The Herman Road system includes Stormwater Project Opportunity Area 7. City staff identified this area during completion of the stormwater surveys as frequently flooding. Based on field reconnaissance, feedback from City staff, and initial system review in GIS, the primary drainage issues include undersized drainage infrastructure and flat grade along Herman Road. The south side of Herman Road does not have a stormwater collection system, which results in standing water on the roadway. The hydraulic model for the Herman Road system includes the piped and open channel conveyance along Herman Road between Southwest Teton Avenue and Southwest Tualatin Road, as well as the open channel/piped system between Herman Road and the outfall at Sweek Pond.
- **Upper Nyberg Creek System:** The Upper Nyberg Creek system includes Stormwater Project Opportunity Areas 5, 9, and 10. All three areas were identified due to frequent flooding and the need for further assessment. Collectively, transport of sediment and gravel in this system, combined with the relatively flat grade of the system, results in reduced capacity of the stormwater collection system and backwater and flooding effects. The hydraulic model is extensive and includes the open channel system along the railroad tracks west of Boones Ferry Road, the piped drainage system on Boones Ferry Road, the culverts discharging east under Boones Ferry Road, the open channel system flowing east from Boones Ferry Road to Martinazzi Avenue, and the open channel and piped systems discharging north to Nyberg Creek from Seminole Trail Warms Springs Street.
- **Lower Nyberg Creek System:** The Lower Nyberg Creek system includes Stormwater Project Opportunity Area 1 and extends along Nyberg Creek from Martinazzi Avenue to Nyberg Lane. Both 1D and 2D modeling approaches were used to evaluate flooding extents, potential causes of flooding and comprehensively assess how modifications to Nyberg Creek influences upstream stormwater system. The Upper Nyberg Creek model 1D model was extended to include the Nyberg Creek channel from Martinazzi Avenue to the culvert outfall at Nyberg Lane and portions of the stormwater collection system along Tualatin-Sherwood Road and Martinazzi Avenue. The 1D and 2D models are linked in XPSWMM and simulated as a single model of the channel and floodplain.

For the Manhassat, Herman Road, and Upper Nyberg Creek System, existing condition hydrology for the 25-year storm event was used to initially evaluate the capacity of the modeled systems and validate model results. Model results were compared to anecdotal flooding reports and City photographs taken during the December 2015 storm event (for the Manhasset Drive system). Model validation information did not include specific flows or water surface elevations at structures within each of the hydraulic model areas. Therefore, model refinements instead of a model calibration were performed by adjusting hydraulic input parameters based on field observations to match reported flooding.

No recent model validation or calibration data were available for the Lower Nyberg Creek System.

Both existing and future condition hydrology were applied to the validated hydraulic model. This process enables the existing infrastructure to be assessed for future capacity needs.

#### 4.4.2 Capacity Evaluation Results

The hydraulic model results showed minimal to no increases in future flows for the modeled areas that are fully developed. As expected, the largest projected flow increases were seen in areas with existing vacant lands. The hydraulic model results confirmed the flooding problem areas/capacity-limited areas as reported by City staff and provided additional information about potential sources of the problems.

Detailed hydraulic modeling results (tables and figures) are provided in Appendix C for the Manhasset, Herman Road, and Upper Nyberg Creek System. Hydraulic modeling results are provided for the Lower Nyberg Creek System in Appendix D.

A summary of the hydraulic modelling results by modeled system is provided below. Table 4-2 summarizes the general modeled flooding locations, the potential source of the capacity deficiencies, and whether a capital project was developed to address the flooding.

- **Manhasset Drive System:** The hydraulic model shows extensive flooding during the 2-year design storm in the stormwater system along Manhasset Drive, especially along the open channel portion where the open channel cross sections are non-symmetrical and limited in capacity. Proper open channel maintenance, including debris removal and regular mowing of channel vegetation, may alleviate some flooding; however, the channel is still undersized for the contributing flow. Because pipes further downstream (north of Manhasset Drive) experience surcharging they do not meet City design standards; however, the maximum water elevations are not above manhole rim elevations.
- **Herman Road System:** The hydraulic model shows extensive flooding in the open channel/culvert system along Herman Road between SW Teton Avenue and SW Tualatin Road. The open channel system north of Herman Road is further restricted by the two culverts across Herman Road. These culverts have a non-traditional layout, likely due to the ground clearance required beneath the railroad and have a negative or backslope. To the east, the parallel culverts south of the intersection of Tualatin Road and Herman Road begin surcharging at the 2-year event. Figures 4-3 and 4-4 show the extent of modeled flooding by conduit.
- **Upper Nyberg Creek System:** The hydraulic model shows widespread system flooding during the 2-year and 10-year design storms. One prevalent location of flooding is the open channel system along the railroad tracks west of Boones Ferry Road (19417 SW Boones Ferry Road). The open channel is overtopping, and the downstream pipes are surcharging, resulting in flooding of nearby businesses. Flow bypassing the system is discharging to Boones Ferry Road via overland flow, consistent with the flow patterns reported by city staff. Sediment accumulation further restricts conveyance across the parallel culverts at Boones Ferry Road.

Additional area experiencing surcharge and flooding is the pipes north of Seminole Trail between Tillamook Court and Martinazzi Avenue, starting at the 10-year event. Modeling did not indicate flooding of the open channel system, but because any system upsize would impact the open channel, capital project development must include a comprehensive review of project needs in this area. Finally, the pipes near the intersection of SW Boones Ferry Road and SW Warm Springs Street and the intersection of SW Warm Springs Street and SW Tonka Street are surcharging beginning at the 10-year event.

- Lower Nyberg Creek System:** The hydraulic model shows systemic flooding along Martinazzi Avenue and Tualatin-Sherwood Road. The flooding is due to the low elevation of roadways and parking lots, low gradient conveyance systems and the low gradient in the Nyberg Creek itself. As described in TM3 (Appendix D), larger regional events result in widespread flooding along Martinazzi Avenue from Nyberg Creek to Tualatin-Sherwood Road due to the backwater effects of the Tualatin River on Nyberg Creek. More frequent, nuisance flooding (evaluated based on a 5-year, 24-hour design storm) still occurs along Martinazzi Avenue and Tualatin-Sherwood Road, but is the result of limited capacity of the collection system to convey flow as opposed to backwater conditions.

Table 4-2. Capacity Evaluation Result Summary and Capital Project Development Approach					
Modeled System	General Location	Conduit	Surcharging/ Flooding Scenario	Source of Capacity Deficiency	Capital Project Development (Y/N) <sup>a</sup>
Herman Road System	Open channel/culvert system on north side of Herman Road	Link32.1	Existing 10-yr	Existing culverts are undersized and have minimal slope. Multiple transitions from open channel to a piped system lead to high energy losses.	Y - CIP 8
		Link34.1	Existing 10-yr		
		322603	Existing 2-yr		
		322638.1	Existing 2-yr		
		333704.1	Existing 2-yr		
		333705.1	Existing 2-yr		
		333706.1	Existing 2-yr		
		333707.1	Existing 2-yr		
		334080.1	Existing 2-yr		
		Culvert across Herman Road	322643	Existing 2-yr	Culvert has minimal slope and nearby pipes show unusual change in inverts. Culvert is surcharging but not flooding. Follow up survey with detailed design recommended.
	Dual culvert south of intersection of Tualatin Road and Herman Road	322618	Existing 2-yr	Culvert has minimal slope. Culvert is surcharging but not flooding.	N
	Stormwater system at intersection of Tualatin Road and Herman Road	268371	Future 25-yr	Pipes is surcharging but not flooding. Refined hydrology during project design may refine project need.	N
Manhasset Drive System	Open channel along Manhasset Drive	Link9	Existing 2-yr	Open channel is undersized and not properly maintained.	Y - CIP 1
		Link10.1	Existing 2-yr		
		Link11.1	Existing 2-yr		
		Link12.1	Existing 2-yr		
		Link13.1	Existing 2-yr		
		Link14.1	Existing 2-yr		
	Piped system downstream of open channel on Manhasset Drive	266695	Existing 2-yr	Existing pipes are surcharging but not flooding due to minimal slope.	Y - CIP 1
		266697	Existing 2-yr		
Lower Nyberg Creek System	Piped system along Martinazzi Avenue and Tualatin-Sherwood Road	Link91	Existing 5-yr <sup>b</sup>	Nyberg Creek is surcharged to the outfall at Martinazzi Avenue. Backwater conditions result in system surcharging and localized flooding.	N
		Link102			
		Link103			
		Link93.1			
		Link100			



Table 4-2. Capacity Evaluation Result Summary and Capital Project Development Approach					
Modeled System	General Location	Conduit	Surcharging/ Flooding Scenario	Source of Capacity Deficiency	Capital Project Development (Y/N) <sup>a</sup>
		Link99			
		Link98			
		Link94			
		Link 136			
		Link74			
		267573_1			
		267573_2			
		267573_3			
		Link97			
		Link134			
		Link135			
		Link86			
		Link89			
Upper Nyberg Creek System	Open channel and pipe system behind Oil Can Henry's including junction of outfalls directly west of Boones Ferry Road	Link36	Existing 2-yr	Rock/gravel accumulation is limiting capacity. Project needs may include source control and maintenance.	Y - CIP 7
		Link43.1	Existing 2-yr		
		Link80	Existing 2-yr		
		277225	Future 2-yr		
	Piped system on Boones Ferry Road near Warm Springs Street	268293	Existing 10-yr	Existing open channels and pipes are undersized for the contributing drainage area. This system receives overland flow from the open channel behind Oil Can Henrys. System rerouting may help alleviate flooding.	Y - CIP2, Phase 3
		322832	Existing 10-yr		
		268296.1	Existing 25-yr		
		267215	Future 10-yr		
	Piped system at intersection of Warm Springs Street and Tonka Street	268297.1	Future 25-yr	Existing pipes have minimal slope and are undersized. System rerouting may alleviate flooding.	Y - CIP 2, Phase 2
		264286	Existing 10-yr		
	Piped system between Seminole Trail and Sagert Street	265109	Existing 2-yr	Existing pipes are undersized for contributing drainage area. Pipes are surcharged but not flooding. System is upstream of reported Sandalwood project opportunity area.	N
		267910	Existing 10-yr		
		267951	Existing 10-yr		
Sandalwood open channel	264521	Future 10-yr	No flooding in model; however, flooding was reported during the December 2015 storm event. Channel is incised.	Y - CIP 3	
	Link31	-			
Open channel behind Mohawk Apartments	Link32	-	Open channel is not flooding in the model; however, flow is being restricted at the downstream ditch inlet, which has large hydraulic losses.	Y - CIP 4 and CIP 2, Phase 1	
	Link 33	-			

- a. Capital projects are detailed in Section 7. Capacity deficiencies associated with system surcharging were not prioritized for project development (see Section 7.3).
- b. The 5-year design storm was evaluated for this reach to reflect nuisance flooding. Significant instream channel modifications (widening or regrading) is needed to alleviate flooding.




## 4.5 Capital Project Development

Based on the system capacity analysis, project alternatives were identified and evaluated to address modeled capacity issues. For some locations, multiple system configurations and sizing were tested to develop the preferred conceptual solution. Project alternatives were discussed with the City during the project development workshop (Section 3.2).

The preferred system configuration was developed into a capital project concept and a preliminary cost established based on the improvements required. For the Manhassat and Herman Road systems, one capital project was developed to address each system deficiency. Because the Upper Nyberg Creek System covered a large area and multiple stormwater project opportunities, a total of five capital projects were developed. Capital project fact sheets that included a project description, project considerations, and preliminary costs are included in Appendix A.

- Manhassat Storm System Improvements (CIP 1). This project addresses flooding due to an undersized conveyance channel and pipe system. This location is associated with Stormwater Project Opportunity Area 4.
- Nyberg Creek Stormwater Improvements (CIP 2). This project addresses undersized pipe pipes and ongoing maintenance issues along Boones Ferry Road, Warm Springs Street, and Martinazzi Avenue. This large project is split into three phases. This location is associated with Stormwater Project Opportunity Area 5.
- Sandalwood Water Quality Retrofit (CIP 3). This project addresses erosion and capacity concerns related to an open channel conveyance system. Water quality features are also incorporated. This location is associated with Stormwater Project Opportunity Area 9.
- Mohawk Apartment Stormwater Improvements (CIP 4). This project addresses limited capacity and system condition concerns and helps eliminate downstream flooding. This location is associated with Stormwater Project Opportunity Area 10.
- Herman Road Storm System (CIP 5). This project adds infrastructure to address frequent flooding. This location is associated with Stormwater Project Opportunity Area 7.
- Boones Ferry Railroad Conveyance Improvements (CIP 7). This project addresses ongoing maintenance issues, flooding, and backwater conditions along railroad ROW. This location is associated with Stormwater Project Opportunity Area 5.

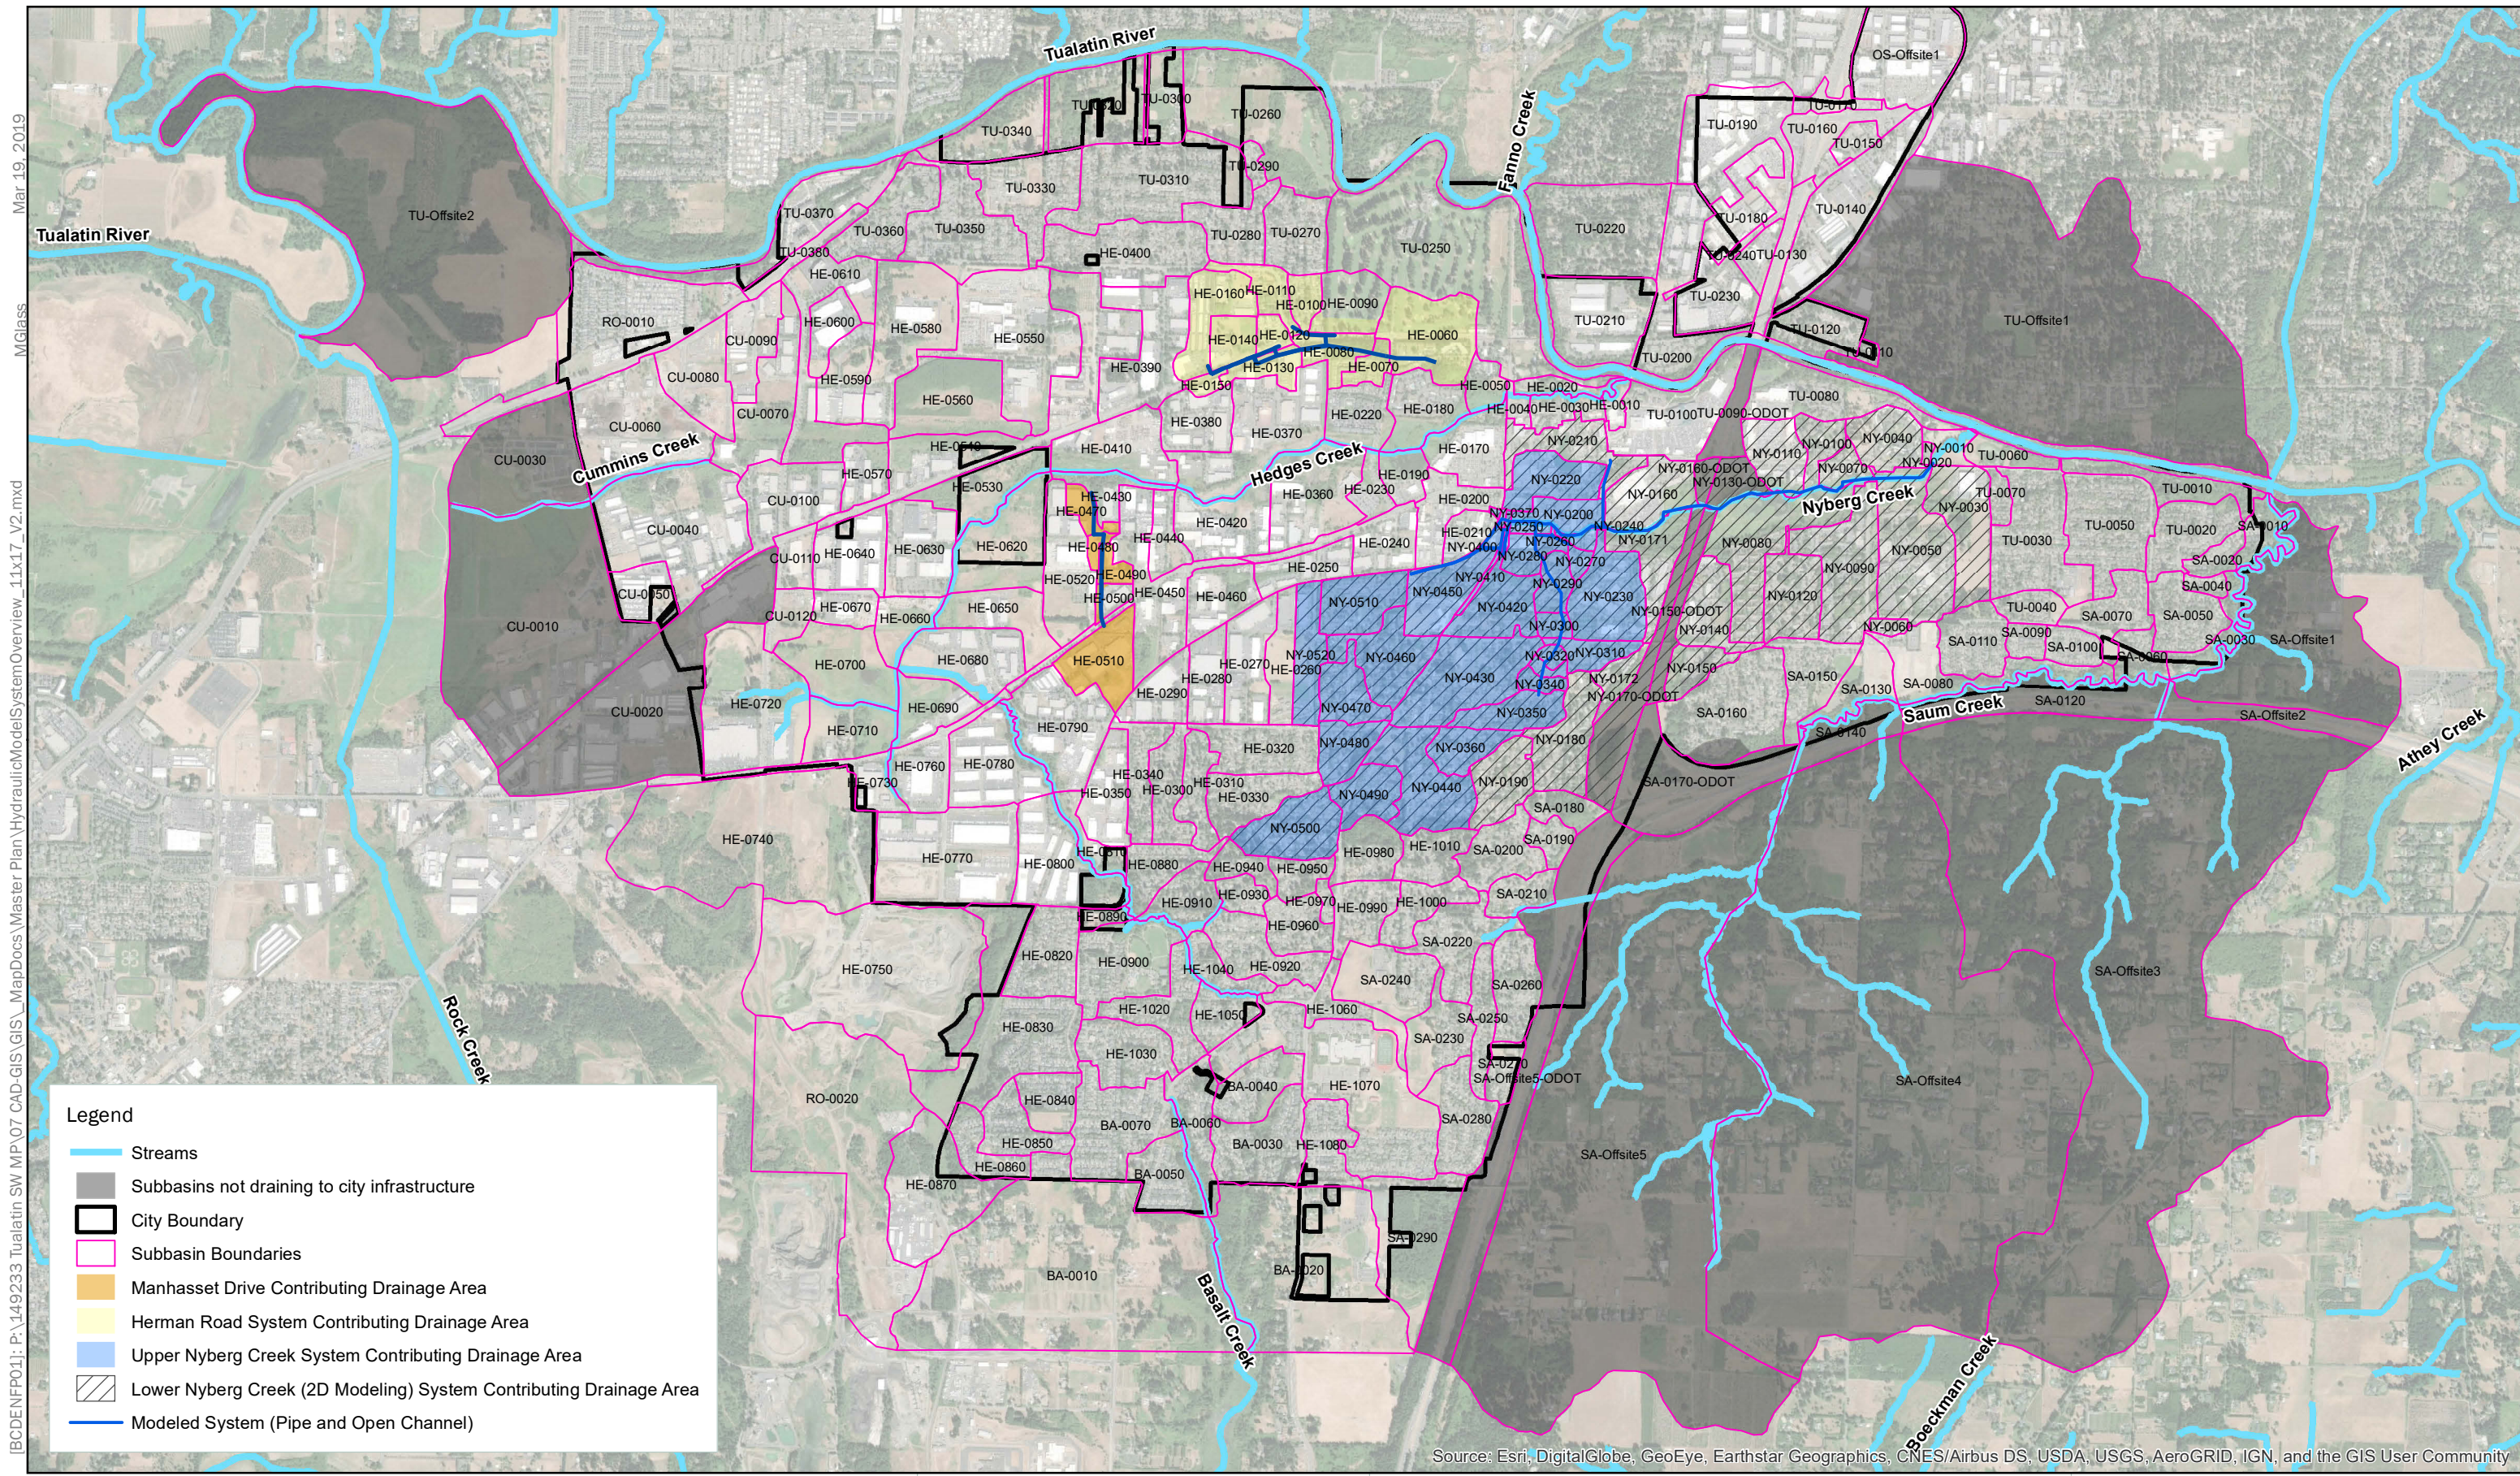

Mar 19, 2019  
 M:glass  
 [BCDENFP01]: P:\149233 Tualatin SW MP\07 CAD-GIS\GIS\_MapDocs\Master Plan\HydraulicModel\SystemOverview\_11x17\_V2.mxd

**Legend**


- Streams
- Subbasins not draining to city infrastructure
- City Boundary
- Subbasin Boundaries
- Manhasset Drive Contributing Drainage Area
- Herman Road System Contributing Drainage Area
- Upper Nyberg Creek System Contributing Drainage Area
- Lower Nyberg Creek (2D Modeling) System Contributing Drainage Area
- Modeled System (Pipe and Open Channel)

Source: Esri, DigitalGlobe, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community



**City of Tualatin**  
**Stormwater Master Plan**

Date: April 2019  
 Project: Project 149233



Notes:  
 1. Projection: NAD 1983 State Plane Oregon North (feet)

**Figure 4-1**  
**Model System Overview**





## Section 5

# Stream Assessment

Tributary stream channels to the Tualatin and Willamette rivers are an important element of the overall stormwater collection and conveyance system in the city. Stream channels provide conveyance and storage of water and sediment and provide habitat for aquatic and terrestrial species.

This section outlines results of the stream assessment conducted for select stream reaches in the city to inform project, program, and policy recommendations. Stream assessment needs were identified as part of the project needs identification effort (Section 3.1.3), to evaluate stream reaches observed to have erosion, invasive vegetation and hillslope instability. The stream assessment is described in additional detail in TM4, included in this SMP as Appendix F.

A total of three capital project recommendations stemmed from results of the stream assessment effort. Program and policy recommendations were also proposed to protect and proactively benefit the stream system.

## 5.1 Stream System Overview

The City of Tualatin's geography and topography are unique. While the city is located adjacent to the Tualatin River, much of the city drains to smaller tributary streams, including Nyberg Creek, Saum Creek and Hedges Creek. The City is in the downstream, lower portion of the Tualatin River watershed, approximately five miles from its confluence with the Willamette River. As such, topography is relatively flat and tributary stream channels have low gradient and are relatively well connected to the surrounding floodplain. There are extensive wetlands that compose much of the Hedges Creek and Nyberg Creek stream corridors.

Below is a brief description of Tualatin River and five tributary stream channels in the city, including ownership characteristics and description of the associated drainage basins:

- The Tualatin River is located along the northwestern border of the City. Relatively limited city area directly discharges to it, and the contributing drainage area is composed of low-density residential and open space. Backwater conditions from the Tualatin River routinely affect stormwater drainage for property near the river, resulting in standing water and flooding on parking lots and roadways.
- Cummins Creek is in the northwest part of the city and is a tributary to Rock Creek and the Tualatin River. The contributing drainage is predominately industrial with some open space (wetland) areas. Cummins Creek is considered privately owned.
- Hedges Creek drains the majority (44 percent) of the city area, and its watershed is almost exclusively located in the city. Much of the waterbody is considered privately owned, including large areas owned by the Wetlands Conservancy. Contributing land use is predominately industrial and low-density residential. Hedges Creek is considered highly modified due to extensive, historic development activities with limited stormwater management that occurred in the watershed.

- Nyberg Creek crosses I-5 and is the primary receiving water for much of the commercial development areas along I-5 and Tualatin-Sherwood Road. Contributing land use is commercial, industrial and low-density residential. Nyberg Creek has extensive wetland complexes and on-going beaver activity. Like Hedges Creek, ownership is a combination of private (Wetlands Conservancy) and public (City and the Oregon Department of Transportation).
- Saum Creek is in the southeastern portion of the City. Contributing land use is low-density residential and open space. There are significant greenways and natural areas along the lower (downstream) portion of the stream channel, which helps limit encroachment and direct impacts to the channel resulting from development. Ownership is a combination of private and public (City).
- Basalt Creek runs north-south in the southern portion of the City. Much of the contributing land use is low-density and rural residential, but with pending adoption of the Basalt Creek Concept Plan concept plan, future development is anticipated to impact the contributing land use and stream condition. Ownership is currently private and public (City).

## 5.2 Objectives

The stream assessment focused on direct observations gained from conducting stream walks along priority reaches of Saum, Nyberg, and Hedges creeks. Objectives of the stream assessment were to:

- Provide a baseline assessment of existing physical stream conditions
- Identify existing problem areas, such as locations of channel instability or excessive erosion that may impact private or public infrastructure
- Assess the potential for changes and impacts to the stream channel
- Recommend capital, operational, maintenance or other solutions for issues identified

Objectives of the stream assessment were developed to support continued evaluation of stream channel conditions in the city. Information collected as part of this assessment should be referenced and used during future inspection efforts to help assess improvements and degradation.

## 5.3 Methodology

City staff identified nine priority reaches in the city based on ownership, history of staff or citizen complaints/concerns, and potential for additional stream flow due to new or redevelopment activities. Figure 5-1 at the end of this section identifies specific stream reaches investigated.

Stream walks were conducted between September 11, 2017, and September 15, 2017. A total of 10 reaches were evaluated, including all nine priority reaches plus Hedges Creek Reach 3A, an optional reach associated with Stormwater Project Opportunity Area 8 (see Table 3-1). A total of 23,225 linear feet of stream and riparian corridor was evaluated.

During the stream walks, photographs were taken to document stream characteristics and condition. Physical and biological stream conditions were noted and mapped and included:

- General vegetation condition, including presence of native and non-native vegetation
- In-stream and hillslope erosion processes (incision, aggradation and hillslope failures)
- Approximate bankfull stream channel widths and depths, measured at appropriate intervals when conditions change
- General aquatic habitat conditions (pools, riffles, large woody debris, flow)
- Location of stormwater outfalls, pipes and groundwater seeps
- Potential pollution sources

- General in-stream sediment distribution throughout the stream channel
- Wildlife activity (presence of beaver dams)

Photo logs and stream reach summary sheets were developed to identify cross section and physical condition characteristics for each reach at the time of the stream walk.

## 5.4 Findings and Results

Observations made during the stream walks were used to qualitatively identify current stream channel deficiencies and potential strategies for improvement. A detailed summary of stream channel condition by reach is provided in Appendix F. General reach characteristics are provided in Table 5-1.

Stream	Reach	Length (ft)	Average Gradient (%)	Average Valley Width (ft)	Contributing City Drainage Area (ac)	Contributing Existing Impervious (%)	Contributing Future Impervious (%)	Difference (%)
Saum	1	6,775	0.6	100-200	493	34	42	8
	2	4,950	0.4	150-175	460	37	44	7
	3	600	1.1 (upstream) 3.0 (downstream)	75-100	367	37	44	7
Nyberg	1	950	<0.1	300-400	816	46	57	11
	2	2,100	0.1	500-650	607	41	57	16
	3	1,400	0.3	30-60	399	36	57	21
Hedges	1	2,250	0.8	75 - 125	2,340	48	58	10
	2	1,900	0.2	125-250	754	41	51	10
	3A	1,740	<0.1	~150	608	36	47	11
	3B	560	3.7	~50	138	40	50	10

### 5.4.1 Vegetation

Stream reaches were found to contain significant amounts of invasive, non-native vegetation such as reed canary grass, Himalayan blackberry, jewel weed, and English Ivy within their riparian corridor. Invasive vegetation was observed in almost every investigated stream reach, although some reaches were heavily impacted. Invasive vegetation can limit native vegetation growth and constrain flow capacity and beneficial habitat. Evidence of beaver activity was prevalent as well.

Reaches did show a distinct lack of trash in and around the channel, which is positive and noteworthy given its urban/suburban setting.

### 5.4.2 Riparian Condition

Wide riparian corridors surround many of the stream channels. Preservation of wide riparian corridors and connection to floodplain is important, especially for low-gradient streams like those in the City because these reaches require space to maintain meandering characteristics and a stable channel form. This finding is positive and noteworthy given the urban/suburban setting.

The upstream/headwater stream reaches investigated were generally steeper and had more confined channels. There is very little in-channel or floodplain storage capacity in these areas to dissipate flows. Riparian vegetation in these areas is also limited. Riparian vegetation provides

channel stability and slope stability through water interception, water uptake, and soil reinforcement from roots. A limited riparian buffer combined with a steeper gradient makes these stream channels more susceptible to channel stability issues (see Section 5.4.3).

### 5.4.3 Channel Erosion and Incision

Stormwater runoff, particularly in urban areas, has the potential to impact stream conditions. Increases in impervious areas through development and redevelopment can alter runoff conditions and increase the timing and magnitude of flows to stream channels. Increased flow can alter stream channel conditions and result in flooding, bank erosion, bed incision, sediment production, and other impacts, commonly referred to as hydromodification. Physical stream channel conditions (i.e., riparian width, stream channel gradient, and channel confinement from development or topographic conditions) were documented and considered in conjunction with observed bank and bed erosion.

Instances of bed and bank erosion were most prevalent in the headwater stream reaches evaluated (e.g., Hedges Creek Reach Nos. 3A and 3B), which are exposed to the first effects of high flows conveyed from surrounding residential neighborhoods during rain events.

The future potential for bed and bank erosion can be observed in conjunction with the potential for development (and associated increases in impervious surface area) (Table 5-1). Upstream reaches, specifically in Nyberg Creek and Hedges Creek, are relatively narrow and show a greater potential for increases in runoff from impervious surface areas. Policies related to flow control may be warranted for select stream reaches to mitigate impacts of increased stormwater runoff.

## 5.5 Additional Investigations

Independent from the stream assessment conducted for this SMP, the City's Parks Department conducted a supplemental assessment of Hedges Creek from SW Ibach Street to SW 105th Avenue (Hedges Creek Stream Assessment, February 2018). Hedges Creek Reach Nos. 3A and 3B are included in this evaluation effort. In addition, this supplemental assessment extended west along the southern Hedges Creek tributary, adjacent to SW Ibach Street.

Potential project needs were identified and prioritized along Hedges Creek. Findings from this supplemental assessment generally corresponded with findings from the stream assessment where locations overlapped.

City staff reviewed the findings and qualified the identified stormwater project needs from this supplemental assessment, and selected project needs to include as part of this SMP.

## 5.6 Capital Project and Program Development

Findings from the stream assessment and supplemental Hedges Creek Stream Assessment were used to identify stormwater project and program needs. Identification of stormwater project needs was isolated to reaches under City ownership.

In addition, the City may consider policies to mitigate stormwater flow associated with new and redevelopment, particularly in headwater stream reaches with observed erosion and downcutting. The City may also consider beaver management efforts to maintain in-channel conveyance capacity and address localized flooding issues resulting from beaver activity.

### 5.6.1 Capital Project Needs

Three capital project needs were verified in conjunction with the stream assessment. Two locations were originally identified during preliminary stormwater project planning (Section 3.0) as Stormwater Project Opportunity Areas. Capital project fact sheets that include a project description, project considerations, and preliminary costs are included in Appendix A.

- **Blake Street Culvert Replacement (CIP 6).** This project addresses an undersized culvert and failing headwall along Hedges Creek. The stream assessment identified headwall deterioration and bank erosion due to the culvert’s orientation. This location is associated with Stormwater Project Opportunity Area 8 and was also identified as a project need in the supplemental Hedges Creek Stream Assessment.
- **Saum Creek Hillslope Repair (CIP 19).** This project replaces a degraded outfall pipe and repairs the hillslope failure near the outfall. The stream assessment confirmed the perched outfall location and evaluated stream bank conditions immediately upstream and downstream of the outfall. This location is associated with Stormwater Project Opportunity Area 3.
- **Hedges Creek Stream Repair (CIP 20).** This project includes an outfall extension, bioengineered slopes, streambed fill, vegetation restoration and construction of a retaining wall to address observed instream channel erosion and protect infrastructure. This location was identified as a project need in the supplemental Hedges Creek Stream Assessment.

### 5.6.2 Program Needs

Results from the collective stream assessment efforts and preliminary project planning (Section 3.0) support the need for an annual program to conduct vegetation management along stream corridors. Efforts would be targeted at: 1) invasive vegetation removal, 2) planting and irrigation (as necessary) 3) installation of native riparian plants, and 4) ongoing inspections to refine future maintenance needs and compare overall stream channel conditions against results from this baseline evaluation.

Results from the stream assessment efforts prioritized the following reaches for vegetation management activities (Table 5-2). Cost assumptions related to the program efforts are detailed in Section 7.

Stream	Reach	Approximate Length (ft)	Location Description	Invasive Vegetation	Ownership
Saum	3	200	Upstream of SW Blake Street near a recent restoration project	Reed canary grass, Himalayan Blackberry	City
Nyberg	3	1,400	Entire reach	Reed canary grass	City (approximately 300' private)
Hedges	1	500	Tualatin Community Park	Reed canary grass	City
	2	1,900	Entire reach	Reed canary grass, Himalayan Blackberry	City
	Southern Tributary	200	Locations C, D, and F identified in the supplemental Hedges Creek Stream Assessment	Not specified	City

### 5.6.3 Policy Considerations

The following policy considerations may be incorporated into future updates to the Tualatin Public Works Construction Code, Tualatin Municipal Code (Title 03), or addressed through internal directives.



### 5.6.3.1 Detention/Flow Control Stormwater Design Standard

In April 2019, CWS adopted updated Design and Construction Standards with updated language in Chapter 4: Runoff Treatment and Control<sup>2</sup>. Updated language incorporates new design requirements related to water quantity and hydromodification control and builds on previous efforts from 2017 (see Section 3.2). New and redevelopment greater than 12,000 square feet of impervious surface will be required to conduct a Hydromodification Assessment and implement strategies commensurate with the receiving water Hydromodification Risk Level, Development Class, and Project Size.

Results from this stream assessment effort and additional investigations conducted by the City appear consistent with CWS's published Hydromodification Risk Levels for receiving waters, which identify upper Hedges Creek and Saum Creek as moderate or high risk for hydromodification.

The City currently implements CWS's Design and Construction Standards for water quality. The City should consider adopting the updated CWS Design and Construction Standards, including standards that address water quantity control and hydromodification, in accordance with areas identified as experiencing channel erosion and incision.

### 5.6.3.2 Beaver Management Activities

The stream assessment effort identified significant beaver activity along investigated reaches. Beavers provide many benefits to stream ecology and habitat, but in urban areas, beaver activity can result in localized flooding and backwater effects in stream channels.


Beavers are classified as "Protected Furbearers" in Oregon, and thus excluded from take (Oregon Administrative Rule 498.012) (Portland 2010). The ODFW encourages public and private landowners to first use beaver exclusion and habitat modification techniques to minimize beaver activity in locations that are susceptible to impacts from beaver activity.

The City may choose to implement/codify beaver management techniques to selectively encourage/discourage beaver activity based on the characteristics of their stormwater drainage systems, topography and vegetation. Management techniques for consideration include:

- **Selective planting:** Encourage/discourage beaver activity through planting of preferred plant species. To minimize or deter beaver activity, avoid use of alder, birch, cottonwood, willow, and other preferred deciduous plants in riparian restoration projects and use non-desirable plant species, including Sitka spruce, elderberry, cascara, and osoberry, as they are not preferred food plants for beavers.
- **Fencing/tree barriers:** Install fencing to isolate one or groups of trees from beaver foraging. Fencing should be 2 to 4 feet high. Install fencing around inlets of culverts or spillways to prevent beavers from blocking inlets.
- **Tree painting:** Paint the bottom (2 feet to 4 feet) of trunk with latex paint/sand mixture.
- **Flood/Flow Control:** Install a flexible pond leveler (a pipe through the beaver dam) to control water levels. Beaver dam removal can also be conducted to lower water levels, but this activity is time intensive and generally only a temporary solution.

---

<sup>2</sup> On November 12, 2019, CWS Board of Directors adopted the most recent amendments to the CWS' Design and Construction Standards. Such amendments included updates to standard engineering details, pump station standards, and minor changes to text for clarity. Implementation policies referenced in this Plan for development projects were adopted in April 2019 and remain in effect.

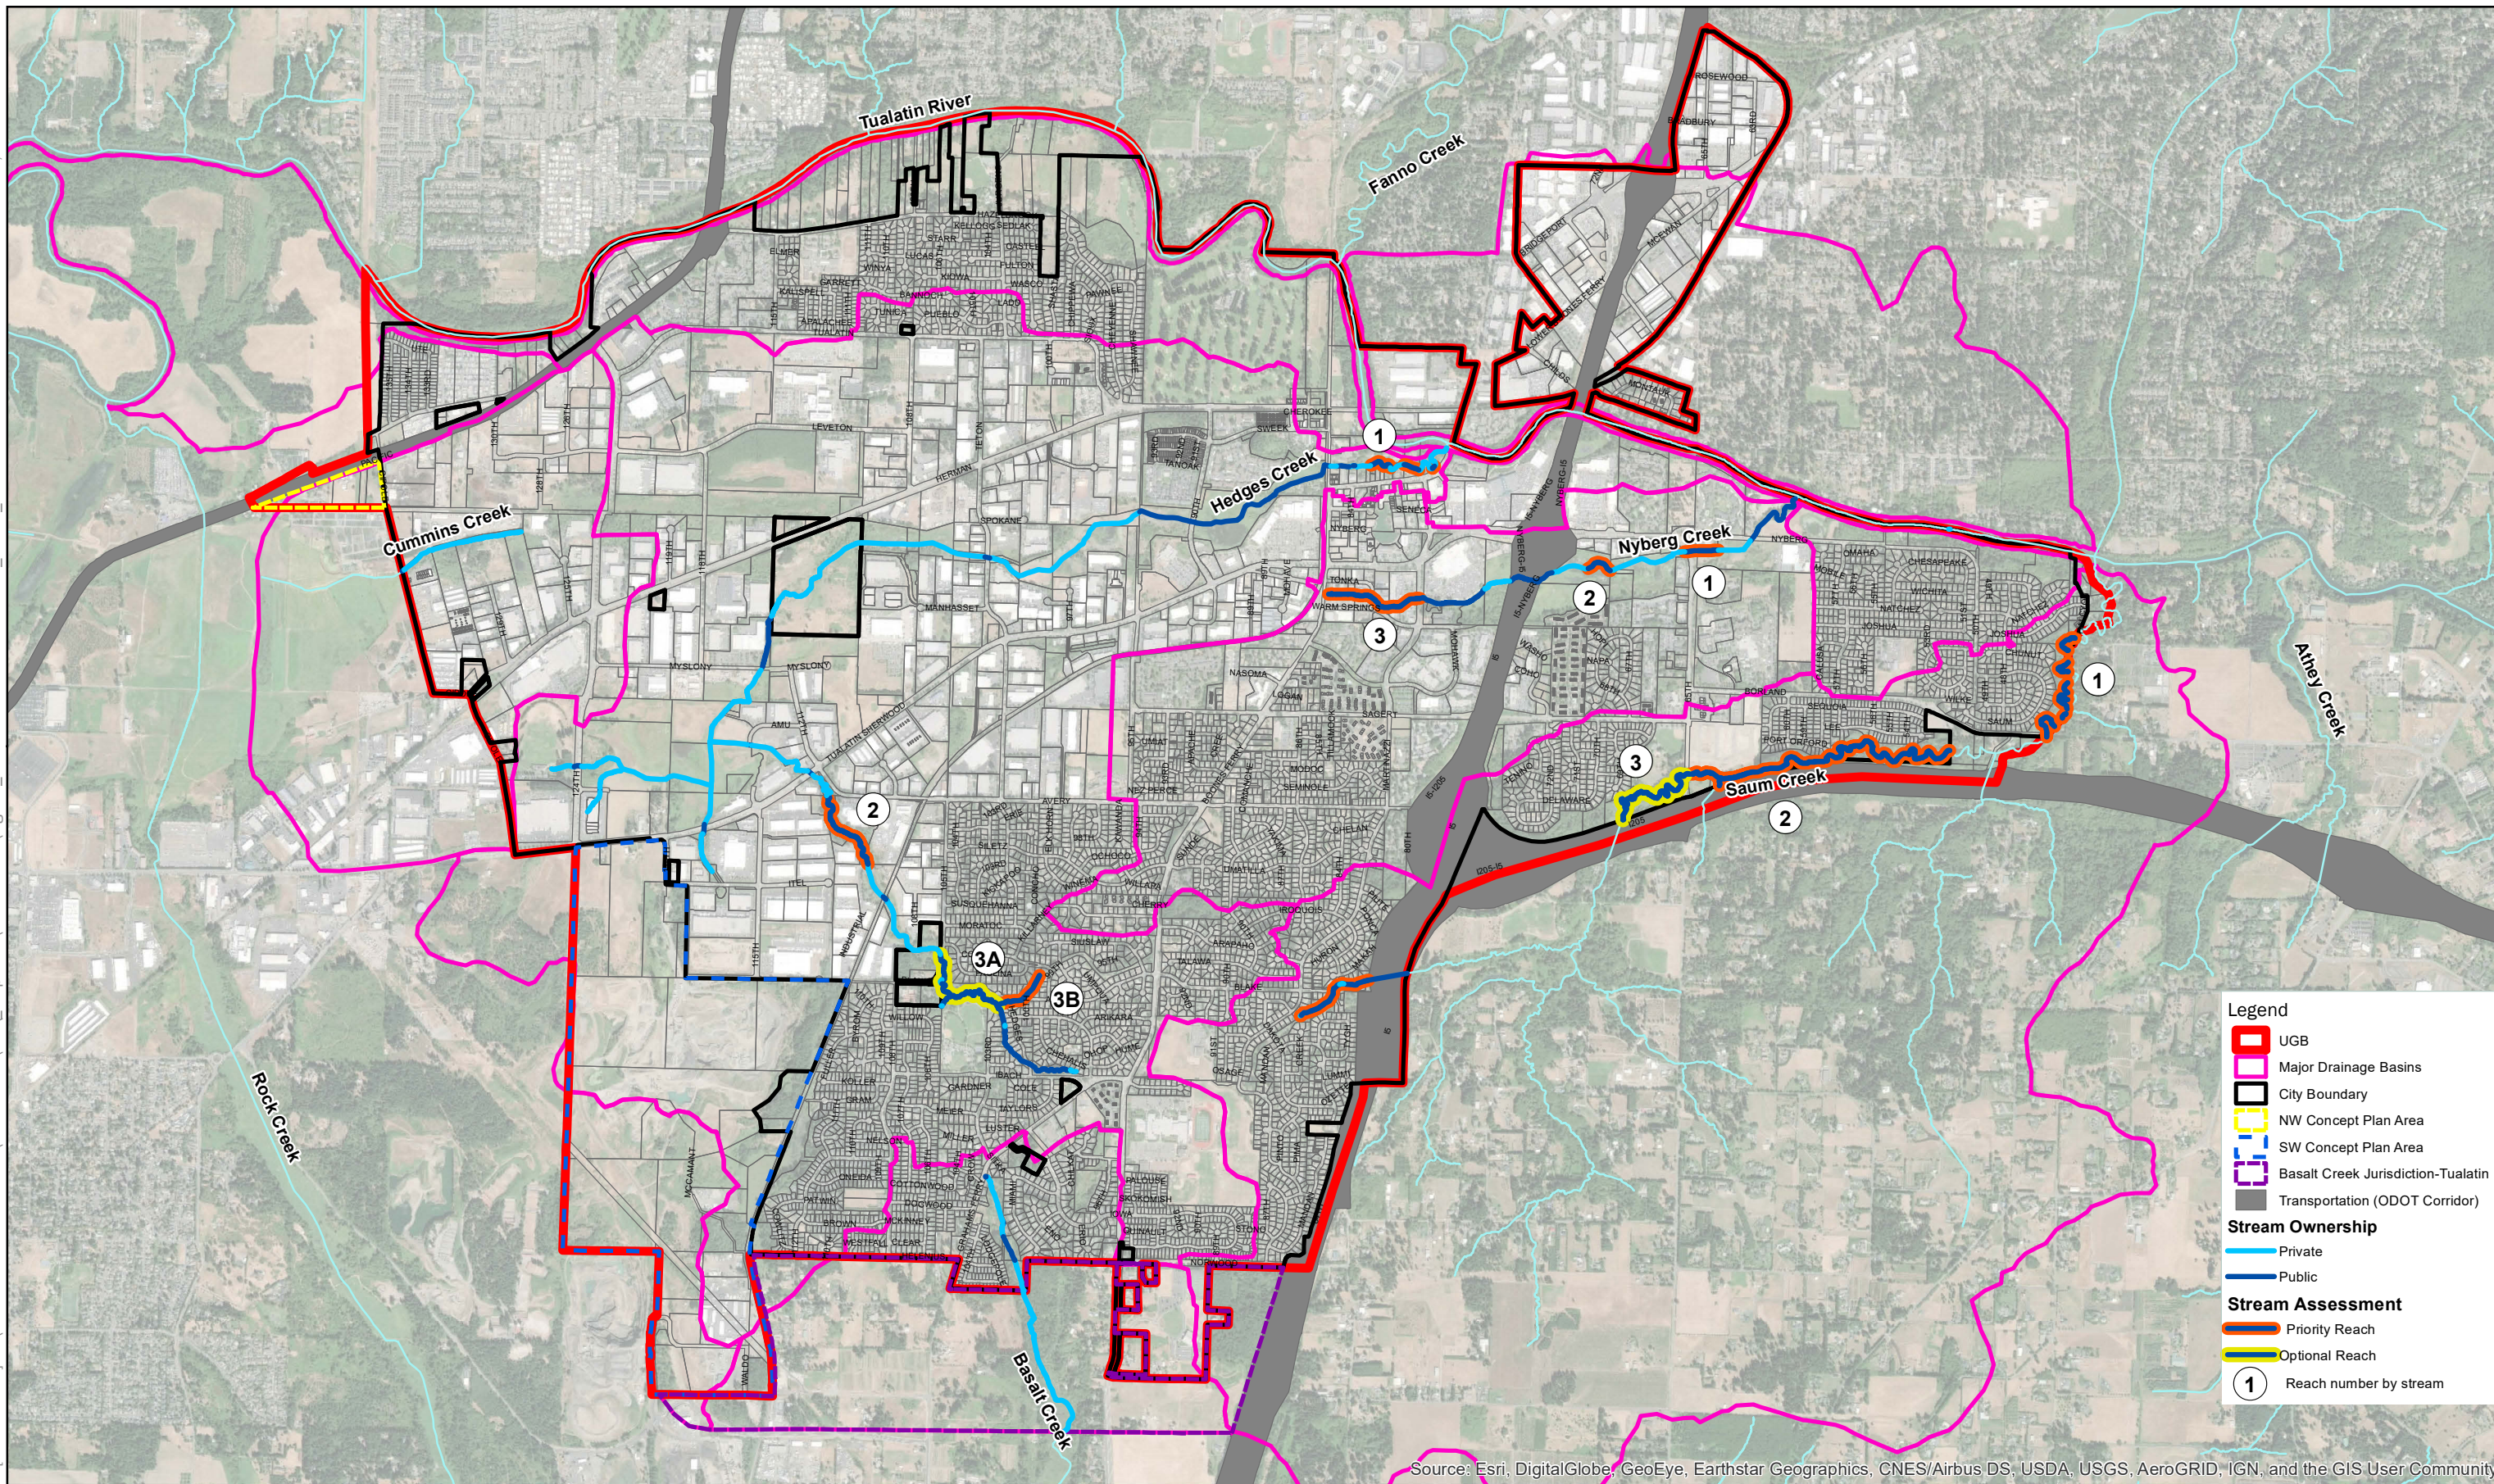


Source: Esri, DigitalGlobe, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community



**City of Tualatin**  
**Stormwater Master Plan**

Date: April 2019  
Project: Project 149233



Notes:  
1. Projection: NAD 1983 State Plane Oregon North (feet)

**Figure 5-1**  
**Stream Assessment Overview**





## Section 6

# System Maintenance and Programmatic Assessment

This SMP includes projects and programs intended to support the City's long-term asset management efforts and supplement existing maintenance activities.

This section outlines maintenance-related project and program needs stemming from review of the City's current maintenance activities and costs, site visits, and staff feedback during a programmatic activity workshop. Project needs are considered a one-time planning and cost effort, whereas program activities are continuous and require annual funding. A detailed condition assessment of City infrastructure was not performed as part of this SMP, but activities to protect and preserve existing assets are proposed, based on the condition of the City's stormwater collection, conveyance, and treatment systems.

A total of six capital project recommendations are associated with condition or maintenance-related deficiencies. Additionally, four program strategies are proposed to maintain City infrastructure and/or provide ongoing water quality benefits.

## 6.1 Maintenance Overview

Maintenance is a necessary requirement for the long-term health and stability of the City's stormwater program. This includes the maintenance of piped conveyance systems, open-channel conveyance system, stormwater structures (manholes, catch basins, etc.), water quality facilities, outfalls and natural systems, and other elements of the stormwater system. Neglected systems perform at a lower level than maintained systems, and it is typically more expensive to fix a neglected system than to conduct preventive maintenance. Maintenance is recommended to be a priority for all elements of the City's stormwater system.

The City contracts out and internally conducts scheduled (routine) and unscheduled maintenance activities on stormwater infrastructure and facilities throughout the City. Many maintenance activities and frequencies are specified in conjunction with CWS's watershed-based NPDES permit. As a co-complementor of the NPDES permit, the City conducts and reports on maintenance activities annually for permit compliance.

Table 6-1 provides an overview of the City's current maintenance activities and obligations, along with an average estimate of staff time to perform the maintenance activity. Based on current NPDES annual reporting, the City can meet most maintenance targets, but public water quality facility maintenance is one area of needed improvement.

**Table 6-1. City Maintenance Activities**

Activity	Frequency required	Annual Target <sup>a</sup>	Annual Effort <sup>a</sup>	Meeting target? (Y/N)	Staff/Division
TV inspection	8-year cycle	57,000 ft	57,000 ft	Y	Storm Division or contract
Pipeline cleaning	6-year cycle	75,000 ft	75,000+ ft	Varies	Storm Division
Ditch inspection/cleaning	--	--	--	--	Storm Division
CB cleaning (with sumps)	Annual	1,200	1,200	Y	Storm Division
CB cleaning (without sumps)	Annual	1,600	1,600	Y	Storm Division
Water quality MH cleaning	2x/year	126 (based on 63 MH)	140+	Y	Storm Division
MH cleaning	----	----	----	--	Storm Division
Street sweeping	12x/year	150 curb miles	150+ mi	Y	Storm Division or contract
Public water quality facility inspections <sup>b</sup>	4x/year	1,200 (based on 300 facilities)	1,200+	Y	Engineering
Public WQ facility maintenance	As needed	----	----	N	Contracted via Parks or Storm Division
Private WQ facility inspections <sup>b</sup>	25%/year	68	80+	Y (need for improved system tracking)	Engineering

a. Values provided are approximate based on the asset inventory documented per the CWS NPDES 2015-16 annual report.

b. Updated per email from Shawn Strasser 10/6/17.

## 6.2 Programmatic Activity Workshop

On April 19, 2018, City and BC staff met to review the City's existing stormwater maintenance-related efforts and discuss general stormwater program needs. Discussion included the City's current funding allocations for maintenance-related activities. A summary document was distributed to staff summarizing the City's asset inventory (from GIS) and maintenance obligations as detailed in CWS's effective SWMP. The goal of the workshop was to define additional programmatic efforts to include in this SMP, along with a dedicated annual funding commitment, to improve upon the City's current programs to protect and preserve assets.

Stormwater project needs identification (Section 3.1) efforts resulted in the identification of three citywide maintenance-related program needs, which formed the basis for discussion of programmatic activities. These citywide needs included:

- Repair and replacement program
- Public water quality facility maintenance program
- Vegetation management program

Current, dedicated funds to support maintenance related activities are limited and do not include a reserve to support variable system maintenance or replacement needs. Relevant program cost information based on the City's 2018-2019 budget is listed in Table 6-2 below.

**Table 6-2. Existing Program Funding (2018-19)**

Relevant Activity	Annual Budget	Staff/Division
Repair of Stormlines/MH/CBs	\$19,400	Storm Division
Line Repairs to System	\$25,000	Storm Division
CCTV Inspection	\$53,530	Storm Division or contract
Retrofit CBs (CWS requirement)	\$45,500 <sup>a</sup>	Storm Division
Contract Landscape Services at 72 sites (reflects water quality facilities but also general landscaping needs)	\$108,300 <sup>b</sup>	Contracted via Parks or Storm Division

a. For 2018-19, the annual \$45,500 was doubled to account for unspent funds in 2017-18.

b. Assume \$25,000 of annual budget is reserved for facility maintenance.

Program activities are defined and described below with respect to conveyance system condition deficiencies, and public/private water quality facilities. Program needs related to vegetation management were previously defined in conjunction with the stream assessment results (see Section 5.6.2).

### 6.2.1 Conveyance System Condition Deficiencies

A stormwater system condition assessment requires review of available, current stormwater system information to identify areas of failure, pending or imminent failure, and areas that are rapidly deteriorating.

Much of the City's infrastructure was constructed in the last 30 years in conjunction with private development trends. As such, the City's stormwater infrastructure (pipe and structures) should have several decades of service life remaining; however, pipe age is not currently tracked in the City's GIS. CCTV of the City's stormwater infrastructure is conducted to address NPDES permit requirements, but detailed evaluation of the CCTV results has not occurred. A condition assessment of buried stormwater infrastructure to confirm remaining service life has also not been conducted to date.

As part of this SMP effort, the City is looking to identify pipe and structure replacement needs and plan for long-term asset replacement, repair, and rehabilitation. Development of a repair and replacement (R/R) program is a critical component of this effort. An R/R program begins by establishing baseline condition data to track and address pipe and structure condition moving forward.

The City wishes to establish separate programs (and annual funding mechanisms) for R/R to address pipes and structures. These programs should first assess and track infrastructure health in conjunction with current CCTV inspections to establish a baseline condition assessment. Pipe and structure R/R can follow as needed. These programs are described further in Section 6.3.2.

### 6.2.2 Public/Private Water Quality Facility Inspection and Maintenance

In accordance with requirements of the CWS NPDES permit, there is increased emphasis on methods for improving stormwater quality. One method is through the tracking, inspection, and maintenance of existing public and private stormwater treatment facilities to ensure that function of these facilities is preserved.

Development of this SMP included a detailed look at existing public water quality facility conditions. The project needs assessment (Section 3.0) identified five project opportunities where the function of the stormwater treatment facilities was compromised. Based on site inspections, these locations require facility restoration as opposed to just maintenance. Restoration efforts include vegetation management and removal (including trees), sediment removal and regrading, installation of

amended soil to support plant growth, and rehab/replacement of inlet or outlet structures. These restoration needs are addressed with capital projects, as detailed in Section 6.3.1.

Preliminary project planning efforts also identified that ongoing (routine) public water quality facility maintenance does not regularly occur. Maintenance is conducted on an as-needed basis as time and funding allow. The City contracts out most of the stormwater facility maintenance activities, which can result in delays. The City regularly inspects facilities in accordance with efforts documented in Table 6-1. Recent inspection efforts identified the following priority locations that require maintenance to ensure functionality, although a stand-alone capital project need was not identified at this time:

- **Lakeridge Terrace Facility Maintenance.** Facility (pond) was constructed in 2001 to serve a 48-lot subdivision. Maintenance needs include sediment removal (facility and outlet structure), tree removal, and replanting.
- **Gertz Swale Redesign.** Facility was constructed in 2003. Stormwater currently short-circuits the facility and results in erosion. Maintenance needs include re-grading the facility, vector management, and installation of an impermeable membrane.
- **Shasta Trail Swale Maintenance.** Facility was constructed in 2004. Stormwater currently short-circuits the facility and results in erosion and discharge to neighboring property. Maintenance needs include re-grading the facility, vector management, and installation of an impermeable membrane.
- **Green Lot Swale Maintenance.** Facility was constructed in 2005. Maintenance needs include re-grading the facility, sediment removal, and vegetation management (removal and replanting)

As part of this SMP effort, the City identified the need for a program (and annual funding mechanism) for continual public water quality facility maintenance. The program can be used to conduct both routine maintenance activities and support larger system restoration or redesign needs. Efforts should prioritize facilities identified through annual inspection efforts, including those priority locations listed above.

In addition, in conjunction with CWS's updated Design and Construction Standards, a lower impervious area development threshold for meeting design standards will result in more private water quality facility installations. The City wishes to expand its private stormwater facility inspection program to include low impact development applications (LIDA) on single family residential sites. This programmatic activity would be supported by an increase in staffing as opposed to an annual funding mechanism.



**Figure 6-1. Example of buried outlet control structure at the Green Lot Swale**

*(photo courtesy of City of Tualatin)*

### 6.2.3 Water Quality Facility Retrofits

Per requirements of the CWS NPDES permit, another method for improving stormwater quality focuses on expanding of water quality treatment through the ongoing identification of water quality retrofit opportunities. Such efforts directly address current NPDES permit requirements related to the development and implementation of a retrofit strategy and the need for increased stormwater pollutant load reduction.

Water quality opportunity areas and water quality projects have been identified as part of the project planning process (Section 3.1.1). Additional project reconnaissance efforts conducted by the City and CWS (see Appendix I) identified the following additional retrofit opportunity locations, although a stand-alone capital project need was not identified at this time:

- **Boones Ferry Road and Iowa Street** (Green Street installation).
- **Boones Ferry Road across from Logan Lane** (Green Street installation).
- **125th Avenue to Herman Road** (Public-Private Partnership for a water quality facility installation during redevelopment).
- **SW 95th Avenue at SW Tualatin-Sherwood Road** (Public-Private Partnership for a water quality facility installation during redevelopment or a Green Street installation).
- **SW Teton Road and SW Herman Road Intersection** (regional facility).
- **SW Nyberg Street at SW 65<sup>th</sup> Avenue** (rehabilitation of an existing water quality facility).

As part of this SMP effort, the City also identified a need for an annual program to validate and construct opportunistic water quality retrofits, as additional opportunity areas are likely to be identified throughout the duration of this SMP's implementation. Such retrofits may include larger-scale regional facilities or installing green streets in conjunction with transportation improvement projects. Efforts should prioritize project opportunities identified through annual inspection efforts, including those priority locations listed above.

## 6.3 Capital Project and Program Development

Findings from the maintenance assessment, in conjunction with the programmatic activity workshop and supplemental site visits, were used to identify stormwater project and program needs in support of improved and proactive system maintenance.

### 6.3.1 Capital Project Needs

Six capital projects, originally identified during the project needs assessment (Section 3.1) and as Stormwater Project Opportunity Areas, were developed to address condition-related deficiencies with piped stormwater infrastructure and priority maintenance deficiencies with public water quality facilities.

Capital project fact sheets including project descriptions, project considerations, and preliminary costs are included in Appendix A.

- **Water Quality Facility Restoration-Venetia (CIP 13)**. This project includes restoring a failing public water quality facility. Project activities include clearing brush and vegetation, removing sediment and regrading, installing amended soils, and replanting. This location is associated with Stormwater Project Opportunity Area 2.
- **Water Quality Facility Restoration-Piute Court (CIP 14)**. This project includes restoring a failing public water quality facility. Project activities include installing a maintenance access road, clearing brush and vegetation, removing sediment and regrading, installing amended soils, replanting with a temporary irrigation system, and replacing the outlet structure. This location is associated with Stormwater Project Opportunity Area 11.
- **Water Quality Facility Restoration-Sequoia Ridge (CIP 15)**. This project includes restoring a failing public water quality facility. Project activities include clearing trees and vegetation, removing sediment and regrading, installing amended soils, installing energy dissipation, replanting with a temporary irrigation system, and replacing the outlet structure. This location is associated with Stormwater Project Opportunity Area 12.

- **Water Quality Facility Restoration–Sweek Drive Pond (CIP 16).** This project includes restoring a failing public water quality facility. Project activities include clearing trees and vegetation, removing sediment, installing amended soils, installing an upstream water quality manhole, replanting with a temporary irrigation system, and installing an outlet control structure. This location is associated with Stormwater Project Opportunity Area 13.
- **Siuslaw Water Quality Facility Retrofit (CIP 17).** This project includes replacing 450 feet of failing stormwater pipe and adds water quality treatment at the outlet. This location is associated with Stormwater Project Opportunity Area 6.
- **Water Quality Facility Restoration–Waterford (CIP 18).** This project includes restoring a failing public water quality facility. Project activities include clearing vegetation, removing sediment and regrading, installing amended soils, replanting with a temporary irrigation system, and relocating and replacing the outlet control structure. This location is associated with Stormwater Project Opportunity Area 14.

### 6.3.2 Program Needs

Results from the project needs assessment (Section 3.1) and maintenance assessment indicate annual programs are needed to proactively address maintenance-related deficiencies.

Cost assumptions related to these programs are detailed in Section 7.

- **Pipe Repair and Replacement Program.** Establishes an annual funding mechanism for pipe R/R. Initial dedicated funds can support development of a baseline condition assessment, including review of existing CCTV in accordance with defined evaluation metrics, coding, and scoring. The National Association of Sewer Service Companies provides a consistent and standard evaluation process for pipes and underground structure conditions. Annual program cost obligations, in addition to staff resources, have been established.
- **Structure R/R Program.** Establishes an annual funding mechanism for structural facility (catch basins, ditch inlets, flow control structures, and manholes) R/R. Initial dedicated funds can support development of a baseline condition assessment. Annual program cost obligations, in addition to staff resources, have been established.
- **Public Water Quality Facility Maintenance Program.** Establishes an annual funding mechanism to conduct routine maintenance (vegetation removal, sediment removal) and restorative maintenance (sediment and regrading, addition of amended soils, replanting, new infrastructure) for public water quality facilities. Immediate needs should be based on annual inspection efforts. Annual program cost obligations, in addition to staff resources, have been established.
- **Public Water Quality Retrofit Program.** Establishes an annual funding mechanism expand water quality treatment throughout the City. Efforts would focus on rehabilitating or retrofitting existing public water quality facilities to promote additional infiltration and/or flow management, planning activities in support of regional water quality retrofit facility installations, and installation of green streets in conjunction with transportation improvement projects. Efforts may include developing a dedicated program, responding to public inquiries, preliminary facility sizing, and detailed design/construction. Annual program cost obligations have been established.
- **Single Family LIDA Inspection Program.** Dedicates staff resources to expand the existing private water quality facility inspection program to single-lot/single family LIDA applications. Annual staff resources have been established.

## Section 7

# Capital Improvement Plan

This section summarizes the capital project and program recommendations identified throughout the master planning process. Project and program recommendations stem from the water quality assessment (summarized in Section 3.1.1), capacity evaluation (Section 4), stream assessment (Section 5), and maintenance assessment (Section 6).

A total of 21 capital projects were identified to address current and future needs related to water quality, capacity/flooding, system condition and repair, maintenance, and stream health. Six program recommendations to address R/R, system maintenance, and ongoing water quality retrofits were also identified.

## 7.1 Summary of Recommended Actions

Projects, programs and policy recommendations in this SMP are proposed to improve and enhance drainage infrastructure and water resources throughout the city, as summarized by the following recommended actions:

- Implement identified system capacity improvements (i.e., reconfiguration, rerouting, upsizing) to manage more frequent, nuisance system flooding.
- Increase water quality treatment throughout the city by expanding treatment area coverage through water quality retrofits and enhancing the level of treatment provided.
- Conduct proactive maintenance of the City's stormwater infrastructure. Utilize system condition data currently collected (i.e., stormwater facility inspections, CCTV) to evaluate needs and priorities.
- Consider the topographic limitations and flat grade of the City's conveyance network with regards to system maintenance activities. Sediment removal and vegetation management are key maintenance needs to ensure conveyance capacity, and an increase in maintenance activities may be warranted for select areas of the system.
- Continue coordination with CWS to ensure updates to the City's TDC and PW Standards are in line with regulatory drivers and protect stream health.
- Ensure timely implementation of capital projects and programs by establishing updated funding mechanisms and rates. Additional funding is needed to adequately manage the drainage system as material costs increase, flows increase, and the drainage system deteriorates with age and use.

## 7.2 Capital Project Recommendations

Table 7-1 summarizes the final capital projects list. Figure 7-1, at the end of this section provides an overview of project locations throughout the city. Project fact sheets are provided in Appendix A and include a project description, summary of design considerations, an overview figure, and cost summary.

This page intentionally left blank.



**Table 7-1. City of Tualatin Stormwater Capital Project Summary**

CIP #	Project Name	Project Summary	Project Objectives	Location	Basin/ Waterbody	Project Description	Total Estimated Cost	SDC Eligible Cost	WQ Retrofit	Project Timing		Associated SW Project Opportunity Area ID
										High Priority (2019-2029)	Lower Priority (Future)	
1	Manhasset Storm System Improvements	Project addresses flooding due to undersized channel and pipe system near Tualatin-Sherwood Road to Manhasset Drive.	<ul style="list-style-type: none"> <li>Increases System Capacity (Flood Control)</li> </ul>	Manhasset Dr (near 10550 SW Manhasset Dr)	Hedges Creek	<ul style="list-style-type: none"> <li>Pipe the existing open channel conveyance and upsize select pipe segments.</li> <li>Replaces the existing 1,050 linear feet (LF) of open channel and 180 LF of 21-inch-diameter pipe with 1,230 linear feet (LF) of 30-inch-diameter pipe.</li> <li>Replaces the existing 750 LF of 27-inch-diameter pipe from Manhasset Drive to the outfall to Hedges Creek with 750 LF of 36-inch-diameter pipe.</li> <li>Includes landscaping, nine new manholes and a new outfall to Hedges Creek.</li> </ul>	\$1,581,000	\$237,000			X	4
2	Nyberg Creek Stormwater Improvements	Project addresses under sized pipes and ongoing maintenance issues near Nyberg Creek between Boones Ferry Road and Martinazzi Avenue.	<ul style="list-style-type: none"> <li>Increases System Capacity (Flood Control)</li> <li>Increases WQ Treatment (Retrofit)</li> </ul>	Boones Ferry Rd (19417 SW Boones Ferry Rd)	Nyberg Creek	<ul style="list-style-type: none"> <li>Upsize undersized pipe segments, relocating StormFilter catch basin units, and rerouting stormwater flow.</li> <li>Project is broken up into three phases due to costs:</li> <li>Phase 1: Install a new trunkline down Martinazzi Avenue from Mohawk Street to Nyberg Creek.</li> <li>Phase 2: Install a 48-inch pipe along Warm Springs Street and a new outfall to Nyberg Creek.</li> <li>Phase 3: Upsize storm system along Boones Ferry Road and divert flow to the new system on Warm Springs Street</li> </ul>	Phase 1: \$1,523,000 Phase 2: \$1,252,000 Phase 3: \$637,000	Phase 1: \$289,000 Phase 2: \$238,000 Phase 3: \$121,000	X	X (Phase 1)	X (Phases 2 and 3)	5
3	Sandalwood Water Quality Retrofit	Project addresses erosion and capacity concerns related to an open channel conveyance system.	<ul style="list-style-type: none"> <li>Addresses Erosion</li> <li>Increases WQ Treatment (Retrofit)</li> </ul>	Sagert St. - Shenandoah Apts (Sandalwood)	Nyberg Creek	<ul style="list-style-type: none"> <li>Regrade the existing open channel conveyance.</li> <li>Install planting for enhanced WQ treatment.</li> <li>Widen and regrade the existing open channel conveyance, resulting in a 10' wide by 220' long swale.</li> <li>Install outfall protection and check dams.</li> <li>Install a new ditch to prevent debris accumulation.</li> <li>Replace existing ditch inlet with a manhole and connect to new ditch.</li> </ul>	\$107,000	\$25,000	X		X	9
4	Mohawk Apartments Stormwater Improvements	Project addresses limited capacity system at Mohawk Apts to eliminate downstream flooding.	<ul style="list-style-type: none"> <li>Increases System Capacity (Flood Control)</li> <li>Addresses Maintenance Need</li> </ul>	Mohawk Apartments	Nyberg Creek	<ul style="list-style-type: none"> <li>Install 1,000 LF of CCTV video inspection to determine/ verify the pipe condition, location, material and size.</li> <li>Install three manholes along the pipe alignment for maintenance access.</li> </ul>	\$295,000	\$59,000			X	10
5	Herman Road Storm System	Project addresses areas of frequent flooding due to limited grade and a lack of drainage infrastructure.	<ul style="list-style-type: none"> <li>Increases System Capacity (Flood Control)</li> </ul>	Herman Rd	Hedges Creek	<ul style="list-style-type: none"> <li>Install 110 LF of 30-inch-diameter pipe</li> <li>Install 960 LF of 36-inch-diameter pipe</li> <li>Install 10 manholes, 4 connections to existing stormwater pipes/culverts, and 12 catch basins with an associated 420 LF of 12-inch inlet leads.</li> </ul>	\$1,023,000	\$276,000			X	7
6	Blake St. Culvert Replacement	Project addresses undersized culvert and failing rock wall due to erosive flows.	<ul style="list-style-type: none"> <li>Increases System Capacity (Flood Control)</li> <li>Addresses Erosion</li> </ul>	Curves at Blake/105th and 108th	Hedges Creek	<ul style="list-style-type: none"> <li>Replace the existing culvert with an 84-inch culvert, along the natural stream alignment.</li> </ul>	\$552,000	\$121,000			X	8
7	Boones Ferry Railroad Conveyance Improvements	Project addresses ongoing maintenance issue, flooding and backwater conditions.	<ul style="list-style-type: none"> <li>Addresses Maintenance Need</li> <li>Increases System Capacity (Flood Control)</li> <li>Addresses Erosion</li> </ul>	RR Culvert behind former Oil Can Henys		<ul style="list-style-type: none"> <li>Install large rock along the railroad ballast.</li> <li>Upsize downstream pipe to increase flow capacity and improve maintenance access.</li> <li>Remove existing gravel and ballast material along 150 ft of the open conveyance channel.</li> <li>Install Class 100 rip-rap along the railroad ballast to reduce the potential for material transport.</li> <li>Install a new ditch inlet to minimize hydraulic losses at the upstream end of the pipe.</li> <li>Replace 480 LF of 36-inch-diameter pipe with 42-inch-diameter pipe.</li> <li>Install a 72-inch manhole along pipe alignment for improved maintenance access.</li> <li>Install a new outfall to the open channel area directly west of Boones Ferry Road. Add rip-rap for energy dissipation.</li> </ul>	\$515,000	\$108,000			X	5
8	89th Avenue Water Quality Retrofit	Project adds pretreatment/ WQ treatment for Hedges Creek wetland and addresses requirement of the NPDES Permit	<ul style="list-style-type: none"> <li>Increases WQ Treatment (Retrofit)</li> </ul>	89th Ave/Tualatin-Sherwood Rd Stormwater Outfall	Hedges Creek	<ul style="list-style-type: none"> <li>Install a Contech CDS hydrodynamic separator (Model CDS3025) with a treatment flow rate of 2.4 cfs.</li> <li>Install 50 LF of 24-inch-diameter pipe and 100 LF of 48-inch-diameter pipe.</li> </ul>	\$262,000	-	X		X	15



**Table 7-1. City of Tualatin Stormwater Capital Project Summary**

CIP #	Project Name	Project Summary	Project Objectives	Location	Basin/ Waterbody	Project Description	Total Estimated Cost	SDC Eligible Cost	WQ Retrofit	Project Timing		Associated SW Project Opportunity Area ID
										High Priority (2019-2029)	Lower Priority (Future)	
9	125 <sup>th</sup> Court Water Quality Retrofit	Project adds pretreatment/ WQ treatment for Hedges Creek wetland and addresses requirement of the NPDES Permit.	<ul style="list-style-type: none"> <li>Increases WQ treatment (Retrofit)</li> </ul>	125th to Herman Rd	Cummins Creek	<ul style="list-style-type: none"> <li>Install a Contech™ CDS hydrodynamic separator (Model CDS3025), with a treatment flow rate of 2.4 cfs.</li> <li>Install 50 LF of 24-inch-diameter pipe and 50 LF of 36-inch-diameter pipe to support connections to existing infrastructure.</li> </ul>	\$206,000	\$74,000	X		X	16
10	93 <sup>rd</sup> Avenue Green Street	Project addresses WQ retrofit objectives of the NPDES Permit through a pilot green street project.	<ul style="list-style-type: none"> <li>Increases WQ treatment (Retrofit)</li> </ul>	93rd Ave	Nyberg Creek	<ul style="list-style-type: none"> <li>Install stormwater planters (with an underdrain and overflow) to treat approximately 15,000 sf of impervious surface from the roadway, sidewalks and property frontage along the unimproved right-of-way.</li> <li>Install 550 LF of curb and gutter along 93rd Avenue to direct stormwater runoff to the WQ facilities.</li> <li>Connect outlets of the WQ facilities to existing stormwater infrastructure on 93rd Avenue.</li> </ul>	\$224,000	-	X		X	17
11	Juanita Pohl Water Quality Retrofit	Project adds WQ treatment in a parking area that discharges to Hedges Creek.	<ul style="list-style-type: none"> <li>Increases WQ treatment (Retrofit)</li> </ul>	Juanita Pohl Parking Lot	Hedges Creek	<ul style="list-style-type: none"> <li>Regrade existing landscape islands to install raingardens for WQ treatment.</li> <li>Excavate and regrade landscape areas and back fill with drain rock and amended soils to support the WQ facility installation.</li> <li>Install of check dams to minimize potential erosion.</li> <li>Install curb and curb cuts to serve as inlets to the facilities and associated piping to connect the facility overflows to downstream structures (i.e., manholes).</li> <li>Plant the facility with native vegetation suitable for a WQ facility.</li> <li>Minor repaving of parking stalls near the facilities.</li> </ul>	\$156,000	-	X	X		20
12	Community Park Water Quality Retrofit	Project adds WQ treatment in a parking area associated with the Tualatin Community Park.	<ul style="list-style-type: none"> <li>Increases WQ treatment (Retrofit)</li> </ul>	Community Park	Hedges Creek	<ul style="list-style-type: none"> <li>Regrade existing landscape islands to install raingardens for WQ treatment.</li> <li>Excavate and regrade the landscape areas and back fill with drain rock and amended soils.</li> <li>Address existing utilities, light pole, signage, etc.</li> <li>Install curb and curb cuts to serve as inlets to the facilities and associated piping to connect the facility overflows to downstream structure (i.e., manhole).</li> <li>Plant the facility with native vegetation suitable for a WQ facility.</li> </ul>	\$158,000	-	X	X		22
13	Water Quality Facility Restoration - Venetia	Project restores a failing WQ facility.	<ul style="list-style-type: none"> <li>Addresses maintenance need</li> <li>Improves WQ</li> </ul>	Venetia WQ Facility (Lee between 56th and 57th)	Saum Creek	<ul style="list-style-type: none"> <li>Restore a public WQ facility.</li> <li>Clear trees and large brush growing in the swale.</li> <li>Remove accumulated sediment along swale bottom, regrade and replace with amended soils and mulch.</li> <li>Replant facility with native vegetation suitable for a WQ facility.</li> </ul>	\$65,000	-			X	2
14	Water Quality Facility Restoration - Piute Court	Project restores a failing WQ facility.	<ul style="list-style-type: none"> <li>Addresses maintenance need</li> <li>Improves WQ</li> </ul>	Piute Ct. WQ Facility	Saum Creek	<ul style="list-style-type: none"> <li>Restore a public WQ facility.</li> <li>Install 100 LF gravel access road in the easement located between homes on Piute Court.</li> <li>Remove accumulated sediment and invasive vegetation, regrade the existing facility, and add amended soils and mulch.</li> <li>Replant the bottom and sides of facility with riparian/wetland vegetation. Add temporary irrigation.</li> <li>Install an energy dissipation pad at the pond inlet.</li> <li>Replace the existing ditch inlet with an outfall control structure.</li> <li>Install a WQ manhole upstream of the facility in Piute Court.</li> </ul>	\$104,000	-			X	11
15	Water Quality Facility Restoration - Sequoia Ridge	Project restores a failing public WQ facility.	<ul style="list-style-type: none"> <li>Addresses maintenance need</li> <li>Improves WQ</li> </ul>	Sequoia Ridge WQ Facility	Saum Creek	<ul style="list-style-type: none"> <li>Restore a public WQ facility.</li> <li>Clear all cottonwood trees and other vegetation from the facility.</li> <li>Remove accumulated sediment and invasive vegetation and add amended soils.</li> <li>Replant the bottom and sides of facility with riparian/wetland vegetation suitable for a stormwater pond. Add temporary irrigation.</li> <li>Install energy dissipation pad at pond inlet.</li> <li>Redesign the outlet control structure to have functional low flow pipe and high flow overflow.</li> <li>Remove the current cap and install an overflow plate.</li> </ul>	\$83,000	-			X	12



**Table 7-1. City of Tualatin Stormwater Capital Project Summary**

CIP #	Project Name	Project Summary	Project Objectives	Location	Basin/ Waterbody	Project Description	Total Estimated Cost	SDC Eligible Cost	WQ Retrofit	Project Timing		Associated SW Project Opportunity Area ID
										High Priority (2019-2029)	Lower Priority (Future)	
16	Water Quality Facility Restoration – Sweek Drive Pond	Project restores a failing public WQ facility.	<ul style="list-style-type: none"> <li>Addresses maintenance need</li> <li>Improves WQ</li> </ul>	Sweek Dr. WQ pond	Hedges Creek	<ul style="list-style-type: none"> <li>Restore a public WQ facility.</li> <li>Install a new outlet control structure to better utilize storage.</li> <li>Clear all cottonwood trees and other vegetation from the facility.</li> <li>Remove accumulated sediment and invasive vegetation and add amended soils.</li> <li>Replant the bottom and sides of the facility with native vegetation suitable for a stormwater pond. Add temporary irrigation.</li> <li>Install a WQ manhole upstream of the pond to minimize sediment loading.</li> <li>Install an energy dissipation pad at the pond inlet and outlet.</li> </ul>	\$103,000	-		X		13
17	Siuslaw Water Quality Facility Retrofit	Project replaces failing infrastructure and adds WQ treatment.	<ul style="list-style-type: none"> <li>Addresses maintenance need</li> <li>Increases WQ treatment (Retrofit)</li> </ul>	Alesa/BF Rd 99th/Siuslaw Greenway	Hedges Creek	<ul style="list-style-type: none"> <li>Replace stormwater conveyance system from Boones Ferry to the outfalls at the existing greenway.</li> <li>Install 350 LF of 30-inch-diameter pipe and 100 LF of 48-inch-diameter pipe.</li> <li>Install a flow splitter/WQ manhole.</li> <li>Install or replace 3 catch basins, 2 manholes, and the installation of 5 check dams/energy dissipation.</li> <li>Grade the existing open channel conveyance to serve as a 15-ft-wide by 500-ft-long bioswale.</li> </ul>	\$454,000	\$104,000	X		X	6
18	Water Quality Facility Restoration - Waterford	Project restores a failing public WQ facility.	<ul style="list-style-type: none"> <li>Addresses maintenance need</li> <li>Improves WQ</li> </ul>	Waterford WQ Facility	Hedges Creek	<ul style="list-style-type: none"> <li>Restore a public WQ facility.</li> <li>Clear invasive and unwanted vegetation from the facility.</li> <li>Excavate and regrade as needed to maximize WQ function and restore to original design.</li> <li>Remove accumulated sediment and replace with amended soils.</li> <li>Replant the swale and bottom and sides of the pond facility with native vegetation suitable for a swale and WQ pond. Add temporary irrigation.</li> <li>Relocate and replace the outlet control structure to the edge of pond for improved maintenance access.</li> <li>Replace inlet rip rap for increased energy dissipation.</li> <li>Install two WQ/flow splitter manholes upstream of facility to minimize sediment loading.</li> </ul>	\$180,000	-		X		14
19	Saum Creek Hillslope Repair	Project replaces infrastructure that is in poor condition and addresses existing slope instability.	<ul style="list-style-type: none"> <li>Addresses maintenance need</li> <li>Addresses erosion</li> </ul>	Recent outfall retrofit (Blake St at Saum Creek)	Saum Creek	<ul style="list-style-type: none"> <li>Replace the storm pipe from Makah Ct. to the outfall and outfall reconstruction and extension to the stream channel.</li> <li>Conduct hillslope rehabilitation (rock buttresses or import new fill material) in conjunction with the pipe and outfall replacement to incorporate energy dissipation and be minimize future erosion and slope instability.</li> </ul>	\$171,000	-		X		3
20	Hedges Creek Stream Repair	Project addresses instream channel erosion and threatened public infrastructure.	<ul style="list-style-type: none"> <li>Addresses erosion</li> </ul>	SW 106 <sup>th</sup> Ave and Willow Street at Hedges Creek	Hedges Creek	<ul style="list-style-type: none"> <li>Site 'N': Install an outfall extension, bioengineered slopes, streambed fill and vegetation restoration.</li> <li>Site 'M': Install an open channel excavation, stream bed fill, and installation of a retaining wall.</li> </ul>	\$327,000	-		X		N/A
21	Nyberg Creek Water Quality Facility	Project adds regional WQ treatment.	<ul style="list-style-type: none"> <li>Increases WQ treatment (Retrofit)</li> </ul>	Warm Springs Street at City-owned parcel adjacent to Nyberg Creek	Nyberg Creek	<ul style="list-style-type: none"> <li>Clear invasive and unwanted vegetation; excavate and grade City-acquired property to support facility installation.</li> <li>Install low flow bypass structure, 485 LF of 12-inch diameter pipe, and 275 LF of 24-inch-diameter pipe on Warm Springs Street between Martinazzi Avenue and the facility.</li> <li>Install 4 manholes, 3 catch basins, and inlet leads along Warm Springs Street.</li> <li>Install an approximately 1-acre tiered WQ facility with beehive overflows. A maintenance access road will also be needed.</li> <li>Install a flow control structure and debris forebay in the WQ facility and a high-flow bypass channel around the facility.</li> <li>Install a new open channel conveyance to outfall at Nyberg Creek.</li> </ul>	\$2,037,000	\$265,000	X	X		N/A



This page intentionally left blank.

### 7.2.1 Integrated Project Development

Integrated project development refers to the selection and design of capital projects to address multiple objectives. Project objectives are reflected in Table 7-1 and include:

- Increase system capacity (flood control)
- Address erosion
- Increase water quality treatment (retrofit)
- Improve water quality
- Address maintenance need

Projects identified to improve water quality are associated with existing site or facility modifications/restoration to address a pollutant source issue or improve treatment function and are, therefore, not considered a retrofit.

This SMP used an integrated approach for project identification and development efforts, starting with the initial identification of project needs and Stormwater Project Opportunity Areas and then the consolidation of Stormwater Project Opportunity Areas into single, multi-objective project concepts where possible (Section 3).

An integrated project development approach was specifically used during the water quality opportunity assessment (Section 3.1.1). Capacity and maintenance-related project needs were prioritized when considering opportunities for water quality enhancement and retrofit. As project concepts were developed and refined, continued opportunities for water quality elements were considered and incorporated. Integrated project examples that reflect the combination of capacity and water quality include CIP 2, Nyberg Creek Stormwater Improvements; CIP 3, Sandalwood Water Quality Retrofit; and CIP 17, Siuslaw Water Quality Facility Retrofit.

The maintenance assessment also recognized that certain capacity-related deficiencies may also be addressed through maintenance-related activities. Integrated project examples reflecting capacity and maintenance related project needs include CIP 4, Mohawk Apartment Stormwater Improvements; and CIP 7, Boones Ferry Railroad Conveyance Improvements.

### 7.2.2 Sizing and Design Assumptions

Capital project sizing and design assumptions were based on the type of improvement proposed. Sizing and design assumptions generally followed the City's Public Works Standards and/or CWS's Design and Construction Standards (2012) or LIDA Handbook (2009).

Project concepts are reflective of an approximate 10% design level. Conceptual layout and design considerations are included in the project fact sheets (Appendix A).

- **Capacity Projects.** Projects to construct new conveyance infrastructure or replace existing conveyance infrastructure were developed following the City's PW Standards. All capacity projects in this SMP were sized for the 25-year, 24-hour design event. Although system surcharging is not permissible per the City's design standards, given the flat grade of much of the existing City infrastructure, system surcharging was deemed permissible for capital projects.
- **Water Quality Projects.** Water quality projects were generally designed according to CWS's LIDA Handbook. Proprietary system vendors were contacted to verify sizing where proprietary treatment systems were proposed (i.e., CIP Nos. 2, 8, and 9). As select retrofit projects could not be reasonably sized within area constraints to manage the full water quality treatment flow/volume, facility sizing was based on maximizing water quality treatment within the available area (i.e., CIP 21).

- **New Infrastructure.** Several projects require new infrastructure in locations where no storm system exists. Conceptual layouts are illustrated in the project fact sheets (Appendix A) and reflect new infrastructure proposed in the public ROW only; however, detailed design must consider/allow for potential utility conflicts and realignment needs. Survey will be required to verify elevations and locations. Final design may require additional structures, an alternate alignment due to conflicts, or deeper or shallower pipes than assumed for the conceptual project design.

### 7.2.3 Cost Assumptions

Project costs are based on the total capital investment necessary to complete a project (i.e., engineering through construction). Costs are based on the proposed layout and general design assumptions as documented in the project fact sheets (Appendix A).

Unit prices for construction elements are based on recent bid tabs and previous local stormwater master planning efforts, adjusted for 2018 based on a historical cost index. The current RS Means *Book for Site Work and Landscaping* was referenced for material costs not previously identified. Cost estimates presented in this SMP are AACE Class 5 Conceptual Level or Project Viability Estimates. Actual costs may vary from these estimates between -50 percent to +100 percent, although changes to design may result in cost differences outside of this anticipated range.

Preliminary cost estimates were based on the unit cost information for construction elements plus a 30 percent construction contingency and multipliers to account for mobilization/demobilization, traffic control and utility relocation, and erosion control. Engineering and permitting costs (15 to 35 percent) and construction administration costs (10 percent) were applied as a general percentage to the total construction cost with contingencies. The range in engineering and permitting costs were based on the anticipated permitting level of effort, including whether in-water work is anticipated, which would warrant environmental permitting efforts in conjunction with Section 404 of the CWA. For planning purposes, costs were rounded to the nearest \$1,000.

Land acquisition and easement costs were not included in the estimates, as most projects are located on City property or within the City right-of-way.

Appendix G includes the unit cost table developed for this SMP and the planning-level cost estimates for each project. Staffing resource assumptions to implement these projects are described in Section 8.1.1.

## 7.3 Program Recommendations

Six program needs were identified to address water quality, stream health, system maintenance, and asset management of stormwater infrastructure.

During the programmatic activity workshop (Section 6.2), City staff reviewed cost assumptions associated with implementing the proposed programs. Program costs vary based on existing City funding levels and coverage or extent of activity anticipated. Table 7-2 summarizes the resulting program cost summary, accounting for the City's current annual funding obligations.

<b>Program Activity</b>	<b>Current Annual Obligation <sup>a</sup></b>	<b>Proposed Program Cost</b>	<b>Project Duration Assumptions</b>	<b>Additional Program Funding (annual) <sup>b</sup></b>
Pipe R/R Program	\$25,000	\$125,000	100-years	\$100,000
Structure R/R Program	\$19,400	\$120,000	100-years	\$100,000
Public WQ Facility Maintenance Program	\$25,000	\$150,000	Ongoing	\$125,000
Public WQ Facility Retrofit Program	N/A	\$75,000	Ongoing	\$75,000
Stream Vegetation Management	N/A	\$100,000	Ongoing	\$100,000
Single Family LIDA Inspection Program	N/A	N/A	10-year	N/A

a. Refer to Table 6-2.

b. Based on subtraction of the current annual obligation. Assumes that the current annual obligation will be maintained in the future.

Cost assumptions by program are detailed below. Staffing resources to implement these proposed programs are described in Section 8.1.2.

- Pipe R/R Program.** Cost assumptions were based on replacing 486,000 LF of public storm line over a 100-year planning period (i.e., 1 percent of pipes replaced annually). Pipe replacement costs assumed a consistent size distribution as the current inventory. Present worth analysis indicated an annual cost between \$1 million and \$1.25 million would be required; however, due to ongoing pipe replacement efforts and unknowns related to lifespan, the City opted to allocate approximately 10 percent of the annually calculated amount (\$125,000) for budgeting purposes. The additional annual allocation was \$100,000, assuming a current annual allocation of \$25,000.

Efforts should first establish a baseline system condition from current CCTV results. R/R efforts should be prioritized based on condition assessment and reported deficiencies.

- Structure Repair and Replacement Program.** Cost assumptions were based on replacing or restoring public catch basins, ditch inlets, flow control structures, and manholes over a 100-year planning period (i.e., 1 percent of structures replaced annually). Replacement costs assumed consistent facility distribution as reflected in the City’s current asset inventory. Restoration costs assumed a lump sum of \$2,000 per structure. Present worth analysis indicated an annual cost between \$140,000 to \$240,000 would be required; however, due to ongoing structure replacement efforts and unknowns related to lifespan, the City opted to allocate 50 percent of the maximum annually calculated amount for budgeting purposes (\$120,000). The additional annual allocation is \$100,000, assuming a current annual allocation of approximately \$20,000.
- Public Water Quality Facility Maintenance Program.** Cost assumptions considered both routine (minor) and restorative needs for public water quality facilities. Typical extensive/restorative facility maintenance ranges from \$75,000 to \$100,000 (based on cost estimates developed for projects as part of this Plan). Routine maintenance efforts can vary (assume \$50,000). The total annual allocation proposed is \$150,000. The additional annual allocation is \$125,000, assuming a current annual allocation of \$25,000.

Efforts should prioritize facilities currently identified by staff as requiring maintenance (see Section 6.2.2).


- Public Water Quality Retrofit Program.** Costs are based on anticipated annual efforts to identify potential retrofit opportunities annually, respond to public inquiries, conduct preliminary facility sizing, and provide oversight of detailed design/construction. Funds may be used internally or contracted externally. The total proposed annual allocation is \$75,000 and should prioritize



locations currently identified by staff or additional retrofit opportunities identified by CWS during their review of this Plan (see Section 6.2.3 and Appendix I).

- **Stream Vegetation Management Program.** Cost assumptions were based on removing 0.5 acres of invasive vegetation per year at a unit cost of \$4.60/square foot (sf). The total proposed annual allocation is \$100,000. Funds may be used internally or contracted externally.
- **Single-Family LIDA Inspection Program.** Costs assumed an expanded number of private stormwater facility inspections (10 additional facilities with a 10 percent annual increase). Staff resources are required, and a proposed annual fund allocation is not included.



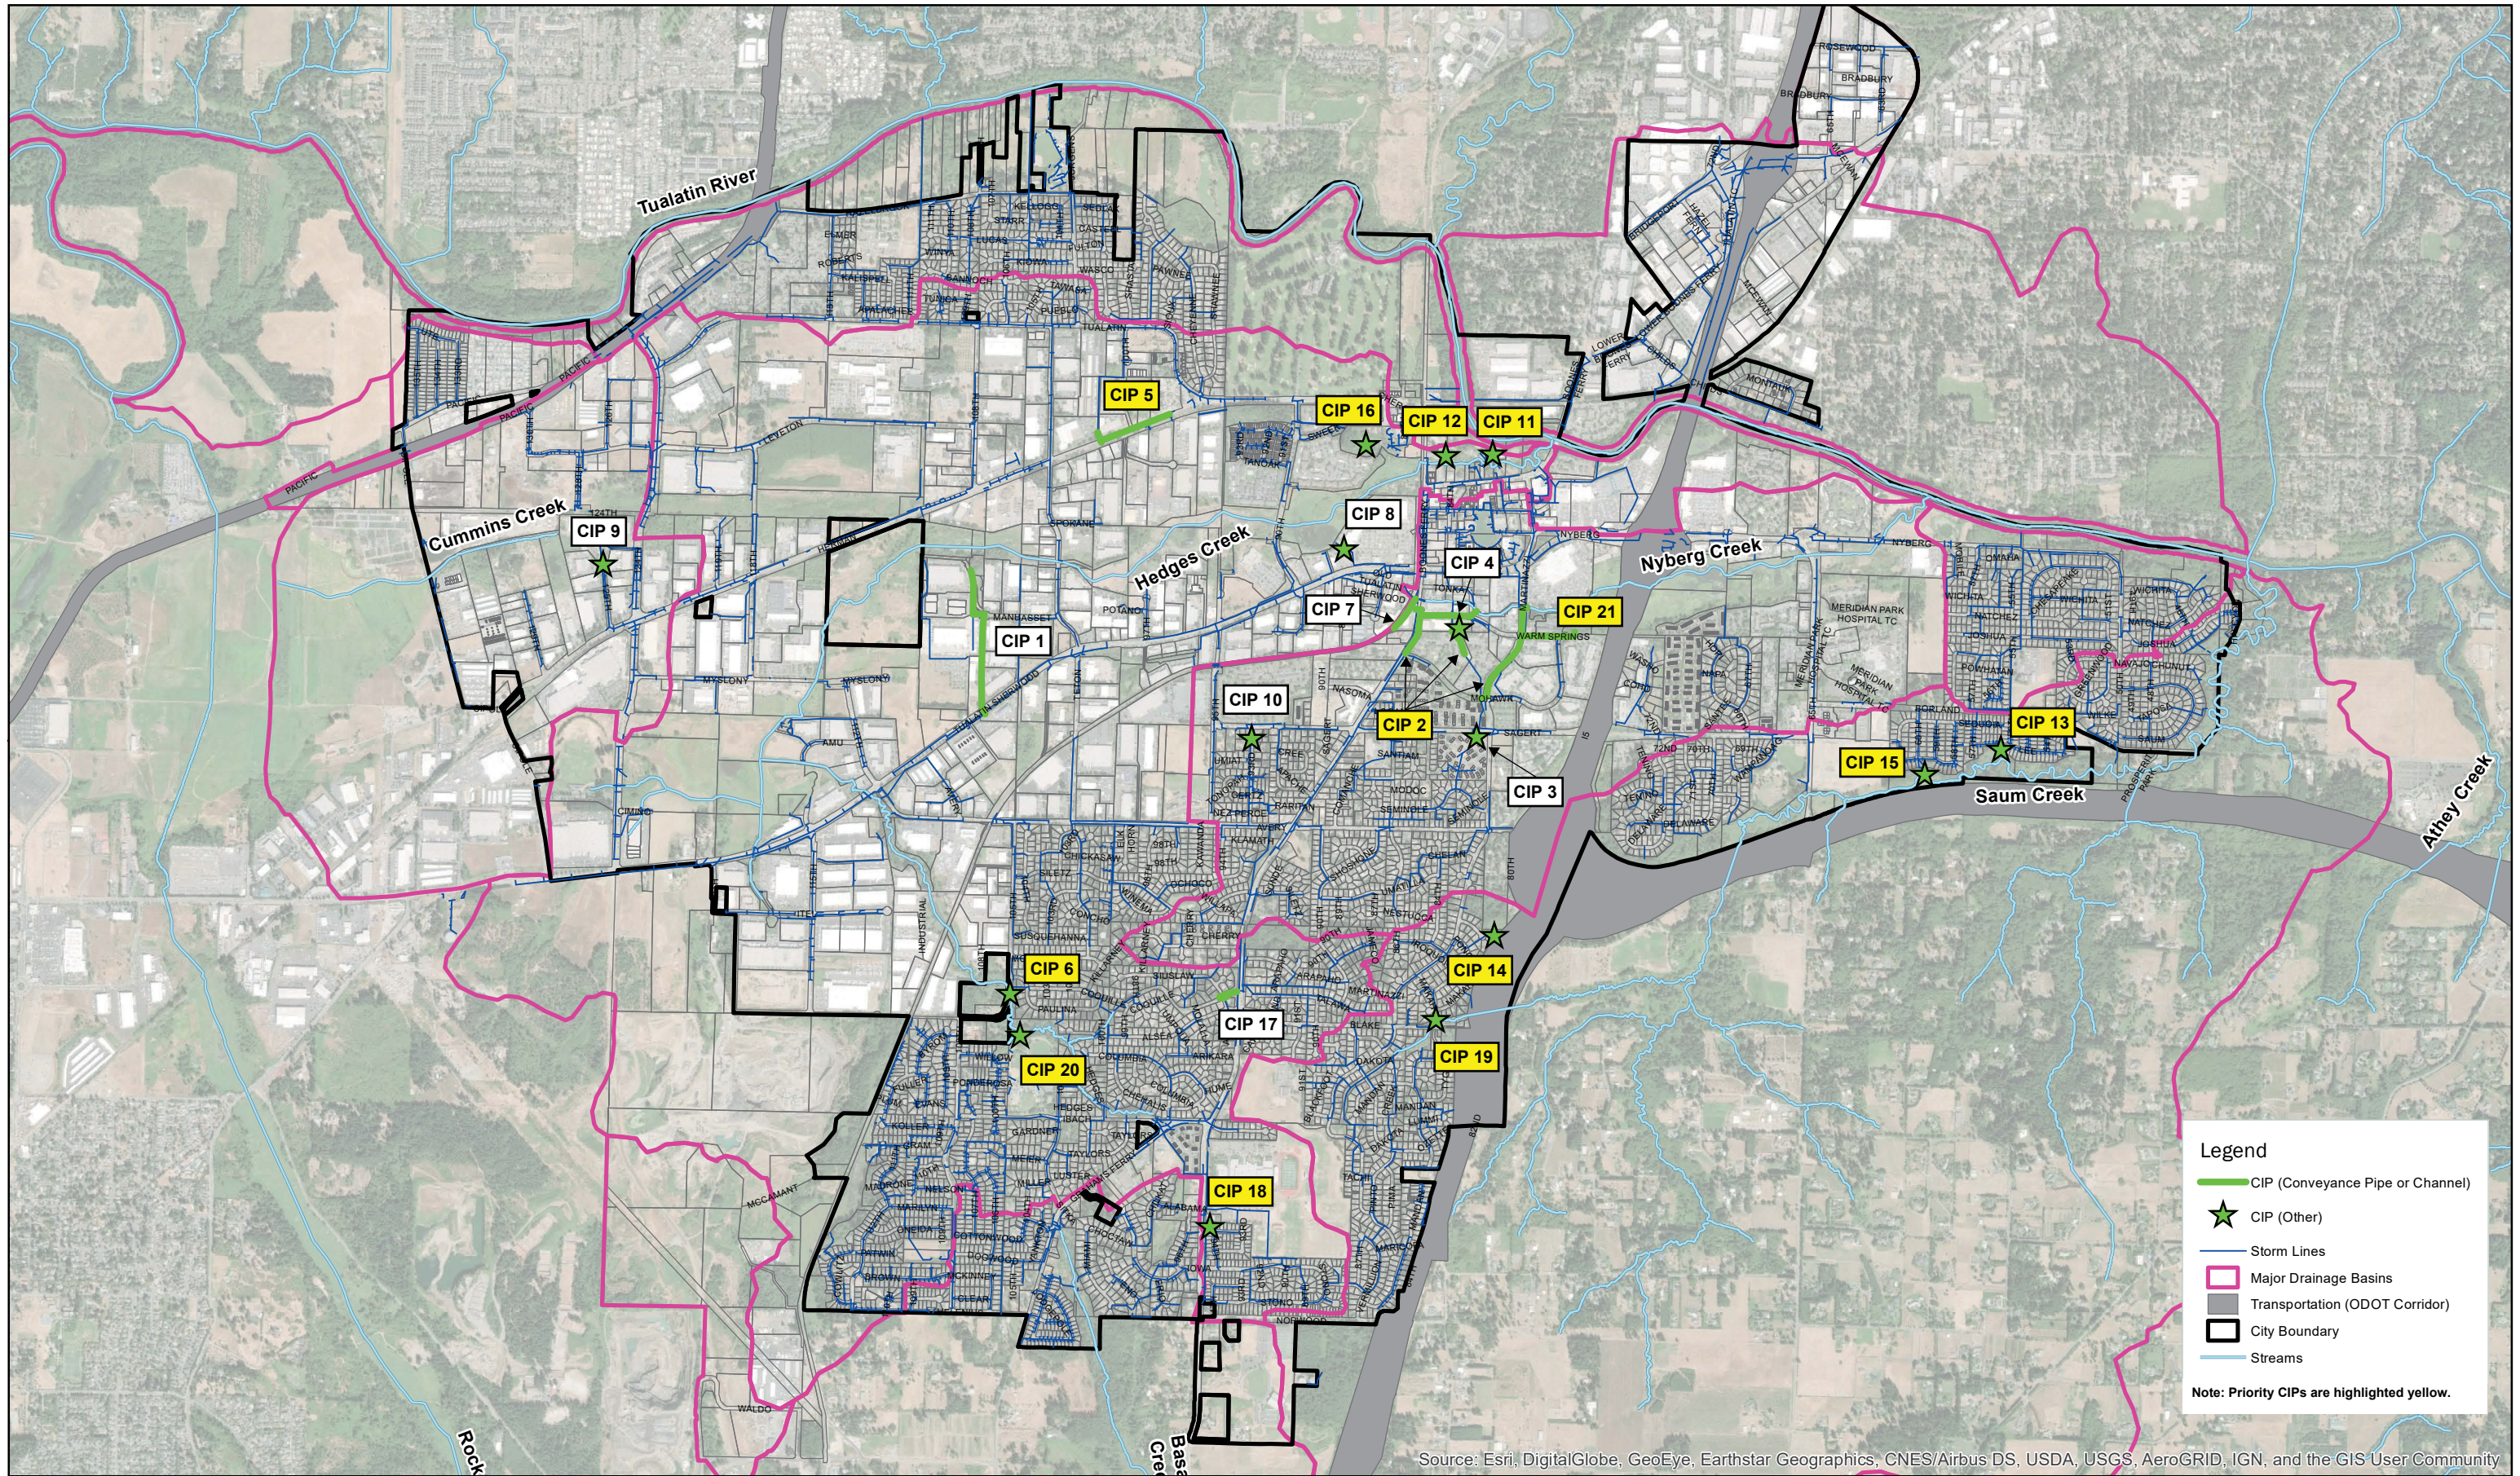



## Section 8

# Implementation

This SMP includes a financial evaluation to determine rate adjustments required to implement projects and programs identified in this Plan.

This section provides an overview of staffing needs, project prioritization, operational costs and established levels of service (LOS) reflected in the stormwater utility rate and SDC evaluation. This section also summarizes results of the rate evaluation.

### 8.1 Staffing Analysis

The City's public works department includes seven FTEs in engineering and six FTEs in operations that currently support stormwater project and program needs. Current staffing levels are considered adequate to support existing commitments, project obligations, and program implementation, but an increase in staff resources is needed to implement capital projects and programs proposed under this SMP.

Appendix H, Table H-1 summarizes the comprehensive results of the staffing analysis for purposes of informing the financial evaluation. Staffing needs for capital projects were incorporated directly into the project cost, while staffing needs for programs were estimated for each individual program. A total of 0.6 FTEs (administration, engineering and maintenance staff) is required to implement all projects identified in this SMP over a 10-year implementation period. A total of 0.4 FTEs is required to implement proposed programs over the next 10-year implementation period. If the City intends to implement only priority projects over the next 10-year implementation period, a total of 0.7 FTEs is required to implement priority projects and all proposed programs (see Section 8.2 for discussion of priority project needs).

#### 8.1.1 Capital Project Staffing Assumptions

For capital projects, additional staffing needs are anticipated to support capital project administration, project management, and the ongoing maintenance of new assets. Staffing estimates to support capital projects were based solely on the conversion of the construction administration cost to an FTE based on an annual salary (cost) equivalent of \$150,000. The total FTE estimate to implement capital projects was then converted to an annual staff allocation based on a 10-year implementation period. Construction administration costs are estimated at 10 percent of the capital expense subtotal (see Appendix G for detailed cost estimates by project).

For reference purposes only, Table H-1 also includes an estimate of maintenance staff time, based on the new infrastructure proposed with the capital project, to support the capital project implementation. Although maintenance staff time was accounted for with the staffing calculation for capital projects described above, it is recognized that select capital projects may require maintenance outside of the City's current maintenance obligations and frequencies to ensure optimum performance, while other capital projects that include replacing existing infrastructure may not require additional maintenance activities, as the existing infrastructure would already be maintained.

Table 8-1 summarizes the maintenance-related cost assumptions used to summarize the estimated maintenance staff needs. The City does not currently track maintenance activities or log maintenance staff hours in time sheets or as part of an asset management program; therefore, maintenance staff time assumptions were based on typical rates and confirmed with City staff. Maintenance staffing resource needs are calculated in hours and converted to an FTE, based on a typical FTE workload of 2,080 hours.

<b>Table 8-1. Maintenance Staff Time Summary</b>		
<b>Maintenance Activity</b>	<b>Average Time Calculation</b>	<b>Maintenance Frequency</b>
Pipe/open channel conveyance cleaning	20' /hour	Annual
Outfall debris removal	4 hours/outfall	Annual
Catch basin maintenance	1 hour/facility	Annual
Water quality facility (swale) maintenance	20' /hour	Annual
Water quality facility (StormFilter or CDS) maintenance	6 hours/facility	Annual
Water quality facility (planter or raingarden) maintenance	50 square feet/hour	Annual
Water quality facility (WQ manhole) maintenance	1 hour/facility	Biannual
Water quality facility inspections	1 hour/facility	Quarterly

Please note that engineering and permitting costs (estimated between 15 and 35 percent of the capital expense subtotal) were included in the capital project cost estimates but not reflected in the staffing costs. The City currently assumes that all engineering and permitting activities will be contracted, so additional staff time to perform engineering and permitting services is not reflected in the staffing analysis.

### **8.1.2 Program Staffing Assumptions**

For select programs, there may also be an increase in engineering and/or maintenance staff needs; however, there are many considerations that would influence staffing levels.

Program-specific estimates of additional engineering and maintenance staff resource needs are listed in Table 8-2 and have been summarized in Appendix H, Table H-1. In general, maintenance and R/R programs require additional engineering staff to evaluate and identify project locations and needs, review maintenance/CCTV records, and contract needed repairs. Additional maintenance staff resources are needed to expand condition assessment efforts to structures.

Costs for implementing an expanded public water quality facility maintenance program, public water quality facility retrofit program, and vegetation management program are estimated as a lump sum that may be spent either on contracted or internal support. Thus, additional staff resources are limited to engineering support, and additional maintenance needs have not been separately identified. Implementing an expanded water quality facility inspection program for single-family LIDA is a staff activity, and the cost is solely accounted for in the staffing analysis.

**Table 8-2. Annual Program Staffing Needs**

Program Activity	Proposed Program Cost <sup>a</sup>	Additional Funding Need <sup>a</sup>	Additional Staffing Resources (Engineering)	Additional Staffing Resources (Maintenance)
Pipe R/R Program	\$125,000	\$100,000	<ul style="list-style-type: none"> <li>0.10 FTE (review and evaluate pipe based on CCTV results, identify additional CCTV needs, PM and contract repairs).</li> <li>Design and construction to be contracted per proposed program funding.</li> </ul>	N/A
Structure R/R Program	\$19,400	\$100,000	<ul style="list-style-type: none"> <li>0.10 FTE (review and evaluate structures based on condition assessment, PM and contract repairs).</li> <li>Design and construction to be contracted per proposed program funding.</li> </ul>	0.10 FTE (vector in support of inspections, site prep, and coordination).
Public WQ Facility Maintenance Program	\$25,000	\$125,000	<ul style="list-style-type: none"> <li>0.05 FTE (identify and document maintenance needs, PM and contract management).</li> <li>Design and construction to be contracted per proposed program funding.</li> </ul>	N/A (efforts to be contracted)
Public WQ Facility Retrofit Program	N/A	\$75,000	N/A	N/A
Stream Vegetation Management	N/A	\$100,000	N/A	N/A (efforts to be contracted)
Single Family LIDA Inspection Program	N/A	N/A	0.05 FTE (conduct additional inspections assuming 10% annual increase).	N/A

a. Refer to Table 7-2.

## 8.2 Project Prioritization

Project prioritization is an important component of the stormwater master planning process and can provide direction in terms of sequencing projects in accordance with City objectives.

The prioritization process was initiated during the programmatic activity workshop (Section 6-2). Example prioritization criteria and scoring methods (qualitative versus quantitative) were provided to City staff to guide their internal process. The City opted to focus prioritization efforts on defining priority projects to be funded over the next 10-year implementation period and not on numeric scoring and specific ranking of projects. Over time, the City may choose to add numeric scoring metrics or weighting factors to refine projects for scheduling or to place more emphasis on specific criteria as new project needs are identified and added to the capital improvement program. Table 8-3 summarizes the general prioritization criteria provided and used by the City as part of its prioritization process.

Table 8-3. Prioritization Criteria		
Criteria	Scoring Definition	
	High (H)	Lower (L)
Flooding Issue/ Safety Concern	<ul style="list-style-type: none"> <li>Addresses an area of known or significant capacity deficiency or erosion potential.</li> <li>Was identified as flooding during existing conditions per targeted hydraulic modeling.</li> </ul>	No reported flooding concerns or safety issues associated with project location.
WQ Improvement	<ul style="list-style-type: none"> <li>Project significantly improves water quality and wildlife habitat.</li> <li>Project may be classified as a retrofit per CWS.</li> </ul>	Project moderately improves or doesn't improve water quality and wildlife habitat.
Maintenance	<ul style="list-style-type: none"> <li>Project will reduce existing maintenance needs or complaints.</li> <li>Project provides increased longevity for facility function.</li> </ul>	Occasional maintenance needs or complaints occur in this area.
Concurrence	<ul style="list-style-type: none"> <li>Project is required or a prerequisite for other budgeted or inter-jurisdictional projects.</li> </ul>	Project is stand-alone and does not affect implementation of other City projects.
Special Interest	<ul style="list-style-type: none"> <li>Project has City Council, City staff, or public interest/motivation.</li> </ul>	Project has no public driver or interest.

City staff independently evaluated projects in conjunction with prioritization guidelines and criteria and determined those highest priority projects for implementation over the next 10 years. A summary of capital projects and costs, including an indication of those priority projects, is provided in Table 8-4.

Table 8-4. Capital Project Costs and Priorities			
Priority Project	CIP Number	CIP Name	Cost Estimates
	1	Manhassat Storm System Improvements	\$1,581,000
X (Phase 1)	2	Nyberg Creek Stormwater Improvements (Phases 1-3)	\$3,412,000
	3	Sandalwood Water Quality Retrofit	\$107,000
	4	Mohawk Apartments Stormwater Improvements	\$295,000
X	5	Herman Road Storm System	\$1,023,000
X	6	Blake St Culvert Replacement	\$552,000
	7	Boones Ferry Railroad Conveyance Improvements	\$515,000
	8	89th Avenue Water Quality Retrofit	\$262,000
	9	125th Court Water Quality Retrofit	\$206,000
	10	93rd Avenue Green Street	\$224,000
X	11	Juanita Pohl Water Quality Retrofit	\$156,000
X	12	Community Park Water Quality Retrofit	\$158,000
X	13	Water Quality Facility Restoration - Venetia	\$65,000
X	14	Water Quality Facility Restoration - Piute Court	\$104,000
X	15	Water Quality Facility Restoration - Sequoia Ridge	\$83,000
X	16	Water Quality Facility Restoration - Sweek Drive Pond	\$103,000
	17	Siuslaw Water Quality Facility Retrofit	\$454,000
X	18	Water Quality Facility Restoration - Waterford	\$180,000
X	19	Saum Creek Hillslope Repair	\$171,000
X	20	Hedges Creek Stream Repair	\$327,000
X	21	Nyberg Water Quality Retrofit	\$2,037,000
		<b>Total</b>	\$12,015,000
		<b>Total (Priority projects only)</b>	\$6,482,000



### 8.3 Level of Service

Developing the stormwater rate evaluation requires the City to determine a level of service consistent with the expectations of the City's stormwater program and ratepayers.

Using project cost information, program cost information, and estimated operational funding expenditures, City staff identified the proposed LOS for stormwater-related services. The proposed LOS assumes construction of priority capital projects within a 10-year timeframe. Program expenditures are funded at recommended levels (see Table 7-2). Staffing needs are identified based on implementing priority projects only and all program elements. Operational costs were provided by City staff and account for vehicle replacement needs and rehabilitation of the City's operations building.

Table 8-5. Current and Recommended Level of Service (Criteria)		
Criteria	Current LOS	Recommended LOS
<b>Capital Project Implementation</b>		
Stormwater Project Implementation (CIPs)	Implement stormwater capital projects in conjunction with City's 2017-2021 Capital Improvement Plan	Implement priority stormwater capital projects per this SMP in a 10-year planning window
<b>Program Implementation (Annual Cost)</b>		
Pipe R/R	Maintain current funding for repair needs	Expand repair efforts into an R/R program.
Structure R/R	Maintain current funding for repair needs	Expand repair efforts into an R/R program.
Public WQ Facility Maintenance Program	Conduct or contract out minor maintenance needs.	Expand maintenance program to include routine and restorative efforts.
Public WQ Facility Retrofit Program	N/A	Add program
Stream Vegetation Management	N/A	Add program
<b>Equipment/Operational Costs (Annual Cost)</b>		
Vehicle/Equipment Replacement <sup>a</sup>	Variable	Assume annual funding to replace vehicles (cost share with sanitary)
Operations Building Rehabilitation <sup>b</sup>	N/A	\$50,000
<b>Staffing (associated with priority capital projects and programs) (FTE)</b>		
Staffing (engineering)	Maintain existing staffing resources	Increase engineering staffing resources by 0.52 FTE to support priority projects and programs.
Staffing (maintenance)	Maintain existing staffing resources	Increase maintenance staffing resources by 0.24 FTE to support priority projects and programs.

a. The vector truck replacement is budgeted at \$310,000 in FY 2019/20. Following FY 2019/20, vehicle replacement is budgeted at \$75,000/year.

b. Annual cost provided by City.

### 8.4 Funding Evaluation

In conjunction with development of this Plan, a review of the City's stormwater utility rate and SDC was conducted. Documentation of the financial evaluation is provided in a separate TM.

This page intentionally left blank.



## Section 9

# References

- Basalt Creek Concept Plan, <http://www.basaltcreek.com> (accessed July 24, 2018).
- City of Portland. 2010. Guidance: Living with American Beaver (*Caster canadensis*). Version 1. City of Portland Terrestrial Ecology Enhancement Strategy. Environmental Services,” October. <https://www.portlandoregon.gov/bes/article/354182> (accessed November 2018).
- City of Tualatin, *Public Works Standards*, Section 206, 2013.
- City of Tualatin, *Capital Improvement Plan 2017 to 2021*, 2016.
- Clean Water Services, *Stormwater Management Plan*. 2016.
- Clean Water Services (2019). Stormwater and Grading Service Standards. April 2019.
- “DEQ 303(d) database,” <http://www.deq.state.or.us/wq/assessment/rpt2012/search.asp#db>. Accessed April 17, 2017.
- Greenworks and CH2MHill, *Hedges Creek Master Plan*, July 2002.
- Greenworks and OTAK, *Hedges Creek Stream Assessment and Cost Estimate*, February 2018.
- King County 2018a, “Beaver Management Devices”, <https://www.kingcounty.gov/services/environment/animals-and-plants/beavers/Resources.aspx> (accessed November 2018, and January 2018).
- King County 2018b, “Beaver Management Solutions Matrix”, February 2018, [https://kingcounty.gov/~media/environment/animalsAndPlants/beavers/Beaver\\_management\\_matrix\\_KingCountyWA\\_2-2018.ashx?la=en](https://kingcounty.gov/~media/environment/animalsAndPlants/beavers/Beaver_management_matrix_KingCountyWA_2-2018.ashx?la=en). (accessed November 2018).
- King County 2018c, “Beaver Management Technical Paper #1: Beaver Management Tools Literature Review and Guidance”, 2017, revised April 2018, <https://your.kingcounty.gov/dnrp/library/2018/kcr2944/kcr2944.pdf>, (accessed November 2018).
- ODFW, “Living with Wildlife: American Beaver Fact Sheet”, December 2009, [https://www.dfw.state.or.us/wildlife/living\\_with/docs/beaver.pdf](https://www.dfw.state.or.us/wildlife/living_with/docs/beaver.pdf), (accessed November 2018).
- ODFW, “ODFW Guidelines for Relocation of Beaver in Western Oregon,” May 2010, <http://library.state.or.us/repository/2010/201006071625481/index.pdf>, (accessed November 2018).
- ODFW, “Requirements for Relocation of Beaver in Oregon”, December 2017, [https://www.dfw.state.or.us/wildlife/living\\_with/docs/Oregon\\_Beaver\\_Relocation\\_Requirements\\_Forms.pdf](https://www.dfw.state.or.us/wildlife/living_with/docs/Oregon_Beaver_Relocation_Requirements_Forms.pdf), (accessed November 2018).
- Oregon Department of Environmental Quality (DEQ), National Pollutant Discharge Elimination System (NPDES) Watershed-based Waste Discharge Permit, Issued to Clean Water Services, Effective May 31, 2016. <https://www.census.gov/quickfacts/fact/table/tualatincityoregon/PST045217>, accessed July 26, 2018). <https://www.tualatinoregon.gov/community/tualatin-history> (accessed July 24, 2018). <https://www.tualatinoregon.gov/planning> (accessed July 24 ,2018).

<https://weatherspark.com/m/768/11/Average-Weather-in-November-in-Tualatin-Oregon-United-States> and <https://www.bestplaces.net/climate/city/oregon/tualatin>, (accessed July 24, 2018).

Soil Conservation Service, *Urban Hydrology for Small Watersheds*, Technical Release 55, June 1986.

Wikipedia, City of Tualatin, [https://en.wikipedia.org/wiki/Tualatin,\\_Oregon](https://en.wikipedia.org/wiki/Tualatin,_Oregon) (accessed July 24, 2018).

## Section 10

# Limitations

This document was prepared solely for City of Tualatin in accordance with professional standards at the time the services were performed and in accordance with the contract between City Tualatin and Brown and Caldwell dated April 14, 2016. This document is governed by the specific scope of work authorized by City of Tualatin; it is not intended to be relied upon by any other party except for regulatory authorities contemplated by the scope of work. We have relied on information or instructions provided by City of Tualatin and other parties and, unless otherwise expressly indicated, have made no independent investigation as to the validity, completeness, or accuracy of such information.




This page intentionally left blank.

## Appendix A: CIP Fact Sheets

---



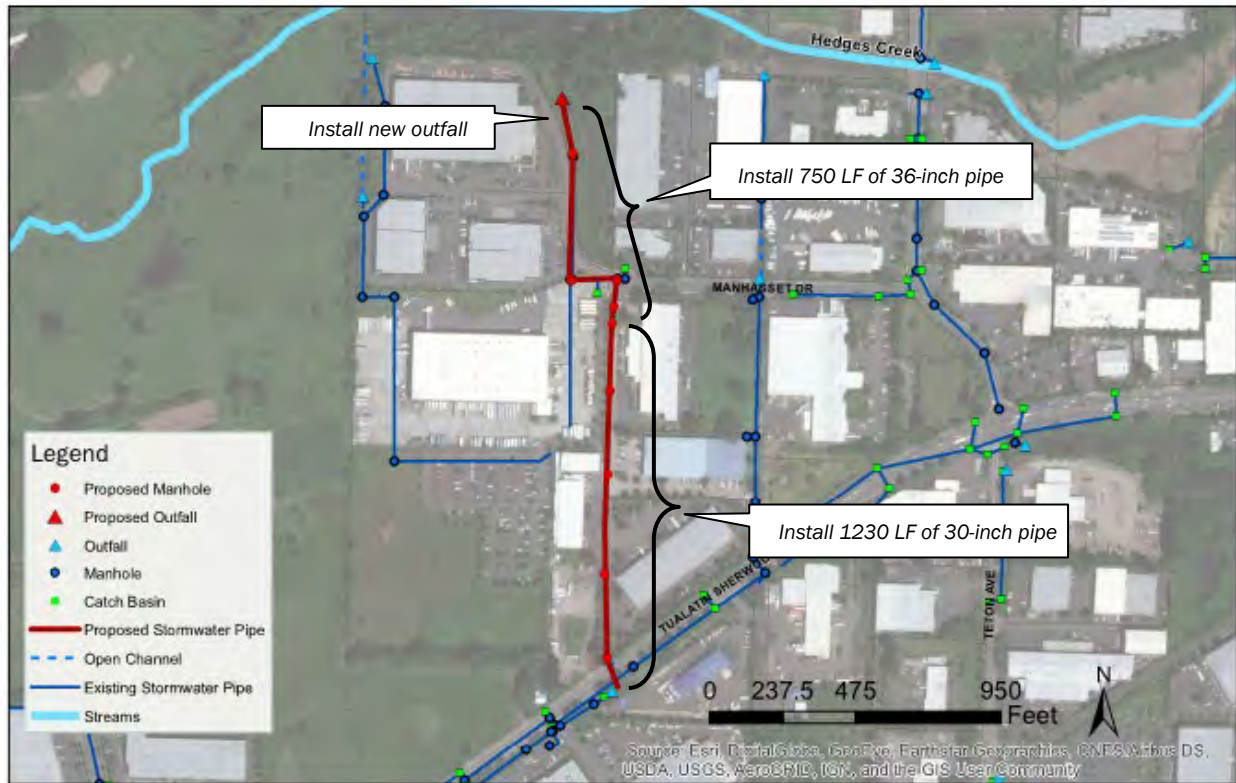

Project Identifier	CIP #1
Project Name	Manhasset Storm System Improvements
Detailed Location	Manhasset Drive
Model File	HE_MA_ALT05.xp
Contributing Drainage Area	41.4 acres
Estimated Existing /Future Impervious %	64.0%/73.4%
Project Objective(s)	Increases System Capacity (Flood Control)

**Project Background**

City staff and residents have reported frequent flooding of the open conveyance channel between private properties from Tualatin-Sherwood Road to Manhasset Drive. Stormwater flows have exceeded the capacity of the channel, overtopping the banks of the channel and impacting adjacent parking lots and structures.

During a site visit in June 2016, debris from nearby properties was found in the channel. Curbs separating the channel and surrounding private property had been removed, allowing additional stormwater to enter the channel. Flow is further restricted due to large hydraulic losses associated with the ditch inlet at the end of Manhasset Drive and the shallow slope of the pipes downstream to the outfall at Hedges Creek.

The current conveyance system consists of 1,050 linear feet (LF) of open channel, 180 LF of 21-inch-diameter pipe and 750 LF of 27-inch-diameter pipe.

Hydraulic modeling of the system confirms the channel and pipe system is undersized for the contributing drainage area.

**Project Description**

This project addresses localized flooding by piping the existing open channel conveyance and upsizing select pipe segments.

This project replaces the existing 1,050 LF of open channel and 180 LF of 21-inch-diameter pipe with 1,230 linear feet (LF) of 30-inch-diameter pipe. The project replaces the existing 750 LF of 27-inch-diameter pipe from Manhasset Drive to the outfall to Hedges Creek with 750 LF of 36-inch-diameter pipe to reduce potential flooding during the 25-year design storm event.

The project also includes landscaping, the installation of nine manholes (five along the open channel alignment will have grated lids), and a new outfall to Hedges Creek.

**Design Considerations**

- Only planning-level hydraulic calculations have been performed to identify conceptual sizing. For design, detailed topographic survey and hydraulic analysis is needed to determine the appropriate invert elevations and pipe diameters to maintain necessary cover depth in this flat terrain.
- Due to the shallow grade of the proposed pipe in the lower portions of the installed system, sediment accumulation may present a maintenance issue and will require regular attention to ensure proper drainage and to prevent flooding.

**Planning-level Cost Estimate**

Capital Expense Total (including contingency)	\$ 1,171,000
Engineering and Permitting (25%)	\$ 293,000
Administration (10%)	\$ 117,000
<b>Capital Project Implementation Cost Total*</b>	<b>\$ 1,581,000</b>

*\*Planning level cost estimates estimated in 2018 dollars, rounded to the nearest thousand. The rounded total cost is based on non-rounded subtotals.*

**Additional Project Information**



Image 1. Observed flooding of drainage ditch during December 2015 storm




Image 2. Grated inlet and rock lined channel at downstream end of drainage ditch





Image 3. Contributing drainage area



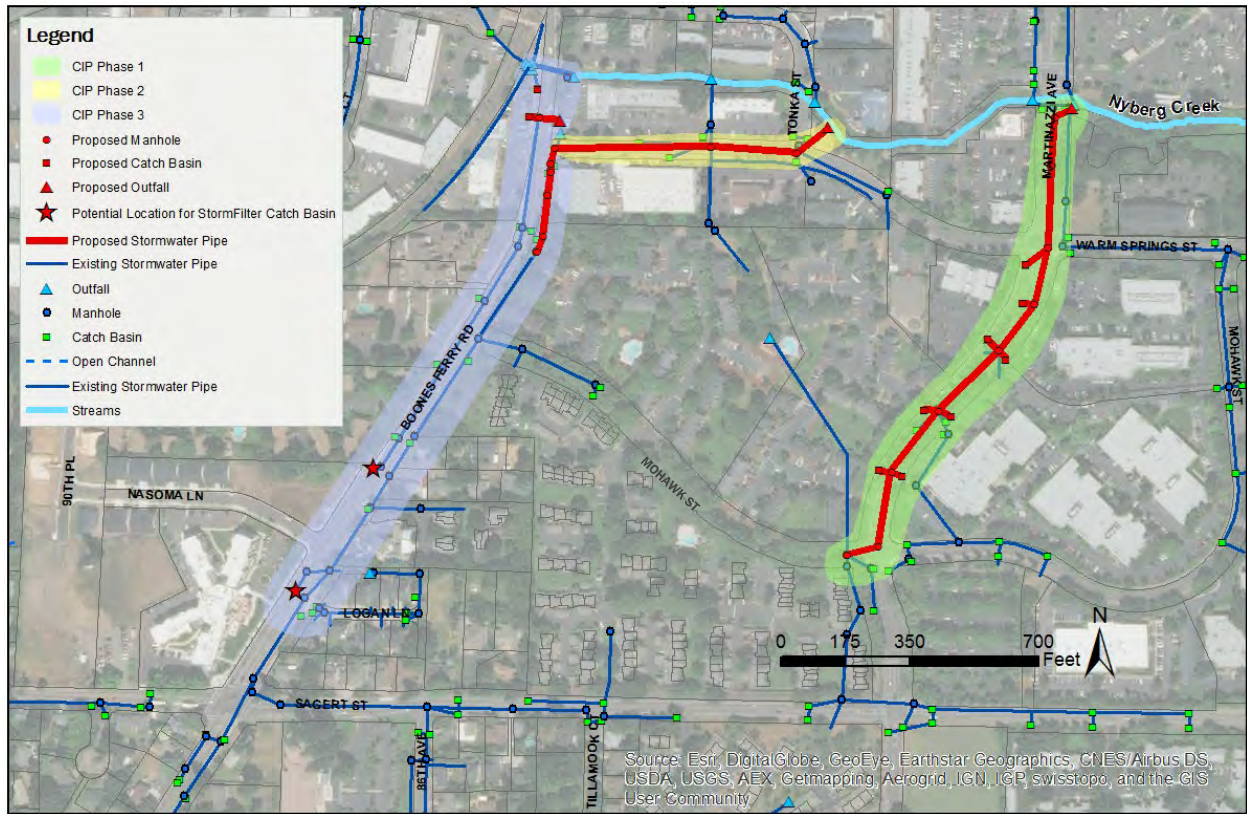

Project Identifier	CIP #2
Project Name	Nyberg Creek Stormwater Improvements
Detailed Location	Nyberg Creek between Boones Ferry Road and Martinazzi Avenue
Model File	NY_ALT06.xp
Contributing Drainage Area	443.2 acres
Estimated Existing /Future Impervious %	47.4%/56.4%
Project Objective(s)	Increases System Capacity (Flood Control), Increases Water Quality Treatment (Retrofit)

**Project Background**

City staff and the public have identified routine flooding along Boones Ferry Road. The affected area, from Boones Ferry Road to Martinazzi Avenue, is relatively flat, contains aging infrastructure, and requires frequent maintenance to remove accumulated sediment. Gravel and railway ballast debris transported from the nearby railroad open conveyance channel (see CIP #7) accumulates in this portion of the storm system.

Hydraulic modeling of the system confirms that undersized pipes near the intersections of Warm Springs Street and Boones Ferry Road and Warm Springs Street and Tonka Street contribute to roadway flooding. Two StormFilter catch basin units located on Boones Ferry Road, north of Warm Springs Street, are located at a roadway sag and regularly clog due to accumulated sediment, which also contributes to roadway flooding.

**Project Description**

This project alleviates localized flooding between Boones Ferry Road and Martinazzi Avenue by upsizing undersized pipe segments, relocating StormFilter catch basin units, and rerouting stormwater flow from select areas away from locations experiencing routine flooding.

Due to the significant cost and extent of the project, the project has been broken into three phases. Phase 1 includes installation of a new trunkline down Martinazzi Avenue from Mohawk Street to Nyberg Creek. Phase 2 includes installation of a 48-inch pipe along Warm Springs Street and a new outfall to Nyberg Creek. Phase 3 includes upsizing the existing storm system along Boones Ferry Road and diversion of flow to the new system on Warm Springs Street. Phases should be constructed in consecutive order.

Detailed activities by phase are listed below:

### Phase 1

Phase 1 must first be constructed to redirect approximately 51 acres of contributing drainage area from areas prone to flooding at Warm Springs Street and Tonka Street. This phase is also recommended prior to implementation of CIP #4 (Mohawk Apartments Stormwater Improvements). This phase includes the following:

- Disconnection of the existing stormwater system from the south at Mohawk Street.
- Replacement of existing infrastructure on Martinazzi with 1500 LF of 24-inch pipe from existing node 263397 (CIP system naming is 263397\_NY-0290) to existing node 270963.
- Installation of 9 manholes and 8 catch basins along Martinazzi Avenue. 440 LF of 12-inch inlet leads are also reflected in the cost estimate for the connection of new and existing catch basins.
- Construction of a new outfall to Nyberg Creek east of the bridge crossing with Martinazzi Avenue.

It is recommended that Phase 1 be completed in conjunction with the anticipated repair of the sanitary sewer system along this section of roadway to minimize disturbance and costs.

### Phase 2

Phase 2 increases capacity of the stormwater system down Warm Springs Street to support redirection of flow from Boones Ferry Road. This phase includes the following:

- Installation of 800 LF of 48-inch pipe down Warm Springs Street from existing node 270971 to new outfall (CIP system naming is Node569) to route flow west to east.
- Installation of 4 manholes and 5 connections to existing infrastructure for the new pipe down Warm Springs Street.
- Construction of a new outfall to Nyberg Creek, northeast of the intersection of Tonka Street and Warm Springs Street.

### Phase 3

Phase 3 reflects infrastructure modifications necessary to connect to new infrastructure installed during Phase 2. Hydraulic modeling shows that the four pipe sections on the east side of Boones Ferry Road south of Warm Springs Street are under capacity. This phase includes the following:

- Replacement of 250 LF of 30-inch pipe with 250 LF of 36-inch pipe from 262848 to 262844 and replacement of 75 LF of 36-inch pipe with 75 LF of 42-inch pipe from 262844 to a new manhole at the intersection of Boones Ferry Road and Warm Springs Street.
- Replacement of 60 LF of 18-inch pipe across Boones Ferry Road with 60 LF of 24-inch pipe.
- Installation of 6 manholes down Boones Ferry Road.
- Removal and replacement of the two existing StormFilter units on Boones Ferry Road with sumped catch basins. Sumped catch basins are recommended due to the high sediment load this area experiences.
- Installation of at least two StormFilter catch basins further south on Boones Ferry Road (see potential locations indicated in Figure 3). These new StormFilter units should treat a contributing drainage area equal to or larger than the drainage area associated with the removed units. The units shall be configured in an offline orientation to tie into existing infrastructure. 150 LF of 12-inch inlet leads are also reflected in the cost estimate for the connection of new StormFilter catch basins.

### Design Considerations

- Construction phasing should follow the phase schedule outlined above and consider project concurrence in conjunction with other CIPs (i.e., CIP #4, CIP #7).
- Detailed downstream analysis of the Nyberg Creek system is in progress. Proposed outfall locations were identified based on observed capacity in the open channel system and conceptual-level hydraulic modeling.
- A preliminary hydraulic model of proposed infrastructure and system modifications demonstrates a significant decrease in flooding for events up to the 25-year design storm.
- Only planning level calculations have been performed to identify conceptual layout and system sizing. Detailed topographic survey is needed to determine appropriate invert elevations and verify pipe diameters to maintain necessary cover and convey the design event.

Planning-level Cost Estimate		
Phase 1	Capital Expense Total (including contingency)	\$ 1,051,000
	Engineering and Permitting (35%)	\$ 368,000
	Administration (10%)	\$ 105,000
	<b>Capital Project Implementation Cost Total*</b>	<b>\$ 1,523,000</b>
Phase 2	Capital Expense Total (including contingency)	\$ 863,000
	Engineering and Permitting (35%)	\$ 302,000
	Administration (10%)	\$ 86,000
	<b>Capital Project Implementation Cost Total*</b>	<b>\$ 1,252,000</b>
Phase 3	Capital Expense Total (including contingency)	\$ 472,000
	Engineering and Permitting (25%)	\$ 118,000
	Administration (10%)	\$ 47,000
	<b>Capital Project Implementation Cost Total*</b>	<b>\$ 637,000</b>
<b>Total</b>	<b>Capital Project Implementation Cost Total*</b>	<b>\$ 3,412,000</b>

\*Planning level cost estimates estimated in 2018 dollars, rounded to the nearest thousand. The rounded total cost is based on non-rounded subtotals.

Additional Project Information

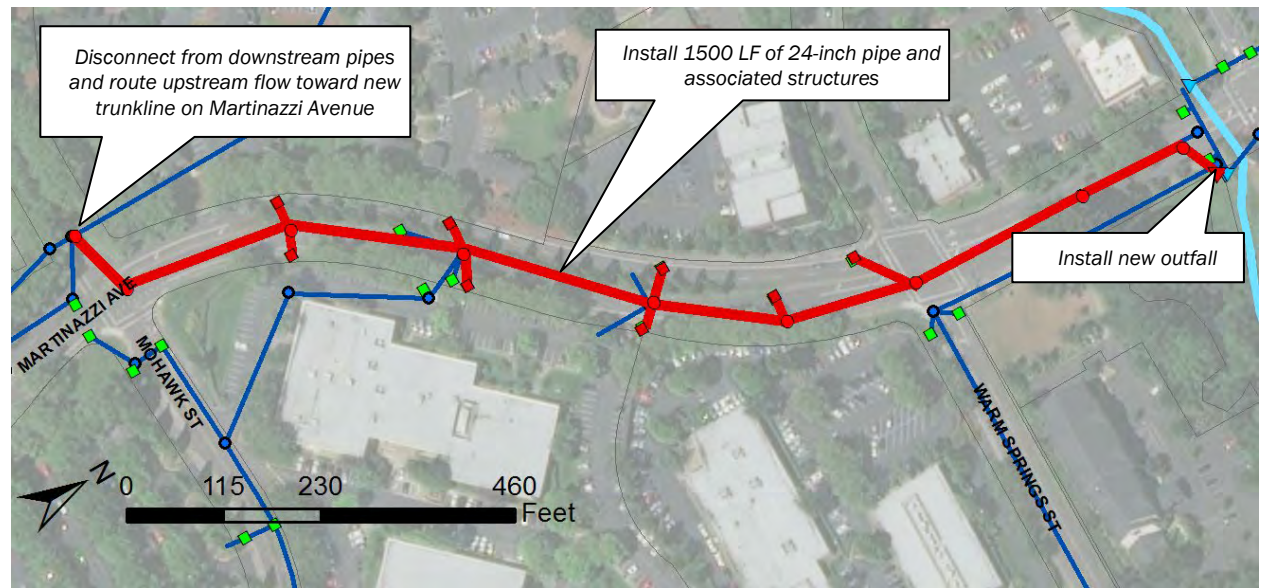


Figure 1. Construction details of Phase 1

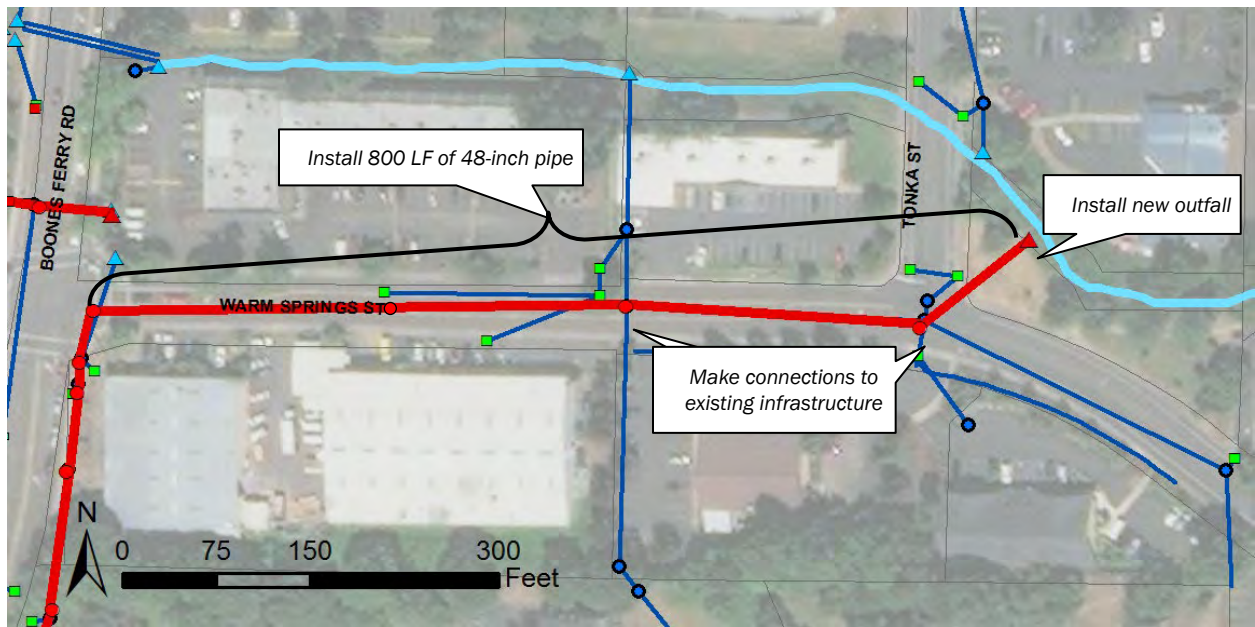


Figure 2. Construction details of Phase 2


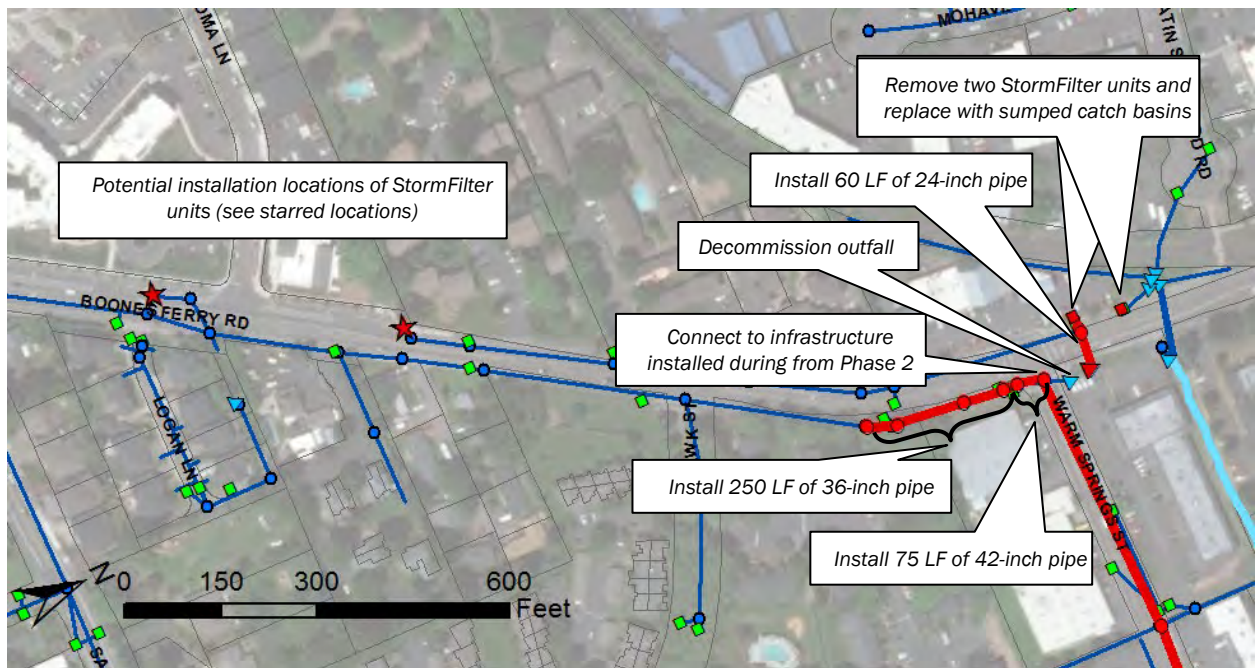


Figure 3. Construction details of Phase 3

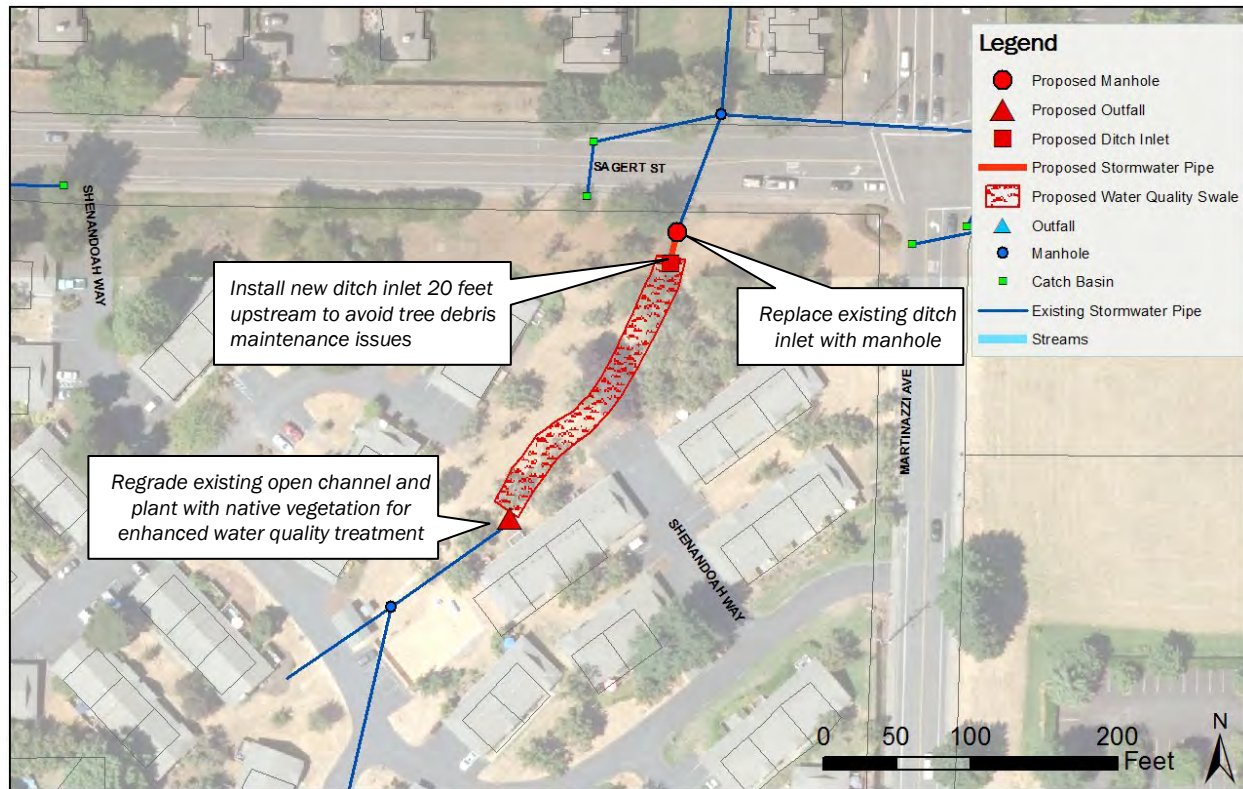

Project Identifier	CIP #3
Project Name	Sandalwood Water Quality Retrofit
Detailed Location	Sagert Street and Martinazzi Avenue
Model File	N/A
Contributing Drainage Area	37.6 acres
Estimated Existing/Future Impervious %	43.3%/53.3%
Objective(s) Addressed	Addresses Erosion; Increases Water Quality Treatment (Retrofit)

**Project Background**

The Sandalwood Condominiums have a piped stormwater system that outfalls to a 220-foot-long open channel conveyance on the north side of the property. The conveyance channel discharges to a ditch inlet (260393) adjacent to Sagert Street.

City staff identified erosion and capacity concerns related to the open channel conveyance system. This project site was also identified during a water quality retrofit evaluation as a potential stormwater treatment facility retrofit. The open channel conveyance system experienced flooding in December 2015, likely due to debris from a nearby tree clogging the ditch inlet. During a site visit in June 2016, incision and bank sloughing were observed, especially near the upstream end of the open channel.

**Project Description**

This project addresses erosion concerns by regrading the existing open channel conveyance and adding plantings for enhanced water quality treatment.

This project includes widening and regrading of the existing open channel conveyance to increase capacity and minimize erosion along its banks. The resulting 10' wide by 220' long swale will include amended soils and vegetation enhancement to improve water quality treatment function and enhance visual appeal.

The outfall to the channel will be reinforced with rip rap to dissipate the energy as the stormwater exits the upstream collection system. Check dams will be installed to reduce velocities and enhance water quality treatment through the system.

A new ditch inlet will be installed, twenty feet south of its current location, to prevent debris accumulation. The existing ditch inlet (260393) will be replaced with a manhole and 20 LF of 30-inch pipe will connect the new ditch inlet to the manhole. The manhole may be installed with a grated lid to act as an emergency overflow.

**Design Considerations**

- Facility sizing and design is based on the Clean Water Services Low Impact Development Approaches (LIDA) Handbook and should be referenced for design guidelines on water quality swales.
- Final swale alignment should consider potential grading impacts to the existing trees.
- Only planning level calculations have been performed to identify conceptual layout and sizing. For design, detailed topographic survey is needed to determine the extent of grading required and appropriate invert elevations to maintain necessary slope and convey the design event.

**Planning-level Cost Estimate**

Capital Expense Total (including contingency)	\$ 79,000
Engineering and Permitting (25%)	\$ 20,000
Administration (10%)	\$ 8,000
<b>Capital Project Implementation Cost Total*</b>	<b>\$ 107,000</b>

*\*Planning level cost estimates estimated in 2018 dollars, rounded to the nearest thousand. The rounded total cost is based on non-rounded subtotals.*

**Additional Project Information**

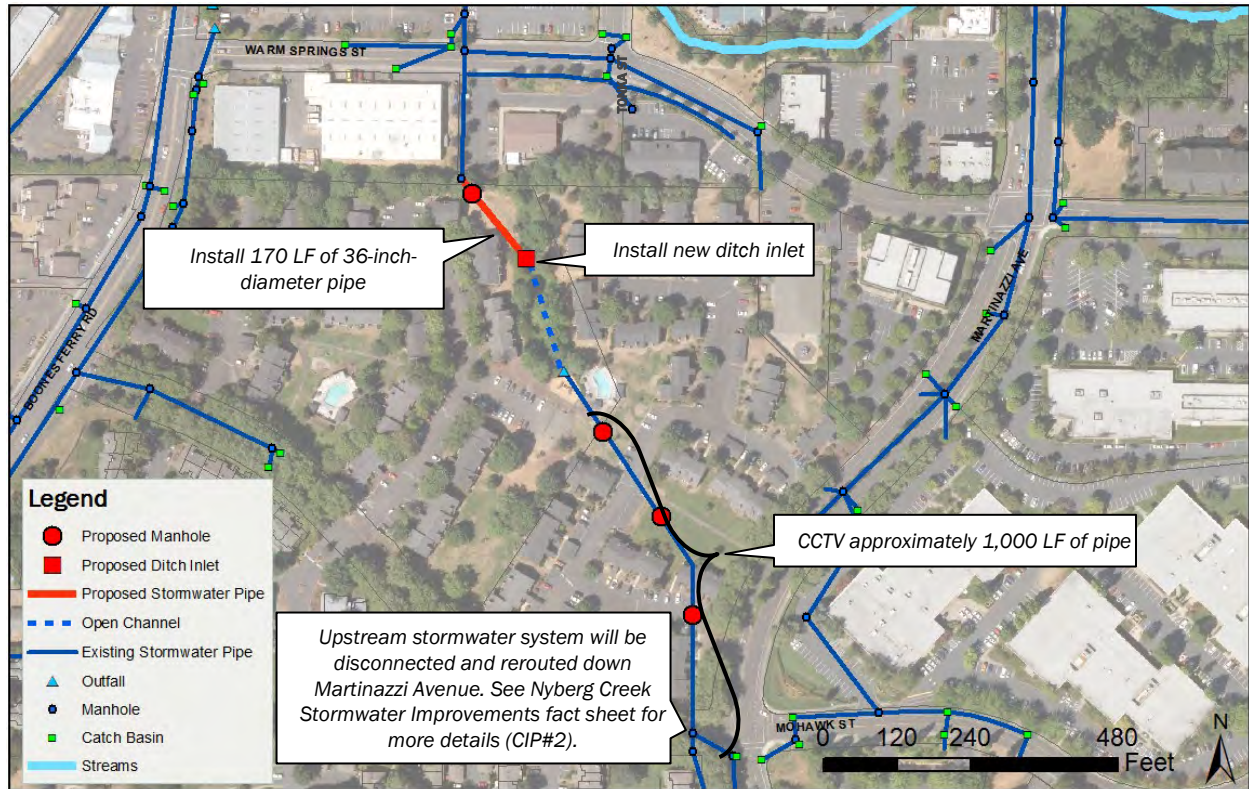


Image 1. Incision and sloughing in the open channel



Image 2. Tree debris clogging the ditch inlet at the downstream end of the open channel





<b>Project Identifier</b>	CIP #4
<b>Project Name</b>	Mohawk Apartments Stormwater Improvements
<b>Detailed Location</b>	8325 SW Mohawk Street
<b>Model File</b>	N/A
<b>Contributing Drainage Area</b>	8.9 acres <sup>1</sup>
<b>Estimated Existing /Future Impervious %</b>	49.1%/58.8%
<b>Objective(s) Addressed</b>	Increases System Capacity (Flood Control); Addresses Maintenance Need

**Project Background**

City staff identified the stormwater system through the Mohawk Apartments as capacity limited. The section of pipe from west of the intersection with Martinazzi Avenue and Mohawk Street to the open conveyance channel has an unknown alignment, condition, material and unverified size. The alignment shown on the figure above is an approximation based on the City’s GIS data.

The existing ditch inlet (260409) downstream from the open channel is undersized during high flow events and bypasses down the adjacent embankment, causing flooding at the intersection of Tonka Street and Warm Springs Street and impacting downstream private properties along Warm Springs Street. The corrugated metal pipe downstream of the ditch inlet is in poor condition according to City staff and requires replacement.

**Project Description**

This project alleviates localized flooding and replaces aging and deteriorating infrastructure. Localized flooding is also addressed in part by CIP #2 (Nyberg Creek Stormwater Improvements).

This project includes 1,000 linear feet (LF) of CCTV video inspection to determine/ verify the pipe condition, location, material and size west of the intersection of Martinazzi Avenue and Mohawk Street to the existing open channel conveyance. Three manholes will be installed along this pipe alignment for maintenance access. This pipe will remain in service to convey drainage from the Todd Village Apartments.

<sup>1</sup> Contributing drainage area reflects disconnection of the upstream stormwater system at Sagert Street and routed down Martinazzi Avenue in accordance with the Nyberg Creek Stormwater Improvements (CIP # 2)

Downstream of the open channel, a new ditch inlet will be installed to replace the existing grated inlet. Limited earthwork and invasive vegetation removal will be conducted to regrade the channel and direct flow to the inlet. 170 LF of corrugated metal pipe will be removed and replaced with 170 LF of 36-inch-diameter HDPE pipe.

**Design Considerations**

- Project scheduling should consider the Nyberg System Improvements (CIP #2), as stormwater flows to this system will be reduced as part of that project due to disconnection and rerouting of the upstream stormwater conveyance pipe down Martinazzi Avenue.
- Easement acquisition has not been included in this cost estimate.
- Based on the results of the CCTV inspection, the section of pipe from Mohawk Street to the open channel may need to be replaced or rehabilitated with cure-in-place pipe lining or similar. This repair is not included in this cost estimate.
- Ongoing sediment removal and vegetation management is required to maintain capacity in the open channel system. Regular maintenance should be conducted.

**Planning-level Cost Estimate**


Capital Expense Total (including contingency)	\$ 218,000
Engineering and Permitting (25%)	\$ 55,000
Administration (10%)	\$ 22,000
<b>Capital Project Implementation Cost Total*</b>	<b>\$ 295,000</b>

*\*Planning level cost estimates estimated in 2018 dollars, rounded to the nearest thousand. The rounded total cost is based on non-rounded subtotals.*

**Additional Project Information**



**Image 1. Grated inlet and open channel near Mohawk Apartments**

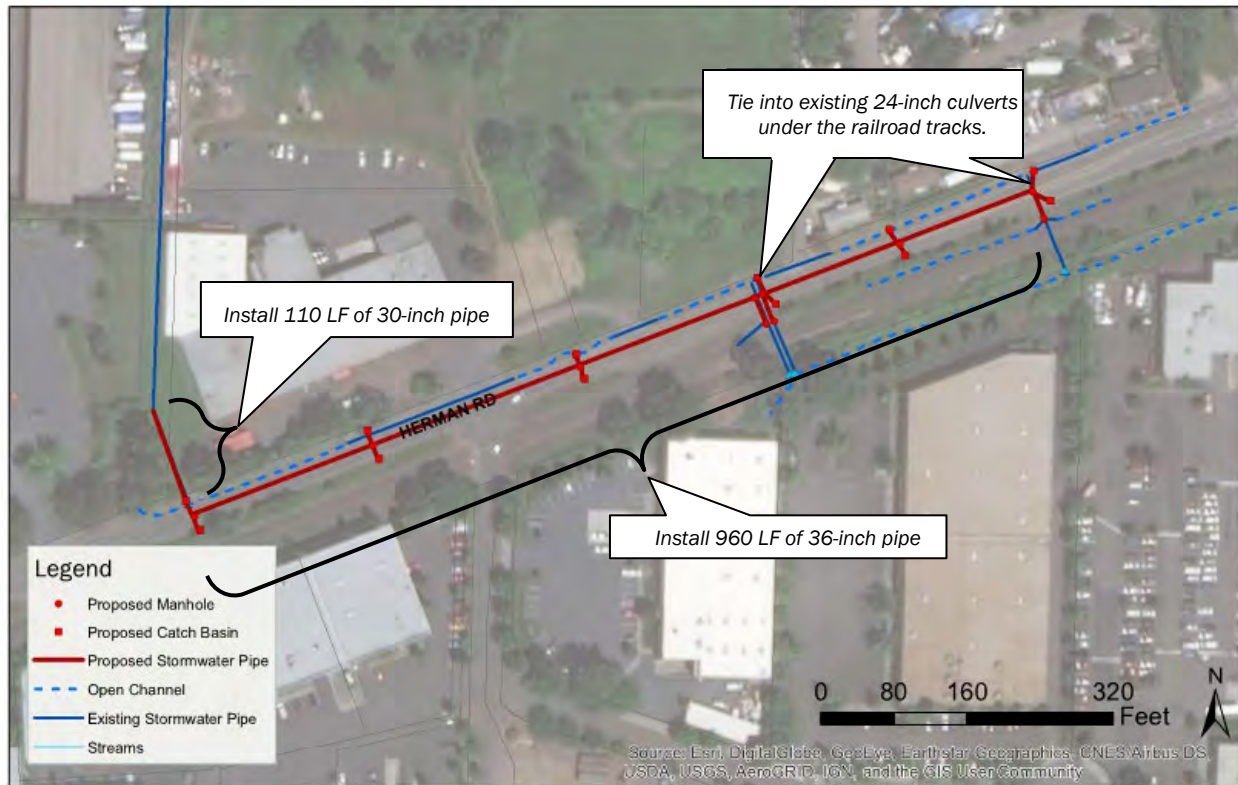

Project Identifier	CIP #5
Project Name	Herman Road Storm System
Detailed Location	Herman Road between Teton Avenue and Tualatin Road
Model File	HE_HE_ALT01.xp
Contributing Drainage Area	42.6 acres
Estimated Existing/Future Impervious %	56.1%/71.3%
Objective(s) Addressed	Increases System Capacity (Flood Control)

**Project Background**

The stormwater system along Herman Road receives runoff from 42.6 acres of industrial and medium density residential land use. The area is subject to frequent flooding due to limited grade and a lack of drainage infrastructure. Stormwater is conveyed via roadside ditches and open channels to culverts under the adjacent railroad right-of-way. The railroad culverts are deeper than the upstream and downstream infrastructure, creating a hydraulic constraint and backwater effects along the northern side of Herman Road.

City staff identified Herman Road as a future roadway widening project and drainage improvements are needed in conjunction with roadway design.

Hydraulic modeling of the existing conveyance system confirms that the elevation of the railroad culverts results in backwater effects and flooding of the open channel/ditch system along Herman Road. The existing ditches and culverts along Herman Road also appear to be undersized for the contributing drainage areas and design flows.

**Project Description**

This project provides guidance towards design of a stormwater collection and conveyance system associated with future Herman Road improvements.

This project includes installation of 110 linear feet (LF) of 30-inch-diameter pipe from existing node 322601 to the centerline of Herman Road and 960 LF of 36-inch-diameter pipe down Herman Road to collect and convey runoff from Herman Road and the surrounding contributing area, replacing the existing open channel/ditch conveyance system. Consideration of the final road vertical profile and pipe cover should be incorporated into the design. This project includes the installation of 10 manholes, 4 connections to existing stormwater pipes/culverts, and 12 catch basins with an associated 420 LF of 12-inch inlet leads.

To maximize slope and utilize the current pipe alignment under the railroad tracks, the existing culverts under the railroad will act as the low points for the new conveyance system.

**Design Considerations**

This project has been sized for the 25-year storm event. Due to the elevation of the railroad culverts, the proposed layout is anticipated to surcharge at the 2-year storm event.

Only planning-level hydraulic calculations have been performed to identify conceptual sizing. For design, detailed topographic survey and hydraulic analysis is needed to determine appropriate invert elevations and verify pipe diameters to maintain necessary cover and convey the design event.

Project design and construction to occur in conjunction with the roadway widening project. Water quality treatment for new and replaced impervious surface and asphalt resurfacing associated with the pipe installation is not reflected in project cost and will be addressed with roadway design.

Due to the shallow grade of the proposed pipe, sediment accumulation may present a maintenance issue and will require regular attention to ensure proper drainage to prevent flooding.

Planning-level Cost Estimate	
Capital Expense Total (including contingency)	\$ 758,000
Engineering and Permitting (25%)	\$ 189,000
Administration (10%)	\$ 76,000
<b>Capital Project Implementation Cost Total*</b>	<b>\$ 1,023,000</b>

\*Planning level cost estimates estimated in 2018 dollars, rounded to the nearest thousand. The rounded total cost is based on non-rounded subtotals.

**Additional Project Information**

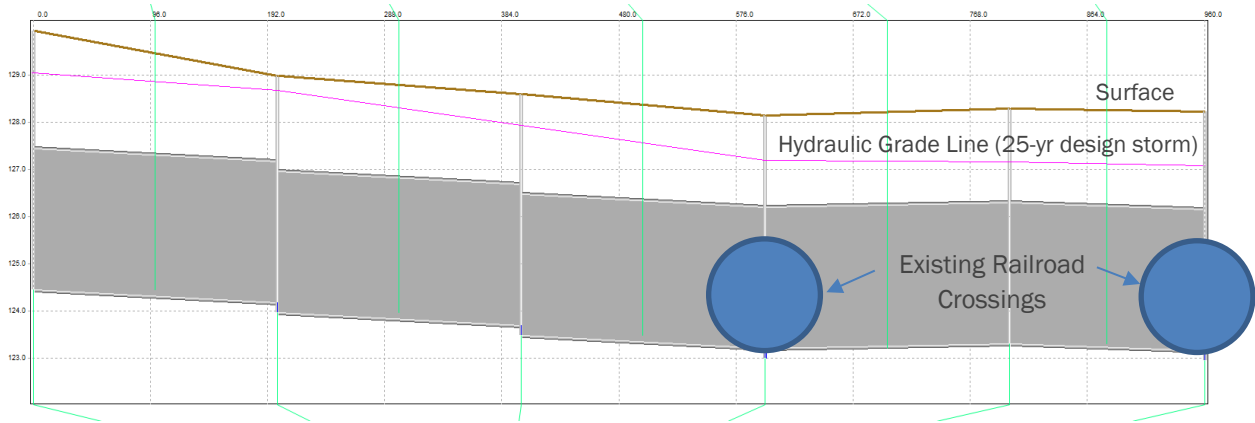


Image 1. Proposed pipe layout along Herman Road



Image 2. Ditch along the northern side of Herman Road



Project Identifier	CIP #6
Project Name	Blake Street Culvert Replacement
Detailed Location	Blake Street and 105 <sup>th</sup> Avenue
Model File	HE_BL_ALT02.xp
Contributing Drainage Area	414.0 acres
Estimated Existing/Future Impervious %	38.3%/46.8%
Objective(s) Addressed	Increases System Capacity (Flood Control); Addresses Erosion

**Project Background**

The existing culvert under 105th Avenue is reported to be undersized by City staff. The upstream end is routinely blocked with debris. The culvert is located along Hedges Creek in a mostly residential neighborhood.

The existing layout of the stream channel creates 90-degree bends on either side of the culvert which are reinforced by rock and concrete walls to prevent bank erosion. The upstream rock wall is failing due to erosive flows impacting the road embankment. 105th Avenue is unimproved and a roadway widening, and improvement project is in the planning stages.

**Project Description**

This project provides guidance towards sizing and design of a replacement culvert at Blake Street and 105<sup>th</sup> Avenue associated with the future 105<sup>th</sup> Avenue roadway improvements.

The project will replace the existing culvert with an 84-inch culvert, sized to convey the 100-year design storm flow. The new culvert will be installed along the natural stream alignment, roughly a 45-degree angle under the road, to optimize the movement of water downstream, reduce hydraulic losses due to the 90-degree bends upstream and downstream of the culvert, decrease erosion potential, and reduce the potential for debris and sediment accumulation. Design and construction should occur with scheduled roadway improvements.

**Design Considerations**

Only planning-level hydraulic calculations have been performed to identify conceptual sizing. For design, detailed topographic survey and hydraulic modeling is needed to verify culvert sizing and determine appropriate invert elevations to maintain necessary cover and convey the design event.

Local roadway drainage collection and water quality infrastructure design will be completed in conjunction with roadway improvements. The vertical curve of the current roadway alignment and elevation difference between the current roadway surface and the stream channel is not sufficient to provide cover for the proposed 84-inch replacement culvert.

Per Oregon Department of Fish and Wildlife feedback in 2017, this reach of Hedges Creek is not fish bearing and fish passage design is not necessary. However, agencies such as the Army Corps of Engineers, Division of State Land, and Department of Environmental Quality may have additional design and permitting requirements not reflected in the current project cost.

**Planning-level Cost Estimate**

Capital Expense Total (including contingency)	\$ 381,000
Engineering and Permitting (35%)	\$ 133,000
Administration (10%)	\$ 38,000
<b>Capital Project Implementation Cost Total*</b>	<b>\$ 552,000</b>

*\*Planning level cost estimates estimated in 2018 dollars, rounded to the nearest thousand. The rounded total cost is based on non-rounded subtotals.*


**Additional Project Information**



Image 1. Downstream end of culvert with rock/concrete wall for erosion prevention



Image 2. Upstream end of culvert

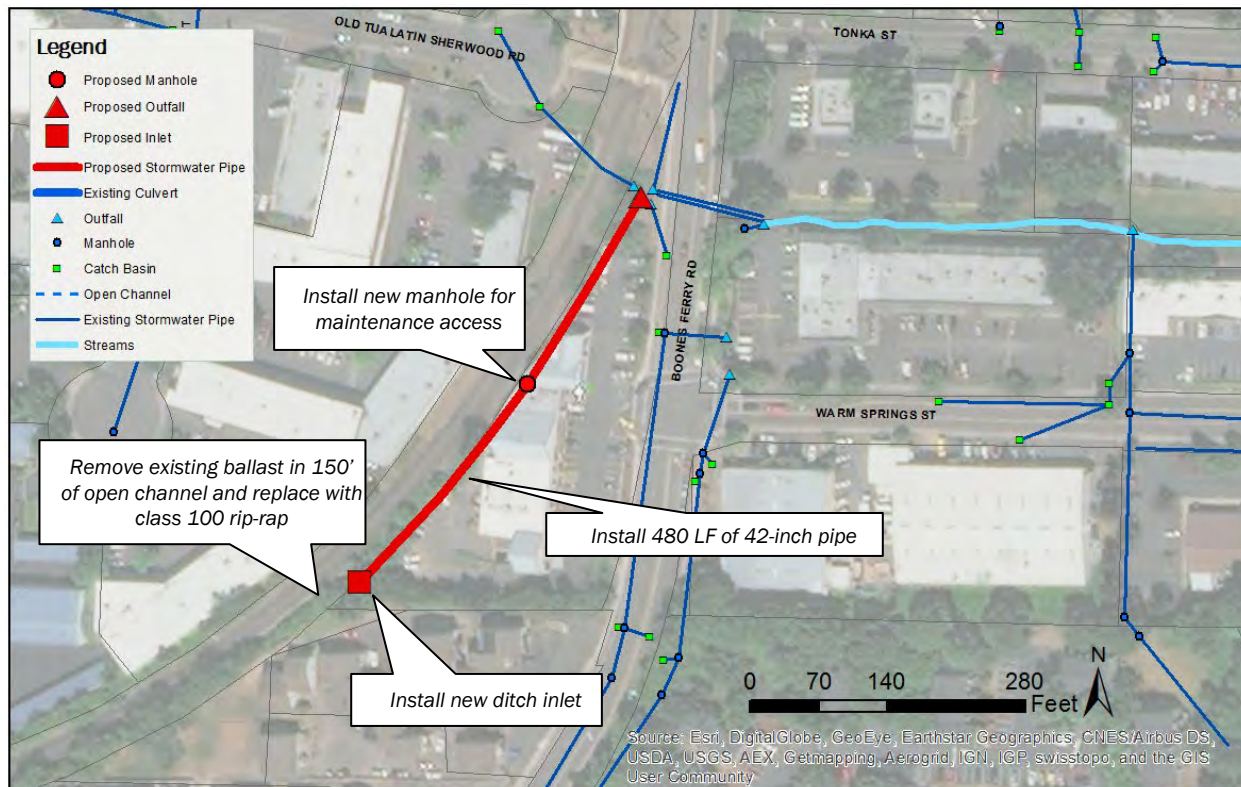

<b>Project Identifier</b>	<b>CIP #7</b>
<b>Project Name</b>	<b>Boones Ferry Railroad Conveyance Improvements</b>
<b>Detailed Location</b>	<b>Boones Ferry Road and Warm Springs Road</b>
<b>Model File</b>	<b>NY_ALT06.xp</b>
<b>Contributing Drainage Area</b>	<b>160.0 acres</b>
<b>Estimated Existing/Future Impervious %</b>	<b>44.0%/53.1%</b>
<b>Objective(s) Addressed</b>	<b>Addresses Maintenance Need; Addresses Erosion; Increases System Capacity (Flood Control)</b>

**Project Background**

City staff identified the ditch inlet at the downstream end of the open conveyance channel that runs adjacent to the ODOT railroad right-of-way as an ongoing maintenance issue. A site visit conducted in December 2016 confirmed that gravel and railroad ballast materials are being transported from the open channel and deposited downstream.

City staff also identified flooding and backwater conditions at this location, which has impacted local businesses during large rainfall events. Hydraulic modeling of the open channel and piped system revealed that the pipe is undersized for the contributing drainage area. During the December 2016 site visit, it was confirmed that gravel and ballast material had accumulated in the pipe system and was beginning to fill culverts under Boones Ferry Road, further limiting capacity.

**Project Description**

This project addresses localized flooding and the need for frequent maintenance along the open conveyance channel adjacent to the ODOT right-of-way.

This project adds large rock along the railroad ballast to stabilize the channel and reduce transport of gravel material into the City’s stormwater collection system. The downstream pipe will be upsized to increase flow capacity and improve maintenance access. Specific activities include:

- Remove existing gravel and ballast material along 150 ft of the open conveyance channel, directly upstream of the existing ditch inlet. Install Class 100 rip-rap along the railroad ballast to reduce the potential for material transport.
- Install a new ditch inlet to minimize hydraulic losses at the upstream end of the pipe.
- Replace 480 LF of 36-inch-diameter pipe with 42-inch-diameter pipe.

- Install a 72-inch manhole along pipe alignment for improved maintenance access.
- Install a new outfall to the open channel area directly west of Boones Ferry Road. Add rip-rap for energy dissipation.

**Design Considerations**

- The open conveyance channel will require regular inspection and maintenance to prevent material transport.
- The pipe is city-owned but located partially on ODOT property and will require close coordination with ODOT and the railroad administration during construction.
- Only planning level hydraulic calculations have been performed to identify conceptual sizing. For design, detailed topographic survey and hydraulic analysis is needed to determine the appropriate invert elevations and pipe diameters to maintain necessary cover and convey the design event.

**Planning-level Cost Estimate**

Capital Expense Total (including contingency)	\$ 356,000
Engineering and Permitting (35%)	\$ 124,000
Administration (10%)	\$ 36,000
<b>Capital Project Implementation Cost Total*</b>	<b>\$ 515,000</b>

*\*Planning level cost estimates estimated in 2018 dollars, rounded to the nearest thousand. The rounded total cost is based on non-rounded subtotals.*

**Additional Project Information**

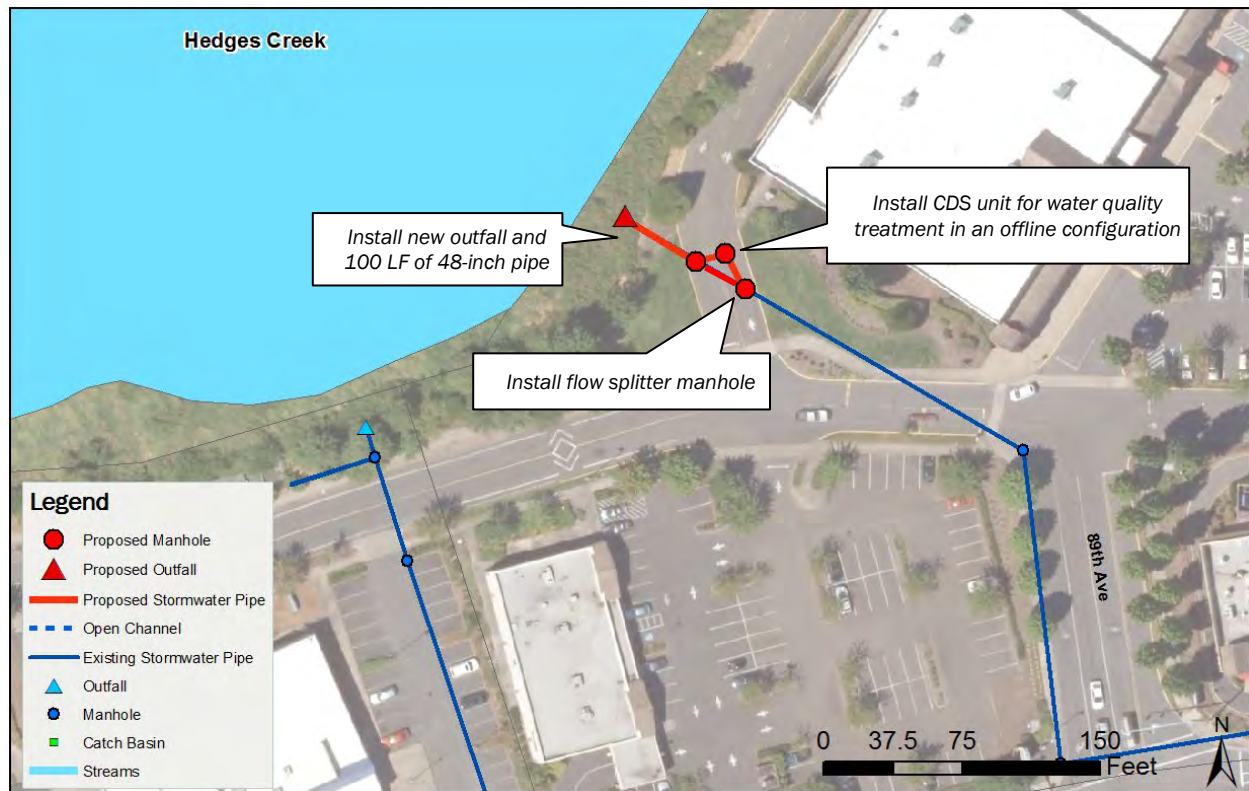


Image 1. Ditch inlet at downstream end of railroad open channel



Image 2. Accumulated ballast and debris upstream of culverts across Boones Ferry Road





<b>Project Identifier</b>	CIP #8
<b>Project Name</b>	89 <sup>th</sup> Avenue Water Quality Retrofit
<b>Detailed Location</b>	Outfall at 89 <sup>th</sup> Avenue
<b>Model File</b>	N/A
<b>Contributing Drainage Area</b>	28.9 acres
<b>Estimated Existing/Future Impervious %</b>	75.1%/75.2%
<b>Objective(s) Addressed</b>	Increases Water Quality Treatment (Retrofit)

**Project Background**

This project was originally identified in the City of Tualatin’s Capital Improvement Plan 2017-2021. The upstream stormwater collection system discharges to Hedges Creek wetland and has no water quality treatment. Clean Water Services’ (CWS) National Pollutant Discharge Elimination System (NPDES) Stormwater Permit requires retrofit of stormwater systems in partner jurisdictions to provide water quality treatment.

The upstream stormwater conveyance system is relatively shallow with minimal slope. Additionally, the water surface elevation in the wetlands at the outfall is relatively high. Due to the limited drop through the conveyance system and the large contributing drainage area, few water quality treatment devices could be implemented. Contech’s CDS hydrodynamic separator unit was selected due to its minimum drop requirements and ability to remove trash and coarse sediment from large contributing drainage areas.

**Project Description**

This project provides additional water quality treatment for the contributing drainage area to address water quality retrofit objectives referenced in CWS’ NPDES permit.

This project includes installation of a Contech CDS hydrodynamic separator (Model CDS3025), with a treatment flow rate of 2.4 cfs. The facility will be installed in an offline configuration, which requires a flow splitter manhole upstream to direct low flows to the CDS unit. The project also includes the installation 50 LF of 24-inch-diameter pipe and 100 LF of 48-inch-diameter pipe to support connections to existing infrastructure and a new outfall structure.

**Design Considerations**

- Easements may be required to optimize the layout and capture the largest possible drainage area. Easement acquisition is not included in this cost estimate.
- Contech was consulted to verify system sizing and pricing based on the contributing drainage area, proposed system configuration and available drop. Only planning level calculations have been performed to identify conceptual layout.
- Detailed topographic survey is needed to determine the appropriate invert elevations and verify pipe diameters to maintain necessary cover and convey the design event.

**Planning-level Cost Estimate**

Capital Expense Total (including contingency)	\$ 209,000
Engineering and Permitting (15%)	\$ 31,000
Administration (10%)	\$ 21,000
<b>Capital Project Implementation Cost Total*</b>	<b>\$ 262,000</b>

*\*Planning level cost estimates estimated in 2018 dollars, rounded to the nearest thousand. The rounded total cost is based on non-rounded subtotals.*

**Additional Project Information**



Image 1. Location of proposed water quality manhole


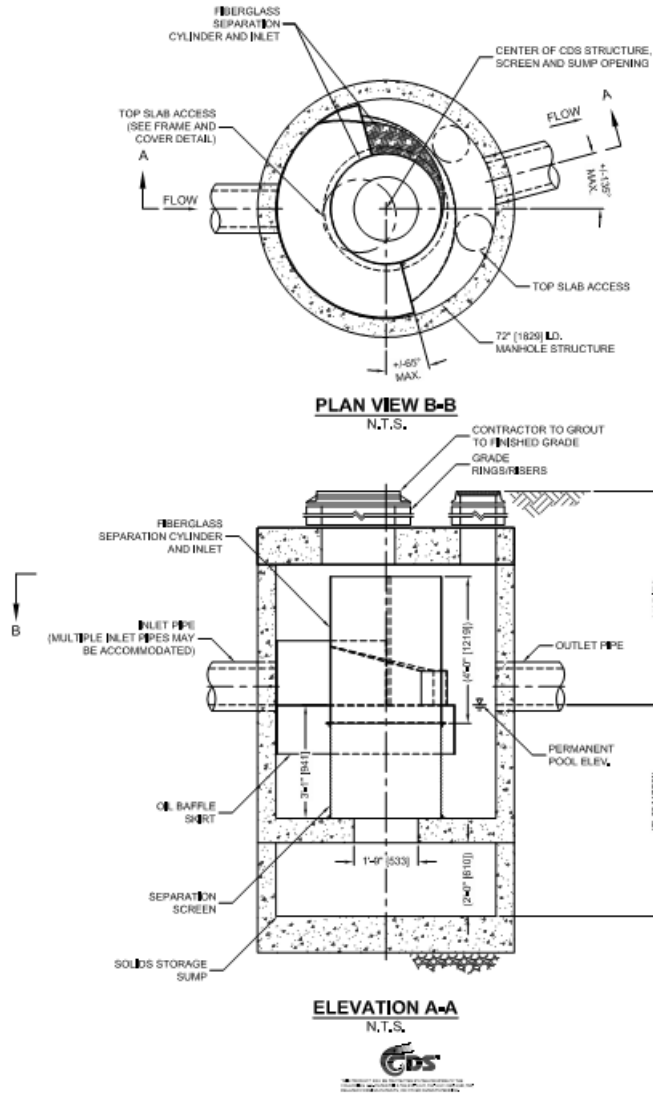


Image 2. Standard detail of Contech CDS3025 unit



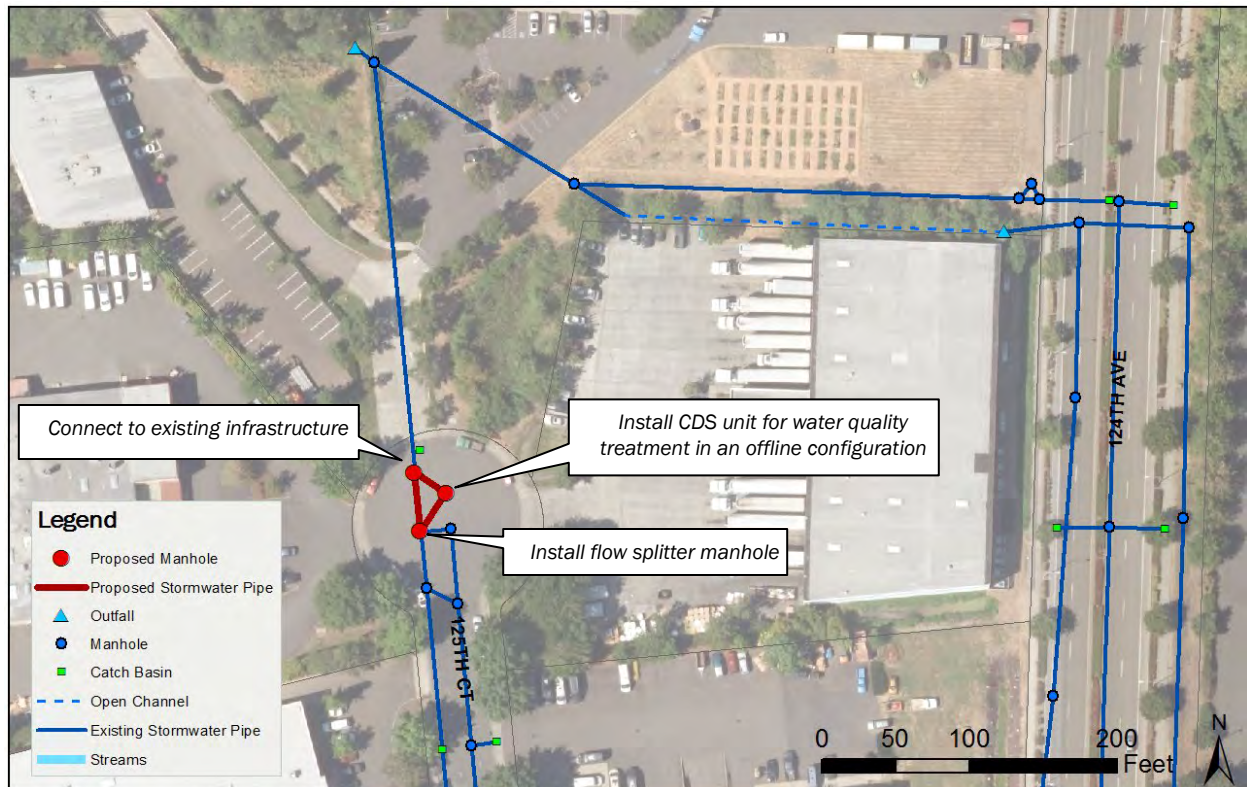

Project Identifier	CIP #9
Project Name	125th Court Water Quality Retrofit
Detailed Location	Outfall at 125 <sup>th</sup> Court
Model File	N/A
Contributing Drainage Area	29.3 acres
Estimated Existing/Future Impervious %	52.8%/71.8%
Objective(s) Addressed	Addresses Water Quality Treatment (Retrofit)

**Project Background**

This project was originally identified in the City of Tualatin’s Capital Improvement Plan 2017-2021. The upstream stormwater collection system discharges to the Hedges Creek wetland and has no water quality treatment. Clean Water Service’s (CWS) National Pollutant Discharge Elimination System (NPDES) Stormwater Permit requires retrofit of stormwater systems in partner jurisdictions to provide water quality treatment.

The upstream stormwater conveyance system is relatively shallow with minimal slope. Additionally, the water surface elevation in the wetlands at the outfall is relatively high. Due to the limited drop through the conveyance system and the large contributing drainage area, few water quality treatment devices could be implemented. Contech’s CDS hydrodynamic separator unit was selected due to its minimum drop requirements and ability to remove trash and coarse sediment from large contributing drainage areas.

**Project Description**

This project provides additional water quality treatment for the contributing drainage area to address water quality retrofit objectives referenced in CWS’ NPDES permit.

This project includes installation of a Contech™ CDS hydrodynamic separator (Model CDS3025), with a treatment flow rate of 2.4 cfs. The facility will be installed in an offline configuration, which requires a flow splitter manhole upstream to direct low flows to the CDS unit. The project also includes the installation of 50 LF of 24-inch-diameter pipe and 50 LF of 36-inch-diameter pipe to support connections to existing infrastructure.

**Design Considerations**


- Contech TM was consulted to verify system sizing and pricing based on the contributing drainage area, proposed system configuration and available drop. Only planning level calculations have been performed to identify conceptual layout.
- Detailed topographic survey is needed to determine the appropriate invert elevations and verify pipe diameters to maintain necessary cover and convey the design event.

**Planning-level Cost Estimate**

Capital Expense Total (including contingency)	\$ 165,000
Engineering and Permitting (15%)	\$ 25,000
Administration (10%)	\$ 16,000
<b>Capital Project Implementation Cost Total*</b>	<b>\$ 206,000</b>

\*Planning level cost estimates estimated in 2018 dollars, rounded to the nearest thousand. The rounded total cost is based on non-rounded subtotals.

**Additional Project Information**

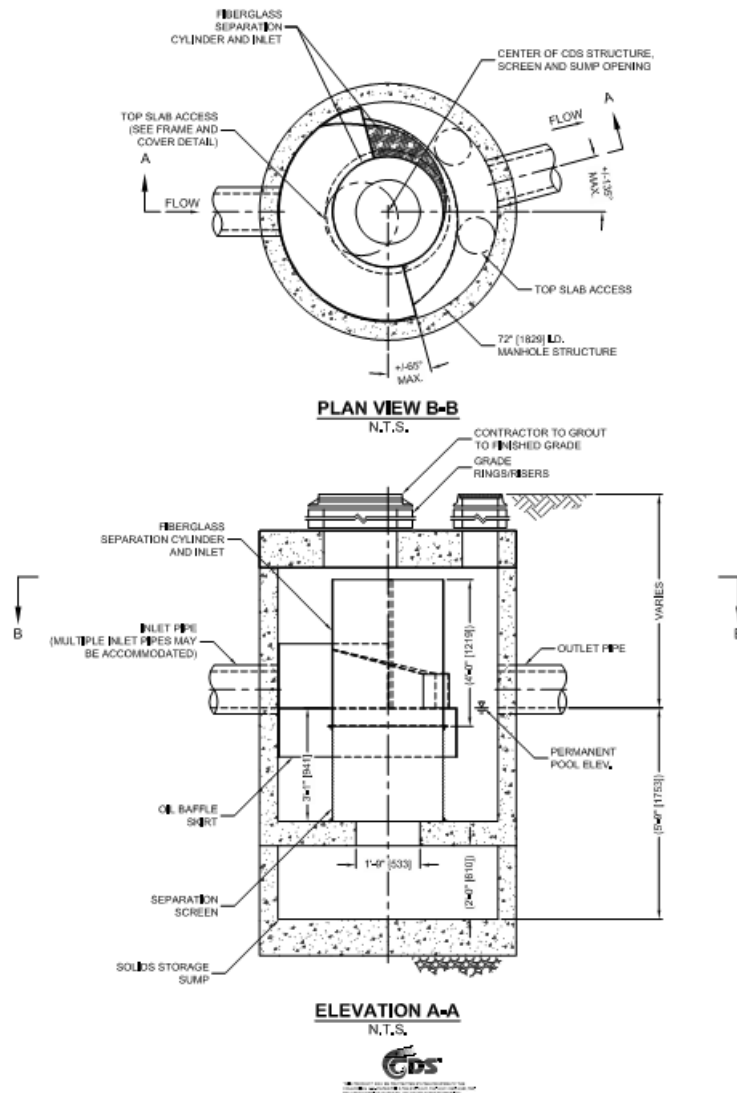



City of Tualatin  
Stormwater Master Plan  
Date: December 2017  
Project: Project 149233




Water Quality Retrofit - 125th Court  
Contributing Drainage Area

Image 3. Contributing drainage area





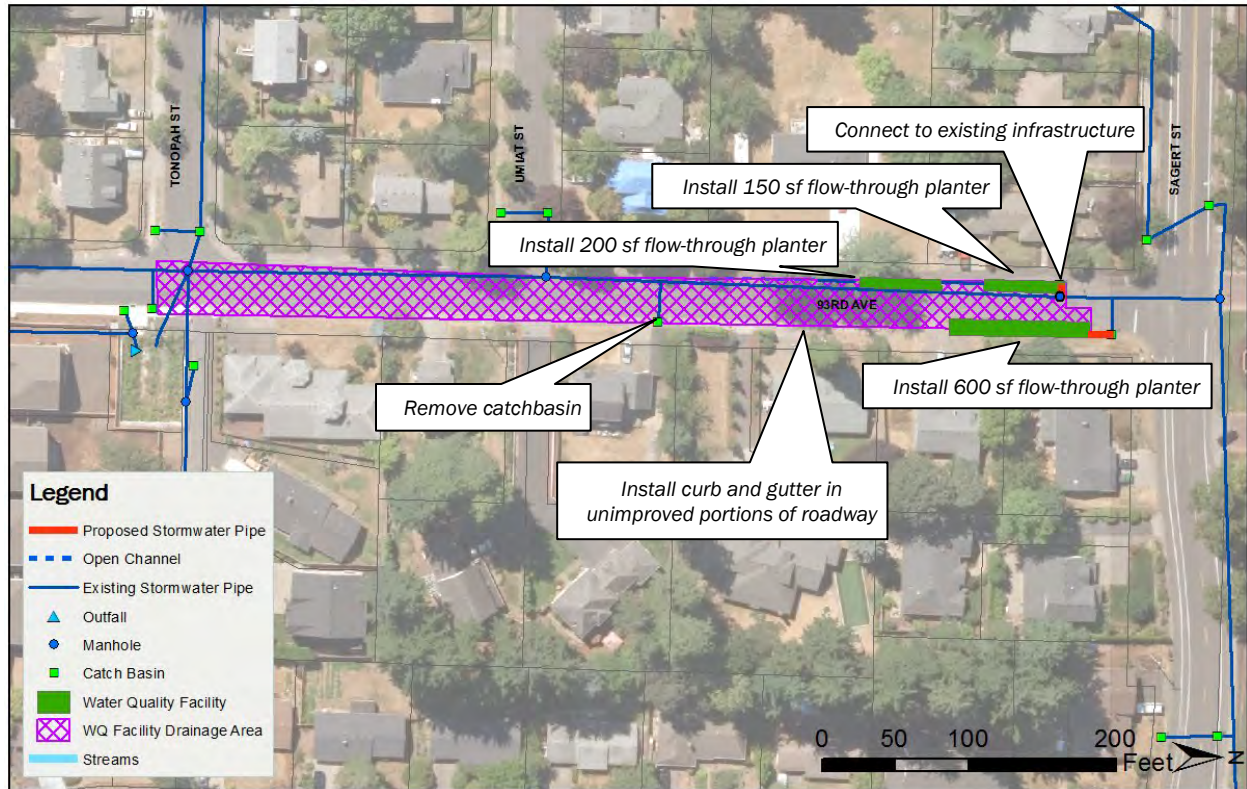

<b>Project Identifier</b>	CIP #10
<b>Project Name</b>	93 <sup>rd</sup> Avenue Green Street
<b>Detailed Location</b>	93 <sup>rd</sup> Avenue between Umiat Street and Sagert Street
<b>Model File</b>	N/A
<b>Contributing Drainage Area</b>	15,000 square feet
<b>Estimated Existing/Future Impervious %</b>	100%/100%
<b>Objective(s) Addressed</b>	Increases Water Quality Treatment (Retrofit)

**Project Background**

This project site was identified during a water quality retrofit evaluation as a potential green street pilot project to provide water quality treatment for 93<sup>rd</sup> Avenue between Umiat Street and Sagert Street.

This section of roadway is unimproved, and runoff is conveyed in roadside ditches before entering a 30-inch concrete stormwater pipe near the intersection of Sagert Street.

**Project Description**

This project provides additional water quality treatment for the contributing drainage area to address water quality retrofit objectives referenced in Clean Water Services’ (CWS) National Pollutant Discharge Elimination System permit. This project features a green street to manage stormwater runoff on an unimproved roadway.

The proposed project includes the installation of stormwater planters to treat approximately 15,000 sf of impervious surface from the roadway, sidewalks and property frontage along the unimproved right-of-way. Due to the poor infiltration characteristics of the soils in this area, flow-through planters with an underdrain and overflow are specified. The graphic above shows potential locations for planters. Curb inlets are assumed at each planter location for purposes of the cost estimate, and the overflow will be piped to the existing conveyance system.

In conjunction with green street facilities, approximately 550 linear feet (LF) of curb and gutter will be installed along 93<sup>rd</sup> Avenue to direct stormwater runoff to the water quality facilities. The outlets of the water quality facilities will be connected to existing stormwater infrastructure on 93<sup>rd</sup> Avenue, which drains to a trunk line in Sagert Street.

**Design Considerations**

- Facility sizing is based on the CWS Low Impact Development Approaches (LIDA) Handbook.
- Street improvements including sidewalk construction have not been included in this cost estimate. Installation of curb and gutter has been included in this cost estimate. It is assumed that green street facility installations will be conducted in conjunction with other roadway improvements.
- Public outreach may be needed to inform local resident and receive feedback regarding the right of way improvements and potential loss of street parking.
- Only planning level calculations have been performed to identify conceptual layout. For design, detailed topographic survey is needed to verify existing infrastructure, determine the appropriate invert elevations and verify facility sizing.

**Planning-level Cost Estimate**

Capital Expense Total (including contingency)	\$ 166,000
Engineering and Permitting (25%)	\$ 42,000
Administration (10%)	\$ 17,000
<b>Capital Project Implementation Cost Total*</b>	<b>\$ 224,000</b>

*\*Planning level cost estimates estimated in 2018 dollars, rounded to the nearest thousand. The rounded total cost is based on non-rounded subtotals.*

**Additional Project Information**



Image 1. Roadside ditches and unimproved roadway at the north end of 93<sup>rd</sup> Avenue


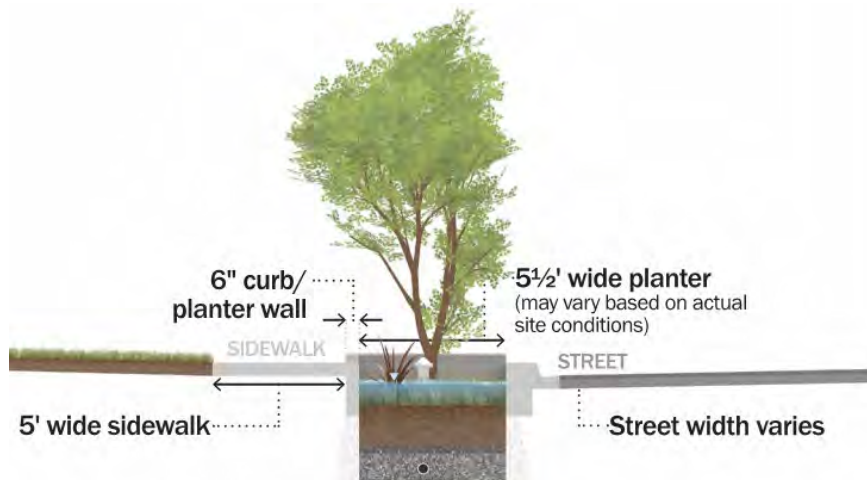


Image 2. Typical green street facility cross section

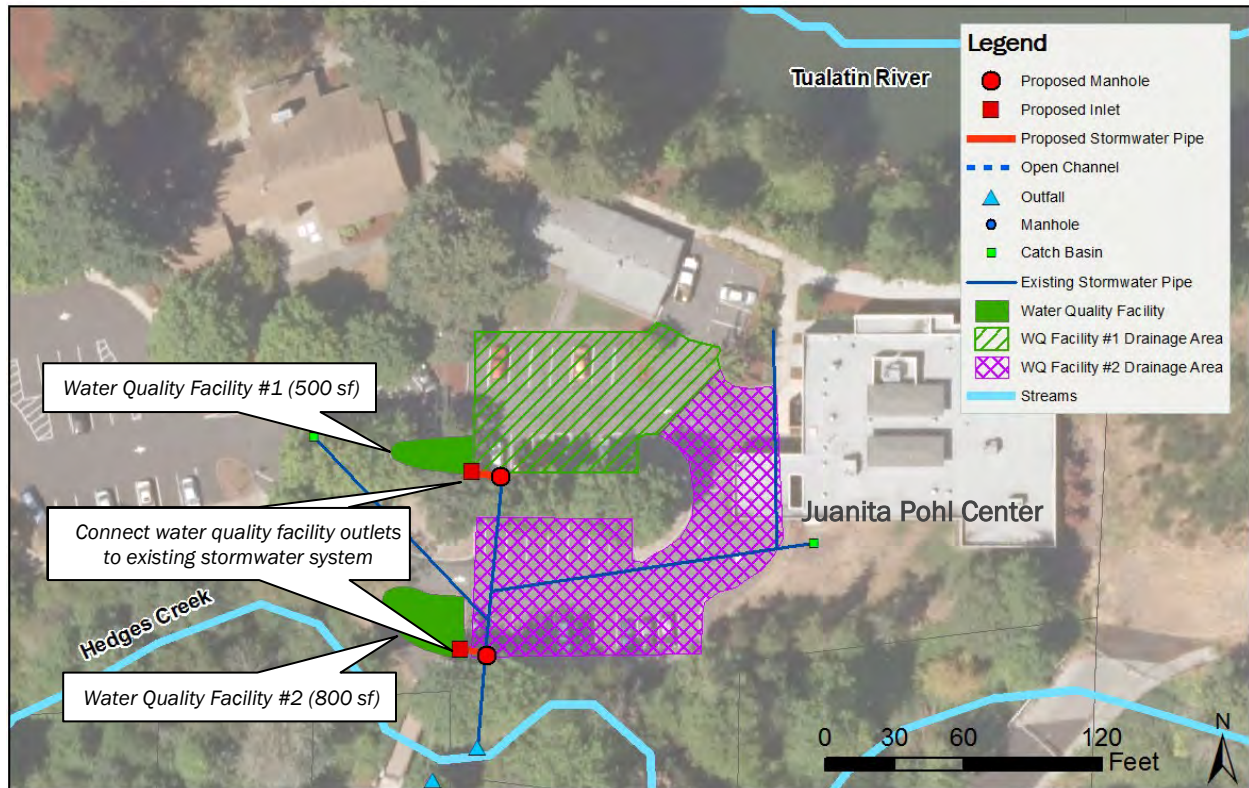

Project Identifier	CIP #11
Project Name	Juanita Pohl Water Quality Retrofit
Detailed Location	Juanita Pohl Center
Model File	N/A
Contributing Drainage Area	0.4 acres
Estimated Existing/Future Impervious %	100%/100%
Objective(s) Addressed	Increases Water Quality Treatment (Retrofit)

**Project Background**

This project site was identified during a water quality retrofit evaluation as a potential site to provide treatment for the parking area associated with the Juanita Pohl Center. The parking area is City-owned with a large contributing impervious drainage area (approximately 15,500 sf) that is currently untreated and discharges directly into Hedges Creek.

**Project Description**

This project provides additional water quality treatment for the contributing drainage area (parking lot) to address water quality retrofit objectives referenced in Clean Water Services' (CWS) National Pollutant Discharge Elimination System permit.

The proposed project includes regrading existing landscape islands to install raingardens for water quality treatment. The existing landscape islands are currently covered with bark chips and not substantially planted with vegetation. Specific activities include:

- Excavation and regrading of the landscape areas and back filling with drain rock and amended soils to support the water quality facility installation.
- Installation of check dams to minimize potential erosion.
- Installation of curb and curb cuts to serve as inlets to the facilities and associated piping to connect the facility overflows to downstream structures (i.e., manholes).
- Plant the facility with native vegetation suitable for a water quality facility.
- Minor repaving of parking stalls near the facilities.

**Design Considerations**

- Facility sizing is based on the CWS' Low Impact Development Approaches (LIDA) Handbook.
- Only planning level calculations have been performed to identify conceptual layout and sizing. Detailed topographic survey is needed to determine the appropriate invert elevations and optimum facility layout and configuration.

**Planning-level Cost Estimate**

Capital Expense Total (including contingency)	\$ 116,000
Engineering and Permitting (25%)	\$ 29,000
Administration (10%)	\$ 12,000
<b>Capital Project Implementation Cost Total*</b>	<b>\$ 156,000</b>

*\*Planning level cost estimates estimated in 2018 dollars, rounded to the nearest thousand. The rounded total cost is based on non-rounded subtotals.*


**Additional Project Information**



Image 1. Proposed location for water quality facility #1



Image 2. Proposed location for water quality facility #2

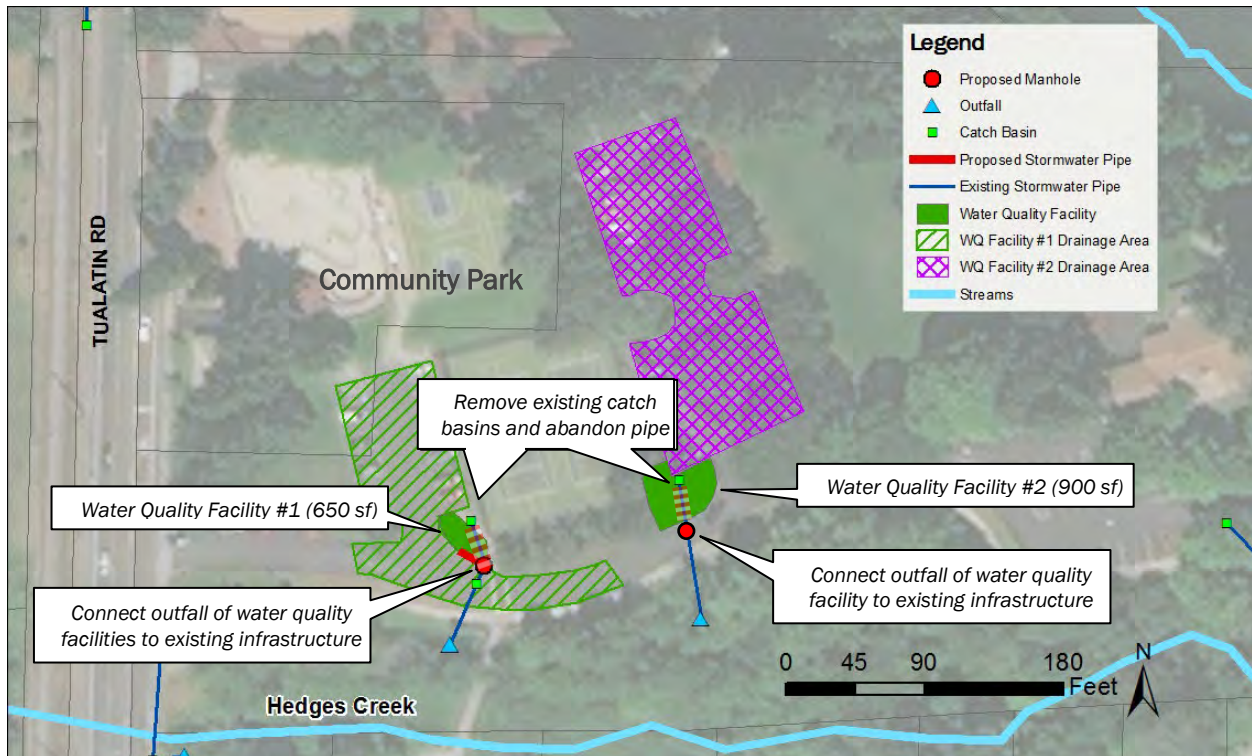

Project Identifier	CIP #12
Project Name	Community Park Water Quality Retrofit
Detailed Location	Tualatin Community Park
Model File	N/A
Contributing Drainage Area	0.6 acres
Estimated Existing/Future Impervious %	100 %/100%
Objective(s) Addressed	Increases Water Quality Treatment (Retrofit)

**Project Background**

This project site was identified during a water quality retrofit evaluation as a potential site to provide treatment for the parking area associated with Tualatin Community Park. The parking area is City-owned with a large contributing impervious drainage area (approximately 25,000 sf) that is currently untreated and discharges directly into Hedges Creek.

**Project Description**

This project provides additional water quality treatment for the contributing drainage area (parking lot) to address water quality retrofit objectives referenced in Clean Water Services' (CWS) National Pollutant Discharge Elimination System permit.

The proposed project includes regrading existing landscape islands to install raingardens for water quality treatment. The existing landscape islands are currently covered with bark chips and not substantially planted with vegetation. Specific activities include:

- Excavation and regrading of the landscape areas and back filling with drain rock and amended soils to support the water quality facility installation.
- Address existing utilities, light pole, signage, etc.
- Installation of curb and curb cuts to serve as inlets to the facilities and associated piping to connect the facility overflows to downstream structure (i.e., manhole).
- Plant the facility with native vegetation suitable for a water quality facility.

**Design Considerations**

- Facility sizing is based on the CWS' Low Impact Development Approaches (LIDA) Handbook.
- Only planning level calculations have been performed to identify conceptual layout and sizing. For design, detailed topographic survey is needed to determine the appropriate invert elevations and optimum facility layout and configuration.
- Two established trees are located within the footprint for water quality facility #2. One of the trees may need to be removed and replaced to make room for the treatment facility.

**Planning-level Cost Estimate**

Capital Expense Total (including contingency)	\$ 117,000
Engineering and Permitting (25%)	\$ 29,000
Administration (10%)	\$ 12,000
<b>Capital Project Implementation Cost Total*</b>	<b>\$ 158,000</b>

*\*Planning level cost estimates estimated in 2018 dollars, rounded to the nearest thousand. The rounded total cost is based on non-rounded subtotals.*


**Additional Project Information**



**Image 1. Proposed location for Water Quality Facility #1**



**Image 2. Proposed location for Water Quality Facility #2**

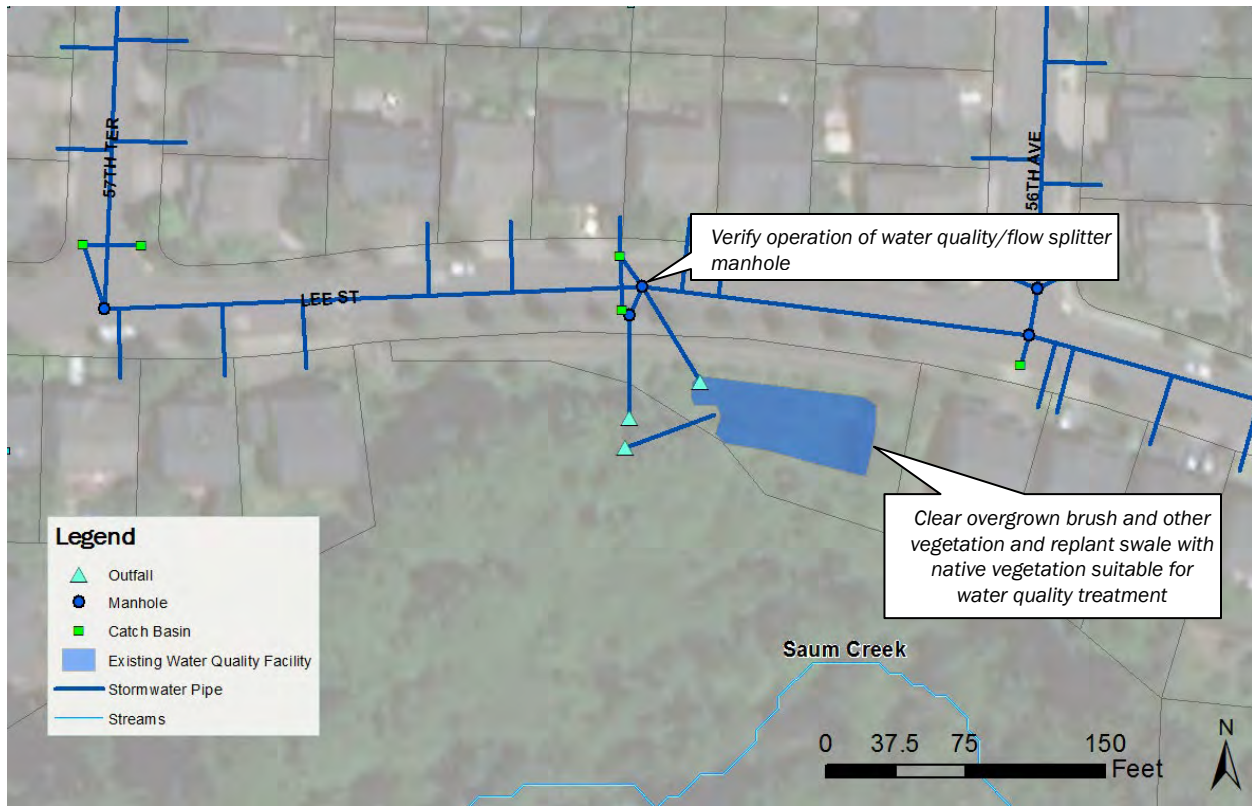

Project Identifier	CIP #13
Project Name	Water Quality Facility Restoration-Venetia
Detailed Location	Lee Street and 56 <sup>th</sup> Avenue
Model File	No modeling
Contributing Drainage Area	6.5 acres
Estimated Existing/ Future Impervious %	42.2%/52.0%
Objective(s) Addressed	Addresses Maintenance Need; Improves Water Quality

**Project Background**

This water quality facility receives residential and roadway stormwater drainage from residential development along Lee Street. The original facility design includes a meandering swale for water quality treatment. From the swale, stormwater discharges south directly to Saum Creek. A high flow bypass upstream of the swale controls stormwater flow rates to the swale.

This facility was reported in need of repairs by City staff, and due to access limitations, has not received regular maintenance. During a site visit in June 2016, overgrown vegetation was observed but the facility appeared functional. The overgrown vegetation appeared to have caused nuisance backwatering, which partially washed out an existing access path. The outfall is located at the southwest end of the swale but was not inspected due to a locked gate.

**Project Description**

This project restores the public water quality facility to its original function by removing accumulated sediment and overgrown vegetation, amending soils and replanting. This project also reestablishes an existing maintenance access.

Specific activities include:

- Clear the trees and large brush growing in the swale.
- Remove accumulated sediment along swale bottom, regrade and replace with amended soils and mulch.
- Replant facility with native vegetation suitable for a water quality facility.
- Verify that the water quality/flow splitter manhole upstream of the facility is operational and diverting the water quality design flow to the facility.

**Design Considerations**

- Routine maintenance should be conducted to ensure proper functionality.
- Project design should confirm whether the flow splitter manhole needs to be repaired or replaced. Structure and pipe replacement costs are not assumed in the cost estimate.

**Planning-level Cost Estimate**

Capital Expense Total (including contingency)	\$ 52,000
Engineering and Permitting (15%)	\$ 8,000
Administration (10%)	\$ 5,000
<b>Capital Project Implementation Cost Total*</b>	<b>\$ 65,000</b>

*\*Planning level cost estimates estimated in 2018 dollars, rounded to the nearest thousand. The rounded total cost is based on non-rounded subtotals.*

**Additional Project Information**




**Image 1. Overgrown swale as seen from Lee Street**



**Image 2. Alternate view of vegetation growing in swale**



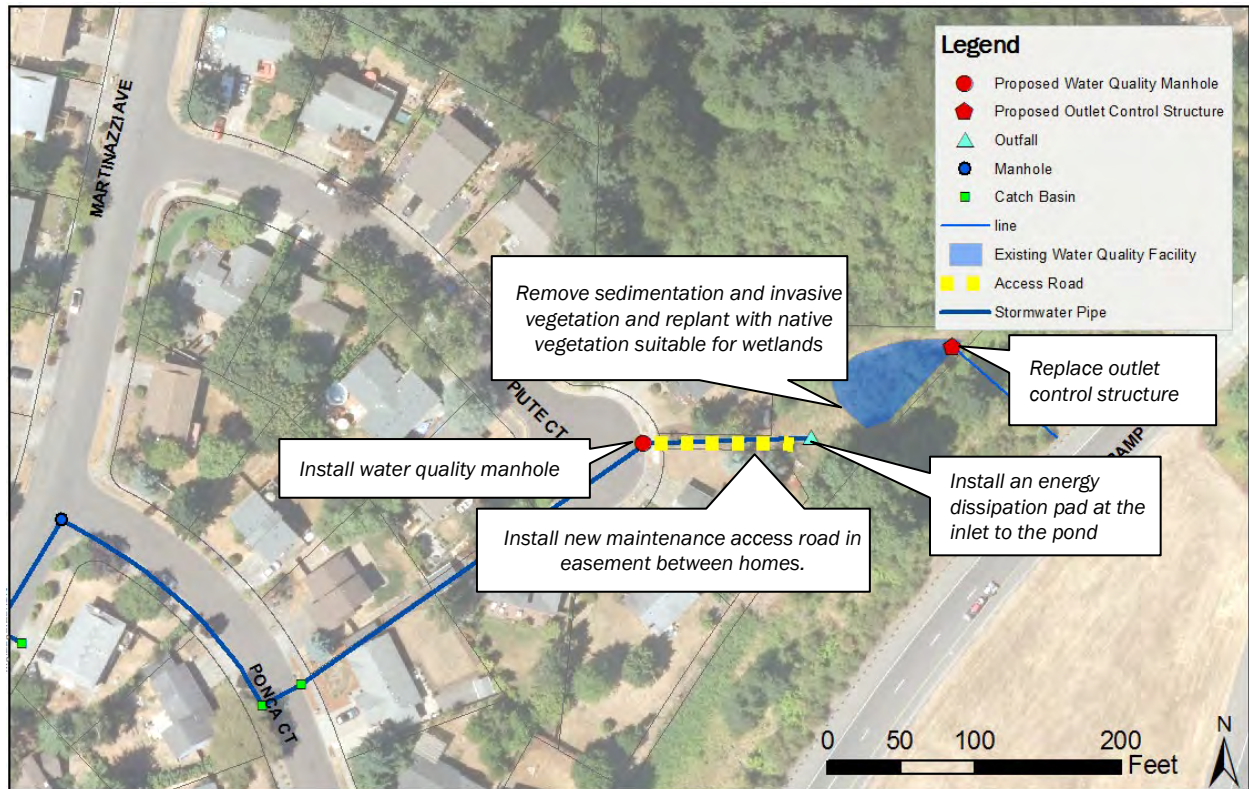

Project Identifier	CIP #14
Project Name	Water Quality Facility Restoration-Piute Court
Detailed Location	8187 Piute Court
Model File	No modeling
Contributing Drainage Area	28.5 acres
Estimated Existing/ Future Impervious %	42.8%/52.7%
Objective(s) Addressed	Addresses Maintenance Need; Improves Water Quality

**Project Background**

The water quality facility at the end of Piute Court receives residential stormwater drainage from development along Martinazzi Avenue and Iroquois Drive (not shown on map). Stormwater discharges to the facility from the west via a storm pipe from Piute Court. This facility was reported in need of repairs by City staff. During a site visit conducted December 2016, sediment accumulation was observed, and the facility was overgrown with invasive reed canary grass.

A field ditch inlet is located at the north end of the pond, which serves as the outlet control structure. It is believed to discharge east under Interstate 205, but staff were unable to verify the downstream point of discharge.

The City has an easement for maintenance access between homes on Piute Court, but there is currently no access road.

**Project Description**

This project restores the public water quality facility to its original function by removing accumulated sediment and overgrown vegetation, amending soils and replanting. This project also establishes a dedicated maintenance access road.

Specific activities include:

- Install a 100-foot-long gravel access road in the easement located between homes on Piute Court.
- Remove accumulated sediment and invasive vegetation, regrade the existing facility, and add amended soils and mulch.
- Replant the bottom and sides of facility with riparian/wetland vegetation. Add temporary irrigation.
- Install an energy dissipation pad at the pond inlet.
- Replace the existing ditch inlet with an outfall control structure.
- Install a water quality manhole upstream of the facility, in Piute Court, to reduce sediment load and minimize future maintenance needs.

**Design Considerations**

- The downstream point of discharge from the pond is currently unknown, and may require coordination with ODOT.
- Routine maintenance should be conducted to ensure proper functionality.
- Additional easements, property acquisition, and private property enhancements associated with installation of the access road (planting, fencing, etc.) is not reflected in the cost estimate.

**Planning-level Cost Estimate**

Capital Expense Total (including contingency)	\$ 83,000
Engineering and Permitting (15%)	\$ 12,000
Administration (10%)	\$ 8,000
<b>Capital Project Implementation Cost Total*</b>	<b>\$ 104,000</b>

*\*Planning level cost estimates estimated in 2018 dollars, rounded to the nearest thousand. The rounded total cost is based on non-rounded subtotals.*


**Additional Project Information**



**Image 1. Invasive reed canary grass covers most of the bottom of the water quality facility**



**Image 2. Sediment deposition near outfall of stormwater system**

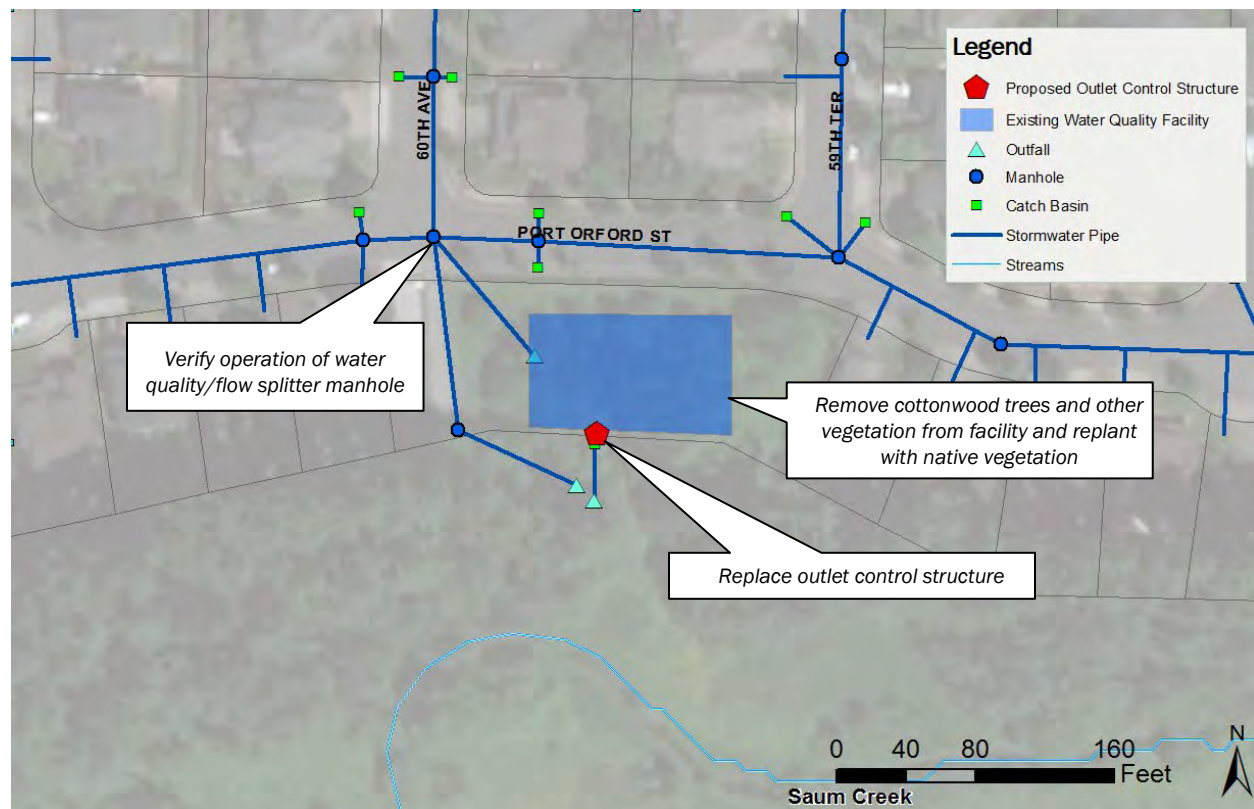

Project Identifier	CIP #15
Project Name	Water Quality Facility Restoration-Sequoia Ridge
Detailed Location	Port Orford Street between SW 59 <sup>th</sup> Terrace and SW 60 <sup>th</sup> Avenue
Model File	No modeling
Contributing Drainage Area	21.7 acres
Estimated Existing/ Future Impervious %	37.3%/50.8%
Objective(s) Addressed	Addresses Maintenance Need; Improves Water Quality

**Project Background**

The water quality facility south of Port Orford Street receives residential stormwater drainage from the surrounding neighborhood. Stormwater discharges to the facility from the northwest and flows south directly into Saum Creek after treatment. The pond is designed to have a capacity of approximately 15,500 cubic feet of storage.

This facility was included as a project in the City's 2017-2021 Capital Improvement Plan and maintenance needs were confirmed by City staff. Mature cottonwood trees are currently growing within the footprint of the pond. During a site visit conducted in December 2016, the outlet control structure appeared clogged with vegetation and debris. No water was seen entering the structure via the low flow pipe and there is standing water in the facility. The outfall from the facility to Saum Creek appeared to be in good condition.

**Project Description**

This project restores the public water quality facility to its original function by removing accumulated sediment and overgrown vegetation, amending soils and replanting. This project also replaces the outlet control structure to allow the facility to discharge.

Specific activities include:

- Clear all cottonwood trees and other vegetation from the facility.
- Remove accumulated sediment and invasive vegetation and add amended soils.
- Replant the bottom and sides of facility with riparian/wetland vegetation suitable for a stormwater pond. Add temporary irrigation.

- Verify that the water quality/flow splitter manhole upstream of the facility is operational and diverting the water quality design flow to the facility. Remove sediment as needed.
- Install energy dissipation pad at pond inlet.
- Redesign the outlet control structure to have functional low flow pipe and high flow overflow. Remove the current cap and install an overflow plate in accordance with current CWS design standards.

**Design Considerations**

- Routine maintenance should be conducted to ensure proper functionality.
- Project design should verify sizing of the outlet control structure including the low flow pipe. Pipe replacement has not been included in the cost estimate.
- Project design should confirm whether the flow splitter manhole needs to be repaired or replaced. Structure and pipe replacement costs are not assumed in the cost estimate.

**Planning-level Cost Estimate**

Capital Expense Total (including contingency)	\$ 67,000
Engineering and Permitting (15%)	\$ 10,000
Administration (10%)	\$ 7,000
<b>Capital Project Implementation Cost Total*</b>	<b>\$ 83,000</b>

*\*Planning level cost estimates estimated in 2018 dollars, rounded to the nearest thousand. The rounded total cost is based on non-rounded subtotals.*


**Additional Project Information**



**Image 1. Large cottonwood trees in water quality facility**



**Image 2. Existing pond outfall control structure**

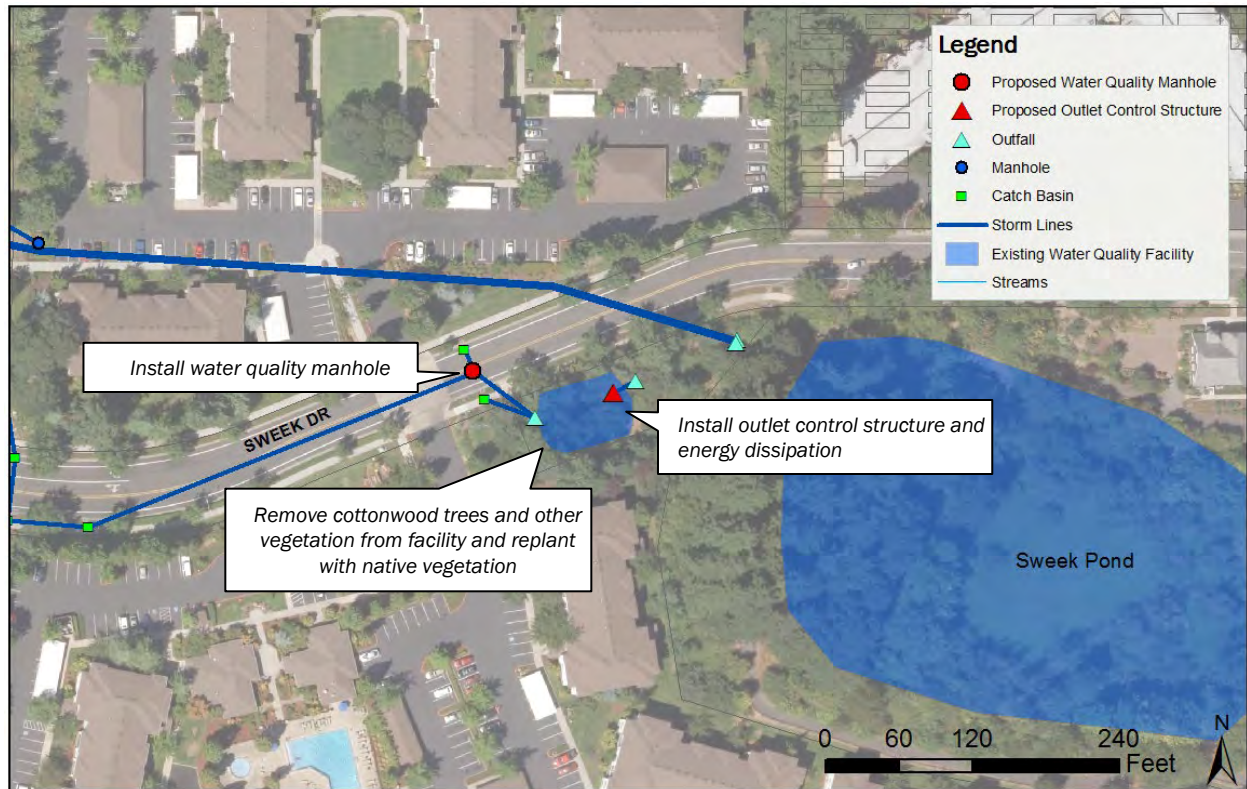

Project Identifier	CIP #16
Project Name	Water Quality Facility Restoration-Sweek Drive Pond
Detailed Location	Sweek Drive and Tualatin Road
Model File	No modeling
Contributing Drainage Area	2.5 acres
Estimated Existing/Future Impervious %	41.5%/50.3%
Objective(s) Addressed	Address Maintenance Need; Improves Water Quality

**Project Background**

The water quality facility south of Sweek Drive treats stormwater runoff from Sweek Drive and a portion of 90<sup>th</sup> Avenue. This facility appears to discharge freely, without a control structure, to the larger Sweek Pond, located directly to the east.

This facility was included as a project in the City's 2017-2021 Capital Improvement Plan and maintenance needs were confirmed by City staff. During a site visit conducted in December 2016, mature cottonwood trees and other vegetation were seen growing throughout the pond bottom.

**Project Description**

This project restores the public water quality facility to its original function by removing accumulated sediment and overgrown vegetation, amending soils and replanting. This project includes installation of an outlet control structure to better utilize storage.

**Specific activities include:**

- Clear all cottonwood trees and other vegetation from the facility.
- Remove accumulated sediment and invasive vegetation and add amended soils.
- Replant the bottom and sides of the facility with native vegetation suitable for a stormwater pond. Add temporary irrigation.
- Install a water quality manhole upstream of the pond to minimize sediment loading.
- Install an energy dissipation pad at the pond inlet
- Install a new outlet control structure and energy dissipation pad.

Design Considerations

- Routine maintenance should be conducted to ensure proper functionality.

Planning-level Cost Estimate


Capital Expense Total (including contingency)	\$ 83,000
Engineering and Permitting (15%)	\$ 12,000
Administration (10%)	\$ 8,000
<b>Capital Project Implementation Cost Total*</b>	<b>\$ 103,000</b>

*\*Planning level cost estimates estimated in 2018 dollars, rounded to the nearest thousand. The rounded total cost is based on non-rounded subtotals.*

Additional Project Information



Image 1. Vegetation and cottonwood trees growing in the water quality facility

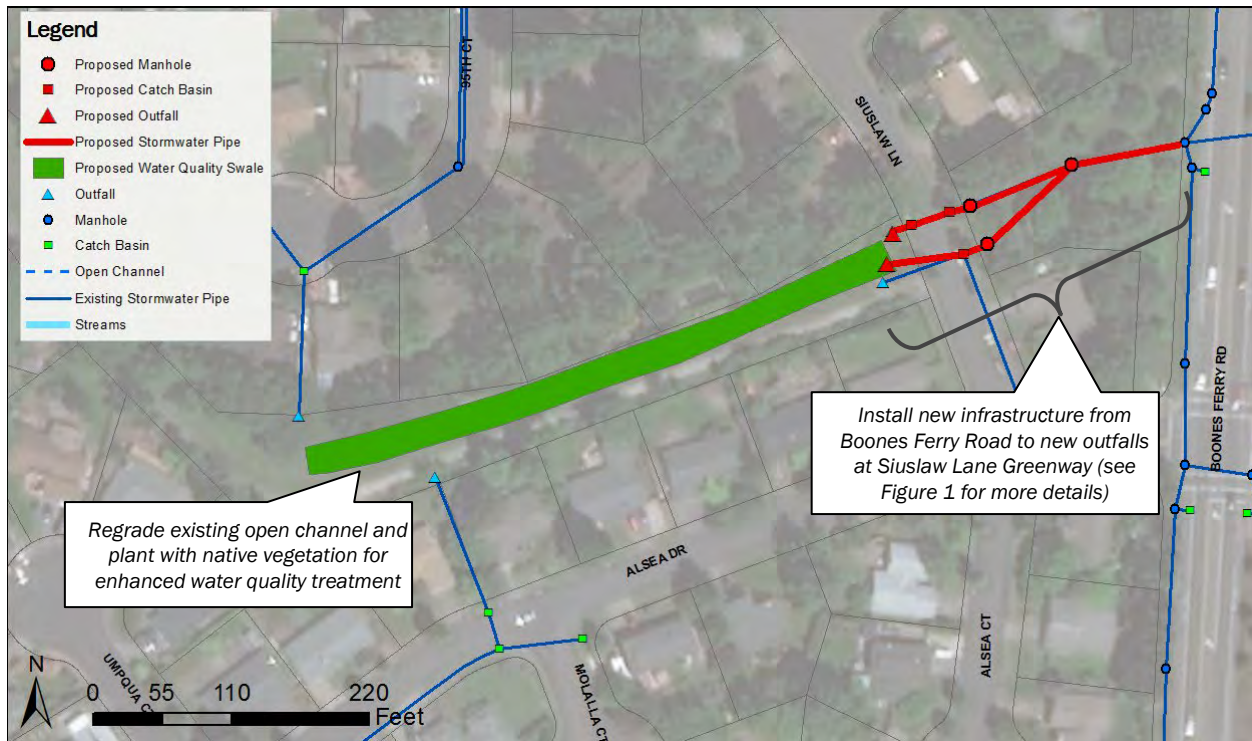

<b>Project Identifier</b>	CIP #17
<b>Project Name</b>	Siuslaw Water Quality Retrofit
<b>Detailed Location</b>	Siuslaw Lane Greenway
<b>Model File</b>	N/A
<b>Contributing Drainage Area</b>	70.3 acres
<b>Estimated Existing/Future Impervious %</b>	39.4%/48.3%
<b>Objective(s) Addressed</b>	Addresses Maintenance Need; Increases Water Quality Treatment (Retrofit)

**Project Background**

The existing open channel conveyance system in the greenway along Siuslaw Lane receives residential stormwater drainage from nearby neighborhoods. Stormwater enters the open channel from Boones Ferry Road and discharges to a ditch inlet adjacent to 98<sup>th</sup> Avenue.

City staff identified this site during a water quality retrofit evaluation as a potential stormwater treatment facility retrofit. During a site visit in December 2016, sediment was observed near the two outfalls to the open channel. The corrugated metal pipes were also reported to be in poor condition and significant rust and corrosion was observed.

**Project Description**

This project replaces infrastructure that is in poor condition and provides water quality treatment in the form of a bioswale.

The stormwater conveyance system will be replaced from Boones Ferry to the outfalls at the existing greenway. This includes the installation of 350 LF of 30-inch-diameter pipe and 100 LF of 48-inch-diameter pipe. A flow splitter/water quality manhole will be installed along this alignment to minimize sediment loading to the new bioswale. The project also includes replacement of 3 catch basins, 2 manholes, and the installation of 5 check dams and energy dissipation at the outfall to the open channel.

The proposed project also includes grading the existing open channel conveyance to serve as a bioswale for water quality treatment. The resulting 15-ft-wide by 500-ft-long bioswale will include amended soils and vegetation enhancement to improve water quality treatment and enhance visual appeal.

**Design Considerations**

- Water quality facility sizing and design is based on the Clean Water Services Low Impact Development Approaches (LIDA) Handbook. The LIDA Handbook should be referenced for design guidelines on swales.
- Routine maintenance should be conducted to ensure proper functionality.

- Final swale alignment and configuration must consider potential grading impacts to the existing trees and the paved walking path.
- Only planning level calculations have been performed to identify conceptual layout and sizing. Detailed topographic survey is needed to determine the extent of grading required, the existing size and elevation of the upstream collection system, and appropriate invert elevations to maintain necessary slope and convey the design event.

Planning-level Cost Estimate	
Capital Expense Total (including contingency)	\$ 336,000
Engineering and Permitting (25%)	\$ 84,000
Administration (10%)	\$ 34,000
<b>Capital Project Implementation Cost Total*</b>	<b>\$ 454,000</b>

\*Planning level cost estimates estimated in 2018 dollars, rounded to the nearest thousand. The rounded total cost is based on non-rounded subtotals.

Additional Project Information



Image 1. Existing outfalls to Siuslaw Lane Greenway


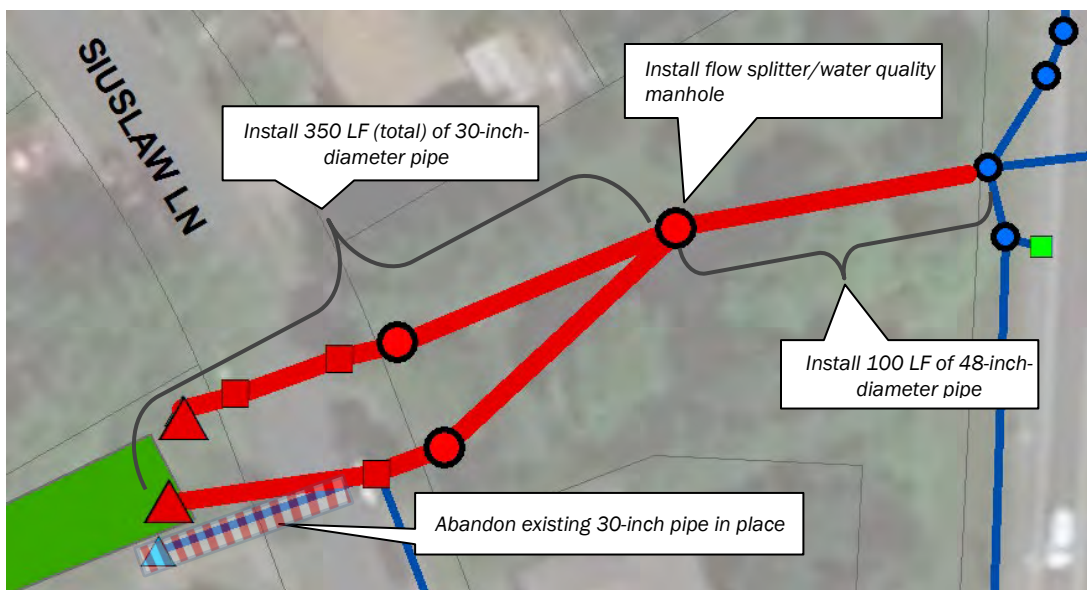


Figure 1. Construction details of new infrastructure



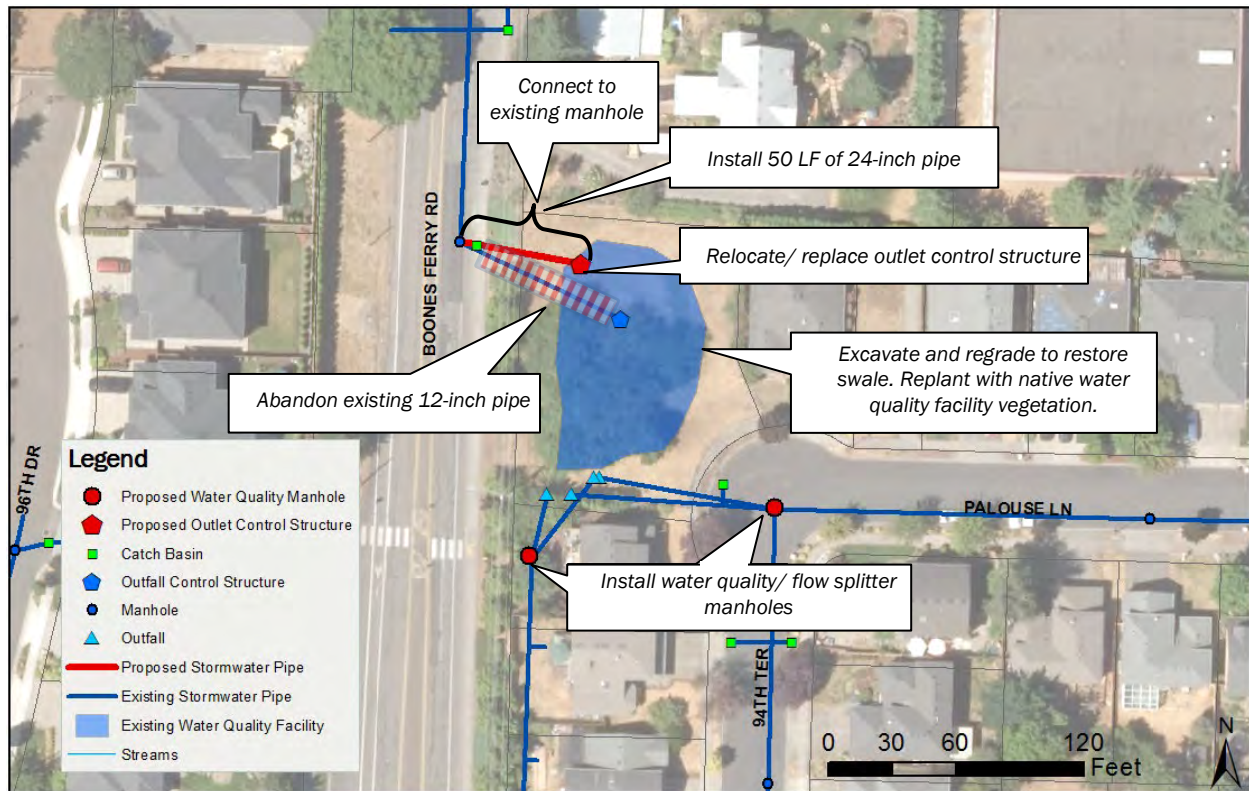

Project Identifier	CIP #18
Project Name	Water Quality Facility Restoration-Waterford
Detailed Location	Palouse Lane and 94 <sup>th</sup> Terrace
Model File	No modeling
Contributing Drainage Area	19.4 acres
Estimated Existing/Future Impervious %	44.8%/54.6%
Objective(s) Addressed	Address Maintenance Need; Improves Water Quality

**Project Background**

The water quality facility located between Palouse Lane and Boones Ferry Road receives residential stormwater runoff from the surrounding neighborhood. Stormwater discharges to the facility from the south. Stormwater discharges from the facility to the west via a pipe under Boones Ferry Road. As-builts indicate the pond was designed to be approximately 4 feet deep with a bottom area of 2,500 square feet. The original design included a water quality swale around the pond perimeter to provide pretreatment of low flows. High flows discharge directly to the pond and bypass the swale.

This facility was included as a project in the City’s 2017-2021 Capital Improvement Plan and maintenance needs were confirmed by City staff.

During a site visit in December 2016, accumulated sediment was found to have filled in the swale causing all water to bypass the swale. There is little/no vegetation present in the pond and swale. The outlet of the facility is in the middle of the pond, preventing maintenance during high water events.

**Project Description**

This project restores the public water quality facility to its original function by removing accumulated sediment and overgrown vegetation, amending soils and replanting. This project also relocates the outlet structure to improve maintenance access.

**Specific activities include:**

- Clear invasive and unwanted vegetation from the facility.
- Excavate and regrade as needed to maximize water quality function and restore to original design.
- Remove accumulated sediment and replace with amended soils.

- Replant the swale and bottom and sides of the pond facility with native vegetation suitable for a swale and water quality pond. Add temporary irrigation.
- Relocate and replace the outlet control structure to the edge of pond for improved maintenance access.
- Replace inlet rip rap for increased energy dissipation.
- Install two water quality/flow splitter manholes upstream of facility to minimize sediment loading.

**Design Considerations**

- Routine maintenance should be conducted to ensure proper functionality.
- Project design should verify sizing and configuration of the flow control manholes and outlet control structure. Detailed topographic survey is needed to confirm appropriate invert elevations and pipe diameters. Inlet pipe replacement is not included in the cost estimate.
- Project design should evaluate sizing and configuration of the outlet control structure to optimize storage and mitigation of peak flow rates and the duration of flow to Hedges Creek. If enhanced flow control is provided, this project may qualify as a retrofit opportunity.

**Planning-level Cost Estimate**


Capital Expense Total (including contingency)	\$ 144,000
Engineering and Permitting (15%)	\$ 22,000
Administration (10%)	\$ 14,000
<b>Capital Project Implementation Cost Total*</b>	<b>\$ 180,000</b>

*\*Planning level cost estimates estimated in 2018 dollars, rounded to the nearest thousand. The rounded total cost is based on non-rounded subtotals.*

**Additional Project Information**



**Image 1. Waterford water quality facility as seen from Palouse Lane**

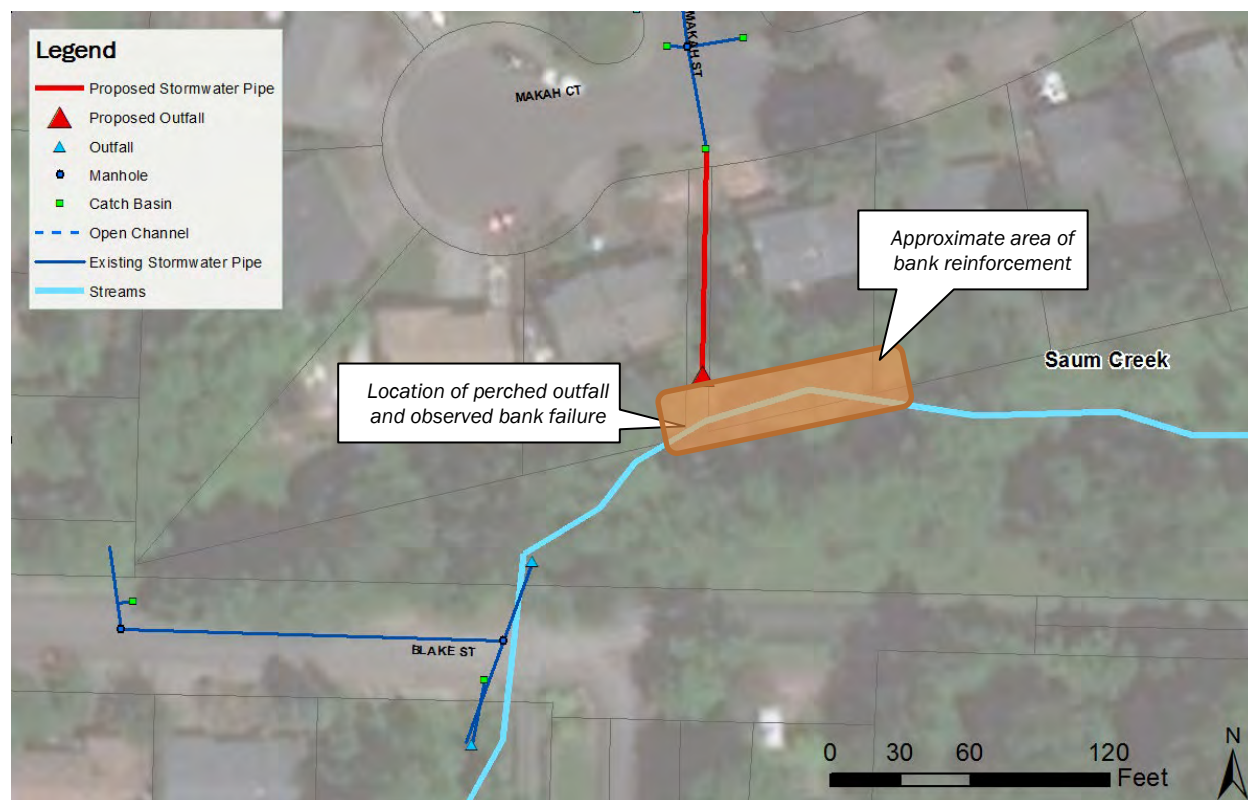

Project Identifier	CIP #19
Project Name	Saum Creek Hillslope Repair
Detailed Location	Blake Street at Saum Creek
Model File	N/A
Contributing Drainage Area	142.2 acres to Saum Creek/5.0 acres to outfall
Estimated Existing /Future Impervious %	39.4%/46.8%
Objective(s) Addressed	Addresses Erosion; Addresses Maintenance Need

**Project Background**

City staff and adjacent property owners identified the outfall into Saum Creek at Blake Street as an erosion and bank stability concern. City maintenance staff report severe bank erosion at this location. Site visits, including a field stream assessment in September 2017, revealed bank erosion along the unprotected bank slope and groundwater seepage along the bank itself. The outfall from Blake Street is perched approximately 7 feet above the creek bed. Bank failure was also observed approximately 100 feet downstream, suggesting the need for a geotechnical evaluation of the reach. Saum Creek itself appears stabilized due to a clay/hard pan layer which prevents downcutting at this location.

The cause of the bank failure is not clear. Stormwater pipe condition deficiencies have been reported upstream of the outfall, which could contribute to slope instability, depending on subsurface geologic conditions and preferential flow paths. The storm pipe and outfall require replacement due to structural deficiencies identified by City staff.

**Project Description**

This project replaces infrastructure that is in poor condition and allocates funding resources to investigate and address existing slope instability.

This project includes replacement of the storm pipe from Makah Ct. to the outfall and outfall reconstruction and extension to the stream channel. Hillslope rehabilitation will be conducted in conjunction with the pipe and outfall replacement to incorporate energy dissipation and minimize future erosion and slope instability. A lump sum of \$20,000 is reflected in the cost estimate for a geotechnical evaluation prior to design and construction, to evaluate hillslope rehabilitation options.

Potential rehabilitation and bank stabilization options include rock buttresses or the import of new fill material and horizontal plantings. These options are typical approaches to correcting typical bank failures. For planning-level cost estimation purposes,

installation of rock buttresses is proposed (Figure 1). However, upon geotechnical consultation and consideration of the final pipe and outfall design, bioengineering solutions may be feasible and/or appropriate (Figure 2).

**Design Considerations**

- Only planning level calculations have been performed to identify pipe size and hillslope reinforcement needs to determine a conceptual project cost.
- A geotechnical evaluation is recommended prior to detailed design to evaluate soil and groundwater conditions in this area and select a preferred design approach in consideration of site conditions and constraints.

**Planning-level Cost Estimate**

Capital Expense Total (including contingency)	\$ 104,000
Geotechnical Engineering (LS)	\$ 20,000
Engineering and Permitting (35%)	\$ 37,000
Administration (10%)	\$ 10,000
<b>Capital Project Implementation Cost Total*</b>	<b>\$ 171,000</b>

*\*Planning level cost estimates estimated in 2018 dollars, rounded to the nearest thousand. The rounded total cost is based on non-rounded subtotals.*

**Additional Project Information**



**Image 1. Perched outfall from Blake Street with severe bank failure**

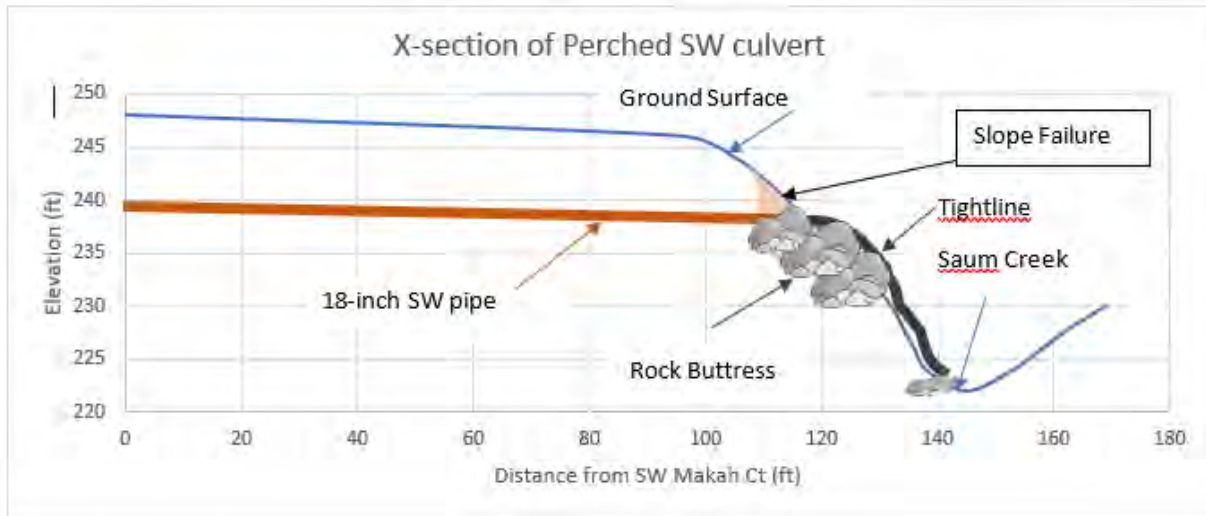


Figure 1. Hillslope Rehabilitation Option - Rock Butress


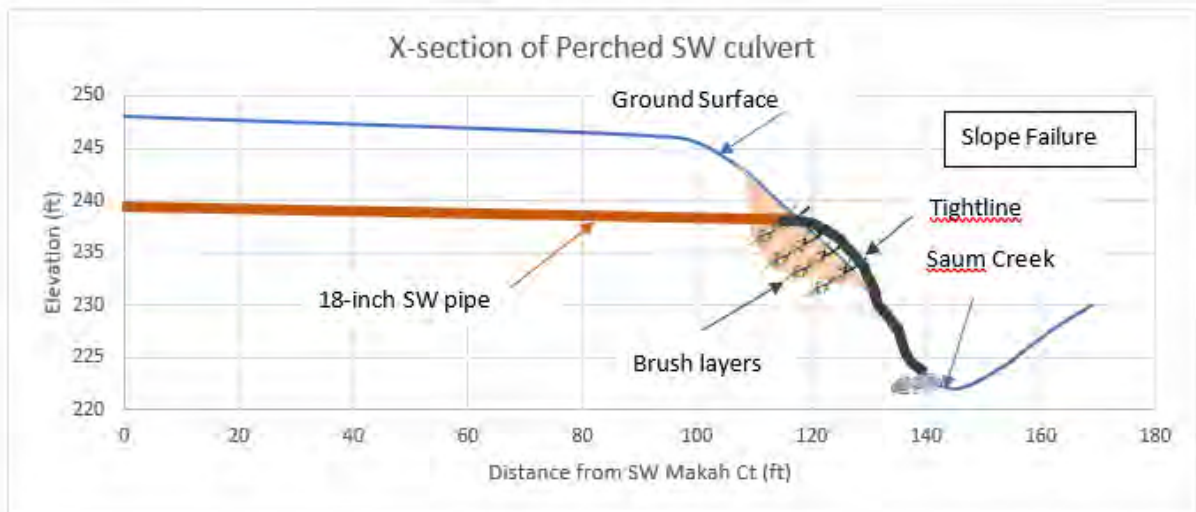


Figure 2. Hillslope Rehabilitation Option - Bioengineering with Brush Layering



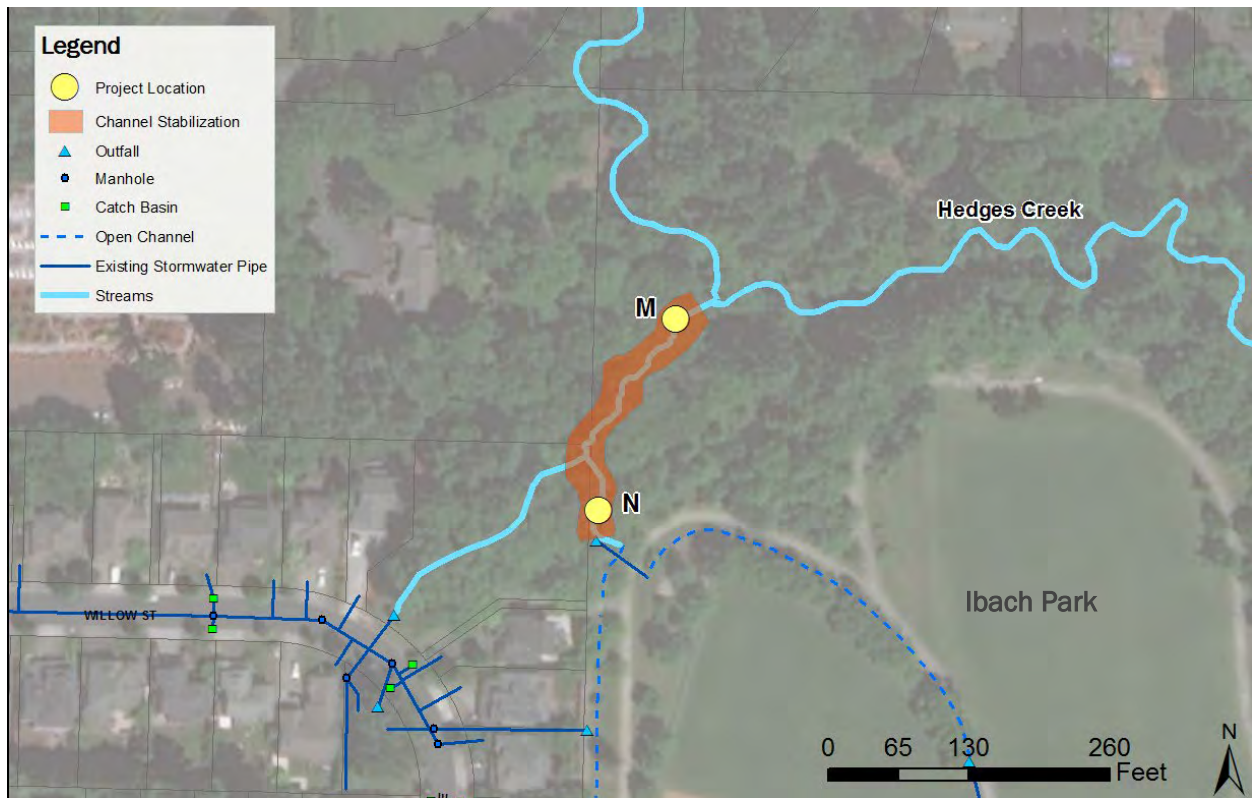

Project Identifier	CIP #20
Project Name	Hedges Creek Stream Repair
Detailed Location	SW 106 <sup>th</sup> Ave and Willow Street at Hedges Creek
Model File	N/A
Contributing Drainage Area	32.7 acres to outfall
Estimated Existing/Future Impervious %	23.5%/29.3%
Project Objective(s)	Addresses Erosion

**Project Background**

Site visits, including a field stream assessment in September 2017, identified active bank erosion in this stream reach vicinity and potential project needs. This project was also identified through a separate evaluation for the City Parks Department (Hedges Creek Stream Assessment, February 2018).

The outfall at the corner of SW Willow Street and SW 106<sup>th</sup> Ave discharges stormwater runoff to a tributary to Hedges Creek from upland residential development. Development in this area appears to be constructed with limited stormwater flow control, resulting in hydromodification along this tributary. Location 'M' was observed to have active erosion occurring adjacent to, upstream and downstream of an existing sanitary manhole. Location 'N' was not visited as part of the stream assessment but reflects similar erosion conditions as location 'M' with evidence of erosion at the pipe outfall. Observations for Location 'N' are documented in the separate evaluation for the City Parks Department.

**Project Description**

This project addresses instream channel erosion and threatened public infrastructure. Corrective actions are referenced directly from the Hedges Creek Stream Assessment by others. Site 'N' activities include an outfall extension, bioengineered slopes, streambed fill and vegetation restoration. Site 'M' activities include open channel excavation, stream bed fill, and installation of a retaining wall.

**Design Assumptions and Considerations**

- Detailed design information related to the proposed corrective actions are included in the “Hedges Creek Stream Assessment, SW Ibach Street to SW 105th Avenue”, February 2018, GreenWorks PC and OTAK, Inc.
- Costs summarized below were taken directly from the “Hedges Creek (SW Ibach Road to SW 105th Avenue) Stream Assessment, CIP Opinion of Construction Costs for Identified Sites”, February 2018, GreenWorks PC and OTAK, Inc.
- Corrective actions employed along this reach should consider both protection of sanitary system infrastructure and channel and outfall stabilization to prevent further erosion.

**Planning-level Cost Estimate Locations ‘M and N’\***

Capital Expense Total (including contingency)	See referenced study
Engineering and Permitting	See referenced study
Project Administration	See referenced study
<b>Capital Project Implementation Cost Total (Location M)</b>	<b>\$ 147,000</b>
<b>Capital Project Implementation Cost Total (Location N)</b>	<b>\$ 180,000</b>
<b>Capital Project Total (Location M and N)</b>	<b>\$ 327,000</b>

*\*Planning level cost estimates based on “Hedges Creek (SW Ibach Road to SW 105th Avenue) Stream Assessment, CIP Opinion of Construction Costs for Identified Sites”, February 2018, GreenWorks PC and OTAK, INC.*

**Additional Project Information**




**Image 1. Location ‘M’ exposed sanitary manhole and incised tributary**





Image 2. Location 'N' outfall and channel erosion (photo provided by OTAK)



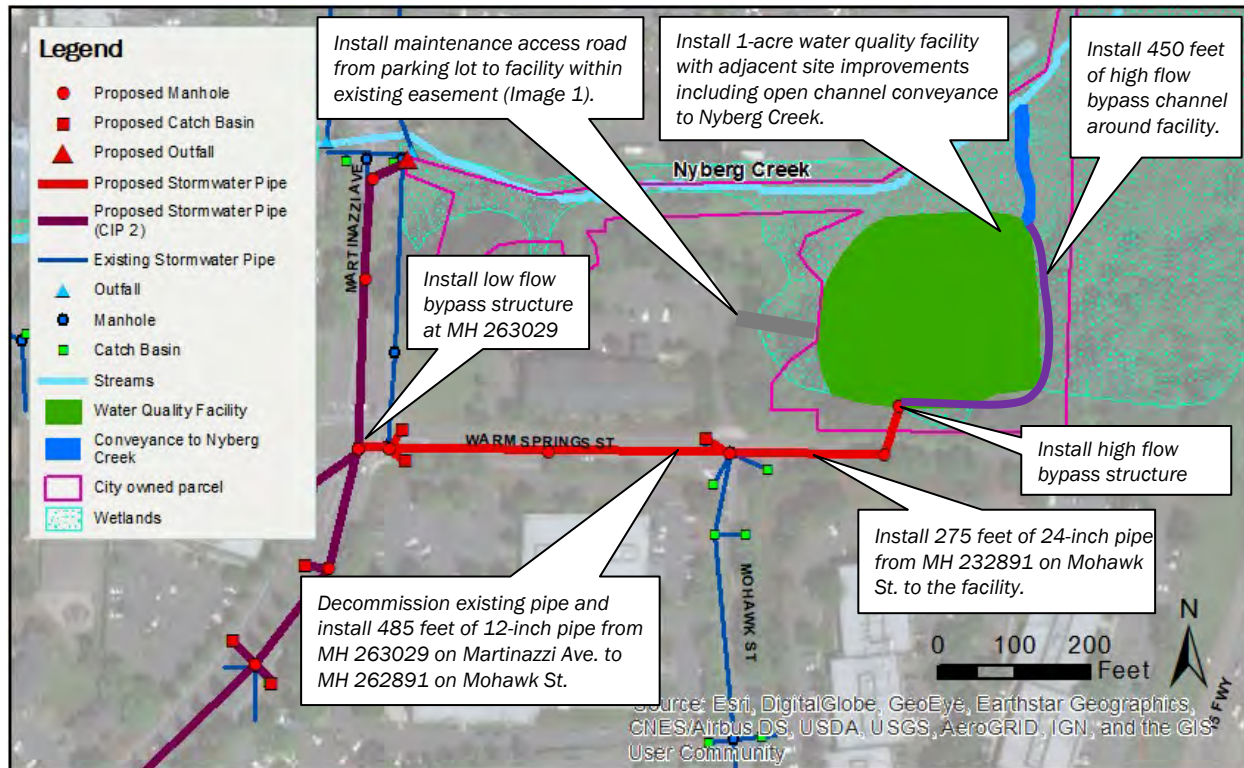

Project Identifier	CIP #21
Project Name	Nyberg Water Quality Retrofit
Detailed Location	Warm Springs Street east of Martinazzi Avenue at City-owned parcel adjacent to Nyberg Creek
Model File	N/A
Contributing Drainage Area	89.7 acres
Estimated Existing /Future Impervious %	55.1%/62.2%
Project Objective(s)	Increases Water Quality Treatment (Retrofit)

**Project Background**

The City recently acquired property adjacent to Nyberg Creek and identified it as a water quality retrofit opportunity, due to the potential for treatment of a large contributing area with high pollutant load potential. Site reconnaissance including review of physical site conditions and potential conveyance system routing was conducted. A desktop GIS evaluation to assess environmental overlays and floodplain extents was also conducted.

Approximately 90 acres of contributing area can be routed to the facility via the existing storm pipe on Mohawk Street and pending construction of CIP #2, Phase 1 along Martinazzi Avenue.

The property is heavily vegetated with mature alder and cottonwood trees. Invasive vegetation dominates the site, specifically blackberries in the upper (higher) portion of the site and reed canary grass in lower portions of the site. Most of the property and proposed facility footprint is within the boundary of the 100-year floodplain and a delineated wetland (W4 per local wetlands inventory). Development of this site as a water quality facility will require federal and state permitting via a Joint Permit Application. Permitting requirements anticipated include an updated wetland delineation, wetland mitigation, and a FEMA no-rise evaluation. Additional site-specific requirements may be identified during the permitting process by the Army Corps of Engineers and Oregon Department of State Lands (Agencies).

**Project Description**

This project provides water quality treatment for a large upstream, untreated contributing drainage area. The conceptual design was developed to maximize water quality treatment based on physical site conditions and available area within the City-acquired property. A 1.5-acre total footprint was identified per discussions with City staff. This area assumes approximately 1-acre for the water quality facility and the remaining 0.5-acres for adjacent site improvements and grading.

The project concept does not provide flow control or address instream channel improvements. Low flows (water quality flow) from contributing drainage area along Martinazzi Avenue will be diverted to the facility while higher flows will continue to be routed down Martinazzi Avenue to the outfall at Nyberg Creek. Total flow from subbasins NY-0230 and NY-0171 (along Warm Springs Street and Mohawk Street) will initially be routed to the facility, and peak flows will be routed around the facility to Nyberg Creek via a high flow bypass channel. Elements of the conceptual design reflected in the cost estimate include:

- Installation of a low flow bypass structure at the intersection of Martinazzi Avenue and Warm Springs Street.
- Installation of 485 LF of 12-inch pipe on Warm Springs Street between Martinazzi Avenue and Mohawk Street.
- Installation of 275 LF of 24-inch pipe on Warm Springs Street between Mohawk Street and the facility.
- Installation of 4 manholes and 3 catch basins along Warm Springs. 100 LF of 12-inch inlet leads are also reflected in the cost estimate for the connection of new and existing catch basins.
- Installation of a flow control structure and debris forebay at the inlet to the facility. The flow control structure will include a high flow bypass channel around facility to discharge to Nyberg Creek.
- Installation of approximately 1 acre of a tiered water quality facility (i.e., raingarden) with beehive overflows and piped connections to the high flow bypass channel. 75 LF of 12-inch piping to connect beehive overflows within the facility to the bypass channel are also reflected in the cost estimate.
- Construction of new open channel conveyance to outfall to Nyberg Creek.

**Design Considerations**

- To capture and treat the maximum drainage area (90 acres) described in this CIP, it must be constructed concurrently or following CIP #2, Phase 1 (Nyberg Creek Stormwater Improvements). Alternatively, the facility could be designed to only treat stormwater conveyed along Warm Springs Street and Mohawk Street.
- An updated wetland delineation will be required to confirm wetland boundaries, mitigation requirements, and wetland condition.
- Actual treatment area and facility footprint to be determined during the preliminary design phase and may vary based on results from the updated wetland delineation.
- 1.5 acres of wetland mitigation is included in the cost estimate; actual mitigation area requirements will be determined by DSL during the permitting process. Wetland mitigation cost was based on a \$155,000 per acre price quoted by the Butler Mitigation Bank in the Tualatin Valley, dated March 2019.
- Cost to acquire additional construction or maintenance easements are not included in the cost estimate.

**Planning-level Cost Estimate**

Capital Expense Total (including contingency)	\$ 1,234,000
Engineering and Permitting (35%)	\$ 432,000
Administration (10%)	\$ 123,000
Wetland Delineation (LS)	\$ 15,000
Wetland Mitigation (LS)	\$ 233,000
<b>Capital Project Implementation Cost Total*</b>	<b>\$ 2,037,000</b>

\*Planning level cost estimates estimated in 2018 dollars, rounded to the nearest thousand. The rounded total cost is based on non-rounded subtotals.

Additional Project Information

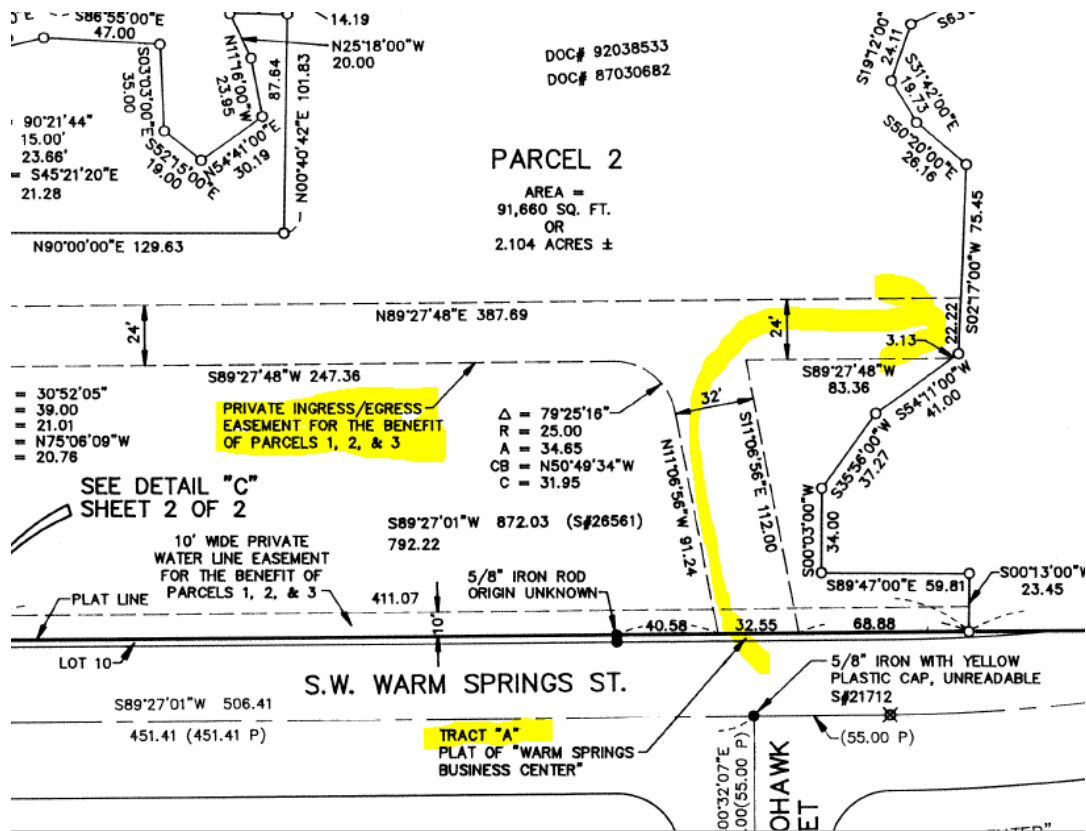


Image 1: Existing easement for site access



Image 2: Existing easement for site access, looking east



Image 3: Proposed location for water quality facility

## **Appendix B: Data Compilation and Preliminary Stormwater Project Development (TM1)**

---







# Technical Memorandum


6500 SW Macadam Avenue, Suite 200  
Portland, OR 97239

T: 503.977.6607  
F: 503.244.9095

Prepared for: City of Tualatin  
Project title: Stormwater Master Plan  
Project no.: 149233

## Technical Memorandum #1

Subject: Data Compilation and Preliminary Stormwater Project Development  
Date: April 24, 2017  
To: Dominique Huffman, P.E., City Project Manager  
From: Angela Wieland, P.E., BC Project Manager

Prepared by:   
Angela Wieland, P.E.

Reviewed by:   
Krista Reininga, P.E.

### Limitations:

*This document was prepared solely for City Tualatin in accordance with professional standards at the time the services were performed and in accordance with the contract between the City of Tualatin and Brown and Caldwell dated April 11, 2016. This document is governed by the specific scope of work authorized by City of Tualatin; it is not intended to be relied upon by any other party except for regulatory authorities contemplated by the scope of work. We have relied on information or instructions provided by the City of Tualatin and other parties and, unless otherwise expressly indicated, have made no independent investigation as to the validity, completeness, or accuracy of such information.*



# Table of Contents

---

List of Tables.....	ii
List of Figures .....	ii
Introduction.....	1
Section 1: Data Compilation and Review.....	1
1.1 GIS System Data .....	1
1.1.1 Preliminary Mapping.....	2
1.1.2 GIS Data Use Assumptions .....	2
1.2 Datum Conversion .....	3
1.3 Reports and Studies .....	4
Section 2: Stormwater Basis of Planning.....	5
2.1 Stormwater Regulatory Drivers .....	5
2.1.1 NPDES Permit Requirements.....	5
2.1.2 TMDL and 303(d) Listings.....	6
2.2 Design Standards and Criteria .....	7
2.3 Land Use and Impervious Coverage .....	8
2.3.1 Land Use Development .....	8
2.3.2 Impervious Percentages by Land Use .....	10
Section 3: Preliminary Stormwater Project Identification .....	11
3.1 Stormwater Surveys.....	11
3.2 Water Quality Retrofit Evaluation.....	11
3.2.1 Methodology.....	12
3.2.2 Results.....	12
3.3 Site Visits .....	13
3.4 Stormwater Project Opportunity Areas .....	13
3.4.1 Programmatic Opportunities.....	13
3.4.2 Modeling Needs.....	14
3.4.3 Next Steps.....	14
Section 4: References .....	14
Attachment A: Matrices.....	A-1
Attachment B: Maps.....	B-1



## List of Tables

---

Table 1-1. GIS System Data Gaps and Assumptions .....	2
Table 1-2 Existing Stormwater Planning Documentation and Reports.....	4
Table 2-1. Drainage Standards and Design Criteria .....	7
Table 2-2. Land Use Categories and Impervious Percentages.....	9

## List of Figures

---

Figure 1-1: Original GIS Rim Elevation Comparison with LIDAR (July 2016) .....	3
Figure 1-2: Updated GIS Rim Elevation Comparison with LIDAR (August 2016) .....	4



## Introduction

The City of Tualatin (City) is developing a stormwater master plan update to guide stormwater program and capital project decisions. The stormwater master plan (SMP) will address both water quantity and quality for constructed systems under the City's management. The master plan requires a clear understanding of existing and future runoff conditions across the city to identify long-term stormwater project needs.

This technical memorandum (TM1) has been developed to document the following:

- Data collection and compilation efforts to date,
- Stormwater planning criteria as identified through code review efforts, and
- Methods used to preliminarily identify stormwater project opportunities, including the water quality assessment to define water quality retrofit opportunity areas.

Through the data collection efforts, which included workshops with City staff and multiple site visits, a preliminary list of 16 stormwater project opportunities have been vetted and are anticipated for stormwater project development as part of the master planning effort.

Section 1 of this TM1 summarizes the data compilation efforts, specifically receipt of GIS data and review of various reports and studies. Section 2 outlines the criteria used for stormwater planning based on review of the Tualatin Development Code (TDC), Public Works Construction Code, and Clean Water Services (CWS) Design and Construction Standards. Section 3 outlines the process and results of the preliminary stormwater project identification efforts, which included stormwater system surveys, a water quality assessment, and site visits.

## Section 1: Data Compilation and Review

In April 2016, BC provided a list of data needs to the City to initiate the master planning project effort. Data needs included GIS system information, background data and reports, City organizational information, stormwater surveys, maintenance program information and procedures, and additional financial information to support the sanitary and stormwater utility rate evaluations.

The project kick-off meeting was conducted on May 16, 2016. Data needs were discussed during the meeting and clarification was provided as necessary. BC's data request was primarily fulfilled over the course of four months (May through October 2016) as part of six separate data packages. Outstanding data needs (as of March 2017) are primarily related to financial information to support the sanitary rate evaluation. This delay is related to sanitary master planning schedule delays and changes related to the sanitary capital improvement project (CIP) total project cost. A summary of financial information in support of the rate evaluations is not included as part of this TM.

This section summarizes results of the data compilation and review efforts, specific for GIS system data and background reports and studies.

### 1.1 GIS System Data

GIS system data were provided in geodatabase format to BC as part of three data submittals: May 24, 2016, May 31, 2016, and August 4, 2016. GIS system data included shapefiles defining city limits, concept planning areas (future growth areas), waterbodies, taxlots, planning district coverage (zoning), impervious coverage, drainage basins, City-owned open space (parks, greenways, and natural areas), water quality facilities, and multiple natural resource overlay districts. Additional, individual shapefiles were provided to BC intermittently since August 2016 to address specific questions or to supplement previously provided information.

LIDAR and aerial photos were provided to BC on an external hard drive on June 14, 2016 and downloaded directly by BC.

Base map data including taxlots, soils, streams, and roadways/ right of way (ROW) were developed as a subset of METRO RLIS data and were provided by the City directly. BC did not process or obtain additional external information to support the data compilation effort unless identified to address an observed data gap.

BC independently reviewed the GIS data to identify applicable shapefiles for use in supporting system mapping, hydrologic analysis, and future hydraulic evaluations. Initial observations and data gaps were identified for discussion with the City. Proposed data assumptions and interpretations were documented.

Attachment A, Table A-1 summarizes GIS data received by date and outlines the initial observations, data gaps, and proposed data assumptions. Metadata or source data is summarized. Relevant fields to be used in the master planning efforts are indicated. Table A-1 was provided to the City in draft form to facilitate discussion of data gap resolution (see Section 1.1.2).

### 1.1.1 Preliminary Mapping

In conjunction with review of the GIS system data, BC prepared preliminary maps identifying project extents, major drainage basins and natural features, topography and soils, and stormwater drainage system features.

Preliminary mapping is included in Attachment B, Figures 1 through 3.

### 1.1.2 GIS Data Use Assumptions

BC met with the City on July 28, 2016 to review the initial GIS data summary and discuss gap resolution. Preliminary mapping was provided to facilitate discussion.

Table 1-1 summarizes the major data gaps and proposed resolutions. Detailed documentation of data gap resolution and data assumptions by topic is documented in Attachment A, Table A-1.

Table 1-1. GIS System Data Gaps and Assumptions		
Data Need	Data Gap	Data Resolution and Assumptions
Land Use	No comprehensive land use coverage was available.	BC developed based on planning district coverage, developable lands coverage (vacant or infill), and undevelopable open space. See Section 2.3.
Undevelopable Open Space Areas	Multiple open space layers were provided. Interpretation of overlay districts was needed to accurately characterize open spaces as developable or undevelopable.	BC developed based on areas designated as wetlands, NRPO, Wetlands Protection Areas (a subset of the Wetland Protection District [WPD]), and City-owned parks, greenways, and natural areas.  Development is permitted in the Wetland Fringe Area (WFA) and Sweek Pond Management Area, so these areas were excluded as part of the WPD.
Concept Planning Areas	Planning district and developable (vacant) lands coverage was only available for the Northwest and Southwest Concept Planning Areas. Input was needed to confirm how concept planning areas should be included in the project extents.	Concept planning areas were included in the project extents. The Basalt Creek Concept Planning Area was included in the hydrology modeling effort based on existing development coverage only.
Drinking and Irrigation Wells	Well location information was not available and is necessary to obtain rule authorizations and complete a system assessment.	Work to assess rule authorizations and develop a system evaluation was deferred. No additional work is needed now.

## 1.2 Datum Conversion

As part of the GIS data review, BC conducted a cursory review of available storm system data. Storm system information (size, material, elevations) was provided in both a structure GIS layer and a pipe GIS layer. Missing data were observed in both layers. BC proposed addressing gaps in rim elevation data by supplementing existing data with rim elevations interpreted from LIDAR. However, use of LIDAR assumes consistent datums (NAVD 88) are being used.

To determine whether a different datum was reflected in the City’s GIS, BC conducted an initial comparison of rim elevations from GIS with rim elevations interpreted from LIDAR (NAVD88 datum), and most rim information in GIS appeared to be inconsistent with elevations interpreted from LIDAR (see Figure 1-1). The average elevation difference of approximately 3 to 4 feet is consistent with the datum correction of 3.52 feet between NGVD 29 and NAVD 88.

In July 2016, a decision was made to convert the City’s system information to the NAVD 88 datum. Thus, the City universally corrected their system elevation data by +3.52’ to align more accurately with the NAVD 88 datum. The system information was updated and provided to BC in August 2016. A follow up review was conducted of the corrected rim elevation data (see Figure 1-2). Although some discrepancies existed, the corrected elevation data appeared more consistent with elevations interpreted from LIDAR. A decision was made to move forward with the corrected elevation data.

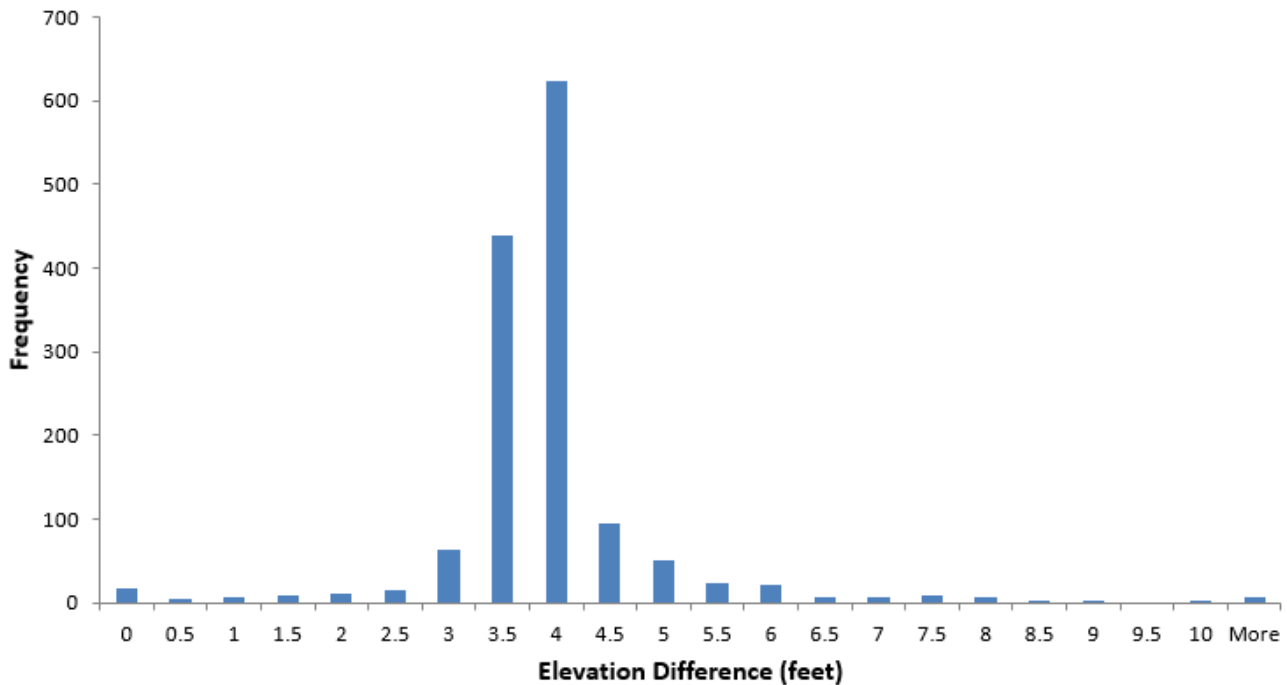


Figure 1-1: Original GIS Rim Elevation Comparison with LIDAR (July 2016)

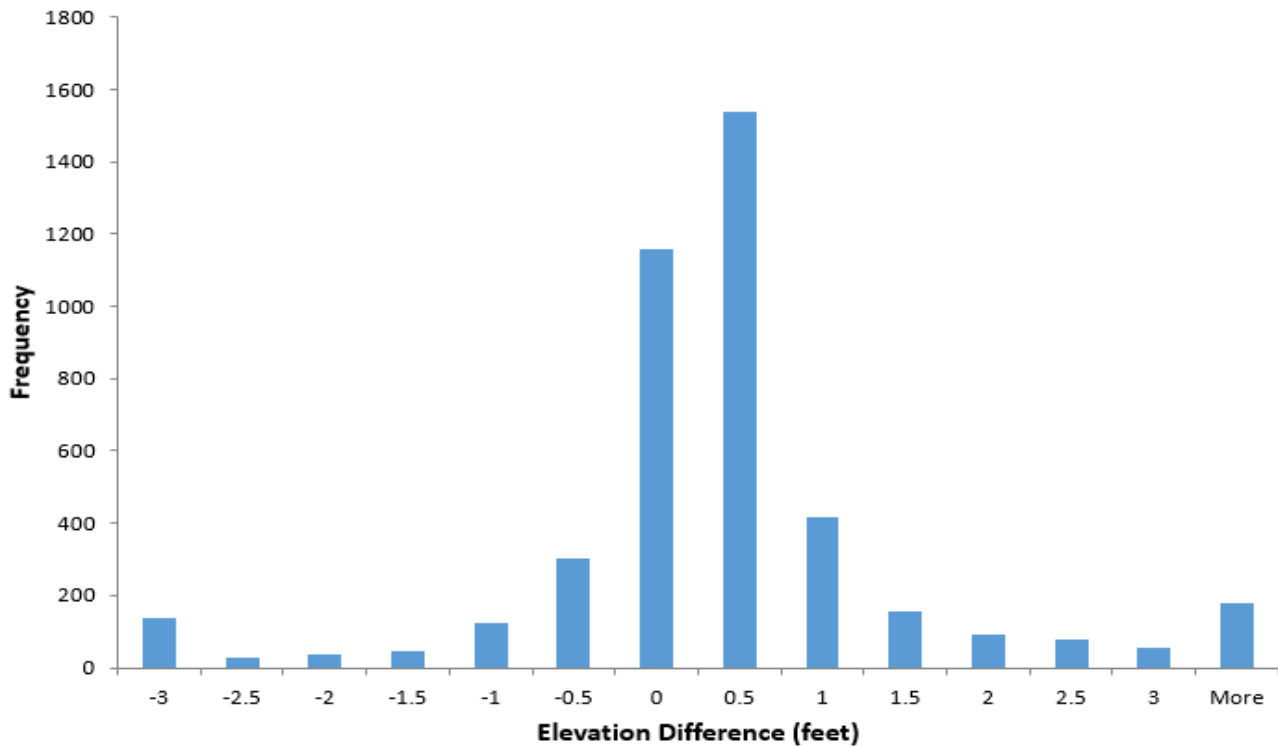


Figure 1-2: Updated GIS Rim Elevation Comparison with LIDAR (August 2016)

### 1.3 Reports and Studies

The City’s last stormwater master plan was completed in 1972. Identified capital improvement project needs are now outdated no longer reflective of current development activities, population growth, and regulatory drivers.

Throughout the last 10 years, the City has been one of the fastest growing communities in Oregon, which has prompted the need to invest in infrastructure and consider long range planning and policy decisions to support businesses and residential life. BC obtained copies of various planning-level reports and studies prepared since the last stormwater master plan to help inform areas of high growth potential and identify stormwater system deficiencies and needs. Reports and studies reviewed and considered for this master plan update are detailed in Table 1-2.

Table 1-2 Existing Stormwater Planning Documentation and Reports		
Report	Date	Summary and application to the SMP
Tualatin Drainage Plan Report	1972	Provides background information and historic basis for the need to update the SMP.
Hedges Creek Wetlands Master Plan	2002	Provides stormwater management recommendations (culvert upsizing under Tualatin Road, sediment removal) related to the 29-acre Hedges Creek Wetlands.
Bridgeport Area Stormwater Master Plan	2005	Provides stormwater system information and a subbasin delineation in the Bridgeport Development Area.
Southwest Tualatin Concept Plan	2010	Provides guidance for industrial development in southwest Tualatin. Planning district/ zoning designation is available.





Table 1-2 Existing Stormwater Planning Documentation and Reports		
Report	Date	Summary and application to the SMP
Basalt Creek Existing Conditions Report	2014	Provides surrounding land use and demographic information for the Basalt Creek Planning Area. Does not provide official planning district/ zoning designation or proposed transportation corridors.

## Section 2: Stormwater Basis of Planning

Design standards related to the sizing and design of stormwater infrastructure are described in the City of Tualatin Public Works Construction Code (PW Standards), dated February 2013. The City often defers to the Clean Water Services (CWS) Design and Construction Standards (2007) and the CWS LIDA Handbook (2009) for water quality and detention facility-specific sizing and design standards.

Additional planning guidelines used to develop the basis of planning for this SMP are described in the City of Tualatin Development Code (TDC) and the Tualatin City Charter, Chapter XI. The TDC, specifically Chapters 3, 5, 6, 7, 8, 71, and 72 define assumptions related to the planning district designations and open space designations that informed the development of land use coverage and hydrologic modeling assumptions for this project. The Tualatin City Charter, Chapter XI, documents protection of city-owned parks and open space and sets limitations on the use of public property for alternative purposes including stormwater management without an approving vote, if such use was not already in place.

Collectively, these documents compose the basis of planning criteria and assumptions used in development of the SMP.

Attachment A, Table A-2 includes a summary of code and additional background data reviewed to establish the stormwater basis of planning criteria.

### 2.1 Stormwater Regulatory Drivers

Regulatory drivers considered in the context of this SMP include Phase I National Pollutant Discharge Elimination System (NPDES) municipal separate storm sewer (MS4) permit requirements and regulatory drivers associated with the total maximum daily load (TMDL) program and 303(d) listings for receiving waters.

#### 2.1.1 NPDES Permit Requirements

The City is a co-implementer on the CWS watershed-based NPDES permit, along with 12 other jurisdictions in Washington County, for management of stormwater runoff. CWS’ NPDES permit was reissued in May 2016 after being administratively extended for seven years after the previous permit expired in 2009.

Implementation of CWS’ NPDES permit is outlined in the CWS Stormwater Management Plan (SWMP). Stormwater activities or best management practices (BMPs) are outlined to address the elements of the permit:

- Illicit Discharge Detection and Elimination
- Industrial and Commercial Facilities
- Construction Site Runoff Control
- Education and Outreach
- Public Involvement and Participation
- Post-Construction Stormwater Management



- Pollution Prevention for Municipal Operations
- Stormwater Management Facilities Operation and Maintenance Activities

Coordination efforts between co-implementers (including the City) and CWS are identified in the SWMP and outlined in more detail in intergovernmental agreements with CWS for specific permit elements. The City maintains IGAs with CWS for erosion and sediment control and system operation and maintenance.

In addition to the permit elements listed above, the reissued NPDES permit requires CWS and co-implementers to prepare a stormwater retrofit strategy, prepare a hydromodification assessment (to address instream channel erosion and modifications), conduct environmental monitoring activities, and develop TMDL pollutant load reduction benchmarks (see Section 2.1.2). These additional requirements will influence the City's stormwater program over the next permit term and will presumably result in increased focus and efforts on stormwater retrofits for water quality improvements, instream natural channel conditions and protection measures, and stormwater design standards to protect receiving waters from increases in pollutant discharge, peak flows, and increased flow duration.

### 2.1.2 TMDL and 303(d) Listings

The majority (approximately 97%) of the City discharges to the Tualatin River and tributaries. Major tributaries include Nyberg Creek, Hedges Creek, Cummins Creek and Saum Creek. Area along the northern portion of the City discharges north directly to the Tualatin River, whereas the tributaries generally run east-west across the City before discharging into the Tualatin River. The Tualatin River is a major tributary to the Willamette River.

The remainder (approximately 3%) of the City discharges to Basalt Creek, a tributary located in the southern portion of the City, which runs south to Coffee Lake Creek in the City of Wilsonville before discharging to the Middle Willamette River.

Water quality impairment and exceedance of water quality standards in the Willamette and Tualatin Rivers have prompted these rivers and corresponding tributaries to be placed on the State 303(d) list for various parameters of concern. TMDLs have then been developed to address specific sources of pollutant loading. CWS is identified as a discharge management agency (DMA) in the respective Tualatin Subbasin and Willamette Basin TMDLs, and the City is identified as a contributing municipality associated with CWS. As such, TMDL pollutant load reductions (in the form of TMDL benchmarks) are required as part of the CWS NPDES permit compliance and represent another regulatory driver promoting implementation of BMPs to reduce pollutant discharges in stormwater.

The Tualatin Subbasin TMDL was developed in 2001 and amended in 2012 to address various sources of pollutants including stormwater runoff from urbanized areas. Pollutants addressed in the TMDL include temperature, bacteria (*E. coli*), chlorophyll a and pH (total phosphorus is used as a surrogate measure), and DO (ammonia and settleable volatile solids are used as a surrogate measure). Pollutant load allocations are established by source and vary by stream reach and whether the discharge occurs to the tributary or mainstem.

The Willamette Basin TMDL was developed in 2006. Pollutants addressed in the TMDL include temperature, bacteria (*E.coli*), and mercury. Like the Tualatin Subbasin TMDL, pollutant load allocations are also established by source and vary based on the location of such discharge.

Additional water quality impairments relevant to the City are reflected on the effective (2012) 303(d) list for receiving waters within the City. Parameters of concern for the Tualatin River include ammonia, biological criteria, copper, iron, lead, and zinc. Parameters of concern for the Middle Willamette River include aldrin, biological criteria, DDT/DDE, dieldrin, iron, and polychlorinated biphenyls (PCBs). Such parameters represent additional targeted parameters for pollutant reduction with the City's stormwater program, as TMDLs are slated for development for these parameters in the future.



## 2.2 Design Standards and Criteria

BC reviewed both the City’s PW Standards and the CWS Design and Construction Standards (2007) and the CWS LIDA Handbook (2009) to establish planning criteria relevant to the analysis of the City’s stormwater system. Planning criteria will help identify where the system has capacity limitations and the basis for design of stormwater projects for water quality, condition improvements, and capacity. Assumptions specific to the development of land use and impervious percentages by land use are described in Section 2.3. Applicable design criteria are referenced in Table 2-1.

Table 2-1. Drainage Standards and Design Criteria		
Criteria	Source	Value
Water Quality Facility Design	PW Standards (206.8)	Design to requirements of CWS Design and Construction Standards and CWS LIDA Handbook. Specific to the PW Standards, facilities are required to have 4' or 6' vinyl coated chain link fencing.
Water Quantity Facility Design	PW Standards (206.8) CWS Design and Construction Standards	Design to requirements of CWS Design and Construction Standards. Match pre- and post-development flow for the 2-year, 10-year, and 25-year, 24-hour storm events.
Pipe Design Storm	PW Standards (206.3)	Design to the 25-year storm event. Surcharge during the 25-year is not permissible. <sup>1</sup>
Pipe Size	PW Standards (206.4)	10" minimum diameter for pipe from catch basins to the main in the public right-of-way 12" minimum diameter for mains in the public right-of-way
Manning’s Roughness	PW Standards (Table 206-8)	Varies by material and shape
Pipe Material	PW Standards (206.4)	Concrete, PVC, Ductile Iron, and Aluminum Spiral Rib Pipe
Pipe Cover	CWS Design and Construction Standards	Table 5-2, varies by pipe material
Structure Spacing	PW Standards (206.4)	250' maximum for 10" pipe; 400' maximum for 12" pipe
Manhole Size	PW Standards (206.6)	48" diameter minimum

1. The City’s Public Works standards reference the rational method for conveyance design. SBUH was an approved equivalent as discussed with the City during the July 28, 2016 meeting.

In conjunction with their recently reissued NPDES Permit, CWS is undertaking a 3-year, phased approach to update their Design and Construction Standards. The phased approach is proposed to meet new permit requirements related to the: 1) impervious threshold for requiring treatment, 2) prioritization of low impact design approaches (LIDA) and green infrastructure (GI), and 3) strategies and priorities for addressing hydro-modification impacts. CWS published their updated Design and Construction Standards to address items 1) and 2) on March 28, 2017 and the updates are scheduled to take affect April 22, 2017. Although most changes proposed now do not directly affect the design standards and criteria being used for the SMP, more significant updates are listed below for reference.

- Updated/ added definitions for LIDA, modify or modification (related to impervious surface), redevelopment,
- Requirements for water quality treatment for development activities that create or modify 1,000 square feet or greater impervious surface, including single family development on lots of existing record.
- Explicit provisions emphasizing use of LIDA and GI in Chapter 4 (Runoff Treatment and Control).
- Adjusted criteria for treatment of existing/ undisturbed impervious area when new/ modified impervious area is applied to a project site. These criteria replace former Table 4-1 of the 2007 CWS Design and Construction Standards.

- Incorporation of a simplified sizing factor (6%) for sizing LIDA facilities (planters, raingardens) for water quality where onsite infiltration is >2 inches/ hour. This standard was previously in the LIDA Handbook.
- Incorporation of LIDA facility design criteria from the LIDA Handbook directly into the Design and Construction Standards.
- A summary of approved approaches (facilities) to meet water quality and water quantity criteria (new Table 4-1).
- Updated procedures for performance and corrective actions to adhere to the two-year warranty period for water quality or quantity facilities.

It should be noted that CWS will again be modifying their Design and Construction Standards to address hydromodification needs. The targeted timeframe for this phase of the modifications is April 2018.

## 2.3 Land Use and Impervious Coverage

As described in Section 1.1.2, land use coverage was not available for the City in GIS. Land use coverage is needed to hydrologically evaluate (model) the City and calculate associated stormwater runoff volumes and flows by subbasin. Both existing and future development conditions will be evaluated to identify where flows are expected to increase and inform CIP sizing.

### 2.3.1 Land Use Development

A preliminary land use coverage was developed based on established planning district boundaries, undevelopable open space areas, and vacant lands subject to future development. Following development of the preliminary land use coverage, BC met with City engineering and planning staff on August 26, 2016 to verify preferred land use categories, actual land use coverage, and impervious area assumptions by land use. Following the meeting, minor adjustments were made related to the institutional land use coverage, undevelopable open space, and vacant lands coverage based on actual site usage. The final land use coverage was verified on October 25, 2016 and is shown in Attachment B, Figure 4.

To develop the land use coverage, planning districts were consolidated into general land use categories. Roadway right-of-way (ROW) is incorporated into the planning district coverage, and therefore incorporated into the land use coverage. One exception is the Oregon Department of Transportation (ODOT) corridor, which was defined separately. Feedback from City staff during the August 26<sup>th</sup> meeting resulted in an expansion of the institutional land use coverage to include school and medical (hospital) facilities otherwise classified as a commercial planning district. Table 2-2 summarizes the consolidation of planning district boundaries into general land use categories.

Vacant lands were determined based on the City-provided GIS coverage of developable lands. Developable lands were categorized as vacant, infill, or redevelopable. To develop existing land use coverage, vacant lands were defined as those areas that are currently undeveloped and when developed, will increase in impervious surface (and associated runoff volume). Future land use coverage will exclude vacant lands and simulate only the underlining land use coverage. BC reviewed aerial imagery to verify the development condition of the vacant, infill, and redevelopable areas. From this review, areas classified as vacant and infill were used to define the vacant land use coverage. Although areas classified as redevelopable could result in increased impervious coverage when developed in the future, a conservative assumption was made to assume these areas are currently developed. Feedback from City staff refined the vacant lands coverage based on recent development activities.

Undevelopable open space areas were identified based on City-provided GIS coverage of City-owned parks, greenways, and natural areas; the City's Wetland Protection Area (WPA); wetlands (both significant and less significant), and the City's Natural Resource Protection Overlay (NRPO) District. Based on conditions outlined

in the TDC, these areas are unlikely to develop or change from their current site usage (imperviousness). Undeveloped open space areas excluded wetland fringe areas and area covered by the Sweek Pond Management Area, as these areas may be subject to future development.

City-owned parks, greenways, and natural areas are classified separately from the other undevelopable open space areas due to the additional impervious area (parking areas, paths, etc.) on these sites. City-owned parks, greenways, and natural areas are subject to the Tualatin City Charter, Chapter XI. These areas are public property and, per the Charter, may not be used or developed in a way that causes a major change in the properties use or function without a legal vote by the public. The City has interpreted this provision as limiting these areas from being developed, including being used to facilitate the installation of stormwater facilities. Feedback from City staff resulted in the inclusion of private open space areas (golf courses, parks) into this land use category.

Finally, the Basalt Creek planning area is located outside of the city limits but included as part of this SMP. Planning district coverage has not yet been established for this area. A separate land use category (Basalt Creek planning area) was established to reflect existing development conditions in this area. Future growth and development is expected, but the timeframe is unknown. For purposes of this SMP, future development conditions will not be evaluated or assessed hydrologically for this area.

**Table 2-2. Land Use Categories and Impervious Percentages**

Planning District Designation	Modeled land use category	Impervious % (existing)	Impervious % (future)
Low Density Residential	Low-density residential (LDR)	43	53
Medium Low Density Residential	Medium-density residential (MDR)	45	55
Medium High Density Residential			
High Density Residential	High-density residential (HDR)	50	60
High Density High Rise Residential			
General Commercial	Commercial (COM)	78	78
Central Commercial			
Medical Commercial			
Office Commercial			
Recreational Commercial			
General Manufacturing	Industrial (IND)	74	74
Light Manufacturing			
Manufacturing Business Park			
Manufacturing Park			
Institutional	Institutional (INS)	35	35
	Vacant, developable (VAC) <sup>a</sup>	5	Consistent with the underlying land use designation.
	Open Space (OSP), undevelopable – Parks, Greenways, Natural Areas, Private <sup>b</sup>	5	5
	Open Space (OSP), undevelopable – WPA, Setbacks, NRPO, Wetlands <sup>b</sup>	4	4



**Table 2-2. Land Use Categories and Impervious Percentages**

Planning District Designation	Modeled land use category	Impervious % (existing)	Impervious % (future)
	Transportation (ODOT Corridor)	46	46
	Basalt Creek/ rural residential	7	7

- a. Vacant land use reflects area with new or infill development potential. Future development conditions assume development of vacant lands consistent with their associated planning district designation.
- b. Open space land use reflects area with no foreseeable development potential.

### 2.3.2 Impervious Percentages by Land Use

Impervious coverage by land use was directly calculated using City-provided GIS coverage of impervious surface and supplemented with City-provided GIS coverage of building footprints and right-of-way. Final impervious percentages by land use category are reflected in Table 2-2.

Impervious surface information in GIS was available for most city area except for the low density residential planning district. Impervious surface coverage reflects building rooftop, pavement, and parking areas. The impervious surface coverage was combined with the right-of-way coverage to yield a total impervious area for each land use category (except the low density residential and the Basalt Creek categories). The percentage impervious was directly calculated from the impervious area and the total area for each land use.

For the low-density residential land use coverage, GIS coverage of the building footprints was combined with the right-of-way coverage to directly calculate the percentage impervious.

For the Basalt Creek planning area, aerial imagery was reviewed to estimate a percent impervious representative of existing land use conditions. Three tax lots were selected at random and the observed impervious surface areas (rooftop, parking areas, driveways) were digitized. The percentage impervious applied to the Basalt Creek planning area was calculated based on the digitized impervious area and the total area for the three tax lots.

For each residential (low-density, medium, density, and high density) land use category, aerial imagery was reviewed to spot check the calculated impervious percentages against observed development conditions. Small, distributed impervious surfaces (patios, decks, detached garages, driveways) specific to residential land use is often overlooked in the delineation of building footprint areas (as used for the low-density residential impervious calculations) or other impervious surfaces in GIS. For each land use category, five tax lots were selected at random and the impervious coverage was estimated and compared with the overall calculated impervious percentage. Results of the aerial verification effort did not result in changes to the impervious percentages based on direct calculations.

Due to the potential for redevelopment and infill amongst the residential land use categories, a separate future condition impervious percentage was defined for the low density, medium density, and high density residential land use categories. Each calculated impervious percentage (reflecting existing development conditions) was increased by 10 percentage points to account for added impervious surface area expected with redevelopment. This increase was made independent from the anticipated development of vacant land use.

The existing and future impervious percentages by land use were compared to values used by surrounding communities to ensure general regional consistency. The percentages were also compared with maximum lot densities defined by planning district in the TDC, which reflect the minimum landscaping requirements. Both comparisons did not result in changes to the impervious percentages estimated for this SMP.



## Section 3: Preliminary Stormwater Project Identification

The City opted to develop their SMP using a collaborative approach with engineering, planning, and operations staff to initially assess known stormwater system problems and identify areas where infrastructure improvement, replacement, or retrofit is needed to address an issue. Preliminary stormwater project opportunities were identified through a combination of surveys (distributed to engineering and maintenance staff), a water quality retrofit evaluation, and workshops/ meetings/ site visits with City staff. Portions of the stormwater system that require a modeling approach to evaluate capacity limitations and project concepts were also identified. This overall process allows the City to focus resources and develop information for areas and projects likely to be prioritized in a capital improvement program.

Attachment A, Table A-3 summarizes the results of this collaborative effort including identified preliminary stormwater problem areas and project opportunity areas. Table A-3 includes site visit observations and notes and details related to project concepts and modeling needs.

### 3.1 Stormwater Surveys

BC provided a stormwater questionnaire to City engineering and maintenance staff in May 2016 to solicit feedback related to the condition and function of the stormwater system. Staff were asked to specifically identify and describe areas of the system that experience regular flooding, need infrastructure replacement, require frequent maintenance, need new infrastructure installed, and experience water quality problems. Staff were also asked to comment on what they consider top priority issues or projects to be addressed in the SMP.

Completed questionnaires, along with a separate GIS layer of stormwater trouble areas maintained by the City, were used to develop a list of preliminary stormwater problem areas. A total of 32 preliminary stormwater problem areas were identified and categorized as follows:

- Capacity (bank overtopping)
- Capacity (other)
- Maintenance
- Erosion
- Infrastructure Needs
- Infrastructure Replacement
- Water Quality

BC and the City reviewed the preliminary stormwater problem areas during a series of meetings from June to October 2016. Areas were qualified for follow-up site visits and/or consideration as a stormwater project opportunity area to be evaluated as part of the SMP. Stormwater problem areas identified based on capacity (bank overtopping) were generally excluded during this review, as stream capacity and natural system flooding was not evaluated as part of this SMP.

Table A-3 provides a comprehensive list of the preliminary stormwater problem areas as identified by City staff.

### 3.2 Water Quality Retrofit Evaluation

As a co-implementer on the CWS NPDES permit, retrofit of the stormwater system to improve water quality is a primary objective for this SMP. Stormwater retrofits, specifically the installation of water quality treatment in areas not otherwise treated, will be a focus for CWS over the next NPDES permit term and allows the City to aid in the reduction of TMDL and 303(d) pollutants to improve overall water quality conditions in the Tualatin and Willamette Basins.



Retrofit opportunities will focus on the use of low impact development approaches (LIDA) to the extent possible, consistent with CWS’ proposed retrofit strategy. LIDA includes the use of raingardens, swales, and planters, which promote infiltration and runoff volume reduction in addition to treatment.

### 3.2.1 Methodology

BC evaluated opportunities to install water quality facilities or retrofits in conjunction with observed stormwater problem areas (as referenced in Section 3.1), documented capital improvement project needs (per City’s 2017-2021 Capital Improvement Plan), and available public lands that would support installation of a stormwater treatment facility.

Aligning water quality retrofits with observed stormwater problem areas allows project concepts to be developed to address multiple objectives. Each preliminary stormwater problem area was discussed with City staff and potential project concepts identified to determine if water quality could be supported. As identified, project concepts were expanded to reflect the installation of new water quality facilities (i.e., raingarden, swale) in conjunction with conventional stormwater infrastructure (pipes, catchbasin) needs. Project concepts were also revised to incorporate redesign or reconfiguration of an existing water quality facility to improve treatment, retention or flow control.

The City’s 2017-2021 Capital Improvement Plan included nine identified stormwater projects. Two of these projects qualify as a stormwater retrofit. These projects reflect treatment of large contributing drainage areas using a pretreatment manhole/ proprietary treatment technology to target trash and debris removal. Although use of a proprietary treatment technology is not CWS’s preferred retrofit approach, these proposed projects are in a flat and fully developed area of the City with limited opportunity to use a surface-based LIDA. These two projects would meet CWS’ outfall retrofit program objectives (CWS 2016 SWMP, Section 7.6). Thus, these two projects were maintained as a stormwater project opportunity for this SMP. It should be noted that the other seven stormwater projects identified in the Capital Improvement Plan are either in progress or already reflected as a preliminary stormwater problem area and being considered in this SMP.

Publicly owned properties, particularly those in a natural or park-like setting often provide opportunity to incorporate water quality treatment into a developed landscape. As described previously, the Tualatin City Charter, Chapter XI limits the use of publicly owned parks, greenways, and natural areas to be used outside of its original intent without a public vote. Therefore, City-owned property not subject to the Charter provisions were identified and evaluated as potential water quality retrofit opportunity areas. These areas included larger parcels without current treatment. Topographic and site usage constraints were considered in the identification of water quality retrofit opportunities, and the resulting, identified areas were generally larger, public parking areas or areas within the road right-of-way.

### 3.2.2 Results

A total of 15 water quality retrofit opportunities were identified, and 10 retrofit opportunities overlapped with preliminary stormwater problem areas. These water quality retrofit opportunity areas were included in site visits and evaluated as a potential stormwater project opportunity area.

Table A-3 lists identified water quality retrofit opportunities and incorporates the water quality retrofit element into proposed project concepts as applicable. Attachment B, Figure 5 maps the preliminary stormwater problem areas and water quality retrofit opportunities. Figure 5 also details public property considered for use in the water quality retrofit evaluation.



### 3.3 Site Visits

BC and City staff conducted two site visits to verify preliminary stormwater problem areas and water quality retrofit opportunities, one on June 29, 2016 and one on December 7, 2016. The site visits were used to verify and qualify the problem areas and retrofit opportunities as a stormwater project opportunity to be evaluated and costed in this SMP. The site visits were also used to explore preliminary project concepts.

Prior to each site visit, BC and City staff met to finalize site visit locations, the site visit schedule, and discuss any accessibility or access constraints. Maps were distributed detailing upstream and downstream conveyance. Site visits were documented via meeting minutes and photo logs.

For those locations identified as a problem area due to frequent maintenance needs, effort was made during the site visits to investigate potential sources of pollutant loading. Frequent maintenance needs were often the result of excessive sediment accumulation, debris accumulation, vegetative overgrowth, and backwater conditions. Although maintenance is routinely conducted by the City, select problem areas were identified for consideration as part of a city-wide programmatic stormwater project to proactively inspect and maintain infrastructure at an increased frequency.

### 3.4 Stormwater Project Opportunity Areas

Following the compilation of stormwater surveys and completion of the water quality retrofit assessment and site visits, a total of 16 stormwater project opportunity areas and two city-wide, programmatic efforts were identified. These areas/ efforts represent the City’s initial stormwater project list to be developed and costed as part of the SMP.

Table A-3 identifies the stormwater project opportunity areas and city-wide programmatic efforts. Attachment B, Figure 6 maps the stormwater project opportunity areas and includes a summary of each area by project category(ies). Project categories are as follows:

- Maintenance/ Asset Management – reflects areas experiencing more frequent maintenance needs that would be incorporated into a maintenance inspection and cleaning program.
- Maintenance – refers to stormwater facilities requiring extensive, one time maintenance.
- Direct replacement – refers to the direct replacement of infrastructure that is failing.
- Upsize infrastructure – refers to the replacement and upsizing of infrastructure that is capacity limited.
- New infrastructure – refers to the installation of new infrastructure, often in locations of pending or future development.
- Water quality retrofit – refers to the installation of treatment or flow control to support water quality improvements.

Stormwater project opportunities may be added or removed during stormwater project development. Additionally, the stormwater project opportunity areas may be combined or broken down into phases as project concepts are refined. An upcoming stormwater project planning workshop will be held to discuss and refine these project concepts and opportunity areas.

#### 3.4.1 Programmatic Opportunities

Two city-wide programmatic opportunities were identified to support ongoing assessment and maintenance of existing infrastructure and public water quality facilities. Identification of these activities as a programmatic opportunity means that an annual budget allocation (as opposed to a one-time budget allocation) would be needed to support these efforts. The preliminary project concepts are identified as follows:



1. Public Infrastructure Improvements – This program would include annual pipe inspections (CCTV inspections), targeted maintenance efforts for pipes and inlets (outside of the scheduled maintenance frequency), and an annual pipe replacement program to address condition deficiencies. Asset age is not currently documented in the City’s GIS; however, the City may want to establish a system lifetime age and assume city-wide replacement of the piped infrastructure over a defined timeframe.
2. Public Water Quality Retrofits – Most public water quality facilities manage runoff from subdivisions or other low density residential areas and are located adjacent to private residences (see Figure 5). Often the public is unaware these facilities exist. Citizen complaints are common and are related to system performance and sizing. The City is considering an ongoing program to review and reengineer existing public water quality facilities to ensure visibility and maximize performance.

### 3.4.2 Modeling Needs

Five stormwater project opportunity areas were identified where hydraulic modeling of the stormwater system would help inform observed capacity limitations and refine project concepts. These areas were reviewed with City staff on February 2, 2017 and the extent of hydraulic modeling and survey needs were verified. Detail related to the system modeling objectives and extent is outlined in Table A-3.

1. Stormwater Project Opportunity Area 4 – Manhassat
2. Stormwater Project Opportunity Area 5 – Boones Ferry Road at Oil Can Henrys
3. Stormwater Project Opportunity Area 7 – Herman Road
4. Stormwater Project Opportunity Area 9 – Sagert Street at the Shenandoah Apartments
5. Stormwater Project Opportunity Area 10 – Mohawk Apartments

### 3.4.3 Next Steps

Stormwater project development will occur based on the preliminary project concepts outlined in Table A-3.

System survey was completed in April 2017 in support of the hydraulic modeling efforts. Hydraulic modeling for the identified project opportunity areas is scheduled to occur from April to June 2017.

City staff will participate in a project development workshop following completion of the hydraulic modeling efforts. The workshop will be used to review preliminary results from the hydraulic modeling effort and facilitate discussion of the proposed project concepts including programmatic and asset management project concepts. The outcome from this workshop will include a final stormwater project list for costing and inclusion in the SMP.

## Section 4: References

City of Tualatin (City). 2016. *Capital Improvement Plan 2017 to 2021*.

Clean Water Services (CWS). 2016. Stormwater Management Plan

Oregon Department of Environmental Quality (DEQ). National Pollutant Discharge Elimination System (NPDES) Watershed-based Waste Discharge Permit. Issued to Clean Water Services. Effective May 31, 2016.

DEQ 303(d) database. <http://www.deq.state.or.us/wq/assessment/rpt2012/search.asp#db>. Accessed April 17, 2017.

## Attachment A: Matrices

---

Table A-1: GIS Data Review and Data Gaps

Table A-2: Code and Background Data Review

Table A-3: Stormwater Problem Areas and Project Opportunities



Table A-1: GIS Data Review and Data Gaps

Initial Data Request	Source (Received From)	Date Received	Database Name (if applicable)	File Name	Feature Class	Data Type-Base or Storm	Layer Notes (from City)	Datum	Relevant Fields	Initial Observations and Identified Gaps	Outstanding Questions (per 7-28-16 and 8-24-16 mtgs)	Data Assumptions and Gap Resolution
<b>Base GIS Data</b>												
City Limits	City of Tualatin	5/24/2016 and 8/4/2016	StormMasterPlan.gdb and StormMasterPlan_Additional_Data.gdb	CITY	polygon	Base	City limits	NAD_1983_HARN_StatePlane_Oregon_North_FIPS_3601_Feet_Intl	acres, status, shape_length, shape_area	All data is populated.	What is the date of the City limits file?	City provided an updated city limits shapefile on 8/4/16 reflecting July 2016 to use as the baseline.  BC adjusted the baseline city limits in October 2016 per comments from City planning to add an omitted annexation from spring 2016.
UGB	City of Tualatin	5/24/2016	StormMasterPlan.gdb	UGB	polygon	Base	Tualatin's planning area boundary	NAD_1983_HARN_StatePlane_Oregon_North_FIPS_3601_Feet_Intl	area, perimeter, UGB, UGB ID, acres, shape ST area, shape ST length, shape length, shape area	All data is populated. No concept planning areas defined. Boundary does appear to include SW Industrial area, however it is not specifically identified as such.	What concept planning areas should be reflected in the MP? - NW Tualatin Concept Plan (2005) - SW Tualatin Concept Plan (2010) - Basalt Creek Concept Plan (2016)	Concept planning areas to be shown conceptually and included in the subbasin delineation and current condition hydrologic calculations only.  City provided planning area shapefile reflecting concept planning area delineation on 8/4/16 (see "other data" rows at end of table).
Taxlots	City of Tualatin	5/24/2016	StormMasterPlan.gdb	parcels	polygon	Base	Subset of May 2016 Metro RLIS release	NAD_1983_HARN_StatePlane_Oregon_North_FIPS_3601_Feet_Intl	Area, Owner, Owner Address, BLDG SQFT, a_t_acres, landuse, lat, lon, gis_acres, shape_length, shape_area	All data is populated. Not clipped to the UGB (Tualatin's planning area boundary).		BC to clip to UGB.
Roads and Roadway Classifications	City of Tualatin	5/24/2016	StormMasterPlan.gdb	FUNC_CLASS_F	line	Base	Tualatin's functional classification for future collectors and arterials	NAD_1983_HARN_StatePlane_Oregon_North_FIPS_3601_Feet_Intl	Street_name, type, class, shape_length	All data is populated. Clipped to UGB.	Do the future collectors and arterials extend to the UGB? Outside UGB?	No additional future collector delineation within or outside of UGB. Use data as available.
	City of Tualatin	5/24/2016	StormMasterPlan.gdb	FUNC_CLASS	line	Base	Tualatin's functional classification for existing collectors and arterials	NAD_1983_HARN_StatePlane_Oregon_North_FIPS_3601_Feet_Intl	street_name, functional class name, functional class code, owner, shape_length	All data is populated. Clipped to city limits.		BC to use unclipped regional collector and arterial data from Metro.
	City of Tualatin	5/24/2016	StormMasterPlan.gdb	FREEWAYS	line	Base	Subset of RLIS freeways layer	NAD_1983_HARN_StatePlane_Oregon_North_FIPS_3601_Feet_Intl	street name, ftype, length	All data is populated.	Does City have ODOT ROW?	To the extent ODOT area appears to drain to City system, BC will delineate subbasins accordingly. For mapping purposes, subbasins composed primarily of ODOT area will be shown as "outside of study area".  City provided ROW shapefile on 8/4/16 (see below).
	City of Tualatin	8/4/2016	StormMasterPlan_Additional_Data.gdb	ROW		Base	Polygon file of ROWs.			Includes both ODOT and city, possibly county. Extends beyond City limits and UGB.  Does not indicate ownership of the ROW.		BC to use ROW shapefile to define ODOT ROW and County ROW that are not specifically modeled unless the City's subbasin delineation extends.
Existing Land Use or Impervious Coverage	City of Tualatin	5/31/2016 and 7/21/2016	StormMasterPlan_2.gdb and DevelopableLands.shp	DevelopableLand	polygon	Base	Shows net developable land within Tualatin. This layer was derived from Metro's Regional Vacant Lands inventory (2011) using local knowledge to correct errors of omission and commission. Currently updated through 2015. Land deemed "constrained" was removed from the inventory and the remainder categorized into the following categories: vacant, infill and redevelopable. Lands currently considered "developed" are not included in this dataset.  <b>7/7/16</b> - Constrained lands were defined as 100-year floodplain, floodway, NRPO, 50-foot buffer on all streams and wetlands, steep slopes. Constrained lands were built using the RLIS stm_line layer and could be rebuilt using the also-provided "Streams" layer.  <b>7/7/16</b> - Developable land is categorized - Vacant, Redevelopable, Infill, Null - What do these mean, which should we use to reflect land that is undeveloped and can develop? (BC to spot check against aeriels). Net vacant land within Tualatin. Parcels deemed entirely vacant (no noticeable improvements) regardless of size are included as well as the vacant portions of parcels greater 1/2 acres. Net infill land within Tualatin, OR. Vacant portions of parcels totaling less than 1/2 acre. Land deemed by staff to have redevelopment potential.	NAD_1983_HARN_StatePlane_Oregon_North_FIPS_3601_Feet_Intl	Dev_type, Shape_area	City did not provide existing land use coverage. Land use coverage will have to be developed using developable lands.  Vacant lands appear to be empty lots/fields which are available for development. Redevelopable lands often contain existing structures (parking lots, buildings, etc.) or require fill/grading (e.g. the old quarries in the SW Industrial Area). Only 7 areas identified as infill, mostly small parcel and generally vacant.	Should constrained lands be removed based on the Streams layer as opposed to the stm_line layer?  In the designation of vacant and redevelopable lands, confirm the difference in how these lands were assigned?  Should a vacant land use classification be used for all developable land categories (including infill) or only those large parcel new developments?	BC/ City staff met with planning on August 24, 2016 to confirm land use assumptions. Based on outcome from meeting, BC created a land use coverage based on their planning districts, undevelopable open space, and developable lands deemed vacant. See specific designations described below.  Vacant lands (excluding those defined as redevelopable) to be used to define lands developing into a future land use.

Table A-1: GIS Data Review and Data Gaps

Initial Data Request	Source (Received From)	Date Received	Database Name (if applicable)	File Name	Feature Class	Data Type-Base or Storm	Layer Notes (from City)	Datum	Relevant Fields	Initial Observations and Identified Gaps	Outstanding Questions (per 7-28-16 and 8-24-16 mtgs)	Data Assumptions and Gap Resolution
Existing Land Use or Impervious Coverage (continued)	City of Tualatin	5/31/2016	StormMasterPlan_2.gdb	impervious	polygon	Base	Impervious surface mapping for commercial & industrial land, schools, churches and multi-family sites	NAD_1983_HARN_StatePlane_Oregon_North_FIPS_3601_Feet_Intl	Type, Shape_area	All data is populated. No impervious surface mapping for residential planning districts.	Per TDC Chapter 5, a buildable density is provided per residential planning district in code but not an impervious percentage. How should density be equated to an impervious percentage?  Should mapped impervious be used to develop impervious percentages rather than local data?	Impervious percentage by planning districts are not available. The City wishes to calculate them. Literature values are not preferred.  Based on outcome from August 24, 2016 meeting, BC directly calculated impervious percentage by planning district using impervious coverage information where available. For the low density residential planning district (where mapped impervious coverage is not available), impervious percentages were calculated based on 1) rooftop and roadway coverage and 2) building density for residential planning districts. BC used aerials to truth check impervious coverage for residential planning districts.  BC proposed impervious percentages by land use category for existing and future model development.
Zoning	City of Tualatin	5/24/2016	StormMasterPlan.gdb	PLANDIST	polygon	Base	Tualatin's planning districts. Tualatin is a "one map" city.	NAD_1983_HARN_StatePlane_Oregon_North_FIPS_3601_Feet_Intl	CZONE, CLASS, ACRES, Zone Name, Shape_Length, Shape_Area	All data is populated. Existing and future land use to be based on zone name designation. Classes of land use include Residential, Commercial, Industrial, and Institutional. Zone names include: Central Commercial, General Commercial, General Manufacturing, High Density High Rise Residential, High Density Residential, Institutional, Light Manufacturing, Low Density Residential, Manufacturing Business Park, Manufacturing Park, Medical Commercial, Medium High Density Residential, Medium Low Density Residential, Office Commercial, Recreational Commercial, Vacant (Infill, Vacant, Redevelopable) Parks, Open Space, and Natural Area	Have planning district coverages been established for concept planning areas?  Does the City have impervious assumptions by planning district that include roads?	Land use categories based on consolidated planning districts. Categories include Industrial, Commercial, Institutional, High Density Residential, Medium Density Residential, Low Density Residential.  Refined planning district (zoning) coverage not available for all concept planning areas. Existing land use based on vacant and open space designation to be used in existing hydrologic calculations. Basalt Creek concept planning area to be modeled based on existing impervious coverage (per aerials).  Institutional land use coverage refined during meeting with planning on August 24 to include schools and hospitals.
Topographic Contours	City of Tualatin	5/24/2016	StormMasterPlan.gdb	Contours_2ft	line	Base	Built by CWS primarily from 2014 LIDAR	NAD_1983_HARN_StatePlane_Oregon_North_FIPS_3601	elevation	All data is populated. Not clipped to the UGB (Tualatin's planning area boundary).		BC to clip to area surrounding UGB.
	City of Tualatin	5/24/2016	StormMasterPlan.gdb	Contours_10ft	line	Base	Built by CWS primarily from 2014 LIDAR	NAD_1983_HARN_StatePlane_Oregon_North_FIPS_3601	elevation	All data is populated. Not clipped to the UGB (Tualatin's planning area boundary).		BC to clip to area surrounding UGB.
LIDAR	City of Tualatin	6/6/2016 and 6/14/16	LIDAR	LIDAR, subfolders (45122c6, 45122c7, 45122c8, 45122d6, 45122d7, 45122d8)	DEM	Base	Contains gridded LIDAR data for Tualatin and the surrounding area.	GCS_NAD_1983_2011. NAVD88 vertical datum	elevation	The 45122c7 grid omitted from initial data submittal. This data is in the NAVD88 vertical datum where most other stormwater structures are in NGVD 29.		
Basin Boundaries	City of Tualatin	5/24/2016	StormMasterPlan.gdb	strm_basin	polygon	Base	Major stream basins: Cummins Creek, Hedges Creek, Nyberg Creek, Saum Creek, Seely Ditch, Tualatin River. <b>7/7/16</b> - How were the basins delineated (automated, per HUC boundaries, etc.? The layer "strm_basin" is of unknown provenance with no documentation. Project should probably use the CWS basin data.	NAD_1983_HARN_StatePlane_Oregon_North_FIPS_3601_Feet_Intl	area, perimeter, basin, basin ID, basin name, acres, shape ST area, Shape ST length, shape length, shape area	All data is populated. Basin delineation varies from CWS basin delineation throughout the city.	Will the basin differences preclude our subbasin delineation efforts?  Should one data source be relied on over another, given that the subbasin boundaries will be refined for modeling purposes?	Major basin and subbasin delineation is not considered accurate. BC to use CWS basin data to aid in new subbasin delineation effort for hydrologic analysis.
	BC/Clean Water Services	5/16/2016	----	subbasins	polygon	Base	Sub-basins generated from merging polygons in "subbasins.shp" from Clean Water Services, used to create project kick-off map	none	area_perimeter, basin_id, bas_name, acres, shape_area	All data is populated. Basins are smaller than strm_basin. Do not extend into concept planning areas.		
Aerial Photos	City of Tualatin	6/6/2016	2015 6inch Air Photos	Multiple files received.	photo	Base	Aerial photography from 2015. 6 inch resolution.		N/A	Full coverage within city limits. Few tiles in nearby town of Sherwood are missing.		
Soils	City of Tualatin	5/24/2016	StormMasterPlan.gdb	Soils	polygon	Base	Subset of Metro RLIS layer	NAD_1983_HARN_StatePlane_Oregon_North_FIPS_3601_Feet_Intl	AREA, CODE, CLASS, county, CLASS.	Missing hydrologic soil group (A, B, C, D) for all soils. Often MUSYM field from NRCS soil files is used to translate to soil reports.  File is not clipped to planning area.	What does the class field represent? What does the Code field represent?	BC to use NRCS soil information to develop GIS coverage by hydrologic soil type.  Gaps in hydrologic soil group coverage to be interpreted from surrounding soil type.

Table A-1: GIS Data Review and Data Gaps

Initial Data Request	Source (Received From)	Date Received	Database Name (if applicable)	File Name	Feature Class	Data Type-Base or Storm	Layer Notes (from City)	Datum	Relevant Fields	Initial Observations and Identified Gaps	Outstanding Questions (per 7-28-16 and 8-24-16 mtgs)	Data Assumptions and Gap Resolution
Streams and Water Bodies	City of Tualatin	5/24/2016	StormMasterPlan.gbd	waterbodies	polygon	Base	Subset of layer created by Metro and Watershed Sciences from LIDAR data.  Layer overlaps with streams layer.	NAD_1983_HARN_StatePlane_Oregon_North_FIPS_3601_Feet_Intl	WB number, type, sub-area, source, create date, created by, modification date, modifier, modification source, notes, shape ST area, Shape ST length, shape length, shape area	Reflect major waterbodies.  Sub-area is completely blank (null), all modification details are blank (null). No names are given, even for major water bodies such as Lake Oswego.	Should this layer be used for any reason?	Layer will not be used in mapping.
	City of Tualatin	5/24/2016	StormMasterPlan.gbd	streams	line	Base	Subset of layer created by Metro and Watershed Sciences from LIDAR data. This layer has better positional accuracy, but it has not been released on RLIS. <b>7/7/16</b> - Should this layer be used versus the stm_line? The layer "streams" is quite a bit better in terms of positional accuracy and is better registered with the aerial photography, LIDAR and contour data we've provided. I'd recommend using this layer over Metro's stm_line	NAD_1983_HARN_StatePlane_Oregon_North_FIPS_3601	segment number, WS_ID, IN_Metro, Hydro ID, is_Piped, pipe ID, pipe SRC, NHD code, FCODE_DESC, name, LLID, HUC12, LIDAR, subarea, source, create date, modification date, modifier, modification source, notes, type, period, shape length	817 of 3391 streams are missing LLID.		BC to use this layer to define and map waterbodies in the City.
	City of Tualatin	5/24/2016	StormMasterPlan.gbd	Ponds	polygon	Base	Areas of year-round ponded or standing water within Tualatin. Overlaps with some wet ponds in public water quality facilities.	NAD_1983_HARN_StatePlane_Oregon_North_FIPS_3601_Feet_Intl	NAME, Shape_Length, Shape_Area	21 of 29 are missing names.	Is missing information due to the fact no pond names exist?	
	City of Tualatin	5/24/2016	StormMasterPlan.gbd	stm_line	line	Storm	Streams, Subset of Metro RLIS layer	NAD_1983_HARN_StatePlane_Oregon_North_FIPS_3601_Feet_Intl	Length, shape_length	All data is populated		Layer will not be used in mapping.
Parks and Open Space Mapping	City of Tualatin	5/24/2016	StormMasterPlan.gbd	Parks_Greenways_Natural_Areas	polygon	Base	All city-owned parks, greenways and natural areas. Some overlap with WPD and NRPO.	NAD_1983_HARN_StatePlane_Oregon_North_FIPS_3601_Feet_Intl	NAME, ACRES, TYPE, Shape_Length, Shape_Area	All data is populated	Are these areas assumed to be undevelopable?  Are the greenways and natural areas included in shapefile designated as significant?  How may parks and greenways be used to support stormwater management? (see City charter)	Areas represent undevelopable open space for purpose of land use coverage. Include in open space land use coverage.  Additional discussion and legal interpretation of city charter required to verify how/ if public open space may be used for stormwater management.
Wetlands and Sensitive Areas	City of Tualatin	5/24/2016	StormMasterPlan.gbd	WPD	polygon	Base	Tualatin's Wetland Protection District. Sweek Pond Management Area and Wetlands Fringe Areas are identified in shapefile.	NAD_1983_HARN_StatePlane_Oregon_North_FIPS_3601_Feet_Intl	area, perimeter, WPD, WPD ID, type, acres, shape ST area, shape ST length, Shape length, shape area	All data is populated. Per Chapter 71, development may occur within the WPD in areas defined as Sweek Pond Management Area (SPMA) and Wetland Fringe Area (WFA).	Should this layer be used to define open space area (unlikely to develop or redevelop)?	Wetland Protection Area (WPA) only to be used in open space land use coverage. Most WPA already reflected in NRPO and wetland coverage.
	City of Tualatin	5/24/2016	StormMasterPlan.gbd	Wetlands	polygon	Base	1996 LWI updated through 2008 for any wetland fills, creation and delineations. <b>7/7/16</b> - Why aren't all wetlands covered by NRPO? Only certain "significant" wetlands are included in the NRPO. The criteria for this can be found in Tualatin Development Code Chapter 72: Natural Resource Protection Overlay District	NAD_1983_HARN_StatePlane_Oregon_North_FIPS_3601_Feet_Intl	area, perimeter, wet, wet ID, w_1, acres, shape ST area, Shape ST Length, shape length, shape area	29 missing area, 23 missing perimeter and WET (What is WET?), 25 missing w_1 (What is w_1?)	Should this layer be used to define open space area (unlikely to develop or redevelop)?	Assume all are undevelopable and include in open space land use coverage.  Per meeting 8/24/16, less significant wetlands (outside of NRPO and included in this shapefile) should also be considered undevelopable.
	City of Tualatin	5/24/2016	StormMasterPlan.gbd	NRPO	polygon	Base	Tualatin's Natural Resource Protection Overlay Districts. <b>7/7/16</b> - Why doesn't it include parks and wetlands? How is this area managed and used by the City? Are there constraints on development or the installation of SW management facilities here?  The definition of NRPO was provided in the layer's metadata. It is also available (in more depth) in Tualatin Development Code Chapter 72: Natural Resource Overlay District (NRPO)	NAD_1983_HARN_StatePlane_Oregon_North_FIPS_3601_Feet_Intl	Acres, Resource Type, NRPO Class, Site Code, x_coord, y_coord, Resource Name, shape_length, shape_area	All data is populated. Coverage does not include parks and all wetlands. Per Chapter 72.060, minor public enhancements may be installed but no other significant development activity.	Should this layer be used to define open space area (unlikely to develop or redevelop)?	Use to supplement open space land use coverage.

Table A-1: GIS Data Review and Data Gaps

Initial Data Request	Source (Received From)	Date Received	Database Name (if applicable)	File Name	Feature Class	Data Type-Base or Storm	Layer Notes (from City)	Datum	Relevant Fields	Initial Observations and Identified Gaps	Outstanding Questions (per 7-28-16 and 8-24-16 mtgs)	Data Assumptions and Gap Resolution
Drinking Water and Irrigation Wells	City of Tualatin	5/31/2016	StormMasterPlan_2.gdb	wr_v_pod_public	point	Base	Oregon Water Right Points of Diversion - Statewide point dataset published by Oregon Water Resources Department <b>7/7/16</b> - Per DH - We are going to assume DEQ's data is correct and ask that you use that data source (DH)	NAD_1983_Oregon_Statewide_Lambe rt_Feet_Intl	use_code, use_code_description, rate_cfs, max_rate_cfs, acre_feet, acre_feet_est, max_acre_feet, source, tributary_to, streamcode	This data appears to reflect surface water diversions and not drinking water wells. Point shapefile. Contains many more fields than wr_v_pou_public.	How does the City want to address UIC rule authorization or UIC retrofits in the Master Plan?	Per 7-21-16 call, rule authorization activities associated with Phase 005 will not be conducted. UICs deemed a maintenance concern to be addressed with CIP development.
	City of Tualatin	5/31/2016	StormMasterPlan_2.gdb	wr_v_pou_public	polygon	Base	Oregon Water Right Places of Use - Statewide polygonal dataset published by Oregon Water Resources Department	NAD_1983_Oregon_Statewide_Lambe rt_Feet_Intl	snp_id, shape_area, use_code, use_code_description, remarks	This data appears to reflect surface water intakes. Polygon shapefile.  What is pou_display, app_char, app_nbr, permit_char, permit_number, cert_nbr, claim_nbr?	See above.	
	City of Tualatin	5/31/2016	StormMasterPlan_2.gdb	OR_Groundwater_DWS As_ORLAMBERT_Ver5_09JAN2015	polygon	Base	Drinking water source areas - Statewide polygonal dataset published by Oregon Department of Environmental Quality	NAD_1983_Oregon_Statewide_Lambe rt_Feet_Intl	pws_id, Tinwsys_na, tinwsf_nam, src_label, epa_method, or_method, comments, area, perimeter, acres, actv_stat	Contains only major wells for the state of Oregon. Does not reference ASR wells. Two wells are located within Tualatin city limits for Tri-County Industrial Park with times of travel between 1 and 15 years. This data does not appear to reflect all drinking water wells.  Unknown acronyms/abbreviations (tinwsys_is, fips_cnty, sens_zone)	See above.	
Other	City of Tualatin	5/24/2016	StormMasterPlan.gbd	BASALTCREEK_JURIS	polygon	Base	The Basalt Creek Concept Plan boundary is provided as a proposed approximate jurisdictional boundary. <b>7/7/16</b> - City will provide data once they have more accurate information to provide.	NAD_1983_HARN_StatePlane_Oregon _North_FIPS_3601_Feet_Intl	acre, future_jurisdiction, shape_length, shape_area	All data is populated. Approximate road alignment and planning districts still required.	When will planning district and road information be made available?	No road or planning districts established. BC to move forward with subbasin delineation efforts and existing condition hydrologic calculations using current information/ aerial verification of impervious.
	City of Tualatin	5/31/2016	StormMasterPlan_2.gdb	TroubledSpots	point	Base	Point dataset of locations prone to seasonal flooding; identified during "kick-off" meeting <b>7/7/16</b> - Will update and coordinate with ops for areas (DH)	NAD_1983_HARN_StatePlane_Oregon _North_FIPS_3601_Feet_Intl	notes	Trouble spots as points with notes, but missing polygons to cover whole area of flooding issues.  Mapped areas vary from identified hot spots and received surveys.	When will data be received?  Have locations been internally vetted to ensure they are representative of storm system flooding and not floodplain inundation?	Shapefile used in the vetting and determination of stormwater problem areas and modeling needs (see Table A-3).
	City of Tualatin	8/4/2016	StormMasterPlan_Additional_Data.gdb	TroubleAreas	polygon	Base	Polygon shapefile of identified trouble areas.			13 areas identified: -Nyberg Ln and Stafford Hills Club -Tualatin Sherwood Rd and Martinazzi Ave outfall south of Fred Meyers -Blake St east of Martinazzi - Outfall south from Dakota Chieftain greenway -Blake St east of Martinazzi - Outfall north of street -Behind Oil Can Henry's and Casa de Robles Apartments - adjacent to RR track -End of 125th Ct - east side (Caruso Products) -Greenspace between Boones Ferry Rd and Siuslaw Ln -Borland Rd south of Meridian Park Hospital -Herman Rd (between Tualatin Rd and Teton) -Sagert and 93rd Ave -Warm Springs St at Elks Club (8350 SW Warm Springs) -East side of 124th Ave north of Leveton Rd -End of SW Piute Ct Also contains brief descriptions of each problem area. Does not reflect Manhassat or Sandalwood (previously discussed).		Shapefile used in the vetting and determination of stormwater problem areas and modeling needs (see Table A-3).



Table A-1: GIS Data Review and Data Gaps

Initial Data Request	Source (Received From)	Date Received	Database Name (if applicable)	File Name	Feature Class	Data Type-Base or Storm	Layer Notes (from City)	Datum	Relevant Fields	Initial Observations and Identified Gaps	Outstanding Questions (per 7-28-16 and 8-24-16 mtgs)	Data Assumptions and Gap Resolution
Other (continued)	City of Tualatin	8/4/2016	StormMasterPlan_Additional_D ata.gdb	building_footprints	polygon	Base	Contains footprints of buildings within city limits and a portion of SW Concept Plan Area.			Includes buildings from all land uses including residential. - 7524 total buildings identified. - 6108 are missing land use class. - 6050 are missing addresses.		To be used in the calculation of impervious coverage by planning district.
	City of Tualatin	8/4/2016	StormMasterPlan_Additional_D ata.gdb	tualland	polygon	Base	City owned property			Contains types (Accessway, Greenway, Management Land, Natural Area, Park, Parking Lot, Public Storm Drainage, Right-of-way, Street Plug, Utility, Water Quality Facility, Water Reservoir) and property names.		To be used to help identify area with the potential to install stormwater treatment/ conveyance/ detention systems as part of CIP development.
	City of Tualatin	8/4/2016	StormMasterPlan_Additional_D ata.gdb	NW_Concept_Plan_Area	polygon	Base	Polygon file of NW Concept Planning Area.					To be used to define concept planning area boundary and project extents.
	City of Tualatin	8/4/2016	StormMasterPlan_Additional_D ata.gdb	SW_Concept_Plan_Area	polygon	Base	Polygon file of SW Concept Planning Area.					To be used to define concept planning area boundary and project extents.
	City of Tualatin	4/3/2017	Tualatin_Land.gdb	Tualatin_Land	polygon	Base	Revised city-owned property			Updated version of tuallands. Changes include revisions to parks, greenways, and natural areas.		TBD. Currently used for the water quality assessment.
<b>Storm GIS Data</b>												
Piped Storm Drainage System	City of Tualatin	5/24/2016 and 8/4/2016	StormMasterPlan.gdb and StormMasterPlan_Additional_D ata.gdb	stormpt	point	Storm	Storm structures (e.g., manholes, catch basins, outfalls, etc.) & also contains UICs (Drywell=Yes) <b>7/7/16</b> - Rim elevations ranged from 300+ to 100+ - is that amount of drop expected? Are there areas/ features where datum issues may be expected? Yes, that range of rim elevations is to be expected. All elevations (when available) were taken from the relevant public works asbuilts. It is assumed that most of these were tied to NAVD27, but Tualatin's code allows for "any known datum" and the datum is often not specified in the asbuilts.	NAD_1983_HARN_StatePlane_Oregon_North_FIPS_3601_Feet_Intl	asset ID, asset type, sump, as built, WQ, IEO, IEIE, IEW, IEIN, IEIS, rim elevation, bottom elevation, depth, owner, jetbook, OP_ID, dry well, diversion	Asset types of interest are ditch inlet, catch basin, clean out, flow structure, culvert in, culvert out, manhole, outfall and UICs. Relevant fields include: RimElev, IEO, IEIE, IEIW, IEIN, IEIS, Asset_id  Attributes of interest include invert elevations in/out, bottom elevations or rim elevations. The 10 UICs are missing bottom elevations, and 1,670 culverts/MH/outfalls are missing IEOs, see "DataOverviewMap_34x44.mxd" for visual representation. Various structures are also missing RIM elevations.	Does the City still wish for the NAVD88 datum to be used for the master plan?  What time frame should be expected for making the datum correction?  What does the field "Jetbook" refer to? Contains entries such as Blue-SD, Gray-SD, Red-SD, etc.	Missing rim elevations to be surveyed (if surveyor is obtaining other system information) or estimated from LIDAR.  City provided converted data on 8/4/16. Converted data appears to have elevations 3.52' higher than previous data to align with the NAVD88 vertical datum.  BC compared updated rim elevations to LIDAR. Results documented in TM1.
	City of Tualatin	5/24/2016 and 8/4/2016	StormMasterPlan.gdb and StormMasterPlan_Additional_D ata.gdb	stormli	line	Storm	Storm lines	NAD_1983_HARN_StatePlane_Oregon_North_FIPS_3601_Feet_Intl	asset ID, storm line type, storm line material, diameter, length, slope, as built, upstream asset ID, downstream asset ID, upstream elevation, downstream elevation, owner, jetbook, shape length	Over 2,000 lines are missing either upstream or downstream elevations (inverts), see "DataOverviewMap_34x44.mxd" for visual representation.  201 pipes have missing/unknown storm line material. 197 pipes are missing diameters. Other missing elements that can be determined using inverts include: slope, length.	Does the City still wish for the NAVD88 datum to be used for the master plan?  What time frame should be expected for making the datum correction?	City provided converted data on 8/4/16. Converted data appears to have elevations 3.52' higher than previous data to align with the NAVD88 vertical datum.
Open Channel Drainage System	City of Tualatin	5/24/2016	StormMasterPlan.gdb	ditches	line	Storm	Storm water conveyance ditches - THIS IS OUTDATED	NAD_1983_HARN_StatePlane_Oregon_North_FIPS_3601_Feet_Intl				Do not use.
	City of Tualatin	5/31/2016	StormMasterPlan_2.gdb	ditches	line	Storm	Storm water conveyance ditches. <b>7/7/16</b> - Is cross section information available? There is sometimes cross section information available in the asbuilt series the ditch has been captured from. IF such info would be helpful, we could search the asbuilts and provide those that are relevant.	NAD_1983_HARN_StatePlane_Oregon_North_FIPS_3601_Feet_Intl	asset ID, asset type, as built, length ft, owner, shape ST length, shape length	All data is populated. No cross-sectional information, no elevation information.		BC to use LIDAR and field survey to develop channel cross sections for modeled portions of the system. As-built information to be provided by the City where available.
	City of Tualatin	8/5/2016	StormMasterPlan_Additional_D ata.gdb	Ditches		Storm	Storm water conveyance ditches.			Still missing cross-sectional data. Appears no changes have been made from previously received shapefile.		
Public Water Quality Facilities	City of Tualatin	5/24/2016	StormMasterPlan.gdb	wq_fac	polygon	Storm	Tualatin's public water quality facilities. <b>7/7/16</b> - Is area served delineated? Current delineation reflects footprint area The area served has not been delineated, but could derived for most of the facilities assuming the "area served" would be more-or-less the subdivision platt it came from.	NAD_1983_HARN_StatePlane_Oregon_North_FIPS_3601_Feet_Intl	asset ID, facility type, water quality facility name, acres served, as built, date completed, WQF number, WQF notes, X coordinate, Y coordinate, impervious surface, address, shape length, shape area	Polygon file reflecting footprint.  33 missing acres served, 2 missing as built, 9 missing completion date, 8 missing WQF number, 42 missing WQF notes (others include notes about dimensions, volume, etc.), impervious surface attribute either "null" or "zero". No delineation of areas/acres served provided.	Is additional information available from CWS?  Would the City be able to provide the drainage area of each public facility (in order to evaluate retrofit potential for water quality).	Drainage areas for public facilities not readily available. May obtain from City following CIP workshop and identification of potential water quality CIPs/ retrofits.  City provided tualland GIS shapefile to distinguish all areas and facilities that may be considered for stormwater CIP development.
Private Water Quality Facilities	City of Tualatin	5/24/2016	StormMasterPlan.gdb	PWQF	point	Storm	Tualatin's private water quality facilities <b>7/7/16</b> - What does the field PWQF_GEO refer to? It's a Boolean attribute that indicates whether or not we have identified exactly where the private water quality facility is located on the parcel. We have some records of private water quality facilities but it is not known to us where they are exactly located (PWQF_GEO = 'No')	NAD_1983_HARN_StatePlane_Oregon_North_FIPS_3601_Feet_Intl	PWQF_ID, PWQD_TYPE, WQP_ID	Point file. Does not contain any information related to size/area served.  12 Missing WQP_ID, not sure if relevant.	What fields are used by the City to track active facilities and maintenance needs?  Is this information available from CWS?	



Table A-2: Code and Background Data Review

Initial Data Request	Data Received and Reviewed	Data Source	Date Received	Information Summary	Outstanding Questions (per 7-28-16 and 8-24-16 mtgs)	Master Plan Application & Assumptions
List of stormwater-related CIPs completed in the last 5-10 years	None Received	----	----	No data to date	Will we be receiving this data? Are there current stormwater CIPs that should be reflected in the MP? Should maintenance-related projects be included in CIP?	Updated stormwater system information accounts for any known system improvements. Current stormwater CIPs to be reviewed for potential inclusion in the MP. Identified stormwater problem areas to be mapped and investigated during site visits.
Completed staff survey, listing drainage problem areas and water quality concerns – compiled by maintenance and engineering staff	Two completed surveys and storm hot spot list	City	6/2/2016	Survey - 1) Bert, included maintenance problem areas, and 2) Engineering Staff  Storm area hot spots list includes 12 locations (roads or intersections) and reference storm infrastructure (ditch inlet, culvert, etc.) but no reference to the problem.  Surveys included general area reference, but limited detail regarding scope and scale of problem. Some areas appear to be floodplain and natural system related instead of system capacity issues.  Storm area hot spot locations and survey reference locations vary from mapped problem areas.  Current problem areas include areas currently being addressed with other projects (wetlands behind Fred Meyer) and general natural system/ floodplain flooding.		Problem areas due to capacity deficiency, maintenance concern, or infrastructure need will require more focused study, possible survey, and possible hydraulic modeling.  Maintenance related CIPs to be considered if proposed maintenance frequency or activity is outside current schedule.
Photos/ information reflecting observed system flooding or capacity deficiencies	Manhasset Photos	City	6/2/2016	Manhasset system flooding from 12-8-15 storm event.	Are other system flooding photos available related to other problem areas?	Limited photos of active flooding are available.  Photos to be used to reference potential source of problem area. (BC staff took additional images of Manhasset during a site visit with city staff on 6-29-16).  Photos to be used to help validate system hydraulic models.
	Manhasset Survey and Easement information	City	6/29/2016	Manhasset property survey (1971 and 1996).  Manhasset area survey (1986 and 1989).  Easement information (UPS) and TL 100/200. Dated 1987 and 1995	Survey information is prior to current development. Are there more recent asbuilts, private development drainage infrastructure information?  Should private system modeling be conducted/ considered as part of the master plan? Only where problem area is located?	No additional asbuilt information available. Data to be used to confirm drainage patterns and contributing area to public system.  Survey data will supplement available information as required.
City Organizational Chart	City Organization Chart 2015-16	City	6/2/2016	Organization chart provided at department head level. Phone directory also provided.		Points of contact
Stormwater program staffing allocations	City completed data needs list - direct documentation	City	6/2/2016	Engineering 0.5 fte and Maintenance 2 fte	Is current staff available to support implementation of the MP and meet maintenance commitments?  Is additional staff needed or warranted?	Maintenance activities and frequencies are mandated by CWS. Maintenance staff is lean, but additional staff is unlikely. City will likely contract out additional maintenance via CIP.  City staff allocations will inform staffing assessment as part of the financial evaluation.
Stormwater maintenance procedures, frequencies and schedules (street sweeping, public water quality facility maintenance, private water quality facility inspection)	City completed data needs list - direct documentation	City	6/2/2016	WQF – inspections 1 every 4 years, 25% of facilities inspected each year (Bethany). See maintenance program report from Bert.	How does the city currently inspect/ensure inspection and maintenance of private water quality BMP's? Should this be a future consideration? Are public facilities inspected at same frequency?  The report refers to maintenance of vegetated facilities being contracted. Does the City want to take on that responsibility?  Does the City maintain a time sheet reporting system to track time spent with each activity?  Is sweeping conducted by the City and is stormwater program budget spent on sweeping currently?	Maintenance responsibilities will be evaluated when considering additional staffing needs.  Public facilities include subdivisions and may be a focus of a retrofit program. Public facilities are inspected once every four years. Maintenance obligations to be accounted for in staff evaluation.  No time sheet reporting system. Staff evaluation to use average time/ activity referenced in other master plans.
	Collection System Maintenance Quarterly Report	City	6/2/2016	Report identifies annual targets for pipeline cleaning, manhole maintenance, catch basin cleaning, TV inspections, water quality manhole cleaning, vegetated facility maintenance, filter maintenance, detention facility maintenance, and sweeping.		Maintenance responsibilities will be evaluated when considering additional staffing needs.

Table A-2: Code and Background Data Review

Initial Data Request	Data Received and Reviewed	Data Source	Date Received	Information Summary	Outstanding Questions (per 7-28-16 and 8-24-16 mtgs)	Master Plan Application & Assumptions
Stomwater Ordinance(s) and other applicable municipal code and development code sections, link or hardcopy	Link provided: Tualatin Development Code (TDC) Chapter 14 - Drainage Plan and Surface Water Management	City	6/2/2016	<p>Defines 10 principal drainage basins. Major receiving waters are Tualatin River, Hedges Creek, Nyberg Creek, and Saum Creek.</p> <p>References Tualatin Drainage Plan, NW Tualatin Concept Plan (2005), SW Tualatin Concept Plan (2010), and Hedges Creek Subbasin (HCP) Plan/ Hedges Creek Subbasin Strategies Report (1995). The Hedges Creek Plan includes stormwater management activities, facilities, and programs.</p> <p>HCS Plan requires onsite detention for new development in Hedges Creek Subbasin.</p> <p>Section 14.040: Defines objectives for surface water management in Tualatin</p>	<p>Are their drainage improvements identified in any of the plans (Hedges Creek specifically) that haven't been installed/ implemented and should be considered?</p> <p>Should the NW and SW Tualatin Concept Plans be referenced for facility installations, stormwater drainage options? Are these proposed options currently reflected in the GIS?</p>	<p>NW and SW Concept Planning areas to be included in project area extents.</p> <p>Plans should be referenced for applicable design criteria as necessary. No anticipated CIPs stem from the plans.</p>
	TDC Chapter 03-05 - Soil Erosion, Surface Water Management, Water Quality Facilities, and Building and Sewers	BC download	6/7/2016	<p>3-05-050: Erosion control permit required for 500 sf land disturbance or slope &gt; 20%</p> <p>3-05-200: Mitigation of downstream system impacts addressed through onsite detention, enlargement of downstream system, or SDCs. Downstream analysis required for min 0.25 mile downstream or point where contributing area is less than 10% total. Onsite facility required where identified downstream deficiency, identified regional detention, or located in Hedges Creek subbasin. IF downstream deficiency, match post development to predevelopment for the 2 through 100 year storms, otherwise match 25 year storm.</p> <p>3-05-240: Detention sizing per King County Surface Water Design Manual. For SFR, assume each lot contributes 2,640 sf impervious.</p> <p>3-5-310, 350, 360, 430: Water quality treatment required for all development except construction of one or two family dwellings. Design standard is 0.36"/4 hours with average return period of 96 hours. Phosphorus performance standard of 65% removal. No water quality facility placement in existing or created wetlands unless mitigation action approved by city (only location exemption identified).</p>	<p>Should regional detention be sized to match the 2, 10, 25, and 100 year predevelopment flow per PW Stds or sized per CWS Stds only up to 25 yr?</p> <p>Are regional detention areas (as referenced in 3-05-200) identified and should be considered under this MP?</p> <p>For impervious surface calculations and financial calculations, is 2,640 still the EDU?</p> <p>Are there additional, documented water quality sizing guidelines we should consider? CWS has not yet established/ publicized updated online/ offline flow through standards (analysis has shown current standards adequate for offline).</p>	<p>Detention standards are per CWS (up to 25 year). Potential change to CWS standards in the future (flow duration/ continuous simulation analysis for facility design) but not to be included in CIP sizing at this time.</p> <p>Regional detention may be considered in the Hedges Creek subbasin or other areas where capacity limitations exist.</p> <p>2,640 sf EDU is correct.</p> <p>Water quality design standards are per CWS.</p>
	TDC Chapter 5 - Residential Planning Growth	BC download	7/14/2016	<p>Provides plan densities per acre for medium/ multi family residential planning districts.</p> <p>Defines development type in each residential planning district.</p>	<p>Are there any changes that are anticipated future changes the plan districts?</p> <p>Should manufactured home parks be considered low density residential for land use purposes as defined in Section 5.040? Maximum density in this category is 6.4 units/ acre - what density range should be used here?</p> <p>Medium low density includes condos, townhouses, duplexes, and other multi-family dwellings - should density range of 10 units/ acre be maintained?</p>	<p>Per land use meeting (8-24-16), manufactured home parks are considered low density residential.</p> <p>Density ranges for all residential development to be used to validate impervious assumptions by land use.</p>
	TDC Chapter 6 - Commercial Planning Districts	BC download	7/25/2016	<p>Defines the various commercial planning district designations.</p>	<p>For existing land use, should all commercial be grouped together?</p>	<p>Per land use meeting (8-24-16), density and landscape requirements for overlay districts to be used to validate impervious assumptions by land use.</p> <p>Per land use meeting (8-24-16), commercial planning district designation to be reviewed. Hospitals and schools to be classified as institutional land use.</p>
	TDC Chapter 7 - Manufacturing Planning Districts	BC download	7/25/2016	<p>Defines the various industrial/ manufacturing planning district designations.</p>	<p>For existing land use, should all manufacturing be grouped together?</p>	<p>Per land use meeting (8-24-16), industrial and manufacturing planning district designations to be grouped together.</p> <p>Per land use meeting (8-24-16), density and landscape requirements for overlay districts to be used to validate impervious assumptions by land use.</p>
	TDC Chapter 8 - Public, Semi-Public, and Misc. Land Use	BC download	7/25/2016	<p>Defines the miscellaneous land uses in the City that do not fit into residential, commercial or industrial land use classifications. Includes government offices, utility facilities, schools, churches and retirement homes.</p>	<p>Should schools, churches, retirement homes and hospitals be categorized similarly? Currently only one institutional planning district parcel - should these be included? Currently they are reflected in LD residential and medium density residential.</p>	<p>Per land use meeting (8-24-16), commercial planning district designation to be reviewed. Hospitals and schools to be classified as institutional land use.</p>
	TDC Chapter 71 - Wetland Protection District	BC download	7/25/2016	<p>Defines established wetland protection district (WPD). WPD includes three subdistricts - 1) the Wetland Protected Area (WPA), which contains marshes and wetlands protected by chapter; 2) Sweek Pond Management Area, which contains Sweek Pond and adjacent area; and 3) the wetlands fringe area (WFA), which contains the balance of land contained in WPD and what is now or will be subject to development and usage.</p> <p>Permanent structures need to be set back 40' from WPA.</p> <p>Development is permitted in WFA per planning district designation. Utilities, habitat protection, gardens, parking, etc. are permitted in Sweek Pond Management Area. No permanent structures in WPA.</p>	<p>Should the entire WPD be considered preserved or protected for purposes of defining an open space land use coverage? Should only the WPA and SPMA be reflected?</p>	<p>Only the wetland protection area (WPA) to be identified as undevelopable open space land use.</p>
	TDC Chapter 72 - Natural Resource Protection Overlay District	BC download	7/25/2016	<p>Designates significant natural resources, which excludes artificially created wetlands but includes greenways and natural areas. Area overlaps with the WPD in some cases. The purpose of the area as defined is to provide sufficient area for stormwater runoff to reduce flood hazards and enhance water quality.</p> <p>Section 72.060 - Through a development review process, the city may allow use of greenways and natural areas for storm drainage purposes.</p> <p>Section 72.150 - Modifications for Storm Drainage Improvements - this chapter does not prevent the City from altering, enlarging, piping or modifying a creek channel in the NRPO District upon a finding that such modification is necessary.</p>	<p>Should the NRPO be considered an area for stormwater management or should it be limited to the greenways and natural areas within the NRPO?</p>	<p>The NRPO to be considered undevelopable open space area.</p> <p>Meeting with City attorney did not occur to verify assumptions of the charter. Although indicated in code, the charter prohibits use of greenways, natural areas, and City-owned parks from being used for stormwater management if that was not the intended use.</p>

Table A-2: Code and Background Data Review

Initial Data Request	Data Received and Reviewed	Data Source	Date Received	Information Summary	Outstanding Questions (per 7-28-16 and 8-24-16 mtgs)	Master Plan Application & Assumptions
Stormwater Ordinance(s) and other applicable municipal code and development code sections, link or hardcopy (continued)	Tualatin City Charter	City	6/2/2016	Chapter XI - Protection of City Owned Parks and Open Space.  Purpose: Prevent transfer, sale, vacation or major change in the use of city parks without approving vote. To preserve...recreational value from incompatible and non-park development.  Definition (Major Change): Change in use of a park from a recreation or preservation use to a non-park use unrelated to public recreation or preservation.  Approval by Voters: Required if the city wants to "cause, undertake, or allow any development or construction that causes a major change in the use of the park or some part thereof".  Designated parks (12), natural areas, and greenways are listed.	Does the City interpret these guidelines as preventing installation of surface water quality or detention features in a park?  Is the list of protected parks, natural areas, greenways included in the Charter up to date?	Meeting with City attorney did not occur to verify assumptions of the charter. Although indicated in code, the charter prohibits use of greenways, natural areas, and City-owned parks from being used for stormwater management if that was not the intended use.  The charter should be used as guidelines regulating stormwater facility placement.
City-specific Stormwater Design Standards (aside from those referenced in municipal code) for stormwater treatment, detention, and/or conveyance, link or hardcopy	Link provided: Public Works Construction Code (February 2013)	City	6/2/2016	Chapter 206 Storm Drainage Design - Use rational method for sizing pipe. Runoff coefficients and rainfall intensity provided.  Table 206-1: Provides associated zone designation and residential swelling density per planning district designation.  Section 206.3: Conveyance system to be designed for 25 year storm event. Surcharge during 25 year event not permitted..  Section 206.4.00: Minimum public system pipe size is 12" diameter. Maximum of 400' between structures.  Section 206.6.00: Minimum 48" diameter manhole.  Section 206.8.00: Design of surface water quality and detention facilities to CWS Design and Construction Standards (2007). Swale side slope limited to 4:1. 4' or 6' fencing required for all facilities; 12' Portland Cement access road required	Are these design criteria accurate?	Use for conveyance system sizing.  Use of SCS/SBUH method (as used in SWMM) is acceptable for pipe design (variance from current city code).
	CWS Design and Construction Standards (2007)	BC download	4/29/2016	4.03.4 - Water quantity facilities to be designed to match pre and post development flow for 2, 10, and 25 year.  4.05 - Defines impervious area requiring treatment for redevelopment sites.  4.06 - Defines water quality facility design standards (by facility)  5.06 - Minimum pipe slope shall provide min velocity of 2.5 fps.	Are there preferred treatment or detention systems or approaches?  What are the appropriate rainfall depths?	Underground detention systems are not preferred.  Per CWS (Detail 1280) 2 year = 2.5", 10 yr = 3.45", 25 yr = 3.9", 100 = 4.5"  CWS design standards shall be used for the sizing of specific water quality and detention facilities.
	CWS LIDA Handbook (2009)	BC download	4/29/2016	Provides additional design guidelines for LIDA facilities including use of sizing factors for select facilities		Use design standards for the sizing of specific facilities.
Copy of IGA(s) with Clean Water Services for related stormwater program implementation	IGA for Erosion Control Inspections	City	6/2/2016	District assumes primary responsibility for managing the erosion and sediment control program. This includes inspection of properties for compliance with rules, enforcement, and review of erosion plan revisions (within 10 days). District summarizes work accomplished and invoices the City. The City collects fees, reviews plans submitted with development proposal, issues permits and forwards permits and plans to District. City pays District 100% of actual costs.	Are there other applicable IGAs for inspection and plan review of stormwater facilities?	No additional IGAs provided.
Most recent annual report to CWS	Stormwater Annual Report, 2013-2014 reporting year	City	6/2/2016	Summarizes District and City's responsibility related to stormwater management. Co implementers required to inspect 25% of private water quality facilities annually	Does the City have responsibility related to illicit discharge investigations or is there an IGA with the District?  Is LIDA required or promoted by the District for use in the City?	LIDA is a preferred treatment approach per new NPDES MS4 permit.  Maintenance responsibilities will be evaluated when considering additional staffing needs.
Other Information	Basalt Creek Concept Plan and joint meeting with Wilsonville materials	BC download	4/26/2016	Describes proposed boundary and planning district delineations	Has the boundary been finalized?  Are planning district delineations available for planning purposes in GIS? Are there roadway alignments available in GIS? Maps are available online currently.	Boundary has been finalized but no established future roadways or planning district coverage. Area to be included in the MP. Existing land use only to be evaluated.  Martin provided boundary of concept planning areas in GIS via 8/4/16 data submittal.
	Bridgeport Area Stormwater Master Plan (2005)	BC download	4/26/2016	Details the storm drainage system and water quality facility installation for the Bridgeport area.	Has the water quality facility been installed? Does it provide detention benefit? Is there asbuilts?	Bridgeport MP subbasin delineation used to define subbasins for this MP effort.
	Tualatin Drainage Plan Report (1972)	BC download	4/26/2016	1972 Storm Drainage Master Plan		Background material only.
	Public Water Quality Facility Asbuilts (5 facilities)	City	1/9/2017	Provides design detail for select water quality facilities.		Use to define maintenance or redesign concepts for CIP development.
	Hedges Creek Wetlands Master Plan	City	3/2/2017	Provides project recommendations (culvert upsizing under Tualatin Road, sediment removal) related to the 29-acre Hedges Creek Wetlands.		Use to inform Natural Resource investigation efforts.



Table A-3: Stormwater Problem Areas and Project Opportunities

Preliminary Stormwater Problem Area ID	WQ Retrofit Opportunity	Stormwater Project Opportunity Area ID	Location Name	Basin/ Waterbody	Source	Problem Description	Problem/ Project Area Summary	Site Visit Summary (per 6-29-16 and 12-7-16 site visits)	Project Category	Preliminary Project Concept	Modeling (Y/N)	Modeling Data Needs
1			Nyberg Ln (near Browns Ferry Park)	Nyberg Creek	City GIS	Capacity (bank overtopping)	Frequent flooding of road. Source unclear - Tualatin R or Nyberg Creek. Low road profile and undersized culvert under Nyberg Ln that floods Stafford Hills Club. Flooding due to backwater conditions.  Per 6/29/16 mtg - not a MP issue.	Not required	N/A	Not required	N	
2		1	Martinazzi Ave (near Tualatin-Sherwood Rd)	Nyberg Creek	Questionnaire-Staff City GIS	Capacity (pipe grade)	Subject to over curb flooding in heavy rain events. Originally considered backwater issue. Current HEC modeling project with CWS to remove sediment and improve capacity in Nyberg Creek.	12/7/16 - Windshield survey conducted. Backwater influences from Nyberg Creek. See Opportunity Area #5 - High flow bypass down Martinazzi to Izzy's Pond (12"). Low flow pipe (42") discharges to downstream end of culvert under Martinazzi and is almost fully submerged. This attributes to sediment accumulation in the pipe down Martinazzi.	Maintenance/ Asset Management	Pipe replacement (parallel pipe) or reconfiguration/ rerouting.  More frequent maintenance program (larger asset management program).	No, however modeling of Opp Area #5 may extend down to this location as needed	
3	Tualatin Sherwood Ave (near Martinazzi Ave)		Nyberg Creek	Questionnaire-Bert City GIS	Capacity (pipe grade)	Pipe inspection confirms existing 42" pipe full of sediment. Flat pipe.  Per 6/29/16 mtg - not a MP issue, but per recent findings should be included.						
4		2	Venetia Water Quality Facility Failing WQF (Lee between 56th and 57th)	Saum Creek	City GIS	Maintenance	The existing access path is partially washed out. The swale is mostly overgrown with large bushes and trees that need to be removed. It is unclear what the swale looks like underneath. Likely some regrading, replanting of the entire swale will be needed. Highflow bypass outfall should be checked and repaired as needed.	6/29/16 - Facility appeared overgrown but functional. No gate access to inspect inlet and outlet configuration. Limited maintenance access. Steeper grade and observed high flow bypass.	Maintenance	Inclusion in larger water quality facility maintenance CIP.	N	
5		3	Recent outfall retrofit (Blake St at Saum Creek)	Saum Creek	City GIS	Maintenance (Debris accumulation)  Erosion	Outfall installation approximately 2010.  Problem area #1: Pipe under Blake (not replaced in 2010) has flat grade and high water in winter.  Problem area #2: Outfall north of Blake (separate pipe system) experiences bank erosion (citizen complaints)	6/29/16 - Outfall south of Blake appears functional. Some invasives identified and two large rocks in flow path result in sediment accumulation (may be intentional to divert flow). Problem areas not specifically looked at. 12/7/16 - Significant bank erosion in the vicinity of the outfall(Problem area #2) and the creek appears to be down cutting though may be stable now due to observed clay/hard pan layer. • The bank is steep and appears to be reasonably unstable and erosive. Further erosion could impact the adjacent home. The upstream system inspected previously (6-29-16) and is in good order. • Culvert inlet under Blake may be undersized and cause some backwater upstream.	Direct Replacement	CIP needed to retrofit existing outfall into creek and minimize erosion of the channel, which is hanging out over the creek and exposed.	N	
6	X		Blue Lot (Boones Ferry Rd and Tualatin Rd)	Hedges Creek	City GIS Water Quality Eval	Capacity (bank overtopping)	Flooding of lot due to proximity to Hedges Creek and floodplain. Flooding due to stream capacity issue.  Per 6/29/16 mtg - flooding not a MP issue	Not required	New Infrastructure/ WQ Retrofit	Use of LID onsite may qualify as a retrofit per CWS retrofit strategy.	N	
7	X		Green Lot (approx. 18725 SW Boones Ferry Rd)	Hedges Creek	City GIS Water Quality Eval	Capacity (bank overtopping)	Flooding of lot due to proximity to Hedges Creek and floodplain. Flooding due to stream capacity issue.  Per 6/29/16 mtg - flooding not a MP issue	Not required	New Infrastructure/ WQ Retrofit	Use of LID onsite may qualify as a retrofit per CWS retrofit strategy.	N	
8			Jurgens City Park	Tualatin River	City GIS	Capacity (bank overtopping)	Path floods due to stream capacity issue.  Per 6/29/16 mtg - flooding not a MP issue	Not required	N/A	Not required	N	
9	X	4	Manhasset Dr. (near 10550 SW Manhasset Dr)	Hedges Creek	Questionnaire-Bert Storm Area Hot Spots City GIS Stormwater CIP Water Quality Eval	Capacity	Frequent flooding of drainage channel between private properties from T-S Rd to Manhasset. Photos and background data received from City.  WQ Opportunity - adjacent undeveloped land that has transportation and warehouse land draining to it	6-29-16 - Private property flooding reported. Drainage channel has limited capacity, especially if private property or area south of T-S Road discharges to it. Observed debris accumulation. Ditch along Manhasset is unmapped and drainage area to the ditch is unclear.	Upsize Infrastructure  WQ Retrofit	CIP needed to alleviate private property flooding. MP effort to conduct detailed study of contributing area and flow patterns.	Y	No asbuilts exist with collection information.  Requires survey of private collection system inputs and open channel. Improvement possibly a closed system. Model from culvert under Tualatin-Sherwood Rd, through open channel between the private properties, to closed system discharge to Hedges Creek.

Table A-3: Stormwater Problem Areas and Project Opportunities

Preliminary Stormwater Problem Area ID	WQ Retrofit Opportunity	Stormwater Project Opportunity Area ID	Location Name	Basin/ Waterbody	Source	Problem Description	Problem/ Project Area Summary	Site Visit Summary (per 6-29-16 and 12-7-16 site visits)	Project Category	Preliminary Project Concept	Modeling (Y/N)	Modeling Data Needs
10		5	Boones Ferry Rd (19417 SW Boones Ferry Rd)	Nyberg Creek	Storm Area Hot Spots City GIS	Debris accumulation Capacity	Drainage ditch (behind Oil Can Henrys) and inlet frequently backed up due to debris accumulation. No system information currently in GIS. Unsure whether a maintenance issue or infrastructure issue.  Per 10/31/16 call - Site visit required to confirm something can/ should be done here.  Per 11/22/16 email - Low area along Boones Ferry has ponding, possibly due to inlet capacity. Nyberg Creek is piped behind the buildings to the west which may also be contributing to the issue behind Oil Can Henry's.	12/7/16 - This area may be the largest systematic problem area in the city. Problem area begins at the inlet along the railroad behind Oil Can Henry's and ends at the crossing of Martinazzi Ave. Some connectivity with Opportunity Area #12. • The inlet along the RR is a maintenance issue, gravel is transported and redeposited down the system. • StormFilter catchbasins along Boones are located at the sag, and clog due to filters being overwhelmed with sediment. • Channel from Boones to Tonka is small, incised and overwhelmed during large events. • The conveyance system in the vicinity of Tonka, Warm Springs and Boones does not appear to be efficient and well laid out. • Problem area #12 contributes to the flooding at Tonka and Warm Spring due to overland flow and carrying sediment down to the intersection. • The channel from Tonka to Martinazzi needs to be reviewed/ optimized for conveyance IE: does the Izzy's weir need to come out and will that facilitate drainage? • Pipe system down Martinazzi from T-S road (Problem Area 1) accumulates sediment and discharges in vicinity.	New Infrastructure	CIP needed for source control and improved conveyance.  Gravel barrier or netting at railroad ballast.  Additional sediment control or more frequent maintenance may be needed to alleviate standing water of StormFilters. Rerouting SF to channel on E of Boones Ferry may improve conveyance.  Inlets at the intersection of Tonka and Warm Springs should be rerouted for efficiency.  Removal or reconfiguration of Izzy's Pond.	Y	Requires survey of select infrastructure and possible open channel conveyance. Model to include Opp Area #10.  Extents of model to be determined with City as most infrastructure modeled will need to be surveyed. Model proposed from inlet along the RR tracks to Boones Ferry, then east where system becomes an open channel. The open channel will be modeled to the outfall at Martinazzi Ave and include drainage from Opp Area #10 to the south.
11			Cummings Creek (125th Ct).	Cummins Creek	Questionnaire-Bert	Capacity (bank overtopping)	Problematic flooding due to vegetation accumulation in stream channel and beaver activity.	12/7/16 - Reported flooding due to low lying property in floodplain. Flooding potentially due to beaver dam mitigation and installation of chain link fence on upstream and downstream ends of footbridge, resulting in backwater effects. Some questions remain with respect to drainage system, discharge locations along SW 125th Court, but no project proposed for this area.	N/A	Not required.	N	
12	X	6	Alsea/BF Rd 99th/Siuslaw Greenway	Hedges Creek	Questionnaire-Bert Retrofit Assessment	Infrastructure Replacement Water Quality	Corrugated Pipe has the bottom rusted out. Ditch inlet. No apparent capacity deficiency, just a pipe replacement.  WQ Opportunity- This long linear greenway may provide an opportunity for enhancement and water quality treatment of outfalls along the alignment	12/7/16 - Pipe replacement due to condition. Scope may include replacement of parallel pipes (GIS indicates are concrete but are CMP) and downstream sediment trap/ water quality facility (swale). • Sedimentation is currently an issue at this location • May regrade grassy swale (concerns with WQ plantings due to maintenance) to be a water quality retrofit. • City input whether a water quality feature at downstream end of parallel pipe system would impede use of greenway.	Direct Replacement WQ Retrofit	CIP needed to replace pipe from Boones Ferry to manhole upstream of parallel pipes. Additional scope may include parallel pipes to outfall, outfall structure to capture sediment, and regrading of existing channel for water quality feature.	Hydrology only	
13			Borland Rd	Saum Creek	Questionnaire-Bert	Infrastructure Needs	Frequent flooding due to lack required drainage infrastructure. Inlet on south side of Borland does not discharge anywhere.  Per 10/31/16 call - Area drains to a drywell and addressed as part of Sagert Farms project effort. Not an area to be addressed with MP.	Not required	N/A	Not required	N	
14	X	7	Herman Rd	Hedges Creek	Questionnaire-Bert Water Quality Eval	Infrastructure Needs Water Quality	Frequent flooding Lacks required drainage infrastructure  Per 10/31/16 call - Recent traffic accident in proximity; desire to install piped/ below ground infrastructure.  WQ Opportunity - Land SE corner of Herman Road and 95th may facilitate water quality treatment associated with Herman Road development	6-29-16 - Relatively flat grade. Half the road drains to roadside ditch and the other half to a ditch along railroad ROW. Stormwater improvements to be done in conjunction with roadway widening. City needs preliminary costs.	New Infrastructure WQ Retrofit	CIP needed to install additional conveyance infrastructure and possibly accommodate water quality.	Y	South side of road has no piped collection system or drainage facilities from 118th to Teton. From Teton east, the road needs full improvements. This area is very flat and there is no clear location to drain runoff.  The model will extend from Teton to Tualatin Road and require verification of culvert elevations under railroad. Preferred discharge location(s) should be identified and coordinated with the City prior to modeling.
15			Grams Ferry/Victoria Woods	Seely Ditch	Questionnaire-Bert Stormwater CIP	Infrastructure Needs	Lacks required drainage infrastructure. Need water treatment for untreated areas.  Per 11/22/16 email - Outfalls have WQFs and no ongoing maintenance. Not a problem.	Not required	N/A	Not required	N	



Table A-3: Stormwater Problem Areas and Project Opportunities

Preliminary Stormwater Problem Area ID	WQ Retrofit Opportunity	Stormwater Project Opportunity Area ID	Location Name	Basin/ Waterbody	Source	Problem Description	Problem/ Project Area Summary	Site Visit Summary (per 6-29-16 and 12-7-16 site visits)	Project Category	Preliminary Project Concept	Modeling (Y/N)	Modeling Data Needs
16	X		93rd Ave	Nyberg Creek	Questionnaire-Bert Water Quality Eval	Infrastructure Needs	Unimproved roadway lacks required drainage infrastructure. Per 10/31/16 call - Outfall improvement may be needed.	12/7/16 - Reported need to install drainage system on unimproved roadway. • Street update could provide treatment in the form of roadside planters or green street for much of the street up to Avery Street. • Street needs sidewalk, curb/gutter, etc. Current conveyance is provided in street side ditch primarily on the west side of 93rd.	WQ Retrofit	GIS indicates collection system exists so no new infrastructure required.  CIP to install green street or develop a green street program may be developed (see City-wide public infrastructure opportunity).	N	
17		8	Curves at Blake/105/108th	Hedges Creek	Questionnaire-Bert	Infrastructure Needs	Lacks required drainage infrastructure Per 10/31/16 call - Potential for two projects; one is to upsize culvert under Blake (fish passageable) and two is to add roadway drainage. City is currently in planning stages for roadway update but no budget for project yet. Culvert alignment may play a role in design and cost estimate.	12/7/16 - No collection system. Current drainage from Coquille and 105th is an open channel ditch to culvert inlet. • Stream channel experiences 90-degree bends on both sides of culvert. • Culvert replacement may need to be fish passable, culvert is undersized, currently a 36" or 42". Existing roadway embankments are steep and drainage updates are needed for the roadway. • City input related to culvert orientation and points of discharge needed.	New Infrastructure	CIP needed to address roadway drainage and culvert crossing. The roadway improvement extents to be verified by City (Moratoc to 108th). The culvert design will incorporate a sizing and length based on the hydrology and ideal alignment.  Per 1/25/17 - ODFW feedback indicates culvert likely not need to be fish passageable.	Hydrology only	
18			Sagert Farms	Saum Creek	Questionnaire-Bert	Infrastructure Needs	Development is currently occurring and area not to be reflected with MP. Two water quality ponds installed. Downstream analysis conducted to verify no impacts.	Not required	N/A	Not required	N	
19			Nyberg Wetlands	Nyberg Creek	Questionnaire-Bert	Capacity (bank overtopping)	Current City-initiated modeling effort in conjunction with CWS and Wetlands Conservancy.  Per 6/29/16 mtg - do not include in MP.	Not required	N/A	Not required	N	
20			Fred Meyer	Nyberg Creek	Questionnaire-Bert Storm Area Hot Spots	Capacity (bank overtopping)	Backwater and heavy sediment load reduces capacity in Nyberg Creek, causing it to overtop its banks. Current City-initiated modeling effort with CH.  Per 6/29/16 mtg - do not include in MP.	Not required	N/A	Not required	N	
21	X	9	Sagert St. - Shenandoah Apts (Sandalwood)	Nyberg Creek	Storm Area Hot Spots Water Quality Eval	Erosion (Channel incision)  Capacity	Reported flooding during Oct and Dec 2015 storms. Concerns over erosion and channel incision. No mapped drainage ditch.	6-29-16 - Limited pipe cover on inlet pipe. Channel is incised and sloughing observed. Flooding may be due to debris from above tree limiting capacity in ditch inlet. Possible opportunity for water quality project, water quality facility.	Upsize Infrastructure  WQ Retrofit	CIP needed to address channel downcutting. WQ and detention should be incorporated into this project if possible (project location is upstream of Opp Area #10).	Y	Model will extend from Seminole to Sagert. This model may be incorporated into the models for Opp areas #5 and #10.
22			Marquis 100 acre regional facility	Nyberg Creek	Questionnaire-Staff	Water Quality	Water quality concerns related to stormwater  Per 11/22/16 email - Not a problem area due to recent WQF install.	Not required	N/A	Not required	N	
23	X	City wide	Public infrastructure improvements	Citywide	Questionnaire-Staff	Infrastructure Needs  Water Quality  Maintenance	Storm lines and infrastructure throughout City.	Not required	Direct Replacement  Maintenance/ Asset Management  WQ Retrofit (Green streets)	Development of an asset management/ maintenance related project for infrastructure requiring increased maintenance frequency; proactive pipe replacement; and green street pilot program.  Areas and scope to be defined during CIP workshop.	N	
24			Riverhouse bridge		Questionnaire-Staff	Infrastructure Needs	Outdated infrastructure that may require replacement. Also includes culvert on lot to the east in the floodplain.  Per 11/22/16 email - Problem was washed out culvert on private lot. Not a problem area.	Not required	N/A	Not required	N	

Table A-3: Stormwater Problem Areas and Project Opportunities

Preliminary Stormwater Problem Area ID	WQ Retrofit Opportunity	Stormwater Project Opportunity Area ID	Location Name	Basin/ Waterbody	Source	Problem Description	Problem/ Project Area Summary	Site Visit Summary (per 6-29-16 and 12-7-16 site visits)	Project Category	Preliminary Project Concept	Modeling (Y/N)	Modeling Data Needs
25		10	Mohawk Apts	Nyberg Creek	Storm Area Hot Spots	Capacity Maintenance	Field ditch inlet backs up and accumulates debris on public property. Close proximity to problem area #5.	12/7/16 - Conveyance capacity issue also affecting Opp area #5. <ul style="list-style-type: none"> <li>Inlet behind Mohawk Apts is overwhelmed and water flows overland through adjacent property and causes flooding at Tonka and Warm Springs.</li> <li>Just a few feet of freeboard is currently available prior to overtopping at the inlet, and a grate structure is installed on top of the inlet. This may be an inlet capacity issue, a pipe capacity issue or the combination of the two.</li> <li>City is unaware of any easements that are in place that may facilitate correcting the issue. Corrective action may include piping the current open channel, updating the inlet, or increasing downstream pipe capacity.</li> <li>City to see whether existing easement continues upstream.</li> </ul>	New Infrastructure	CIP needed to alleviate overland flow affecting surrounding properties. May include closed conveyance for open channel system through apartments.	Y	Include with Opp Area 5 modeling effort. Model to extend from
26			Lake Blake		Storm Area Hot Spots	Maintenance	Field ditch inlet.  Per 11/22/16 email - Likely same location as problem area #3. Not a standalone problem area.	Not required	N/A	Not required	N	
27			124th Ave at Leventon Dr.	Cummins Creek	Storm Area Hot Spots	Maintenance	Field ditch inlet backs up and accumulates debris.	12/7/16 - Maintenance issues at existing inlet on private property. Inlet doesn't appear to receive road drainage. Invasive vegetation prevents drainage. May include as part of an ongoing maintenance CIP.	Maintenance/ Asset Management	Development of an asset management/ maintenance related CIP for increased maintenance frequency or proactive pipe replacement to be discussed during CIP workshop (see City-wide public infrastructure opportunity).	N	
28		11	Piute Ct	Saum Creek	Storm Area Hot Spots	Maintenance	Public water quality facility is failing. No adequate access road. Sediment accumulation. The location of discharge is unknown.	12/7/16 - WQ facility maintenance required and installation of access road. <ul style="list-style-type: none"> <li>Limited easement between homes to install access road but existing access along backside of facility and reported existing road overgrown.</li> <li>City to verify whether existing road alignment (currently overgrown) can be used as an access road from Martinazzi.</li> </ul>	New Infrastructure  Maintenance	CIP to include facility regrading with sediment removed and replantings. The outfall structure should be inspected. The discharge location is unknown but likely on ODOT ROW. Need to establish maintenance access. Existing easement available between two houses on Piute Ct.	N	
29	X		Facility next to C and E Rentals	Hedges Creek	Site Visit Water Quality Eval	Unknown	Ownership and functionality of existing stormwater facility is not known.  Per 10/31/16 call - Not a City issue. Property belongs to Washington County. Remove from problem area list, but may be potential water quality opportunity area.	Not required. Per City, ownership is Washington County.	N/A	Do not consider at this time.	N	
30		12	Sequoia Ridge Water Quality Facility	Saum Creek	Stormwater CIP	Maintenance	Maintenance needed and malfunctioning outlet structure.	12/7/16 - This facility has had little to no maintenance over the years. <ul style="list-style-type: none"> <li>Large cottonwood trees need to be removed, full replanting, outfall structures need to be re-viewed and updated as needed.</li> <li>Due to the standing water its assumed there is little to no beneficial vegetation</li> <li>Outlet structure appears to have a capped low flow pipe so pond design may have included an underdrain.</li> </ul>	Maintenance	Inclusion in larger water quality facility maintenance CIP.	N	
31		13	Sweek Dr. water quality pond	Hedges Creek	Stormwater CIP	Maintenance	Maintenance needed due to sediment accumulation and tree growth.	12/7/16 - This facility has had little to no maintenance over the years. <ul style="list-style-type: none"> <li>Large cottonwood trees need to be removed, full replanting, outfall structures need to be re-viewed and updated as needed.</li> </ul>	Maintenance	Inclusion in larger water quality facility maintenance CIP.	N	
32	X	14	Waterford Water Quality Facility	Hedges Creek	Stormwater CIP Water Quality Eval	Maintenance Water Quality	Maintenance needed due to sediment build up and limited access to outlet structure. Original design had a WQ swale graded around the pond for preliminary treatment and then the swale discharged into the pond. The swale no longer exists and needs to be regraded into the facility, there is likely sediment build up in the pond that needs to be removed. The existing outlet structure in the pond needs to be removed and replaced along the side of the pond to facilitate access.	12/7/16 - This facility has had little to no maintenance over the years. <ul style="list-style-type: none"> <li>Original design reported to properly function 15+ years ago.</li> <li>No vegetation is visible and the original design included a swale graded around the pond for pretreatment, prior to entering the pond. The swale currently does not receive any water and is not functional.</li> <li>Full replanting of vegetation is needed. Outfall structures need to be relocated and reviewed so that maintenance can be performed during high water events as needed. The inlet riprap needs to be replaced.</li> </ul>	Maintenance  WQ Retrofit	Update system design to incorporate detention and water quality improvements.  Redesign system to relocate outfall structure and replace inlet structure.	Hydrology only	

Table A-3: Stormwater Problem Areas and Project Opportunities

Preliminary Stormwater Problem Area ID	WQ Retrofit Opportunity	Stormwater Project Opportunity Area ID	Location Name	Basin/ Waterbody	Source	Problem Description	Problem/ Project Area Summary	Site Visit Summary (per 6-29-16 and 12-7-16 site visits)	Project Category	Preliminary Project Concept	Modeling (Y/N)	Modeling Data Needs
	X	City wide	Public Water Quality Retrofit	Citywide	Water Quality Eval	Water Quality	City staff has been receiving complaints from homeowners unaware that a public water quality facility is located in close proximity to their residence. Re-engineering and/or retrofit of existing water quality facilities may be required.	Pending	Maintenance WQ Retrofit	Develop a program to review/ investigate existing system design and function. To be discussed during CIP workshop.	N	
	X	15	89th Ave/Tualatin-Sherwood Rd Stormwater Outfall	Hedges Creek	Stormwater CIP Water Quality Eval	Water Quality	Water quality manhole installation to prevent debris from discharging into wetlands. CWS retrofit program driver.	12/7/16 - Limited opportunity for green infrastructure or any facility with drop requirement. Water surface elevation in adjacent wetlands, which is the outfall for this system, prohibits use of any facility with large internal drop requirement.	New Infrastructure/ WQ Retrofit	Per review of CWS Permit and SWMP, appears to be viable as an outfall retrofit project.	N	
	X	16	125th to Herman Rd	Cummins Creek	Stormwater CIP Water Quality Eval	Water Quality	Water quality treatment facility/ manhole installation to treat 143 ac contributing area with no upstream treatment. CWS retrofit program driver.	12/7/16 - Limited opportunity for green infrastructure or any facility with drop requirement. Water surface elevation in adjacent wetlands, which is the outfall for this system, prohibits use of any facility with large internal drop requirement. • Identifying the catchment for a proposed vortex device sizing remains the challenge due to the railway along south side of SW Herman Road and its impact on the catchment areas. • City input needed on drainage patterns in proximity of railway.	New Infrastructure/ WQ Retrofit	Per review of CWS Permit and SWMP, appears to be viable as an outfall retrofit project.	N	
	X		City Operations Yard	Hedges Creek	Water Quality Eval	Water Quality	Potential water quality retrofit at City-owned, municipal property. Significant impervious surface area. No existing treatment.	Pending	New Infrastructure/ WQ Retrofit	Use of LID onsite may qualify as a retrofit per CWS retrofit strategy.	N	
	X		White Parking Lot	Hedges Creek	Water Quality Eval	Water Quality	Potential water quality retrofit at City-owned, parking lot. Significant impervious surface area. No existing treatment.	Pending	New Infrastructure/ WQ Retrofit	Use of LID onsite may qualify as a retrofit per CWS retrofit strategy.	N	



## Attachment B: Maps

---

Figure 1: Project Area Overview

Figure 2: Topography and Soils

Figure 3: Stormwater System Overview


Figure 4: Land Use

Figure 5: Water Quality Assessment

Figure 6: Stormwater Project Opportunity Areas






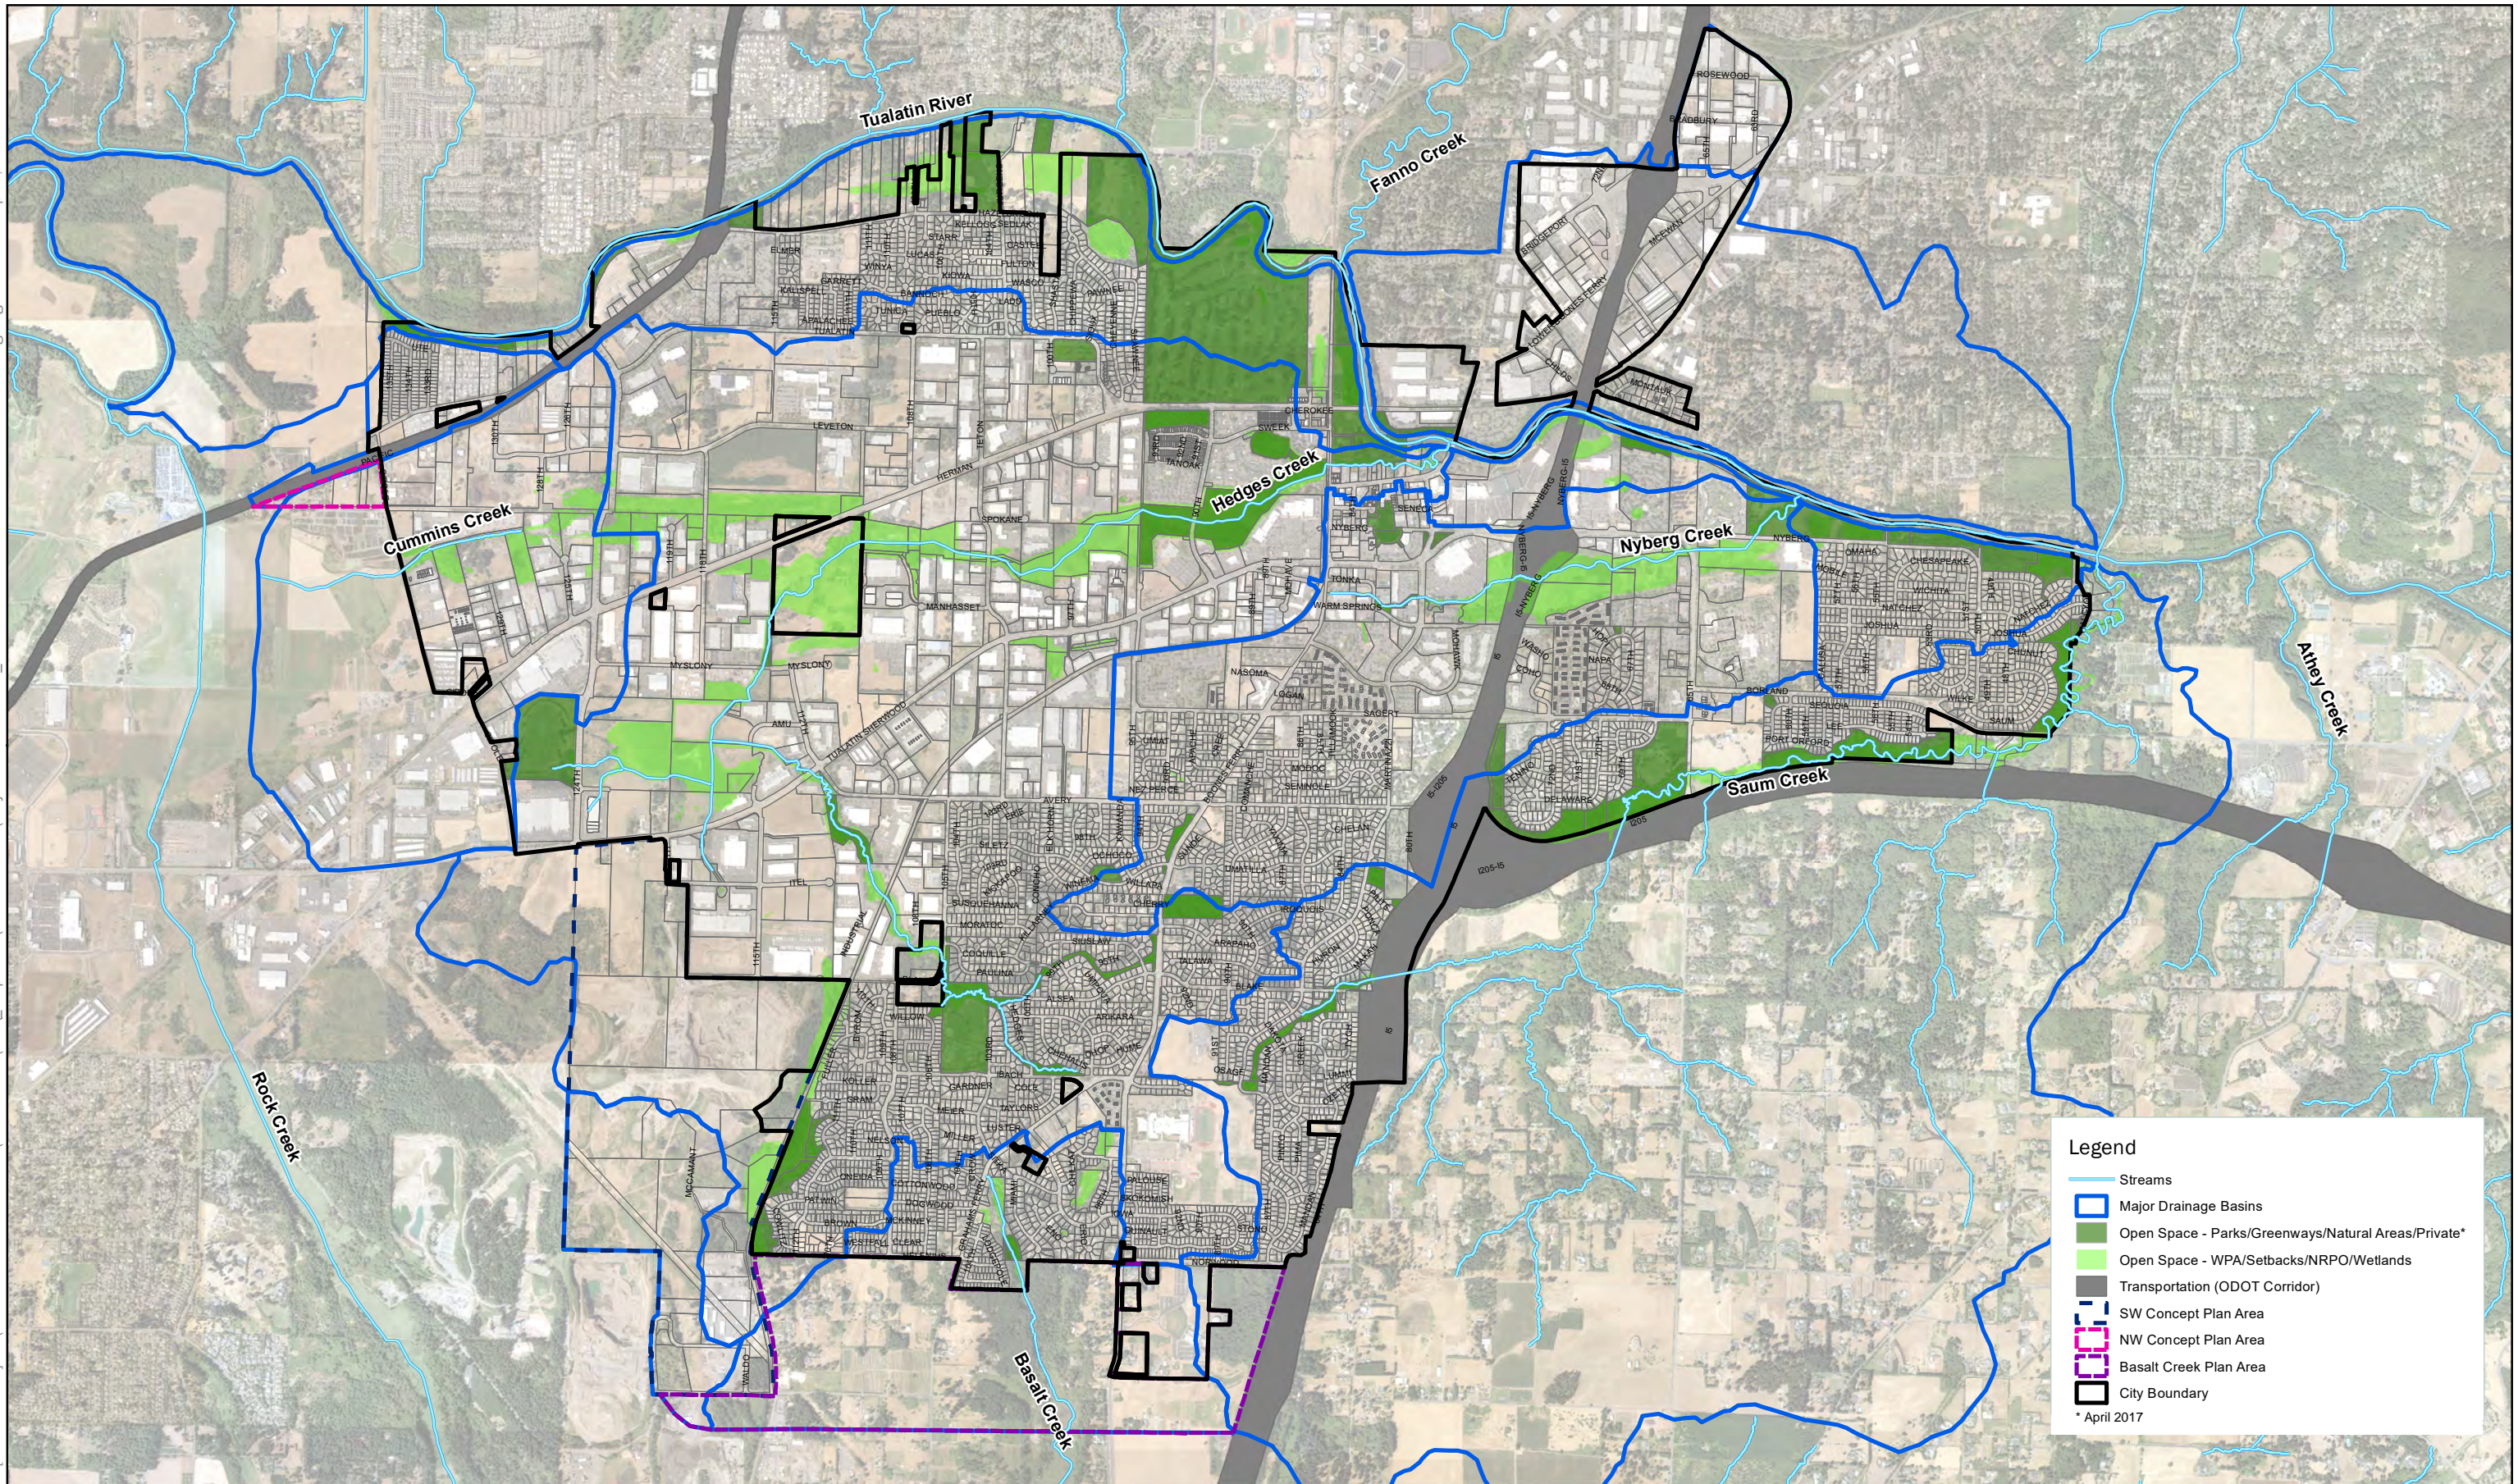


**Legend**

- Streams
- Major Drainage Basins
- Open Space - Parks/Greenways/Natural Areas/Private\*
- Open Space - WPA/Setbacks/NRPO/Wetlands
- Transportation (ODOT Corridor)
- SW Concept Plan Area
- NW Concept Plan Area
- Basalt Creek Plan Area
- City Boundary

\* April 2017



**City of Tualatin**  
**Stormwater Master Plan**  
 Date: March 2017  
 Project: Project 149233


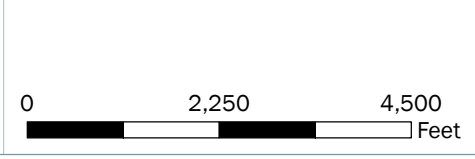


Notes:  
 1. Projection: NAD 1983 State Plane Oregon North (feet)

**Figure 1**  
**Project Area Overview**






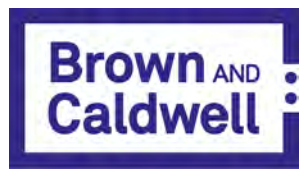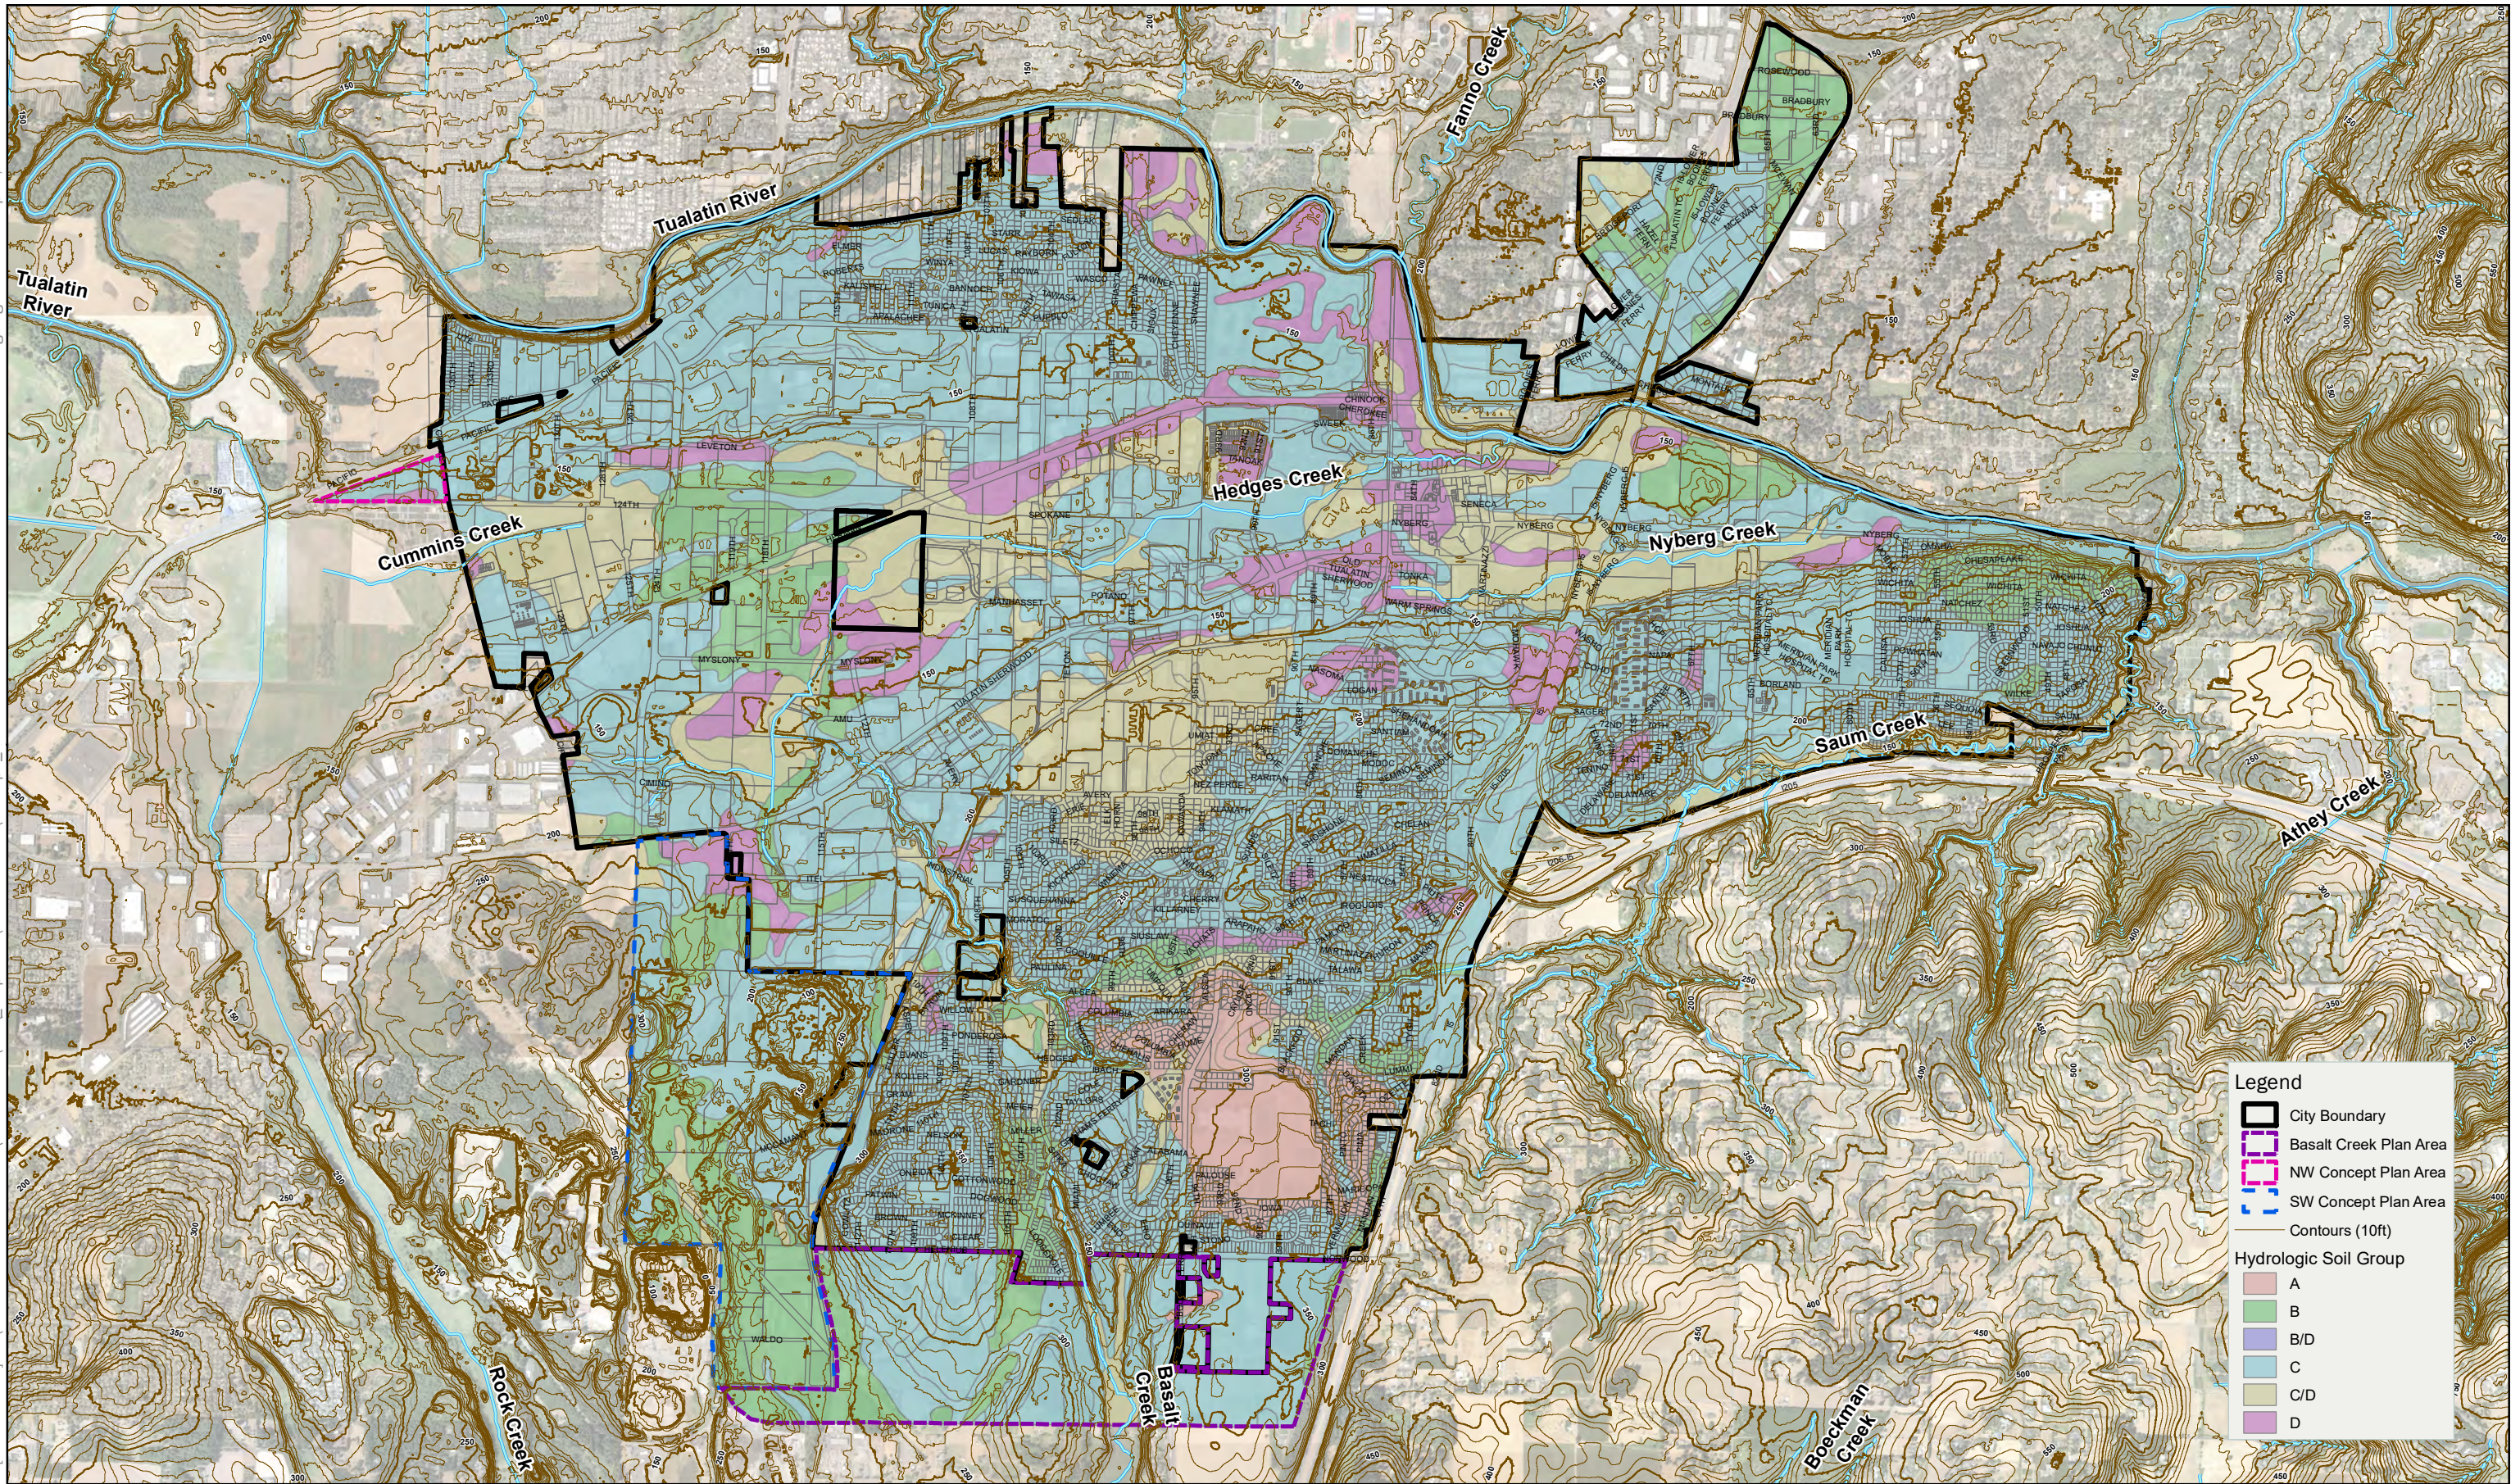

**City of Tualatin**  
**Stormwater Master Plan**


Date: March 2017  
Project: Project 149233



Notes:  
1. Projection: NAD 1983 State Plane Oregon North (feet)

**Figure 2**  
**Topography and Soils**



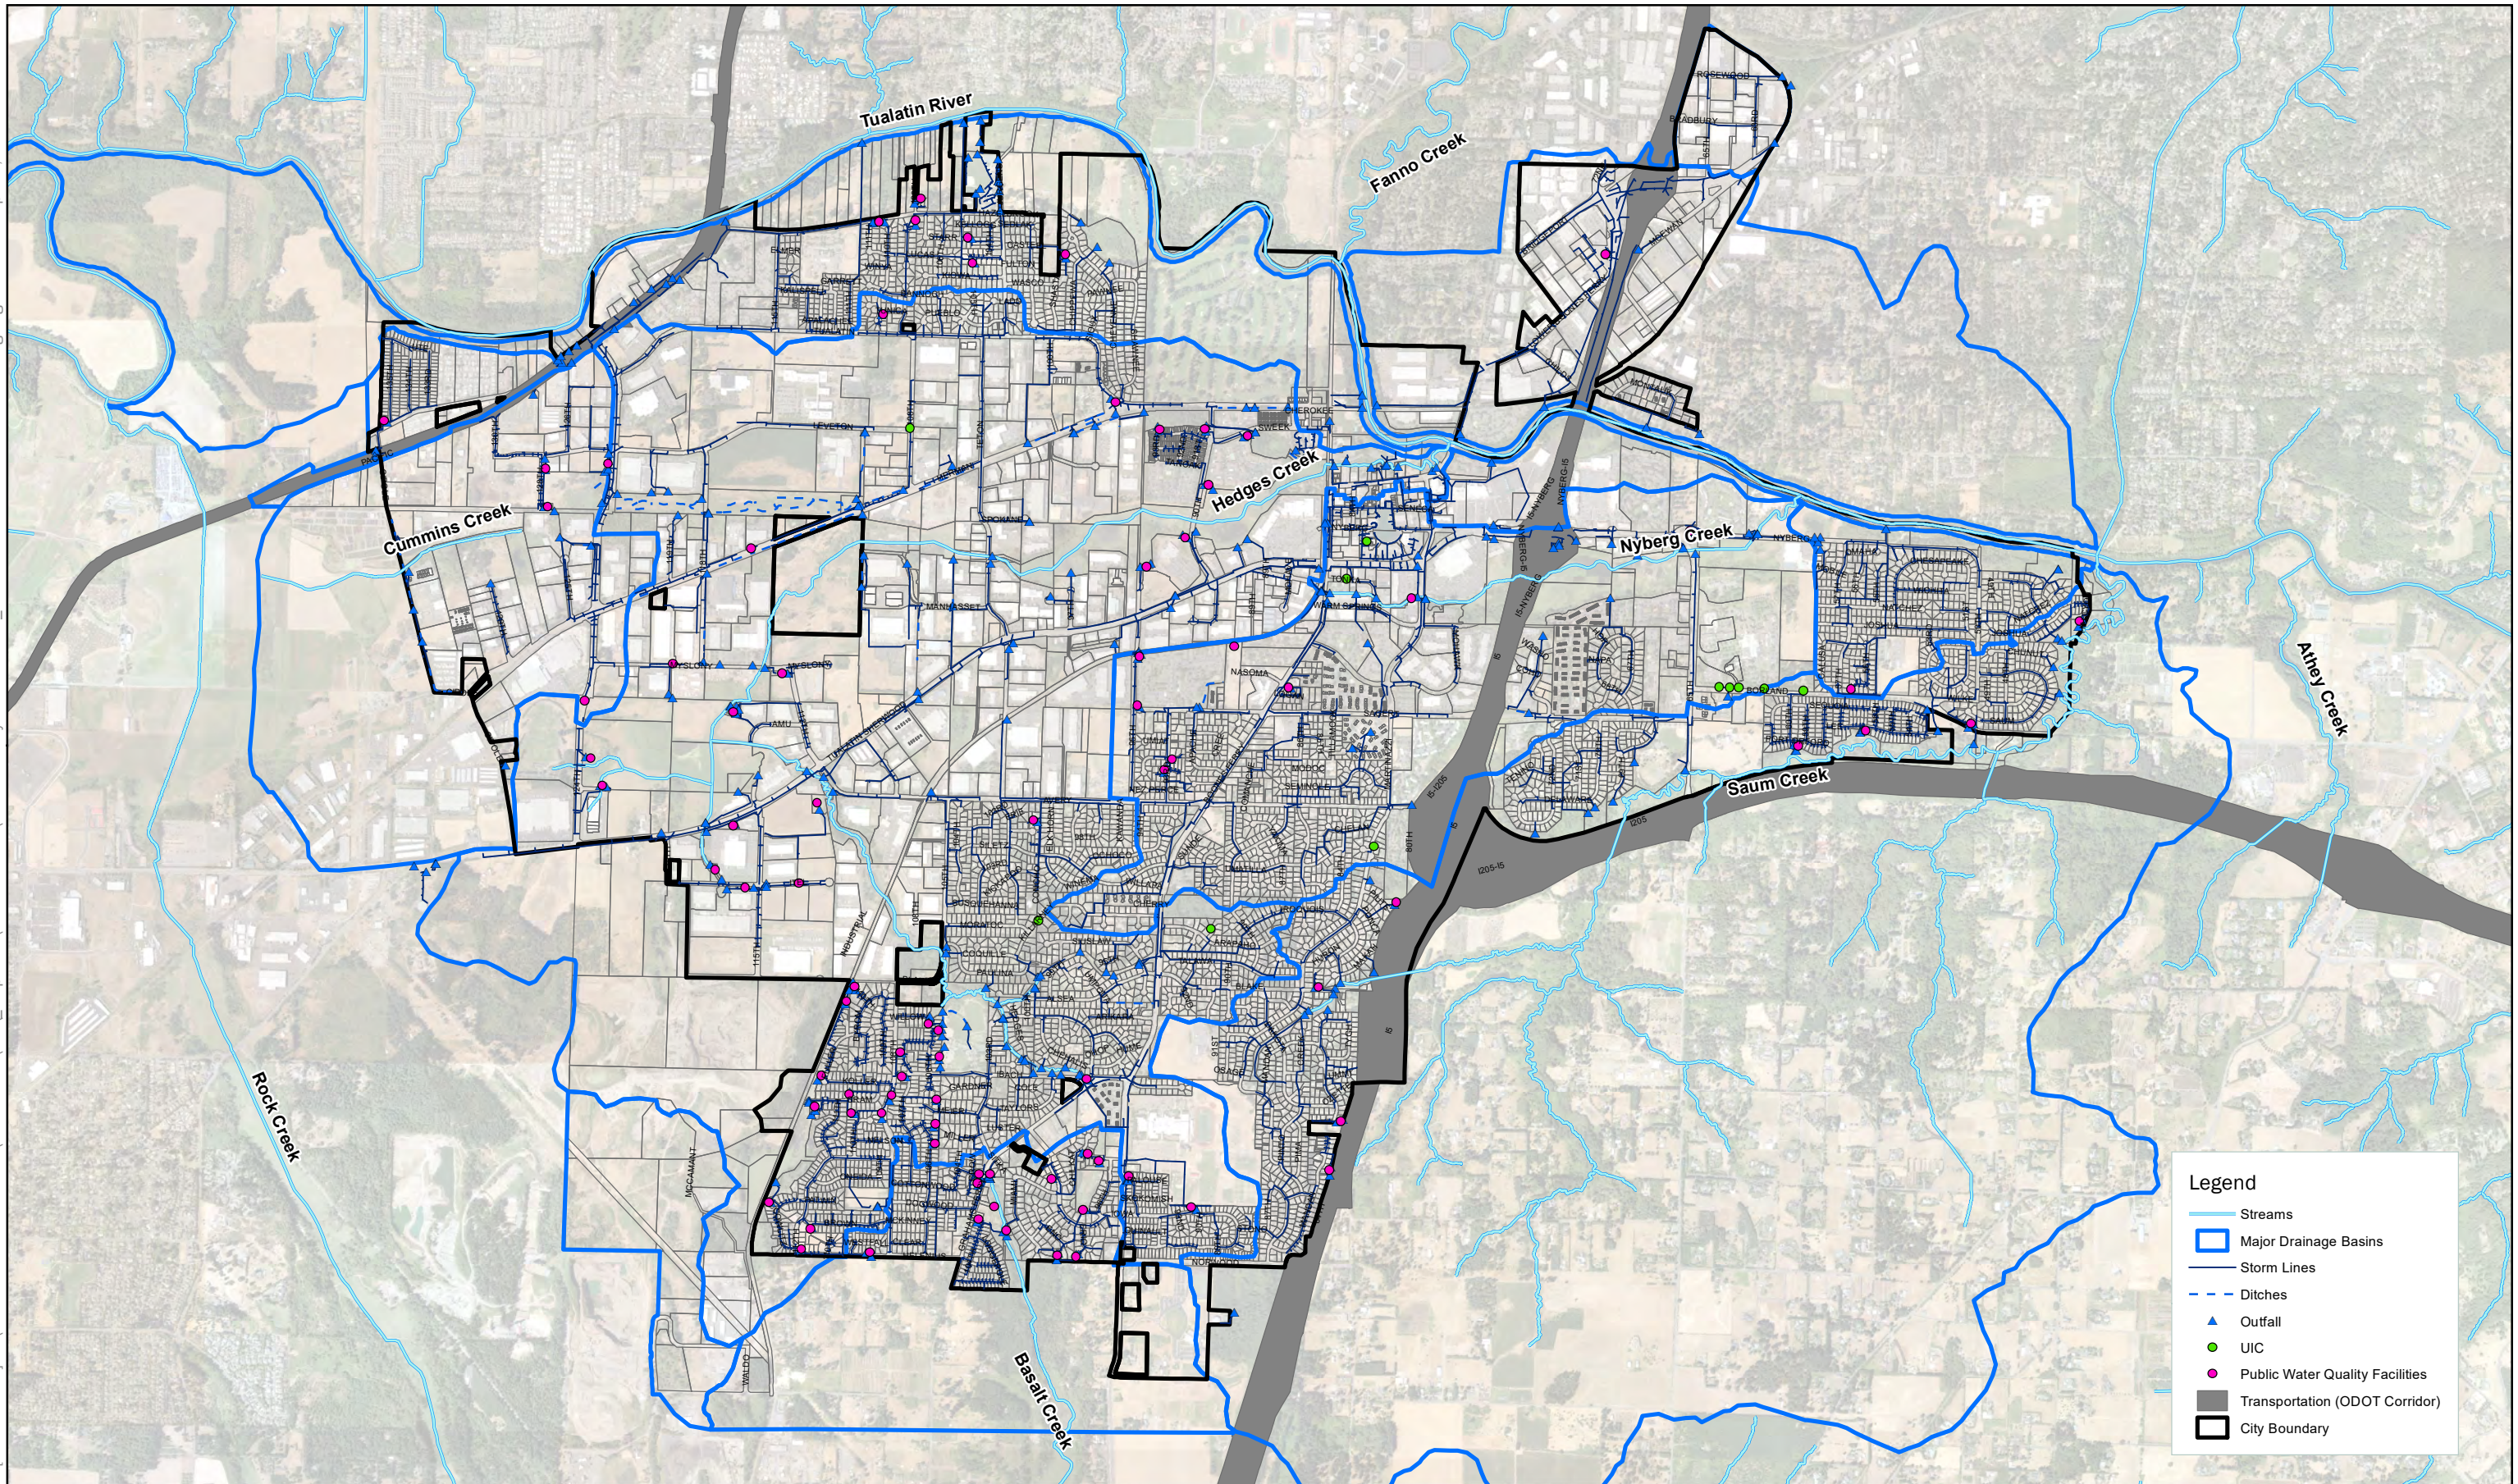


**Legend**

- Streams
- Major Drainage Basins
- Storm Lines
- Ditches
- Outfall
- UIC
- Public Water Quality Facilities
- Transportation (ODOT Corridor)
- City Boundary



**City of Tualatin  
Stormwater Master Plan**


Date: March 2017  
Project: Project 149233



Notes:  
1. Projection: NAD 1983 State Plane Oregon North (feet)

**Figure 3  
Stormwater System Overview**



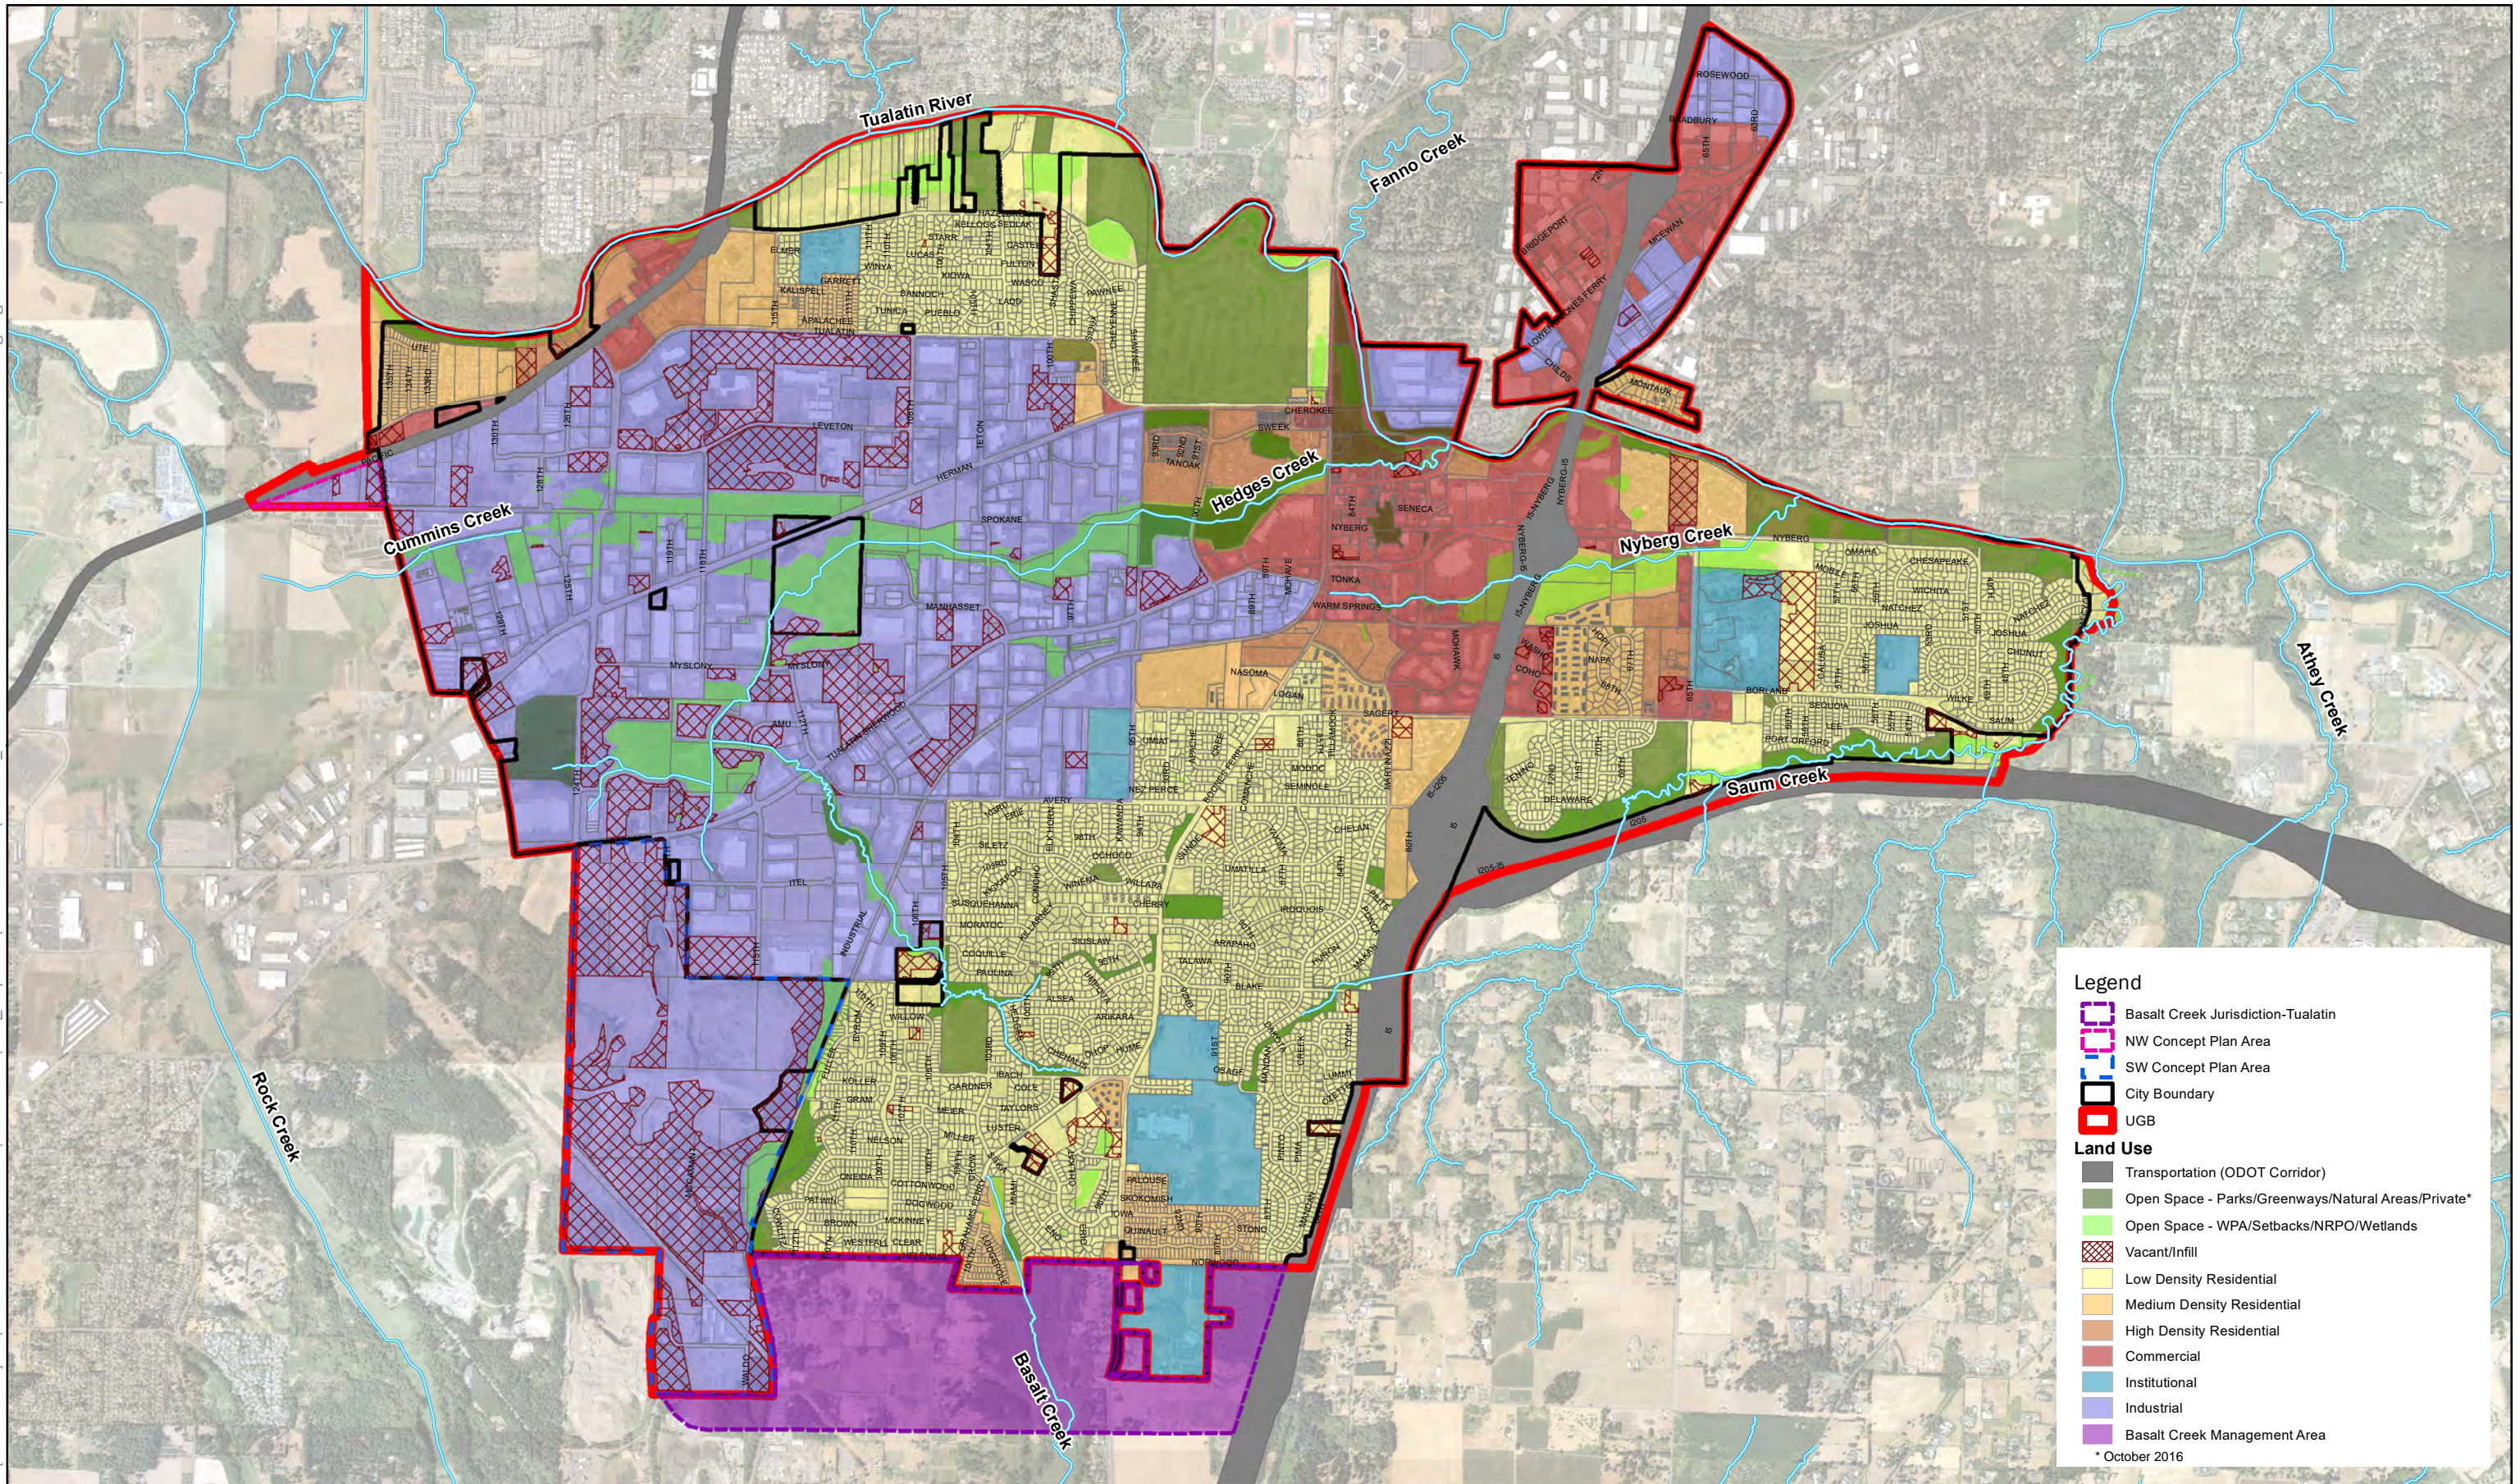

**Legend**

- Basalt Creek Jurisdiction-Tualatin
- NW Concept Plan Area
- SW Concept Plan Area
- City Boundary
- UGB

**Land Use**


- Transportation (ODOT Corridor)
- Open Space - Parks/Greenways/Natural Areas/Private\*
- Open Space - WPA/Setbacks/NRPO/Wetlands
- Vacant/Infill
- Low Density Residential
- Medium Density Residential
- High Density Residential
- Commercial
- Institutional
- Industrial
- Basalt Creek Management Area

\* October 2016



**City of Tualatin**  
**Stormwater Master Plan**


Date: March 2017  
Project: Project 149233



Notes:  
1. Projection: NAD 1983 State Plane Oregon North (feet)

**Figure 4**  
**Land Use**



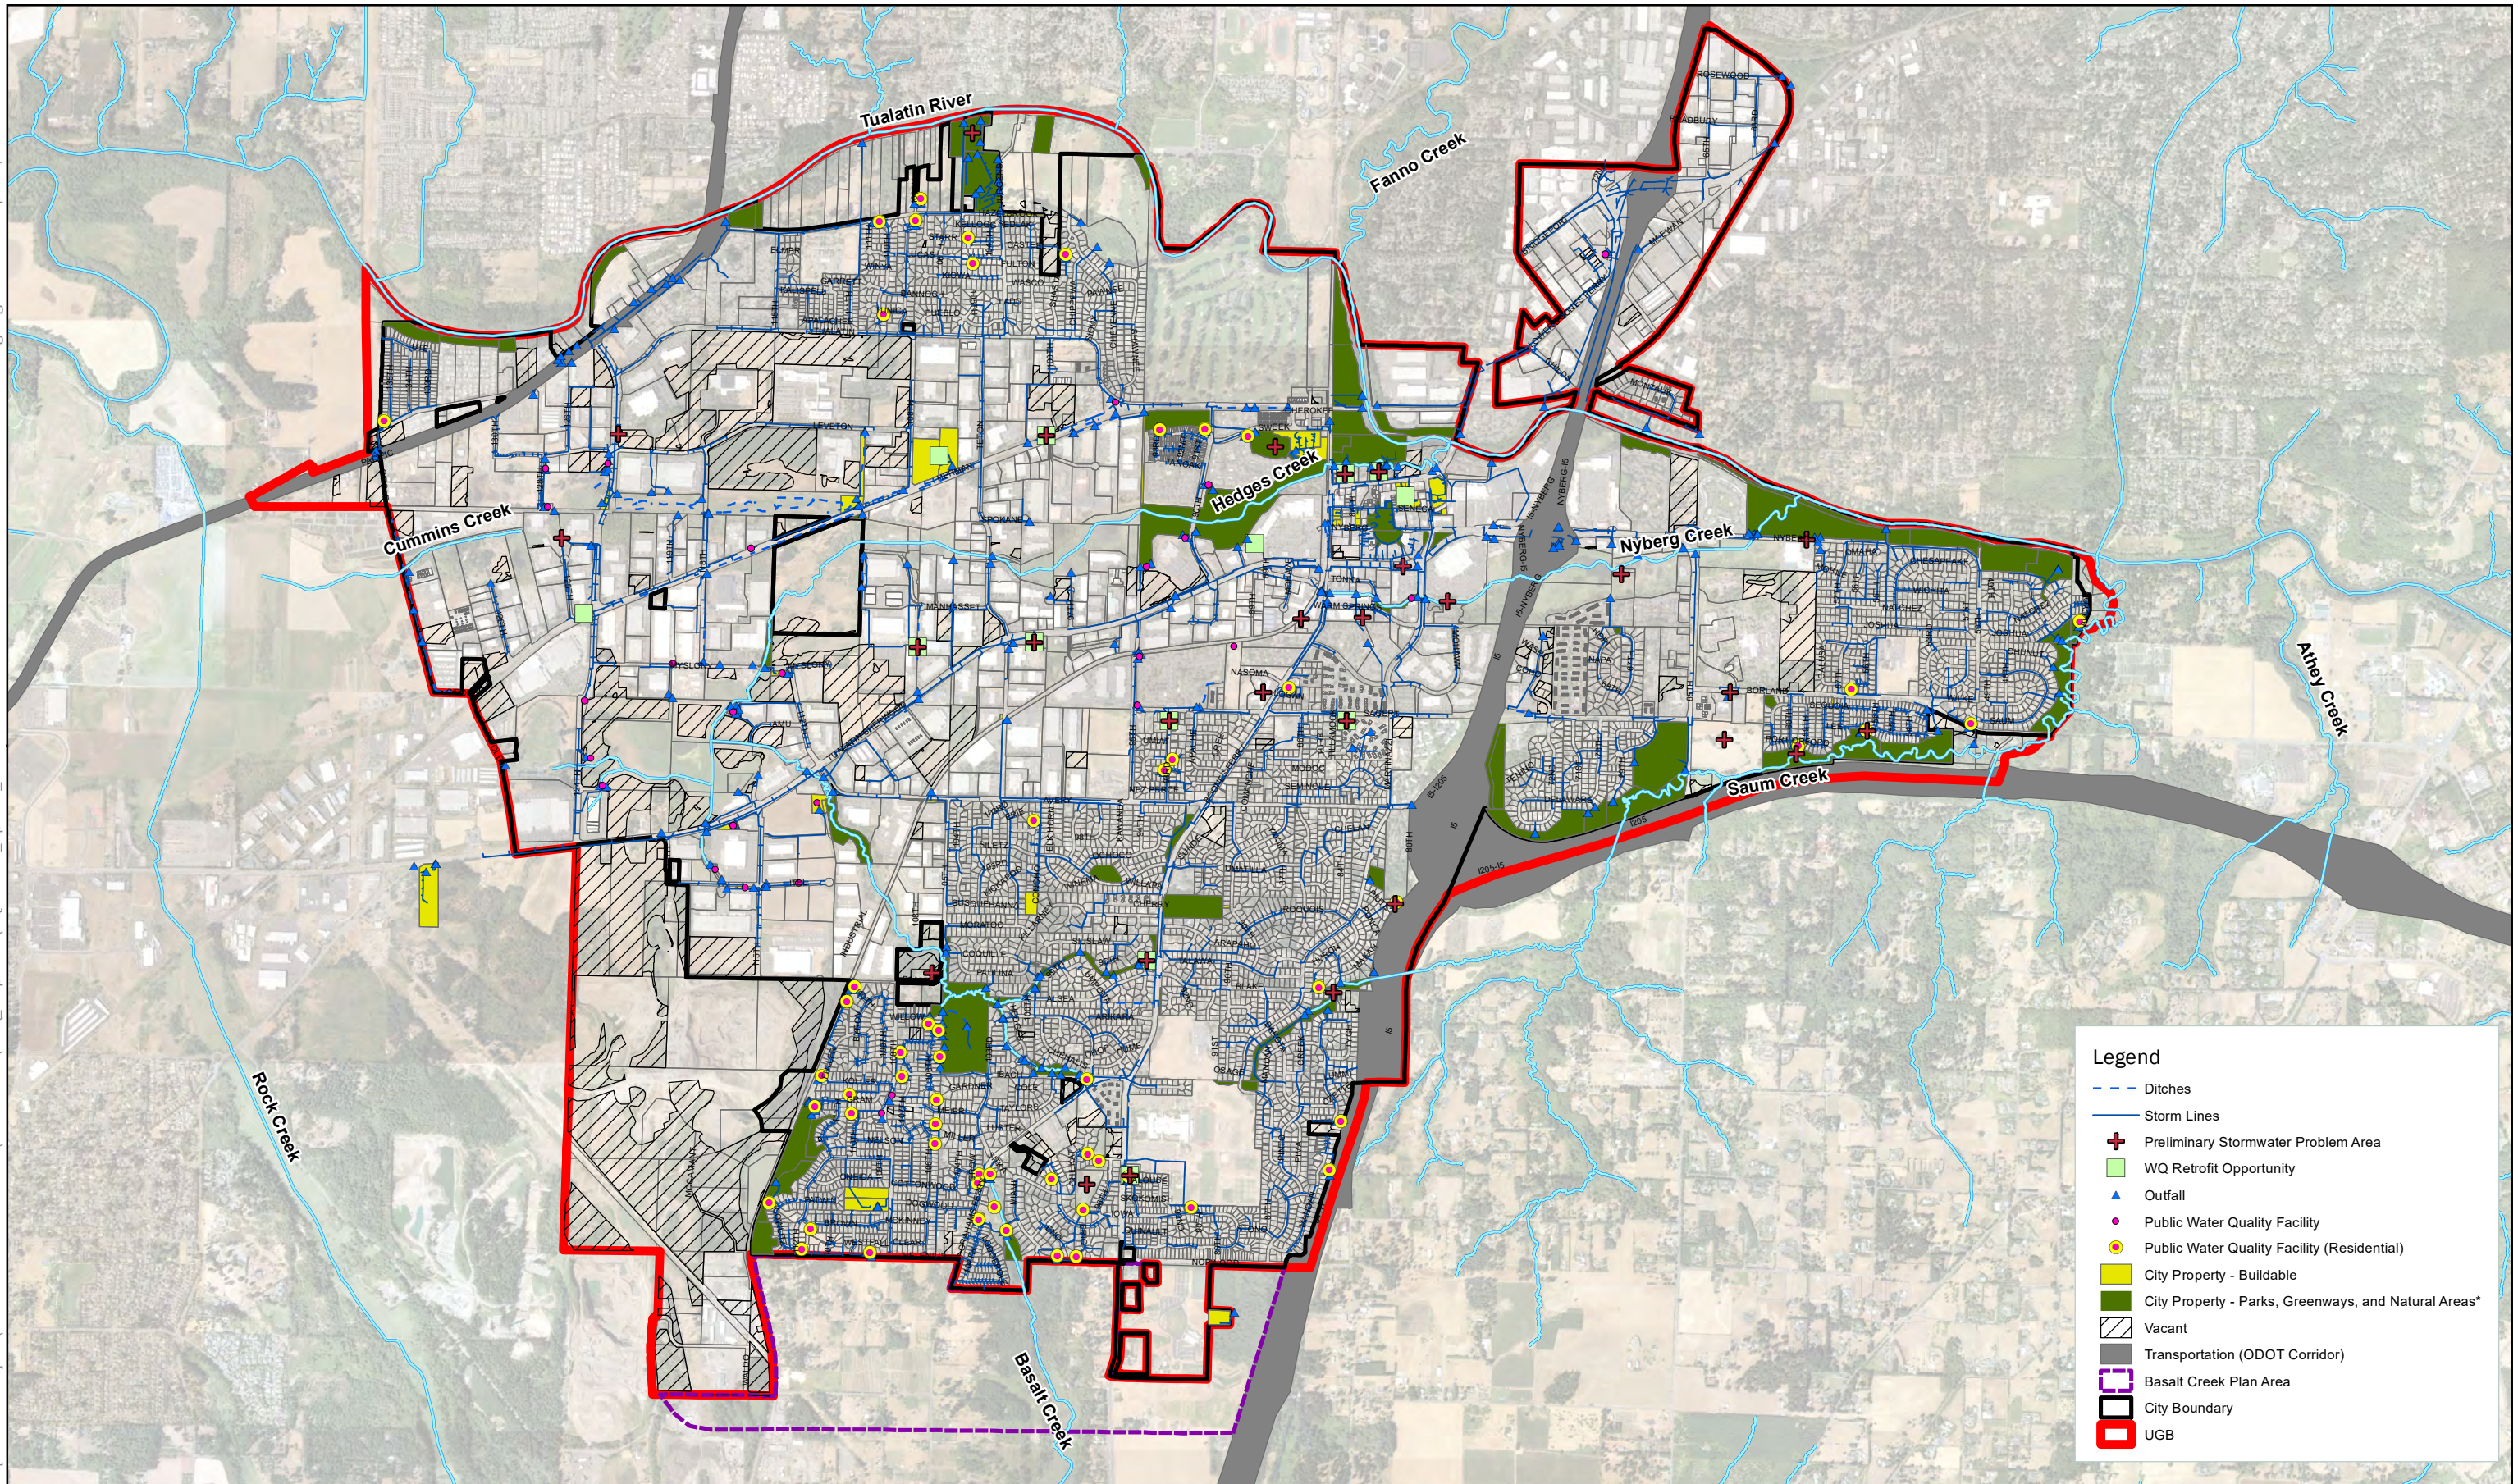


**Legend**

- - - Ditches
- Storm Lines
- ⊕ Preliminary Stormwater Problem Area
- WQ Retrofit Opportunity
- ▲ Outfall
- Public Water Quality Facility
- Public Water Quality Facility (Residential)
- City Property - Buildable
- City Property - Parks, Greenways, and Natural Areas\*
- ▨ Vacant
- Transportation (ODOT Corridor)
- ▭ Basalt Creek Plan Area
- ▭ City Boundary
- ▭ UGB



**City of Tualatin**  
**Stormwater Master Plan**

Date: March 2017  
Project: Project 149233




Notes:  
1. Projection: NAD 1983 State Plane Oregon North (feet)

**Figure 5**  
**Water Quality Assessment**





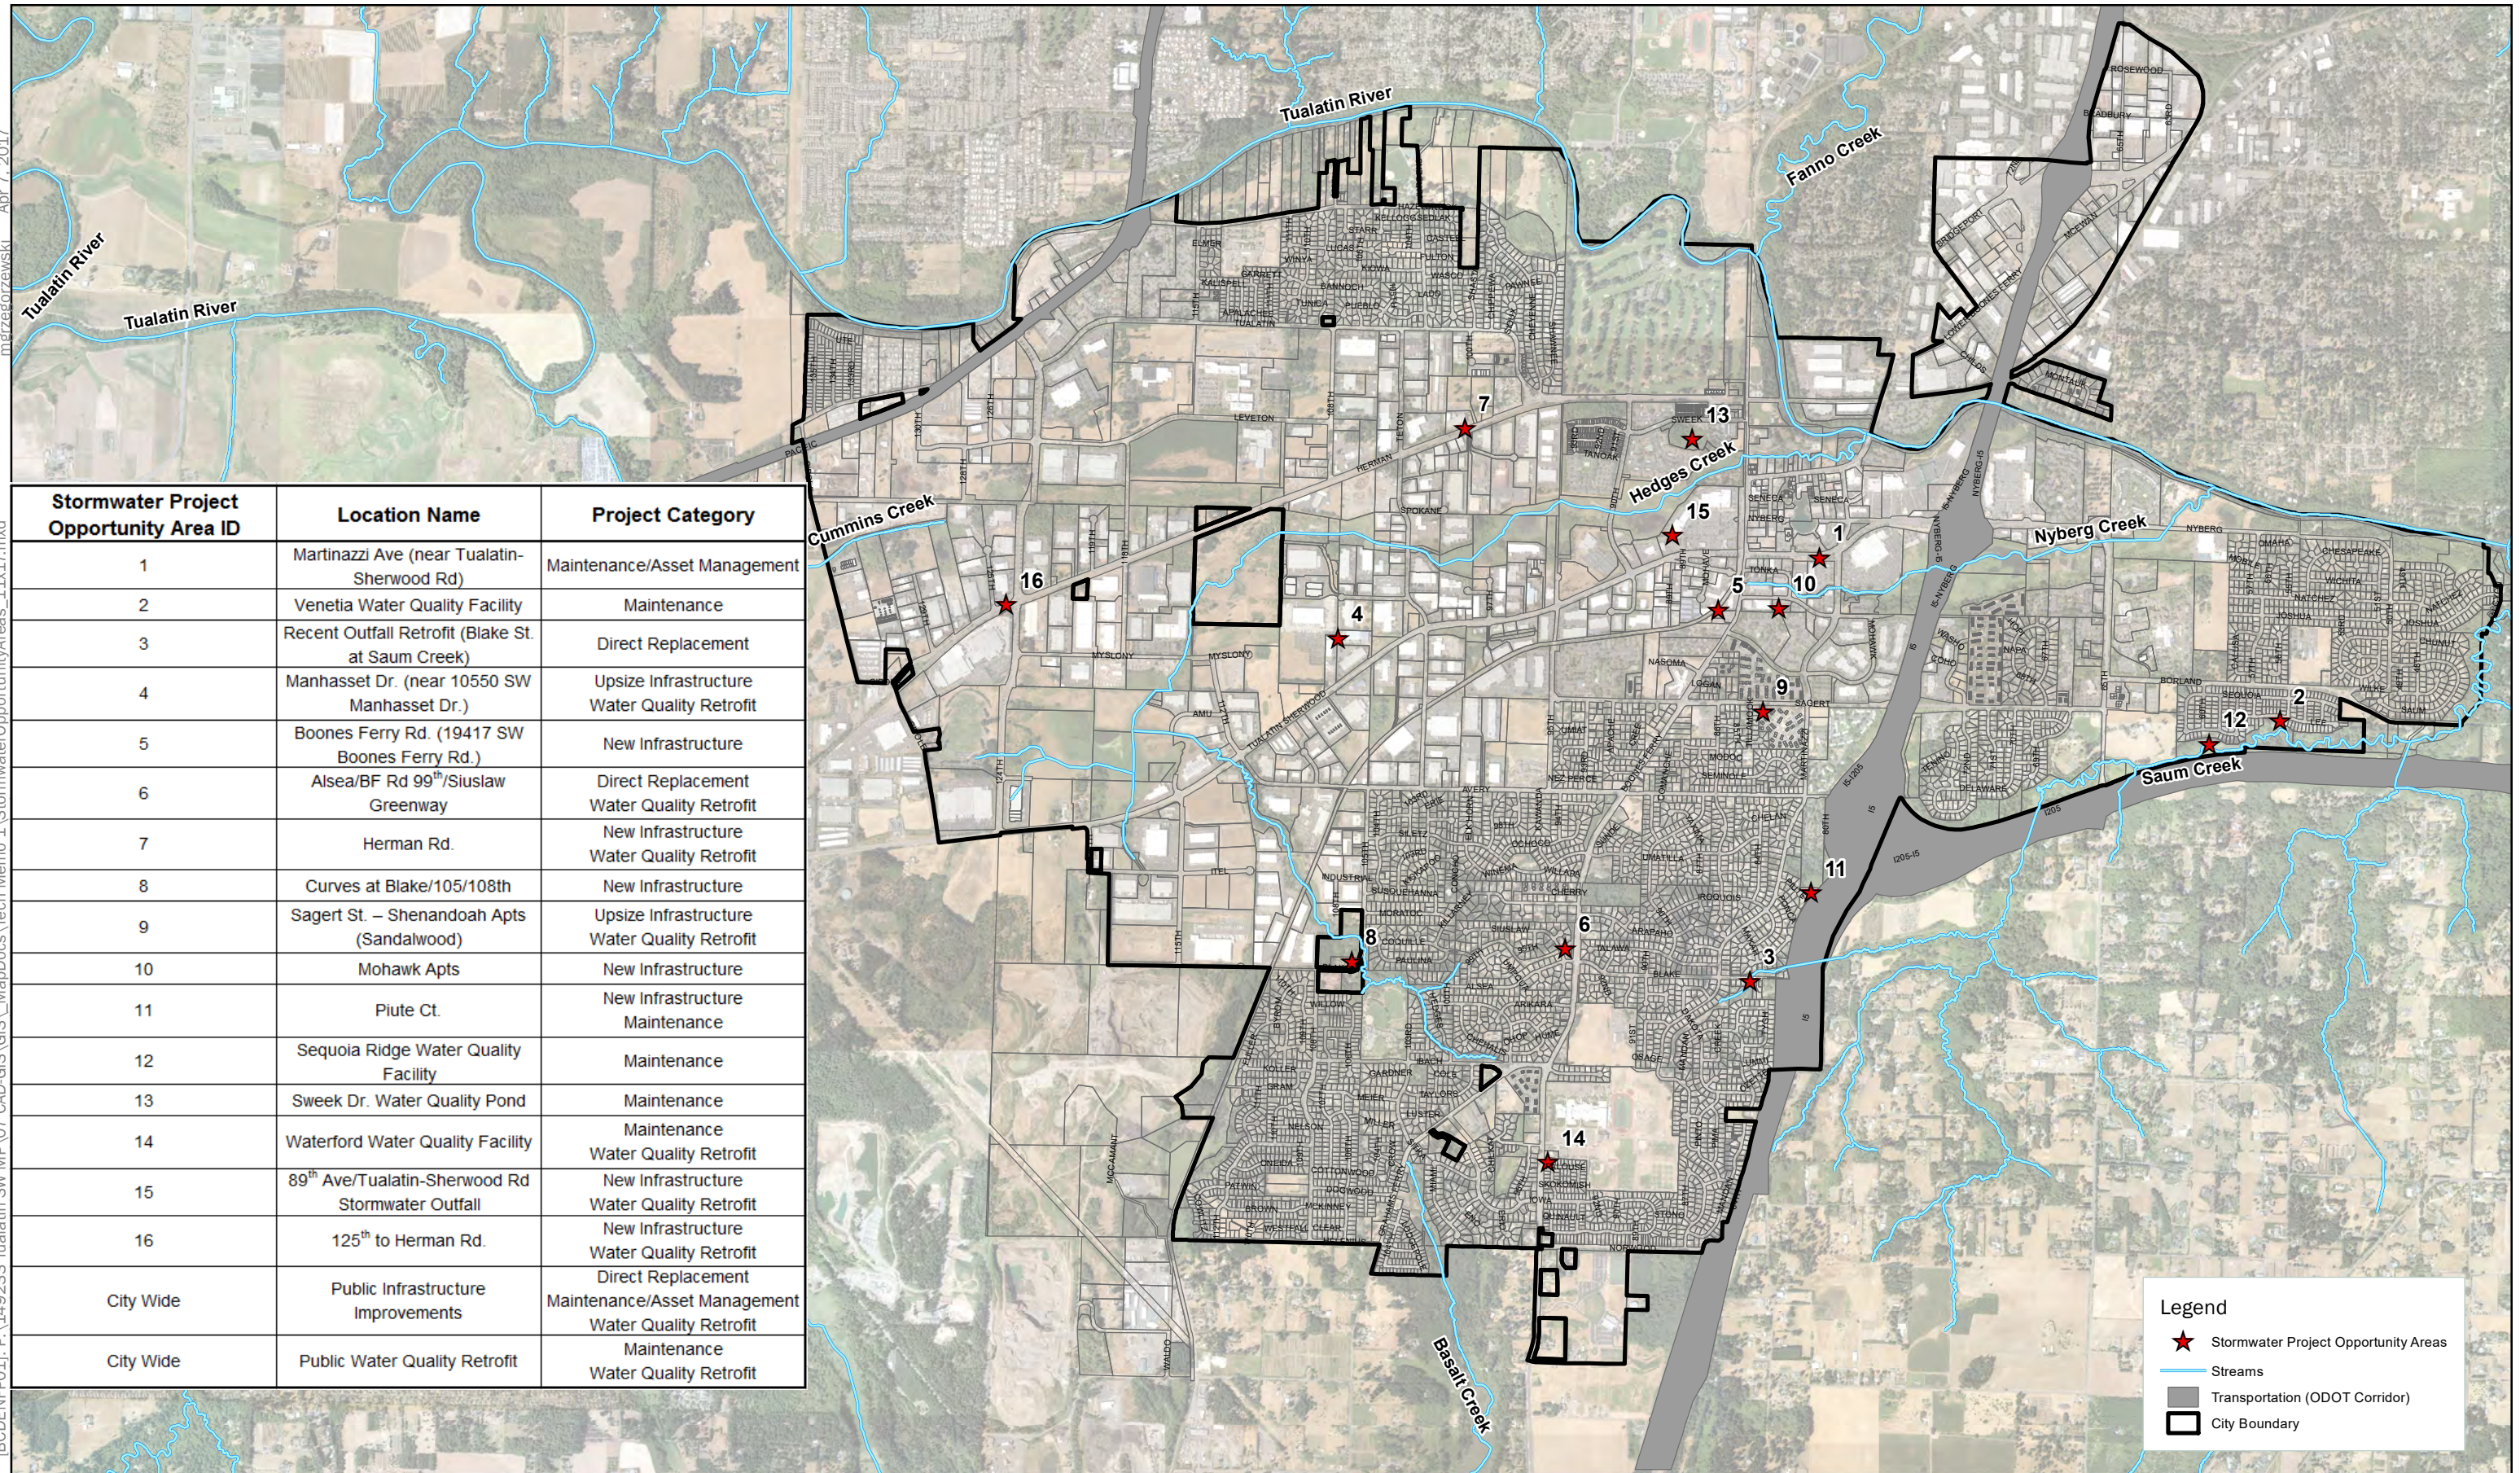


Stormwater Project Opportunity Area ID	Location Name	Project Category
1	Martinazzi Ave (near Tualatin-Sherwood Rd)	Maintenance/Asset Management
2	Venetia Water Quality Facility	Maintenance
3	Recent Outfall Retrofit (Blake St. at Saum Creek)	Direct Replacement
4	Manhasset Dr. (near 10550 SW Manhasset Dr.)	Upsize Infrastructure Water Quality Retrofit
5	Boones Ferry Rd. (19417 SW Boones Ferry Rd.)	New Infrastructure
6	Alesa/BF Rd 99 <sup>th</sup> /Siuslaw Greenway	Direct Replacement Water Quality Retrofit
7	Herman Rd.	New Infrastructure Water Quality Retrofit
8	Curves at Blake/105/108th	New Infrastructure
9	Sagert St. – Shenandoah Apts (Sandalwood)	Upsize Infrastructure Water Quality Retrofit
10	Mohawk Apts	New Infrastructure
11	Piute Ct.	New Infrastructure Maintenance
12	Sequoia Ridge Water Quality Facility	Maintenance
13	Sweek Dr. Water Quality Pond	Maintenance
14	Waterford Water Quality Facility	Maintenance Water Quality Retrofit
15	89 <sup>th</sup> Ave/Tualatin-Sherwood Rd Stormwater Outfall	New Infrastructure Water Quality Retrofit
16	125 <sup>th</sup> to Herman Rd.	New Infrastructure Water Quality Retrofit
City Wide	Public Infrastructure Improvements	Direct Replacement Maintenance/Asset Management Water Quality Retrofit
City Wide	Public Water Quality Retrofit	Maintenance Water Quality Retrofit



**City of Tualatin  
Stormwater Master Plan**

Date: March 2017  
Project: Project 149233



Notes:  
1. Projection: NAD 1983 State Plane Oregon North (feet)

**Figure 6  
Stormwater Project Opportunity Areas**



## **Appendix C: Hydrology and Hydraulic Modeling Methods and Results (TM2)**

---





# Technical Memorandum

6500 SW Macadam Avenue, Suite 200  
Portland, OR 97239

T: 503.977.6607  
F: 503.244.9095

Prepared for: City of Tualatin  
Project Title: Stormwater Master Plan  
Project No.: 149233

## Technical Memorandum 2 (updated)

Subject: Hydrology and Hydraulic Modeling Methods and Results  
Date: Original: September 8, 2017  
Updated: September 7, 2018  
To: Kim McMillan, P.E., City Project Manager  
From: Angela Wieland, P.E.,  
Matt Grzegorzewski  
Ryan Retzlaff

Prepared by:

Ryan Retzlaff

Reviewed by:

Angela Wieland, P.E.

### Limitations:

*This document was prepared solely for City of Tualatin in accordance with professional standards at the time the services were performed and in accordance with the contract between City of Tualatin and Brown and Caldwell dated April 11, 2016. This document is governed by the specific scope of work authorized by City of Tualatin; it is not intended to be relied upon by any other party except for regulatory authorities contemplated by the scope of work. We have relied on information or instructions provided by City of Tualatin and other parties and, unless otherwise expressly indicated, have made no independent investigation as to the validity, completeness, or accuracy of such information.*



# Table of Contents

---

Section 1: Introduction.....	1
Section 2: Stormwater Design Standards and Criteria .....	1
Section 3: Hydrologic Model Development.....	2
3.1 Subbasin Delineation .....	2
3.2 Time of Concentration .....	3
3.3 Existing Land Use Conditions .....	4
3.4 Future Land Use Conditions .....	5
3.5 Impervious Coverage .....	5
3.6 Curve Number .....	6
3.7 Design Storms.....	6
Section 4: Hydraulic Model Development.....	7
4.1 Modeling Areas .....	7
4.1.1 Herman Road System.....	7
4.1.2 Manhasset Drive System .....	8
4.1.3 Nyberg Creek System .....	8
4.2 Conveyance Naming Convention .....	9
4.3 Datum .....	9
4.4 Survey Needs .....	9
4.5 Hydraulic Input Parameters.....	9
4.5.1 Node Data .....	10
4.5.2 Conduit Data .....	10
4.5.3 System Routing.....	10
Section 5: Model Refinement and Results .....	11
5.1 Model Refinement .....	11
5.2 Hydrologic Model Results .....	11
5.3 Hydraulic Model Results.....	12
5.3.1 Initial Identification of Flooding Problems.....	12
5.3.2 Summary of Flooding Problems.....	12
Section 6: References .....	16
Attachment A: Hydrology Model Results .....	A-1
Attachment B: Hydraulic Model Results.....	B-1
Attachment C: Figures .....	C-1
Attachment D: Photo Log .....	D-1



## List of Tables

---

Table 1. Drainage Standards and Design Criteria .....	2
Table 2. Pipe Flow Velocities .....	4
Table 3. Modeled Land Use Categories and Impervious Percentages .....	5
Table 4. Runoff Curve Numbers for Urban Areas .....	6
Table 5. Design Storm Depths.....	7
Table 6. Initial Flood Control Capital Improvement Projects .....	14





## Section 1: Introduction

The City of Tualatin (City) is developing a stormwater master plan to guide future surface and stormwater program decisions. The master plan will address both water quantity and quality issues for the constructed and natural systems under the City's management. The master plan requires a clear understanding of existing and future runoff conditions across the city to identify long-term stormwater project needs.

This technical memorandum (TM2) has been developed to document the methodology used for modeling city-wide hydrology and hydraulics in specific areas of concern. Section 2 of TM2 outlines applicable stormwater design standards and criteria used to evaluate the performance of the storm drainage system. Section 3 outlines hydrologic model development. Section 4 outlines hydraulic model development, and Section 5 outlines results of the modeling efforts and proposed locations for the development of capital projects (CP).

The hydrology model was developed to evaluate peak flows generated by all subbasins within the city for existing and anticipated future development conditions. The hydrologic modeling results show that peak flows are expected to remain constant in watersheds such as Nyberg Creek and the Tualatin River where most land area is currently built to maximum zoning allowances. The most significant flow increases are anticipated in the Hedges Creek watershed due to significant vacant lands slated for future industrial development.

The hydraulic model results show flooding in several open channel and piped systems starting at a 2-year design storm event. Specific flooding locations include the open channel along the north side of Herman Road west of SW Tualatin Road, the railroad ditch behind Oil Can Henry's, and the open channel system along Manhasset Drive. Capital projects will be needed to address system flooding.

## Section 2: Stormwater Design Standards and Criteria

Brown and Caldwell (BC) conducted a review of the City's Public Works (PW) Standards and the Clean Water Services (CWS) *Design and Construction Standards* (2007) and the CWS *Low Impact Development Approaches (LIDA) Handbook* (2009) to establish planning criteria relevant to the analysis of the City's stormwater system. Planning criteria were used to identify where the system has capacity limitations and as the basis for design of stormwater projects for water quality, condition improvements, and capacity.

Applicable planning criteria are referenced in Table 1.

**Table 1. Drainage Standards and Design Criteria**

Criteria	Source	Value
Water Quality Facility Design	PW Standards (206.8)	Design to requirements of CWS <i>Design and Construction Standards</i> and CWS <i>LIDA Handbook</i> . Specific to the PW Standards, facilities are required to include 4 foot or 6 foot vinyl coated chain link fencing.
Water Quantity Facility Design	PW Standards (206.8) CWS <i>Design and Construction Standards</i>	Design to requirements of CWS <i>Design and Construction Standards</i> . Match pre- and post-development flow for the 2-, 10-, and 25-year, 24-hour storm events.
Pipe Design Storm	PW Standards (206.3)	Design to the 25-year storm event. Surcharge during the 25-year is not permissible. <sup>a</sup>
Pipe Size	PW Standards (206.4)	10-inch minimum diameter for pipe from catch basins to the main line in the public right-of-way. 12-inch minimum diameter for mains in the public right-of-way.
Manning’s Roughness	PW Standards (Table 206-8)	Varies by material and shape.
Pipe Material	PW Standards (206.4)	Concrete, PVC, Ductile iron, and aluminum spiral rib pipe.
Pipe Cover	CWS <i>Design and Construction Standards</i>	Table 5-2, varies by pipe material.
Structure Spacing	PW Standards (206.4)	250 feet maximum for 10-inch pipe; 400 feet maximum for 12-inch pipe.
Manhole Size	PW Standards (206.6)	48-inch-diameter minimum.

a. The City’s PW standards reference the rational method for conveyance design. Santa Barbara Urban Hydrograph (SBUH) was an approved equivalent as discussed with the City during the July 28, 2016 meeting.

For additional details on the City’s design standards and criteria, see Section 2.2 of *TM #1: Data Compilation and Preliminary Stormwater Project Development (TM1)* dated April 24, 2017.

## Section 3: Hydrologic Model Development

The hydrologic model was developed using XP-Storm Water Management Model (XPSWMM) version 2016.1. Within the model, the Santa Barbara Urban Hydrograph (SBUH) method was used to estimate hydrology. The necessary parameters for the SBUH method include subbasin areas, impervious percentages, pervious curve numbers, and times of concentration. The hydrology routine in XPSWMM converts rainfall into stormwater runoff based on design storm parameters (e.g., volume and intensity of rainfall) and subbasin characteristics such as topography, land use, vegetation, soil types and SBUH subbasin parameters described above.

This section includes detailed descriptions of the methodology used in determining each of the hydrology model input parameters.

### 3.1 Subbasin Delineation

The purpose of the subbasin boundary delineation is to refine major watershed boundaries into smaller subbasins to reflect specific catchment areas within the city.

Watershed boundaries for six major watersheds were provided by the City as a geographic information system (GIS) shapefile: Hedges Creek, Nyberg Creek, Saum Creek, Cummins Creek, Tualatin River, and Seely Ditch. These larger watershed boundaries are defined based on topography and conveyance system routing.

The watershed boundaries were refined in GIS based on outfall locations, with areas ranging between 56 and 2,918 acres. These watersheds were then divided up into smaller subbasins using a combination of contours, streets, tax lots, and conveyance infrastructure such as pipes, ditches, culverts, and open channels. Subbasins are generally smaller in the more densely urbanized areas where the pipe network is more complex. Smaller subbasins were also delineated in areas where hydraulic modeling was proposed



(see Section 4.1). Subbasin boundary questions were addressed using as-built records, GIS invert data, and City staff knowledge of the existing drainage system. A total of 256 subbasins were defined, ranging in size from 0.4 to 777.7 acres with an average area of 38.1 acres. The watershed and subbasin boundaries are shown in Attachment C, Figure 1.

Each subbasin was assigned a name in conjunction with the City-provided watershed name (e.g., NY for Nyberg Creek) and numbering associated with location in the subbasin. The numbering begins at 0010 near the outfall and increase in increments of 10 moving upstream. Subbasin names are shown in Attachment A, Table A-1.

Larger subbasins were delineated in the outer areas of the city and in rural/agricultural areas that have not yet developed. Many of these larger subbasins drain away from City infrastructure and include: CU-0010, CU-0020, CU-0030, SA-0120, SA-0140, SA-Offsite1, SA-Offsite2, SA-Offsite3, SA-Offsite4, SA-Offsite5, TU-Offsite1, and TU-Offsite2. Additionally, portions of the transportation corridor along I-5 are isolated from City infrastructure by topography or physical features. Subbasins in these areas were delineated separately and named with the extension “-ODOT.” Hydrologic model results from subbasins that are not contributing to city infrastructure are highlighted in gray in Attachment A, Table A-1.

Subbasin areas were calculated in GIS and are also provided in Attachment A, Table A-1.

### 3.2 Time of Concentration

Due to the number of subbasins, a modified, streamlined methodology was used to calculate time of concentration. The traditional approach of calculating time of concentration requires overland flow, shallow concentrated flow, and channel or pipe flow times to be calculated individually and added together, as shown in equation (1). The streamlined method is described below and includes application of general assumptions for the overland flow and shallow concentrated flow time components and calculating average pipe flow variables and applying them to all subbasins to determine the pipe flow times.

$$(1) T_c = \text{Overland flow time (min)} + \text{Shallow concentrated flow (min)} + \text{Pipe/ channel flow (min)}$$

The first step involves estimating the longest pipe flow path within each subbasin. Twenty subbasins were selected at random and the longest pipe flow path to the outlet was measured for each of them. A linear regression shown in equation (2), was developed based on the measured values and applied to the remaining subbasins to calculate an approximate pipe flow path. In the regression equation, subbasin area in acres is the independent variable (x), and longest pipe flow length is the dependent variable (y). This method was used to save time and is nearly as accurate as estimating the length of pipe flow within each subbasin.

$$(2) Y = 43.411x + 413.91 \text{ (} R^2 = 0.81 \text{)}$$

Average pipe slope was calculated for each subbasin based on LiDAR data. The maximum and minimum surface elevations within each subbasin were identified in GIS and used to approximate an average pipe slope for each subbasin. To check the validity of these values, pipe slope was manually calculated for 20 subbasins based on available invert data in GIS. The average of the manually calculated pipe slopes was found to be 40 percent less than the average of the slopes calculated using the maximum and minimum surface elevations. Thus, a 40 percent correction factor was applied to all calculated pipe slopes.

Pipe flow velocities were calculated using Manning’s equation. Calculations assumed a 12-inch-diameter concrete pipe ( $n = 0.014$ ) flowing at maximum discharge (93 percent full). Table 2 shows the calculated pipe flow velocities for slopes ranging from 0.5 percent to 6 percent. Average pipe slopes were rounded to the nearest 0.5 percent to estimate pipe flow velocities for calculating pipe flow times.

The channel or pipe flow times were directly calculated for each subbasin using the pipe flow velocities per Table 2 and the calculated longest flow path.



To account for the overland flow component of the time of concentration calculation, 5 minutes was assumed for sheet flow. No additional time was assumed for shallow concentrated flow due to the relatively large percentage of impervious surface in the City. From this information, the total time of concentration was calculated for all subbasins.

Table 2. Pipe Flow Velocities	
Slope, percent	Velocity, feet per second
0.5	3.2
1	4.5
1.5	5.5
2	6.4
2.5	7.2
3	7.8
3.5	8.5
4	9.1
4.5	9.6
5	10.1
5.5	10.6
6	11.1

Fourteen subbasins were identified as having a substantial amount of open space or vacant lands and minimal pipe network so the streamlined methodology described above did not apply. For these subbasins, the traditional method of calculating time of concentration was used to more accurately estimate the overland flow and shallow concentrated flow times.

The traditional method required identifying the longest flow path lines in GIS and dividing the path into sheet flow, shallow concentrated flow, and pipe/ open channel flow lengths. The maximum sheet flow length was set to 150 feet. The shallow concentrated flow length was calculated based on the remaining flow path length needed to reach an open channel conveyance. The flow length and slope of the open channel conveyance was directly measured in GIS, and the average open channel velocity was estimated using the following equation (3) where k is the velocity factor dependent on the channel bottom, and s is the measured slope of the channel in ft/ft. Grassed waterways have a velocity factor k of 15.

$$(3) v = k\sqrt{s}$$

The time of concentration calculated for all subbasins ranged from 5.8 to 183 minutes with an average of 14.2 minutes. Attachment A, Table A-1 includes the calculated time of concentration values for each subbasin.

### 3.3 Existing Land Use Conditions

The City provided GIS data representing City planning districts, developable lands, parks, open spaces, and natural areas. Through coordination with the City, BC developed general land use classes by consolidating planning districts and merging the planning districts with developable lands and (undevelopable) open spaces.

Developable lands were categorized as vacant, infill, or re-developable. Upon analysis of aerial imagery, it was determined that areas classified as vacant and infill are currently undeveloped and development will lead to a significant increase in impervious coverage and associated runoff volume. Thus, vacant land use



coverage consists of vacant and infill areas. Re-developable areas are already developed consistent with their planning district designation and were assigned land use based on their consolidated planning district designation. Undevelopable open space included City-owned parks, greenways, and natural areas, the Wetland Protection Area (WPA), wetlands, and the Natural Resource Protection Overlay (NRPO) District.

The Oregon Department of Transportation (ODOT) corridor along Interstate 5, Interstate 205, and Highway 99W was defined separately as a transportation land use coverage as these areas are fully developed and impervious coverage is not expected to change.

For additional detail on the development of land use coverage, refer to Section 2.3.1 of TM1. Existing land use coverage is shown in Attachment C, Figure 2.

### 3.4 Future Land Use Conditions

To represent future land use conditions, all vacant lands defined under existing condition land use was assumed to be developed in accordance with the City’s underlying planning district designation. Future conditions land use is also reflected in Attachment C, Figure 2.

### 3.5 Impervious Coverage

Impervious coverage by land use was directly calculated using City-provided GIS coverage of impervious surface and supplemented with City-provided GIS coverage of building footprints and right-of-way. The calculated impervious percentages by land use were verified using aerial imagery and compared to impervious percentages used by surrounding communities.

Due to the potential for redevelopment and infill amongst the residential land use categories, a separate future condition impervious percentage was defined for the low density, medium density, and high density residential land use categories. Each calculated impervious percentage (reflecting existing development conditions) was increased by 10 percentage points to account for added impervious surface expected with redevelopment. This increase was made independent from the anticipated development of vacant land use.

Existing and future impervious percentages by land use are shown in Table 3. For additional detail on the impervious coverage calculations, refer to Section 2.3.2 of TM1.

<b>Modeled Land Use</b>	<b>Existing Impervious Percentage</b>	<b>Future Impervious Percentage</b>
Low-density residential	43	53
Medium-density residential	45	55
High-density residential	50	60
Institutional	35	35
Industrial	74	74
Commercial	78	78
ODOT Corridor	46	46
Basalt Creek/Rural Residential	7	7
Open Space (Parks/Greenways/Natural Areas)	5	5
Open Space (WPD/NRPO/Wetlands)	4	4
Vacant	5	Consistent with underlining planning district designation



An area-weighted average impervious coverage by subbasin was calculated for both existing and future conditions based on the contributing land use and associated impervious percentage. The existing and future impervious percentage for each subbasin is shown in Attachment A, Table A-1.

### 3.6 Curve Number

Curve numbers are dimensionless numbers defined by the hydrologic soil group and land cover and are required for use in the SBUH hydrology method.

Runoff curve numbers for pervious areas were estimated from typical runoff curve number tables provided in the Soil and Conservation Service (SCS) Technical Release 55, titled *Urban Hydrology for Small Watersheds* (SCS 1986). Curve number values are shown in Table 4 and were selected based on hydrologic soil group and associated land use description for the pervious portions of each subbasin.

Aerial imagery was used to select a representative pervious land use description. Fair condition open space was used for primarily developed subbasins and fair-condition woods-grass combination was used for primarily undeveloped subbasins. Hydrologic soil group coverage is shown in Attachment C, Figure 3. Area-weighted pervious curve numbers were then directly calculated for each subbasin.

A curve number of 98 was assumed for impervious areas.

Table 4. Runoff Curve Numbers for Urban Areas				
Land use descriptions	Curve numbers for hydrologic soil group			
	A	B	C	D
Open space (lawns, parks, golf courses, cemeteries, etc.)				
Good condition (grass cover >75%)	39	61	74	80
Fair condition (grass cover 50–75%)	49	69	79	84
Poor condition (grass cover <50%)	68	79	86	89
Paved parking lots, roofs, driveways, etc.	98	98	98	98
Woods-grass combination:				
Poor condition	57	73	82	86
Fair condition	43	65	76	82
Good condition	32	58	72	79

### 3.7 Design Storms

Design storms are precipitation patterns typically used to evaluate the capacity of storm drainage systems and design capital improvements for the desired level of service.

Design storms used for this study included the 2-, 10-, and 25-year recurrence interval 24-hour events. The rainfall depths were taken from CWS’ *Design & Construction Standards*, Standard Detail Drawing No. 1280. The rainfall distribution for these design storms was based on a SCS Type IA, 24-hour distribution, which is applicable to western Oregon, Washington, and northwestern California.

Table 5 lists the design storm rainfall depths used in the hydrology model.

Table 5. Design Storm Depths	
Design storm event	Rainfall depth, inches
2-year, 24-hour	2.50
10-year, 24-hour	3.45
25-year, 24-hour	3.90

## Section 4: Hydraulic Model Development

To evaluate flood hazards and capacity limitations of stormwater infrastructure, the XPSWMM computer model was used to simulate the hydraulic performance of select pipe and open-channel systems to calculate peak flow, water surface elevation, and velocities within the modeled infrastructure for select design storms.

This section includes a summary of the hydraulic modeled areas and input parameters used to characterize the hydraulic conditions of the modeled system.

### 4.1 Modeling Areas

As described in TM1, a total of five stormwater project opportunity areas were identified as those that would benefit from a hydraulic modeling assessment:

1. Stormwater Project Opportunity Area 4 – Manhasset
2. Stormwater Project Opportunity Area 5 – Boones Ferry Road at Oil Can Henry’s
3. Stormwater Project Opportunity Area 7 – Herman Road
4. Stormwater Project Opportunity Area 9 – Sagert Street at the Shenandoah Apartments
5. Stormwater Project Opportunity Area 10 – Mohawk Apartments

These project opportunity areas were identified based on City and stakeholder reported flooding and the need for additional information to understand the potential cause of flooding. Hydraulic assessment of these areas will also help with development of project concepts and CIPs. The hydraulic model extents were discussed and verified with City staff on February 2, 2017. Due to proximity and connectivity of the proposed modeled system, three of the project opportunity areas (5, 9, and 10) were combined into one hydraulic model system. The specific model areas are described in detail below and an overview is provided in Attachment C, Figure 4.

#### 4.1.1 Herman Road System

City staff identified this area during completion of the stormwater surveys (see TM1) as frequently flooding. The drainage system along the north side of Herman Road is characterized by ditches and culverts, which drain south under the road and adjacent railroad through two culverts. South of the railroad is an open channel that conveys all runoff to the east before discharging into Sweek Pond.

Based on field reconnaissance, feedback from City staff, and initial system review in GIS, the primary drainage issues include undersized drainage infrastructure and flat grade along Herman Road. The south side of Herman Road does not have a stormwater collection system, which results in standing water on the roadway.

The hydraulic model for the Herman Road system includes the piped and open channel conveyance along Herman Road between Southwest Teton Avenue and Southwest Tualatin Road, as well as the open channel/piped system between Herman Road and the outfall at Sweek Pond. Attachment C, Figure 5 shows the hydraulic modeling extents specific for the Herman Road system.



### 4.1.2 Manhasset Drive System

The City frequently responds to flooding of the open channel system, starting from Tualatin-Sherwood Road to Manhasset Drive. This area was also identified as having frequent flooding during completion of stormwater surveys. The Manhasset Drive system receives stormwater from the area south of Tualatin-Sherwood Road. A culvert under Tualatin-Sherwood Road discharges north to the open channel system, which runs between private industrial properties before entering a ditch inlet and pipe to Hedges Creek.

Based on field reconnaissance, feedback from City staff, and initial system review in GIS, the open channel system is capacity limited. The channel is larger and steeper in the southern (upstream) portion and becomes shallower flatter in the northern (downstream) portion. During a site visit on June 29, 2016, BC and City staff observed a large amount of debris and lawn clippings in the channel as well as portions of the curb and larger rocks, which further limit capacity and indicate the need for ongoing maintenance. The stormwater conveyance system downstream of the open channel system is very flat but appears to have adequate capacity as no flooding has been reported.

The hydraulic model for the Manhasset Drive system includes the culvert under Tualatin-Sherwood Road and the piped and open channel system running north to the outfall into Hedges Creek. Attachment C, Figure 6 shows the hydraulic modeling extents specific for the Manhasset Drive system.

### 4.1.3 Nyberg Creek System

The Nyberg Creek system includes stormwater project opportunity areas 5, 9, and 10. These areas were combined into a single hydraulic model to provide a more comprehensive assessment of the problem areas and downstream system impacts. All three of these stormwater project opportunity areas were identified due to frequent flooding issues and the need for further assessment.

Stormwater project opportunity area 5 is associated with the open channel system along the railroad tracks behind the former Oil Can Henry's (19417 SW Boones Ferry Road). The open channel is adjacent to a railroad ballast, and gravel and rock from the ballast is dislodged and transported to a 36-inch pipe that daylights prior to discharge under Boones Ferry Road via a parallel culvert. The gravel and rock occlude the outlet and pipe under Boones Ferry Road, causing backwater conditions and flooding at Oil Can Henry's. During a site visit on December 8, 2016, it was observed that the pipe under Boones Ferry Road was more than 50 percent filled with sediment. Attachment D includes photographs of the rocky open channel system and the transition to the piped system. Additionally, water quality along Boones Ferry Road is being managed with StormFilter catchbasins located at a sag in Boones Ferry Road. The StormFilter catchbasins do not appear to be functioning, possibly due to the high sediment and gravel loads, which result in standing water in the roadway.

Stormwater project opportunity areas 9 and 10 are associated with two open channel segments in Sandalwood (area 9) and in the Mohawk Apartments property (area 10), which experience significant erosion and flooding. The open channel at Sandalwood is experiencing severe incision, which prevents runoff from being effectively discharged to the downstream ditch inlet and pipe system. Water ponds in this area and is not adequately conveyed. The open channel at the Mohawk Apartments is also ineffective at discharging to the downstream ditch inlet, and thus, flow overtops the banks causing overland runoff through private property. Downstream from the Mohawk Apartments site, the piped conveyance system in Tonka Street and Warm Springs Street does not appear to be laid out in an efficient manner, which further contributes to the observed capacity deficiencies.

The hydraulic model includes the open channel associated with stormwater project opportunity area 5, the piped the drainage system on Boones Ferry Road, the culverts discharging east under Boones Ferry Road, and the open channel system flowing east from Boones Ferry Road to Martinazzi Avenue. The model terminates at the Martinazzi Avenue culvert where a free outfall has been included as the model's boundary



condition. The open channel system between Boones Ferry Road and Martinazzi Avenue is the upstream portion of Nyberg Creek. The open channel and piped systems associated with stormwater project opportunity areas 9 and 10 discharge north to Nyberg Creek and are also included. Attachment C, Figure 7 provides an overview of the Nyberg Creek system that was modeled.

## 4.2 Conveyance Naming Convention

Storm structures, including manholes, catch basins, ditch inlets, outfalls, tees, flow structures, and clean outs, are identified in the City’s GIS database by their asset ID, a six-digit number ranging from 123539 to 335465. The storm conduits also use a similar naming convention. The six-digit asset IDs for conduits range from 164640 to 335463.

The names of nodes (storm structures, typically manholes) and links (pipes or open channel conduits) assigned in the hydraulic models are consistent with the City’s naming convention. Based on field survey results, and to accommodate flow routing and other modeling needs, links or nodes were added that did not previously exist in the City’s GIS database. For these added features, the default XPWMM naming convention was used (e.g., Link43, Node68).

## 4.3 Datum

To verify the vertical datum reflected in the City’s GIS data, BC conducted a comparison of rim elevations from the GIS with rim elevations interpreted from LIDAR, which uses the North American Vertical Datum of 1988 (NAVD88). The average rim elevation interpreted from LIDAR was consistently 3.5 feet higher than the City-provided rim elevations. This is consistent with the datum correction of +3.52 feet between National Geodetic Vertical Datum of 1929 (NGVD29) and NAVD88. Based on this observation, it was assumed that most of the City’s GIS data provided in their original June 2016 data package used the NGVD29 vertical datum.

In July 2016, the City corrected their system elevation data to match the NAVD88 vertical datum and provided updated stormwater system information in GIS to BC. The hydraulic modeling assumes consistent use of the NAVD88 vertical datum.

## 4.4 Survey Needs

After determining the extent of areas to be modeled for each stormwater project opportunity area (see Section 4.1), missing invert elevations and pipe diameters within these general extents were identified from GIS. A total of 77 structures required field survey.

CESNW performed the survey work in April, 2017 and obtained the missing data necessary for modeling. Survey results were delivered in the form of a computer-aided design (CAD) file and an Excel spreadsheet. After converting the data from CAD to GIS, BC staff incorporated the updated elevations into the GIS database. The updated GIS data were exported to XPSWMM for use in the hydraulic model.

## 4.5 Hydraulic Input Parameters

Hydraulic input parameters include conduit (pipe or open channel) name, upstream (US) and downstream (DS) node information (name, invert elevation, rim elevation), conduit length, conduit slope, conduit shape, and pipe diameter. The following sections describe the model input parameters that were required for development of the hydraulic models.

Attachment B, Table B-1 Hydraulic Model Results, includes all conduit and node data applicable to each system model.

### 4.5.1 Node Data

Model nodes include manholes, catch basins, outfalls, and other junction points as defined in the City’s GIS or developed based on changes in conduit direction, slope, or cross section configuration (for open channels).

The upstream and downstream node names for each conduit were assigned based on the naming convention provided by the City’s GIS. Nodes in the hydraulic model that also include model hydrologic input information were renamed with the nomenclature NodeName\_SubbasinName (e.g. 261567\_NY-0530).

The rim elevation at each node location was assigned based on the City’s GIS. Several rim elevations were missing in the City’s GIS database and values were estimated based on LiDAR data. Field survey included the collection of rim elevations for structures where rim elevations were inconclusive from LiDAR.

Upstream and downstream invert elevations were extracted from node and conduit data in GIS. If invert information was missing or conflicting between the node and conduit attribute data, the invert data were collected via field survey as described in Section 4.4.

### 4.5.2 Conduit Data

Modeled conduits include pipes, culverts, and open channels. The length of each modeled conduit was originally provided in the City’s GIS. Because conduits were extended or combined with other segments as necessary to ensure continuity in the system, revised conduit lengths were directly calculated using GIS.

Conduit slopes were calculated in XPSWMM using the upstream and downstream node invert elevations and refined segment lengths.

Pipe diameters were obtained from the City’s GIS or collected during field survey. For pipes where pipe diameters were not provided in GIS or could not be field-verified during the survey work, the diameter was assumed to be the same size as the pipe segment immediately upstream. This assumption provides a conservative estimate of hydraulic system capacity. Pipes were assumed to be circular in shape.

Most open channel cross-sections were obtained by field survey. Open channels segments not surveyed or used for flow routing purposes were assumed to be trapezoidal in shape with dimensions approximated based on measurements obtained during field visits or via aerial imagery.

Manning’s roughness coefficient “n” is dependent on the surface material of pipes and open channels. All modeled pipes were concrete and assigned a roughness coefficient of 0.014. A roughness coefficient range of 0.027 to 0.045 was assigned to open-channel conduits based on field observations from aerial imagery. Open channels lined with shorter vegetation and dirt had lower roughness while open channels lined with large rocks and thick vegetation had values of Manning’s “n” up to 0.045.

### 4.5.3 System Routing

Only select portions of the City’s conveyance system were hydraulically modeled to evaluate system flooding. To account for upstream subbasins that do not directly enter the modeled conveyance system but still contribute runoff to the modeled system, a simplified system routing was used. A simple pipe network was incorporated into the hydraulic model to mimic the upstream conveyance system and route flow downstream to the modeled system.

This approach was used for the Nyberg Creek model area (see Attachment C, Figure 4). The simple pipe network geometry is based on available GIS information and invert elevations as available and assumes a constant pipe slope based on surface elevations. The hydraulic model results for the simple pipe networks and simplified routing are included in Attachment B, Table B-1 for reference only. These results should not be considered in the assessment of system flooding or CP development.

## Section 5: Model Refinement and Results

XP-SWMM was used to simulate the 2-year, 10-year, and 25-year, 24-hour design events for current and future development conditions. Results of the hydrologic and hydraulic model simulations are tabulated in Attachment A, Table A-1 (for hydrology) and Attachment B, Table B-1 (for hydraulics).

### 5.1 Model Refinement

The hydrologic and hydraulic models were developed and initial model results were compared to City-reported flooding locations, field observations, and City photographs taken during the December 2015 storm events (for the Manhasset Drive system). Model validation information was anecdotal and general in nature, and did not include specific flows or water surface elevations at structures within each of the hydraulic model areas. Therefore, model refinements instead of a model validation were performed by comparing initial model results with reported flooding areas and adjusting hydraulic input parameters based on field observations to match reported flooding.

The Herman Road system was refined following site visits by BC staff and additional feedback from City staff. The geometry of culverts under the rail road and select ditches and culverts on the north side of the road were refined. In addition, the contributing drainage area for subbasin HE-0090 was decreased from 19.04 acres to 5.00 acres based on discussion of drainage patterns with City staff (Attachment C, Figure 5). Subbasin HE-0900 is primarily composed of the Tualatin Country Club golf course and does not contribute to the Herman Road system. Please note the subbasin delineation was not adjusted, only the area contributing to the Herman Road system from subbasin HE-0900.

For the Manhasset Drive system, to better match reported flooding and photo documentation, several adjustments were made to the hydraulic model. The Manning's roughness coefficient of the open channels was refined to more closely align with the observed conditions. Values vary from 0.03 to 0.08 based on field observations. A short link was added (Link13) with a roughness value of 0.08 to represent a highly-obstructed portion of the open channel system where debris and lawn clippings were observed during the site visit. The addition of Link13 also extended the steeper upstream segment to reflect existing topography, as surveyed cross sections are often extrapolated and do not always align with specific grade break locations. Finally, the contributing drainage area for subbasin HE-0500 (Attachment C, Figure 6) was decreased from 4.93 acres to 1.54 acres based on as-built drawings provided by the City. Please note the subbasin delineation was not adjusted, only the area contributing to the Manhasset Drive system from subbasin HE-0500.

For the Nyberg Creek system, to better match reported flooding in the proximity of Oil Can Henry's (area 5) and Mohawk Apartments (area 10), the entrance and exit loss coefficients at ditch inlets in both locations were set to 1.0 to reflect reduced hydraulic efficiency in the transition from open channel to piped system. Link84 was added to the downstream end of the open channel by Oil Can Henry's to represent the steep concrete chute before the system daylights west of Boones Ferry Road. The Manning's roughness coefficients of the open channels were refined based on observed condition to represent the gravel and rock subgrade, with values ranging from 0.04 and 0.05. Sediment, as a hydraulic model parameter, was added to the downstream piped system to mimic observed conditions where rock and gravel have filled the pipe and outlet.

### 5.2 Hydrologic Model Results

The hydrologic model results show minimal to no increases in future flows for subbasins that are fully developed, such as in the Nyberg Creek and Tualatin River watersheds. The largest increases in flow were in subbasins with large amounts of vacant land, such as in the Hedges Creek watershed.

Results of the hydrologic simulations for all events and subbasins are tabulated in Attachment A (Table A-1). Results are displayed as maximum flows within each subbasin for each design storm. Attachment A, Table A-1 also provides the change in peak flow and percent increase between the existing and future conditions flows for each subbasin.

## 5.3 Hydraulic Model Results

The hydraulic model results show minimal to no increases in future flows for the modeled areas that are fully developed. As expected, the largest projected flow increases were seen in areas with existing vacant land. The model results confirm the flooding problem areas/ capacity limited areas as reported by City staff, and they provided additional information about potential sources of the problems.

Hydraulic modeling results are tabulated in Attachment B, Table B-1. Results are displayed as the maximum water surface elevation and maximum peak flows for existing and future conditions for each modeled conduit.

### 5.3.1 Initial Identification of Flooding Problems

Based on the hydraulic model results summarized in Attachment B, Table B-2, flooding in the piped system was identified when the theoretical maximum capacity of the conduit was exceeded and surcharging occurred. In the open channel system, flooding was identified when the maximum water surface elevation at any modeled node was equal to or greater than the ground elevation of the node, which implies that flow is overtopping the bank.

In areas where flooding occurs and stormwater would exit a pipe or overtop an open channel, the model was configured to ensure no system losses, and that all water exiting the system would be routed back into the system immediately downstream of the flooded location. This modeling approach more accurately simulates real-world channel and pipe conditions and eliminates water loss from the system. Links used to model this process are highlighted in gray in Attachment B, Table B-1, as they are not actual system conduits and instead were used to inform the identification of flooded areas.

The design storm and scenario where the model indicates flooding is identified in Attachment B, Table B-1.

### 5.3.2 Summary of Flooding Problems

Table 6 summarizes the general modeled flooding locations, the potential source of the capacity deficiencies, and preliminary CIP recommendations. A summary of the hydraulic model results by system is described below.

#### 5.3.2.1 Herman Road System

The hydraulic model shows extensive flooding in the open channel/culvert system along Herman Road between SW Teton Avenue and SW Tualatin Road. Attachment C, Figures 8 and 9 show the extent of system flooding by modeled conduit. The stormwater conveyance system is very flat and the open channel system and culverts appear to be undersized.

The open channel system north of Herman Road is further restricted by the two culverts across Herman Road. These culverts have a non-traditional layout, likely due to the ground clearance required beneath the railroad, and have a negative or backslope. To reduce flooding along the north side of Herman Road, the open channel system from conduit 322603 and 268054 could be piped. The culverts across Herman Road could be replaced to more freely discharge. Piping the open channel segments also provides flexibility for future road improvements and roadway widening.

To the east, the parallel culverts south of the intersection of Tualatin Road and Herman Road (conduit 322619 and 322618) begin surcharging at the 2-year event. While the model does not indicate flooding, these pipes do not meet City design standards.

**5.3.2.2 Manhasset Drive System**

The hydraulic model shows extensive flooding during the 2-year design storm in the stormwater system along Manhasset Drive, especially along the open channel portion. Attachment C, Figure 10 shows the extent of modeled flooding by conduit.

Channel velocity is high in the upstream portion of the open channel system where the slope is steeper and the channel is grassy (lower Manning’s n). As the channel flattens and becomes rockier in the downstream portion of the system, the channel velocity decreases and water begins to pond. The open channel cross sections are also unsymmetrical and limited in capacity. Proper maintenance of the open channel, including removal of debris and regular mowing of vegetation in the channel, may alleviate some flooding; however, the channel is still undersized for the contributing flow. Due to limited easement within the surrounding areas, replacement of the open channel system with an adequately-sized piped system may reduce flooding.

Pipes further downstream (north of Manhasset Drive) experience surcharging and therefore do not meet City design standards; however, the maximum water elevations are not above rim elevations.

**5.3.2.3 Nyberg Creek System**

The hydraulic model shows widespread system flooding during the 2-year design storm. Attachment C, Figure 11 and 12 show the extent of modeled flooding by modeled conduit.

One prevalent location of flooding is the open channel behind Oil Can Henry’s (19417 SW Boones Ferry Road). The open channel is overtopping and the downstream pipes (Link 36, Link 80) are surcharging, resulting in flooding of nearby businesses. In the hydraulic model, flooding is being routed to the system on Boones Ferry Road via links Overflow1 and Overflow2, consistent with the flow patterns reported by city staff. The ditch inlet at the end of the open channel also restricts flow. Based on field observations, sediment discharges to the inlet and is deposited in the downstream pipes, further restricting flow. Sediment is also deposited into the parallel culvert across Boones Ferry Road, which limits capacity beginning at the 10-year storm (see Attachment B, Table B-1). Modification of this inlet structure to increase hydraulic efficiency and conducting regular maintenance to remove accumulated sediment are needed to reduce flooding.

Additional system surcharging and minor flooding is also occurring in the pipes north of Seminole Trail between Tillamook Court and Martinazzi Avenue starting at the 10-year event. These pipes appear to be undersized for the 25-year design event and do not meet the City’s design standard. This system is upstream of the reported flooding at Sandalwood (area 9). Although modeling did not indicate flooding of the open channel system, upsizing of the upstream pipes would impact the open channel so a comprehensive review of project needs in this area will be needed.

Additionally, the pipes near the intersection of SW Boones Ferry Road and SW Warm Springs Street and the intersection of SW Warm Springs Street and SW Tonka Street are surcharging beginning at the 10-year event. System rerouting, particularly the catch basins at the corner of SW Tonka St and SW Warm Springs Street directly north to Nyberg Creek and the catchbasins along SW Boones Ferry Road, may help alleviate the capacity issues.



**Table 6. Initial Flood Control Capital Improvement Projects**

Modeled System	General Location	Conduit	Flooding Scenario	Source of Capacity Deficiency	CIP Recommended?
Herman Road System	Open channel/culvert system on north side of Herman Road	Link32.1	Existing 10-yr	Existing culverts are undersized and have minimal slope. Multiple transitions from open channel to a piped system lead to high energy losses.	Y
		Link34.1	Existing 10-yr		
		322603	Existing 2-yr		
		322638.1	Existing 2-yr		
		333704.1	Existing 2-yr		
		333705.1	Existing 2-yr		
		333706.1	Existing 2-yr		
		333707.1	Existing 2-yr		
		334080.1	Existing 2-yr		
		Link33.1	Future 2-yr		
	Culvert across Herman Road	322643	Existing 2-yr	Existing pipe has minimal slope and nearby pipes show unusual change in inverts. Follow up survey recommended.	Y
	Dual culvert south of intersection of Tualatin Road and Herman Road	322618	Existing 2-yr	Pipe has minimal slope. Culvert is surcharging but not flooding.	Y
	Stormwater system at intersection of Tualatin Road and Herman Road	268371	Future 25-yr	Pipe is surcharging but not flooding. Refined hydrology during CP development may adjust project need.	Possibly
Manhasset Drive System	Open channel along Manhasset Drive	Link9	Existing 2-yr	Open channel is undersized and not properly maintained.	Y
		Link10.1	Existing 2-yr		
		Link11.1	Existing 2-yr		
		Link12.1	Existing 2-yr		
		Link13.1	Existing 2-yr		
		Link14.1	Existing 2-yr		
	Piped system downstream of open channel on Manhasset Drive	266695	Existing 2-yr	Existing pipes are surcharging but not flooding due to minimal slope.	Y
		266697	Existing 2-yr		
268265		Existing 2-yr			



**Table 6. Initial Flood Control Capital Improvement Projects**

Modeled System	General Location	Conduit	Flooding Scenario	Source of Capacity Deficiency	CIP Recommended?
Nyberg Creek System	Open channel and pipe system behind Oil Can Henry's including junction of outfalls directly west of Boones Ferry Road	Link36	Existing 2-yr	Rock/gravel accumulation is limiting capacity. Project needs may include source control and maintenance.	Y
		Link43.1	Existing 2-yr		
		Link80	Existing 2-yr		
		277225	Future 2-yr		
	Piped system on Boones Ferry Road near Warm Springs Street	268293	Existing 10-yr	Existing open channels and pipes are undersized for the contributing drainage area. This system receives overland flow from the open channel behind Oil Can Henrys. System rerouting may help alleviate flooding.	Y
		322832	Existing 10-yr		
		268296.1	Existing 25-yr		
		267215	Future 10-yr		
		268297.1	Future 25-yr		
	Piped system at intersection of Warm Springs Street and Tonka Street	264286	Existing 10-yr	Existing pipes have minimal slope and are undersized. System rerouting may alleviate flooding.	Y
		265109	Existing 2-yr		
	Piped system between Seminole Trail and Sagert Street	267910	Existing 10-yr	Existing pipes are undersized for contributing drainage area. Pipes are surcharged but not flooding. System is upstream of reported Sandalwood project opportunity area.	Y
		267951	Existing 10-yr		
		264521	Future 10-yr		
Sandalwood open channel	Link31	-	No flooding in model; however, flooding was reported during the December 2015 storm event. Channel is incised.	Y	
Open channel behind Mohawk Apartments	Link32	-	Open channel is not flooding in the model; however, flow is being restricted at the downstream ditch inlet, which has large hydraulic losses.	Y	
	Link 33	-			



## Section 6: References

City of Tualatin. 2013. Public Works Standards, Section 206.

Clean Water Services. 2007. *Stormwater and Grading Design Standards*. March 2017.

Soil Conservation Service (SCS). 1986. *Urban Hydrology for Small Watersheds*, Technical Release 55. June.





## **Attachment A: Hydrology Model Results**

---





**Table A-1: Hydrology Model Results**

Basin ID	Area (acres)	Time of Concentration (minutes)	Existing Impervious Percentage	Future Impervious Percentage	Pervious CN	Existing Land Use			Future Land Use			Existing Land Use			Future Land Use		
						Maximum Flow (cfs)			Maximum Flow (cfs)			Increase in Maximum Flow (cfs)			Percent Increase in Maximum Flow (%)		
						2-yr	10-yr	25-yr	2-yr	10-yr	25-yr	2-yr	10-yr	25-yr	2-yr	10-yr	25-yr
<b>Basalt Creek</b>																	
BA-0010	226.9	63.6	10	12	73	10.68	26.88	36.14	11.22	27.80	37.26	0.54	0.92	1.12	5.1	3.4	3.1
BA-0020	127.4	62.7	15	15	76	9.23	20.44	26.64	9.23	20.44	26.64	0.00	0.00	0.00	0.0	0.0	0.0
BA-0030	32.1	8.5	41	51	79	9.15	16.03	19.42	10.44	17.54	21.00	1.29	1.51	1.57	14.1	9.4	8.1
BA-0040	20.3	8.9	34	47	78	4.90	9.05	11.13	5.99	10.37	12.52	1.09	1.32	1.40	22.1	14.6	12.5
BA-0050	22.0	7.5	37	49	72	4.26	8.49	10.65	5.48	10.04	12.32	1.22	1.56	1.67	28.7	18.4	15.7
BA-0060	21.2	7.6	34	44	78	5.33	9.73	11.94	6.12	10.70	12.95	0.79	0.96	1.02	14.8	9.9	8.5
BA-0070	39.9	46.8	43	52	75	5.58	10.56	13.10	6.76	12.06	14.71	1.18	1.50	1.61	21.1	14.2	12.3
<b>Cummins Creek</b>																	
CU-0010	175.4	46.8	5	5	79	14.78	33.24	43.12	14.78	33.24	43.12	0.00	0.00	0.00	0.0	0.0	0.0
CU-0020	123.3	35.0	22	25	78	15.69	31.98	40.41	16.46	33.00	41.52	0.77	1.02	1.11	4.9	3.2	2.8
CU-0030	57.4	15.8	16	21	81	11.10	21.44	26.70	11.87	22.43	27.76	0.76	0.98	1.06	6.9	4.6	4.0
CU-0040	73.5	23.8	58	63	80	21.55	35.23	41.81	22.93	36.74	43.34	1.38	1.51	1.54	6.4	4.3	3.7
CU-0050	16.2	8.4	61	70	79	6.00	9.68	11.45	6.72	10.45	12.22	0.72	0.77	0.77	12.0	7.9	6.7
CU-0060	57.1	13.8	65	72	80	20.97	33.29	39.17	22.72	35.12	40.99	1.74	1.83	1.83	8.3	5.5	4.7
CU-0070	34.8	10.8	47	59	80	10.85	18.35	22.00	12.58	20.30	24.01	1.73	1.95	2.00	16.0	10.6	9.1
CU-0080	28.5	9.3	73	73	79	12.20	18.70	21.78	12.20	18.70	21.78	0.00	0.00	0.00	0.0	0.0	0.0
CU-0090	21.4	8.1	68	74	79	8.68	13.59	15.92	9.33	14.25	16.58	0.65	0.66	0.66	7.4	4.9	4.2
CU-0100	33.9	12.0	64	66	75	11.32	18.66	22.20	11.76	19.15	22.70	0.44	0.49	0.50	3.9	2.6	2.3
CU-0110	10.5	8.2	68	74	77	4.12	6.53	7.67	4.46	6.88	8.02	0.34	0.35	0.35	8.2	5.4	4.6
CU-0120	10.3	7.2	28	74	79	2.49	4.61	5.68	4.52	6.94	8.09	2.03	2.33	2.41	81.4	50.4	42.5



**Table A-1: Hydrology Model Results**

Basin ID	Area (acres)	Time of Concentration (minutes)	Existing Impervious Percentage	Future Impervious Percentage	Pervious CN	Existing Land Use			Future Land Use			Existing Land Use			Future Land Use		
						Maximum Flow (cfs)			Maximum Flow (cfs)			Increase in Maximum Flow (cfs)			Percent Increase in Maximum Flow (%)		
						2-yr	10-yr	25-yr	2-yr	10-yr	25-yr	2-yr	10-yr	25-yr	2-yr	10-yr	25-yr
Hedges Creek																	
HE-0010	4.2	6.2	75	75	82	1.96	2.97	3.44	1.97	2.97	3.45	0.01	0.01	0.01	0.4	0.2	0.2
HE-0020	6.8	6.6	8	14	80	1.31	2.62	3.29	1.44	2.78	3.47	0.13	0.16	0.18	9.5	6.2	5.3
HE-0030	10.1	7.6	65	74	82	4.27	6.61	7.73	4.61	6.98	8.09	0.34	0.37	0.36	8.0	5.5	4.7
HE-0040	3.7	6.7	65	70	80	1.51	2.39	2.80	1.60	2.48	2.90	0.09	0.10	0.10	5.8	4.1	3.4
HE-0050	8.7	7.4	25	29	78	1.85	3.57	4.44	1.99	3.75	4.63	0.14	0.18	0.19	7.6	5.0	4.3
HE-0060	35.5	30.6	41	50	80	7.27	12.93	15.73	8.27	14.12	16.98	1.00	1.19	1.25	13.7	9.2	7.9
HE-0070	6.5	7.6	41	49	81	2.08	3.52	4.23	2.28	3.75	4.46	0.20	0.23	0.23	9.5	6.4	5.5
HE-0080	12.5	7.9	43	47	81	4.03	6.81	8.16	4.24	7.04	8.40	0.20	0.23	0.24	5.0	3.4	2.9
HE-0090	19.0	39.4	43	53	80	3.66	6.43	7.79	4.21	7.07	8.46	0.54	0.64	0.67	14.8	10.0	8.6
HE-0100	7.4	7.2	43	53	79	2.21	3.82	4.61	2.52	4.18	4.99	0.32	0.37	0.38	14.3	9.6	8.2
HE-0110	11.3	7.4	48	57	79	3.58	6.07	7.28	4.02	6.57	7.80	0.44	0.50	0.52	12.4	8.3	7.1
HE-0120	5.4	7.0	47	57	80	1.79	2.99	3.58	2.02	3.26	3.86	0.23	0.26	0.28	13.1	8.8	7.7
HE-0130	9.6	8.1	74	74	83	4.46	6.69	7.74	4.46	6.69	7.74	0.00	0.00	0.00	0.0	0.0	0.0
HE-0140	10.5	7.6	27	74	79	2.52	4.66	5.74	4.59	7.02	8.18	2.08	2.36	2.45	82.4	50.7	42.6
HE-0150	3.3	7.1	74	74	84	1.58	2.36	2.73	1.58	2.36	2.73	0.00	0.00	0.00	0.0	0.0	0.0
HE-0160	22.0	10.1	68	73	79	8.80	13.77	16.13	9.27	14.25	16.61	0.47	0.48	0.48	5.3	3.5	3.0
HE-0170	23.9	10.4	61	62	81	9.13	14.49	17.05	9.20	14.57	17.13	0.07	0.08	0.08	0.8	0.5	0.5
HE-0180	22.2	12.2	31	37	78	4.85	9.14	11.31	5.35	9.76	11.97	0.50	0.62	0.66	10.2	6.8	5.8
HE-0190	10.6	8.2	37	37	79	2.81	5.04	6.15	2.81	5.04	6.15	0.00	0.00	0.00	0.0	0.0	0.0
HE-0200	19.6	8.8	76	76	81	8.88	13.36	15.47	8.88	13.36	15.48	0.00	0.00	0.00	0.0	0.0	0.0
HE-0210	9.3	7.1	74	74	80	4.12	6.31	7.34	4.12	6.31	7.34	0.00	0.00	0.00	0.0	0.0	0.0
HE-0220	19.1	8.8	39	46	81	5.67	9.81	11.83	6.23	10.45	12.50	0.55	0.65	0.67	9.8	6.6	5.7
HE-0230	8.4	7.4	55	64	81	3.11	5.03	5.95	3.40	5.34	6.28	0.30	0.32	0.33	9.5	6.3	5.6
HE-0240	22.8	9.2	73	74	80	9.85	15.06	17.52	9.98	15.19	17.65	0.13	0.13	0.13	1.3	0.9	0.7
HE-0250	15.4	7.8	71	71	81	6.69	10.25	11.95	6.69	10.25	11.95	0.00	0.00	0.00	0.0	0.0	0.0



**Table A-1: Hydrology Model Results**

Basin ID	Area (acres)	Time of Concentration (minutes)	Existing Impervious Percentage	Future Impervious Percentage	Pervious CN	Existing Land Use			Future Land Use			Existing Land Use			Future Land Use		
						Maximum Flow (cfs)			Maximum Flow (cfs)			Increase in Maximum Flow (cfs)			Percent Increase in Maximum Flow (%)		
						2-yr	10-yr	25-yr	2-yr	10-yr	25-yr	2-yr	10-yr	25-yr	2-yr	10-yr	25-yr
HE-0260	15.4	7.3	49	49	82	5.42	8.90	10.58	5.44	8.92	10.60	0.02	0.02	0.02	0.4	0.2	0.2
HE-0270	24.9	8.9	69	74	82	10.66	16.36	19.06	11.11	16.82	19.51	0.46	0.46	0.45	4.3	2.8	2.4
HE-0280	15.8	7.9	74	74	82	7.13	10.79	12.53	7.13	10.79	12.53	0.00	0.00	0.00	0.0	0.0	0.0
HE-0290	16.9	8.5	74	74	81	7.54	11.43	13.26	7.54	11.43	13.26	0.00	0.00	0.00	0.0	0.0	0.0
HE-0300	17.2	7.7	43	53	79	5.17	8.92	10.75	5.89	9.75	11.62	0.72	0.83	0.86	14.0	9.3	8.0
HE-0310	14.8	7.1	43	53	80	4.63	7.89	9.49	5.24	8.58	10.20	0.60	0.69	0.71	13.0	8.7	7.5
HE-0320	25.8	10.7	45	54	81	8.35	13.97	16.70	9.27	15.00	17.75	0.92	1.03	1.05	11.0	7.3	6.3
HE-0330	22.0	8.2	41	51	80	6.58	11.36	13.70	7.44	12.36	14.73	0.86	0.99	1.03	13.1	8.7	7.5
HE-0340	16.4	7.9	48	57	79	5.26	8.88	10.65	5.85	9.55	11.33	0.59	0.67	0.69	11.2	7.5	6.4
HE-0350	21.2	9.0	71	74	80	9.03	13.89	16.18	9.27	14.12	16.42	0.24	0.24	0.24	2.6	1.7	1.5
HE-0360	39.0	12.8	35	46	78	9.05	16.69	20.51	10.70	18.71	22.65	1.65	2.02	2.14	18.3	12.1	10.4
HE-0370	52.1	18.9	59	60	79	16.32	26.69	31.68	16.48	26.87	31.86	0.16	0.17	0.18	1.0	0.7	0.6
HE-0380	20.1	9.8	74	74	81	8.85	13.42	15.58	8.85	13.42	15.58	0.00	0.00	0.00	0.0	0.0	0.0
HE-0390	40.4	13.0	74	74	80	16.74	25.62	29.81	16.74	25.62	29.81	0.00	0.00	0.00	0.0	0.0	0.0
HE-0400	42.1	13.3	48	58	79	12.31	21.06	25.34	14.03	23.03	27.37	1.72	1.97	2.03	14.0	9.3	8.0
HE-0410	30.4	14.0	51	52	82	9.97	16.40	19.50	10.17	16.62	19.72	0.19	0.22	0.22	2.0	1.3	1.1
HE-0420	29.0	10.1	52	56	79	9.44	15.78	18.86	9.89	16.29	19.38	0.45	0.51	0.53	4.8	3.2	2.8
HE-0430	10.4	8.2	24	24	80	2.42	4.53	5.58	2.42	4.53	5.58	0.00	0.00	0.00	0.0	0.0	0.0
HE-0440	11.5	7.4	56	72	80	4.15	6.77	8.03	4.97	7.65	8.94	0.82	0.89	0.91	19.7	13.1	11.3
HE-0450	44.0	12.0	58	73	80	15.45	25.07	29.69	18.37	28.16	32.79	2.92	3.09	3.10	18.9	12.3	10.4
HE-0460	19.3	8.3	60	60	80	7.33	11.73	13.83	7.33	11.73	13.83	0.00	0.00	0.00	0.0	0.0	0.0
HE-0470	6.4	7.6	70	70	81	2.78	4.28	4.99	2.78	4.28	4.99	0.00	0.00	0.00	0.0	0.0	0.0
HE-0480	2.6	6.9	74	74	80	1.14	1.75	2.03	1.14	1.75	2.03	0.00	0.00	0.00	0.0	0.0	0.0
HE-0490	4.8	6.9	68	74	79	1.98	3.10	3.63	2.10	3.23	3.77	0.13	0.14	0.14	6.5	4.5	3.8
HE-0500	4.9	6.6	74	74	79	2.17	3.34	3.89	2.17	3.34	3.89	0.00	0.00	0.00	0.0	0.0	0.0
HE-0510	22.7	9.2	58	74	79	8.13	13.22	15.66	9.80	14.98	17.43	1.67	1.77	1.77	20.5	13.4	11.3



**Table A-1: Hydrology Model Results**

Basin ID	Area (acres)	Time of Concentration (minutes)	Existing Impervious Percentage	Future Impervious Percentage	Pervious CN	Existing Land Use			Future Land Use			Existing Land Use			Future Land Use		
						Maximum Flow (cfs)			Maximum Flow (cfs)			Increase in Maximum Flow (cfs)			Percent Increase in Maximum Flow (%)		
						2-yr	10-yr	25-yr	2-yr	10-yr	25-yr	2-yr	10-yr	25-yr	2-yr	10-yr	25-yr
HE-0520	30.9	10.3	47	71	80	9.83	16.55	19.81	13.00	19.99	23.30	3.18	3.45	3.49	32.3	20.8	17.6
HE-0530	23.9	73.1	31	31	78	2.52	4.87	6.10	2.52	4.87	6.10	0.00	0.00	0.00	0.0	0.0	0.0
HE-0540	70.6	17.9	45	62	76	16.30	29.44	36.00	21.50	35.61	42.44	5.20	6.17	6.44	31.9	21.0	17.9
HE-0550	64.8	16.9	56	73	79	20.22	33.38	39.74	24.87	38.38	44.78	4.65	5.00	5.05	23.0	15.0	12.7
HE-0560	39.7	96.0	15	61	77	2.52	5.40	6.96	5.80	9.80	11.77	3.29	4.40	4.81	130.7	81.3	69.2
HE-0570	12.9	10.1	58	58	69	3.37	6.04	7.37	3.37	6.04	7.37	0.00	0.00	0.00	0.0	0.0	0.0
HE-0580	46.2	42.3	30	74	79	6.56	12.54	15.59	12.61	19.66	23.00	6.05	7.12	7.41	92.1	56.7	47.5
HE-0590	19.9	8.3	56	74	78	6.84	11.31	13.47	8.54	13.13	15.30	1.70	1.82	1.83	24.8	16.1	13.6
HE-0600	12.6	7.1	65	74	79	4.97	7.88	9.28	5.53	8.50	9.90	0.56	0.62	0.62	11.3	7.9	6.7
HE-0610	42.7	11.9	50	56	75	11.32	20.07	24.41	12.40	21.37	25.77	1.09	1.30	1.36	9.6	6.5	5.6
HE-0620	37.6	62.1	12	27	80	3.65	7.48	9.47	4.67	8.83	10.96	1.02	1.36	1.49	27.8	18.1	15.8
HE-0630	30.1	14.0	71	71	73	10.48	16.90	19.99	10.48	16.91	19.99	0.00	0.00	0.00	0.0	0.0	0.0
HE-0640	25.0	10.6	74	74	72	9.51	15.11	17.79	9.51	15.11	17.79	0.00	0.00	0.00	0.0	0.0	0.0
HE-0650	24.0	9.4	22	72	81	5.70	10.55	12.99	10.39	15.87	18.45	4.70	5.32	5.47	82.5	50.4	42.1
HE-0660	14.5	45.0	26	46	79	1.84	3.62	4.53	2.59	4.57	5.56	0.74	0.96	1.03	40.3	26.4	22.7
HE-0670	11.0	7.7	73	74	76	4.50	7.03	8.24	4.53	7.06	8.27	0.03	0.03	0.03	0.7	0.5	0.4
HE-0680	32.5	11.8	53	68	77	9.90	16.82	20.20	12.20	19.39	22.82	2.30	2.57	2.62	23.2	15.3	13.0
HE-0690	18.9	8.7	34	46	76	4.21	7.98	9.88	5.20	9.20	11.18	0.99	1.23	1.30	23.5	15.4	13.2
HE-0700	34.6	12.1	10	30	80	6.26	12.58	15.82	8.55	15.49	18.95	2.29	2.91	3.13	36.5	23.2	19.8
HE-0710	23.0	31.1	29	66	79	3.74	7.12	8.85	6.53	10.45	12.32	2.78	3.33	3.48	74.4	46.7	39.3
HE-0720	63.4	16.7	61	72	78	20.64	33.65	39.90	23.76	36.99	43.27	3.12	3.35	3.37	15.1	10.0	8.5
HE-0730	18.4	7.8	61	63	79	6.88	11.07	13.08	7.07	11.27	13.28	0.19	0.20	0.21	2.7	1.9	1.6
HE-0740	141.9	29.4	11	39	76	12.91	30.39	39.79	23.88	45.54	56.52	10.97	15.15	16.74	85.0	49.9	42.1
HE-0750	145.8	22.6	59	73	78	41.19	68.44	81.64	49.77	77.82	91.14	8.59	9.38	9.51	20.9	13.7	11.6
HE-0760	21.9	8.6	73	73	78	9.18	14.21	16.59	9.20	14.22	16.61	0.02	0.02	0.02	0.2	0.1	0.1
HE-0770	64.6	13.4	59	73	78	20.99	34.72	41.36	25.45	39.56	46.25	4.47	4.84	4.89	21.3	13.9	11.8



**Table A-1: Hydrology Model Results**

Basin ID	Area (acres)	Time of Concentration (minutes)	Existing Impervious Percentage	Future Impervious Percentage	Pervious CN	Existing Land Use			Future Land Use			Existing Land Use			Future Land Use		
						Maximum Flow (cfs)			Maximum Flow (cfs)			Increase in Maximum Flow (cfs)			Percent Increase in Maximum Flow (%)		
						2-yr	10-yr	25-yr	2-yr	10-yr	25-yr	2-yr	10-yr	25-yr	2-yr	10-yr	25-yr
HE-0780	35.0	10.9	66	66	79	13.31	21.13	24.87	13.31	21.13	24.87	0.00	0.00	0.00	0.0	0.0	0.0
HE-0790	40.8	11.6	66	68	79	15.46	24.51	28.82	15.81	24.87	29.18	0.34	0.36	0.37	2.2	1.5	1.3
HE-0800	38.4	10.4	58	63	79	13.38	21.87	25.96	14.36	22.94	27.05	0.98	1.07	1.09	7.3	4.9	4.2
HE-0810	10.1	6.8	44	49	79	3.03	5.24	6.33	3.26	5.51	6.60	0.23	0.27	0.27	7.4	5.1	4.3
HE-0820	26.0	9.0	41	50	80	7.59	13.18	15.93	8.58	14.34	17.13	0.99	1.16	1.20	13.1	8.8	7.5
HE-0830	72.0	13.2	22	42	77	12.70	25.63	32.28	17.98	32.35	39.49	5.28	6.72	7.21	41.6	26.2	22.3
HE-0840	15.3	8.3	43	53	79	4.51	7.82	9.45	5.16	8.58	10.23	0.65	0.76	0.78	14.4	9.7	8.3
HE-0850	17.8	8.6	43	53	79	5.22	9.06	10.95	5.98	9.94	11.86	0.76	0.88	0.91	14.5	9.7	8.3
HE-0860	14.3	6.5	38	47	79	3.94	7.00	8.51	4.45	7.61	9.15	0.52	0.62	0.64	13.1	8.8	7.6
HE-0870	51.4	11.1	32	50	72	8.24	17.36	22.10	12.34	22.67	27.83	4.10	5.31	5.73	49.8	30.6	25.9
HE-0880	16.7	7.0	38	47	79	4.68	8.26	10.03	5.27	8.96	10.76	0.59	0.70	0.73	12.6	8.5	7.3
HE-0890	4.4	5.9	41	50	79	1.31	2.26	2.73	1.48	2.46	2.95	0.17	0.20	0.22	13.1	9.0	8.0
HE-0900	36.4	9.3	24	29	77	6.70	13.52	17.02	7.50	14.55	18.14	0.79	1.03	1.12	11.8	7.6	6.6
HE-0910	16.1	7.0	36	44	77	4.01	7.35	9.02	4.57	8.03	9.74	0.56	0.68	0.72	13.8	9.2	7.9
HE-0920	25.1	8.5	43	53	64	3.38	7.67	9.94	4.77	9.54	11.99	1.39	1.87	2.05	41.2	24.4	20.7
HE-0930	7.7	7.0	39	48	72	1.55	3.05	3.82	1.89	3.48	4.28	0.34	0.43	0.46	21.8	14.1	12.1
HE-0940	9.1	6.7	41	50	77	2.43	4.35	5.31	2.80	4.80	5.78	0.38	0.45	0.47	15.5	10.4	8.9
HE-0950	9.6	8.1	40	50	75	2.25	4.20	5.18	2.67	4.71	5.72	0.42	0.51	0.54	18.5	12.2	10.5
HE-0960	16.1	7.6	42	52	71	3.25	6.38	7.98	4.06	7.41	9.09	0.81	1.03	1.10	25.0	16.1	13.8
HE-0970	2.8	6.0	39	48	65	0.38	0.86	1.11	0.51	1.04	1.31	0.13	0.18	0.20	35.4	21.0	17.9
HE-0980	17.7	29.8	31	37	78	2.87	5.50	6.84	3.21	5.95	7.33	0.35	0.46	0.49	12.1	8.3	7.1
HE-0990	18.2	7.8	42	51	64	2.42	5.52	7.16	3.35	6.78	8.54	0.93	1.26	1.38	38.6	22.8	19.3
HE-1000	15.5	7.8	43	53	75	3.91	7.13	8.74	4.64	8.01	9.67	0.73	0.88	0.93	18.6	12.4	10.6
HE-1010	16.1	7.6	43	53	80	4.90	8.43	10.16	5.57	9.20	10.96	0.67	0.77	0.80	13.6	9.1	7.8
HE-1020	23.3	7.8	42	51	78	6.57	11.57	14.04	7.55	12.72	15.24	0.98	1.15	1.20	14.9	9.9	8.5
HE-1030	25.8	7.8	43	53	75	6.48	11.82	14.49	7.73	13.34	16.09	1.26	1.52	1.60	19.4	12.9	11.0



**Table A-1: Hydrology Model Results**

Basin ID	Area (acres)	Time of Concentration (minutes)	Existing Impervious Percentage	Future Impervious Percentage	Pervious CN	Existing Land Use			Future Land Use			Existing Land Use			Future Land Use		
						Maximum Flow (cfs)			Maximum Flow (cfs)			Increase in Maximum Flow (cfs)			Percent Increase in Maximum Flow (%)		
						2-yr	10-yr	25-yr	2-yr	10-yr	25-yr	2-yr	10-yr	25-yr	2-yr	10-yr	25-yr
HE-1040	11.0	6.5	37	47	72	2.05	4.14	5.21	2.58	4.83	5.96	0.54	0.69	0.75	26.2	16.7	14.3
HE-1050	14.2	6.9	36	48	78	3.68	6.66	8.15	4.41	7.54	9.07	0.73	0.88	0.92	19.9	13.2	11.3
HE-1060	17.1	7.3	40	47	53	0.64	2.81	4.05	1.26	3.76	5.14	0.63	0.95	1.09	98.4	34.0	26.8
HE-1070	89.0	18.0	38	44	59	5.01	15.84	21.97	7.49	19.74	26.38	2.48	3.91	4.41	49.4	24.7	20.1
HE-1080	19.4	7.5	45	55	66	3.29	6.86	8.71	4.37	8.27	10.24	1.08	1.41	1.53	32.9	20.6	17.6
<b>Nyberg Creek</b>																	
NY-0010	7.1	6.9	5	5	76	0.87	2.06	2.69	0.88	2.06	2.69	0.00	0.00	0.00	0.2	0.1	0.1
NY-0020	1.1	6.2	6	6	77	0.15	0.34	0.44	0.15	0.34	0.44	0.00	0.00	0.00	0.0	0.0	0.2
NY-0030	30.3	40.2	13	46	80	3.63	7.38	9.33	6.06	10.49	12.66	2.43	3.11	3.33	67.0	42.1	35.7
NY-0040	18.8	8.7	37	58	75	4.21	7.97	9.87	6.06	10.22	12.24	1.85	2.25	2.37	44.0	28.2	24.0
NY-0050	49.1	10.4	30	32	79	11.66	21.53	26.48	11.91	21.85	26.82	0.25	0.32	0.34	2.2	1.5	1.3
NY-0060	2.8	6.2	78	78	79	1.29	1.95	2.26	1.29	1.95	2.26	0.00	0.00	0.00	0.1	0.0	0.0
NY-0070	7.4	6.7	50	58	79	2.45	4.10	4.91	2.72	4.42	5.24	0.27	0.31	0.33	11.2	7.6	6.8
NY-0080	47.1	10.3	24	29	79	10.14	19.35	24.00	11.03	20.48	25.22	0.89	1.13	1.21	8.8	5.8	5.0
NY-0090	39.9	9.2	52	61	79	13.22	22.05	26.33	14.74	23.74	28.06	1.51	1.69	1.73	11.5	7.7	6.6
NY-0100	10.4	6.4	45	52	73	2.49	4.61	5.68	2.87	5.09	6.19	0.39	0.48	0.51	15.6	10.4	8.9
NY-0110	18.5	7.8	70	71	76	7.38	11.63	13.65	7.46	11.71	13.73	0.08	0.09	0.09	1.1	0.7	0.6
NY-0120	23.3	7.4	44	54	80	7.23	12.36	14.86	8.20	13.46	16.00	0.97	1.10	1.14	13.3	8.9	7.7
NY-0130-ODOT	9.7	6.8	46	46	79	3.09	5.24	6.29	3.09	5.24	6.29	0.00	0.00	0.00	0.0	0.0	0.0
NY-0140	20.3	7.4	60	75	79	7.62	12.25	14.47	9.03	13.78	16.02	1.41	1.52	1.56	18.5	12.4	10.7
NY-0150	11.0	7.0	43	49	80	6.96	11.94	14.37	7.50	12.57	15.03	0.54	0.63	0.65	7.8	5.3	4.5
NY-0150-ODOT	11.7	7.0	46	46	80	3.74	6.34	7.60	3.74	6.34	7.60	0.00	0.00	0.00	0.0	0.0	0.0
NY-0160	24.1	9.9	66	66	82	11.51	17.86	20.87	11.51	17.86	20.87	0.00	0.00	0.00	0.0	0.0	0.0
NY-0160-ODOT	3.9	9.9	46	46	82	1.28	2.13	2.55	1.28	2.13	2.55	0.00	0.00	0.00	0.0	0.0	0.0
NY-0170-ODOT	30.4	11.4	46	46	80	9.27	15.77	18.93	9.27	15.77	18.93	0.00	0.00	0.00	0.0	0.0	0.0
NY-0180	26.5	9.1	44	54	79	7.84	13.55	16.35	8.97	14.86	17.70	1.13	1.31	1.35	14.4	9.6	8.3





**Table A-1: Hydrology Model Results**

Basin ID	Area (acres)	Time of Concentration (minutes)	Existing Impervious Percentage	Future Impervious Percentage	Pervious CN	Existing Land Use			Future Land Use			Existing Land Use			Future Land Use		
						Maximum Flow (cfs)			Maximum Flow (cfs)			Increase in Maximum Flow (cfs)			Percent Increase in Maximum Flow (%)		
						2-yr	10-yr	25-yr	2-yr	10-yr	25-yr	2-yr	10-yr	25-yr	2-yr	10-yr	25-yr
NY-0190	20.1	8.0	43	53	79	5.93	10.28	12.41	6.78	11.27	13.44	0.85	0.99	1.03	14.4	9.6	8.3
NY-0200	11.5	8.4	72	72	81	5.01	7.66	8.90	5.01	7.66	8.90	0.00	0.00	0.00	0.0	0.0	0.0
NY-0210	22.1	12.2	70	70	82	9.21	14.12	16.44	9.21	14.13	16.45	0.00	0.00	0.00	0.0	0.0	0.0
NY-0220	20.1	11.7	67	70	82	8.19	12.68	14.80	8.42	12.91	15.03	0.23	0.23	0.23	2.8	1.8	1.6
NY-0230	29.6	8.1	78	78	80	13.54	20.36	23.60	13.55	20.37	23.61	0.01	0.01	0.01	0.1	0.1	0.0
NY-0240	2.8	6.0	57	57	80	1.04	1.68	1.99	1.04	1.68	1.99	0.00	0.00	0.00	0.0	0.0	0.0
NY-0250	2.2	6.9	71	71	82	0.99	1.51	1.75	0.99	1.51	1.75	0.00	0.00	0.00	0.0	0.0	0.0
NY-0260	2.8	6.1	71	72	81	1.27	1.94	2.26	1.28	1.95	2.27	0.01	0.01	0.01	1.0	0.7	0.6
NY-0270	2.9	5.9	75	76	79	1.30	1.99	2.31	1.31	2.00	2.33	0.02	0.02	0.02	1.2	0.9	0.7
NY-0280	6.5	6.4	59	66	80	2.46	3.97	4.70	2.66	4.20	4.93	0.20	0.23	0.23	8.1	5.7	4.9
NY-0290	8.9	6.6	49	59	79	2.90	4.89	5.85	3.29	5.33	6.32	0.39	0.44	0.47	13.3	9.0	8.0
NY-0300	4.1	6.4	47	56	79	1.30	2.21	2.66	1.47	2.41	2.87	0.17	0.20	0.21	13.0	8.9	7.9
NY-0310	9.4	6.5	39	57	79	2.67	4.71	5.71	3.41	5.56	6.62	0.74	0.86	0.91	27.5	18.2	15.9
NY-0320	2.5	6.1	45	55	79	0.76	1.31	1.57	0.87	1.43	1.71	0.11	0.13	0.13	13.9	9.6	8.4
NY-0330	2.3	6.0	45	55	79	0.72	1.24	1.49	0.82	1.36	1.62	0.10	0.12	0.13	13.9	9.7	8.5
NY-0340	4.1	6.3	44	54	79	1.24	2.14	2.57	1.42	2.34	2.79	0.18	0.20	0.22	14.1	9.5	8.5
NY-0350	15.6	7.8	43	53	79	4.62	8.00	9.66	5.28	8.77	10.46	0.66	0.77	0.80	14.3	9.6	8.3
NY-0360	13.1	7.6	43	53	79	3.89	6.74	8.14	4.44	7.39	8.81	0.56	0.65	0.67	14.3	9.6	8.2
NY-0370	1.0	6.2	76	76	83	0.49	0.74	0.86	0.49	0.74	0.86	0.00	0.00	0.00	0.0	0.0	0.0
NY-0380	0.6	6.3	76	76	82	0.29	0.43	0.50	0.29	0.43	0.50	0.00	0.00	0.00	0.0	0.0	0.0
NY-0390	0.4	7.2	75	75	83	0.19	0.29	0.33	0.19	0.29	0.33	0.00	0.00	0.00	0.0	0.0	0.0
NY-0400	1.5	6.5	78	78	83	0.73	1.09	1.26	0.73	1.09	1.26	0.00	0.00	0.00	0.0	0.0	0.0
NY-0410	1.6	5.8	48	58	82	0.56	0.91	1.09	0.62	0.99	1.16	0.06	0.07	0.07	11.0	7.8	6.6
NY-0420	22.0	8.2	45	55	81	7.10	11.96	14.33	7.98	12.96	15.35	0.89	1.00	1.03	12.5	8.4	7.2
NY-0430	40.6	11.6	42	53	79	11.24	19.69	23.85	13.09	21.86	26.11	1.85	2.17	2.26	16.5	11.0	9.5
NY-0440	32.9	10.6	39	52	79	9.01	15.90	19.30	10.72	17.91	21.39	1.71	2.01	2.09	19.0	12.6	10.8



**Table A-1: Hydrology Model Results**

Basin ID	Area (acres)	Time of Concentration (minutes)	Existing Impervious Percentage	Future Impervious Percentage	Pervious CN	Existing Land Use			Future Land Use			Existing Land Use			Future Land Use		
						Maximum Flow (cfs)			Maximum Flow (cfs)			Increase in Maximum Flow (cfs)			Percent Increase in Maximum Flow (%)		
						2-yr	10-yr	25-yr	2-yr	10-yr	25-yr	2-yr	10-yr	25-yr	2-yr	10-yr	25-yr
NY-0450	22.3	8.0	48	58	81	7.44	12.42	14.83	8.35	13.43	15.86	0.91	1.01	1.03	12.2	8.1	7.0
NY-0460	26.1	9.0	43	53	80	8.10	13.80	16.57	9.15	14.99	17.81	1.05	1.20	1.24	13.0	8.7	7.5
NY-0470	15.9	7.9	42	52	80	4.86	8.34	10.04	5.50	9.07	10.80	0.64	0.73	0.76	13.1	8.8	7.5
NY-0480	14.7	7.7	40	49	79	4.20	7.37	8.93	4.75	8.02	9.60	0.55	0.65	0.67	13.1	8.8	7.6
NY-0490	15.6	7.8	41	51	79	4.47	7.82	9.47	5.11	8.57	10.25	0.64	0.75	0.78	14.3	9.6	8.2
NY-0500	25.5	9.0	40	51	79	7.13	12.55	15.22	8.28	13.90	16.64	1.15	1.36	1.41	16.2	10.8	9.3
NY-0510	21.3	8.5	45	55	82	7.11	11.85	14.15	7.93	12.77	15.09	0.82	0.92	0.94	11.6	7.8	6.6
NY-0520	18.6	7.6	52	54	81	6.75	10.97	13.00	6.89	11.13	13.16	0.14	0.16	0.16	2.1	1.4	1.2
<b>Oswego Creek</b>																	
OS-Offsite1	56.1	19.8	74.6	74.6	70.2	17.97	29.04	34.36	17.97	29.04	34.36	0.00	0.00	0.00	0.0	0.0	0.0
<b>Rock Creek</b>																	
RO-0010	76.5	18.8	52	63	79	21.50	36.37	43.63	24.85	40.17	47.52	3.35	3.79	3.89	15.6	10.4	8.9
RO-0020	147.4	25.6	27	72	72	14.61	34.08	44.56	42.28	69.10	82.01	27.67	35.02	37.45	189.4	102.8	84.0
<b>Saum Creek</b>																	
SA-0010	11.6	6.4	28	34	75	2.17	4.38	5.51	2.46	4.76	5.92	0.29	0.38	0.41	13.4	8.7	7.5
SA-0020	7.2	5.9	38	46	78	1.96	3.50	4.26	2.22	3.81	4.60	0.26	0.31	0.34	13.1	8.8	7.9
SA-0030	12.7	6.7	18	22	79	2.62	5.12	6.39	2.79	5.34	6.63	0.17	0.22	0.24	6.6	4.3	3.7
SA-0040	3.8	5.8	42	52	79	1.13	1.95	2.36	1.28	2.14	2.56	0.16	0.19	0.20	13.9	9.8	8.5
SA-0050	22.2	7.4	43	53	79	6.49	11.30	13.66	7.45	12.41	14.81	0.95	1.11	1.15	14.7	9.8	8.4
SA-0060	11.0	6.3	26	35	79	2.58	4.81	5.94	2.94	5.27	6.42	0.36	0.45	0.48	14.1	9.4	8.1
SA-0070	19.8	7.7	39	50	77	5.04	9.17	11.22	6.07	10.40	12.52	1.02	1.23	1.29	20.3	13.4	11.5
SA-0080	30.9	8.7	31	37	79	7.69	14.05	17.23	8.35	14.86	18.09	0.67	0.82	0.86	8.7	5.8	5.0
SA-0090	6.5	6.2	42	52	79	1.92	3.33	4.03	2.19	3.65	4.37	0.27	0.32	0.34	14.0	9.5	8.5
SA-0100	9.5	6.8	43	53	79	2.84	4.91	5.92	3.25	5.39	6.42	0.41	0.48	0.49	14.5	9.7	8.4
SA-0110	21.7	7.9	37	51	79	5.90	10.50	12.78	7.11	11.93	14.28	1.22	1.44	1.50	20.6	13.7	11.7
SA-0120	41.7	10.8	23	28	78	8.17	16.06	20.09	8.88	16.98	21.09	0.72	0.93	1.00	8.8	5.8	5.0



**Table A-1: Hydrology Model Results**

Basin ID	Area (acres)	Time of Concentration (minutes)	Existing Impervious Percentage	Future Impervious Percentage	Pervious CN	Existing Land Use			Future Land Use			Existing Land Use			Future Land Use		
						Maximum Flow (cfs)			Maximum Flow (cfs)			Increase in Maximum Flow (cfs)			Percent Increase in Maximum Flow (%)		
						2-yr	10-yr	25-yr	2-yr	10-yr	25-yr	2-yr	10-yr	25-yr	2-yr	10-yr	25-yr
SA-0130	17.3	7.1	24	28	78	3.63	7.04	8.77	3.88	7.36	9.11	0.25	0.32	0.34	6.8	4.5	3.9
SA-0140	19.5	8.3	23	29	78	4.02	7.82	9.76	4.52	8.46	10.44	0.50	0.64	0.69	12.4	8.2	7.1
SA-0150	23.1	8.0	30	36	78	5.37	10.05	12.41	5.93	10.75	13.15	0.56	0.70	0.74	10.4	7.0	6.0
SA-0160	51.0	10.5	37	45	79	11.99	21.39	26.06	13.51	23.22	27.97	1.52	1.82	1.91	12.7	8.5	7.3
SA-0170-ODOT	54.8	14.2	46	46	78	14.66	25.70	31.13	14.66	25.70	31.13	0.00	0.00	0.00	0.0	0.0	0.0
SA-0180	10.4	6.4	38	46	79	2.92	5.15	6.25	3.27	5.57	6.70	0.36	0.42	0.44	12.2	8.2	7.1
SA-0190	7.9	6.6	42	52	81	2.57	4.33	5.18	2.87	4.67	5.55	0.30	0.34	0.37	11.6	7.9	7.1
SA-0200	20.7	8.4	43	53	79	6.10	10.57	12.77	6.98	11.59	13.82	0.88	1.02	1.05	14.4	9.6	8.2
SA-0210	11.7	6.8	39	48	76	2.90	5.33	6.54	3.37	5.91	7.15	0.48	0.58	0.61	16.4	10.9	9.4
SA-0220	26.7	9.1	38	47	74	5.67	10.90	13.55	6.73	12.24	14.98	1.06	1.34	1.43	18.7	12.3	10.5
SA-0230	22.3	7.5	37	42	55	0.83	3.67	5.29	1.37	4.50	6.24	0.54	0.84	0.95	65.4	22.8	18.0
SA-0240	28.4	9.3	37	40	60	2.08	6.17	8.43	2.51	6.81	9.15	0.43	0.64	0.72	20.9	10.3	8.5
SA-0250	14.5	6.7	42	53	59	1.38	3.64	4.87	2.25	4.86	6.22	0.88	1.22	1.35	63.7	33.4	27.7
SA-0260	21.7	7.5	42	51	73	4.81	9.15	11.34	5.86	10.46	12.74	1.05	1.31	1.40	21.9	14.3	12.3
SA-0270	8.8	6.8	36	53	69	1.34	2.92	3.75	2.11	3.92	4.83	0.77	1.00	1.08	57.0	34.2	28.9
SA-0280	26.0	8.6	42	51	61	2.77	6.93	9.17	4.09	8.76	11.19	1.32	1.82	2.02	47.7	26.3	22.0
SA-0290	47.0	36.9	15	16	76	4.22	9.57	12.45	4.35	9.76	12.66	0.13	0.19	0.21	3.1	2.0	1.7
SA-Offsite1	115.3	21.4	7	7	76	10.49	26.06	34.48	10.49	26.06	34.48	0.00	0.00	0.00	0.0	0.0	0.0
SA-Offsite2	21.0	7.1	8	8	76	2.79	6.39	8.30	2.81	6.42	8.33	0.02	0.03	0.03	0.8	0.5	0.4
SA-Offsite3	718.9	122.1	7	7	70	21.84	50.21	68.45	21.84	50.21	68.45	0.00	0.00	0.00	0.0	0.0	0.0
SA-Offsite4	777.7	183.0	7	7	73	27.14	57.12	74.84	27.14	57.12	74.84	0.00	0.00	0.00	0.0	0.0	0.0
SA-Offsite5	576.2	159.7	8	9	76	30.51	64.30	83.28	30.51	64.30	83.28	0.00	0.00	0.00	0.0	0.0	0.0
SA-Offsite5-ODOT	98.6	159.7	46	46	76	8.67	15.72	19.30	8.67	15.72	19.30	0.00	0.00	0.00	0.0	0.0	0.0



**Table A-1: Hydrology Model Results**

Basin ID	Area (acres)	Time of Concentration (minutes)	Existing Impervious Percentage	Future Impervious Percentage	Pervious CN	Existing Land Use			Future Land Use			Existing Land Use			Future Land Use		
						Maximum Flow (cfs)			Maximum Flow (cfs)			Increase in Maximum Flow (cfs)			Percent Increase in Maximum Flow (%)		
						2-yr	10-yr	25-yr	2-yr	10-yr	25-yr	2-yr	10-yr	25-yr	2-yr	10-yr	25-yr
<b>Tualatin River</b>																	
TU-0010	18.2	7.0	10	11	73	1.70	4.53	6.06	1.78	4.64	6.19	0.08	0.12	0.13	4.8	2.5	2.1
TU-0020	23.9	7.5	40	50	73	5.25	10.02	12.43	6.32	11.35	13.85	1.07	1.34	1.43	20.4	13.4	11.5
TU-0030	45.1	10.1	41	50	77	11.70	21.03	25.67	13.33	23.00	27.73	1.63	1.96	2.06	13.9	9.3	8.0
TU-0040	9.8	7.5	41	50	79	2.86	4.98	6.02	3.19	5.37	6.43	0.33	0.39	0.41	11.6	7.8	6.7
TU-0050	41.2	9.7	43	53	71	8.28	16.19	20.22	10.37	18.83	23.05	2.08	2.64	2.82	25.2	16.3	14.0
TU-0060	9.4	7.5	5	5	77	1.24	2.85	3.71	1.24	2.85	3.71	0.00	0.00	0.00	0.0	0.0	0.0
TU-0070	5.3	5.9	40	50	80	1.59	2.75	3.33	1.81	3.01	3.60	0.22	0.26	0.28	13.7	9.5	8.3
TU-0080	34.6	9.4	39	49	74	7.51	14.33	17.78	9.11	16.33	19.91	1.60	2.00	2.13	21.3	13.9	12.0
TU-0090-ODOT	12.7	7.1	46	46	80	4.11	6.94	8.31	4.11	6.94	8.31	0.00	0.00	0.00	0.0	0.0	0.0
TU-0100	38.3	11.3	71	72	80	15.85	24.43	28.48	16.05	24.62	28.68	0.19	0.20	0.19	1.2	0.8	0.7
TU-0110	2.2	6.3	23	28	77	0.44	0.87	1.09	0.48	0.92	1.14	0.04	0.05	0.05	8.6	5.6	4.9
TU-0120	19.9	7.7	33	40	78	4.95	9.08	11.14	5.48	9.73	11.83	0.53	0.65	0.69	10.7	7.2	6.2
TU-0130	11.8	6.6	76	76	79	5.26	8.05	9.37	5.26	8.05	9.37	0.00	0.00	0.00	0.0	0.0	0.0
TU-0140	51.9	18.9	64	66	75	15.63	25.87	30.82	16.11	26.42	31.38	0.48	0.55	0.56	3.1	2.1	1.8
TU-0150	6.4	7.1	78	78	79	2.91	4.41	5.12	2.91	4.41	5.12	0.00	0.00	0.00	0.0	0.0	0.0
TU-0160	22.0	10.1	78	78	74	9.12	14.10	16.45	9.12	14.10	16.45	0.00	0.00	0.00	0.0	0.0	0.0
TU-0170	6.8	6.8	56	56	76	2.20	3.71	4.45	2.20	3.71	4.45	0.00	0.00	0.00	0.0	0.0	0.0
TU-0180	21.8	10.0	63	63	73	7.13	11.91	14.23	7.13	11.91	14.23	0.00	0.00	0.00	0.0	0.0	0.0
TU-0190	50.0	18.5	60	61	77	14.74	24.61	29.39	15.02	24.92	29.71	0.27	0.31	0.32	1.9	1.3	1.1
TU-0200	39.3	9.9	6	6	76	4.25	10.51	13.87	4.25	10.51	13.87	0.00	0.00	0.00	0.0	0.0	0.0
TU-0210	39.2	9.9	67	67	79	15.40	24.27	28.48	15.40	24.27	28.48	0.00	0.00	0.00	0.0	0.0	0.0
TU-0220	56.9	12.5	5	5	76	5.61	14.23	18.89	5.61	14.23	18.89	0.00	0.00	0.00	0.0	0.0	0.0
TU-0230	25.6	9.6	73	73	79	10.88	16.72	19.49	10.88	16.72	19.49	0.00	0.00	0.00	0.0	0.0	0.0
TU-0240	8.3	6.7	78	78	78	3.79	5.76	6.69	3.79	5.76	6.69	0.00	0.00	0.00	0.0	0.0	0.0
TU-0250	123.1	35.0	37	44	81	23.87	42.46	51.76	26.42	45.61	55.08	2.55	3.15	3.32	10.7	7.4	6.4



**Table A-1: Hydrology Model Results**

Basin ID	Area (acres)	Time of Concentration (minutes)	Existing Impervious Percentage	Future Impervious Percentage	Pervious CN	Existing Land Use			Future Land Use			Existing Land Use			Future Land Use		
						Maximum Flow (cfs)			Maximum Flow (cfs)			Increase in Maximum Flow (cfs)			Percent Increase in Maximum Flow (%)		
						2-yr	10-yr	25-yr	2-yr	10-yr	25-yr	2-yr	10-yr	25-yr	2-yr	10-yr	25-yr
TU-0260	72.6	23.6	31	38	82	16.23	28.92	35.20	17.74	30.73	37.11	1.51	1.82	1.91	9.3	6.3	5.4
TU-0270	23.1	9.3	43	53	79	6.71	11.65	14.08	7.68	12.78	15.25	0.97	1.13	1.17	14.5	9.7	8.3
TU-0280	20.5	8.0	43	53	79	6.06	10.51	12.69	6.93	11.52	13.74	0.87	1.01	1.04	14.3	9.6	8.2
TU-0290	3.8	6.3	42	53	81	1.23	2.07	2.49	1.39	2.26	2.68	0.16	0.18	0.19	12.7	8.8	7.7
TU-0300	15.7	7.9	15	17	80	3.28	6.35	7.92	3.41	6.52	8.10	0.13	0.17	0.18	4.0	2.7	2.3
TU-0310	64.5	14.7	39	52	79	16.25	28.98	35.29	19.40	32.71	39.18	3.15	3.73	3.90	19.4	12.9	11.0
TU-0320	36.8	12.4	28	34	79	8.22	15.36	18.96	9.01	16.35	20.02	0.79	0.99	1.05	9.7	6.4	5.6
TU-0330	35.4	9.5	40	46	79	9.87	17.36	21.06	10.75	18.41	22.15	0.88	1.05	1.09	8.9	6.0	5.2
TU-0340	27.7	9.9	39	48	79	7.66	13.49	16.36	8.65	14.66	17.59	0.99	1.17	1.22	12.9	8.7	7.5
TU-0350	42.9	10.9	44	57	79	12.36	21.43	25.89	14.75	24.19	28.74	2.39	2.76	2.85	19.3	12.9	11.0
TU-0360	26.7	8.6	48	58	79	8.37	14.21	17.07	9.52	15.53	18.41	1.16	1.31	1.35	13.8	9.2	7.9
TU-0370	40.5	10.0	48	54	79	12.39	21.15	25.43	13.41	22.32	26.64	1.01	1.17	1.21	8.2	5.5	4.7
TU-0380	9.0	7.4	65	69	79	3.52	5.59	6.58	3.72	5.79	6.79	0.19	0.21	0.22	5.5	3.7	3.3
TU-Offsite1	400.6	97.7	5	5	68	10.54	24.79	34.90	10.54	24.79	34.90	0.00	0.00	0.00	0.0	0.0	0.0
TU-Offsite2	307.6	76.7	6	6	79	21.09	45.82	59.17	21.18	45.96	59.33	0.09	0.14	0.16	0.4	0.3	0.3

Note: Subbasins that do not drain to city infrastructure are highlighted in gray.



## **Attachment B: Hydraulic Model Results**

---







Table B-1. Hydraulic Model Parameters and Results

						Node Name		Invert Elevation (ft)		Ground Elevation (ft)		Existing 2 yr Max Water Surface Elevation (ft)		Future 2 yr Max Water Surface Elevation (ft)		Existing 10 yr Max Water Surface Elevation (ft)		Future 10 yr Max Water Surface Elevation (ft)		Existing 25 yr Max Water Surface Elevation (ft)		Future 25 yr Max Water Surface Elevation (ft)		2 yr Max Flow (cfs)		10 yr Max Flow (cfs)		25 yr Max Flow (cfs)		When Hydraulically Deficient	
Link ID	Length (ft)	Shape	Diameter/Height (ft)	Slope (%)	Design Flow (cfs)	US	DS	US	DS	US	DS	US	DS	US	DS	US	DS	US	DS	US	DS	US	DS	Existing	Future	Existing	Future	Existing	Future		
Herman Road System																															
267853	105.1	Circular	2.0	0.6	15.9	262914	322610_HE-0080	123.72	123.12	131.59	127.16	124.84	124.05	124.94	124.11	125.35	124.39	125.47	124.44	125.63	124.52	125.80	124.57	6.7	7.6	11.5	12.6	13.9	14.9		
268054	60.5	Circular	1.0	2.5	5.0	262138_HE-0120	270931	127.44	125.90	129.44	129.14	127.99	126.15	128.04	126.19	128.24	126.99	128.34	127.09	128.56	127.17	129.01	127.25	1.8	2.0	3.0	3.3	3.7	3.9	Future 25-yr	
268371	55.7	Circular	2.0	0.4	12.6	262922	262914	124.12	123.92	130.53	131.59	125.29	124.84	125.39	124.94	125.83	125.35	125.96	125.47	126.18	125.63	126.38	125.80	5.8	6.5	9.8	10.7	11.8	12.8		
268372	131.0	Circular	1.0	0.9	3.2	262918_HE-0090	262914	126.13	124.92	128.62	131.59	126.51	125.30	126.54	125.33	126.65	125.44	126.68	125.47	126.71	125.63	126.75	125.80	1.0	1.1	1.7	1.9	2.0	2.2		
268384	174.9	Circular	2.0	0.4	13.3	262545	262922	124.92	124.22	128.65	130.53	125.98	125.29	126.08	125.99	126.54	125.83	126.69	125.96	127.04	126.18	127.33	126.38	5.8	6.5	9.9	10.7	11.9	12.8		
322603	108.8	Circular	1.5	0.3	5.6	322601_HE-0160	HE-0150	127.31	126.95	131.06	129.95	130.36	128.91	130.54	128.93	132.61	129.10	132.87	129.12	133.94	129.17	134.23	129.19	8.8	9.3	13.8	14.2	16.1	16.6	Existing 2-yr	
322618	380.4	Circular	2.5	0.2	8.5	322608	322610_HE-0080	123.37	122.66	127.87	127.16	125.94	124.05	126.21	124.11	126.52	124.39	126.52	124.44	126.53	124.52	126.53	124.57	12.0	13.3	14.1	14.1	14.1	14.1	Existing 2-yr	
322620	51.1	Circular	2.0	1.7	27.8	322615	322613	124.99	124.10	127.99	128.23	125.99	125.98	126.27	126.26	126.71	126.64	126.78	126.69	126.83	126.72	126.90	126.77	2.9	3.2	5.1	5.7	6.1	6.6		
322621	40.9	Circular	2.0	-3.1	36.7	322613	322614	122.95	124.20	128.23	128.14	125.98	125.97	126.26	126.24	126.64	126.56	126.69	126.58	126.72	126.60	126.77	126.62	2.9	3.1	5.0	5.7	6.1	6.5		
322638.1	49.5	Circular	1.0	0.3	1.9	322625	322630	125.26	125.09	128.26	128.09	127.63	126.46	127.69	126.67	127.82	127.29	127.87	127.51	127.89	127.59	127.97	127.75	4.5	4.5	4.5	4.5	4.5	4.5	Existing 2-yr	
322638_flood	49.5	Trapezoidal	1.0	0.3		322625	322630	127.26	127.09	128.26	128.09	127.63	126.46	127.69	126.67	127.82	127.29	127.87	127.51	127.89	127.61	127.97	127.75	8.3	11.0	17.5	20.8	22.0	25.4		
322639	76.9	Circular	1.0	0.1	0.9	322626	322631	124.80	124.74	127.80	127.74	126.00	126.14	126.27	126.47	126.71	127.24	126.78	127.47	126.81	127.56	126.89	127.72	-1.6	-1.9	-2.3	-2.6	-2.7	-2.9		
322641	43.5	Circular	2.0	2.2	61.8	322627	322634	124.72	123.78	127.72	128.15	126.14	126.09	126.47	126.38	127.24	126.97	127.47	127.13	127.56	127.18	127.72	127.29	11.0	13.0	17.7	20.4	21.3	22.8		
322642	52.4	Circular	2.0	0.6	33.8	322634	322637	123.00	122.66	128.15	127.86	126.09	126.03	126.38	126.29	126.97	126.70	127.13	126.76	127.18	126.79	127.29	126.83	11.0	13.0	17.7	20.4	21.3	22.8		
322643	12.3	Circular	2.0	0.6	31.7	322637	322632_HE-0130	124.06	123.99	127.86	126.49	126.03	125.99	126.29	126.25	126.70	126.49	126.76	126.49	126.79	126.49	126.83	126.49	10.9	13.0	17.7	20.4	21.3	22.8	Existing 2-yr	
333707_flood	46.9	Trapezoidal	1.0	0.4		333702	333701_HE-0140	128.16	127.99	129.16	128.99	128.58	128.45	128.61	128.51	128.73	128.61	128.76	128.66	128.79	128.68	128.82	128.73	9.5	10.1	15.3	15.8	18.0	18.6		
333704.1	12.6	Circular	0.8	0.3	1.1	333700	333699	125.88	125.84	128.88	128.84	128.33	128.27	128.38	128.32	128.48	128.42	128.53	128.47	128.55	128.48	128.59	128.59	2.2	2.2	2.2	2.2	2.2	2.2	Existing 2-yr	
333704_flood	12.6	Trapezoidal	1.0	0.3		333700	333699	127.88	127.84	128.88	128.84	128.33	128.27	128.38	128.32	128.48	128.42	128.53	128.47	128.55	128.49	128.59	128.53	12.1	14.6	19.9	22.8	23.7	26.6		
333705.1	34.5	Circular	0.8	0.3	1.1	333701_HE-0140	333700	125.99	125.88	128.99	128.88	128.45	128.33	128.51	128.38	128.61	128.48	128.66	128.53	128.68	128.55	128.73	128.59	1.9	1.9	1.9	1.9	1.9	1.9	Existing 2-yr	
333705_flood	34.5	Trapezoidal	1.0	0.3		333701_HE-0140	333700	127.99	127.88	128.99	128.88	128.45	128.33	128.51	128.38	128.61	128.48	128.66	128.53	128.68	128.55	128.73	128.59	11.9	14.4	19.8	22.6	23.6	26.5		
333706.1	46.9	Circular	0.8	0.4	1.2	333702	333701_HE-0140	126.16	125.99	129.16	128.99	128.58	128.45	128.61	128.51	128.73	128.61	128.76	128.66	128.79	128.68	128.82	128.73	1.5	1.3	1.5	1.2	1.5	1.2	Existing 2-yr	
333707.1	49.2	Circular	0.8	0.0	1.2	333703	333702	126.32	126.16	129.32	129.16	128.73	128.58	128.75	128.61	128.87	128.73	128.89	128.76	128.93	128.79	128.95	128.82	1.4	1.3	1.4	1.2	1.5	1.1	Existing 2-yr	
333707_flood	49.2	Trapezoidal	1.0	0.3		333703	333702	128.32	128.16	129.32	129.16	128.73	128.58	128.75	128.61	128.87	128.73	128.89	128.76	128.93	128.79	128.95	128.82	9.3	9.8	15.1	15.6	17.8	18.3		
334080.1	52.0	Circular	0.8	0.3	1.2	333699	334081	125.84	125.66	128.84	128.66	128.27	127.67	128.32	127.74	128.42	127.87	128.47	127.94	128.49	127.96	128.53	128.03	2.6	2.6	2.6	2.6	2.6	2.6	Existing 2-yr	
334080_flood	52.0	Trapezoidal	1.0	0.3		333699	334081	127.84	127.66	128.84	128.66	128.27	127.99	128.32	128.04	128.42	128.14	128.47	128.18	128.49	128.20	128.53	128.24	11.1	13.6	19.0	21.9	22.8	25.8		
335317	21.7	Circular	2.0	-6.5	53.6	322614	322612	122.70	124.10	128.14	127.10	125.97	125.96	126.24	126.23	126.56	126.51	126.58	126.52	126.60	126.52	126.62	126.52	2.8	3.1	5.0	5.7	6.1	6.5		
Link32.1	185.2	Trapezoidal	1.5	0.3		HE-0150	333703	126.95	126.32	129.95	129.32	128.91	128.73	128.93	128.75	129.10	128.87	129.12	128.89	129.17	128.93	129.19	128.95	10.4	10.8	14.3	14.5	15.7	15.8	Existing 10-yr	
Link32_flood	185.2	Trapezoidal	1.0	0.3		HE-0150	333703	128.95	128.32	129.95	129.32	128.91	128.73	128.93	128.75	129.10	128.87	129.12	128.89	129.17	128.93	129.19	128.95	0.0	0.0	1.8	2.1	3.1	3.5		
Link33.1	119.5	Trapezoidal	2.0	0.0		334081	322625	125.66	125.26	128.66	128.26	127.67	127.63	127.74	127.69	127.87	127.82	127.94	127.87	127.96	127.96	127.89	128.03	127.97	12.8	14.9	18.8	20.7	21.3	22.9	Future 2-yr
Link33_flood	119.5	Trapezoidal	1.0	0.3		334081	322625	127.66	127.26	128.66	128.26	127.67	127.63	127.74	127.69	127.87	127.82	127.94	127.87	127.96	127.96	127.89	128.03	127.97	0.0	0.5	1.9	2.8	3.2	4.5	
Link34.1	110.5	Trapezoidal	2.0	0.3		322630	322627	125.09	124.72	128.09	127.72	126.46	126.14	126.67	126.47	127.29	127.24	127.51	127.47	127.59	127.56	127.75	127.72	12.7	15.2	19.7	21.1	21.0	21.7	Existing 10-yr	
Link34_flood	110.5	Trapezoidal	1.0	0.3		322630	322627	127.09	126.72	128.09	127.72	---	---	---	---	127.289	127.235	127.509	127.474	127.588	127.56	127.748	127.72	0.0	0.0	1.6	4.2	5.2	7.5		
Link35	10.7	Trapezoidal	2.0	0.2		322631	322627	124.74	124.72	127.74	127.72	126.14	126.14	126.47	127.24	127.24	127.47	127.47	127.56	127.56	127.72	127.72	-1.6	-1.9	-2.4	-2.6	-2.7	-2.9			
Link36	12.6	Trapezoidal	2.0	7.2		270931	322615	125.90	124.99	129.14	127.99	126.15	125.99	126.19	126.27	126.99	126.71	127.13	126.78	127.17	126.83	127.25	126.90	1.8	2.0	-11.4	11.2	10.5	-15.3		
Link37	230.8	Trapezoidal	2.0	0.1		322615	322626																								

Table B-1. Hydraulic Model Parameters and Results


						Node Name		Invert Elevation (ft)		Ground Elevation (ft)		Existing 2 yr Max Water Surface Elevation (ft)		Future 2 yr Max Water Surface Elevation (ft)		Existing 10 yr Max Water Surface Elevation (ft)		Future 10 yr Max Water Surface Elevation (ft)		Existing 25 yr Max Water Surface Elevation (ft)		Future 25 yr Max Water Surface Elevation (ft)		2 yr Max Flow (cfs)		10 yr Max Flow (cfs)		25 yr Max Flow (cfs)		When Hydraulically Deficient
Link ID	Length (ft)	Shape	Diameter/Height (ft)	Slope (%)	Design Flow (cfs)	US	DS	US	DS	US	DS	US	DS	US	DS	US	DS	US	DS	US	DS	US	DS	Existing	Future	Existing	Future	Existing	Future	
265110	24.9	Circular	3.0	16.5	251.0	262210_NY-0280	262209	130.60	126.50	136.53	133.15	131.46	127.49	131.54	127.68	131.83	128.50	131.97	129.10	132.12	129.72	132.29	130.17	20.3	23.4	34.2	37.4	39.2	41.1	
265111	207.7	Circular	2.5	3.1	67.4	262209	NY-0250	126.30	119.80	133.15	126.15	127.49	124.06	127.68	124.58	128.50	125.75	129.10	125.93	129.72	126.08	130.17	126.15	20.2	23.4	34.1	37.3	39.1	41.1	
266998	142.0	Circular	3.0	3.0	106.5	260409	262210_NY-0280	135.09	130.90	140.51	136.53	136.11	131.73	136.21	131.80	136.51	132.00	136.60	132.05	136.63	132.12	136.65	132.29	17.9	20.8	30.3	33.3	34.5	36.3	Future 10-yr
267215	83.8	Circular	3.0	0.7	52.1	262844	270971	125.20	124.61	132.63	127.61	127.20	125.52	127.40	125.73	128.60	127.01	129.04	127.07	129.43	127.14	129.97	127.20	27.5	32.0	47.8	53.1	57.9	63.3	
267573_1	52.0	Circular	5.3	0.9	265.1	260399	Node588	114.33	113.88	123.85	123.85	116.51	116.10	116.62	116.21	116.85	116.47	116.88	116.49	116.92	116.55	116.93	116.57	88.9	97.6	113.9	115.2	116.6	117.4	
267573_2	45.0	Circular	5.3	0.9	265.4	Node588	Node589	113.88	113.50	123.85	123.15	116.10	115.74	116.21	115.84	116.47	116.11	116.49	116.14	116.55	116.21	116.57	116.23	93.3	101.7	120.6	122.3	125.5	126.7	
267573_3	15.0	Circular	5.3	0.9	265.2	Node589	270963	113.50	113.37	123.15	123.15	115.74	115.61	115.84	115.72	116.11	115.98	116.14	116.01	116.21	116.08	116.23	116.10	97.8	106.1	128.2	130.6	136.3	138.2	
267910	126.6	Circular	1.8	0.9	14.3	262152_NY-0350	263083_NY-0340	212.30	211.10	216.42	215.65	213.49	212.14	213.63	212.25	216.63	214.57	218.16	215.65	218.69	215.65	219.20	215.65	8.4	9.7	14.7	16.1	17.8	19.3	Existing 10-yr
267951	199.0	Circular	1.8	1.4	17.3	263085	271340_NY-0320	205.20	202.44	208.46	205.44	206.28	203.09	206.38	203.12	207.60	203.25	208.00	203.27	208.02	203.28	208.03	203.28	10.4	11.9	17.8	18.8	18.9	18.9	Existing 10-yr
267953	84.5	Circular	2.5	7.2	102.3	260393	262947_NY-0310	200.00	193.90	203.34	206.92	200.64	194.46	200.69	194.50	202.36	194.63	202.49	194.65	202.52	194.66	202.53	194.66	11.1	12.7	18.8	20.1	20.4	20.6	
268293	21.4	Circular	2.5	1.4	45.1	262846	262844	126.70	126.40	135.44	132.63	129.06	127.81	129.37	127.96	131.22	128.63	132.11	129.04	133.06	129.43	134.34	129.97	27.5	32.0	47.8	53.1	57.9	63.3	Existing 10-yr
268295.1	119.7	Circular	2.5	5.5	89.7	262856	262847_NY-0370	138.10	131.46	147.25	138.76	139.24	132.77	139.36	132.95	139.88	134.24	140.78	136.10	143.52	137.76	144.74	137.87	27.1	31.5	47.2	52.4	57.1	62.5	
268295_flood	119.7	Trapezoidal	1.0	7.1		262856	262847_NY-0370	146.3	137.8	147.3	138.8	---	---	---	---	---	---	---	---	---	---	---	---	0.0	0.0	0.0	0.0	0.0	0.0	
268296.1	67.6	Circular	2.5	4.4	79.6	262847_NY-0370	262846	131.26	128.30	138.76	135.44	132.77	129.31	132.95	129.40	134.24	131.22	136.10	132.11	137.76	133.06	137.87	134.34	27.5	32.0	47.9	53.1	57.8	58.0	Existing 25-yr
268296_flood	67.6	Trapezoidal	1.0	4.9		262847_NY-0370	262846	137.8	134.4	138.8	135.4	---	---	---	---	---	---	---	---	---	---	---	---	0.0	0.0	0.0	0.0	0.0	0.0	13.1
268297.1	41.3	Circular	2.5	10.4	122.8	262848	262856	142.50	138.20	148.93	147.25	143.71	139.24	143.85	139.36	144.35	139.88	144.63	140.78	147.55	143.52	148.04	144.74	27.1	31.5	47.2	52.4	57.1	58.2	Future 25-yr
268297_flood	41.3	Trapezoidal	1.0	4.1		262848	262856	147.9	146.3	148.9	147.3	---	---	---	---	---	---	---	---	---	---	---	---	0.0	0.0	0.0	0.0	0.0	0.0	10.7
277225	110.2	Circular	3.0	1.2	48.1	277227_NY-0380	277232	124.00	122.72	127.95	126.72	127.47	125.40	128.36	125.65	129.66	126.72	129.67	126.72	129.69	126.72	129.70	126.72	46.6	51.7	53.9	54.0	54.2	54.3	Future 2-yr
312461	52.4	Circular	1.0	6.1	8.2	312444_NY-0410	312445_NY-0400	143.10	139.90	147.23	143.47	143.29	140.10	143.30	140.10	143.34	140.16	143.35	140.17	143.37	140.20	143.38	140.20	0.6	0.6	0.9	1.0	1.1	1.2	
322832	62.1	Circular	1.3	2.4	9.3	312443	322831	125.60	124.11	129.32	126.11	125.95	125.21	125.97	125.70	130.39	126.96	129.32	127.00	131.01	127.05	129.32	127.10	1.3	1.3	10.9	9.1	12.4	9.0	Existing 10-yr
333171	653.3	Circular	2.5	4.6	81.2	263397_NY-0290	333170	179.70	149.92	187.40	152.92	180.52	150.82	180.59	150.86	180.83	150.99	180.91	151.03	180.94	151.04	180.98	151.07	17.9	20.8	30.3	33.3	34.5	36.3	
Link31	127.0	Natural	2.5	1.9		271340_NY-0320	260393	202.44	200.06	205.44	203.34	203.09	200.71	203.12	200.74	203.25	202.36	203.27	202.49	203.28	202.52	203.28	202.53	11.1	12.7	19.0	20.2	20.4	20.6	
Link32	93.0	Natural	2.5	8.0		333170	Node561	149.92	142.51	152.92	145.10	150.82	143.64	150.86	143.68	150.99	143.80	151.03	143.83	151.04	143.84	151.07	17.9	20.8	30.3	33.3	34.5	36.3		
Link33	93.0	Natural	2.0	4.3		260409	Node561	142.51	138.51	145.10	140.51	143.64	139.63	143.68	139.67	143.80	139.77	143.83	139.80	143.84	139.82	143.86	139.83	17.9	20.8	30.3	33.3	34.5	36.3	
Link34	186.3	Circular	3.5	0.2	42.8	NY-0250	270982_NY-0200	119.40	119.01	126.15	126.00	124.06	123.90	124.58	124.39	125.75	125.38	125.93	125.46	126.08	125.54	126.15	125.59	23.7	26.8	33.7	35.1	35.7	37.0	
Link35	303.0	Circular	1.0	4.7	7.1	312445_NY-0400	312443	139.80	125.70	143.47	129.32	140.10	125.99	140.10	125.99	140.16	130.39	140.17	129.32	140.20	131.01	140.20	129.32	1.3	1.3	2.0	2.1	2.3	2.4	
Link36	456.0	Circular	3.0	2.7	102.2	335464	Node591	136.18	123.77	142.50	127.95	139.70	127.93	139.94	128.93	140.04	130.27	140.05	130.28	140.06	130.30	140.06	130.31	46.3	51.4	53.3	53.4	53.5	53.6	Existing 2-yr
Link37	40.0	Natural	2.0	1.3		270971	322831	124.61	124.11	127.61	126.11	125.52	125.21	125.73	125.70	127.01	126.96	127.07	127.00	127.14	127.05	127.20	127.10	27.5	31.9	47.7	53.0	57.8	63.3	
Link38	120.0	Natural	2.0	1.2		322831	277232	124.11	122.72	126.11	126.72	125.21	125.13	125.70	125.65	126.96	126.72	127.00	126.72	127.05	126.72	127.10	126.72	28.5	32.7	56.0	61.1	66.8	71.0	
Link43.1	1125.0	Natural	0.5	1.3		NY-0450	Node595	151.99	137.68	154.39	142.50	153.96	140.13	154.08	140.51	154.82	140.66	155.18	140.67	155.78	140.68	156.22	140.69	4.5	4.5	4.5	4.5	4.6	4.6	Existing 2-yr
Link43_flood	1125.0	Trapezoidal	2.0	1.1		NY-0450	Node595	152.39	140.50	154.39	142.50	153.96	141.69	154.08	141.79	154.82	142.08	155.18	142.10	155.78	142.13	156.22	142.15	41.9	47.9	66.7	67.9	70.0	71.5	
Link49	115.0	Circular	5.0	1.3	208.2	NEW1	Node570	117.18	115.68	127.68	127.68	122.81	121.87	123.08	121.93	123.64	122.01	123.68	122.02	123.73	122.02	123.76	122.03	90.3	99.1	115.3	116.6	118.0	118.8	
Link60	280.0	Trapezoidal	1.5	1.0		NY-0520	NY-0510	165.05	162.19	166.55	163.70	165.52	162.90	165.53	162.93	165.68	163.14	165.68	163.16	165.74	163.25	165.75	163.28	6.7	6.9	11.0	11.1	13.0	13.1	
Link61	1000.0	Trapezoidal	1.5	1.0		NY-0510	NY-0450	162.19	151.99	163.70	154.39	162.90	153.96	162.93	154.08	163.14	154.82	163.16	155.18	163.25	155.78	163.28	156.22	13.6	14.6	22.6	23.7	26.6	27.7	
Link62	1200.0	Circular	3.0	1.5	74.9	NY-0470	NY-0460	182.73	165.16	187.73	170.16	184.02	165.55	184.12	165.58	184.51	165.69	184.62	165.72	184.75	165.76	184.88	165.78	20.3	23.3	35.7	39.2	43.3	47.0	
Link63	900.0	Trapezoidal	2.0	1.5		NY-0460	NY-0450	165.16	151.99	170.16	154.39	165.55	153.96	165.58	154.08	165.69	154.82	165.72	155.18	165.76	155.78	165.78	156.22	28.1	32.1	49.1	53.9	59.4	64.4	
Link67	1500.0	Circular	3.0	2.6	99.1	NY-0430	NY-0420	210.40	171.97	215.40	176.97	211.32	173.04	211.40	173.13	211.64	173.43	211.72	173.52	211.78	173.60	211.86	173.71	20.1	23.7	35.4	39.5	42.9	47.2	
Link68	1150.0	Circular	3.0	2.6	99.1	NY-0420	262848	171.97	142.50	176.97	148.93	173.04	143.71	173.13	143.85	173.43	144.35	173.52	144.63	173.60	147.55	173.71	148.04	27.1	31.5	47.2	52.4	57.1	62.5	
Link69	1600.0	Circular	1.8	1.5	18.9	NY-0360																								

## Attachment C: Figures

---





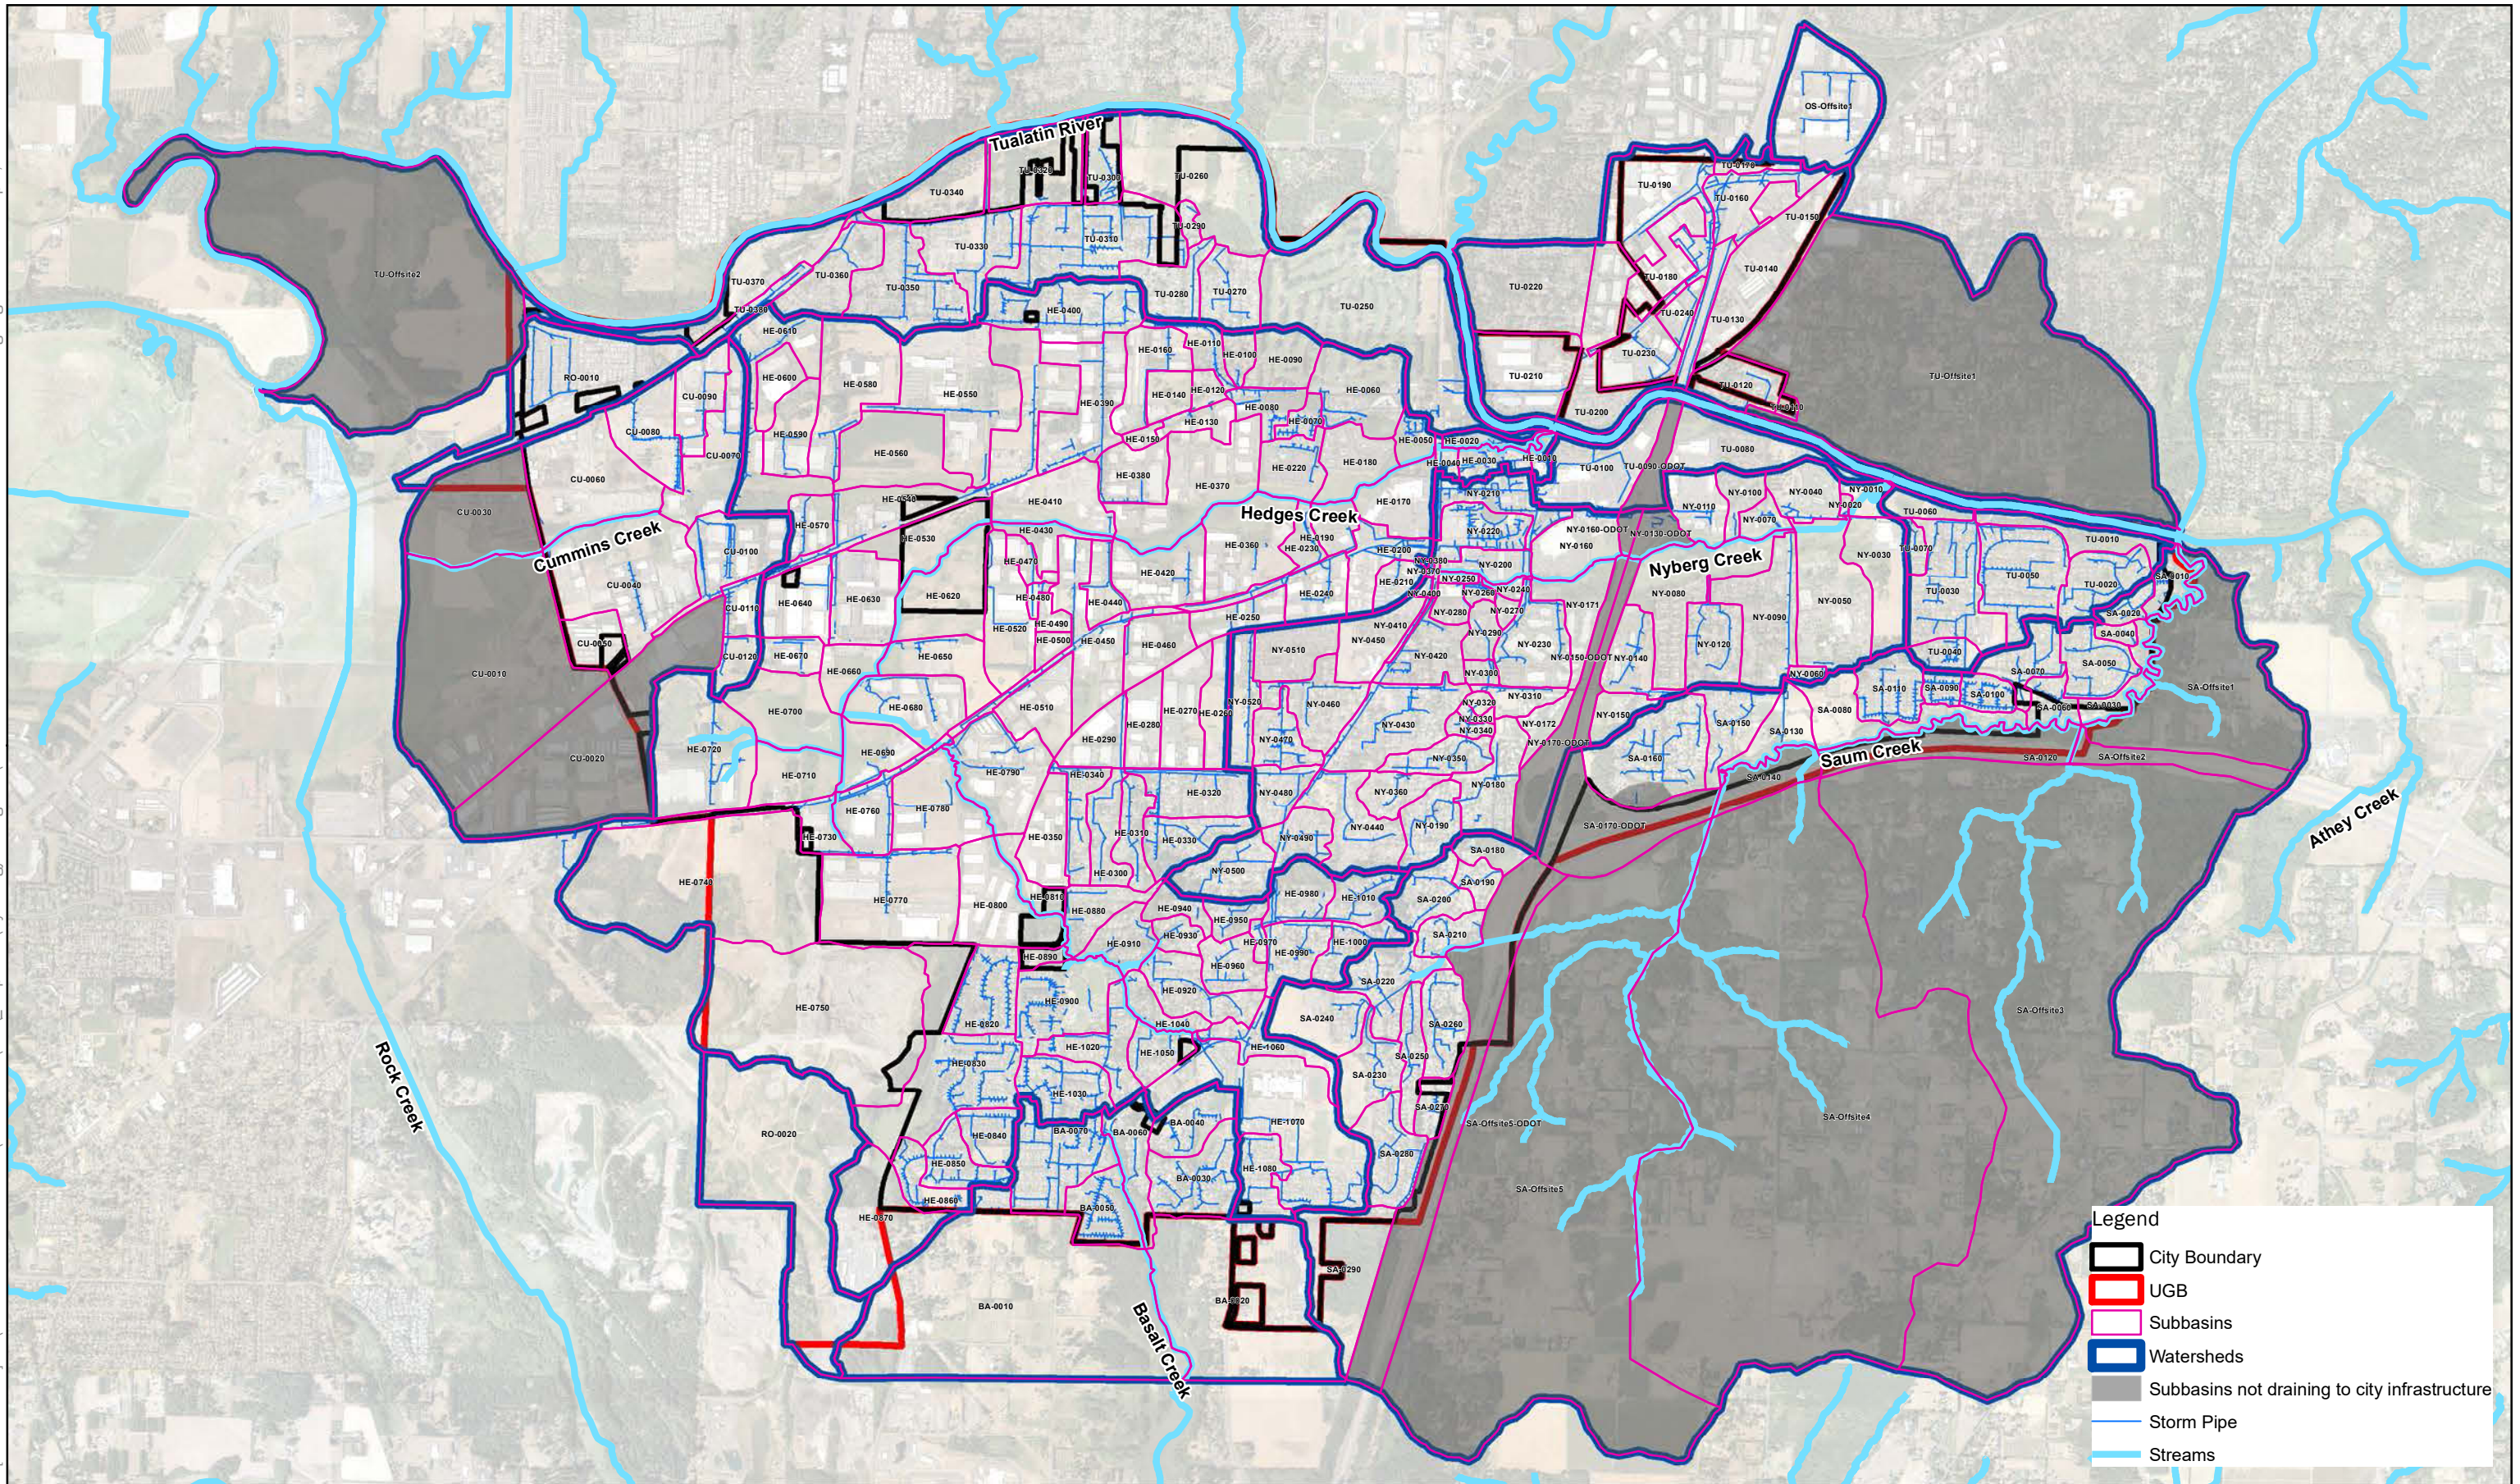

**City of Tualatin  
Stormwater Master Plan**

Date: August 2017  
Project: Project 149233


0 2,300 4,600  
Feet



Notes:  
1. Projection: NAD 1983 State Plane Oregon North (feet)

**Figure 1  
Subbasin Boundaries**



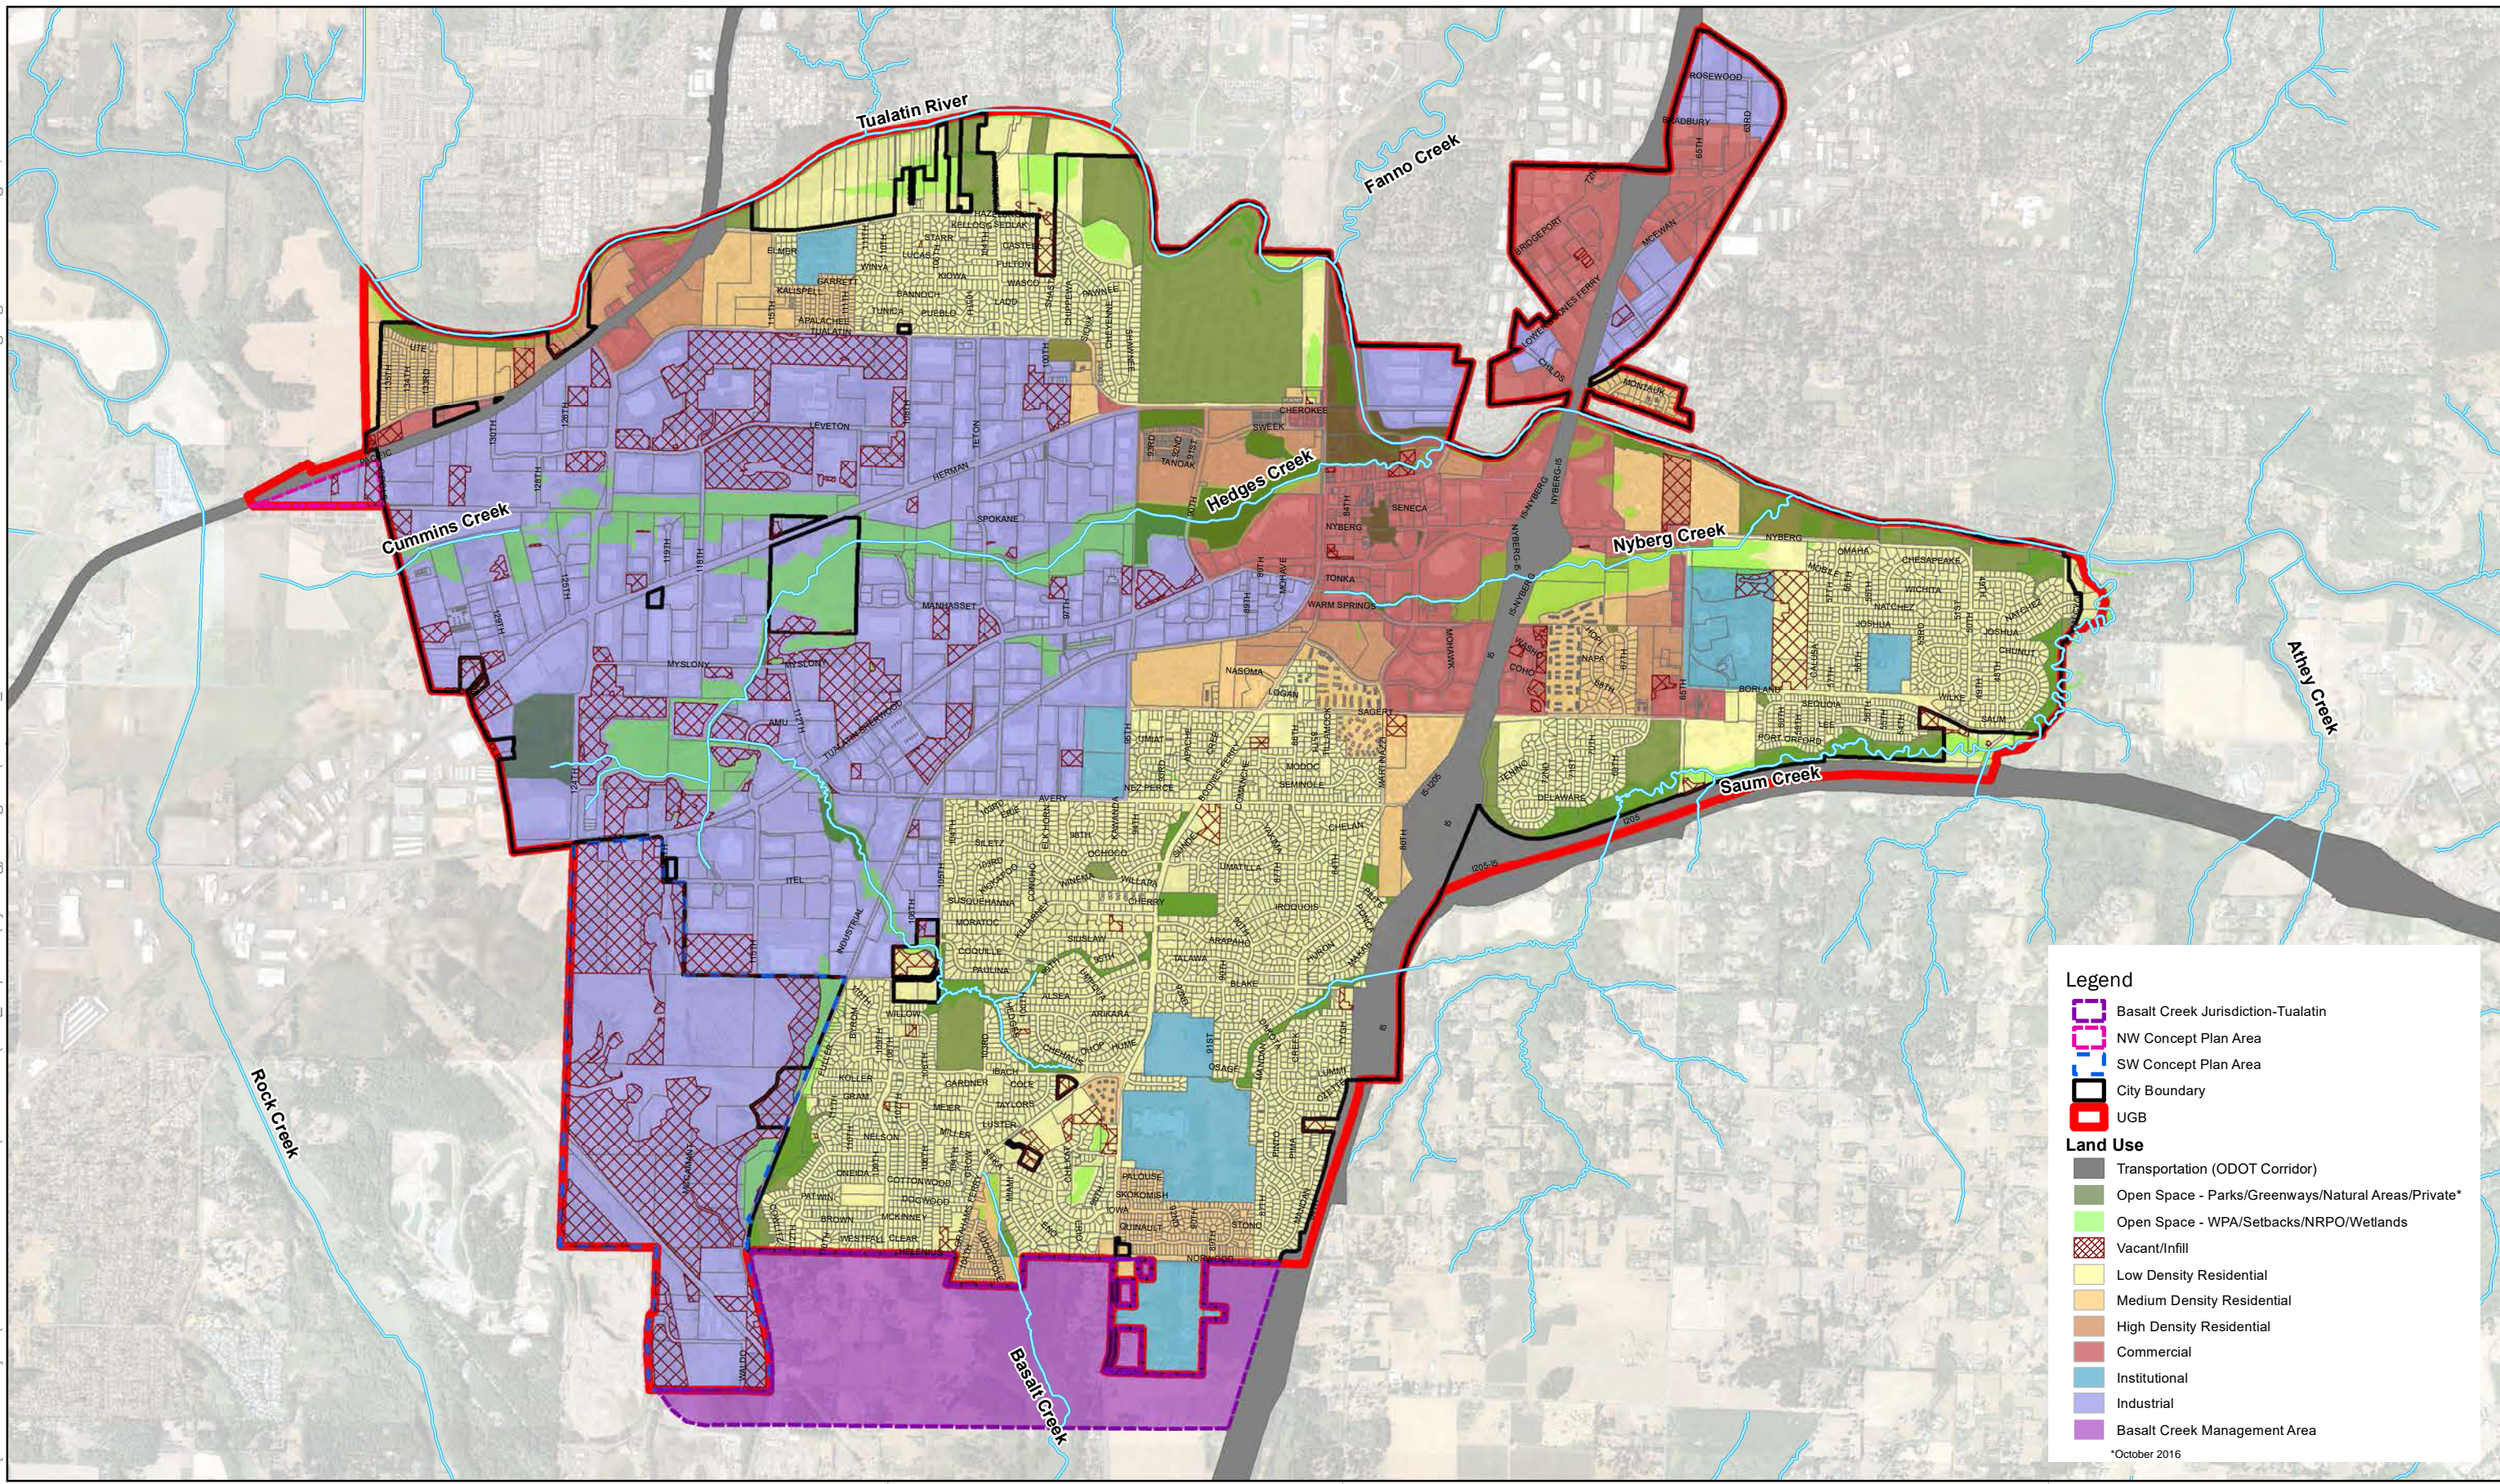


**Legend**

- Basalt Creek Jurisdiction-Tualatin
- NW Concept Plan Area
- SW Concept Plan Area
- City Boundary
- UGB

**Land Use**


- Transportation (ODOT Corridor)
- Open Space - Parks/Greenways/Natural Areas/Private\*
- Open Space - WPA/Setbacks/NRPO/Wetlands
- Vacant/Infill
- Low Density Residential
- Medium Density Residential
- High Density Residential
- Commercial
- Institutional
- Industrial
- Basalt Creek Management Area

\*October 2016



**City of Tualatin**  
**Stormwater Master Plan**

Date: August 2017  
Project: Project 149233





Notes:  
1. Projection: NAD 1983 State Plane Oregon North (feet)

**Figure 2**  
**Land Use**






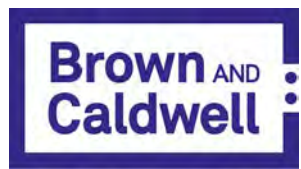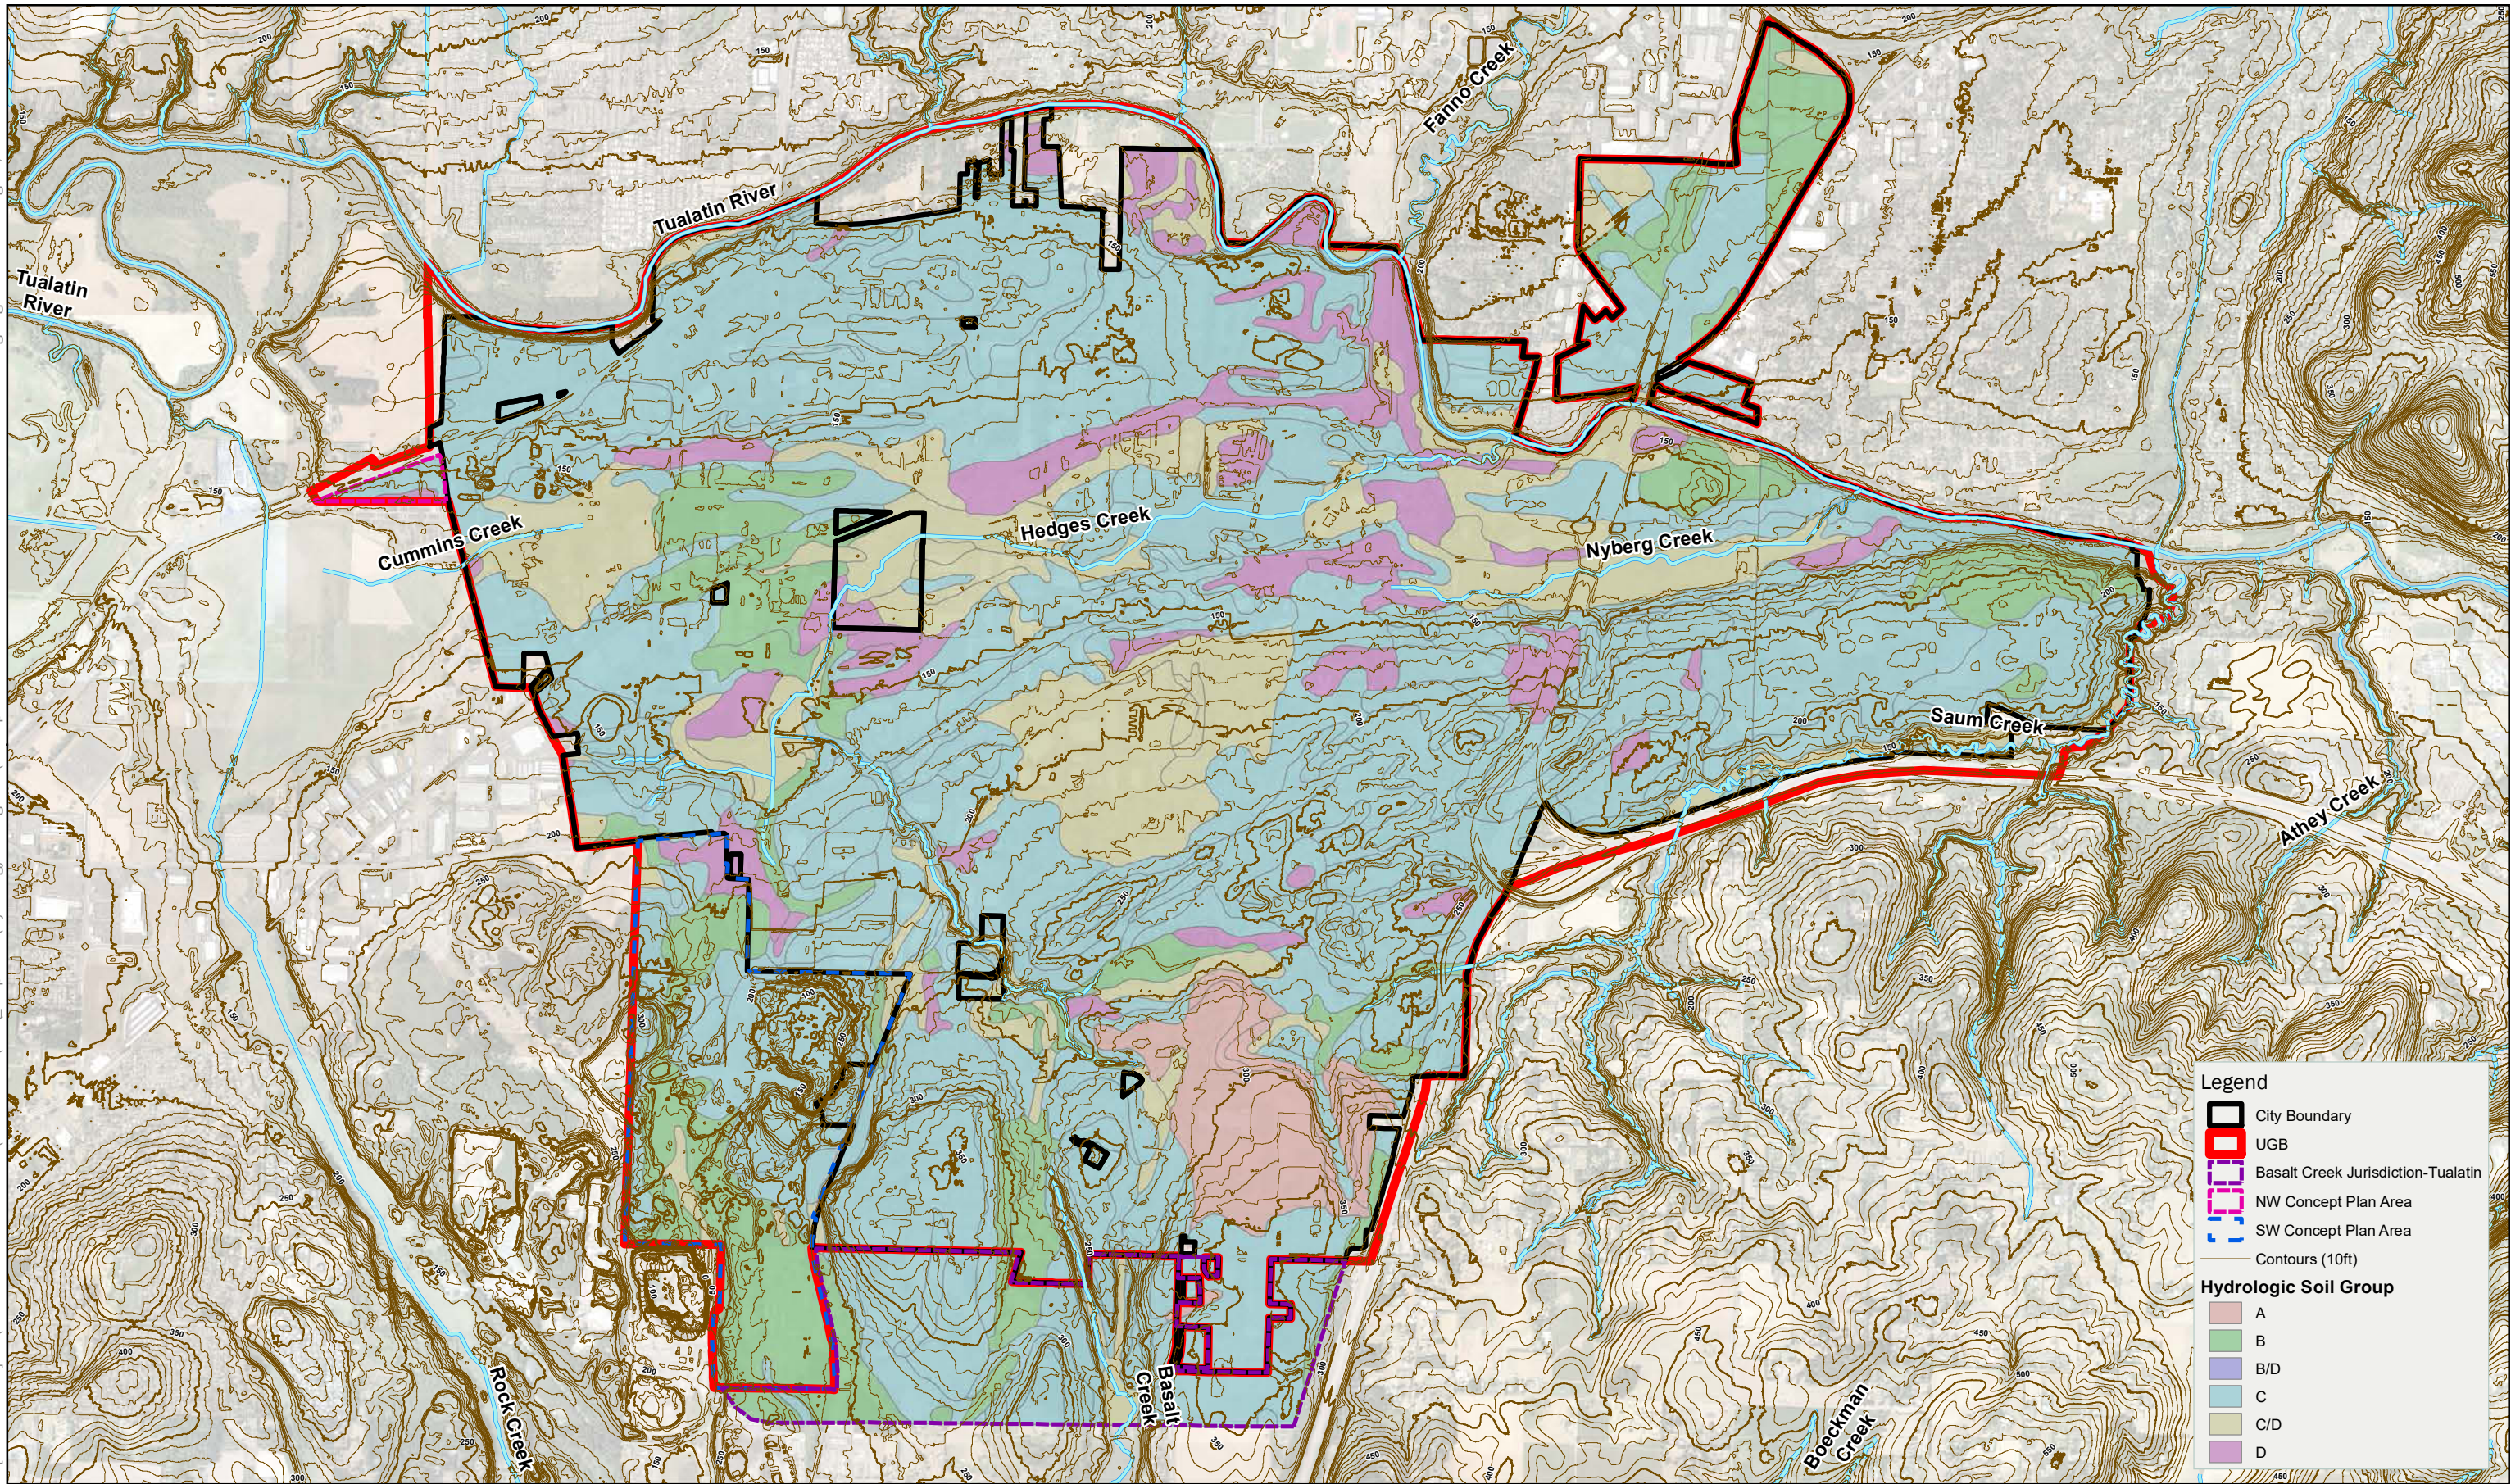

**City of Tualatin**  
**Stormwater Master Plan**

Date: August 2017  
Project: Project 149233




Notes:  
1. Projection: NAD 1983 State Plane Oregon North (feet)

**Figure 3**  
**Topography and Hydrologic Soil Group**



BCDENFP011: P:\149233 Tualatin SW MP\07 CAD-GIS\GIS\_MapDocs\Hydrology\TM Figures\HydraulicModel\SystemOverview\_11x17.mxd mgrzeorzewski Sep 13, 2018

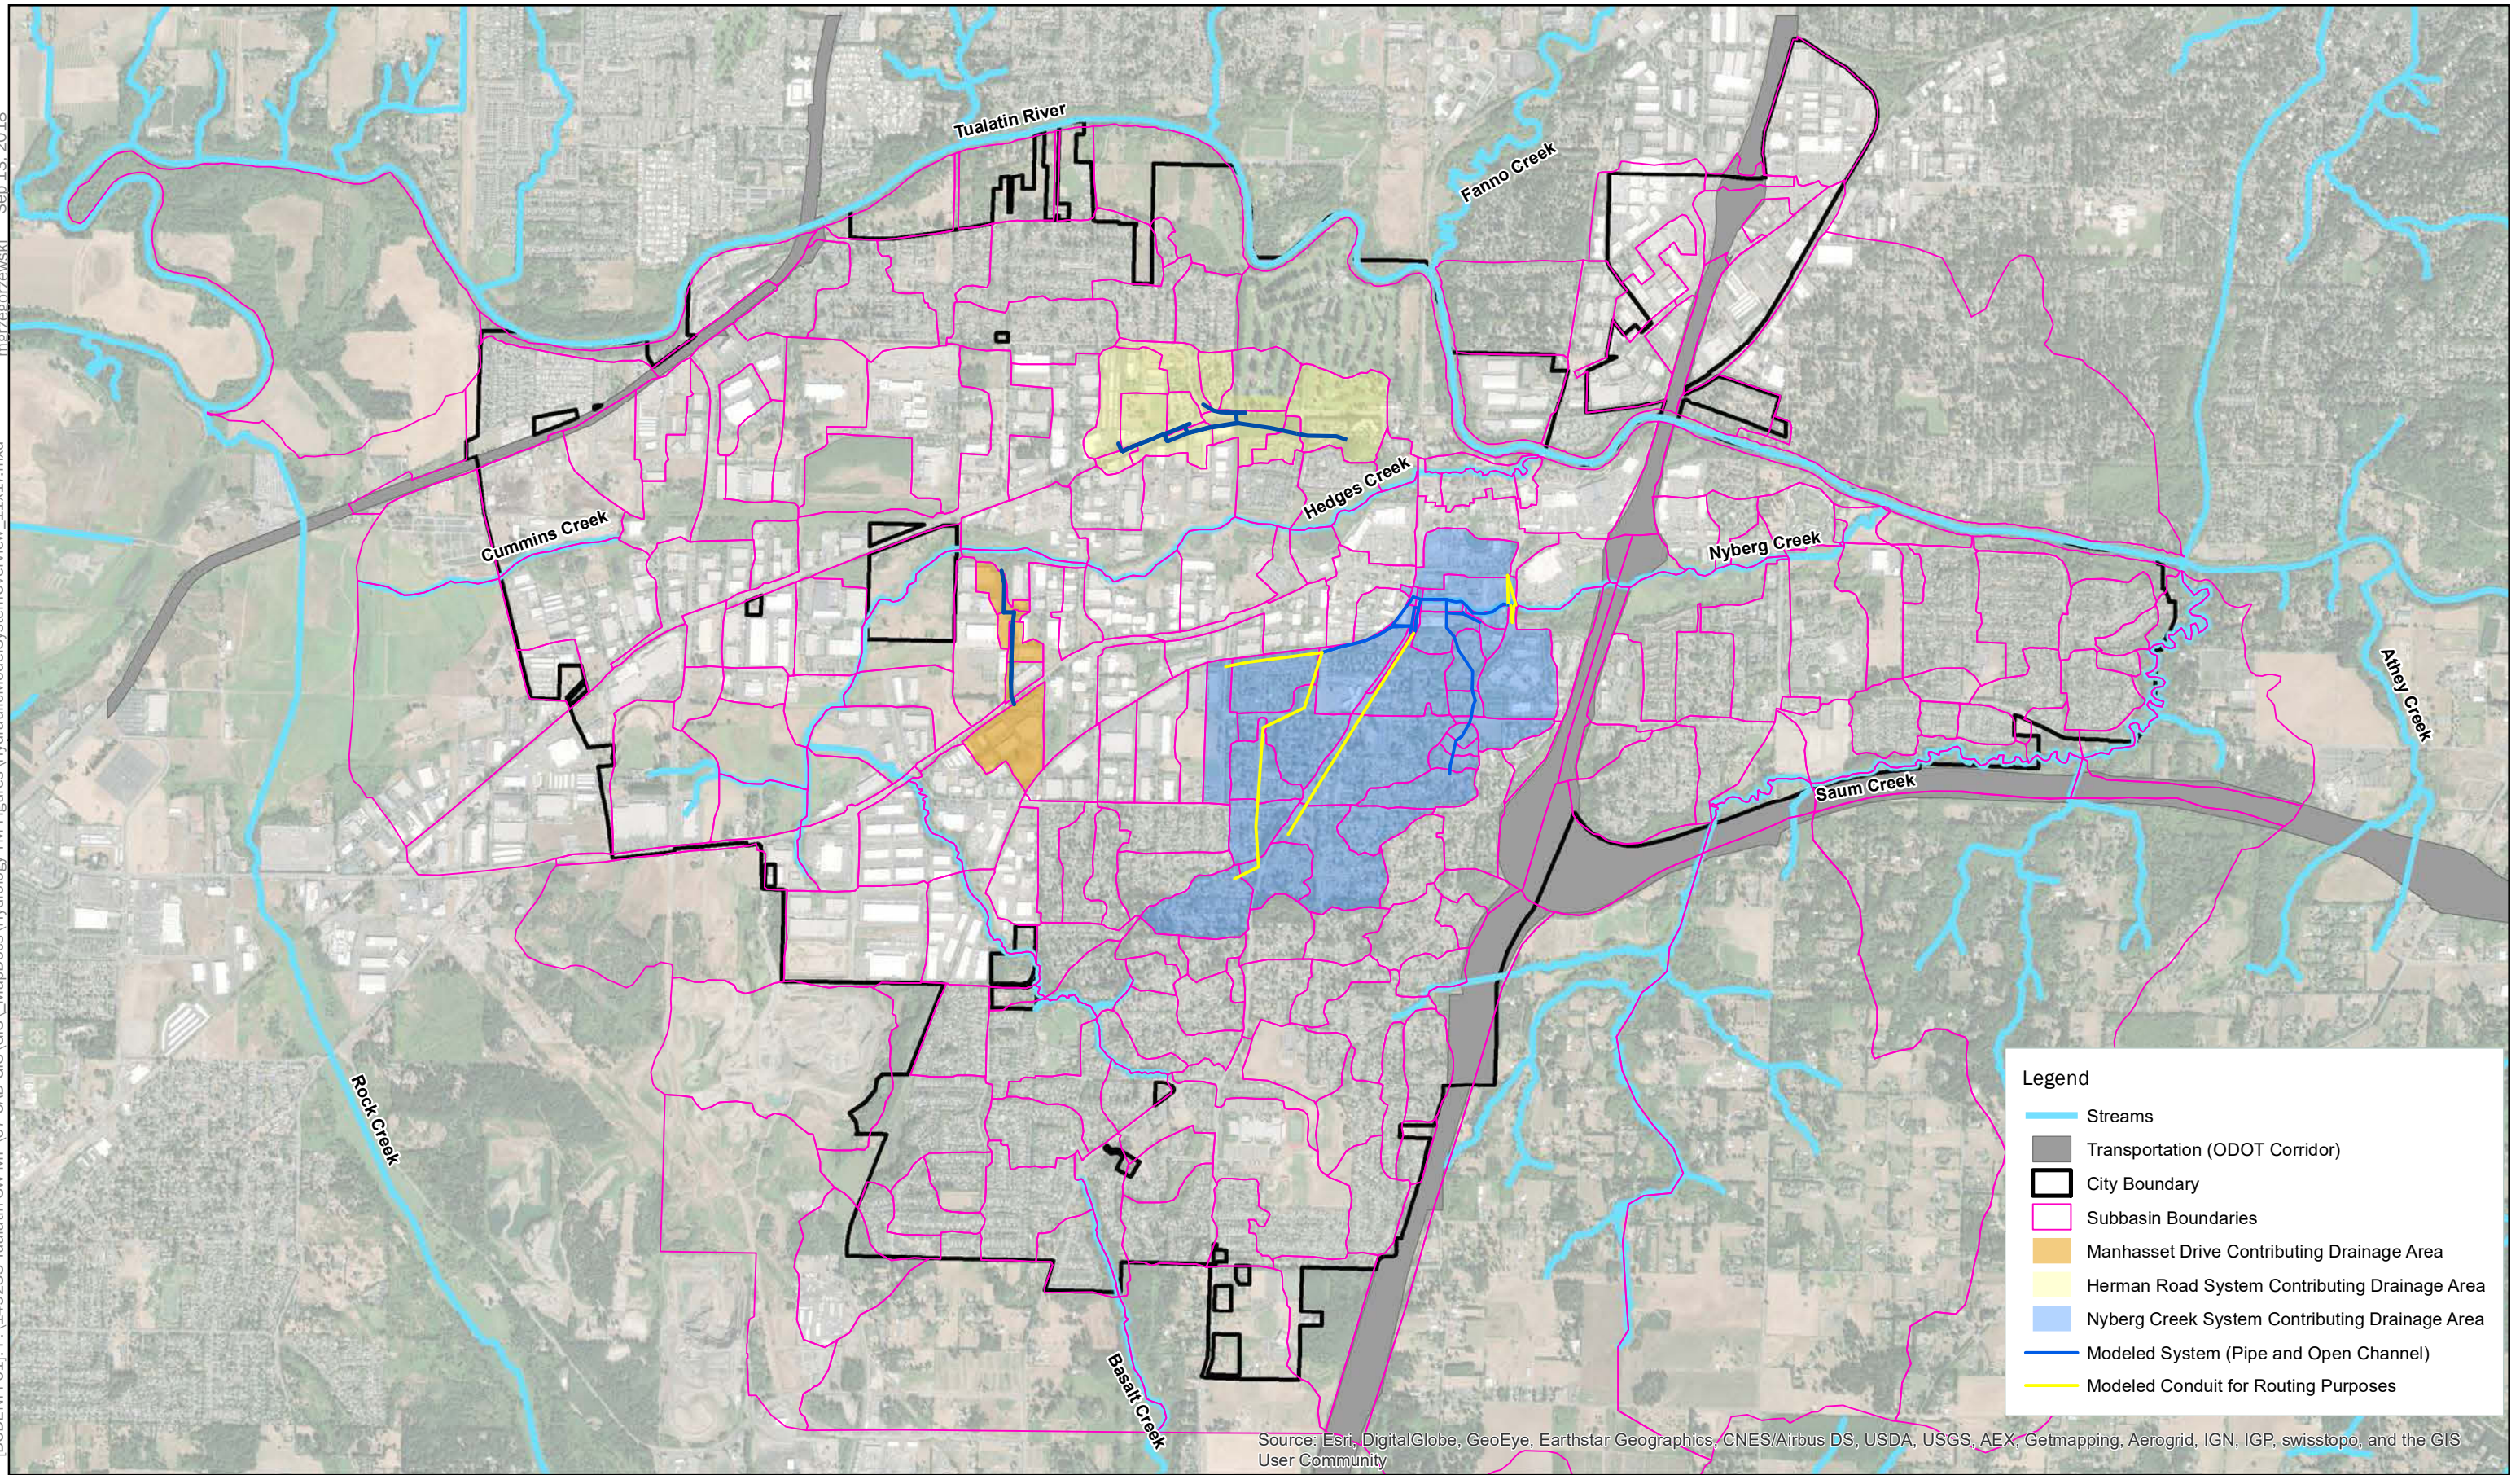


**Legend**

- Streams
- Transportation (ODOT Corridor)
- City Boundary
- Subbasin Boundaries
- Manhasset Drive Contributing Drainage Area
- Herman Road System Contributing Drainage Area
- Nyberg Creek System Contributing Drainage Area
- Modeled System (Pipe and Open Channel)
- Modeled Conduit for Routing Purposes



**City of Tualatin  
Stormwater Master Plan**


Date: August 2018  
Project: Project 149233



Notes:  
1. Projection: NAD 1983 State Plane Oregon North (feet)

**Figure 4  
Hydraulic Model System Overview**



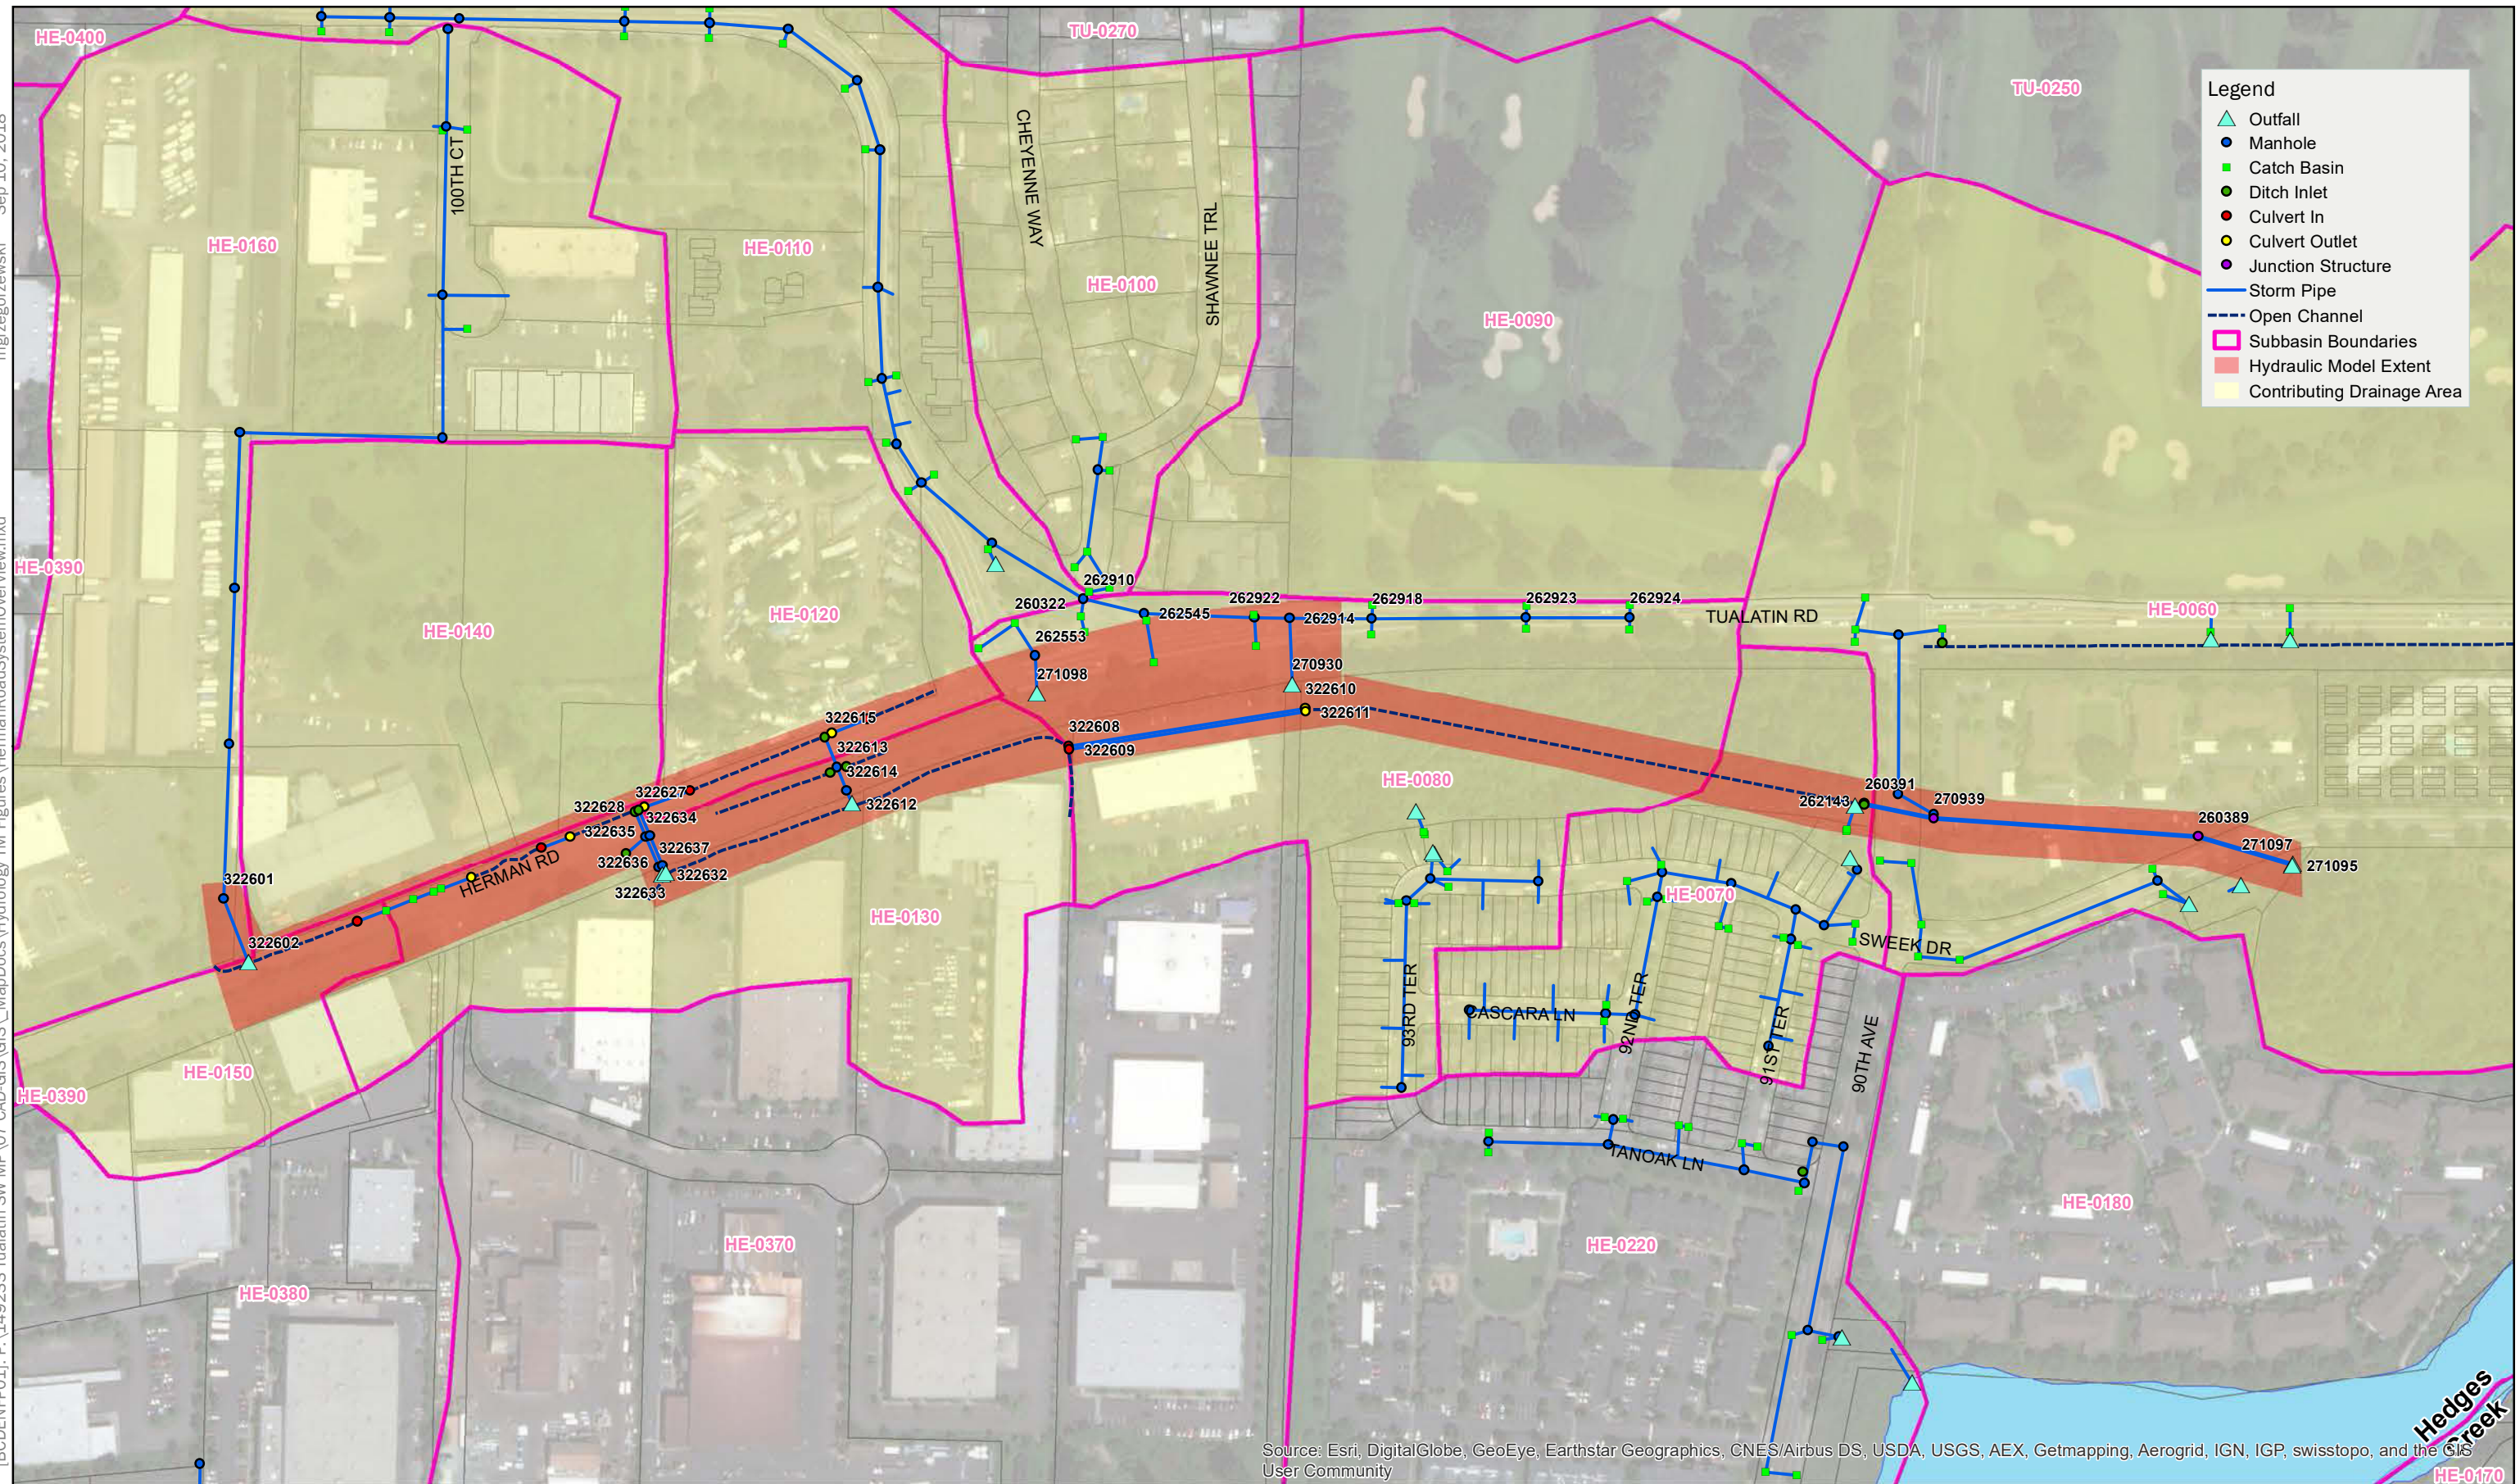


Source: Esri, DigitalGlobe, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AEX, Getmapping, Aerogrid, IGN, IGP, swisstopo, and the GIS User Community



**City of Tualatin**  
**Stormwater Master Plan**

Date: August 2018  
Project: Project 149233














Notes:  
1. Projection: NAD 1983 State Plane Oregon North (feet)

**Figure 5**  
**Hydraulic Modeling Extents**  
**Herman Road System**




**Legend**


-  Outfall
-  Manhole
-  Catch Basin
-  Ditch Inlet
-  Culvert In
-  Culvert Outlet
-  Storm Pipe
-  Open Channel
-  Subbasin Boundaries
-  Hydraulic Model Extent

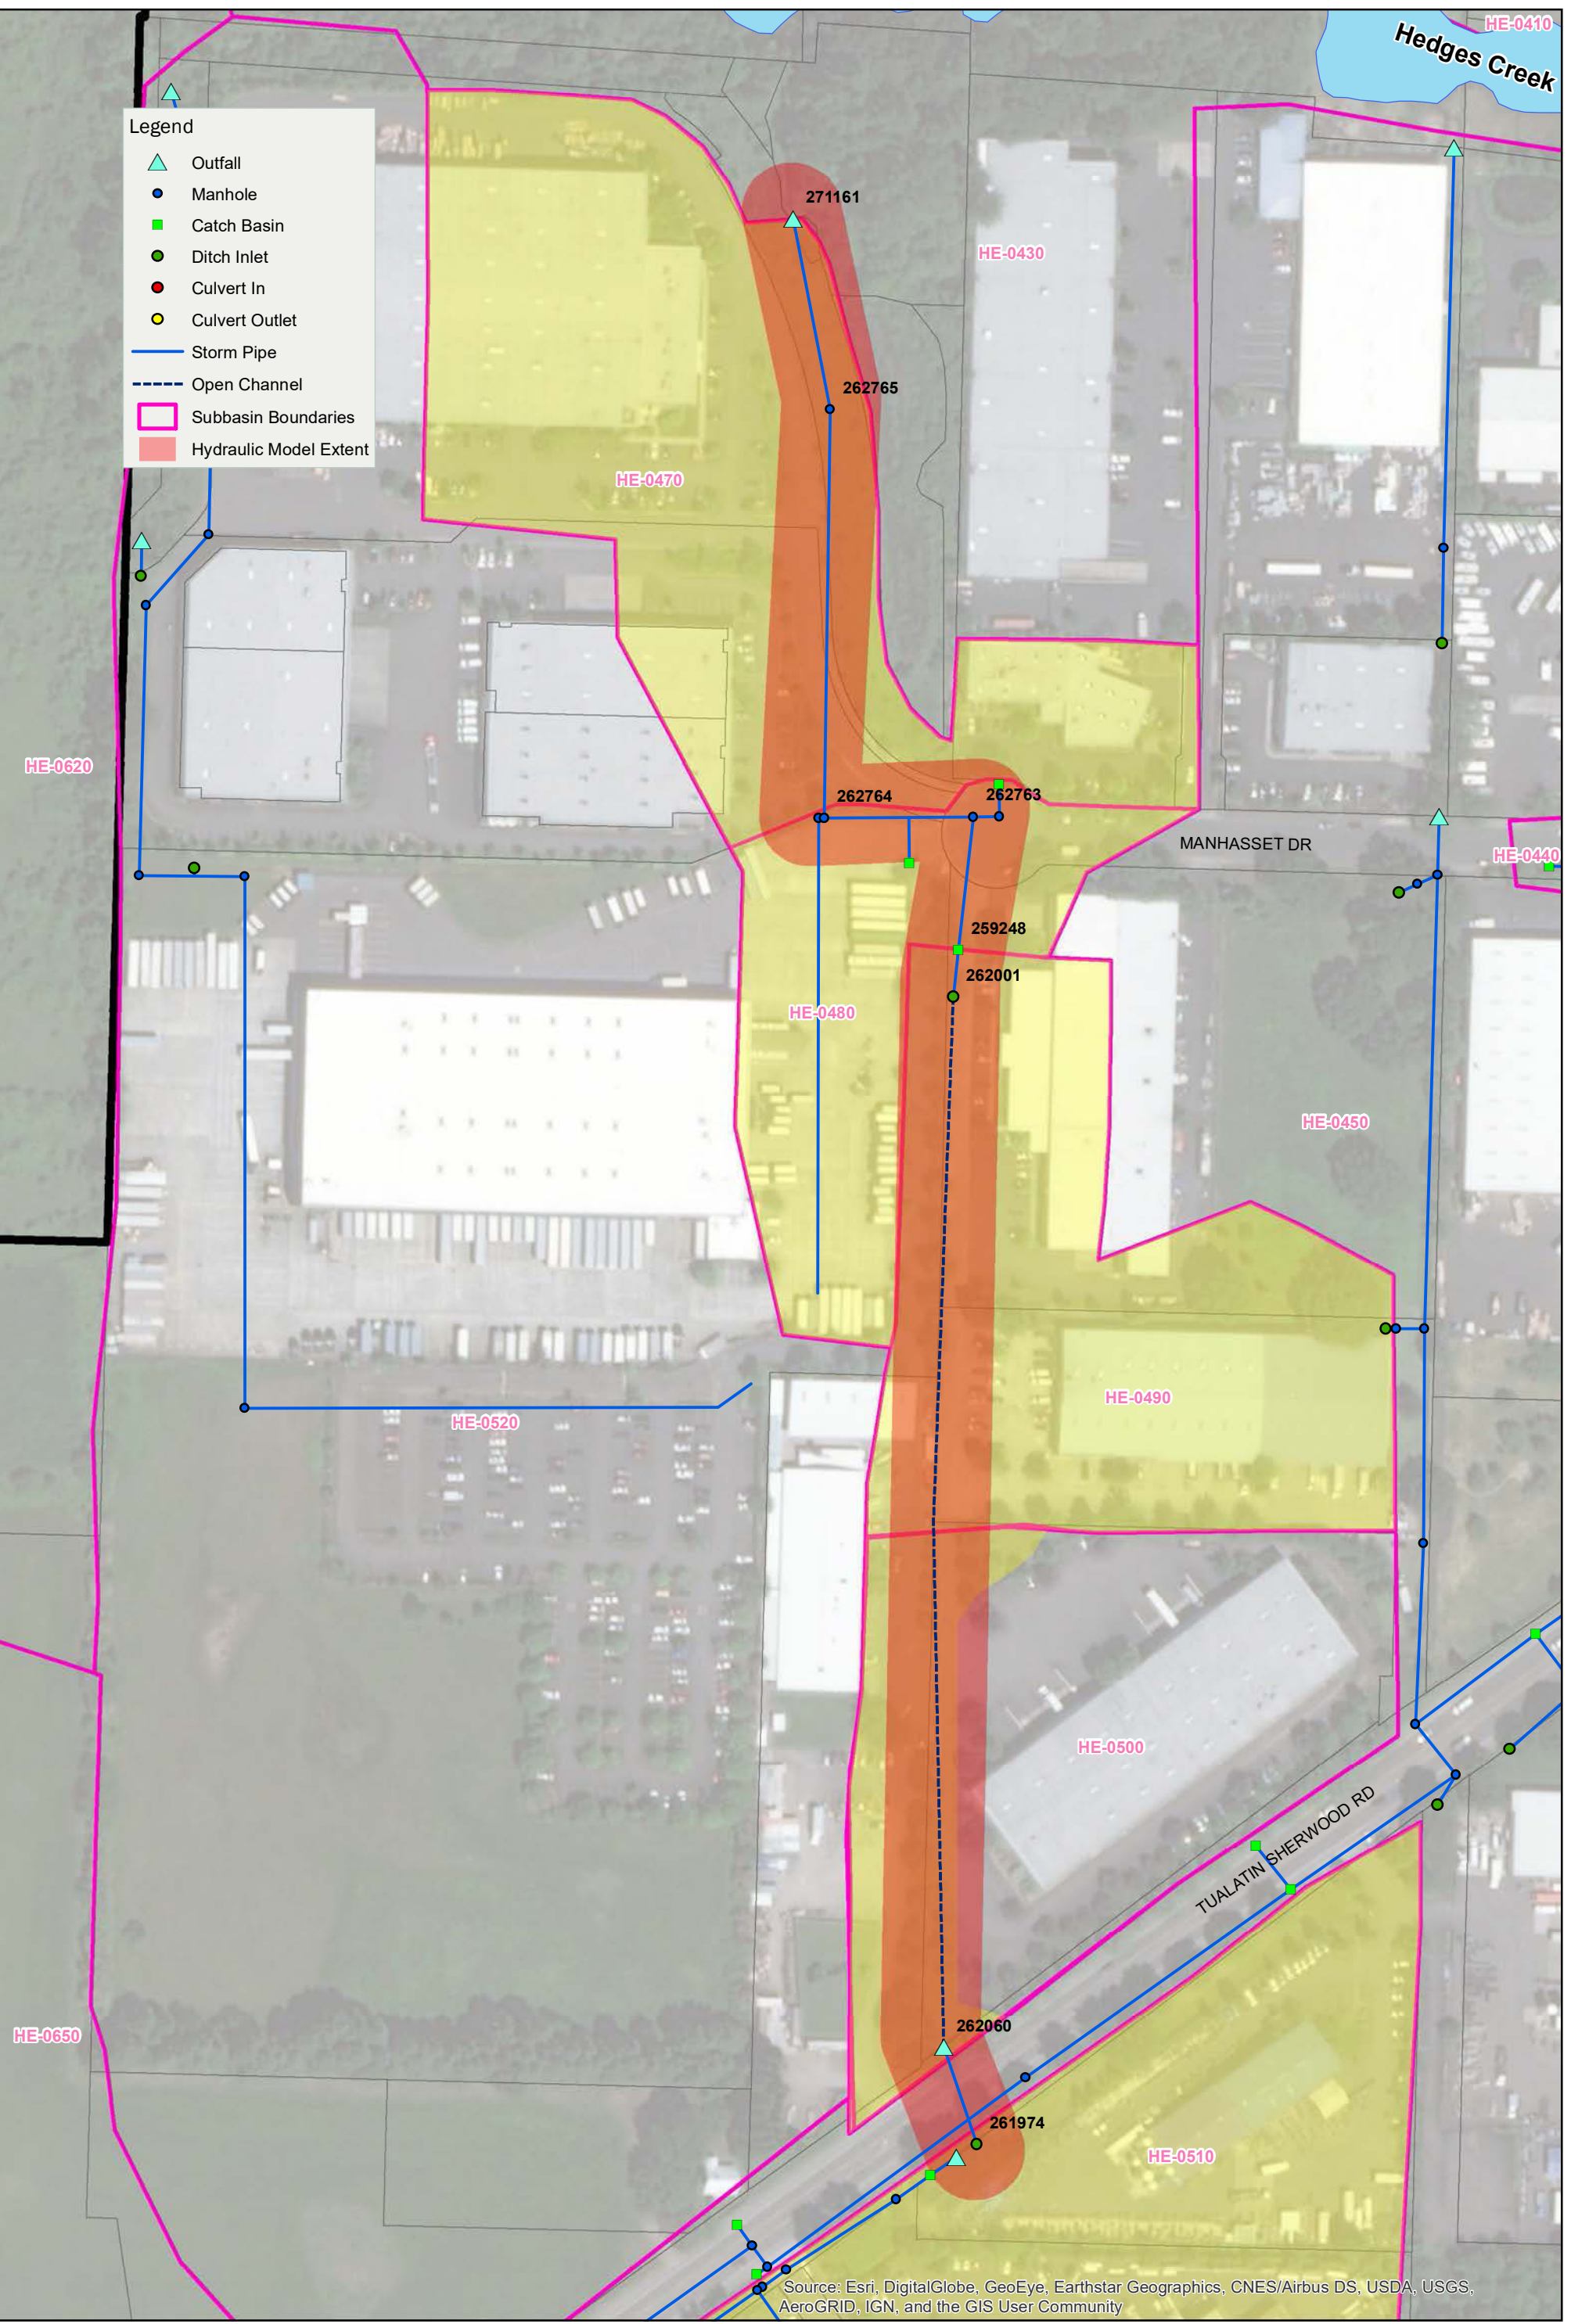

Source: Esri, DigitalGlobe, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community

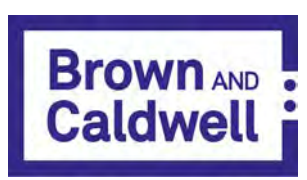


**City of Tualatin**  
**Stormwater Master Plan**  
 Date: August 2018  
 Project: Project 149233

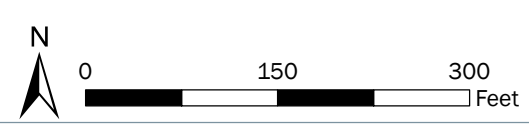

**Figure 6**  
**Hydraulic Modeling Extents**  
 Manhasset Drive System






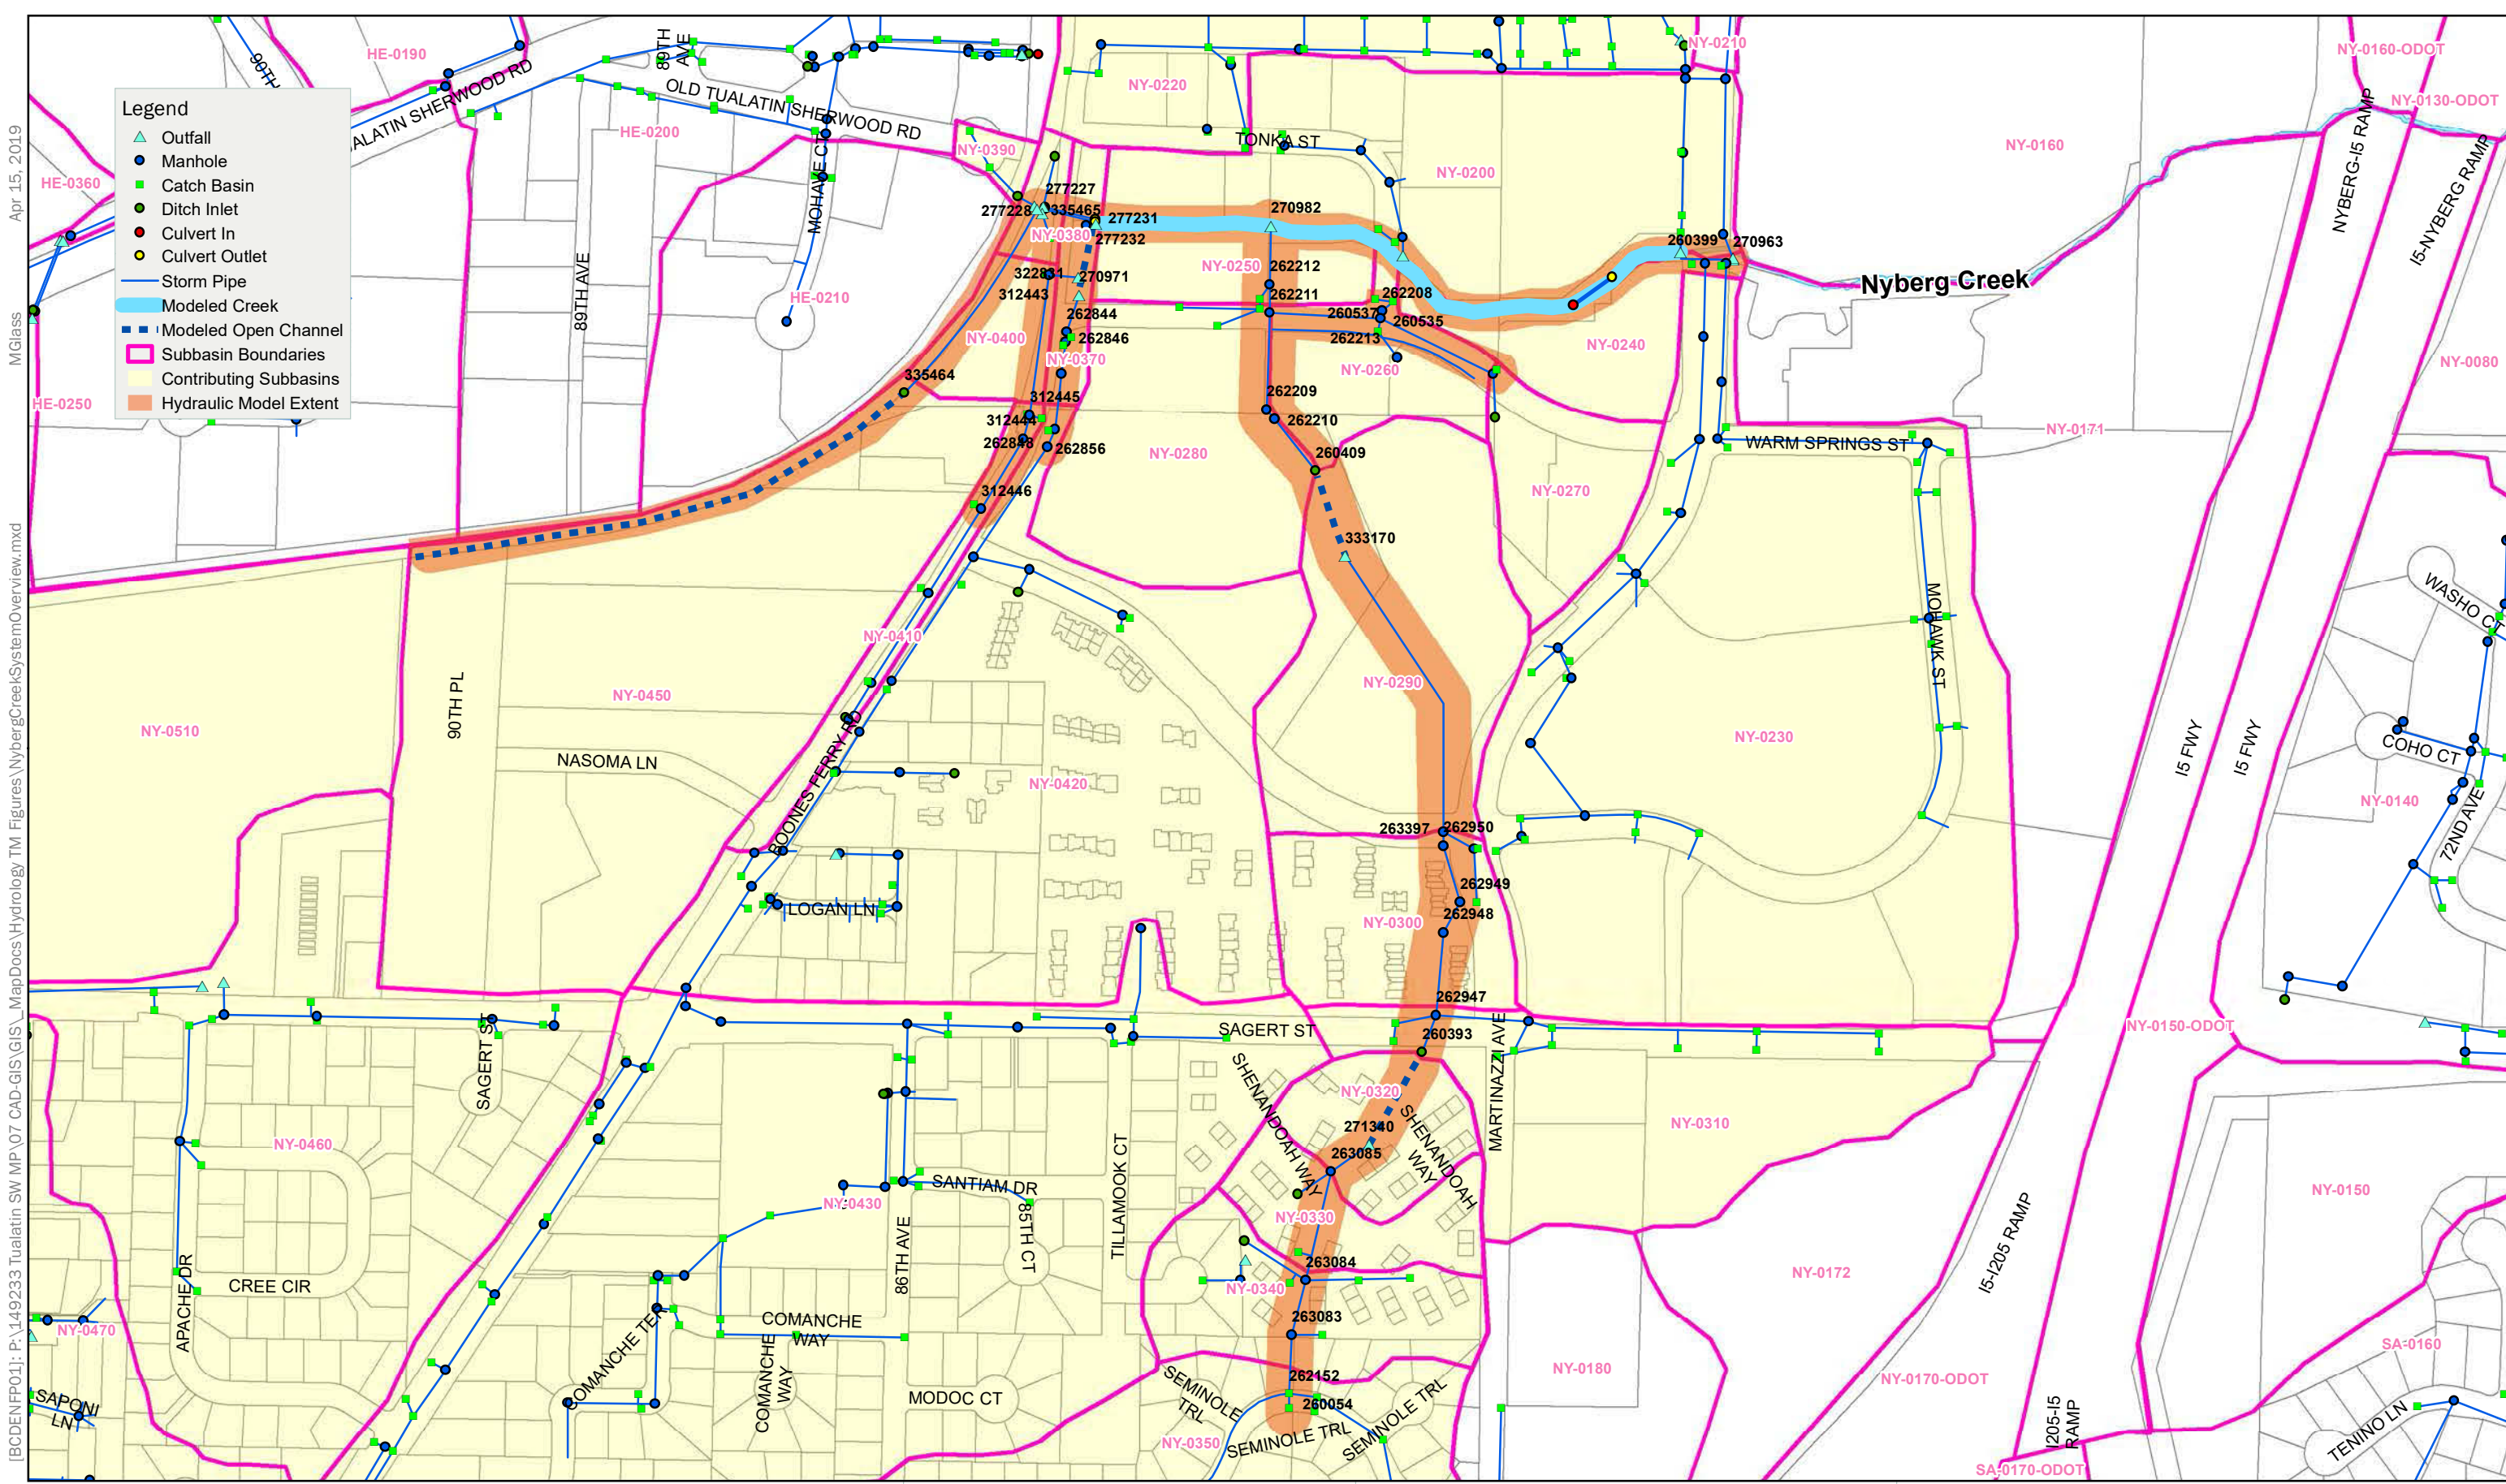


**Legend**

- ▲ Outfall
- Manhole
- Catch Basin
- Ditch Inlet
- Culvert In
- Culvert Outlet
- Storm Pipe
- Modeled Creek
- Modeled Open Channel
- Subbasin Boundaries
- Contributing Subbasins
- Hydraulic Model Extent

Apr 15, 2019  
 M:\Glass  
 [BCDENFP01]: P:\149233 Tualatin SW MP\07 CAD-GIS\GIS\_MapDocs\Hydrology\TM\_Figures\NybergCreekSystemOverview.mxd




**City of Tualatin**  
**Stormwater Master Plan**  
 Date: August 2017  
 Project: Project 149233



Notes:  
 1. Projection: NAD 1983 State Plane Oregon North (feet)

**Figure 7**  
**Hydraulic Modeling Extents**  
**Nyberg Creek System**



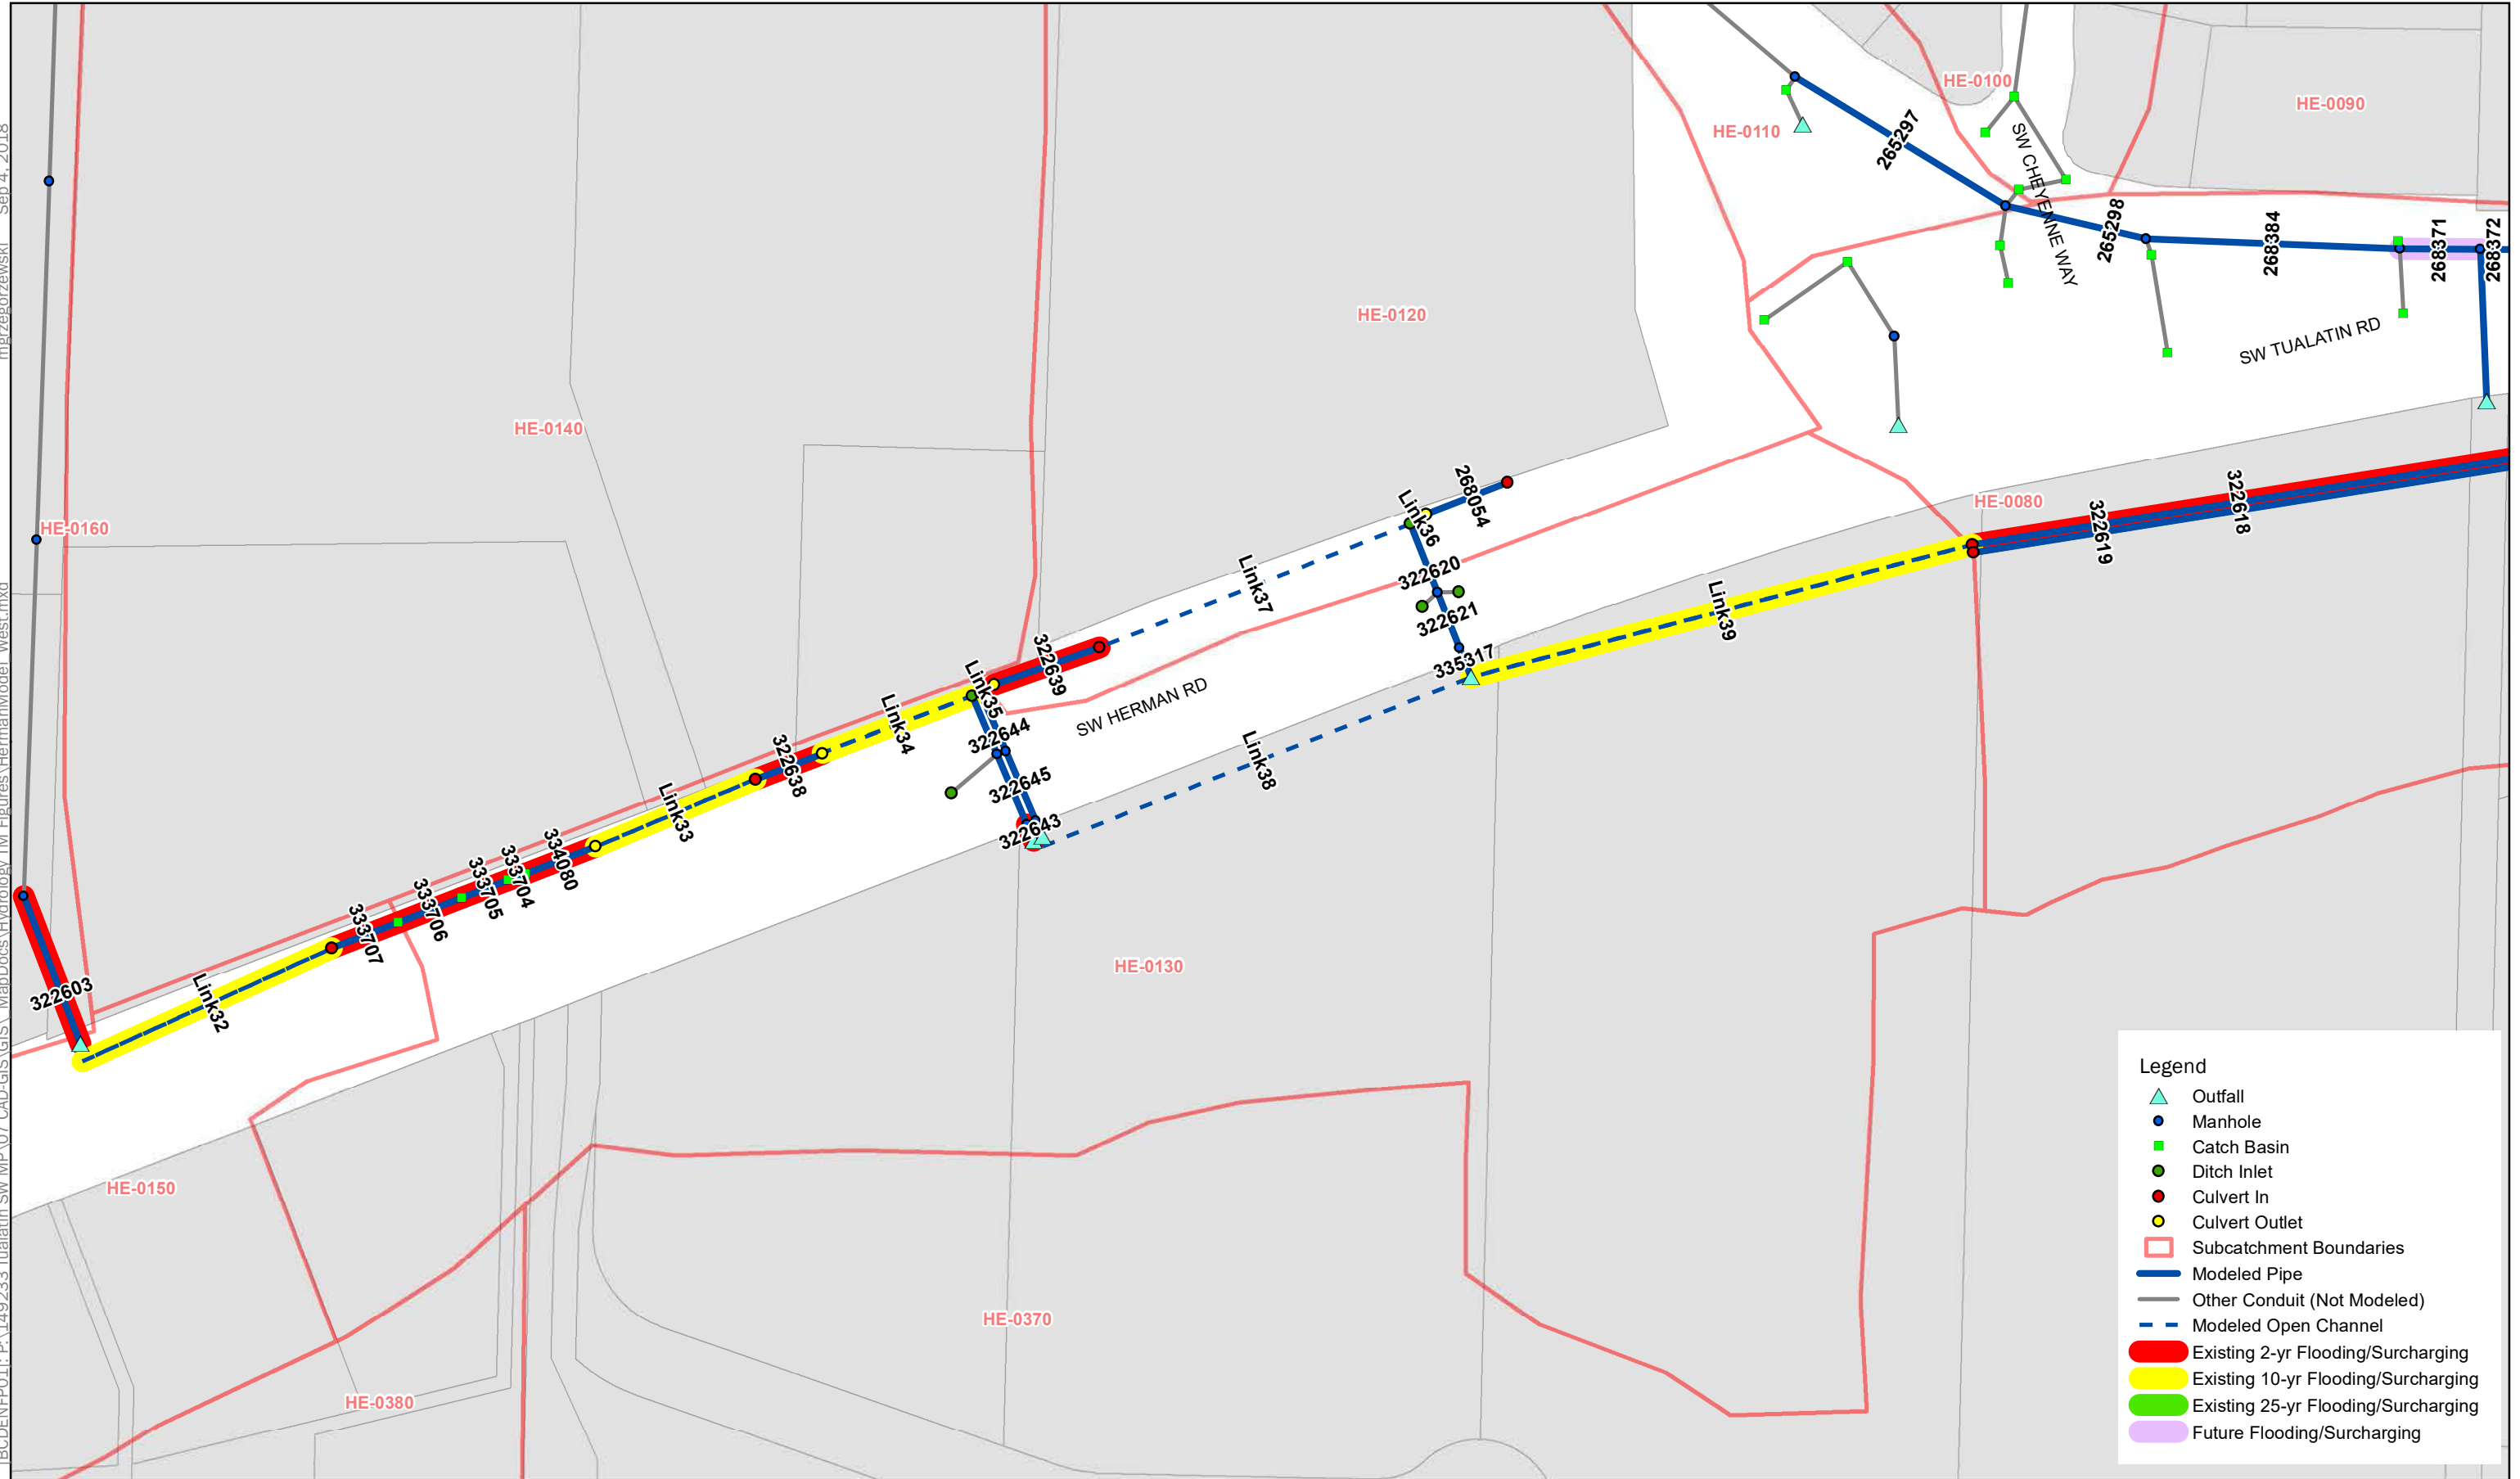


**Legend**

- Outfall
- Manhole
- Catch Basin
- Ditch Inlet
- Culvert In
- Culvert Outlet
- Subcatchment Boundaries
- Modeled Pipe
- Other Conduit (Not Modeled)
- Modeled Open Channel
- Existing 2-yr Flooding/Surcharging
- Existing 10-yr Flooding/Surcharging
- Existing 25-yr Flooding/Surcharging
- Future Flooding/Surcharging



**City of Tualatin**  
**Stormwater Master Plan**


Date: August 2018  
 Project: Project 149233

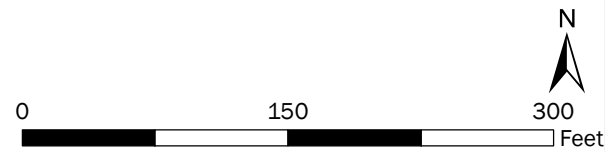

Notes:  
 1. Projection: NAD 1983 State Plane Oregon North (feet)

**Figure 8**  
**Hydraulic Modeling Results**  
**Herman Road System-West**



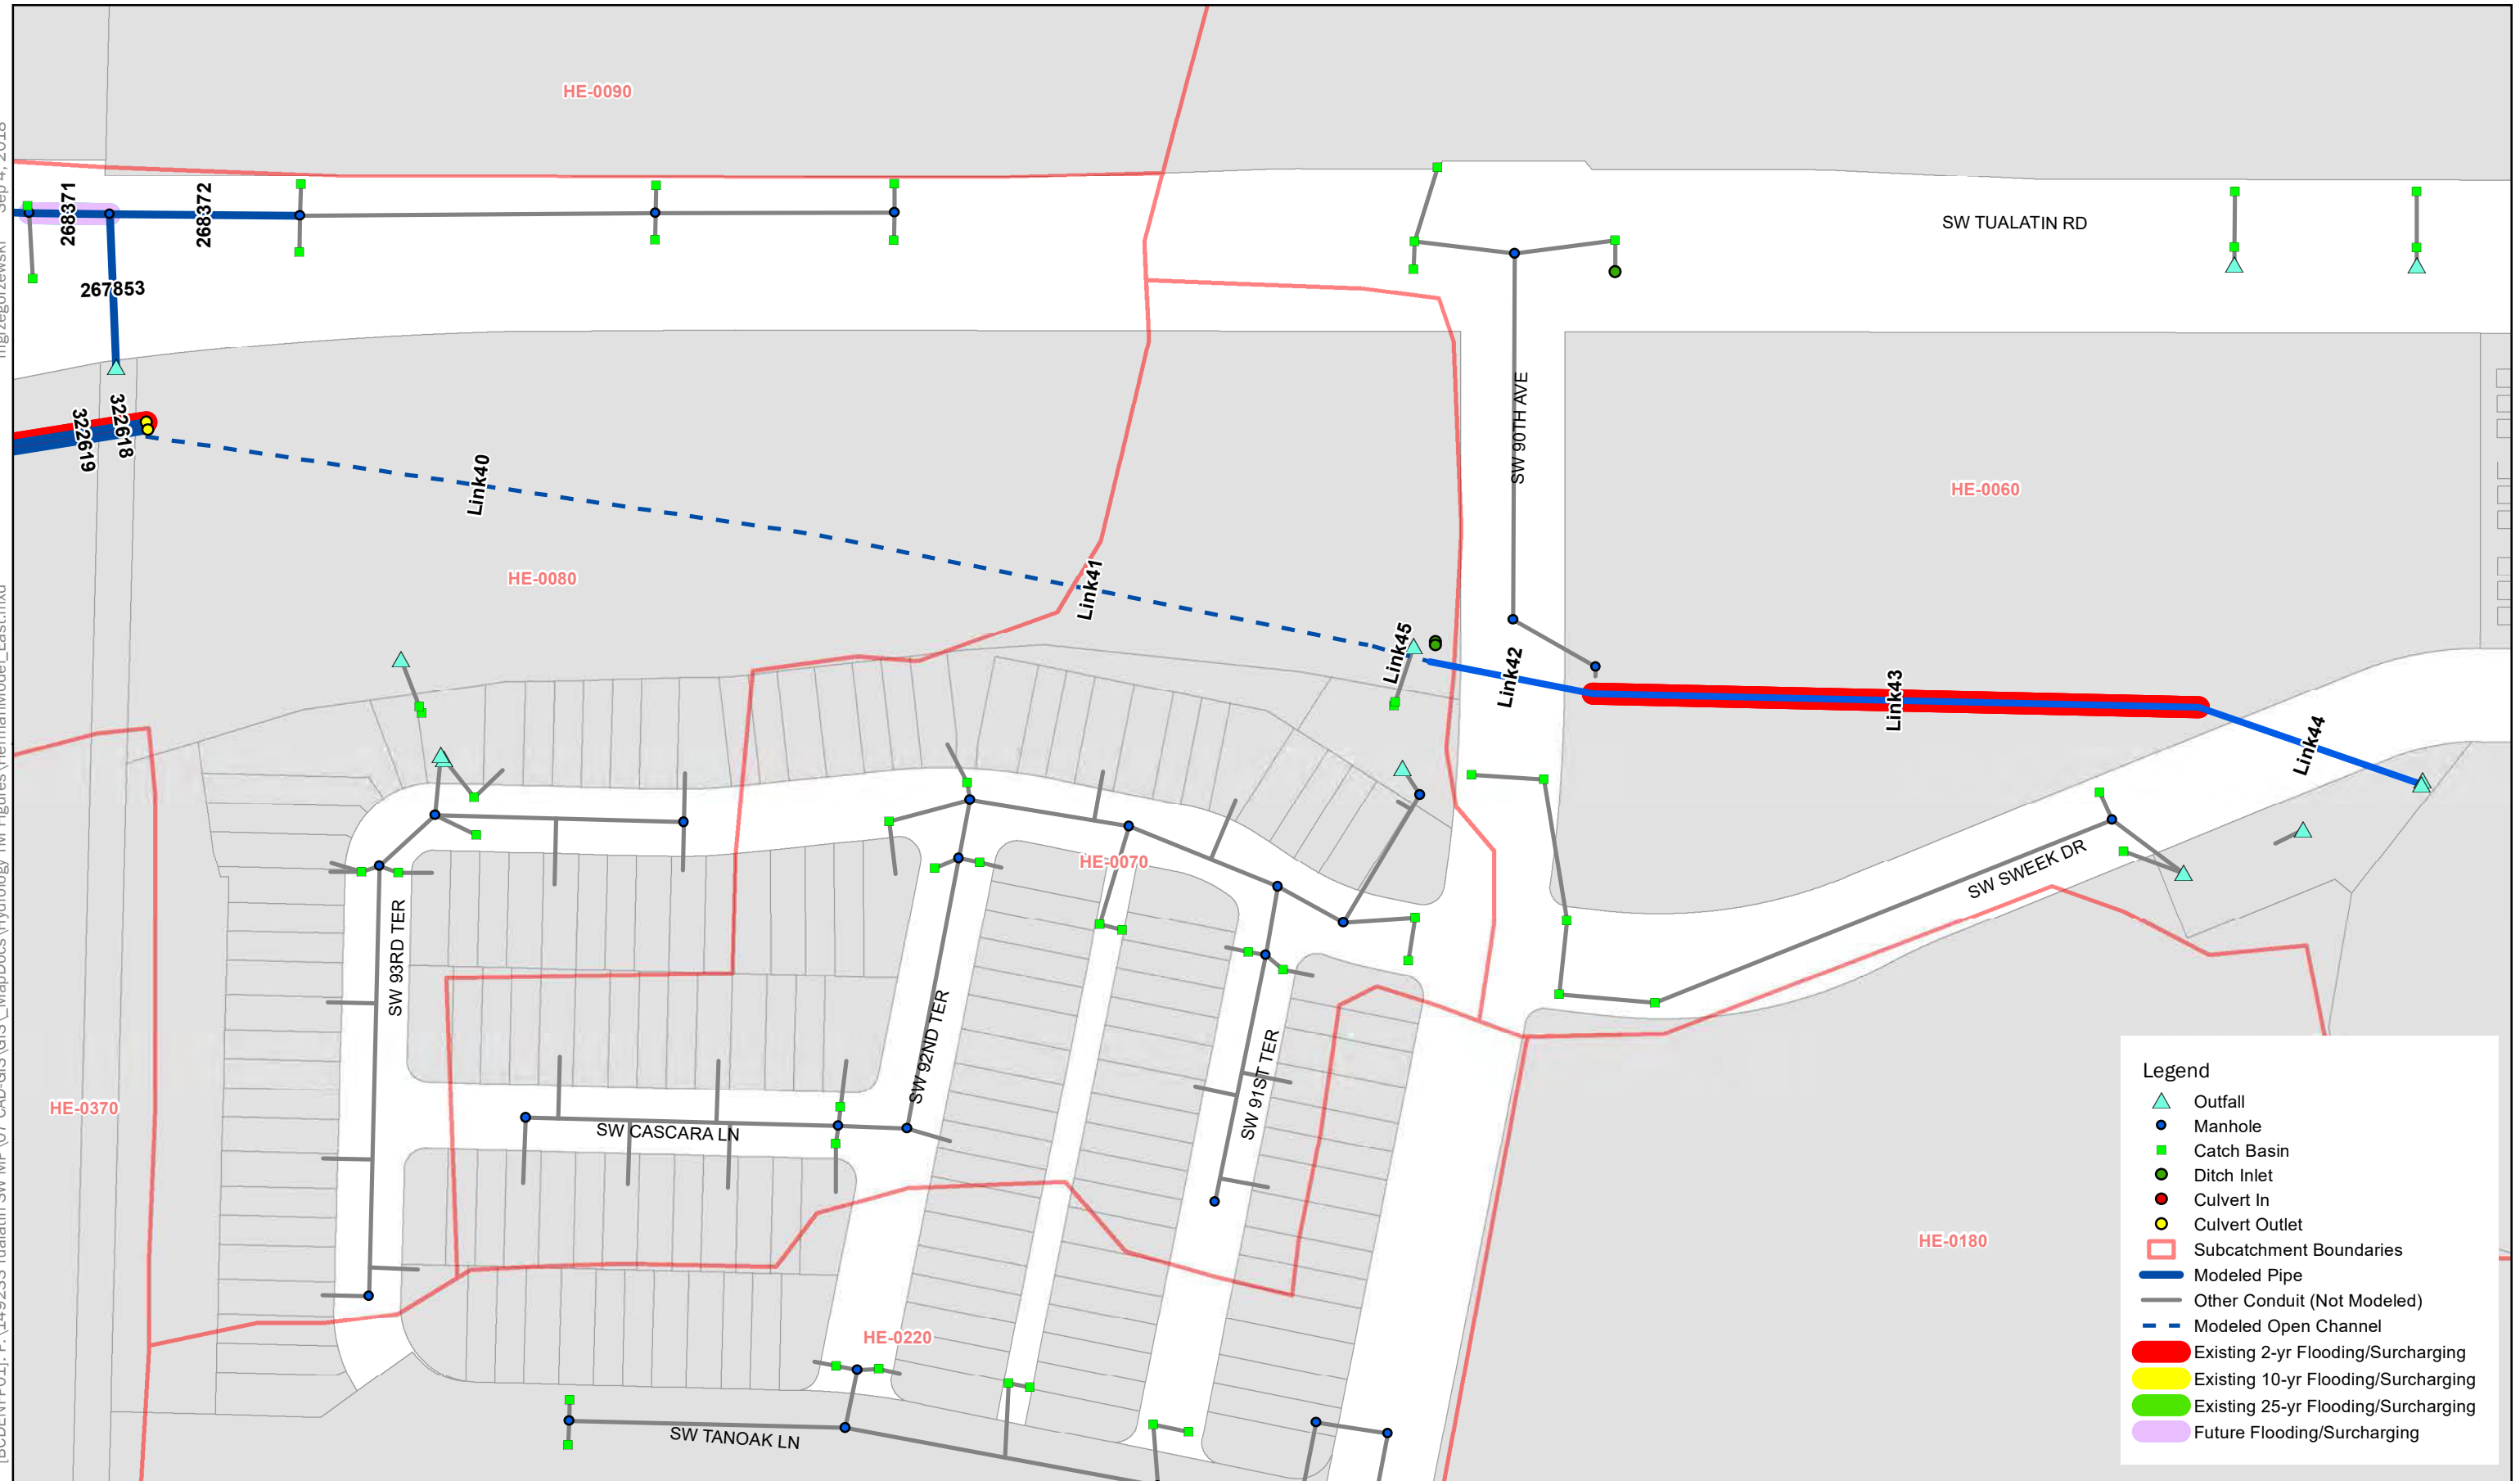

**Legend**


- Outfall
- Manhole
- Catch Basin
- Ditch Inlet
- Culvert In
- Culvert Outlet
- Subcatchment Boundaries
- Modeled Pipe
- Other Conduit (Not Modeled)
- Modeled Open Channel
- Existing 2-yr Flooding/Surcharging
- Existing 10-yr Flooding/Surcharging
- Existing 25-yr Flooding/Surcharging
- Future Flooding/Surcharging

Notes:  
 1. Projection: NAD 1983 State Plane Oregon North (feet)  
 2. Due to the very low slope of Link43, the calculated design flow is artificially low. No surcharging is occurring in this pipe despite maximum flow surpassing design flow beginning at the 2-year event.




**City of Tualatin  
Stormwater Master Plan**

Date: August 2018  
 Project: Project 149233

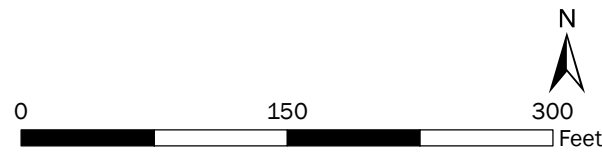

**Figure 9  
Hydraulic Modeling Results  
Herman Road System-East**



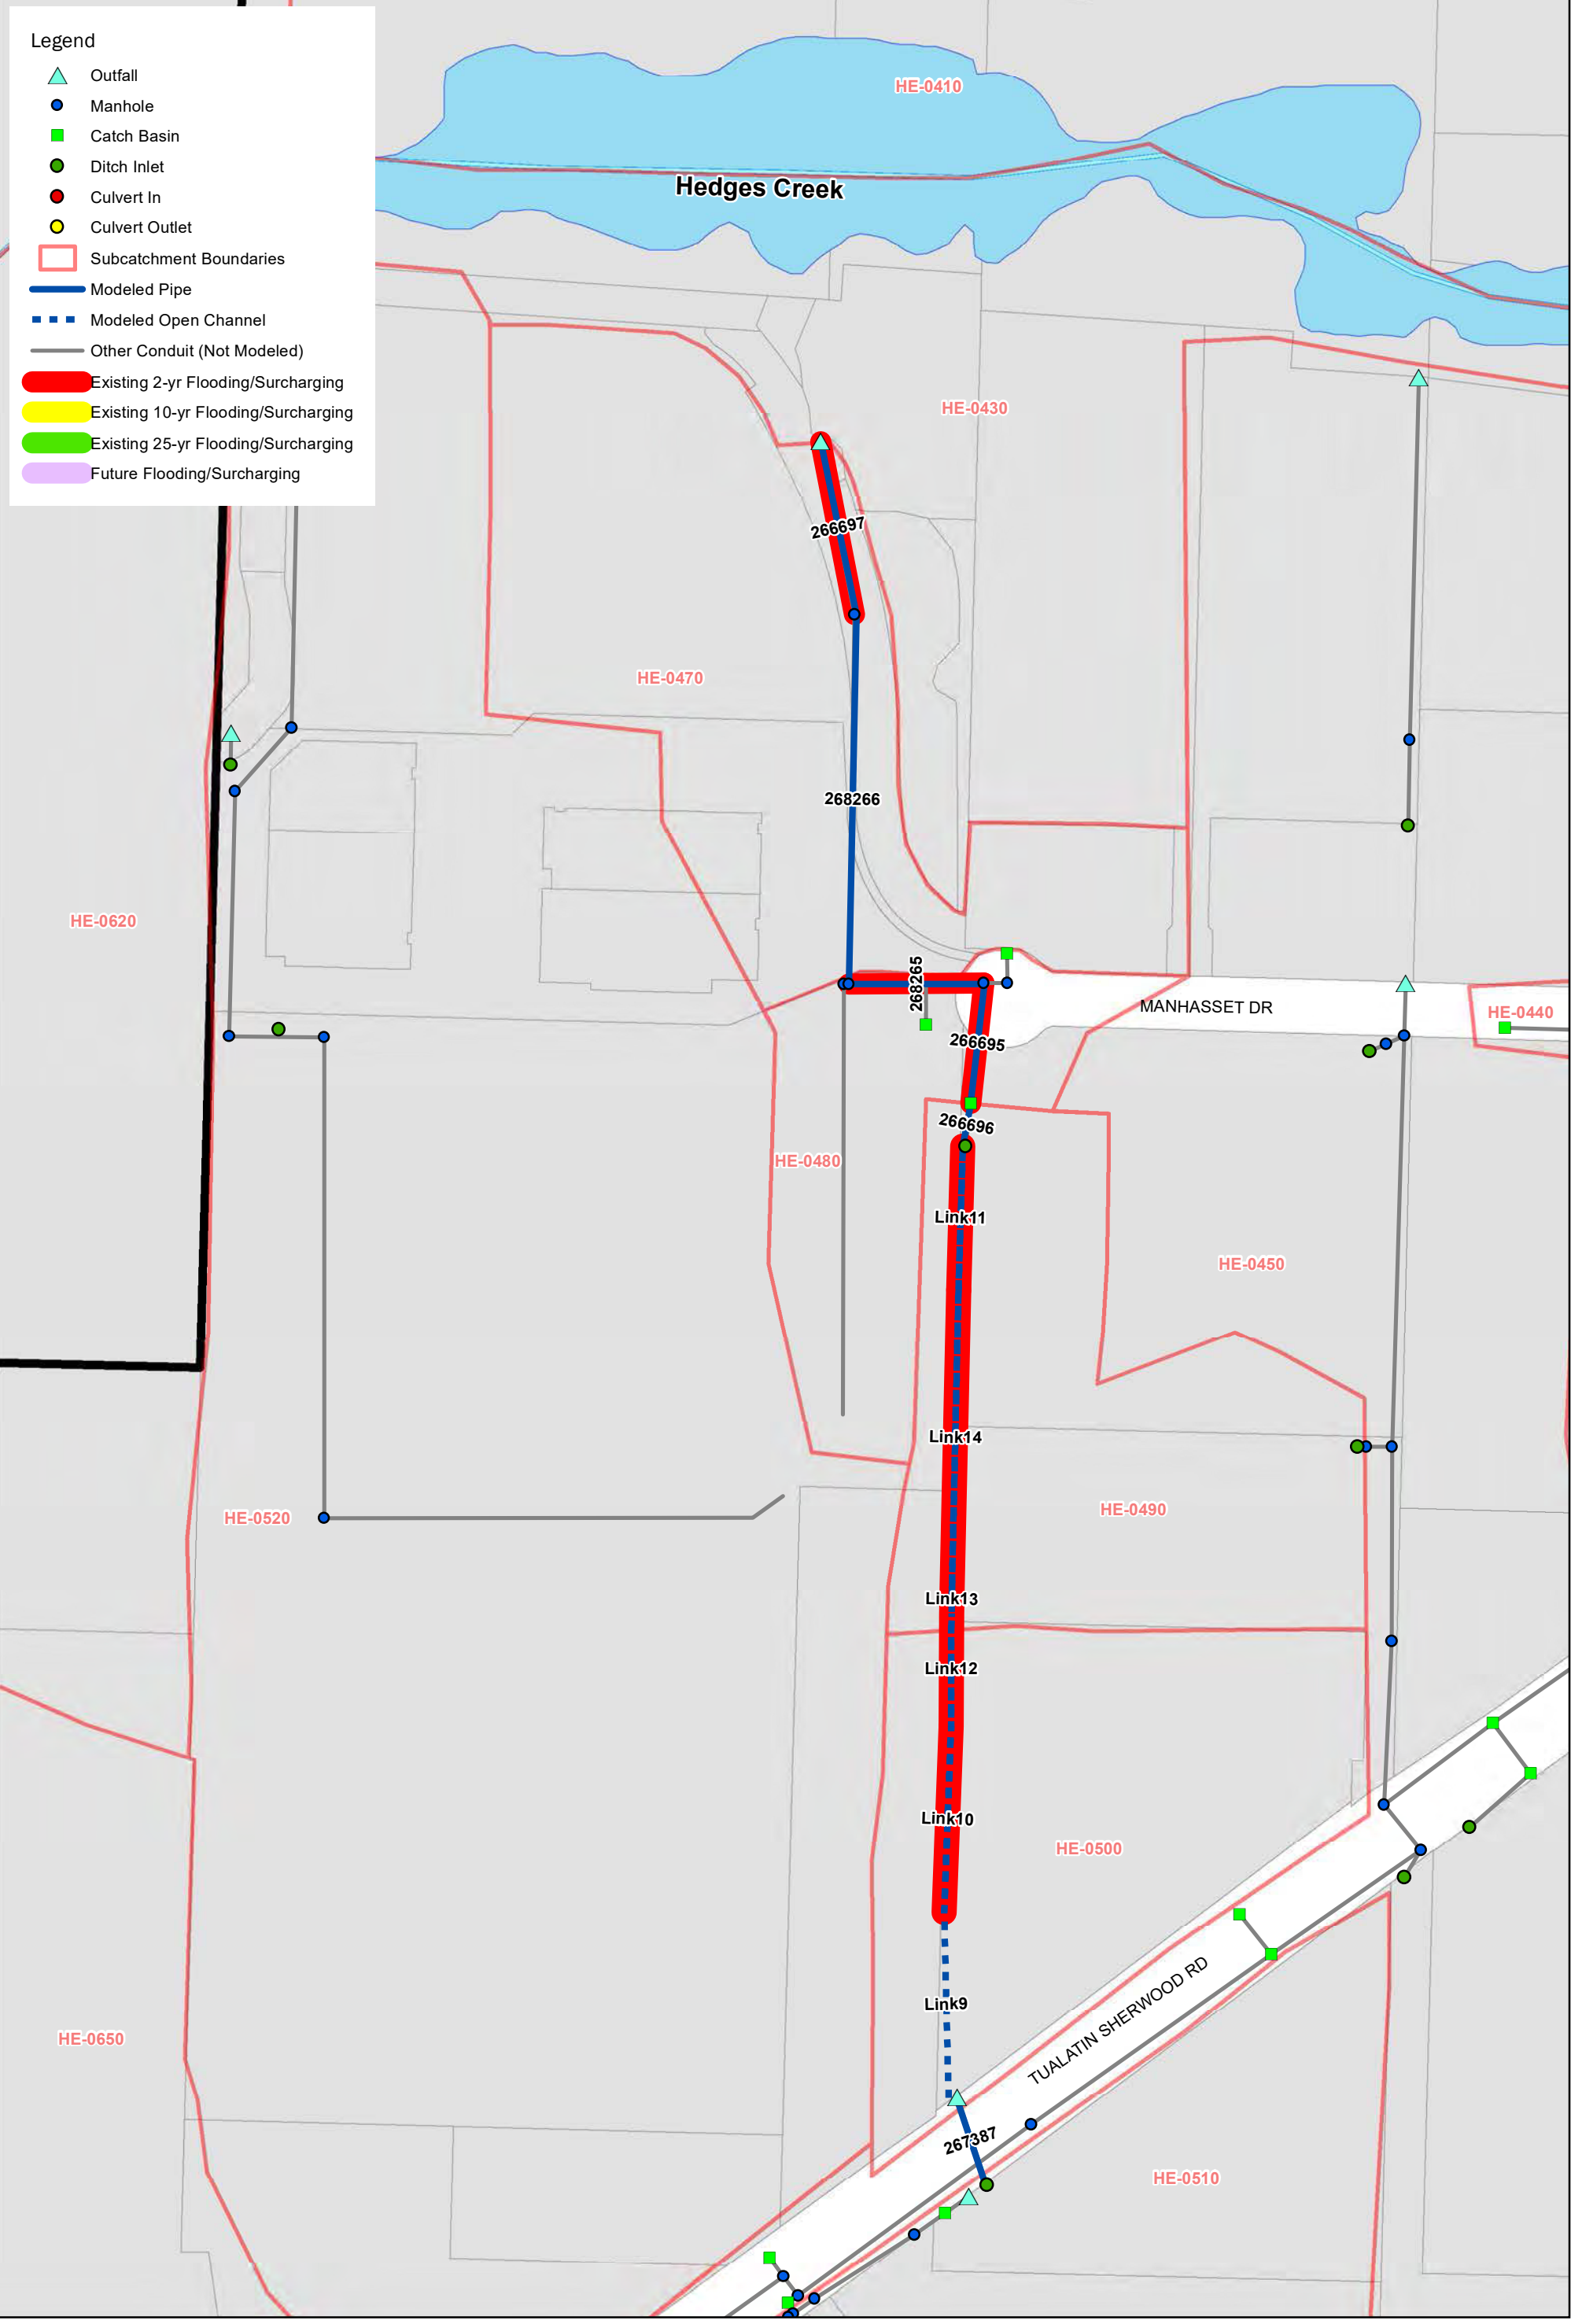

**Legend**

- ▲ Outfall
- Manhole
- Catch Basin
- Ditch Inlet
- Culvert In
- Culvert Outlet
- Subcatchment Boundaries
- Modeled Pipe
- - - Modeled Open Channel
- Other Conduit (Not Modeled)
- Existing 2-yr Flooding/Surcharging
- Existing 10-yr Flooding/Surcharging
- Existing 25-yr Flooding/Surcharging
- Future Flooding/Surcharging

HE-0620

HE-0470

HE-0410

HE-0430

HE-0480

HE-0450

HE-0520

HE-0490

HE-0650

HE-0500

HE-0510

HE-0440

266697

268266

268265

266695

266696

Link11

Link14

Link13

Link12


Link10

Link9


267387

MANHASSET DR

TUALATIN SHERWOOD RD



City of Tualatin  
**Stormwater Master Plan**  
 Date: August 2017  
 Project: Project 149233

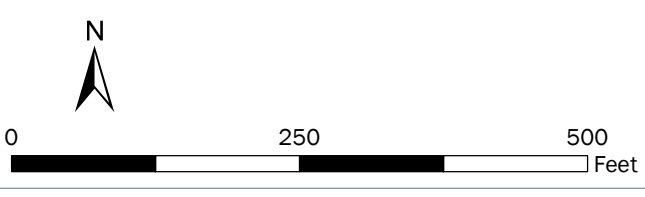


**Figure 10**  
**Hydraulic Modeling Results**  
**Manhasset Drive System**





**Legend**

- ▲ Outfall
- Manhole
- Catch Basin
- Ditch Inlet
- Culvert In
- Culvert Outlet
- Subcatchment Boundaries
- Modeled Pipe
- Modeled Open Channel
- Modeled Creek
- Other Conduit (Not Modeled)
- Existing 2-yr Flooding/Surcharging
- Existing 10-yr Flooding/Surcharging
- Existing 25-yr Flooding/Surcharging
- Future Flooding/Surcharging

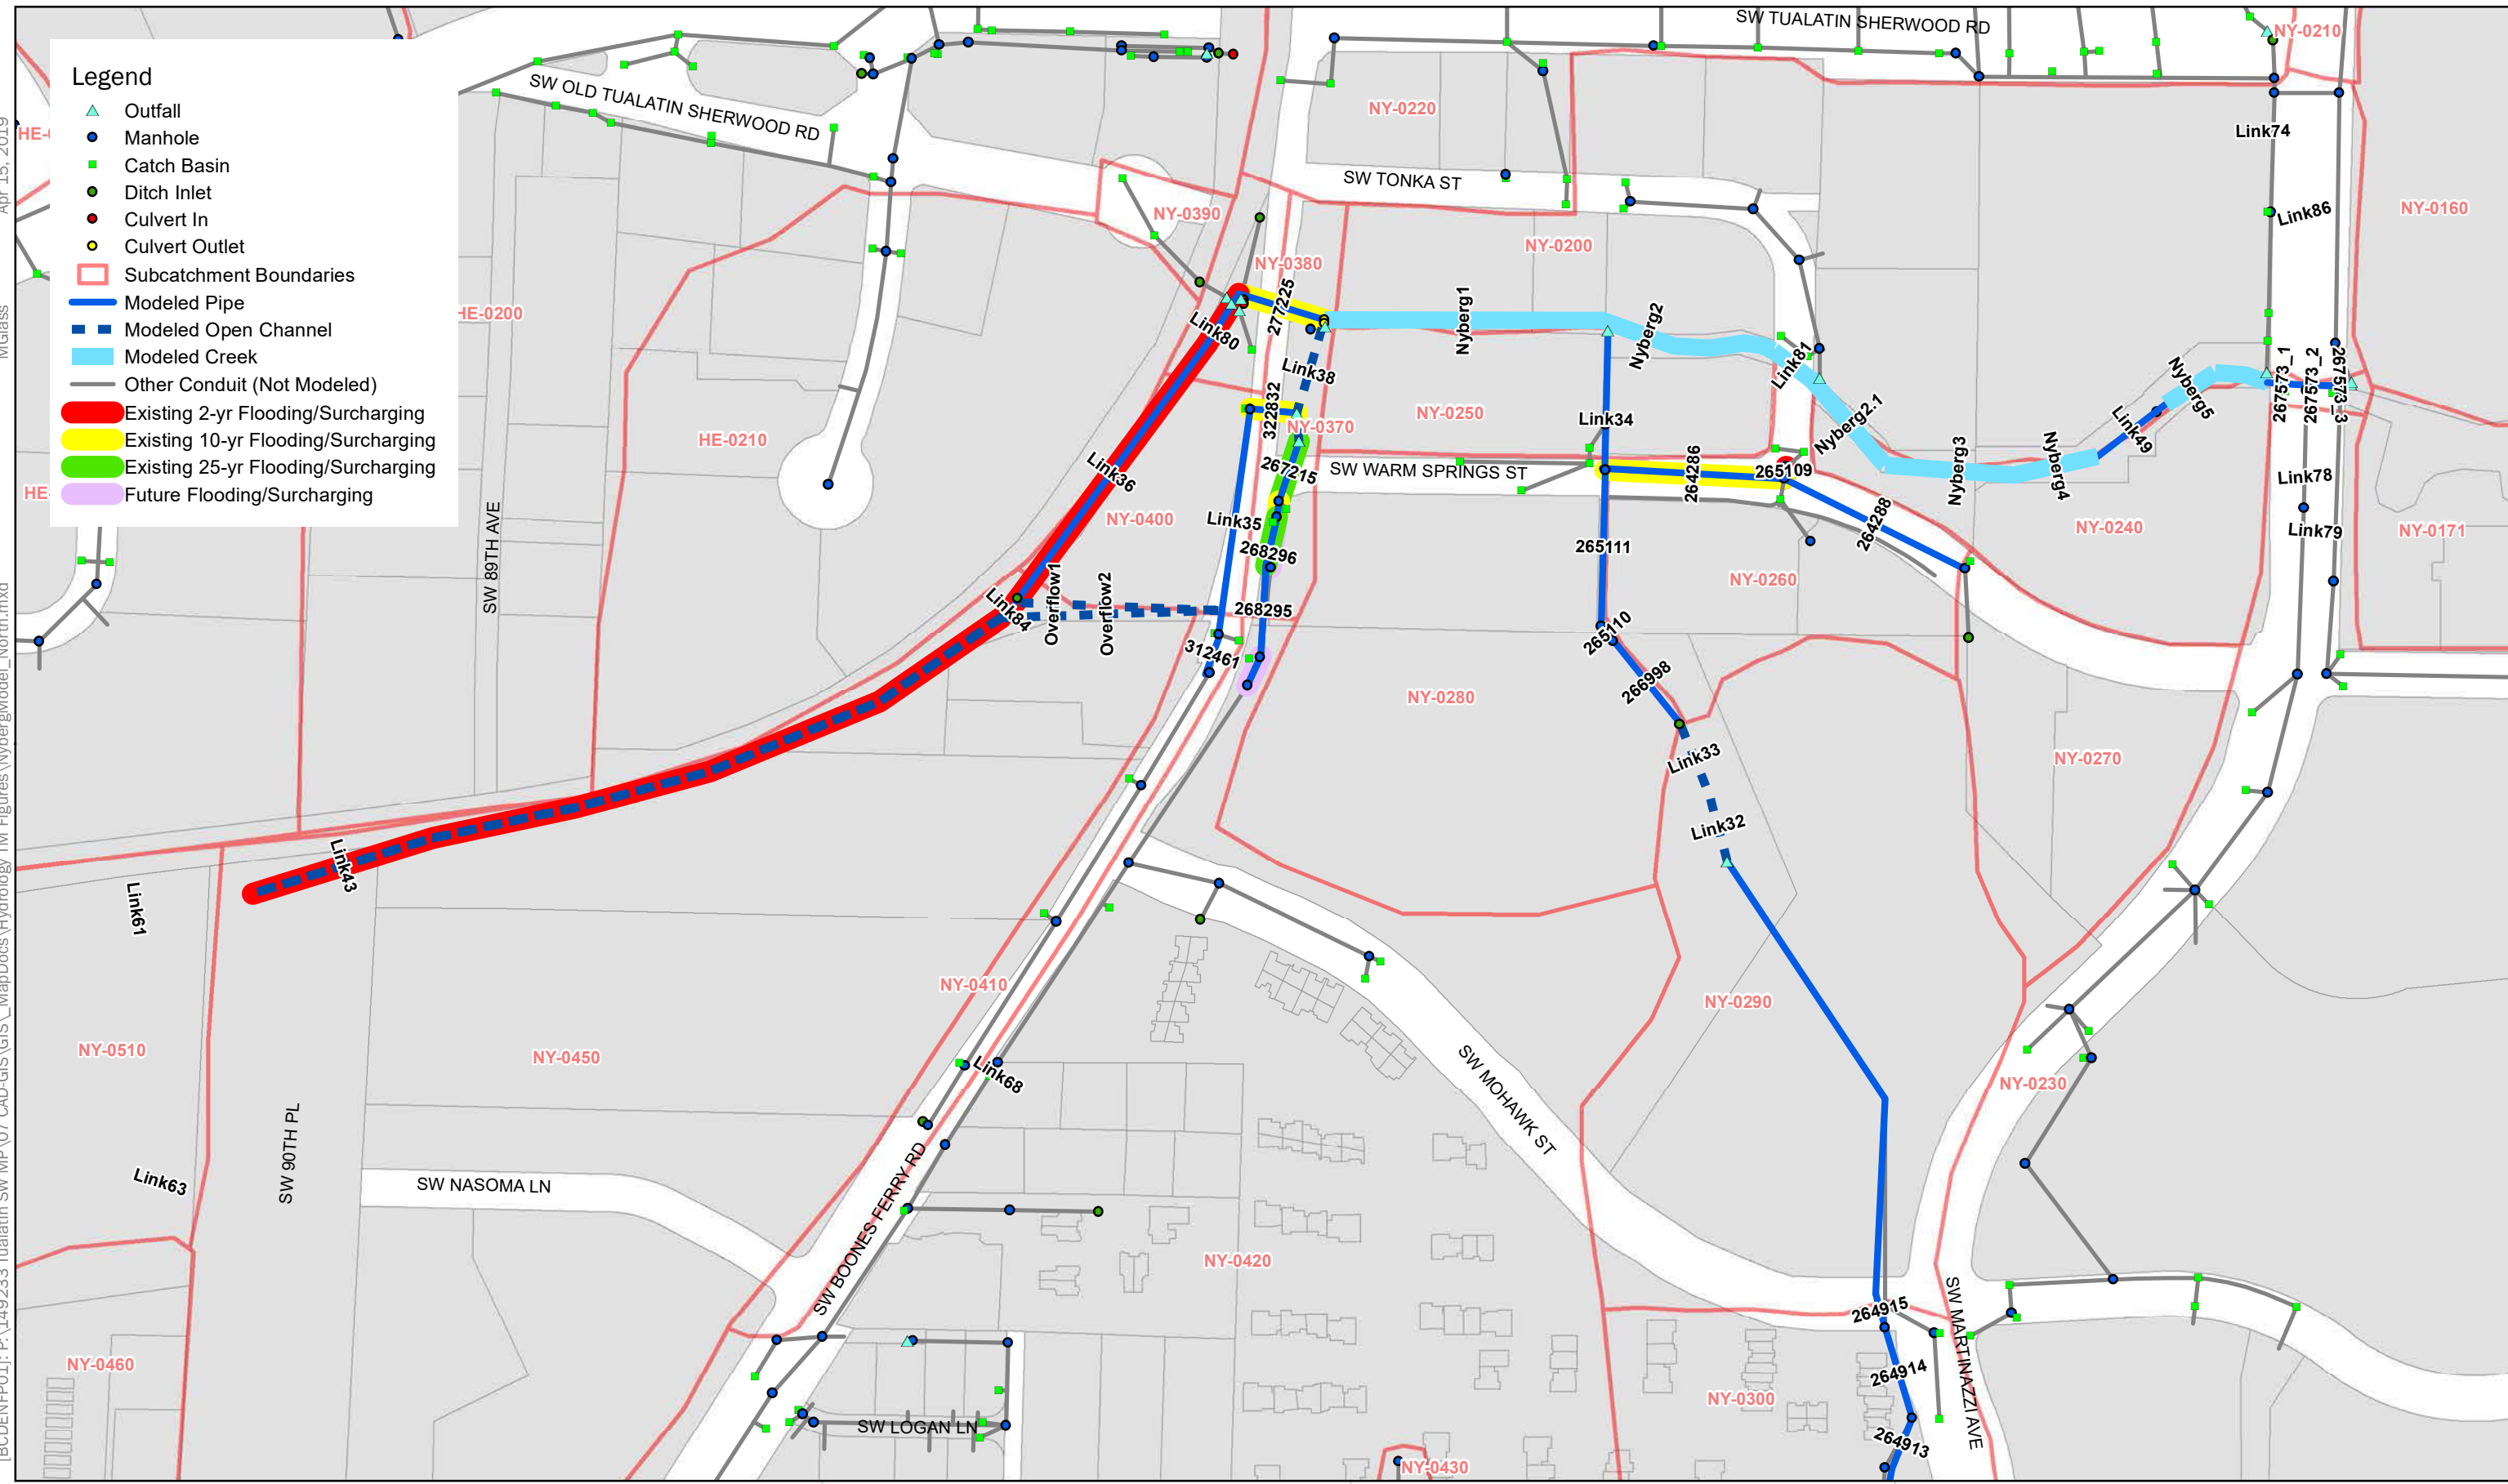

**City of Tualatin**  
**Stormwater Master Plan**

Date: August 2017  
 Project: Project 149233



Notes:  
 1. Projection: NAD 1983 State Plane Oregon North (feet)


**Figure 11**  
**Hydraulic Modeling Results**  
**Nyberg Creek System-North**



mgzregorzewski Sep 8, 2017


[BCDENFP01]: P:\149233 Tualatin SW MP\07 CAD-GIS\GIS\_MapDocs\Hydrology\TM Figures\NybergModel\_South.mxd

- Legend**
- ▲ Outfall
  - Manhole
  - Catch Basin
  - Ditch Inlet
  - Culvert In
  - Culvert Outlet
  - Subcatchment Boundaries
  - Modeled Pipe
  - Modeled Open Channel
  - Other Conduit (Not Modeled)
  - Existing 2-yr Flooding/Surcharging
  - Existing 10-yr Flooding/Surcharging
  - Existing 25-yr Flooding/Surcharging
  - Future Flooding/Surcharging

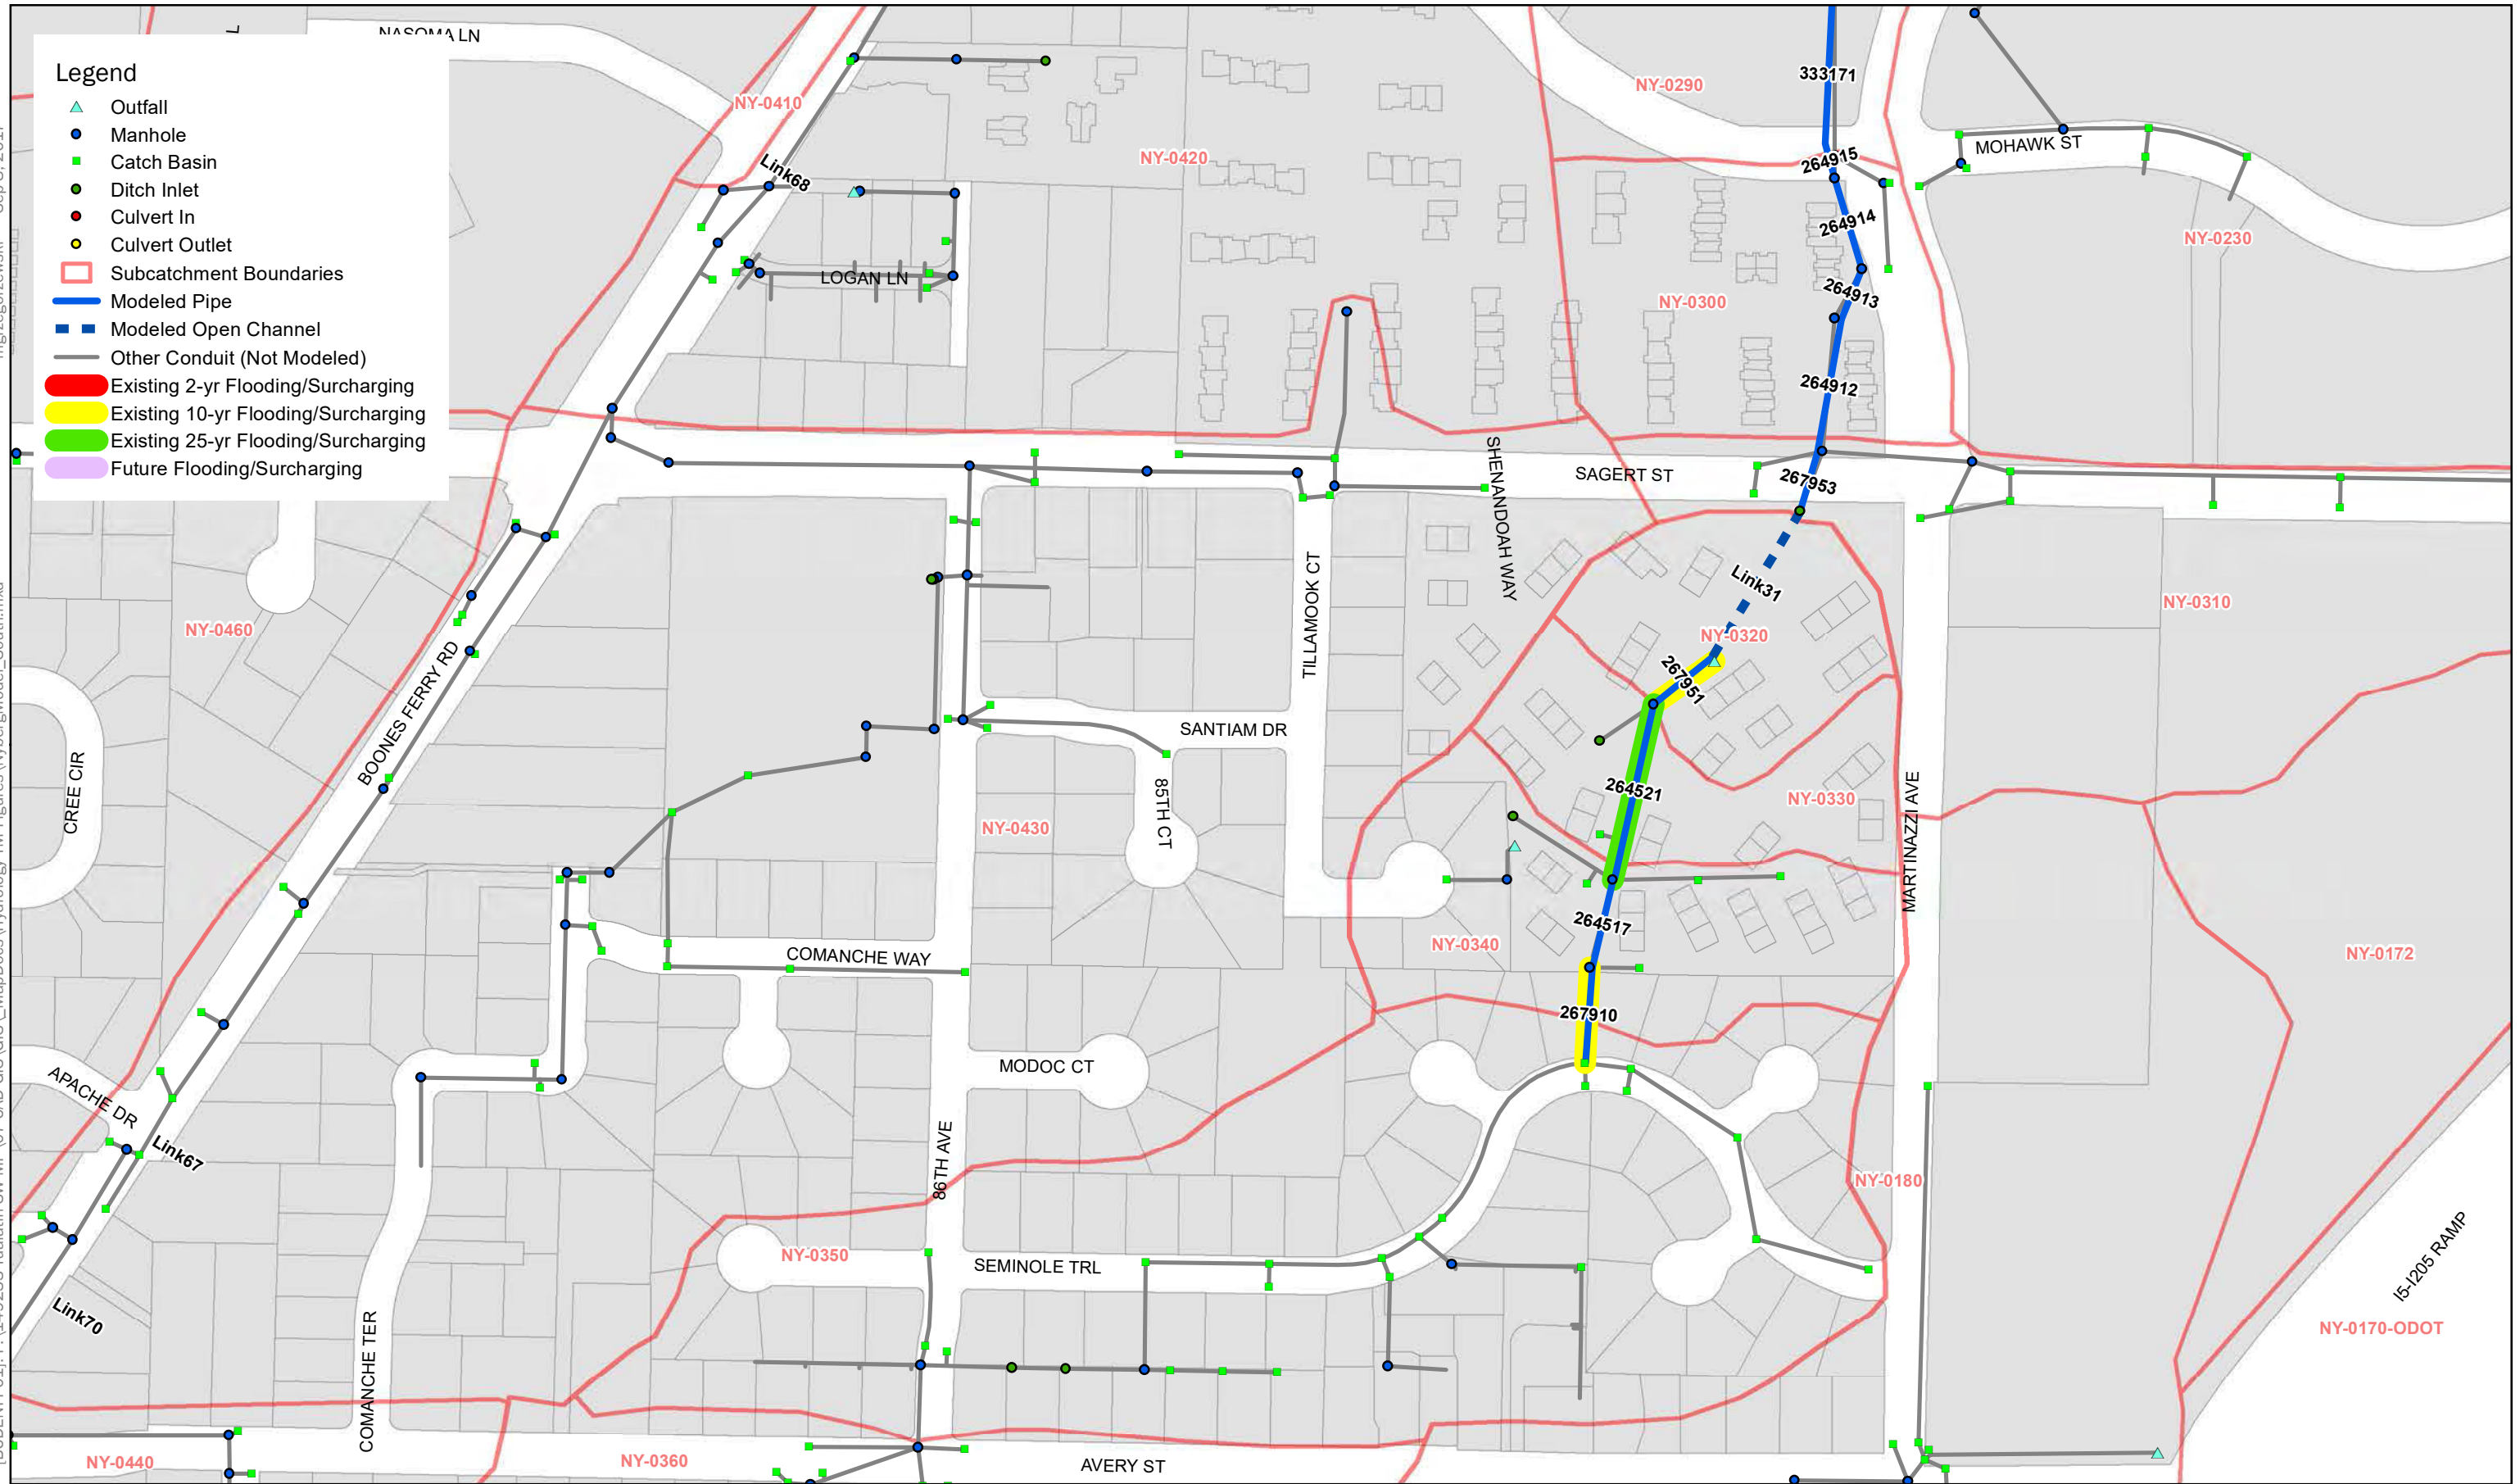

**City of Tualatin  
Stormwater Master Plan**

Date: August 2017  
Project: Project 149233



Notes:  
1. Projection: NAD 1983 State Plane Oregon North (feet)

**Figure 12  
Hydraulic Modeling Results  
Nyberg Creek System-South**



## Attachment D: Photo Log

---









## Attachment D


# Modeled System Photo Log

Photographs and descriptions from the June 29, 2016 and December 8, 2016 field investigations are provided on the following pages by modeled system. Photos were used to verify existing system conditions and refine the hydraulic model.

Hydraulic Model System	Manhasset Drive
	 <p data-bbox="428 1083 1424 1213"><b>Location:</b> Manhasset Drive Open Channel <b>Photo number:</b> 1 <b>Description:</b> Flooding of open channel along Manhasset Drive during December 2015 storm event. Photo provided by City.</p>
	 <p data-bbox="428 1774 1424 1841"><b>Location:</b> Manhasset Drive Open Channel <b>Photo number:</b> 2</p>

<p><b>Hydraulic Model System</b></p>	<p><b>Manhasset Drive</b></p>
<p><b>Description:</b></p>	<p>Open channel upstream of ditch inlet at Manhasset Drive. Channel bottom is rocky and has high roughness.</p>
	<p><b>Location:</b> Manhasset Drive Open Channel  <b>Photo number:</b> 3  <b>Description:</b> Debris in open channel is a restriction during rain events.</p>
	<p><b>Location:</b> Manhasset Drive Open Channel  <b>Photo number:</b> 4  <b>Description:</b> Grated inlet at end of open channel segment along Manhasset Drive.</p>



Hydraulic Model System	Nyberg Creek
	 <p data-bbox="431 831 1419 932"> <b>Location:</b> Behind Oil Can Henry's (19417 SW Boones Ferry Road)  <b>Photo number:</b> 1  <b>Description:</b> Grated inlet at the end of railroad ditch where sediment enters the piped system                 </p>
	 <p data-bbox="431 1503 1419 1604"> <b>Location:</b> Behind Oil Can Henry's (19417 SW Boones Ferry Road)  <b>Photo number:</b> 2  <b>Description:</b> Alternate view of grated inlet                 </p>

<p><b>Hydraulic Model System</b></p>	<p><b>Nyberg Creek</b></p>
	<div data-bbox="430 279 1144 814" data-label="Image"> </div> <p data-bbox="430 825 1156 930"> <b>Location:</b> Boones Ferry Road and SW Tonka Street  <b>Photo number:</b> 3  <b>Description:</b> Heavy sedimentation in dual culvert across Boones Ferry Road         </p>
	<div data-bbox="430 951 1144 1486" data-label="Image"> </div> <p data-bbox="430 1497 1221 1602"> <b>Location:</b> Mohawk Apartments  <b>Photo number:</b> 4  <b>Description:</b> Downstream inlet causing flooding issues at the Mohawk Apartments         </p>

## Appendix D: Nyberg Creek Flood Reduction Modeling (TM3)

---





6500 SW Macadam Avenue, Suite 200  
Portland, OR 97239

T: 503.977.6607

# Technical Memorandum

Prepared for: City of Tualatin

Project title: Stormwater Master Plan

Project no.: 149233

## **Technical Memorandum #3**

Subject: Nyberg Creek Flood Reduction Modeling

Date: February 15, 2019

To: Kim McMillan, P.E., City Engineer

From: Ryan Retzlaff and Angela Wieland, P.E.

### **Limitations:**

*This document was prepared solely for the City of Tualatin in accordance with professional standards at the time the services were performed and in accordance with the contract between the City of Tualatin and Brown and Caldwell dated April 11, 2016. This document is governed by the specific scope of work authorized by the City of Tualatin; it is not intended to be relied upon by any other party except for regulatory authorities contemplated by the scope of work. We have relied on information or instructions provided by the City of Tualatin and other parties and, unless otherwise expressly indicated, have made no independent investigation as to the validity, completeness, or accuracy of such information.*

Nyberg\_Final\_TM

## Overview

This technical memorandum (TM) summarizes development and results related to the one-dimensional (1D) and two-dimensional (2D) hydraulic modeling of Nyberg Creek from Martinazzi Avenue to Nyberg Lane. Brown and Caldwell (BC) conducted modeling to evaluate the type and extent of conveyance system modifications necessary to reduce or eliminate localized nuisance flooding along Tualatin-Sherwood (TS) Road and Martinazzi Avenue. The nuisance flooding is primarily related to the capacity and geometry of Nyberg Creek and the associated stormwater collection system in the proximity of Martinazzi Avenue and TS Road.

Various types of system modifications including channel widening, channel deepening, and removal of culverts and flow impediments have been evaluated to assess the reduction in water surface elevation at key locations where flooding is experienced.

This TM presents model results (i.e., associated reduction in water surface elevation) for eight system modification alternatives. Three of those alternatives provide significant reduction in water surface elevation along TS Road and Martinazzi Avenue for a 5-year, 24-hour storm event, which was the storm event selected to represent nuisance flooding of the system. These alternatives may be considered by the City of Tualatin (City) as a future capital improvement project (CIP).

## Model Development

BC performed modeling using the platform XP-SWMM. Both 1D and 2D modeling approaches were employed to comprehensively identify flooding extents, potential causes of flooding, and how potential changes to Nyberg Creek and the stormwater collection system can reduce flooding (inundation) at five key locations in the Nyberg Creek basin, specifically those locations along Martinazzi Ave and TS Road.

The 1D model includes Nyberg Creek channel cross sections that extend to the top of bank, the double 48-inch culverts behind Fred Meyer, and the narrow channel associated with the embankment east of I-5. The 2D model represents the floodplain or area above the top of bank. This approach allows full representation of the flooded area.

BC used the 1D XP-SWMM Nyberg Creek system model that was developed as part of the City's stormwater master plan (SMP) effort for this evaluation. BC extended the existing model from Martinazzi Avenue to the culvert outfall at Nyberg Lane to capture the full system that influences localized flooding. Additional portions of the stormwater collection system north of TS Road along Martinazzi Avenue, as well as conveyance infrastructure along TS Road, were added to reflect low points in the roadway where water has the potential to exit the closed conveyance system (i.e., catch basins).

BC built the 2D model for Nyberg Creek, extending downstream of Martinazzi Ave to Nyberg Lane, to accurately illustrate surface inundation above the top of bank of the channel and flooding out of the closed conduit collection system. The 1D and 2D models are linked in XP-SWMM and simulated as a single model of the channel and floodplain. Using a 1D and 2D modeling approach, stormwater moves in and out of the channel, flood plain, and structures, simulating the relationship and movement of water as it occurs in nature. BC used light detecting and ranging (LiDAR), field observations from stream walks, aerial photos, and topographic survey to develop the 2D model.

## System Hydrology

BC used city-wide hydrology based on the Santa Barbara Urban Hydrograph (SBUH) method, previously developed as part of the SMP, for this modeling effort (see *TM2: Hydrology and Hydraulic Modeling Methods and Results, September 7, 2018*). Future land use conditions were simulated to establish the boundary condition and evaluate alternatives.



Contributing subbasins to Nyberg Creek, downstream of Martinazzi Avenue, were included in the model update to accurately reflect all contributing drainage area. See Attachment A, Figure 1 for contributing subbasins and routing used for this effort.

BC selected the Clean Water Services (CWS) 5-year (3.1 inches), 24-hour Soil Conservation Service (SCS) Type 1A storm event for evaluation based on feedback from City staff and the objective to address more frequent nuisance flooding. All results in this TM are specific for this rainfall event.

## **System Survey**

The BC team surveyed the Nyberg Creek channel from Martinazzi Avenue to Nyberg Lane to inform the geometry for the 1D model extension. This section of the creek had not been surveyed previously as part of the stormwater master plan effort. Accurate data is important because of the shallow grade and significant wetlands.

The survey effort included eight stream cross sections to the top of bank, 10 channel invert elevations to establish the long stream profile, and inverts for the culverts behind Fred Meyer, located approximately 900 feet east of Martinazzi Avenue. Staff also surveyed additional ground, rim, and invert elevations at specific locations and infrastructure along Martinazzi Avenue and TS Road. Finally, staff conducted field and topographic surveys to verify the elevation of the roadway embankment, orientated north and south in the Nyberg wetland complex, approximately 1,000 feet east of I-5. As mentioned, BC used LiDAR to develop the geometry to inform the 2D model.

## **Boundary Condition**

Nyberg Creek discharges to the Tualatin River approximately 5,700 feet downstream of Martinazzi Avenue. During large, regional storm events, the Tualatin River can backwater and influence Nyberg Creek conveyance capacity, which results in flooding along TS Road and Martinazzi Avenue. BC reviewed the potential influence of the Tualatin River on system hydraulics to establish an appropriate boundary condition for the hydraulic model.

To determine the influence of the Tualatin River on Nyberg Creek during smaller storm events, BC modeled the existing channel geometry for the 5-year, 24-hour storm event with future land use hydrology, assuming both a free outfall and using a 10-year flood elevation for the Tualatin River as a downstream boundary condition. The 10-year Federal Emergency Management Agency (FEMA) flood elevation is 119.50 feet for the Tualatin River. For reference, the low point along Martinazzi Ave is at an elevation of 119.70 feet, and the low point along TS Road is at an elevation of 120.65 feet. Both low point elevations are above the 10-year flood elevation for the Tualatin River.

Surface flooding at key (5) locations in the system did not change significantly depending on the boundary condition used. The water surface elevations at key locations along Martinazzi Avenue and TS Road increased by less than 0.10 foot with application of a 10-year flood elevation in the Tualatin as the boundary condition. Additionally, with smaller, more frequent storm events, the timing of the peak discharge for Nyberg Creek and associated water surface elevation in the City's system has a low probability of occurrence with the timing of a 10-year flood elevation for the Tualatin River. This is primarily due to the size of the Tualatin River watershed versus the much smaller local flow contribution from the City. Based on these results, BC did not use a boundary condition to evaluate the 5-year, 24-hour nuisance storm event as part of this analysis.

## **Model Validation**

There were no recent model validation or calibration data available. In lieu of a model validation, the City provided flooding photos of Martinazzi Avenue and TS Road during February 1996, which is reflective of a 100-year storm event. BC compared documented flooding in the images provided to the modeled flooding

extents along Martinazzi Avenue and TS Road for the existing channel geometry and the 5-year, 24-hour storm event. The flooding extents for the 5-year, 24-hour storm event is not as extensive and is shallower than the extents in the photos; however, flooding locations are consistent.

### Baseline Condition Model

BC established the baseline condition model using future land use conditions with a free outfall (Attachment A, Figure 2).

BC modeled and evaluated system alternatives based on the water surface elevations at five key locations in the Nyberg Creek basin (see Figures 2, 3, 4 and 5). These five locations experience regular flooding and are in the proximity of Martinazzi Avenue and TS Road. Flooding readily occurs along TS Road, Martinazzi Avenue, and the southwest corner of the Fred Meyer Parking lot.

### Model Alternative Summary

BC developed and simulated eight alternatives to determine how modifications to the Nyberg Creek system would change the extent of surface flooding and the water surface elevation at key locations in the Nyberg Creek basin. The focus was on reducing the water surface elevation at Martinazzi Avenue and TS Road, so the alternatives emphasized system modifications to move water downstream. Table 1 summarizes the alternatives based on the simulated modifications to Nyberg Creek and associated infrastructure (e.g., channel widening, removal of culvert, removal of embankment, channel slope modification, and channel deepening).

Alternatives 1 and 2 reflect the proposed system modifications suggested by the City for evaluation.

Table 1. Alternative Descriptions			
Alternative	Channel Modification (width)	Channel Modification (depth)	Infrastructure Modification
1	Maintain existing channel width	Reduction of channel bed elevation by 1 foot from Martinazzi Ave. to Nyberg Lane (length = 5,000 feet)	Removal of 300 feet of berm (located 1,000 feet east of I-5) Removal of 2-48-inch diameter culverts (Key Location ID #5)
2	Maintain existing channel width	Reduction of channel bed elevation by 1 foot from Martinazzi Ave. to I-5 (length = 1,500 feet)	Removal of 300 feet of berm (located 1,000 feet east of I-5) Removal of 2-48-inch diameter culverts (Key Location ID #5)
3	Channel width to 15 feet with 3:1 side slope from Martinazzi Ave to I-5 (length = 1,500 feet)	Maintain existing slopes	Removal of 300 feet of berm (located 1,000 feet east of I-5) Removal of 2-48-inch diameter culverts (Key Location ID #5)
4	Channel width to 15 feet with 3:1 side slope from Martinazzi Ave to Nyberg Lane (length = 5,000 feet)	Maintain existing slopes	Removal of 300 feet of berm (located 1,000 feet east of I-5) Removal of 2-48-inch diameter culverts (Key Location ID #5)
5	Channel width to 20 feet with 3:1 side slope and a low flow channel from Martinazzi Ave to Nyberg Lane (length = 5,000 feet)	Maintain existing slopes	Removal of 300 feet of berm (located 1,000 feet east of I-5) Removal of 2-48-inch diameter culverts (Key Location ID #5)
6	Maintain existing channel width	Maintain existing slopes	Removal of 300 feet of berm (located 1,000 feet east of I-5)
7	No width modification, channel slope modified to be consistent from Martinazzi Ave to Nyberg Lane (length = 5,000 feet)	Minor modification of channel depth	Removal of 300 feet of berm (located 1,000 feet east of I-5) Removal of 2-48-inch diameter culverts (Key Location ID #5)
8	Maintain existing channel width	Maintain existing slopes	Removal of 2-48-inch diameter culverts (Key Location ID #5)





## Results and Recommendations

Table 2 summarizes the model results for each alternative to inform actions that may reduce the extent, depth, and frequency of localized flooding at Martinazzi Avenue and TS Road. The model results represent the difference in water surface elevation from the baseline condition model at the five key locations.

Alternatives 3, 4, and 5 show the most significant reduction in water surface elevations when compared to the baseline condition (see Table 2). Alternative 5 provides the greatest reduction and shows no flooding at the key locations yet represents the most significant changes to the Nyberg Creek channel and associated infrastructure. Figures 3, 4, and 5 (see Attachment A) show the anticipated flooding (surface inundation) associated with each of these three alternatives.

Future actions to mitigate flooding along Martinazzi Avenue and TS Road should be coordinated with future actions currently being explored by CWS and The Wetland Conservancy in the areas east of I-5 owned by The Wetland Conservancy.

Table 2. Water Surface Elevation Change Compared to Baseline Conditions									
Key Location ID	Key Location Description	Alternatives							
		1	2	3	4	5 <sup>a</sup>	6	7	8
1	TS Road, 300' west of Martinazzi Avenue	0.02	0.01	-1.47	NA	NA	0.00	0.00	0.01
2	Martinazzi Road, west of Fred Meyer	0.01	0.00	-1.26	-1.36	NA	-0.02	-0.02	0.00
3	SW Corner of Fred Meyer	0.03	0.02	-1.23	-1.33	NA	0.00	0.00	0.02
4	Martinazzi Avenue Outfall	0.03	0.02	-5.5	-5.51	NA	-0.01	-0.01	0.02
5	2 - 48" culverts south of Fred Meyer	0.03	0.03	-3.37	-3.37	NA	0.00	0.01	0.03

a. NA = no flooding occurs at key locations, so no comparison can be made to the baseline condition model.




## Attachment A: Figures

---






Jan 7, 2019  
M:Glass  
P:\149233 Tualatin SW MP\07 CAD-GIS\GIS\_MapDocs\Master Plan\HydraulicModel\SystemOverview\_11x17\_V2.mxd

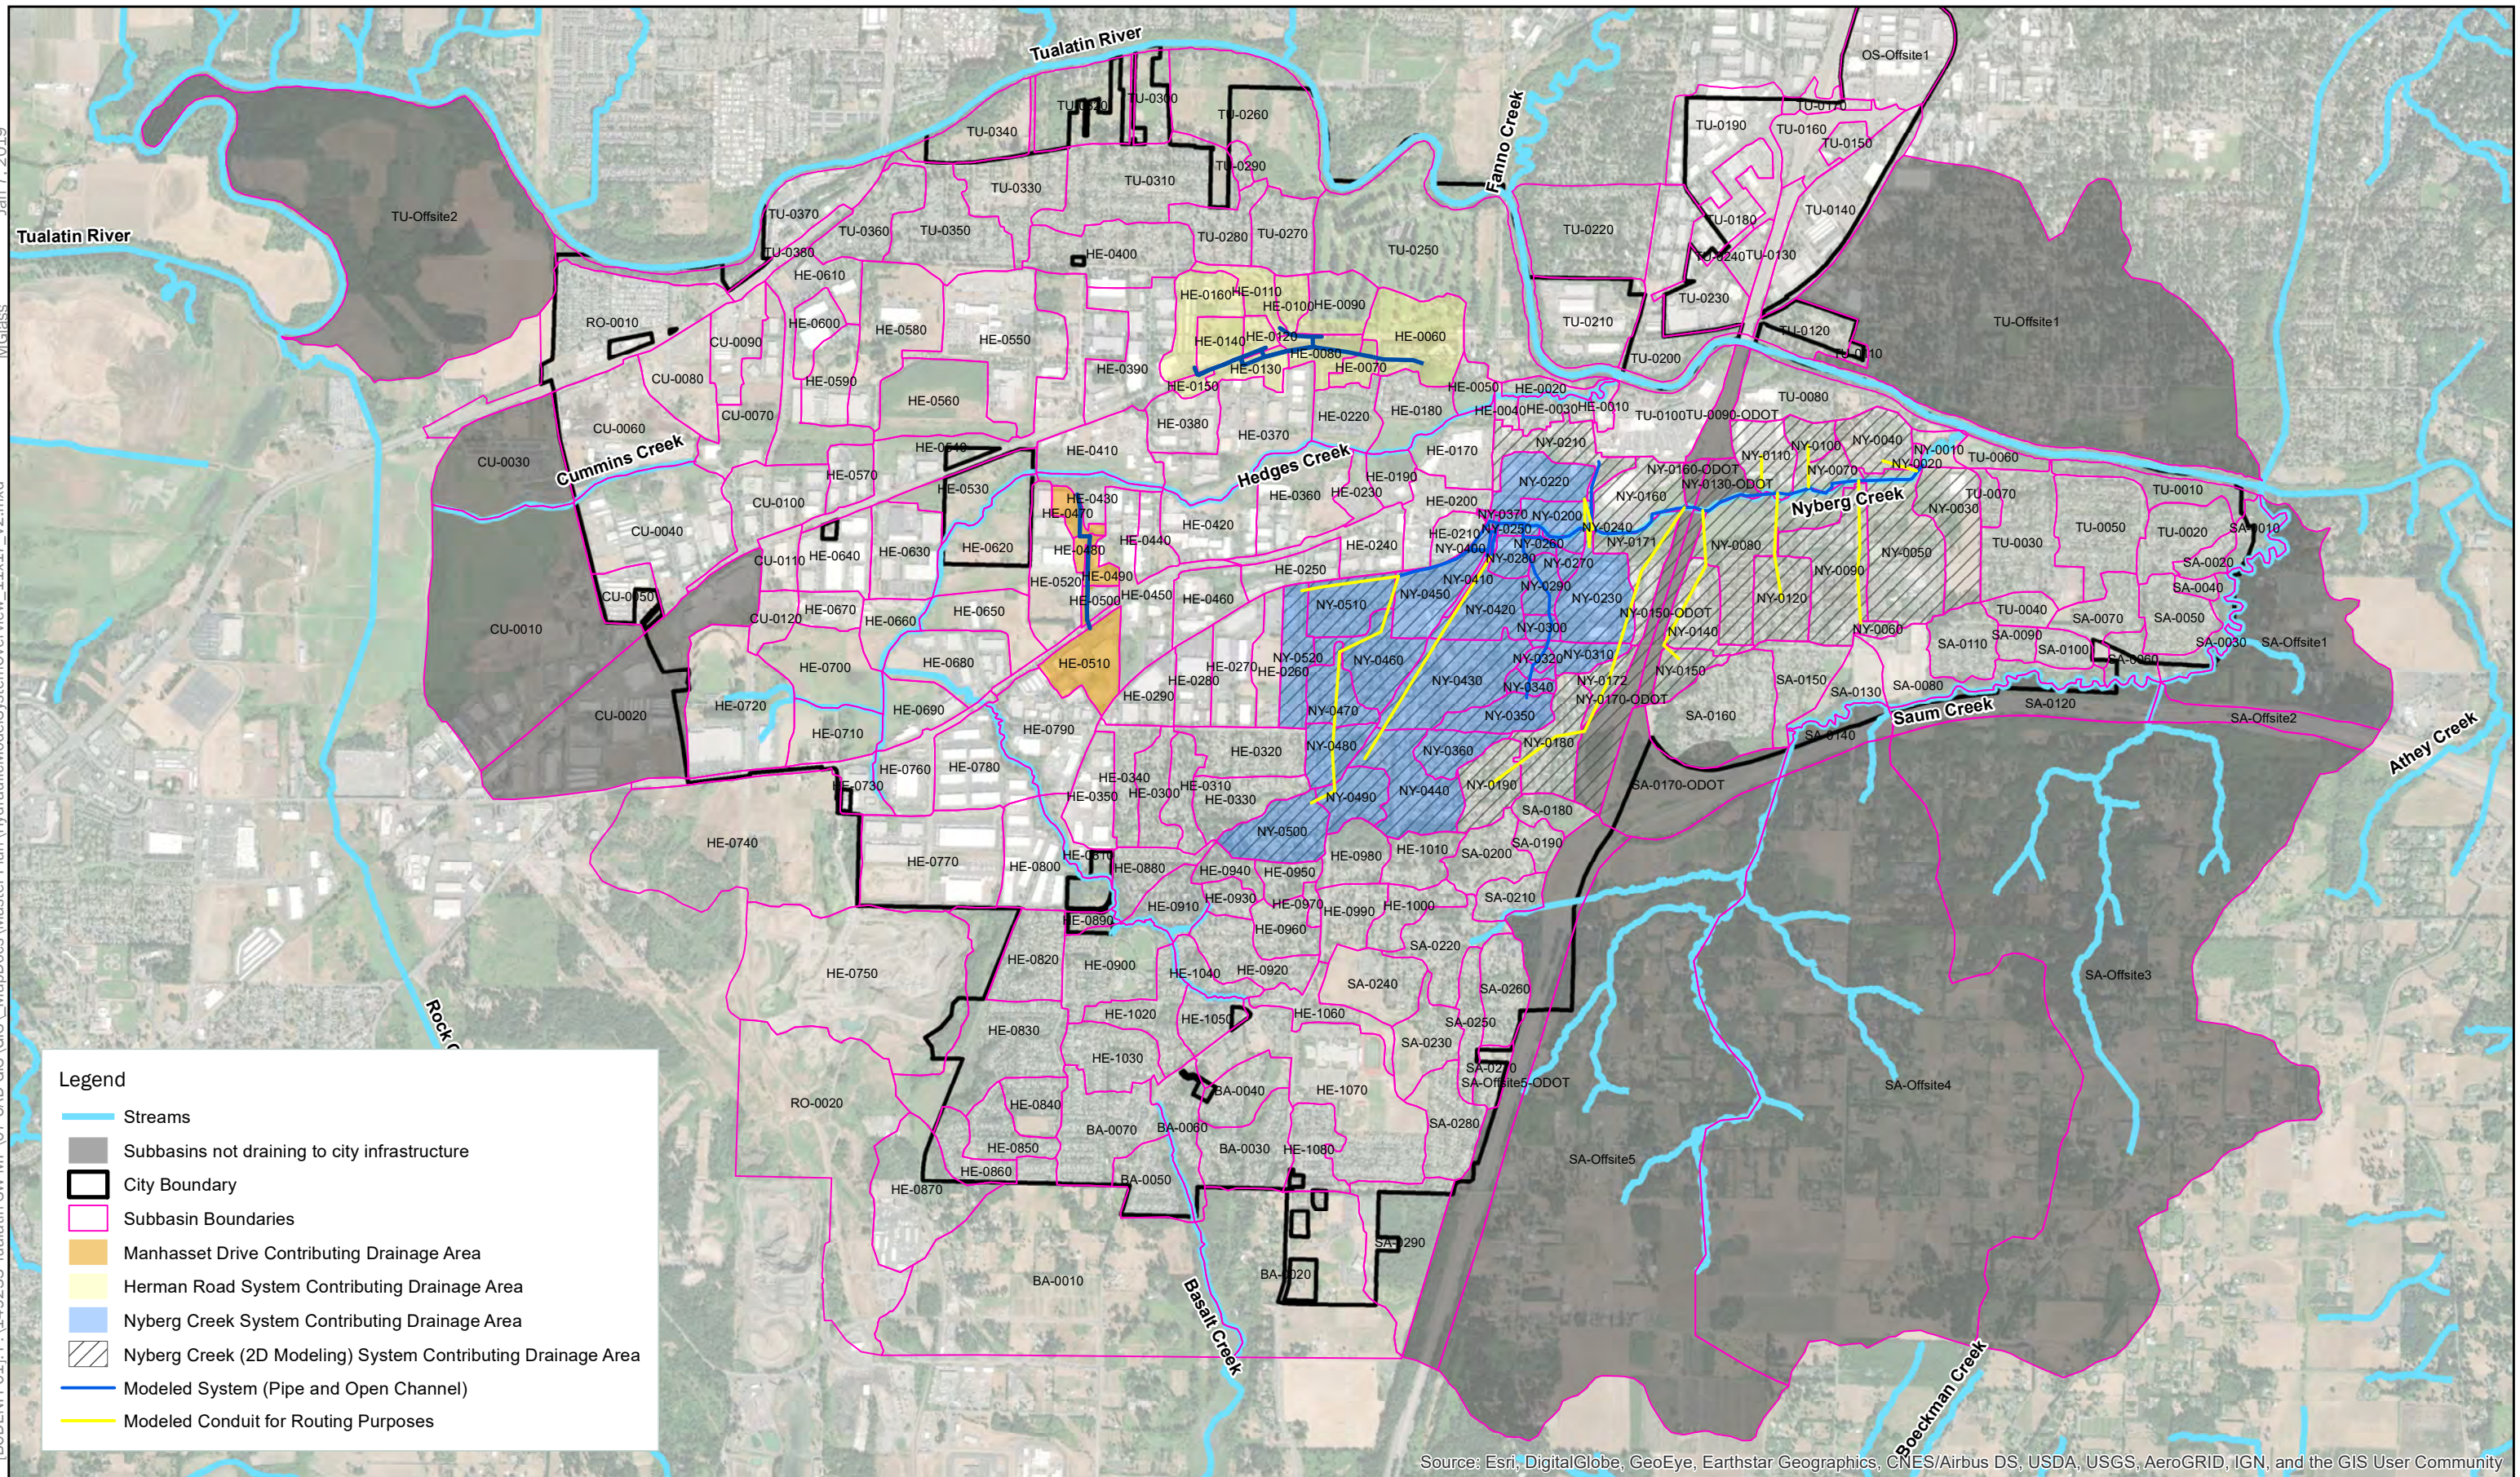

**Legend**


- Streams
- Subbasins not draining to city infrastructure
- City Boundary
- Subbasin Boundaries
- Manhasset Drive Contributing Drainage Area
- Herman Road System Contributing Drainage Area
- Nyberg Creek System Contributing Drainage Area
- Nyberg Creek (2D Modeling) System Contributing Drainage Area
- Modeled System (Pipe and Open Channel)
- Modeled Conduit for Routing Purposes

Source: Esri, DigitalGlobe, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community



**City of Tualatin**  
**Stormwater Master Plan**

Date: December 2018  
Project: Project 149233



Notes:  
1. Projection: NAD 1983 State Plane Oregon North (feet)

**Figure 1**  
**Model System Overview**





Date: February 15, 2019  
Project No.: 149233  
Client: City of Tualatin


Figure 2.  
Base Case 2D Model Results





Date: February 15, 2019  
Project No.: 149233  
Client: City of Tualatin

Figure 3.  
Alternative 3 2D Model Results








Date: February 15, 2019  
Project No.: 149233  
Client: City of Tualatin

Figure 4.  
Alternative 4 2D Model Results





Date: February 15, 2019  
Project No.: 149233  
Client: City of Tualatin

Figure 5.  
Alternative 5 2D Model Results



## Appendix E: Capital Project Modeling Results

---





Table E-1. CIP Hydraulic Model Parameters and Results

					Node Name		Invert Elevation (ft)		Ground Elevation (ft)		Future 10 yr CIP Max Water Surface		Future 25 yr CIP Max Water Surface		Future CIP Max Flow (cfs)		CIP Project Number
Link ID	Length (ft)	Shape	Diameter/Height (ft)	Slope (%)	US	DS	US	DS	US	DS	US	DS	US	DS	10-yr	25-yr	
<b>Herman Road System</b>																	
322603	108.8	Circular	2.0	2.2	322601_HE-0160	HE-0150	127.3	125.0	131.1	130.0	129.3	128.4	130.37	129.05	14.24	16.61	CIP #5
Link48	200.0	Circular	3.0	0.1	HE-0150	HE-0140	124.5	124.2	130.0	129.0	128.4	128.1	129.05	128.68	16.58	19.31	CIP #5
Link49	200.0	Circular	3.0	0.1	HE-0140	Node571	124.0	123.7	129.0	128.6	128.1	127.6	128.68	127.94	23.59	27.46	CIP #5
Link50	200.0	Circular	3.0	0.1	Node571	322634.0	123.5	123.2	128.6	128.2	127.6	127.0	127.94	127.20	23.59	27.46	CIP #5
Link52	200.0	Circular	3.0	0.1	HE-0120	322634.0	123.3	123.2	128.3	128.2	127.0	127.0	127.17	127.20	-5.42	-6.14	CIP #5
Link51	160.0	Circular	3.0	0.1	HE-0120	322613.0	123.3	123.2	128.3	128.2	127.0	126.9	127.17	127.09	8.68	9.99	CIP #5
<b>Manhasset Drive System</b>																	
267387	102.0	Circular	2.5	4.1	261974_HE-0510	262060_HE-0500	157.90	153.75	160.40	160.40	158.65	154.70	160.16	154.80	15.0	17.4	CIP #1
Link9	200.0	Circular	2.5	3.4	262060_HE-0500	Node280	153.75	147.00	160.40	153.00	154.70	147.81	154.80	147.88	16.0	18.6	CIP #1
Link12	200.0	Circular	2.5	3.2	Node280	Node283	146.80	140.40	153.00	146.40	147.70	141.47	147.78	141.60	16.0	18.6	CIP #1
Link15	200.0	Circular	2.5	1.2	Node283	HE-0490	140.20	137.90	146.40	143.40	141.47	139.17	141.60	139.37	16.0	18.6	CIP #1
Link11	350.0	Circular	2.5	0.9	HE-0490	262001	137.70	134.65	143.40	139.76	139.17	136.70	139.37	137.02	19.2	22.3	CIP #1
266696	47.4	Circular	2.5	0.6	262001	259248	134.65	134.37	139.76	139.25	136.70	136.19	137.02	136.50	19.2	22.3	CIP #1
266695	132.0	Circular	2.5	0.6	259248	262763_HE-0480	134.17	133.40	139.25	138.78	136.19	135.34	136.50	135.55	19.2	22.3	CIP #1
268265	149.3	Circular	3.0	0.1	262763_HE-0480	262764	133.20	133.00	138.78	137.99	135.34	134.47	135.55	134.59	20.9	24.3	CIP #1
268266	407.7	Circular	3.0	0.7	262764	262765_HE-0470	132.80	129.98	137.99	135.43	134.29	132.26	134.48	132.52	20.9	24.3	CIP #1
266697	194.1	Circular	3.0	0.2	262765_HE-0470	271161	129.88	129.56	135.43	132.56	132.26	131.18	132.52	131.31	25.1	29.3	CIP #1
<b>Nyberg Creek System</b>																	
Link90	80.0	Circular	2.0	3.0	263397_NY-0290	Node597	179.70	177.30	187.40	186.35	181.24	179.00	182.73	180.36	33.3	36.3	CIP #2.1
Link91	180.0	Circular	2.0	2.4	Node597	Node598	177.30	173.02	186.35	182.52	179.00	174.72	180.36	175.02	33.3	36.3	CIP #2.1
Link95	190.0	Circular	2.0	2.6	Node598	Node599	172.82	167.92	182.52	173.78	174.44	169.54	174.70	169.76	33.3	36.2	CIP #2.1
Link92	230.0	Circular	2.0	3.4	Node599	Node600	167.72	159.79	173.78	166.36	169.14	161.21	169.24	161.31	33.3	36.2	CIP #2.1
Link93	161.0	Circular	2.0	5.6	Node600	Node602	159.63	150.56	166.36	157.22	160.83	151.76	160.90	151.83	33.3	36.2	CIP #2.1
Link94	162.0	Circular	2.0	7.2	Node602	Node603	150.51	138.77	157.22	146.89	151.61	139.87	151.67	139.93	33.3	36.2	CIP #2.1
Link78	220.0	Circular	2.0	6.6	Node603	NY-0230	138.51	123.97	146.89	130.70	139.65	125.32	139.71	125.58	33.3	36.2	CIP #2.1
Link96	120.0	Circular	2.0	8.6	NY-0230	270963	123.86	113.50	130.70	123.15	125.32	116.00	125.58	116.10	53.5	59.7	CIP #2.1
Link89	400.0	Circular	4.0	1.3	270971	NY-0250	125.30	120.00	130.80	126.15	127.24	125.46	127.55	126.06	52.9	63.3	CIP #2.2
264286	237.6	Circular	4.0	0.4	NY-0250	262213	119.80	118.80	126.15	125.08	125.46	124.81	126.06	125.08	51.2	59.3	CIP #2.2
Link97	150.0	Circular	4.0	0.5	262213	Node569	118.80	118.00	125.08	125.27	124.81	124.61	125.08	124.92	54.6	63.4	CIP #2.2
268297	41.3	Circular	3.0	5.8	262848	262856	142.50	140.10	148.93	147.25	144.70	141.60	145.05	141.82	52.4	62.5	CIP #2.3
268295	119.7	Circular	3.0	5.8	262856	262847_NY-0370	140.00	133.00	147.25	138.76	141.60	134.70	141.82	135.04	52.4	62.5	CIP #2.3
268296	67.6	Circular	3.0	5.9	262847_NY-0370	262846	132.80	128.80	138.76	135.44	134.70	131.06	135.04	131.46	53.1	63.3	CIP #2.3
268293	21.4	Circular	3.5	5.6	262846	262844	128.60	127.40	135.44	132.63	131.06	129.50	131.46	129.82	53.1	63.3	CIP #2.3
267215	50.0	Circular	3.5	4.2	262844	270971	127.40	125.30	132.63	130.80	129.51	127.24	129.83	127.55	53.1	63.3	CIP #2.3
322832	62.1	Circular	2.0	2.4	312443	322831	125.60	124.11	129.32	129.11	126.25	126.29	126.86	126.86	2.1	2.4	CIP #2.3
Link36	484.0	Circular	3.5	2.7	335464	277227_NY-0380	136.18	122.95	141.50	128.95	138.39	127.68	138.91	129.03	89.8	107.5	CIP #7
<b>Blake Street System</b>																	
Link31	120.0	Circular	7.0	1.2	Node1557	Node1566	196.2	194.8	203.5	203.5	201.11	201.88	198.09	199.76	155.5	194.1	CIP #6





Figure E-1. CIP #1 Manhasset Storm System Improvements – Proposed System Node Numbering

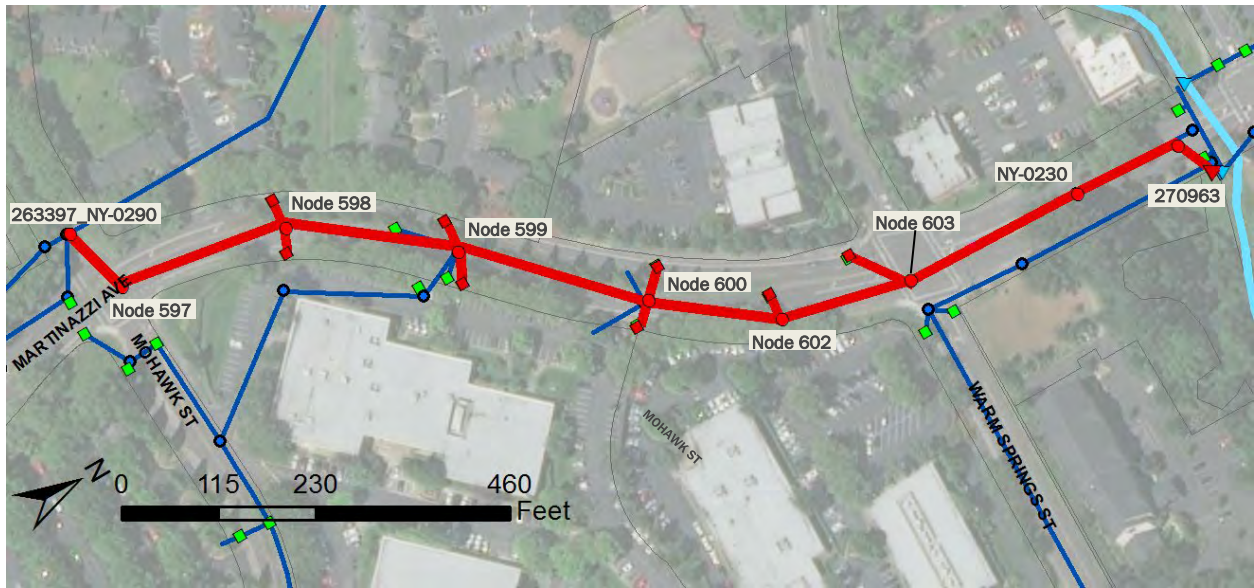


Figure E-2A. CIP #2 Nyberg Creek Stormwater Improvements (Phase 1)– Proposed System Node Numbering

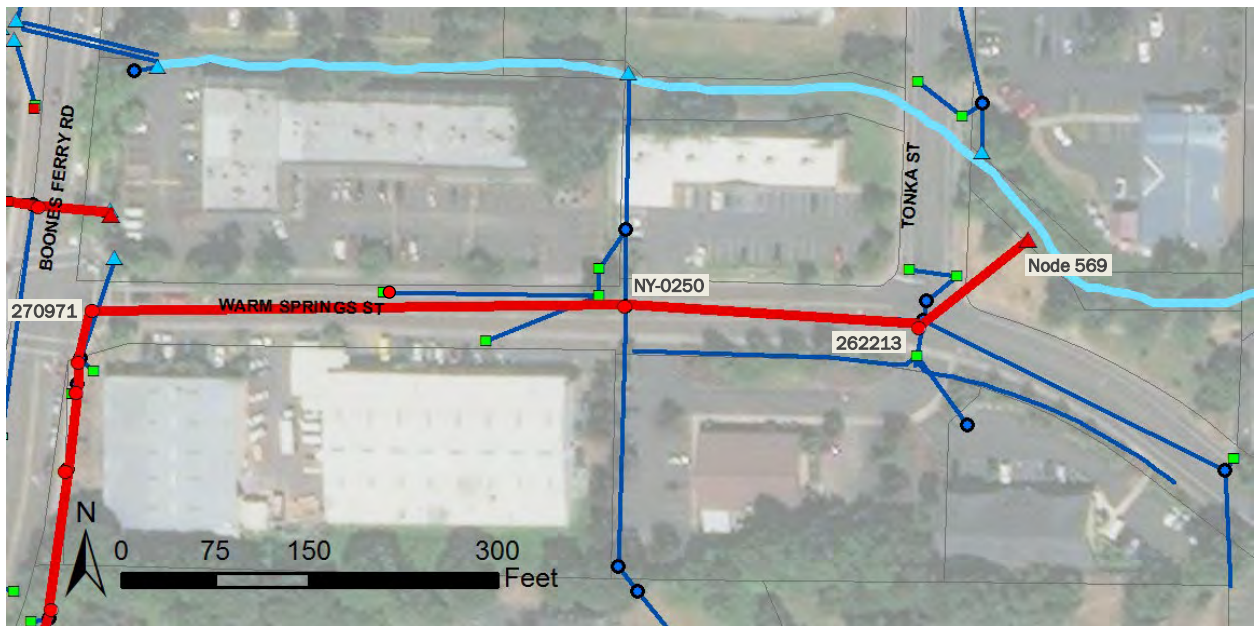


Figure E-2B. CIP #2 Nyberg Creek Stormwater Improvements (Phase 2) – Proposed System Node Numbering



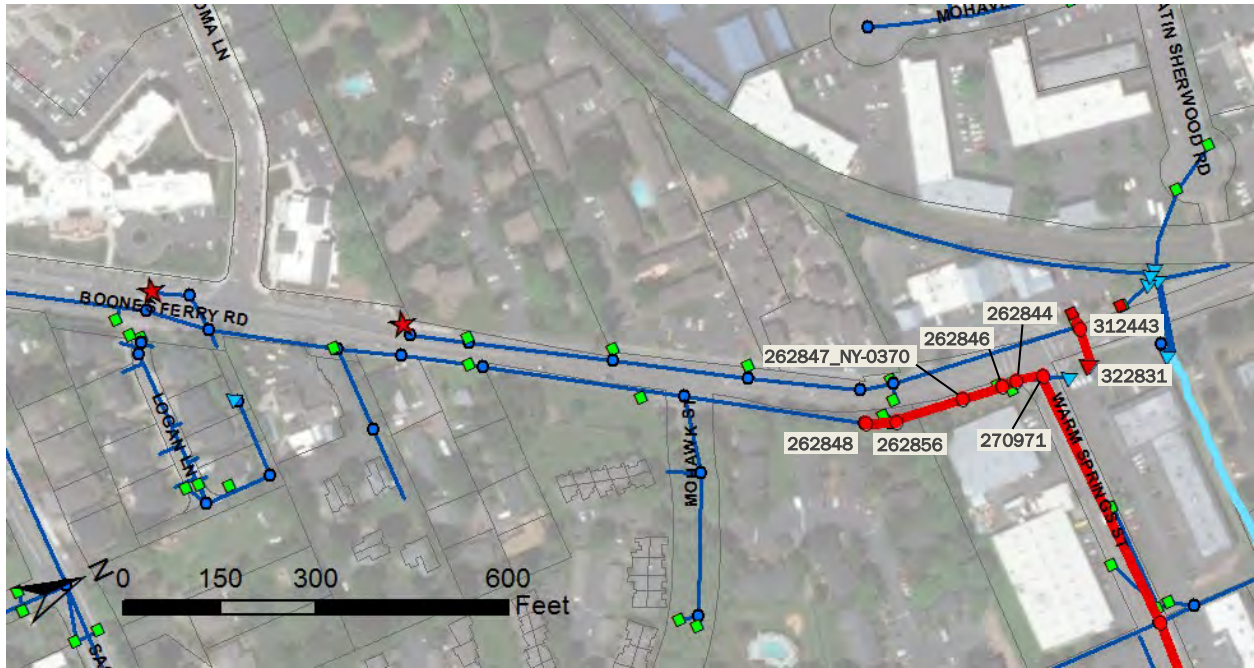


Figure E-2C. CIP #2 Nyberg Creek Stormwater Improvements (Phase 3) – Proposed System Node Numbering

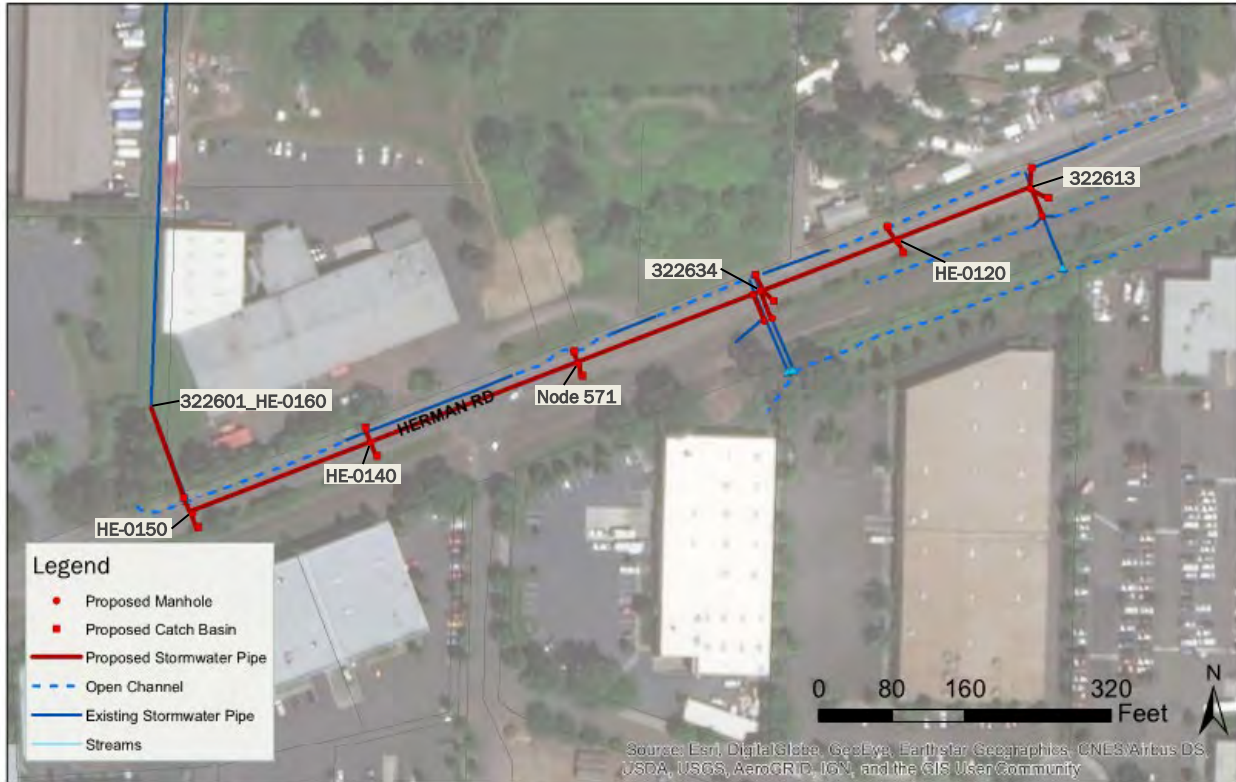


Figure E-3. CIP #5 Herman Road Storm System – Proposed System Node Numbering



Figure E-4. CIP #6 Blake Street Culvert Replacement – Proposed System Node Numbering

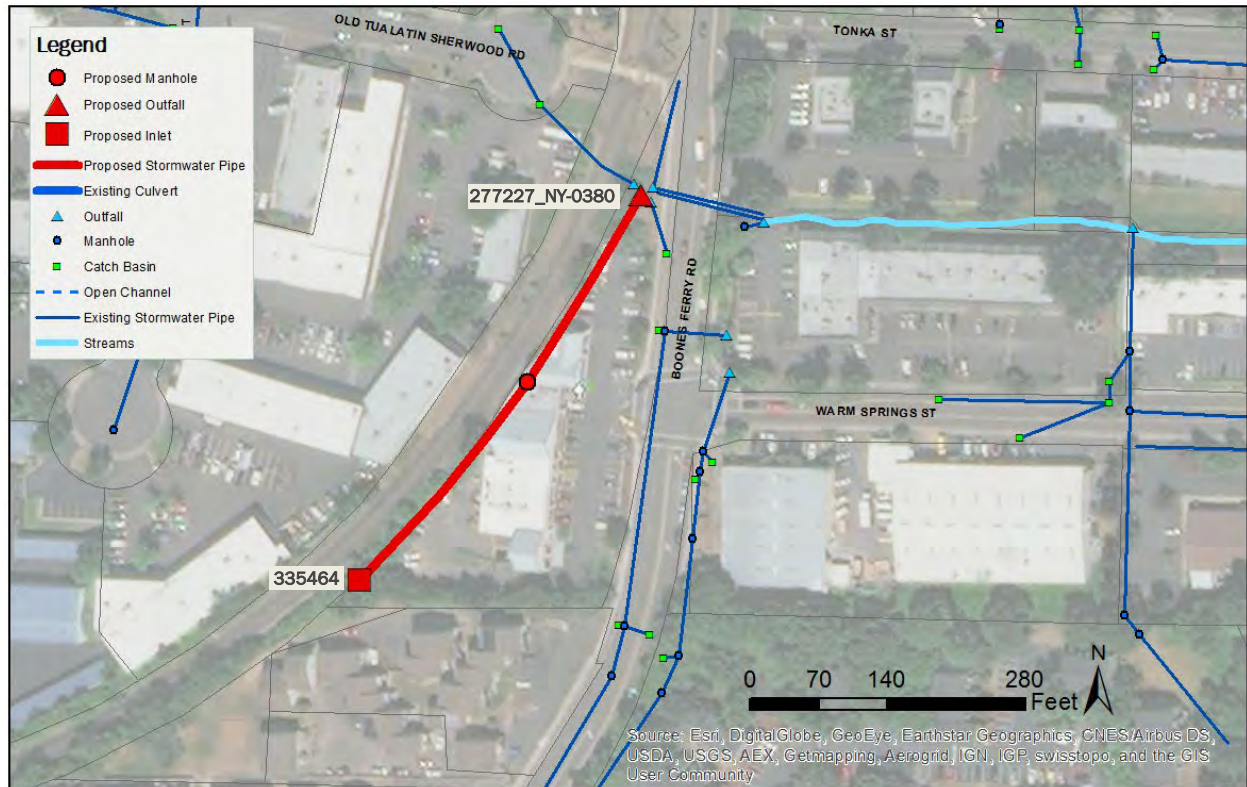


Figure E-5. CIP #7 Boones Ferry Railroad Conveyance Improvements – Proposed System Node Numbering

## **Appendix F: Stream Assessment TM (TM4)**

---





Stream Assessment  
Technical Memorandum  
City of Tualatin

*Prepared for:  
Brown and Caldwell  
6500 SW Macadam Avenue #200  
Portland, Oregon*

January 30, 2018  
Finalized: February 17, 2019

## Table of Contents

Glossary.....	4
1.0 Introduction and Summary.....	5
2.0 Methodology.....	7
3.0 Stream Assessment Results.....	9
3.1 Overall Summary.....	9
3.1 Saum Creek.....	10
3.1.1 Saum Creek Reaches #1 and #2.....	10
3.1.2 Saum Creek Reach #3.....	10
3.2 Nyberg Creek.....	13
3.2.1 Nyberg Creek Reaches #1 and #2.....	13
3.2.2 Nyberg Creek Reach #3.....	14
3.3 Hedges Creek.....	14
3.3.1 Hedges Reach #1.....	14
3.3.2 Hedges Reach #2.....	16
3.3.3 Hedges Reach #3A.....	17
3.3.4 Hedges Reach #3B.....	19
4.0 Findings and Recommendations.....	20
4.1 Channel Erosion and Incision.....	20
4.1.1 Flow Control.....	21
4.1.2 Road Embankment Erosion.....	21
4.2 Vegetation Management.....	22
4.3 Slope Stability.....	23
5.0 References.....	24

### List of Tables

Table 1. List of Stream Reaches Walked.....	8
Table 2. Summary of physical stream channel characteristics by reach.....	9
Table 3. Summary of Channel Erosion Observations and Recommended Strategies.....	20
Table 4. List of Locations Recommended for Vegetation Management.....	23

### List of Figures

Figure 1. Vicinity Map and Location of Priority Stream Reaches Walked during Stream Assessment.....	6
---	---

### List of Photos

Photo 1. Hanging culvert on north side of Saum Creek Reach #3 in location of hillslope failure (September 2017).....	11
---	----



Photo 2. Otak photo of newly constructed Saum Creek channel in Chieftan/Dakota Greenway (c. 2013) ..... 12

Photo 3. Saum Creek restoration in Chieftan/Dakota Greenway (September 2017)..... 12

Photo 4. Saum Creek immediately upstream of SW Blake Street. Channel is obscured by reed canary grass. This area is very flat, and wet..... 12

Photo 5. Nyberg Creek Reach #1 downstream of SW 65th Avenue..... 13

Photo 6. Nyberg Creek Reach #2 downstream of I-5, with beaver swimming in foreground..... 13

Photo 7. Nyberg Creek Reach #3 upstream of SW Martinazzi Avenue. .... 14

Photo 8. Culvert placed in debris from washed out bridge to convey Hedges Creek. .... 15

Photo 9. Hedges Creek Reach #1. Reed canary grass-choked ..... 16

Photo 10. Hedges Creek Reach #2. .... 16

Photo 11. Hedges Creek Reach #3A, showing rock wall location and missing rocks..... 18

Photo 12. Side channel incision and erosion around sanitary sewer manhole..... 18

Photo 13. Restoration area showing cabled logs and root wads. Approximately 950 feet upstream of SW 105th Avenue. .... 19

Photo 14. Left bank slump upstream of confluence..... 19

Photo 15. Perched culvert on downstream side of SW Alesa Ct. .... 19

## Attachments

A Stream Reach Summary Sheets

B-1 Saum Creek Reach #1 Photo Log

B-2 Saum Creek Reach #2 Photo Log

B-3 Saum Creek Reach #3 Photo Log

B-4 Nyberg Creek Reach #1 Photo Log

B-5 Nyberg Creek Reach #2 Photo Log

B-6 Nyberg Creek Reach #3 Photo Log

B-7 Hedges Creek Reach #1 Photo Log

B-8 Hedges Creek Reach #2 Photo Log

B-9 Hedges Creek Reach #3A Photo Log

B-10 Hedges Creek Reach #3B Photo Log

## Glossary

Aggradation	The process of building up a surface by deposition (as in sediment in a stream channel).
Bankfull Depth	The depth of the channel when discharges are at full channel capacity. Discharges above the bankfull depth would overflow onto the floodplain. Evidence of bankfull depth includes breaks in slope on channel banks, vegetation changes,
Bankfull Width	The width of the channel when discharges are at full channel capacity, measured at the elevation of bankfull depth.
Channel	The deepest part of a stream or water body.
Channel Capacity	The maximum flow a given channel can transmit without overtopping its banks.
Downcutting	Streambed erosion that results in deep, narrow, channels.
Downstream	In the direction that flow is headed, generally to a lower elevation in the case of stream channels.
Erosion	The wearing away of soil and rock by the action of streams, mass wasting, and weathering.
Gradient	The steepness of the channel slope, referred to in percent or feet of drop in elevation per foot length of channel.
Hillslope	The flanks that form the valley walls adjacent to stream channels. Hillslopes are the zones where soil and rock are loosened by weathering processes and transported downgradient.
Incision	Downward erosion, as in a streambed. Synonymous with downcutting.
Reach	A length of stream channel with similar physical characteristics, or length of stream channel between two arbitrarily chosen landmarks, such as road crossings or other logical breaks in open channel flow.
Tributary	Any stream that contributes water to another stream.
Upstream	In the direction that flow originates, generally from a higher elevation in the case of stream channels.

## 1.0 Introduction and Summary

The Tualatin River is the major surface water feature in the City of Tualatin (City), located north of the City Center. The City manages the surface and stormwater that flows into the Tualatin River through pipes and tributary creeks, as well as flood flows from the river that backwater into tributary channels and stormwater pipes.

The City contracted with Brown and Caldwell for development of their Stormwater Master Plan to evaluate hydrology and stormwater flows, identify system deficiencies, and develop and prioritize capital improvement projects to facilitate long-term economic, social and environmental benefit of residents and businesses in Tualatin. As part of the Stormwater Master Plan, the City wanted to incorporate a stream channel assessment into the overall stormwater system evaluation. Tributary streams to the Tualatin River are an important component of the surface water network in the City. They provide conveyance and storage (both in channel and on floodplains) of water and sediment, and habitat to aquatic and terrestrial species.

This stream assessment technical memorandum (TM) provides supporting documentation for Tualatin's Stormwater Master Plan. A field assessment was conducted on priority reaches along tributary streams in September 2017. Figure 1 shows the locations of the tributary stream reaches assessed. The overall goals of the stream assessment were to:

- Provide a baseline assessment of existing physical stream conditions;
- Identify existing problem areas such as locations of channel instability or excessive erosion that may impact private or public infrastructure;
- Assess the potential for changes and impacts to the stream channel; and
- Recommend capital, operational, maintenance or other solutions for issues identified.

Results of the field assessment include recommendations for strategies that address erosion, invasive vegetation, and hillslope instability. Specific recommendations include:

- Development of policies to encourage onsite retention of stormwater and flow mitigation in neighborhoods where stream channels are susceptible to flashy runoff conditions.
- Development of vegetation management plans for stream reaches that are teeming with invasive vegetation.
- Regular inspection of infrastructure that is being impacted by erosion to monitor for further deterioration in advance of future planned capital projects.

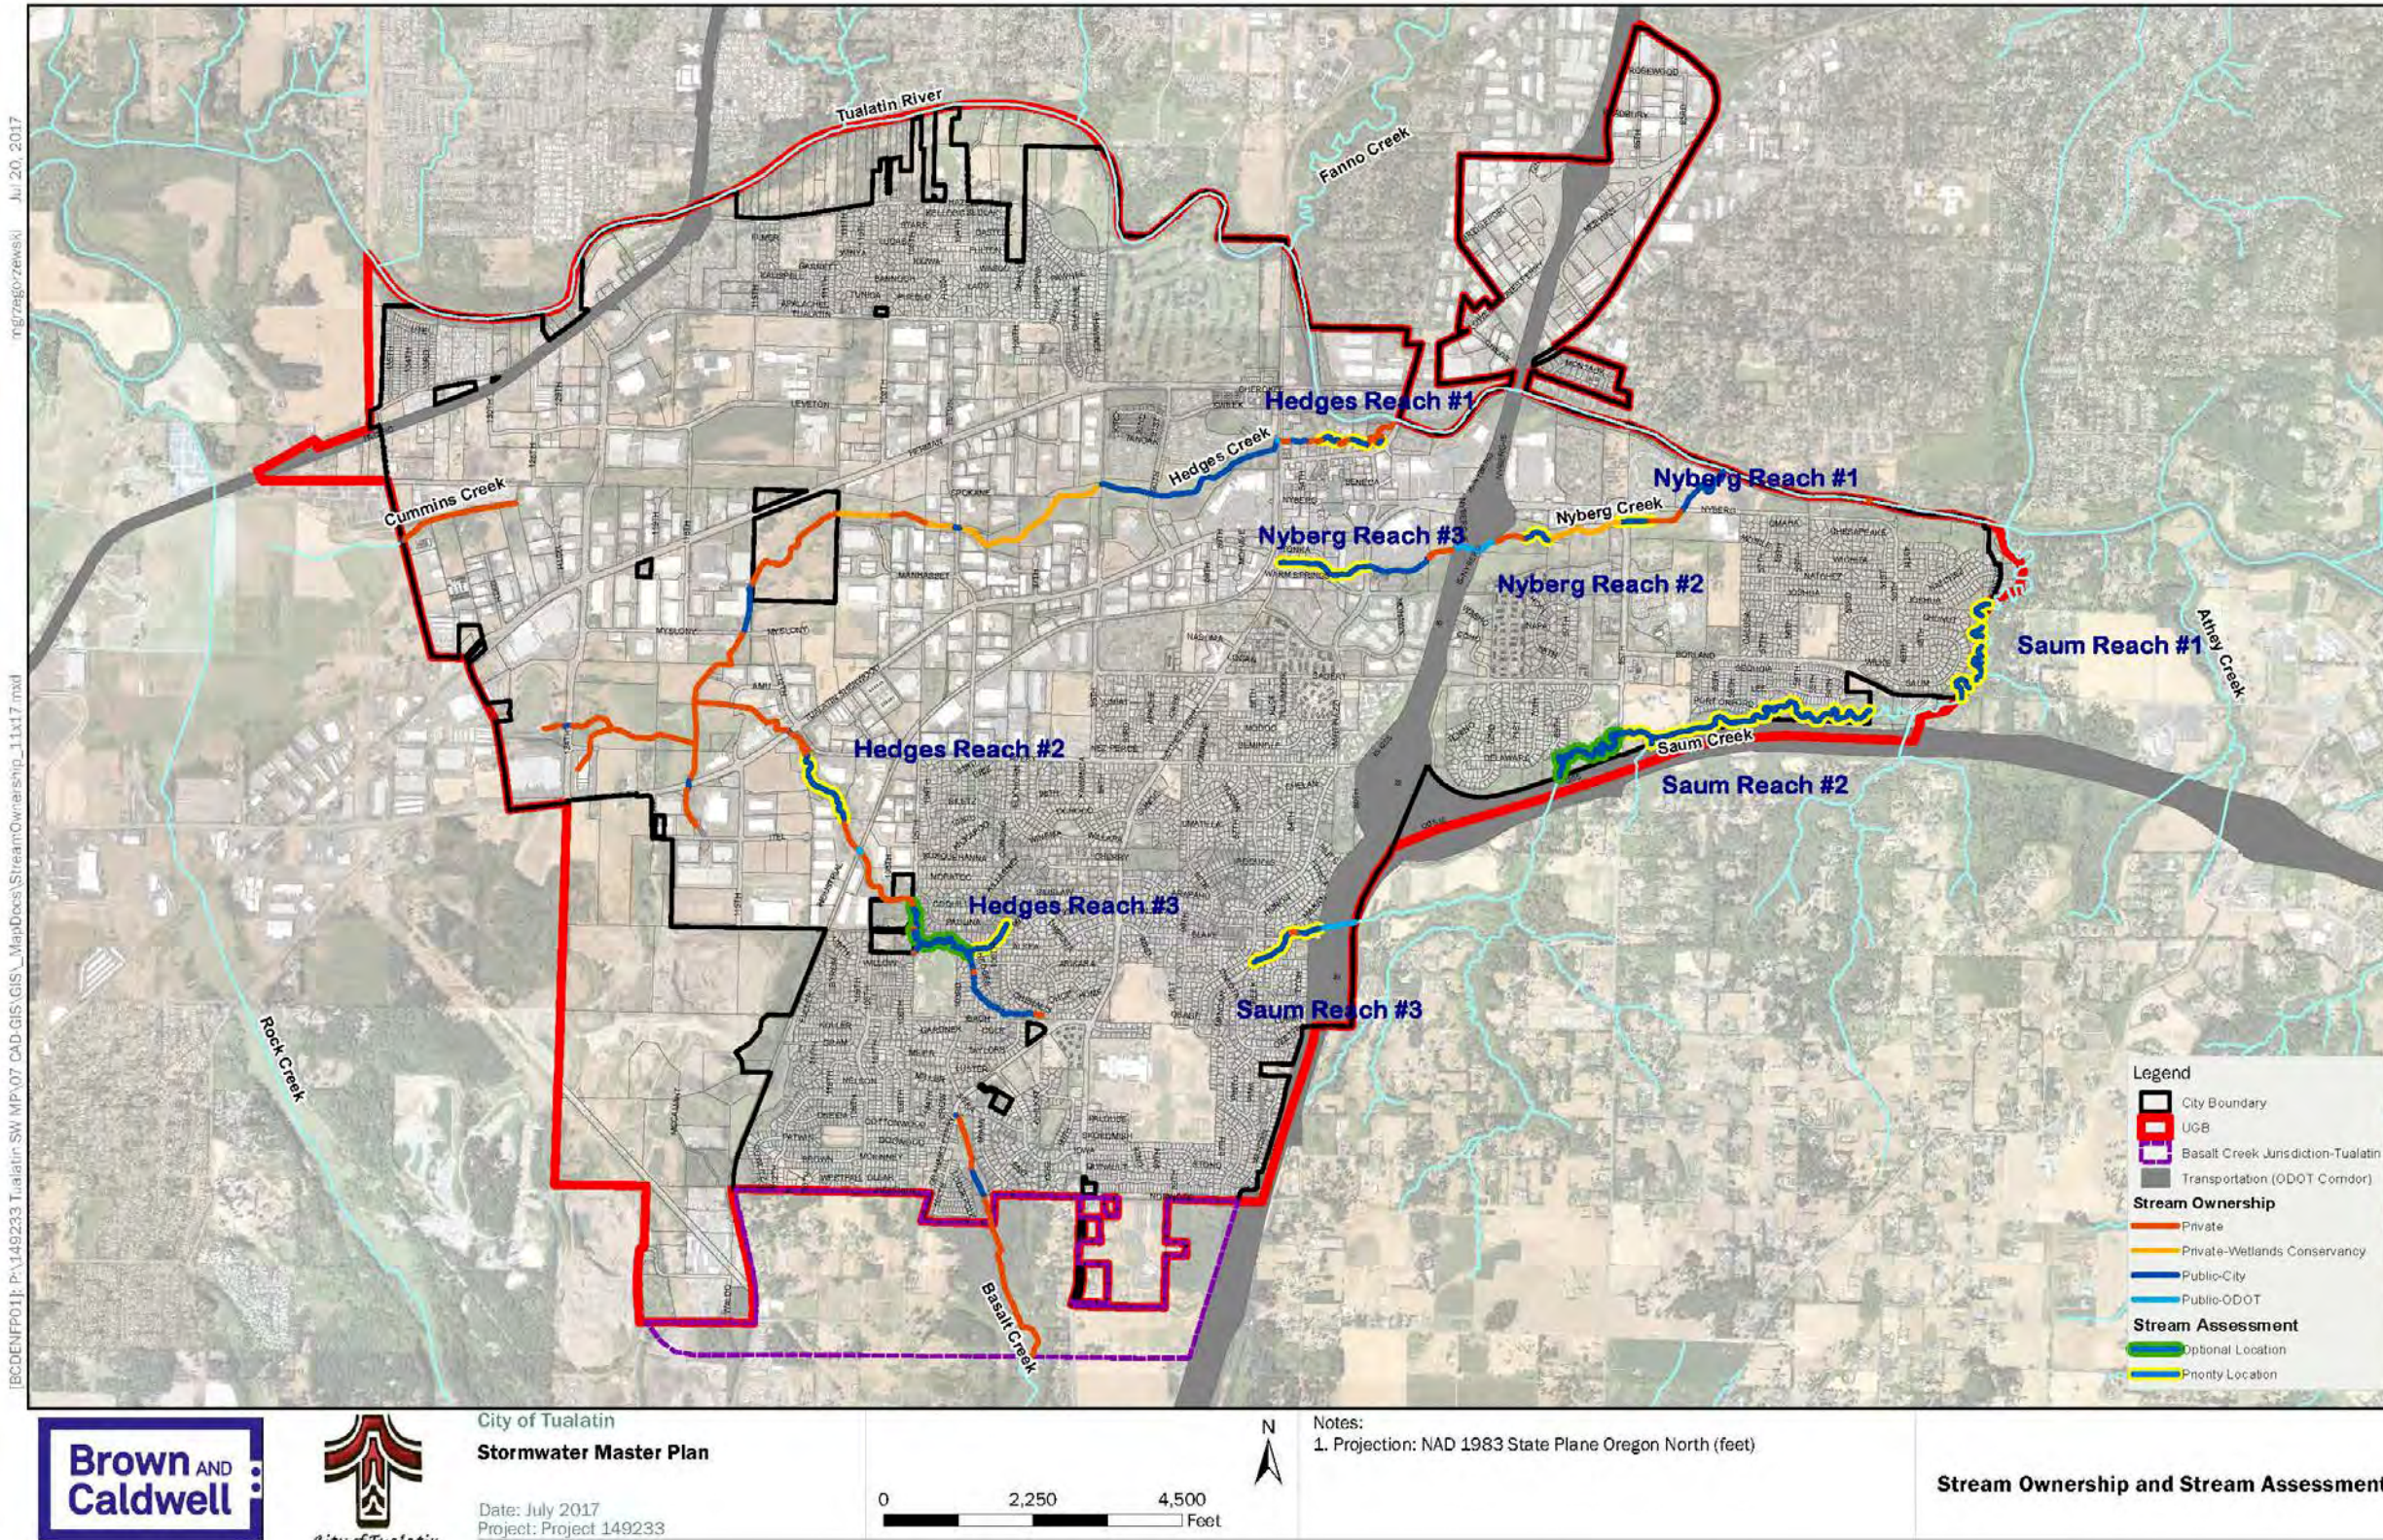


Figure 1. Vicinity Map and Location of Priority Stream Reaches Walked during Stream Assessment

## 2.0 Methodology

The stream assessment was primarily focused on direct observations gained from conducting stream walks on priority stream reaches along Saum, Nyberg, and Hedges Creeks. Priority stream reaches were identified by City staff based on ownership and a history of staff or citizen complaints/ concerns, and potential for additional stream flows due to new or redevelopment.

Prior to stream walks, maps were generated from geographic information system (GIS) coverages provided by the City. Available GIS data including major roads, City parcels, streams, and wetlands were reviewed and incorporated into field maps. Additionally, regional geologic map information was obtained online (Hart and Newcomb 1965).

The stream walks were conducted by Erin Nelson, Altaterra Consulting and Ryan Retzlaff, Brown and Caldwell between September 11, 2017 and September 15, 2017. Streams were walked in the upstream direction from the lowest point in the reach to the highest point in the reach. Photographs were taken to document conditions (generally in the upstream direction). Physical and biological conditions were noted in a field notebook and mapped with geographic references (such as road crossings) and approximate distances upstream from the starting point. The following stream characteristics were documented:

- General vegetation condition, including presence of native and non-native vegetation
- In-stream and hillslope erosion processes (incision, aggradation and hillslope failures)
- Approximate bankfull stream channel widths and depths, measured at appropriate intervals when conditions change
- General aquatic habitat conditions (pools, riffles, large woody debris, flow)
- Location of stormwater outfalls, pipes and groundwater seeps
- Potential pollution sources
- General in-stream sediment distribution throughout stream channel
- Wildlife activity (presence of beaver dams)

These characteristics were noted because they provide evidence of current aquatic health and physical channel conditions, as well as documentation that can be used to compare future stream assessment results.

Observations made during the stream walks were used to qualitatively identify current stream channel deficiencies and potential strategies for improvement. Hydrologic and hydraulic data, including historic, current or predicted stream discharges was not reviewed relative to the physical channel conditions. Analysis of this data compared to physical channel dimensions could potentially be used to predict future changes.

Table 1 provides a list of the reaches included in the assessment and the approximate reach lengths that were walked. Stream reaches were evaluated from downstream starting point to upstream end point.

Table 1. List of Stream Reaches Walked

Stream	Reach	Starting Point	End Point	Approximate Distance (ft)
Saum Creek	#1	Tualatin River	SW Prosperity Park Road	6,775
	#2	SW Lee Street (east end)	SW 65 <sup>th</sup> Ave	4,950
	#3	SW Blake Street	Upstream 530', downstream vicinity 90'	600
Nyberg Creek	#1	SW Nyberg Lane	SW 65 <sup>th</sup> Avenue	950
	#2	SW 65 <sup>th</sup> Ave	I-5	2,100
	#3	SW Martinazzi Ave	Boones Ferry Road	1,400
Hedges Creek	#1	SW Boones Ferry Road/Tualatin River	SW Tualatin Rd	2,250
	#2	Tualatin-Sherwood Rd	SW Industrial Way	1,900
	#3A	Blake St/SW 105 <sup>th</sup> Ave	Confluence with S. Tributary	1,740
	#3B	Confluence with S. Tributary	SW 99 <sup>th</sup> Ave	560

### 3.0 Stream Assessment Results

Stream channel characteristics observed during the stream walk and field investigations are described below for each reach. Additional detail is provided in the reach summary sheets included in Attachment A. Physical reach characteristics are summarized in Table 2. This information can be compared to discharge data, if available, to compare physical channel dimensions (channel capacities) to flow.

Table 2. Summary of physical stream channel characteristics by reach.

Stream	Reach	Avg. Gradient (%)	Avg. Valley Width (ft)	Avg. Bankfull Width (feet)	Avg. Bankfull Depth (feet)	Width:Depth Ratio
Saum Creek	#1	0.59	100-200	13.2	5.9	2.2
	#2	0.36	150-175	10.5	4.7	2.2
	#3 (us of Blake)	1.12	75-100	6	2	3.0
	#3 (ds of Blake)	3.0	75-100	nm	nm	nm
Nyberg Creek	#1	<0.001	300-400	nm	nm	nm
	#2	0.09	500-650	nm	nm	nm
	#3	0.3	30-60	6.5	2.5	2.6
Hedges Creek	#1	0.8	75 - 125	11.5	4.2	2.7
	#2	0.2	125-250	11.5	4.3	2.7
	#3A	0.009	~150	10.6	3.7	2.9
	#3B	3.7	~50	5.7	2.8	2.0

Notes: us = upstream, ds = downstream, nm = not measured

#### 3.1 Overall Summary

Some of the notable positive characteristics observed in the stream reaches investigated include:

- wide riparian corridors surround many of the stream channels, which is noteworthy given the otherwise urban/suburban setting of the City
- a distinct lack of trash in and around the channels

Preservation of riparian corridors and floodplains is especially important in low-gradient stream systems, where streams typically have a meandering characteristic and require space to maintain this stable channel form. Moderate and steep gradient streams are usually more confined by narrow valleys and narrower floodplains, and stable channel forms do not necessarily need as much lateral space for movement. However, wide swaths of riparian vegetation in these areas is also very beneficial to channel stability. Healthy riparian corridors in moderate and steep gradient systems supply large wood to channels as trees fall in (providing channel structure), and slope stability benefits through water interception, water uptake, and soil reinforcement from roots.

Negative characteristics observed in many of the stream reaches investigated include the presence of invasive non-native vegetation such as reed canary grass, Himalayan blackberry, jewel weed, and English Ivy. Invasive vegetation was observed in almost every stream reach, although some reaches were heavily impacted.

Physical stream channel conditions generally correlate to the reaches position in the watershed and factors such as riparian width, stream channel gradient, and channel confinement (from development or topographic conditions). Bank and bed erosion was most prevalent in the headwater reaches of the stream channels assessed (e.g., Saum Creek Reach #3 and Hedges Creek Reach #3B), where stream channel gradients were steeper, and channels were confined. These headwater reaches are also exposed to the first effects of high flows during rain events, conveyed from surrounding residential neighborhoods. There is very little in-channel or floodplain storage capacity to dissipate flows. The lower or downstream reaches of the streams generally have wide riparian corridors and floodplains to effectively dissipate peak flows from the channel to the floodplain, reducing the power to erode. Localized bank erosion was mostly observed in the lower reaches on the outside of meanders, where erosion would be expected to occur.

### 3.1 Saum Creek

Approximately 2 ¼ miles of Saum Creek were assessed between its confluence with the Tualatin River to its headwaters, upstream of I-205, near SW Blake Street. Most of the Saum Creek stream corridor within Tualatin is surrounded by a wide riparian protected greenway (the Saum Creek Greenway downstream of I-5 in Reaches #1 and #2 and the Chieftan/Dakota Greenway upstream of I-5 in Reach #3). Highlights of stream channel characteristics, and problems notes are described below and reach description summary sheets for Saum Creek Reaches #1, #2, and #3 are provided in Attachment A. Photo logs of the stream walks for Saum Creek Reaches #1, #2, and #3 are provided in Attachments B-1 through B-3.

#### 3.1.1 Saum Creek Reaches #1 and #2

The lower reaches (Saum Creek Reach #1 and Reach #2) have the benefit of a wide floodplain to accommodate high flows during flood events. There were no outstanding issues observed in either reach that stood out as needing attention. Minor erosion was observed in both reaches, but there was no indication that the erosion is currently impacting City or private property or infrastructure or that remedies are needed at this time for these minor issues. Non-native invasive vegetation was present along many portions of both reaches, intermixed with native vegetation. The City may wish to develop a vegetation management plan for the Saum Creek Greenway to ensure the success of native vegetation and reduce the proliferation of the non-native invasive species in the corridor.

#### 3.1.2 Saum Creek Reach #3

Saum Creek Reach #3 is divided by SW Blake Street. Downstream of SW Blake Street, a hillslope failure on the north side of the channel has caused the outfall that discharges stormwater piped from SW Makah Ct. to hang several feet above the stream bed (Photo 1). The hillslope failure caused several large trees to fall, resulting in a large number of branches, logs and debris in this reach. The entire north slope was saturated at the time of the site visit. Soil saturation could be a contributing factor to the slope instability in this location. The mechanisms of slope failure were not investigated in detail during the site investigation. Further investigation of the geologic condition along this slope is recommended in order to determine cause of failure and need for hillslope reinforcement.





*Photo 1. Hanging culvert on north side of Saum Creek Reach #3 in location of hillslope failure (September 2017)*

The channel upstream of SW Blake Street was restored in 2014 with a series of rock check dams and pools. This project was constructed in conjunction with a neighborhood water quality project. Prior to the restoration, the channel in this reach was significantly incised and banks were being eroded from high rates and volumes of stormwater runoff emanating from the surrounding residential development (Otak, 2013). A new stream channel gradient was established through the reach using rock weirs and splash pools to dissipate the energy (Photo 2) and the entire corridor was revegetated with native vegetation. A current view of the restoration area is shown in Photo 3. The channel structure (boulders and drop pools) is intact and erosion does not appear to be a current problem in this reach. However, the lower portion of the reach immediately upstream of SW Blake Street is very flat, and the ground is saturated (Photo 4). Saturated conditions, as well as the presence of invasive vegetation appear to be impacting native plants that have been planted in this corridor. There is a need for ongoing vegetation maintenance in the entire reach, but particularly in this area where an investment has already been made on the stream restoration project. Plant selection and/or locations may need some adjustment for the best chance of success.



*Photo 2. Otak photo of newly constructed Saum Creek channel in Chieftan/Dakota Greenway (c. 2013)*



*Photo 3. Saum Creek restoration in Chieftan/Dakota Greenway (September 2017)*



*Photo 4. Saum Creek immediately upstream of SW Blake Street. Channel is obscured by reed canary grass. This area is very flat, and wet.*

## 3.2 Nyberg Creek

Three reaches (approximately 0.84 miles) of Nyberg Creek between SW Nyberg Lane and SW Boones Ferry Road were assessed and/or walked as part of the stream assessment. Highlights of stream channel characteristics and problems noted are described below and reach description summary sheets for Nyberg Creek Reaches #1, #2, and #3 are provided in Attachment A. Photo logs of the stream walks for Nyberg Creek Reaches #1, #2, and #3 are provided in Attachments B-4 through B-6.

### 3.2.1 Nyberg Creek Reaches #1 and #2

Nyberg Reach #1 and Nyberg Reach #2 were mostly lacking stream channel characteristics at the time of the stream assessment. These reaches are wetland complexes with significant open water components (Photos 5 and 6). Beaver activity is prevalent, and is likely the reason for the extensive open water in these two reaches. There was evidence of past efforts to address the beaver activity in Nyberg Creek Reaches #1 and #2. However, the beaver activity observed did not appear to be in areas of concern with regard to infrastructure or flooding. Vegetation in Nyberg Creek Reaches #1 and #2 consisted of wetland vegetation. Due to the on-going beaver activity and the changing nature of the flooded areas that currently have wetland characteristics, there is no recommendation for vegetation management.



*Photo 5. Nyberg Creek Reach #1 downstream of SW 65th Avenue*



*Photo 6. Nyberg Creek Reach #2 downstream of I-5, with beaver swimming in foreground.*

### 3.2.2 Nyberg Creek Reach #3

Nyberg Creek Reach #3, between SW Martinazzi Avenue and Boones Ferry Rd has much different physical characteristics than Nyberg Creek Reach #1 and Reach #2. This reach is primarily confined to a narrow swath of open space between commercial development. Immediately upstream of SW Martinazzi Avenue, a notched concrete dam is present, creating a pond (known by City staff as Izzy's Pond) on the upstream side. Upstream of the pond, the channel is piped for approximately 100 feet in a strip mall parking lot. The remainder of the reach consists of open channel that is straight, narrow, and dominated by reed canary grass (Photo 7). Vegetation management is needed in this entire reach, including removal of invasive reed canary grass and replacement with other appropriate native vegetation.



Photo 7. Nyberg Creek Reach #3 upstream of SW Martinazzi Avenue.

### 3.3 Hedges Creek

Approximately 1 ¼ miles of Hedges Creek was assessed between the Tualatin River and the headwaters near SW 99<sup>th</sup> Ave. in the Ibach Park neighborhood. Hedges Creek is almost entirely within the City of Tualatin jurisdictional boundary, but much of it is under private ownership. Only a small portion of the stream was walked, at the mouth and at the headwaters. Three independent reaches (Reach #1, #2, and #3) were selected for investigation because of known issues and/or City property ownership. Reach #3 was further divided into two sub-reaches, Reach #3A and Reach #3B, because there were distinctly different characteristics observed in the downstream (#3A) and upstream (#3B) portions of the reach. Highlights of stream channel characteristics and problems notes are described below and reach description summary sheets for Hedges Creek Reaches #1, #2, #3A, and #3B are provided in Attachment A. Photo logs of the stream walks for Hedges Creek Reaches #1, #2, #3A, and #3B are provided in Attachments B-7 through B-10.

#### 3.3.1 Hedges Reach #1

Hedges Reach #1 extends from the Tualatin River to SW Tualatin Road. This reach reflects a mix of public and private ownership and is partially located within Tualatin Community Park property. The lower 1,200 feet of the channel includes meandering characteristics, except for a few straight sections. In general, the straight sections correspond with sections where the channel bed consists of hard silt. The channel bed otherwise consisted of loose sediment (fine silt and sand, with occasional gravel) in Hedges Reach #1.

Bank erosion was observed in Hedges Reach #1 at a few locations on the outside of meander bends in the first 500 feet upstream of the Tualatin River. Rip-rap armoring was observed at one location on private property approximately 450' upstream from the Tualatin River, and a concrete apron was observed on private property at another location 200' upstream from the Tualatin River. It appears that these materials were used to stabilize the stream banks, prevent erosion, and protect private property. The bank stabilization efforts appear to be locally effective in protecting property in the immediate vicinity of the stabilization.

The channel gradient is steeper in the lower (downstream) portion of the reach, flattening out in the upstream portion towards Tualatin Road.

A channel-spanning debris jam was present approximately 300 feet upstream from the mouth of the channel. This debris jam may be associated the event that washed out a private bridge approximately 500 feet upstream from the mouth. The debris and gravel deposited downstream of the bridge wash-out is still present in the channel and the culvert (Photo 8) that conveys water through the debris, directs water toward the opposite bank, due to its orientation. It is not clear whether the culvert was placed in the channel pre- or post- bridge wash out, but the culvert is undersized for the volume of flow received in the channel. The area of the culvert is smaller than the bankfull channel capacity upstream and downstream. High flows would back up at this location and eventually overtop the road and result in erosion. The channel makes a 90 degree turn against a vertical bank, 30 feet downstream of the culvert. Due to the orientation of the stream channel and the culvert which concentrates and directs flow in this location, this bank is at risk of erosion, and may be a potential threat to a private structure located on the top of the bank.

Approximately 200 feet downstream, another private structure is located on the top of the bank on the outside bend of a meander. This structure may have similar risks due to proximity to the edge of the bank. Both of these structures are east of SW Martinazzi Ave and north of SW Boones Ferry Road.



*Photo 8. Culvert placed in debris from washed out bridge to convey Hedges Creek.*

Approximately 1,200 feet upstream of the mouth, an 18-inch diameter stormwater outfall enters Hedges Creek from the south. Stormwater inputs at this location could account for some of the differences in stream characteristics upstream. Upstream of this location, in the Tualatin Community Park, the channel is mostly straight, with a wider floodplain, and a flatter gradient, and based on the channel conditions, erosive flows appear to be less frequent. No channel erosion was observed in this part of the reach. The channel is also largely overgrown with reed canary grass through this portion of the reach (Photo 9), and beaver dams were also observed. Vegetation management is needed to control reed canary grass in the Tualatin Community Park.



*Photo 9. Hedges Creek Reach #1. Reed canary grass-choked channel downstream of Tualatin Road.*

### 3.3.2 Hedges Reach #2

Hedges Creek Reach #2 is located between SW Tualatin-Sherwood Road and SW Industrial Way. It is surrounded by the Hedges Creek Greenway open space, a wide riparian floodplain area. Hedges Creek is relatively stable through this reach, with only minor erosion observed on the outside of meanders. The adjacent floodplain provides ample room for the channel to naturally meander and migrate. However, the entire reach needs extensive vegetation management due to observed, dense invasive plants including Himalayan blackberry and reed canary grass, as shown in Photo 10.



*Photo 10. Hedges Creek Reach #2.*

### 3.3.3 Hedges Reach #3A


Hedges Creek Reach #3A is located between SW 105<sup>th</sup> Avenue/Blake Street and a tributary that enters Hedges Creek from the South downstream of SW Alsea Ct. A pedestrian bridge crosses the stream channel in this location.

Hedges Reach #3A has a meandering characteristic and a relatively low gradient. Channel substrate consists of loose silt, hard silt, and an outcrop of bedrock present for about 100 feet of stream channel starting approximately 500 feet upstream of 105<sup>th</sup> Avenue. A rock wall protecting the bank (and presumably road embankment) 175 feet upstream and on the east side of 105<sup>th</sup> Avenue/Blake Street has been compromised, as it has been eroded by the stream (Photo 11). At this location, Hedges Creek makes a 90-degree turn, which is a point of maximum velocity and energy on the outside bend. It is recommended to reinforce/ rebuild the rock wall to ensure the road embankment is not compromised and/or reorient the culvert under 105<sup>th</sup> Avenue/ Blake Street to minimize flow velocity directed at the road embankment and wall. It is assumed that design and construction would be conducted in conjunction with the scheduled road widening project for 105<sup>th</sup> Avenue.

Another issue observed in Reach #3A is channel incision in a side channel entering the main channel from the south, approximately 700 feet upstream of SW 105<sup>th</sup> Avenue. The neighborhood west of Ibach Park contributes drainage to this side channel and it appears that this channel receives a large volume of water from the upstream catchment. The extreme erosion in this side channel has exposed a sanitary sewer manhole (Photo 12). This exposure, over time, may compromise the structural integrity of the manhole.

Evidence of a recent stream restoration project was observed upstream of Ibach Park (Photo 13), starting approximately 950 feet upstream of SW 105<sup>th</sup> Avenue. Large wood, bed protection matting and tiles, and root wads were placed and cabled at several different locations in the channel. It is unclear based on the locations of the restoration efforts what the goals might have been. Bank erosion and hillslope slumps were observed throughout the reach, however, property or infrastructure did not appear to be impacted or immediately threatened by the erosion. Invasive vegetation, including English ivy, and Himalayan blackberry were present throughout the reach as well.

It is recommended that locations of active channel erosion, in the vicinity of the rock wall and the sanitary sewer pipe, in this reach be monitored by the City to ensure that site conditions do not deteriorate. Additionally, the side channel entering Hedges Creek in Reach #3A has experienced erosion due to the flashiness of stormwater runoff from upstream. Flow control and onsite retention standards and policies are recommended for the City's consideration in Hedges Reach #3A, in the vicinity of the area west of Ibach Park, to mitigate for areas of active erosion and preserve the integrity of small streams such as this side channel.

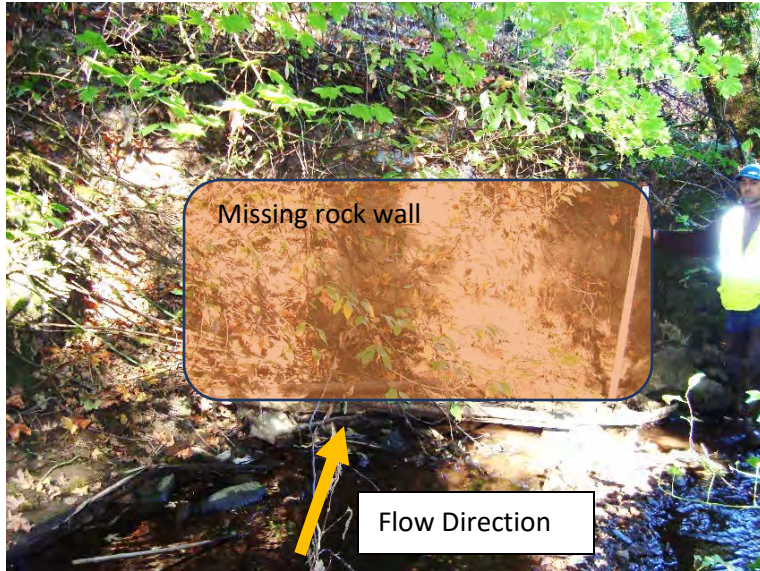

*Photo 11. Hedges Creek Reach #3A, showing rock wall location and missing rocks.*



*Photo 12. Side channel incision and erosion around sanitary sewer manhole.*





Photo 13. Restoration area showing cabled logs and root wads. Approximately 950 feet upstream of SW 105th Avenue.

### 3.3.4 Hedges Reach #3B

Hedges Creek Reach #3B is located between a tributary that enters Hedges Creek from the South downstream of SW Alsea Ct and SW 99<sup>th</sup> Avenue.

Hedges Reach #3B has a much steeper gradient than Reach #3A and the channel is incised with the width to depth ratio decreasing upstream along the reach. The channel is not stable in this reach. Adjacent slopes have failed on both banks (Photo 14) and the culvert under SW Alsea Ct. is perched resulting from erosion and downcutting at the base (Photo 15).



Photo 14. Left bank slump upstream of confluence.



Photo 15. Perched culvert on downstream side of SW Alsea Ct.

Further upstream of SW Alsea Ct. to SW 99<sup>th</sup> Ave, there is more evidence of erosion and downcutting. A culvert delivering water to the head of the channel near 9999 SW Alsea Ct. is perched approximately 6 feet above the current channel. The culvert is actively eroding the channel. It appears the channel receives a large volume of water from the upstream catchment. BC estimates approximately 140 acres of residential development is collected and conveyed undetained to this stream reach. Given the susceptibility to headwater channels to experience erosion due to the flashiness of stormwater runoff, flow control and onsite retention standards and policies are recommended for the City’s consideration in Hedges Reach #3B to mitigate for areas of active erosion and preserve the integrity of the headwater channels.

## 4.0 Findings and Recommendations

As part of the City’s stormwater master plan development, the City is defining projects and strategies to enhance or protect City resources and address stormwater-related problems occurring on City property. This stream assessment was focused on publicly owned land and resources. Findings and recommendations have been identified and developed specific to reaches observed, and do not reflect all stream conditions in the City.

The following is a summary of findings from the stream assessment and recommendations of strategies, including programmatic, projects, and policies to improve stream channel conditions in the reaches evaluated, and/or solve site specific problems.

### 4.1 Channel Erosion and Incision

Channel erosion and incision was primarily observed in Hedges Creek, and particularly in the headwaters in Reaches #3A and #3B. Table 3 summarizes the locations of channel erosion that were considered problematic from the standpoint of being a risk to property or infrastructure, and recommended strategies for addressing the situation.

*Table 3. Summary of Channel Erosion Observations and Recommended Strategies*

Stream	Reach	Approximate Location and Issue	Ownership	Recommended Strategy
Hedges Creek	#1	~500 ft. upstream of Tualatin River (washed out bridge)	Private	1. As of the writing of this report, the City is currently working with the property owner and other resource agencies to address permit compliance.
	#3A	~175 ft. upstream of SW 105 <sup>th</sup> Ave. (rock wall)	City	1. Inspect rock wall for ongoing deterioration. 2. Repair rock wall in conjunction with road project. 3. Reorient the downstream culvert to minimize flow velocity directed at embankment.
	#3A	~700 ft. upstream of SW 105 <sup>th</sup> Ave. (side channel and exposed sanitary)	City	1. Consider policies to encourage onsite retention and flow mitigation. 2. Inspect sanitary sewer manhole for ongoing exposure or deterioration.

		sewer manhole)		
	#3B	Entire stream reach (erosion and instability)	City/ Private	Consider policies to encourage onsite retention and flow mitigation.
	#3B	Culvert at 9999 SW Alsea Ct. (extreme downcutting)	City	<ol style="list-style-type: none"> <li>1. Consider policies to encourage onsite retention and flow mitigation.</li> <li>2. Implement channel reconstruction/stabilization project to protect private property (private property owner).</li> </ol>

#### 4.1.1 Flow Control

The physical conditions of Hedges Creek Reach #3 indicate that the stream channel is subjected to high flow volumes on a regular basis. There is significant erosion and downcutting at the base of two culverts and in the channel (adjacent to house 9999 SW Alsea Ct, and downstream of SW Alsea Ct) as well as bank and hillslope failures in this reach. Additionally, a side channel entering Hedges Creek near Ibach Park has experienced extreme incision, likely due to altered hydrology upstream. This side channels exposed a sanitary sewer manhole, and if the channel continues to downcut, it may further threaten the integrity of the sewer structure. Altered hydrology (from forested/ undeveloped conditions to residential development) has impacted this reach. These observed locations (see Table 3) may benefit from implementation of flow control design standards aimed at reducing both the peak flow and the duration of channel forming flows entering this reach. The City does not currently require stormwater detention or flow mitigation in conjunction with new and redevelopment and coordinates with Clean Water Services on stormwater management and stormwater design standards. The City may consider updates to their stormwater management policy to encourage onsite retention and flow mitigation in areas susceptible to hydromodification impacts, such as Hedges Reach #3.

It should be noted that flow control may not be as effective in the downstream reaches (i.e., Hedges Reach #1) because of wide floodplains and wetlands are effective at dissipating flow and reducing erosivity. It is recommended that hydrologic and hydraulic modeling be conducted to model the potential effects of flow control standards on downstream reaches.

#### 4.1.2 Road Embankment Erosion

The rock wall protecting the road embankment on 105<sup>th</sup> Avenue/Blake Street from Hedges Creek in Reach #3A was observed to be failing. Rocks have fallen into the stream, and only a few pieces of the wall remain in place. It is understood that the City plans to widen SW 105<sup>th</sup> Avenue, which will require a detailed evaluation and updated design of the road embankment and culvert crossings in relationship to the stream channel. A potential design option is to reorient the culvert in conjunction with the roadway widening project to mimic the direction of the natural stream channel and minimize flow velocity directed at the road embankment. Alternatively, reinforcement/ replacement of the existing rock wall would be needed.

#### 4.2 Vegetation Management

Nearly all the reaches assessed were impacted by invasive vegetation, with the most common species being reed canary grass, Himalayan blackberry and English Ivy. Specific locations where intense vegetation management is recommended is detailed in Table 4.

Table 4. List of Locations Recommended for Vegetation Management

Stream	Reach	Location	Ownership	Invasive Vegetation	Approximate Distance (ft)
Saum Creek	#3	Upstream of SW Blake Street in vicinity of existing restoration project (maintenance is needed).	City	Reed canary grass, Himalayan Blackberry	Approximately 200
Nyberg Creek	#3	Entire reach	Mostly City, approximately 300 feet private	Reed canary grass	1,400
Hedges Creek	#1	Tualatin Community Park	City	Reed canary grass	~500
	#2	Entire reach	City	Reed canary grass, Himalayan Blackberry	1,900

Hedges Reach #2 has the most potential for improvement. This area is within the Hedges Creek Greenway and there are established deciduous and conifer trees in the riparian corridor that provide significant shade and would aid in the establishment of newly planted vegetation if a revegetation effort was initiated. Invasive plants are successful because they thrive in environments where native plants struggle, such as areas that lack shade. Providing a hospitable environment for new plant growth, including shade from established trees, will make restoration efforts more successful.

Vegetation management efforts should include a plan for removal of invasive vegetation, replacement with native vegetation of appropriate type and quantities to be successful, irrigation (initially, until plants are established), follow-up monitoring, and on-going maintenance to continue invasive plant removal. Any efforts to remove invasive vegetation and replant with native riparian plants will require a long-term commitment to maintaining the restored areas to ensure success. At a minimum, annual inspections and potential maintenance (depending on the results of inspection) should occur following re-vegetation efforts. If annual inspections indicate no maintenance is needed, the frequency of inspections can be decreased.

#### 4.3 Slope Stability

Results of the stream assessment identified one location where a capital project may be developed to address City infrastructure potentially susceptible to failure. A perched stormwater pipe above the stream channel in Saum Creek Reach #3 was identified during the stream assessment. Stormwater discharge from this pipe will cause further erosion of the slope around it if left in its current position. A capital project is recommended to replace the pipe and repair the hillslope failure in the vicinity in conjunction with the pipe replacement. The new pipe should be placed on the hillside (i.e., thick-walled flexible pipe or similar) to the bottom of the slope, with energy dissipation provided. A geotechnical evaluation is recommended in order to determine the cause of the slope failure in the vicinity of the perched pipe, and provide input to the slope repair design.

## 5.0 References

D.H. Hart and R.C. Newcomb. USGS. Geology and Ground Water of the Tualatin Valley, Oregon. Water Supply Paper 1697. 1965. Accessed online. <https://pubs.er.usgs.gov/publication/wsp1697>

Otak 2013. Saum Creek Hydromodification and Water Quality Retrofit. Accessed online. <http://www.otak.com/news/media/saumcreekhydromodificationandwaterqualityretrofittualatinoregon/>



Attachment A  
Stream Reach Summary Sheets





# City of Tualatin


## Stream Channel Condition Survey

### Stream Reach Descriptions



Beaver dam ~ 700 ft. downstream of Borland Rd (photo location shown below with camera icon)

<b>Stream</b>	Saum Creek
<b>Reach</b>	#1 (Tualatin River to SW Prosperity Park Rd)
<b>General Characteristics</b>	
Reach Length:	~6,775 ft.
Gradient:	~0.6%
Valley Width:	~100—200 ft
Planform:	Meandering
Average BFW:	~13' (range 12' to 15')
Average BFD:	~6' (range 4' to 7')
Substrate:	Predominantly silt, some small gravel
Vegetation:	Invasive vegetation (reed canary grass, blackberries, ivy), Douglas fir
Beaver Activity:	Yes. Four beaver dams observed.
<b>Issues:</b>	Minor erosion downstream of Borland Rd.


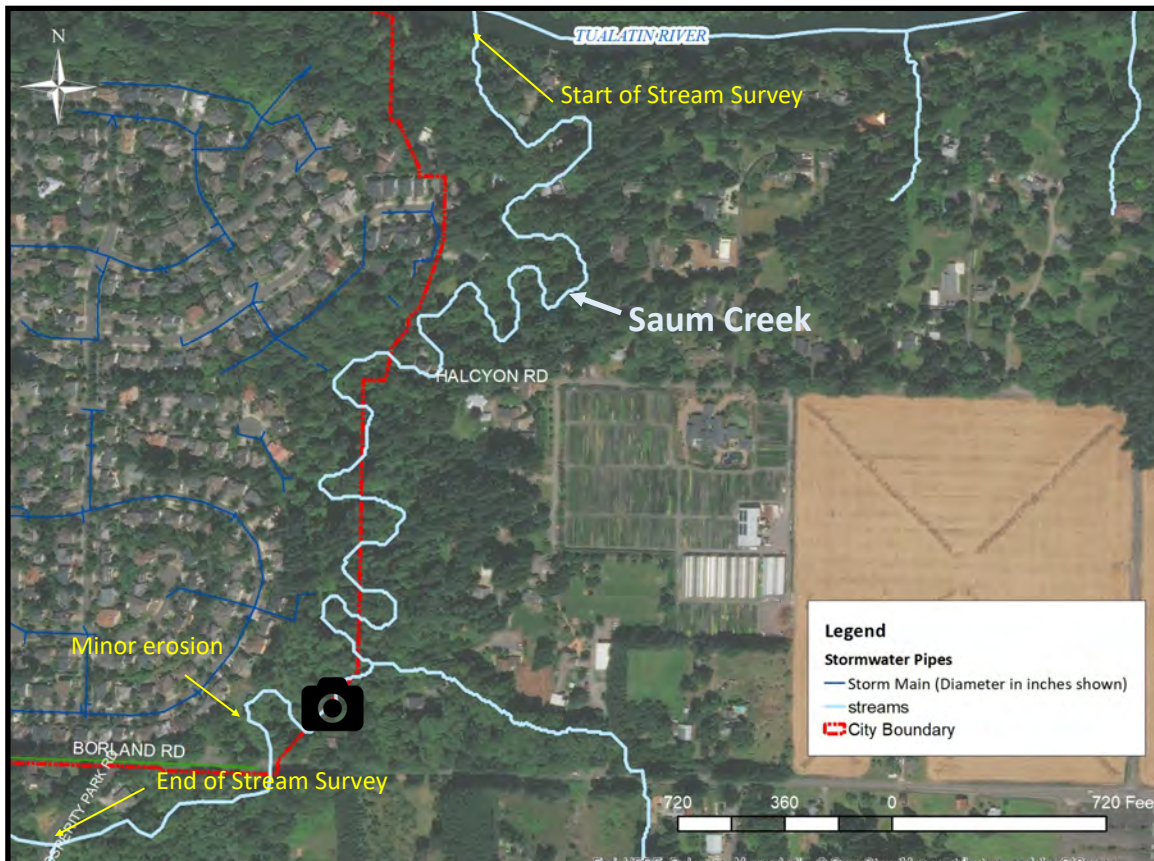


Aerial view of Saum Creek Reach #1 (Tualatin River to Prosperity Park Road)

# City of Tualatin

## Stream Channel Condition Survey

### Stream Reach Descriptions

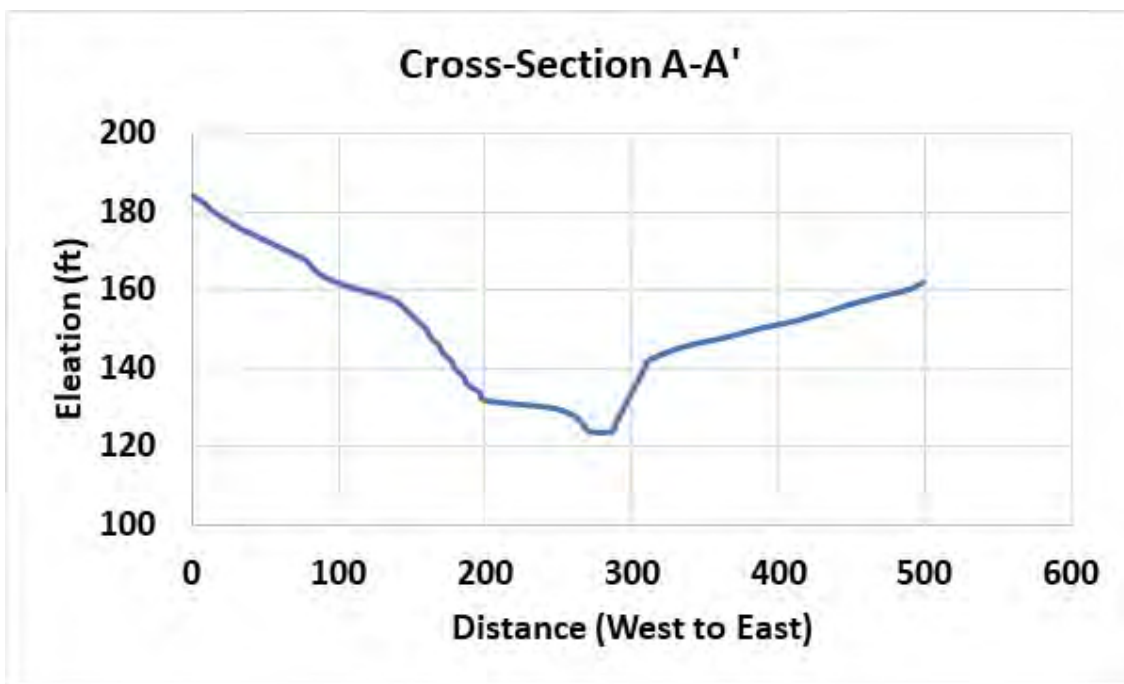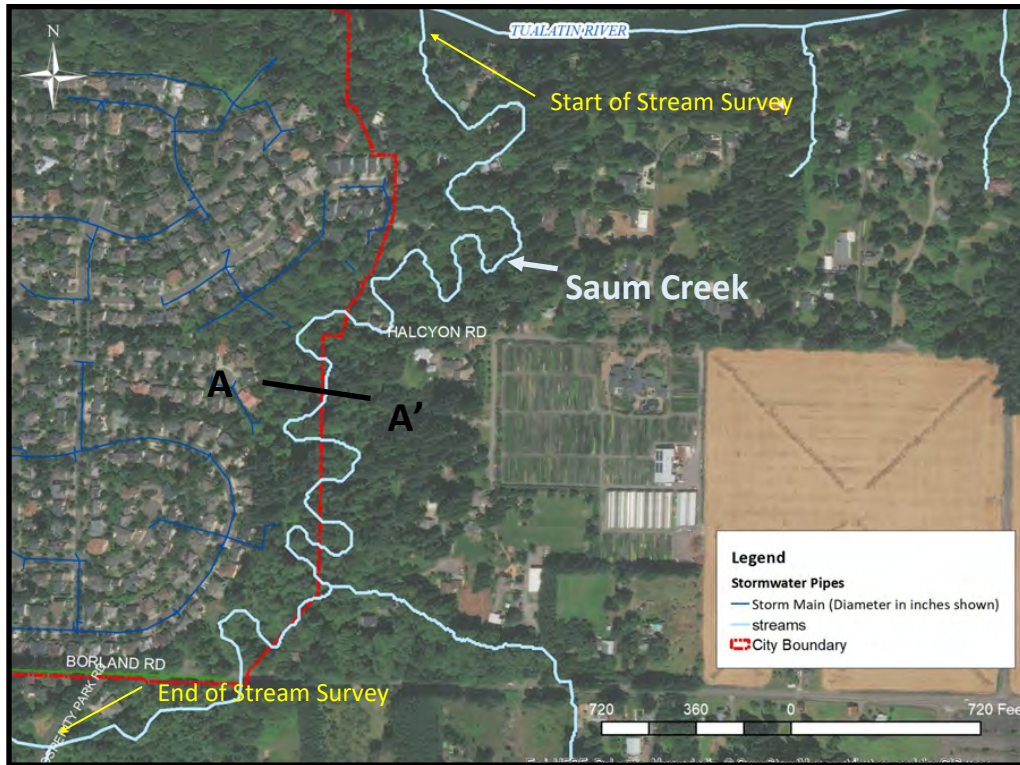

Generalized topographic cross section of Saum Creek Valley in Reach #1.

# City of Tualatin

## Stream Channel Condition Survey

### Stream Reach Descriptions



Hard clay forming pools within channel bed in Saum Creek Reach #2 (photo location shown below with camera icon)

<b>Stream</b>	Saum Creek
<b>Reach</b>	#2 (Lee St. to 65 Ave.)
<b>General Characteristics</b>	
Reach Length:	~4,950 ft.
Gradient:	~0.4 %
Floodplain Width:	~150' - 175'
Planform:	Meandering (Lee St. to SW 60th, straight (SW 60th to 65th Ave)
Average BFW:	~10' (range 8' to 15')
Average BFD:	~5' (range 3' to 6')
Substrate:	Silt, hard clay, occasional gravel
Vegetation:	Mixed floodplain forest (maples, alders, firs), reed canary grass, jewel weed, blackberries, ferns, willows, sedges
Beaver Activity:	None observed.
<b>Issues:</b>	No critical issues.




Aerial view of Saum Creek Reach #2 (SW Lee Street to 65th Avenue)

# City of Tualatin

## Stream Channel Condition Survey

### Stream Reach Descriptions

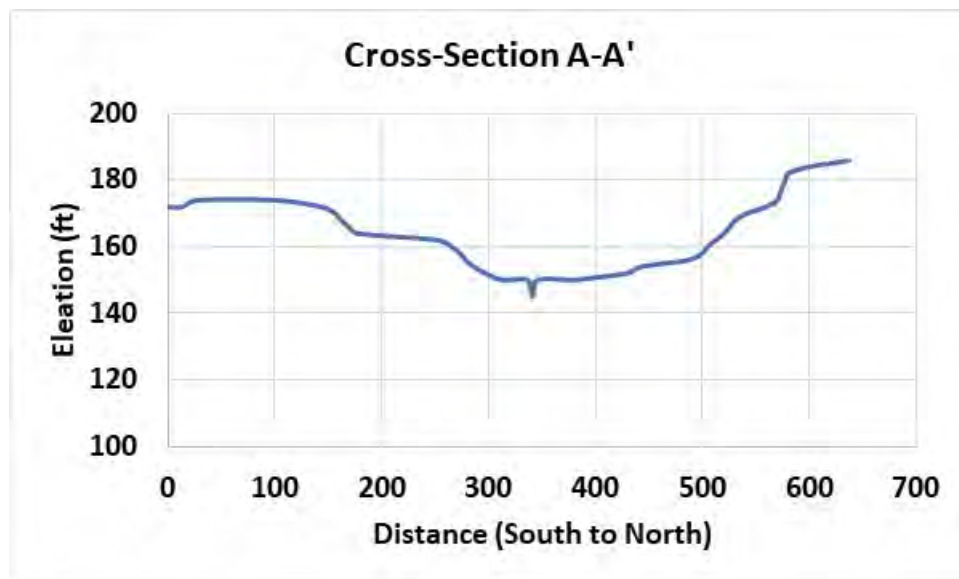

Generalized topographic cross section of Saum Creek floodplain in Reach #2.

# City of Tualatin

## Stream Channel Condition Survey

### Stream Reach Descriptions



Rock check dam and pool in restored section upstream of Blake Street (photo location shown below with camera icon)

<b>Stream</b>	Saum Creek
<b>Reach</b>	#3 (Vicinity of Blake Street)
<b>General Characteristics</b>	
Reach Length:	~600 ft.
Gradient:	~1.1 % (ds of Blake), ~3% (us of Blake)
Valley Width:	~75' to 100' (confined)
Planform:	Straight
Average BFW:	~6'
Average BFD:	~2'
Substrate:	Fine sediment
Vegetation:	Conifer and deciduous trees (many down in channel), reed canary grass, ivy
Beaver Activity:	None observed.
<b>Issues:</b>	Unstable hillslope and perched culvert, invasive vegetation.



Aerial view of Saum Creek Reach #3 (Vicinity of Blake Street)

# City of Tualatin


## Stream Channel Condition Survey

### Stream Reach Descriptions



Ponded area in Nyberg Creek Reach #1 downstream of 65th Avenue (photo location shown below with camera icon)

<b>Stream</b>	Nyberg Creek
<b>Reach</b>	#1 (Nyberg Lane to 65 Ave.)
<b>General Characteristics</b>	
Reach Length:	~950 ft.
Gradient:	~0.001% (almost flat)
Floodplain Width:	~300 –400'
Planform:	Straight, ditch-like or undefined channel (wetland, floodplain)
Average BFW:	Not measured. Mostly no single-thread channel. Multiple flow pathways.
Average BFD:	Not measured.
Substrate:	Loose silt and decaying vegetation.
Vegetation:	Wetland plants, reed canary grass, duckweed, spiraea, jewel weed
Beaver Activity:	Yes, at least two beaver dams in reach.
<b>Issues:</b>	No critical issues.


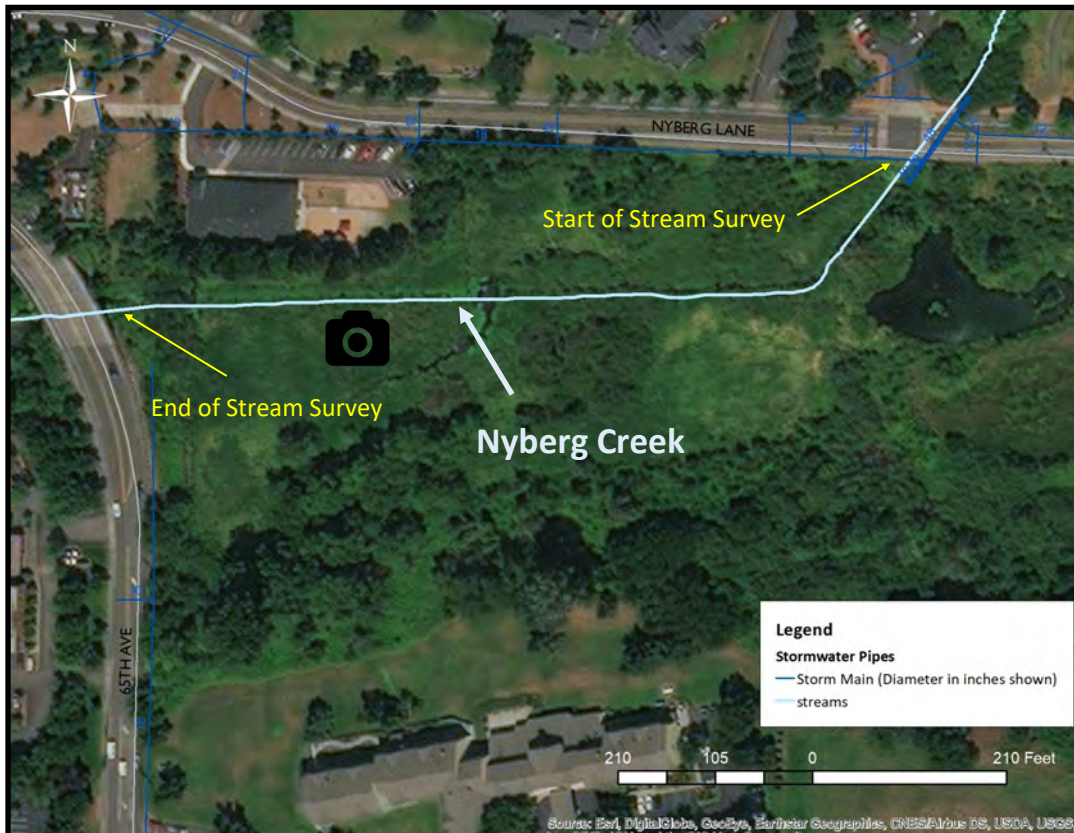


Aerial view of Nyberg Creek Reach #1 (Nyberg Lane to 65th Avenue)

# City of Tualatin

## Stream Channel Condition Survey

### Stream Reach Descriptions

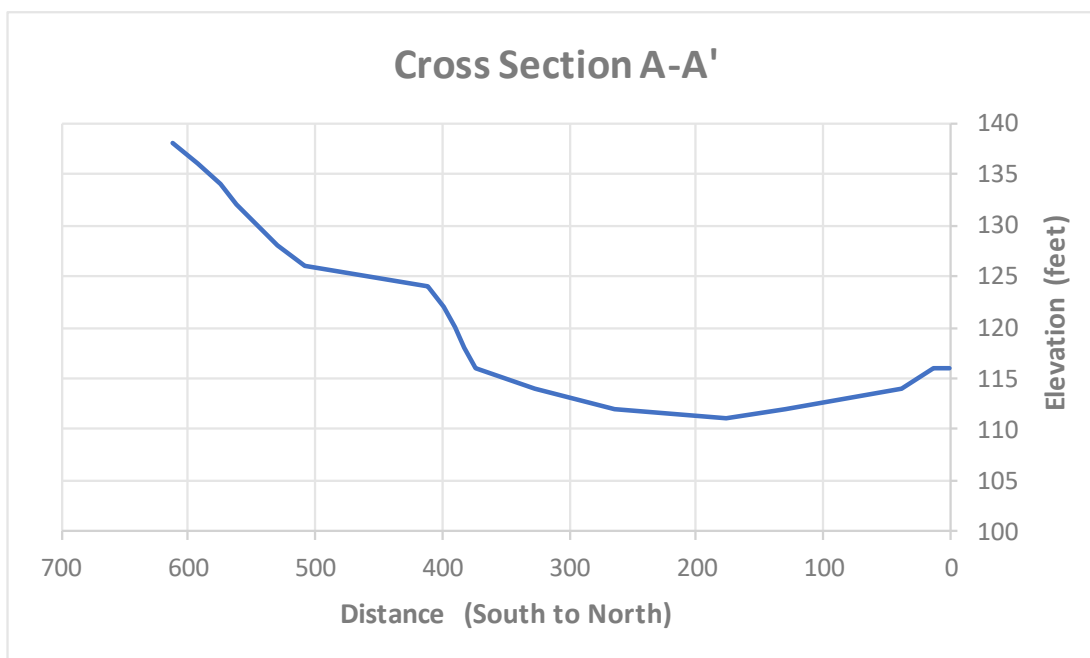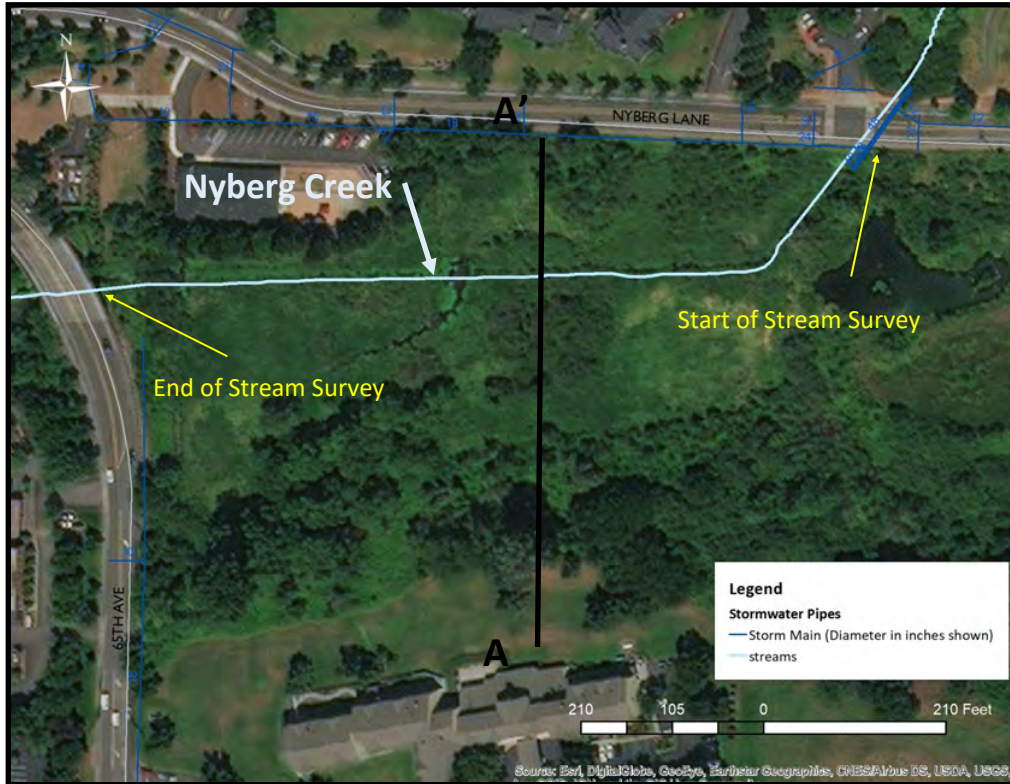

Generalized topographic valley cross section of Nyberg Creek floodplain.

# City of Tualatin

## Stream Channel Condition Survey

### Stream Reach Descriptions



Nyberg wetlands between 65th Avenue and I-5  
(photo location shown below with camera icon)

<b>Stream</b>	Nyberg Creek
<b>Reach</b>	#2 (65 Avenue to I-5)
<b>General Characteristics</b>	
Reach Length:	~2,100 ft.
Gradient:	~0.095%
Floodplain Width:	~500-650'
Planform:	Flooded, no channel.
Average BFW:	No channel. Not measured.
Average BFD:	No channel. Not measured.
Substrate:	Not evaluated. Flooded.
Vegetation:	Wetland plants, reed canary grass, duckweed, spiraea, jewel weed
Beaver Activity:	Extensive. Major beaver dam, and beavers observed during field visit.
<b>Issues:</b>	No critical issues.



Aerial view of Nyberg Creek Reach #2 (65th Avenue to I-5)



# City of Tualatin


## Stream Channel Condition Survey

### Stream Reach Descriptions



Nyberg Creek between Tonka Rd and Boones Ferry Rd. (photo location shown below with camera icon)

<b>Stream</b>	Nyberg Creek
<b>Reach</b>	#3 (Martinazzi Road to Boones Ferry Rd)
<b>General Characteristics</b>	
Reach Length:	~1,400 ft.
Gradient:	~0.29%
Valley Width:	~30-60' (channel is confined by development)
Planform:	Straight, confined by development
Average BFW:	~6.5'
Average BFD:	~2.5'
Substrate:	Fine silt.
Vegetation:	Dominated by reed canary grass, few deciduous trees.
Beaver Activity:	No.
<b>Issues:</b>	No critical issues.


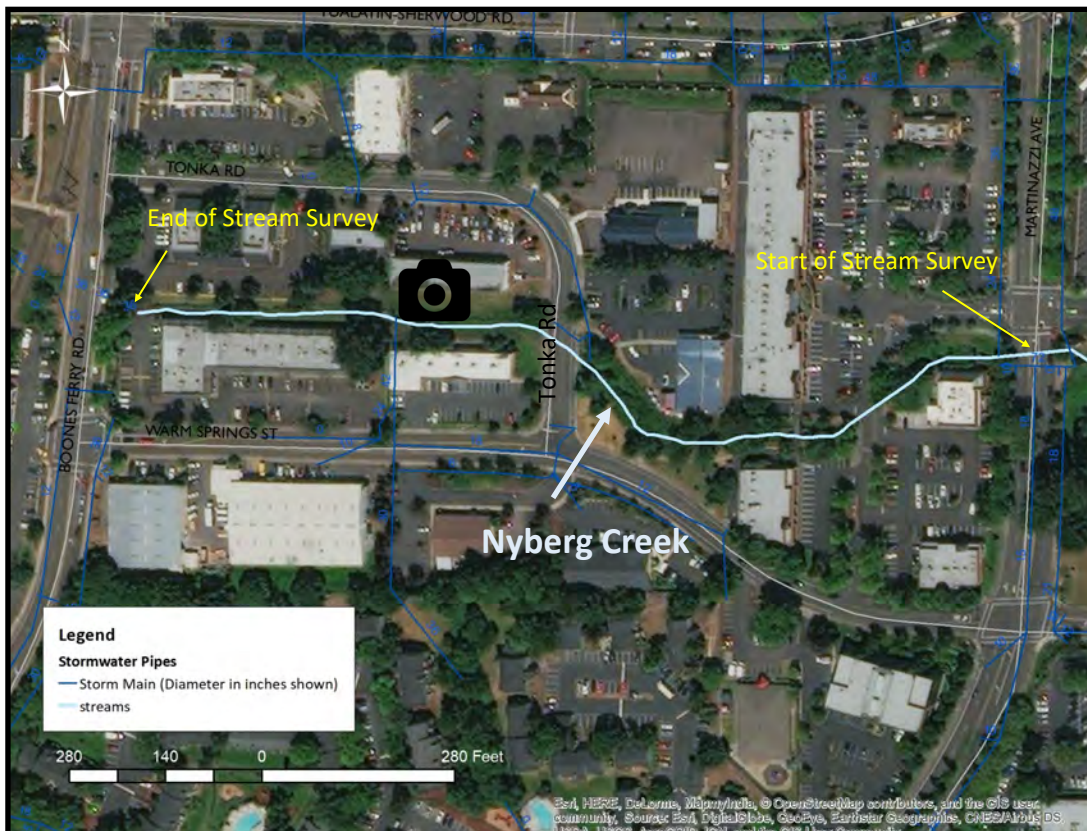


Aerial view of Nyberg Creek Reach #3 (Martinazzi Avenue to Boones Ferry Rd)

# City of Tualatin

## Stream Channel Condition Survey

### Stream Reach Descriptions

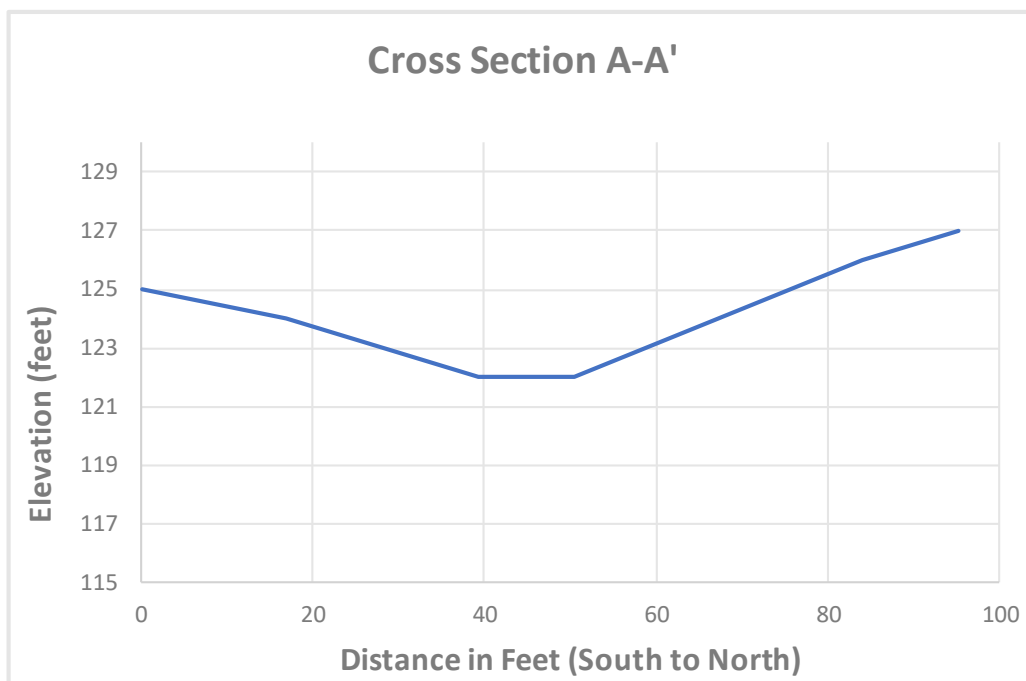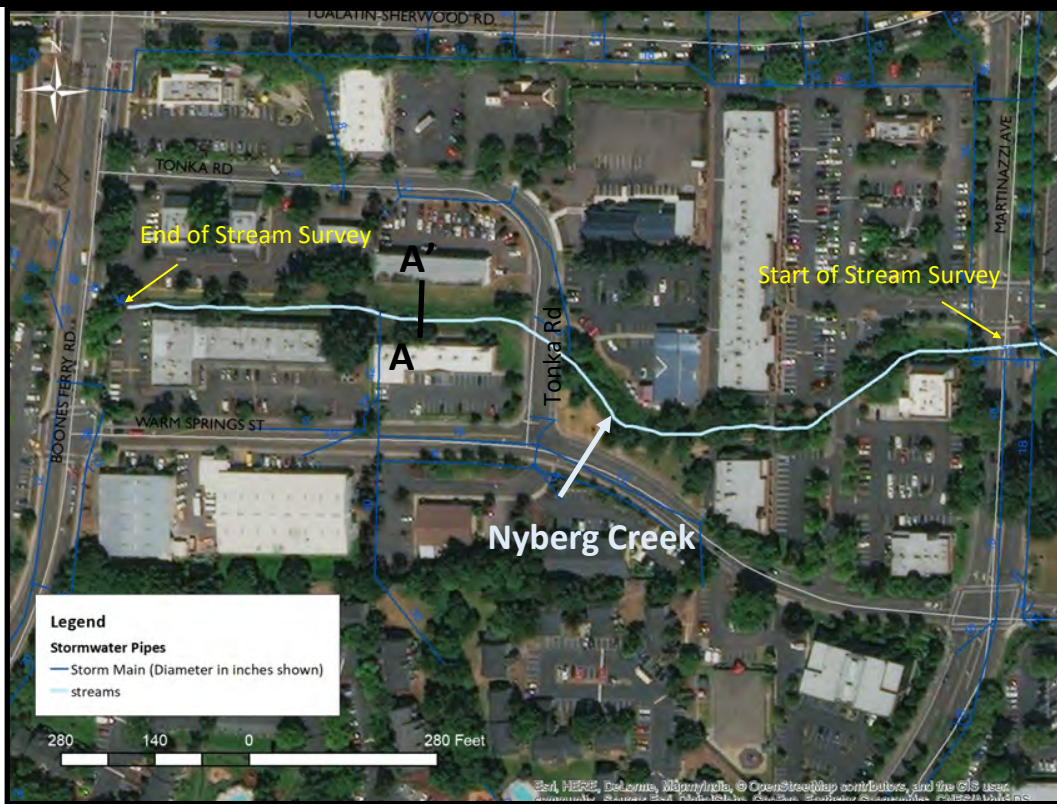

Generalized topographic valley cross section of Nyberg Creek between Tonka Rd. and Boones Ferry Rd.

# City of Tualatin

## Stream Channel Condition Survey

### Stream Reach Descriptions



Channel-spanning debris jam in Hedges Creek Reach #1 approx. 300' upstream of Tualatin River (photo location shown below with camera icon)

<b>Stream</b>	Hedges Creek
<b>Reach</b>	#1 (Tualatin River to Tualatin Rd)
<b>General Characteristics</b>	
Reach Length:	~2,250 ft.
Gradient:	~0.8%
Valley Width:	~75-125'
Planform:	Meandering and straight, where confined
Average BFW:	~11.5' (wider near Tualatin, channel narrows upstream)
Average BFD:	~4.2'
Substrate:	Varies. Gravel and large rocks near mouth, hard silt in straight sections.
Vegetation:	Conifer and deciduous trees in lower section, reed canary grass, nettles, blackberries.
Beaver Activity:	Yes, upper half of reach.
<b>Issues:</b>	Bank erosion near private property. Washed out private bridge. No City issues.





Aerial view of Hedges Creek Reach #1 (Tualatin River to Tualatin Rd.)

# City of Tualatin

## Stream Channel Condition Survey

### Stream Reach Descriptions

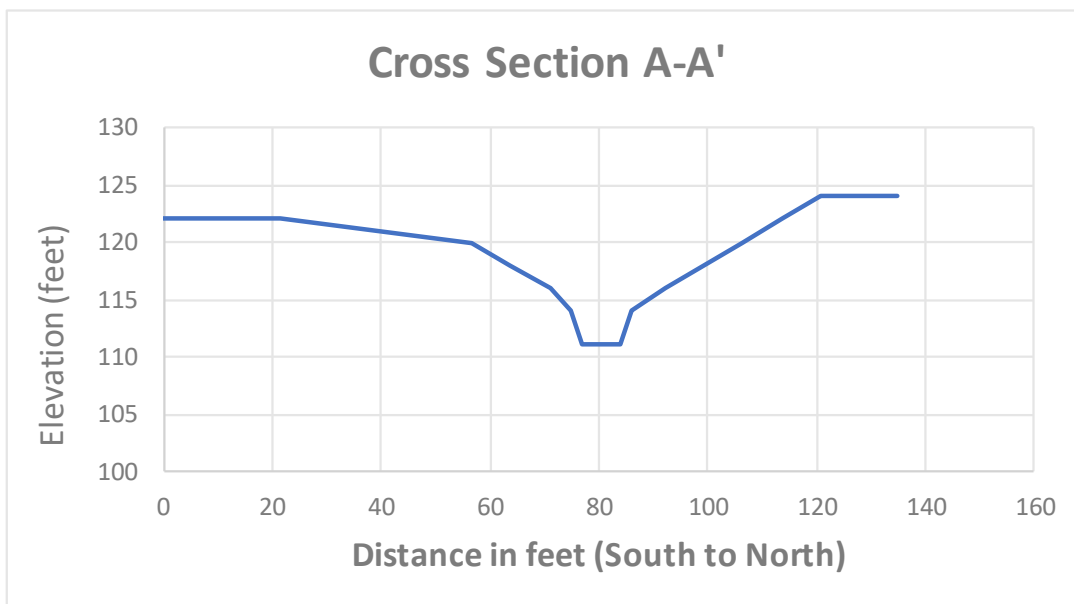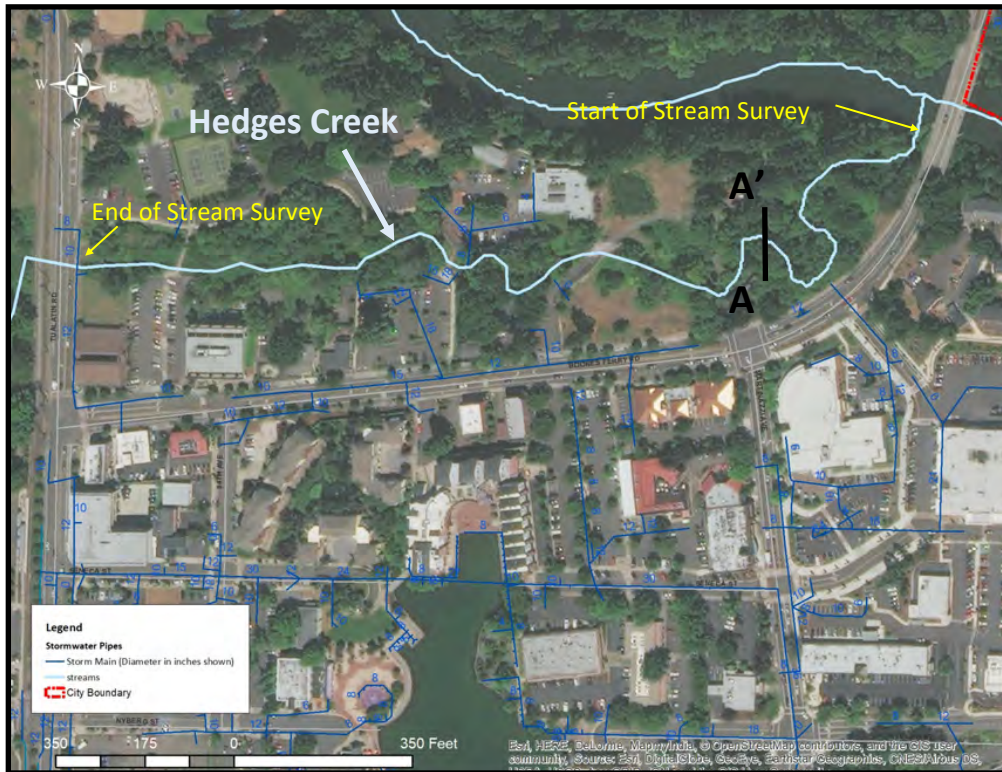

Generalized topographic valley cross section of Hedges Creek Reach #1.

# City of Tualatin

## Stream Channel Condition Survey

### Stream Reach Descriptions





Typical photo of Hedges Creek Reach #2. Stream channel is overgrown with invasive vegetation. Channel is to the right and 4' below Ryan (standing on the bank). Photo location shown below with camera icon.

<b>Stream</b>	Hedges Creek
<b>Reach</b>	#2 (Tualatin-Sherwood Rd. to Industrial Way)
<b>General Characteristics</b>	
Reach Length:	~1,900 ft.
Gradient:	~0.2%
Valley Width:	~125-250'
Planform:	Meandering
Average BFW:	~11.5'
Average BFD:	~4.3'
Substrate:	Clay, hard silt.
Vegetation:	Reed canary, blackberries, nightshade, jewel weed, some deciduous and conifer trees.
Beaver Activity:	Yes, one beaver dam noted.
<b>Issues:</b>	Invasive vegetation.



Aerial view of Hedges Creek Reach #2 (Tualatin-Sherwood Rd to Industrial Way)

City of Tualatin  
Stream Channel Condition Survey  
Stream Reach Descriptions

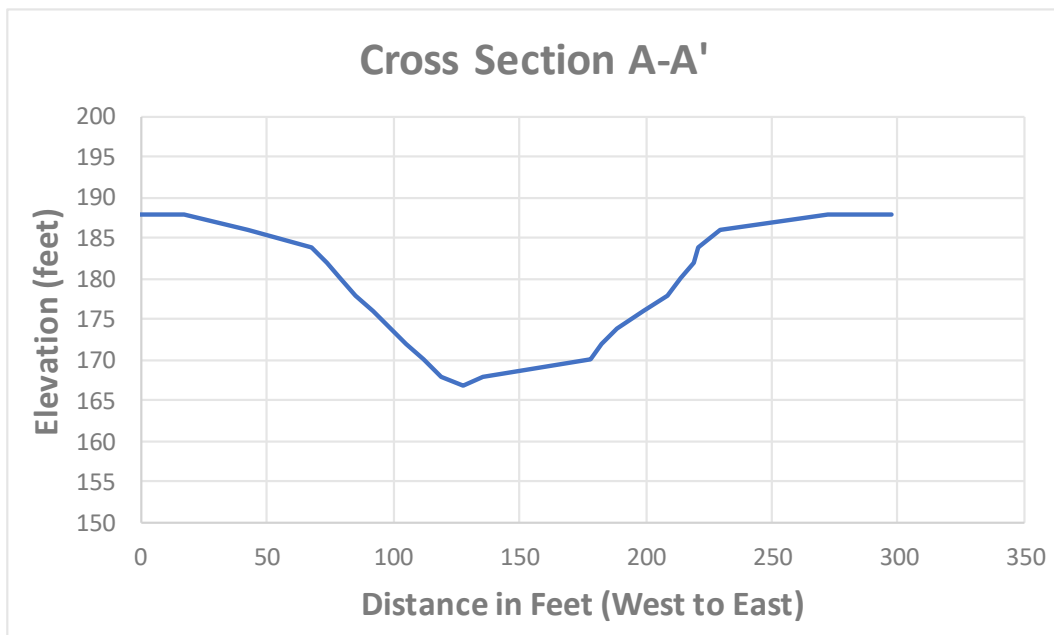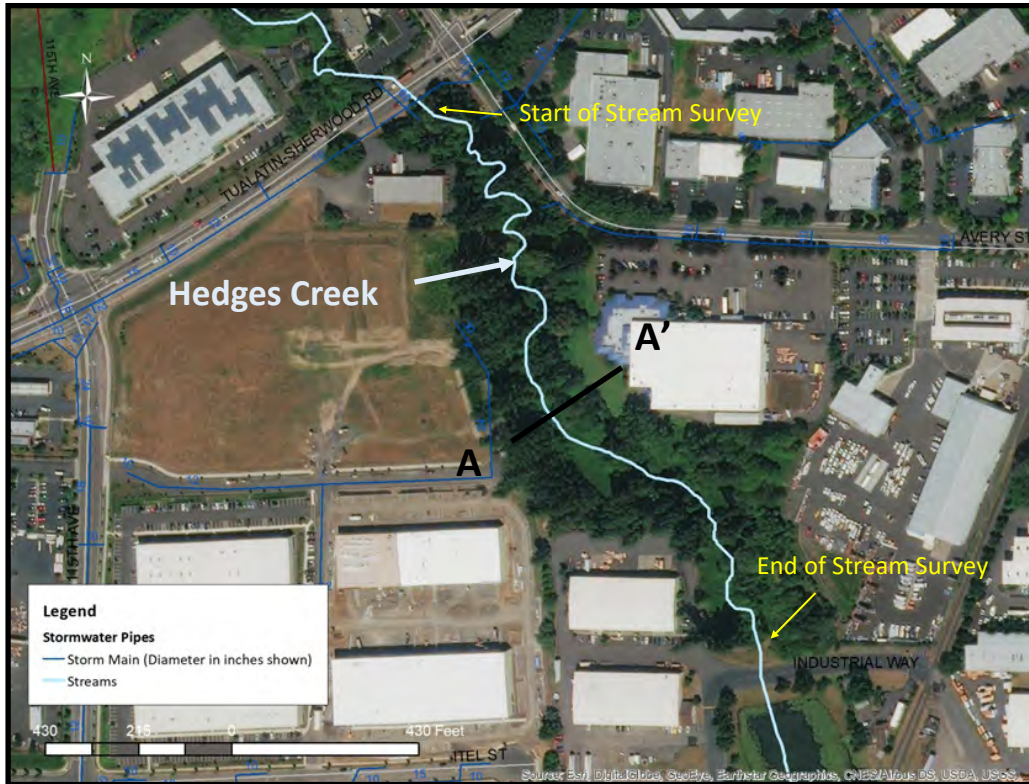

Generalized topographic valley cross section of Hedges Creek Reach #2.

# City of Tualatin


## Stream Channel Condition Survey

### Stream Reach Descriptions





Incised side channel of Hedges Creek. Photo location shown below with camera icon.

<b>Stream</b>	Hedges Creek
<b>Reach</b>	#3A (Blake St/105th St to Confluence with S. Tributary)
<b>General Characteristics</b>	
Reach Length:	~1,740 ft.
Gradient:	~0.9 %
Valley Width:	~50-150'
Planform:	Meandering and straight (where steep and confined)
Average BFW:	~10.5'
Average BFD:	~3.6'
Substrate:	Varies. Hard silt, bedrock, gravel, and loose silt.
Vegetation:	Conifer and deciduous trees, reed canary grass, nettles, blackberries.
Beaver Activity:	None observed.
Issues:	Channel incision adjacent to sanitary sewer manhole, and bank erosion and rock wall failure adjacent to Blake St./105th St.

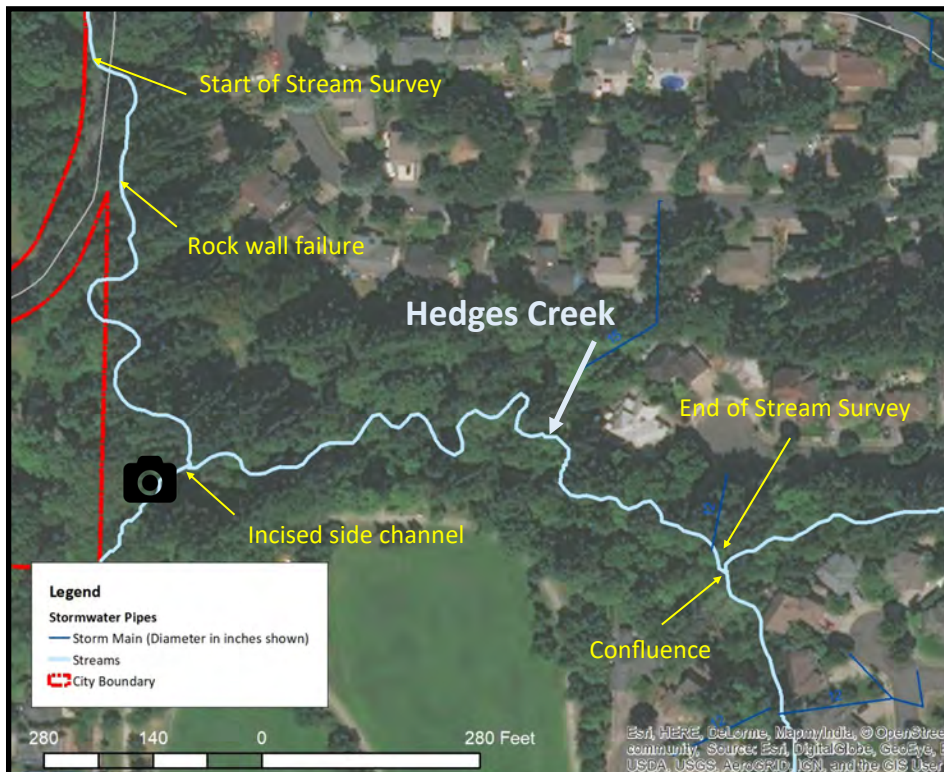

Aerial view of Hedges Creek Reach #3 (Blake St/105th St to Confluence with S. Tributary)

City of Tualatin  
Stream Channel Condition Survey  
Stream Reach Descriptions

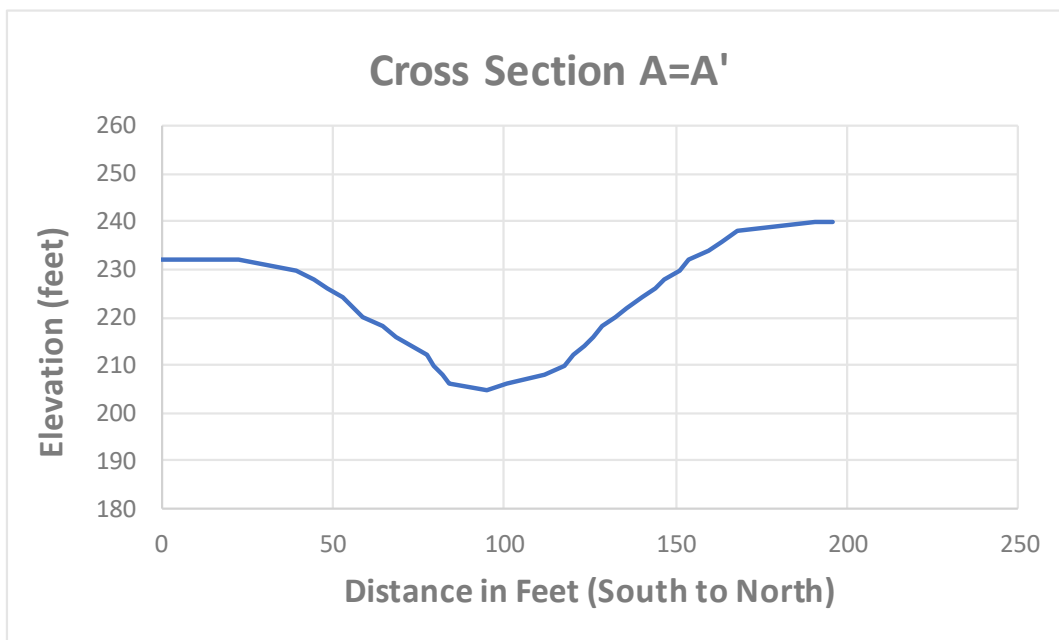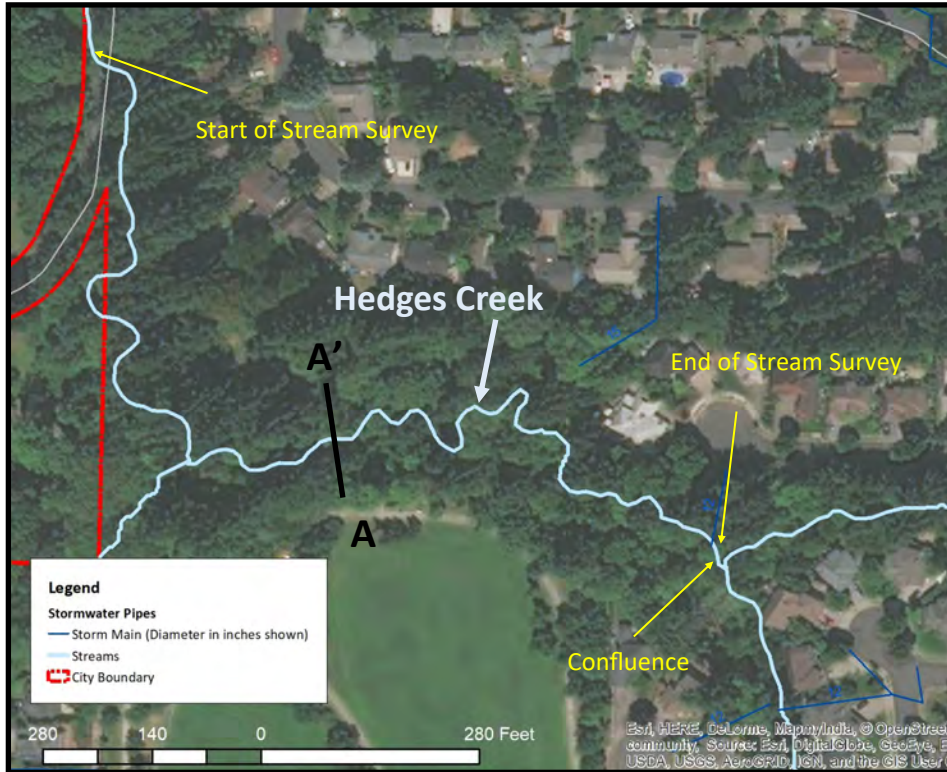

Generalized topographic valley cross section of Hedges Creek Reach #3 downstream of confluence.



# City of Tualatin


## Stream Channel Condition Survey

### Stream Reach Descriptions



Unstable hillslope and debris in channel. Photo Location shown below with camera icon.

<b>Stream</b>	Hedges Creek
<b>Reach</b>	#3B (Confluence with S. Tributary to SW 99th Ave)
<b>General Characteristics</b>	
Reach Length:	~560 ft.
Gradient:	~3.7%
Valley Width:	~50-150'
Planform:	Straight
Average BFW:	5.5'
Average BFD:	2.8'
Substrate:	Varies. Hard silt, gravel, and loose silt.
Vegetation:	Conifer and deciduous trees, reed canary grass, nettles, blackberries.
Beaver Activity:	None observed.
Issues:	Extreme erosion/channel downcutting in proximity to private property, and hillslope failures.


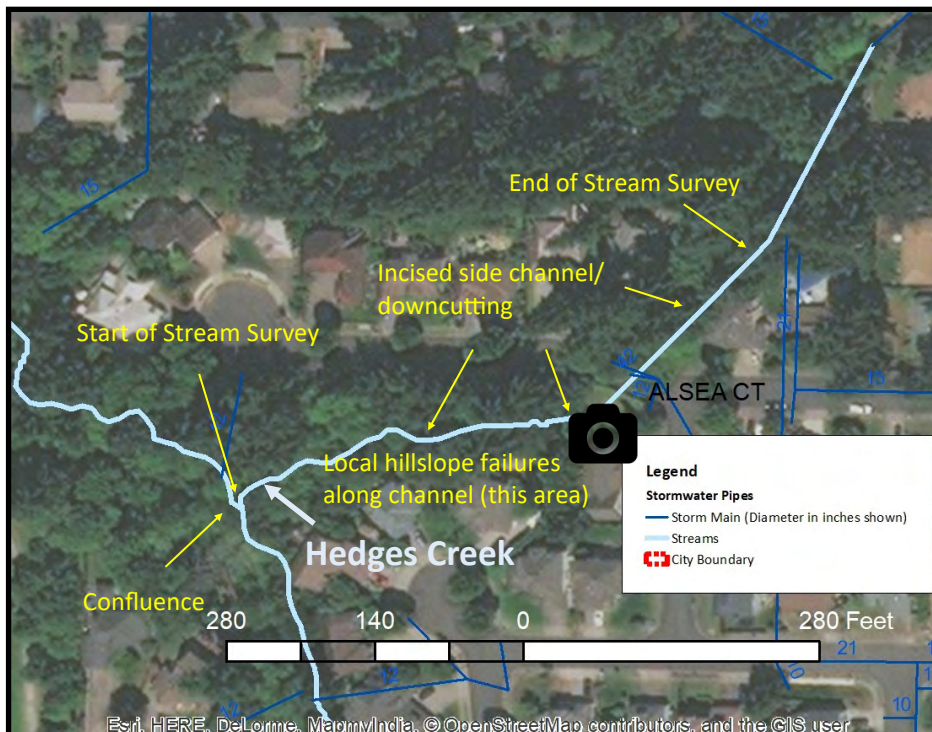


Aerial view of Hedges Creek Reach #3B (Confluence with S. Tributary to SW 99th Avenue)

# City of Tualatin

## Stream Channel Condition Survey

### Stream Reach Descriptions

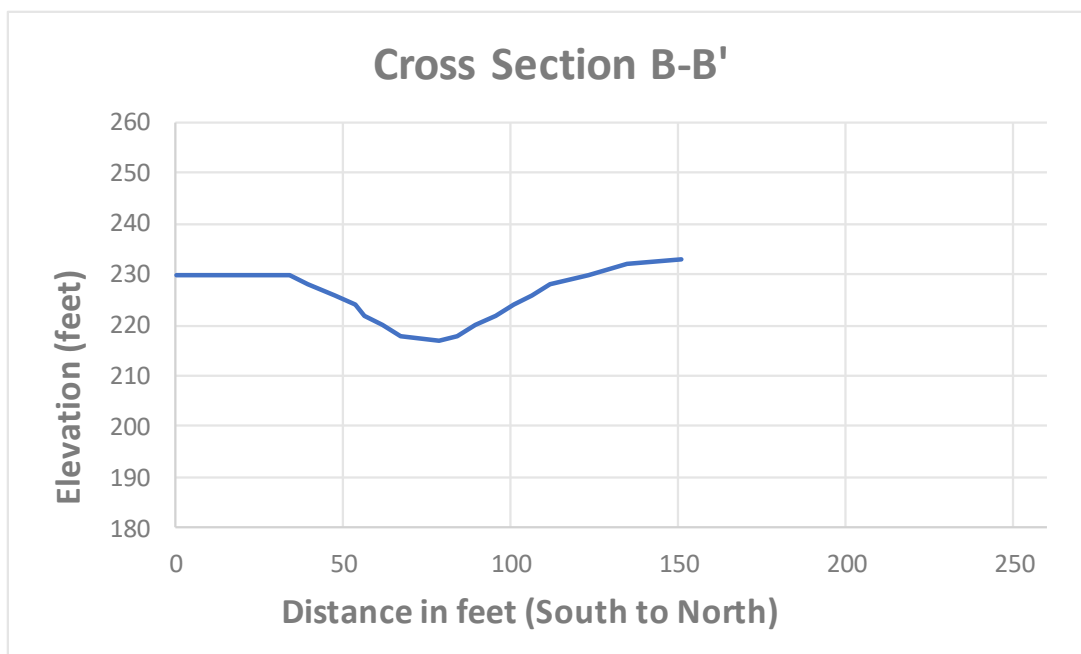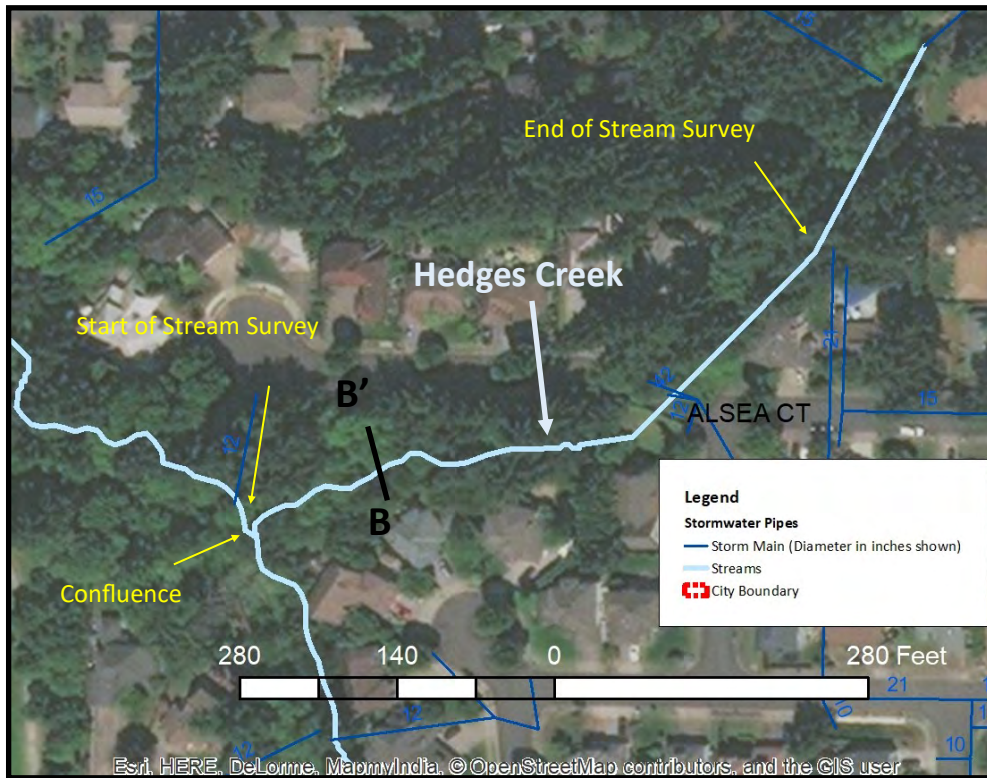

Generalized topographic valley cross section of Hedges Creek Reach #3 upstream of confluence.



Attachment B-1

Saum Creek Reach #1 Photo Log

## Attachment B-1

# Photo Documentation

## Saum Creek Reach #1 (Tualatin River from mouth to SW Prosperity Park Rd.)


Photographs and descriptions of the field investigation (by site) are provided on the following pages. Photographs are shown in the order that the stream survey was conducted, from the most downstream point in the reach to the most upstream point in the reach. In general, photos were taken in the upstream direction, except where noted. Photographs are labeled with a unique identifier that includes photograph number and stream reach identification. Photographs in Saum Creek Reach #1 are identified as S1-X, with X being the number of the photograph. Photo locations are shown in Figure 1.



Figure 1. Saum Creek Reach #1 Photo Location Points



**Site location:** Near Tualatin River  
**Photo number:** Tual-1  
**Description:** Flood marker on utility pole (1996 flood). Red arrow shows marker location.

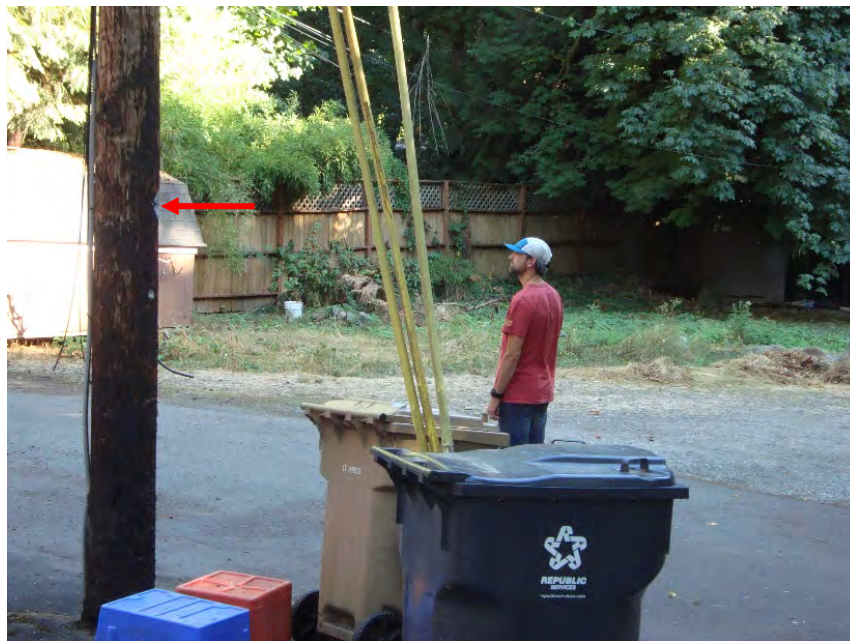

**Site location:** Near Tualatin  
**Photo number:** Tual-2  
**Description:** View of utility pole with flood marker (1996 flood). Red arrow shows marker location.



**Site location:** Tualatin River  
**Photo number:** S1-1  
**Description:** Tualatin River from mouth of Saum Creek- looking north




**Site location:** 30' upstream  
**Photo number:** S1-2  
**Description:** 7' high vertical bank (right bank) unstable, bamboo



**Site location:** ~200' upstream from Tualatin  
**Photo number:** S1-3  
**Description:** Former bridge abutment, looking upstream at left bank



**Site location:** ~400' upstream from Tualatin River  
**Photo number:** S1-4  
**Description:** Corrugated steel pipe (former water intake?) on left bank

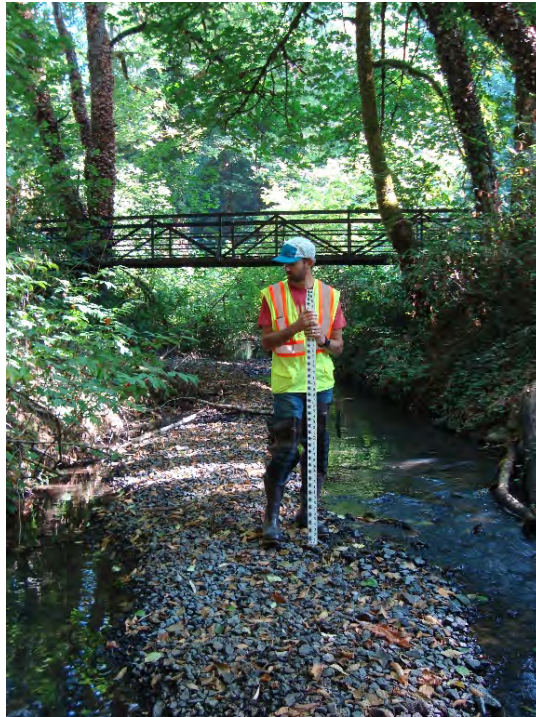

**Site location:** ~750' upstream from Tualatin

**Photo number:** S1-5

**Description:** Gravel deposition in bed (angular rock, construction debris?), pedestrian bridge in background, looking upstream



**Site location:** ~800' upstream of Tualatin

**Photo number:** S1-6

**Description:** Private driveway culvert crossing (6'), looking upstream





**Site location:** ~850' upstream of Tualatin, 20' upstream of culvert

**Photo number:** S1-7

**Description:** Old 3' high concrete weir wall (2 ½' wide opening) with pool on downstream end. Weir is leaning downstream and sediment has deposited behind it on upstream side.



**Site location:** ~800' downstream of SW Halcyon Rd. culvert crossing

**Photo number:** S1-8

**Description:** Silty bottom, water depth 1 ½' - 2', bankfull width ~ 12', bankfull depth ~ 6'



**Site location:** SW Halcyon Rd. culvert crossing

**Photo number:** S1-9


**Description:** Looking upstream- twin 6' culverts, plunge pool on downstream end



**Site location:** 20' upstream of SW Halcyon Rd. crossing

**Photo number:** S1-10

**Description:** Channel looking downstream

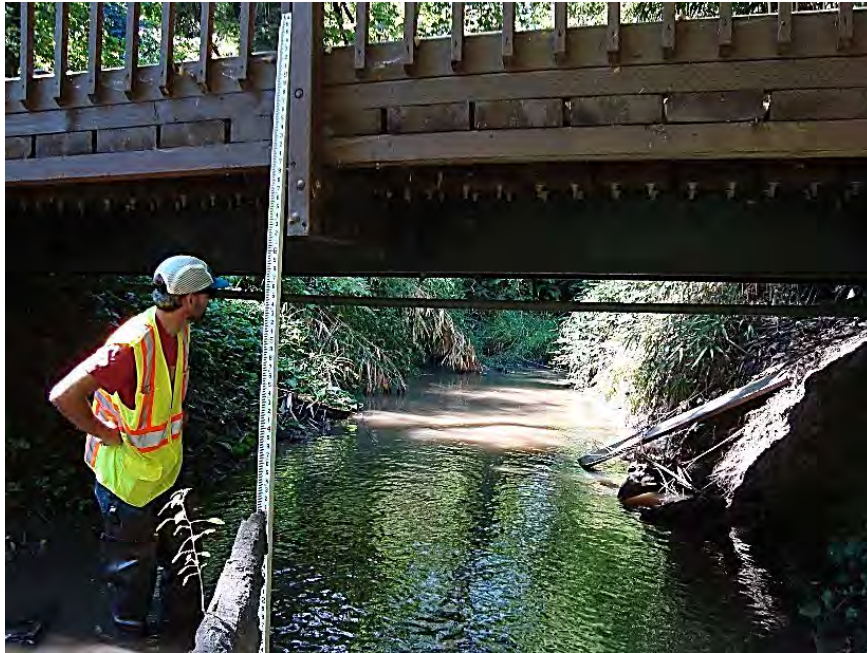

**Site location:** Driveway bridge ~150' upstream of SW Halcyon Rd.

**Photo number:** S1-11

**Description:** Looking downstream



**Site location:** ~300' upstream of SW Halcyon Rd.

**Photo number:** S1-12

**Description:** Looking upstream at pedestrian bridge, large wood in channel in distance



**Site location:** 800' upstream from SW Halcyon Rd.  
**Photo number:** S1-13  
**Description:** Slightly more gravel in channel in this reach



**Site location:** 850' upstream from SW Halcyon Rd.  
**Photo number:** S1-14  
**Description:** Looking upstream at beaver dam, debris on branches (high water mark near Ryan's right hand ~4.5 feet above channel bed)



**Site location:** ~1,200' downstream from SW Borland Rd.  
**Photo number:** S1-15  
**Description:** Pedestrian bridge looking upstream, silty bed



**Site location:** ~1,200' downstream from SW Borland Rd.  
**Photo number:** S1-16  
**Description:** Pedestrian bridge looking downstream, large tree down across channel in distance



**Site location:** ~ 700' downstream of SW Borland Rd.  
**Photo number:** S1-17  
**Description:** Beaver dam, ivy-covered trees in distance, looking upstream



**Site location:** 300' downstream of SW Borland Rd.  
**Photo number:** S1-18  
**Description:** Riprap left bank outside bend



**Site location:** 150' downstream of SW Borland Rd.

**Photo number:** S1-19

**Description:** Left bank slump, seepage, wetland plants observed in vicinity



**Site location:** SW Borland Rd. culvert

**Photo number:** S1-20

**Description:** Looking upstream (10 1/2' high, 10' wide)



**Site location:** 600' upstream of SW Borland Rd.

**Photo number:** S1-21

**Description:** Broken pipe (right side of photo) on left bank, looking upstream



**Site location:** SW Prosperity Park Rd culverts

**Photo number:** S1-22

**Description:** Looking upstream at twin 36" culverts





Attachment B-2

Saum Creek Reach #2 Photo Log





**Site location:** 50' upstream of SW Lee St. (starting location)  
**Photo number:** S2-1  
**Description:** Hard silt on bottom of channel, creates riffles, looking upstream



**Site location:** South of SW 45<sup>th</sup> Terrace  
**Photo number:** S2-2  
**Description:** Looking upstream



**Site location:** South of SW 55<sup>th</sup> Terrace  
**Photo number:** S2-3  
**Description:** Wide floodplain bench left bank (right side of photo)



**Site location:** Between SW 55<sup>th</sup> and SW 56<sup>th</sup>, near I-205  
**Photo number:** S2-4  
**Description:** Channel spanning debris blockage, ~4' above channel bed, looking south and upstream



**Site location:** South of SW 56th  
**Photo number:** S2-5  
**Description:** Looking upstream, facing north, cedar tree on left bank appears to shade out invasive plants



**Site location:** Between SW 56<sup>th</sup> and SW 57<sup>th</sup>  
**Photo number:** S2-6  
**Description:** Hard silt creates pool/drop sequence in channel, small riffles



**Site location:** South of SW 57th

**Photo number:** S2-7


**Description:** Looking upstream at debris in channel and associated bank erosion on edges



**Site location:** South of SW 58<sup>th</sup>, near trail project under construction

**Photo number:** S2-8

**Description:** Looking downstream, hard clay unit in bed, slight knick point in channel, minor incision just upstream of debris jam

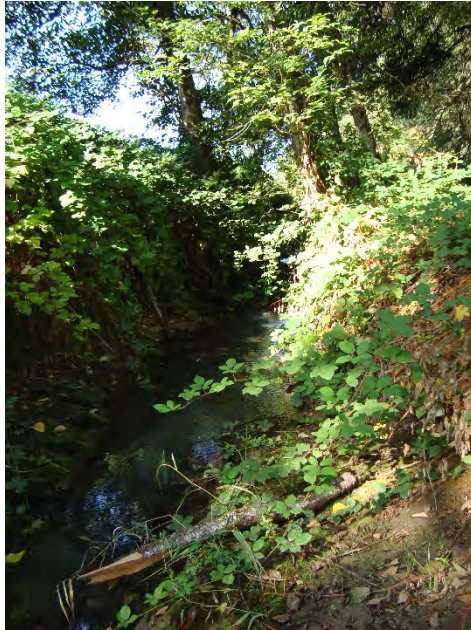

**Site location:** South of SW 58<sup>th</sup>, near trail project under construction  
**Photo number:** S2-9  
**Description:** Looking upstream- same location as Photo S2-8



**Site location:** South of SW 59th  
**Photo number:** S2-10  
**Description:** Location of 12" steel pipe in channel disconnected from vertical segment. Some gravel in channel at this location.



**Site location:** Upstream of Photo S2-10  
**Photo number:** S2-11  
**Description:** Groundwater seepage on right bank



**Site location:** South of Sequoia Drive  
**Photo number:** S2-12  
**Description:** Debris jam





**Site location:** 1200' east of SW 65<sup>th</sup> Ave.

**Photo number:** S2-13

**Description:** Fence, looking west



**Site location:** 1000' east of SW 65<sup>th</sup> Ave.

**Photo number:** S2-14

**Description:** Mitigation site on right bank (I-205 side), left side of photo. Red arrow shows channel location.



**Site location:** 1000' east of SW 65<sup>th</sup> Ave.  
**Photo number:** S2-15  
**Description:** Looking east (downstream) at mitigation site. Red arrow shows channel location.



**Site location:** 1000' east of SW 65<sup>th</sup> Ave.  
**Photo number:** S2-16  
**Description:** Looking north at construction site across channel



**Site location:** 600' east of SW 65<sup>th</sup> Ave.  
**Photo number:** S2-17  
**Description:** Right bank swale on west side of mitigation area.



**Site location:** 100' east of SW 65<sup>th</sup> Ave.  
**Photo number:** S2-18  
**Description:** Debris jam looking downstream



**Site location:** 100' east of SW 65<sup>th</sup> Ave

**Photo number:** S2-19

**Description:** Looking upstream from same location as Photo S2-18. Gravel in channel at this point.



**Site location:** SW 65<sup>th</sup> Ave. crossing

**Photo number:** S2-20

**Description:** Looking upstream at pool on downstream side of SW 65<sup>th</sup> Ave.



Attachment B-3

Saum Creek Reach #3 Photo Log





**Site location:** Downstream of SW Blake St.

**Photo number:** S3-1

**Description:** Looking down at valley bottom from above. Red arrow indicates location of channel.



**Site location:** Downstream of SW Blake St.

**Photo number:** S3-2

**Description:** Hillslope failure and perched culvert



**Site location:** Downstream of SW Blake St.  
**Photo number:** S3-3  
**Description:** Perched culvert- hillslope failure on left bank



**Site location:** Upstream of SW Blake St. crossing  
**Photo number:** S3-4  
**Description:** Beginning of restoration area, very wet





**Site location:** ~80' upstream of SW Blake St.  
**Photo number:** S3-5  
**Description:** Looking upstream, mucky conditions



**Site location:** ~130' upstream of SW Blake St.  
**Photo number:** S3-6  
**Description:** Looking downstream, swale on right bank, rock on outside bend (near stadia- obscured by vegetation)



**Site location:** ~300' upstream of SW Blake St.

**Photo number:** S3-7

**Description:** Constructed rock drop pool (restoration)



**Site location:** ~350' upstream of SW Blake St.

**Photo number:** S3-8

**Description:** Constructed rock pool



Attachment B-4

Nyberg Creek Reach #1 Photo Log

## Attachment B-4

# Photo Documentation

### Nyberg Creek Reach #1 (SW Nyberg Lane to SW 65<sup>th</sup> Ave.)

Photographs and descriptions of the field investigation (by site) are provided on the following pages. Photographs are shown in the order that the stream survey was conducted, from the most downstream point in the reach to the most upstream point in the reach. In general, photos were taken in the upstream direction, except where noted. Photographs are labeled with a unique identifier that includes photograph number and stream reach identification. Photographs in Nyberg Creek Reach #1 are identified as N1-X, with X being the number of the photograph. Photo locations are shown in Figure 1.



Figure 1. Nyberg Creek Reach #1 Photo Location Points



**Site location:** South side of SW Nyberg Lane  
**Photo number:** N1-1  
**Description:** Poned area adjacent to Nyberg Creek upstream of SW Nyberg Lane



**Site location:** Upstream side of SW Nyberg Lane  
**Photo number:** N1-2  
**Description:** Nyberg Creek where it flows under SW Nyberg Lane through three 48" culverts



**Site location:** Upstream side of SW Nyberg Lane  
**Photo number:** N1-3  
**Description:** Looking downstream at culverts, same location as Photo N1-2



**Site location:** 200' upstream from SW Nyberg Lane  
**Photo number:** N1-4  
**Description:** Old roadbed. Stream is in 30" CMP culvert under road.



**Site location:** 250' upstream of SW Nyberg Lane  
**Photo number:** N1-5  
**Description:** Deep, narrow main channel, flow is spread-out in multiple paths across wetland area



**Site location:** 400' upstream of SW Nyberg Lane  
**Photo number:** N1-6  
**Description:** Looking downstream at top of beaver dam. Red arrow points to top of dam. Drop is approximately 3 feet.



**Site location:** 450' upstream of SW Nyberg Lane  
**Photo number:** N1-7  
**Description:** Recently removed beaver debris



**Site location:** 300' downstream of SW 65<sup>th</sup> Ave.  
**Photo number:** N1-8  
**Description:** Looking upstream at ponded area. Red arrow shows location of SW 65<sup>th</sup> Ave.





**Site location:** 100' downstream of SW 65<sup>th</sup> Ave.

**Photo number:** N1-9

**Description:** Upstream end of ponded area



**Site location:** Nyberg Creek on downstream side of SW 65<sup>th</sup> Ave.

**Photo number:** N1-10

**Description:** Same view as Photo N1-9



**Site location:** Nyberg Creek on downstream side of SW 65<sup>th</sup> Ave.  
**Photo number:** N1-11  
**Description:** Photo taken from left bank (north side) on 9/12. Additional debris was removed between 9/11 and 9/12. See photo N1-12 for comparison.



**Site location:** Nyberg Creek on downstream side of SW 65<sup>th</sup> Ave (east side)  
**Photo number:** N1-12  
**Description:** Photo taken from south side on 9/11. Red arrow shows debris removed from beaver activity.



Attachment B-5

Nyberg Creek Reach #2 Photo Log





**Site location:** South of 7-11, West of SW 65<sup>th</sup> Ave.

**Photo number:** N2-1

**Description:** Nyberg Creek Wetlands



**Site location:** Business park between Nyberg wetlands and SW Nyberg St.

**Photo number:** N2-2

**Description:** Ponded area shown indicated by red arrow.



**Site location:** Nyberg Wetlands, downstream side of beaver dam

**Photo number:** N2-3

**Description:** Staff gauge in ponded area



**Site location:** South of business park

**Photo number:** N2-4

**Description:** Constructed channel opening on north side of beaver dam (shown by red dashed lines)



**Site location:** Downstream side of beaver dam

**Photo number:** N2-5

**Description:** Dam extends the entire length of valley bottom, creating a ~3 - 4' drop



**Site location:** Poned area downstream of I-5

**Photo number:** N2-6

**Description:** Baby beaver in foreground







Attachment B-6

Nyberg Creek Reach #3 Photo Log

## Attachment B-6

# Photo Documentation

## Nyberg Creek Reach #3 (SW SW Martinazzi Ave. Ave. to SW Boones Ferry Rd.)

Photographs and descriptions of the field investigation (by site) are provided on the following pages. Photographs are shown in the order that the stream survey was conducted, from the most downstream point in the reach to the most upstream point in the reach. In general, photos were taken in the upstream direction, except where noted. Photographs are labeled with a unique identifier that includes photograph number and stream reach identification. Photographs in Nyberg Creek Reach #3 are identified as N3-X, with X being the number of the photograph. Photo locations are shown in Figure 1.



Figure 1. Nyberg Creek Reach #3 Photo Location Points



**Site location:** East side of SW SW Martinazzi Ave.  
**Photo number:** N3-1  
**Description:** Looking downstream of SW Martinazzi Ave. where 48-inch diameter stormwater pipe enters Nyberg Creek (approximately where red arrow is pointing)



**Site location:** Upstream of SW Martinazzi Ave. by Shari's restaurant  
**Photo number:** N3-2  
**Description:** Nyberg Creek, concrete dam with notch



**Site location:** ~200' upstream of SW Martinazzi Ave.

**Photo number:** N3-3

**Description:** Culvert next to Shari's restaurant in parking lot (indicated by red arrow)



**Site location:** ~300' upstream from SW Martinazzi Ave.

**Photo number:** N3-4

**Description:** Looking at the upstream end of the culvert next to Shari's restaurant (shown by red arrow)



**Site location:** ~350' upstream from SW Martinazzi Ave.

**Photo number:** N3-5

**Description:** Looking downstream from footbridge at upstream end of parking lot culvert (obscured by reed canary grass)



**Site location:** SW Tonka Rd. bridge

**Photo number:** N3-6

**Description:** Looking in downstream direction



**Site location:** ~400' downstream of SW Boones Ferry Rd.

**Photo number:** N3-7

**Description:** Looking upstream, narrow channel



**Site location:** ~200' downstream of SW Boones Ferry Rd.

**Photo number:** N3-8

**Description:** 42" outfall on south side of channel (1/2 full)



**Site location:** 100' downstream of SW Boones Ferry Rd.  
**Photo number:** N3-9  
**Description:** Looking upstream at narrow channel. Grass has been cut on north side.



**Site location:** SW Boones Ferry Rd.  
**Photo number:** N3-10  
**Description:** Culverts entering Nyberg Creek from SW Boones Ferry Rd.







Attachment B-7

Hedges Creek Reach #1 Photo Log

## Attachment B-7

# Photo Documentation

## Hedges Creek Reach #1 (Tualatin River to SW Tualatin Rd.)

Photographs and descriptions of the field investigation (by site) are provided on the following pages. Photographs are shown in the order that the stream survey was conducted, from the most downstream point in the reach to the most upstream point in the reach. In general, photos were taken in the upstream direction, except where noted. Photographs are labeled with a unique identifier that includes photograph number and stream reach identification. Photographs in Hedges Creek Reach #1 are identified as H1-X, with X being the number of the photograph. Photo locations are shown in Figure 1.

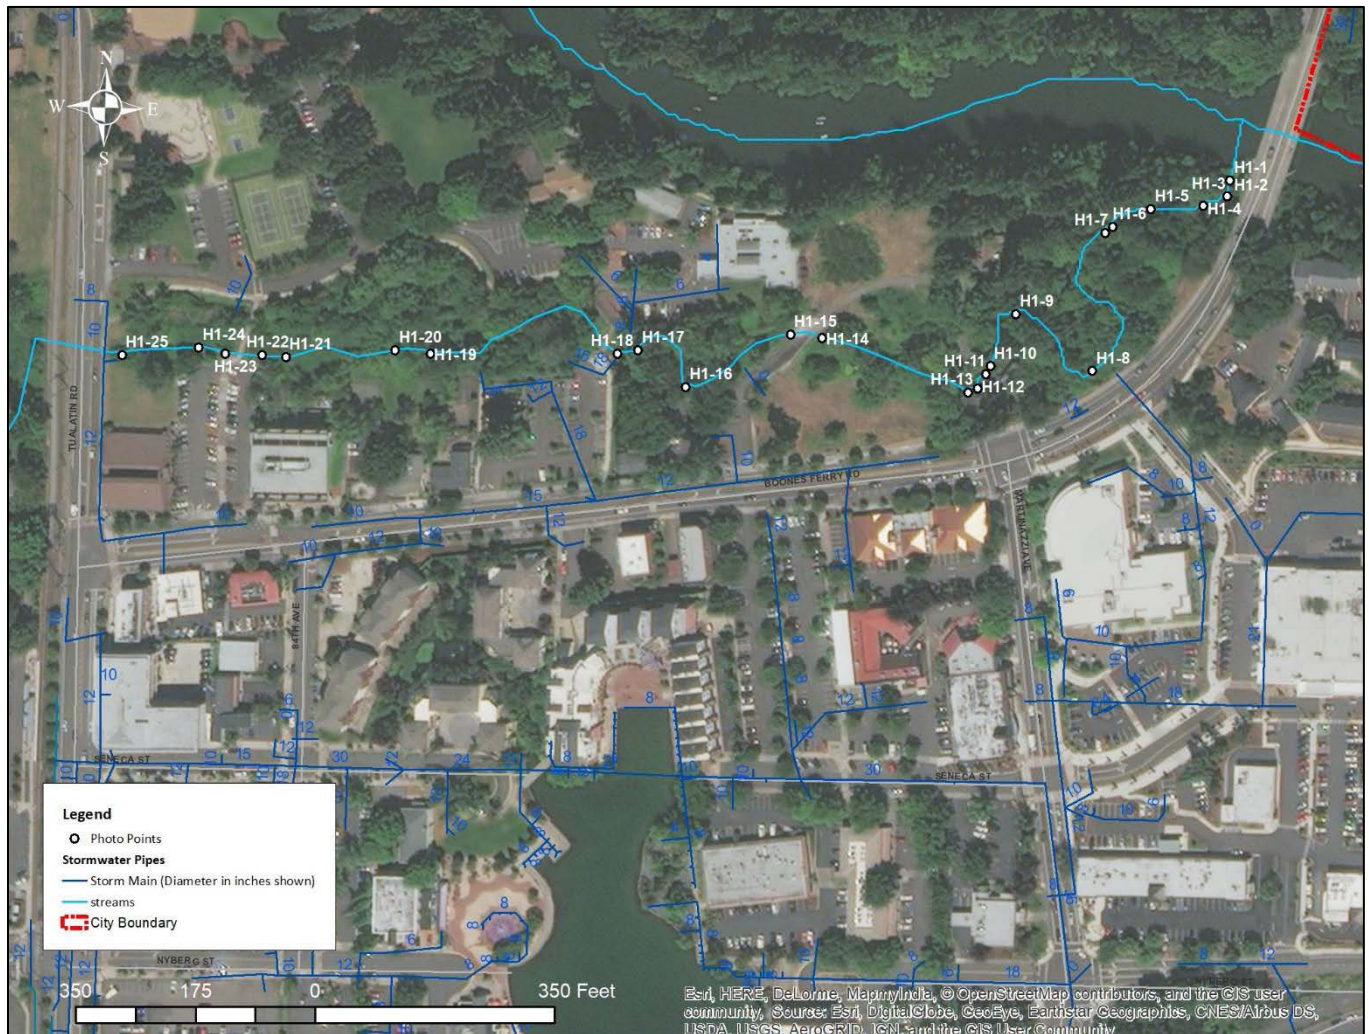


Figure 1. Hedges Creek Reach #1 Photo Location Points

<b>Waterbody:</b>	Hedges Creek Reach #1
<b>Reach description:</b>	
<b>Site locations:</b>	Tualatin River to Tualatin Road



**Site location:** Mouth of Hedges Creek below Boones Ferry Road bridge at Tualatin River  
**Photo number:** H1-1  
**Description:** 3" to 1.5' rocks in channel (rip-rap stabilization)



**Site location:** 30' upstream of Tualatin River  
**Photo number:** H1-2  
**Description:** 1' - 2' rocks in channel, high water mark on bridge abutment corresponds to about 6' above channel bed in this location, steep gradient to mouth



**Site location:** 100' upstream of Tualatin River  
**Photo number:** H1-3  
**Description:** Lots of silt in channel, gradient flattens



**Site location:** 150' upstream of Tualatin River  
**Photo number:** H1-4  
**Description:** Looking upstream, right bank erosion, downed trees, slumping on right bank



**Site location:** 200' upstream of Tualatin River  
**Photo number:** H1-5  
**Description:** Concrete poured in channel from left bank




**Site location:** 300' upstream of Tualatin River  
**Photo number:** H1-6  
**Description:** Looking upstream, gravel deposit in center of channel below channel-spanning debris jam



**Site location:** 300' upstream of Tualatin River

**Photo number:** H1-7

**Description:** Looking downstream at debris jam, Ryan is touching water line (?) pipe across debris

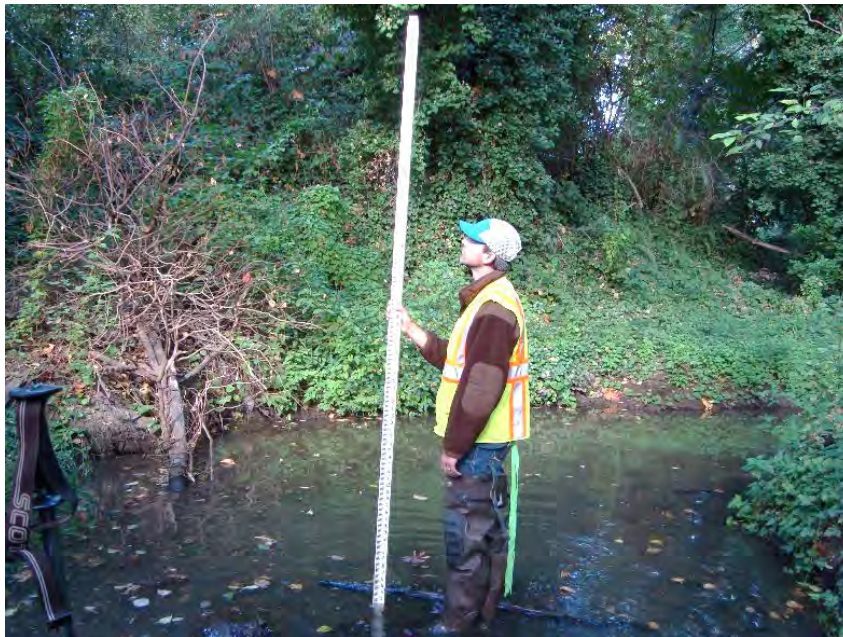


**Site location:** 350' upstream of Tualatin River

**Photo number:** H1-8

**Description:** Looking upstream at outside bend (adjacent to SW Boones Ferry Road)



**Site location:** 450' upstream of Tualatin River  
**Photo number:** H1-9  
**Description:** Looking upstream, bank armoring on left bank (right side of photo)

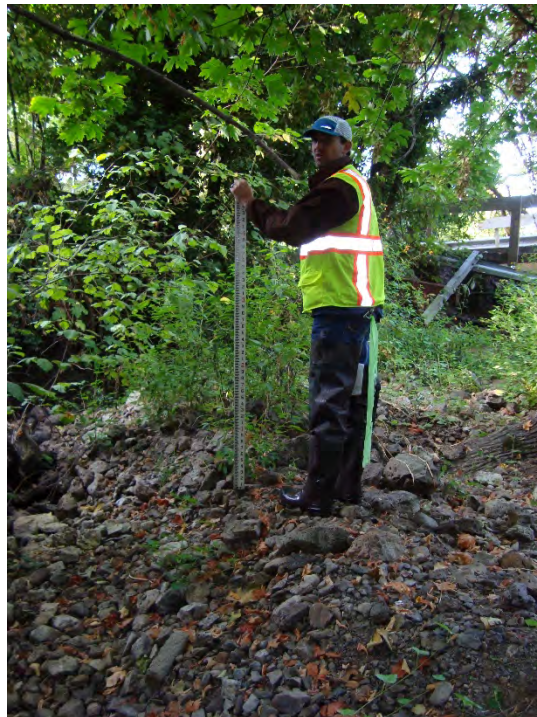

**Site location:** 500' upstream of Tualatin River (near SW Martinazzi Avenue)  
**Photo number:** H1-10  
**Description:** Debris deposited downstream of washed out driveway bridge



**Site location:** 500' upstream of Tualatin River  
**Photo number:** H1-11  
**Description:** Looking downstream at debris and creek, right bank (outside bend) is downstream of culvert constriction (washed out) where flow is concentrated. This area is vulnerable to erosion.



**Site location:** 500' upstream of Tualatin River  
**Photo number:** H1-12  
**Description:** Looking upstream at culvert under washed out bridge amongst debris that has not been removed





**Site location:** 500' upstream of Tualatin River

**Photo number:** H1-13

**Description:** Channel upstream of washed out bridge, stagnant water. Flow is restricted by debris and washed out culvert.



**Site location:** 800' upstream of Tualatin River

**Photo number:** H1-14


**Description:** Looking east (downstream) from new bridge.



**Site location:** 800' east of Tualatin River

**Photo number:** H1-15

**Description:** Looking west (upstream) from new bridge.

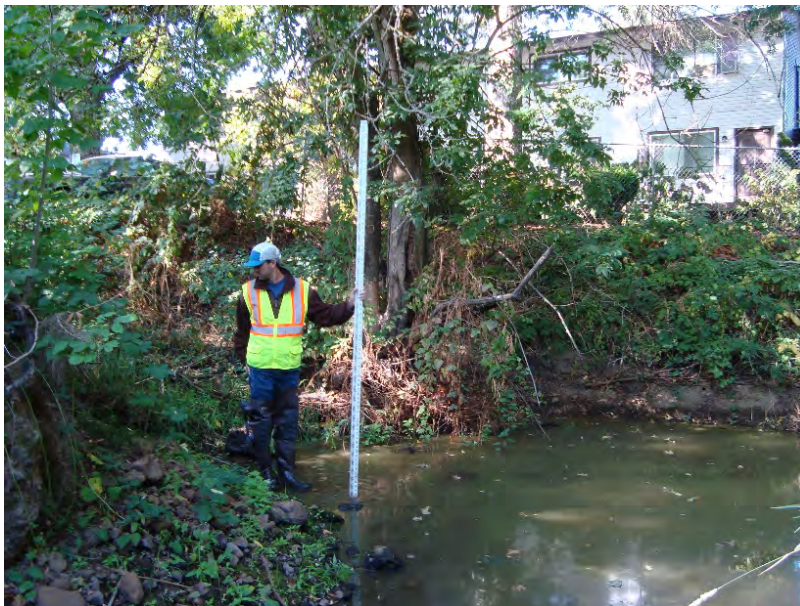

**Site location:** 1,000' upstream of Tualatin River

**Photo number:** H1-16

**Description:** Old culvert (where Ryan is standing), photo is looking upstream at outside bend where stream takes a sharp turn to the north



**Site location:** 1,200' upstream of Tualatin River

**Photo number:** H1-17

**Description:** Tualatin-Greenway bridge, channel choked with reed canary grass



**Site location:** 1,200' upstream of Tualatin River

**Photo number:** H1-18

**Description:** Same location as photo H1-17. 18" diameter stormwater pipe enters channel on right bank where stadia rod is pointed.



**Site location:** 1400' upstream of Tualatin River  
**Photo number:** H1-19  
**Description:** Looking upstream at reed canary grass choked channel.



**Site location:** 1450' upstream of Tualatin River  
**Photo number:** H1-20  
**Description:** Beaver dam looking upstream, wider floodplain west of this location (open space).



**Site location:** 1,500' upstream of Tualatin River  
**Photo number:** H1-21  
**Description:** Looking downstream in open space area.



**Site location:** 200' downstream of SW Tualatin Road  
**Photo number:** H1-22  
**Description:** Pedestrian bridge in wetland area downstream of SW Tualatin Road.



**Site location:** 200' downstream of SW Tualatin Road

**Photo number:** H1-23

**Description:** Looking upstream from pedestrian bridge at pooled water in wetland area east of SW Tualatin Road.



**Site location:** 200' downstream of SW Tualatin Road

**Photo number:** H1-24

**Description:** Wetland area from pedestrian bridge



**Site location:** SW Boones Ferry Road  
**Photo number:** H1-25  
**Description:** Looking upstream at culvert under SW Boones Ferry Road







Attachment B-8

Hedges Creek Reach #2 Photo Log

## Attachment B-8

# Photo Documentation

## Hedges Creek Reach #2 (SW Tualatin-Sherwood Rd. to SW Industrial Way)

Photographs and descriptions of the field investigation (by site) are provided on the following pages. Photographs are shown in the order that the stream survey was conducted, from the most downstream point in the reach to the most upstream point in the reach. In general, photos were taken in the upstream direction, except where noted. Photographs are labeled with a unique identifier that includes photograph number and stream reach identification. Photographs in Hedges Creek Reach #2 are identified as H2-X, with X being the number of the photograph. Photo locations are shown in Figure 1.

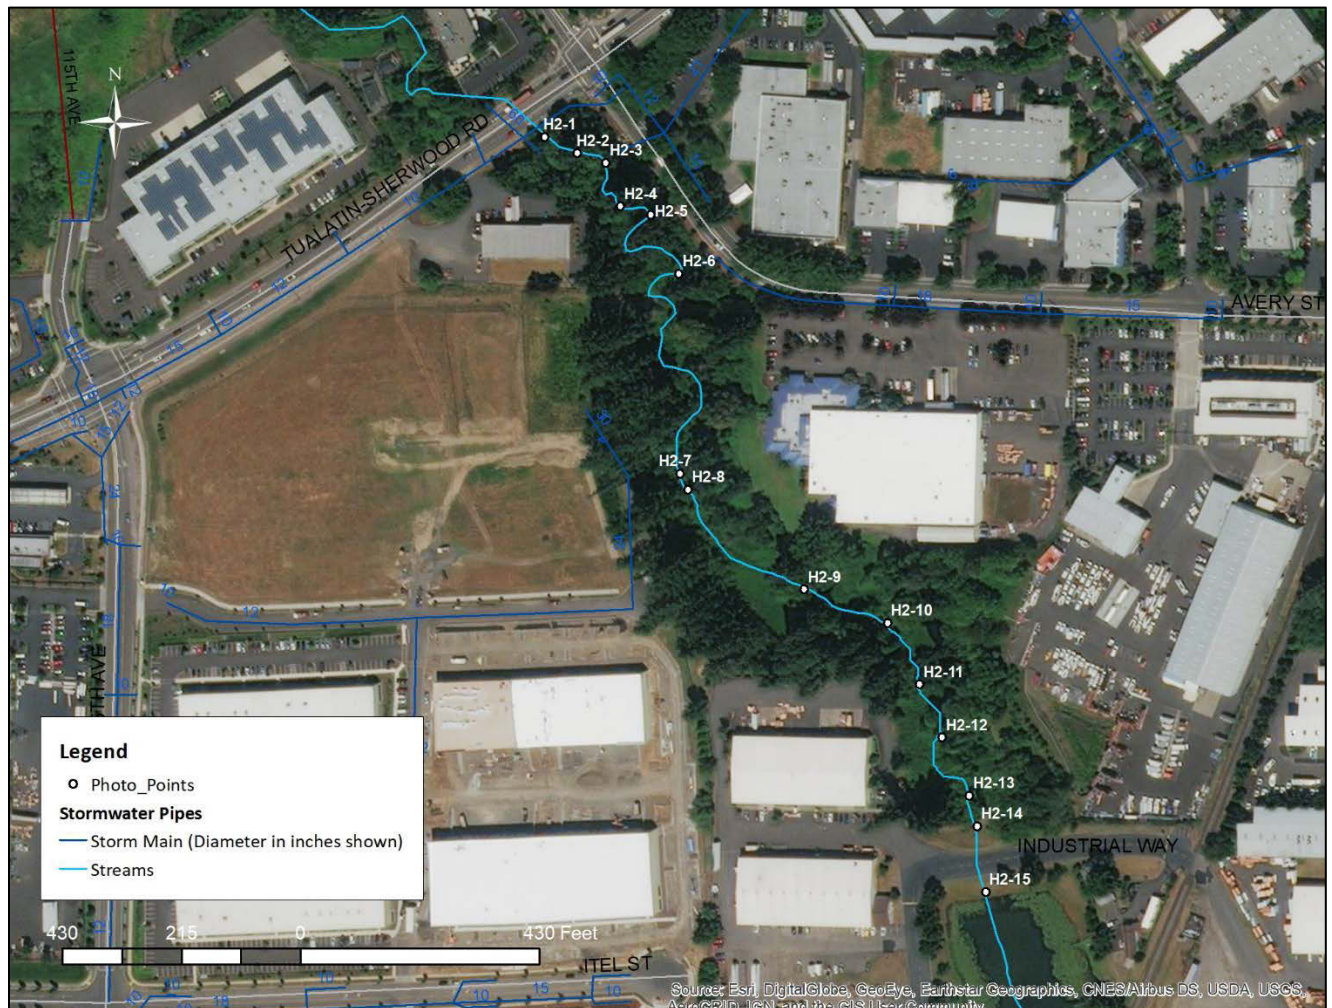


Figure 1. Hedges Creek Reach #2 Photo Location Points



**Site location:** Culvert at SW Tualatin-Sherwood Road  
**Photo number:** H2-1  
**Description:** Armored channel with rip-rap, looking downstream



**Site location:** 100' upstream of SW Tualatin-Sherwood Road  
**Photo number:** H2-2  
**Description:** Staff gauge in channel



**Site location:** 200' upstream of SW Tualatin-Sherwood Road

**Photo number:** H2-3

**Description:** Right bank outfall



**Site location:** 400' upstream of SW Tualatin-Sherwood Rd.

**Photo number:** H2-4

**Description:** Looking upstream, wide floodplain, banks 4- 5' high, width ~ 8 - 10 ', hard silt bed



**Site location:** 500' upstream of SW Tualatin-Sherwood Road  
**Photo number:** H2-5  
**Description:** Debris on branches above channel (~4') indicating high water mark (red arrow)



**Site location:** 600' upstream of SW Tualatin-Sherwood Road  
**Photo number:** H2-6  
**Description:** Erosion on outside bend (right bank)



**Site location:** 650' upstream of SW Tualatin-Sherwood Road  
**Photo number:** H2-7  
**Description:** Channel location from top of bank (4' depth). Enveloped with blackberries and reed canary grass.



**Site location:** 700' upstream of SW Tualatin-Sherwood Road  
**Photo number:** H2-8  
**Description:** Looking upstream



**Site location:** 900' upstream of SW Tualatin-Sherwood Road

**Photo number:** H2-9


**Description:** Looking upstream, exposed roots in channel. Left bank debris (high water ~4')



**Site location:** 1000' upstream of SW Tualatin-Sherwood Road

**Photo number:** H2-10


**Description:** Looking upstream, wide floodplain

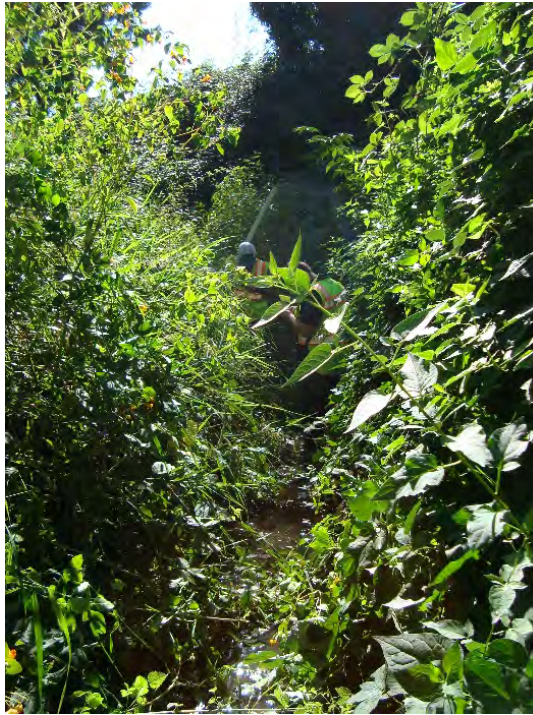

**Site location:** 1200' upstream of SW Tualatin-Sherwood Road

**Photo number:** H2-11

**Description:** Hard silt layer in channel

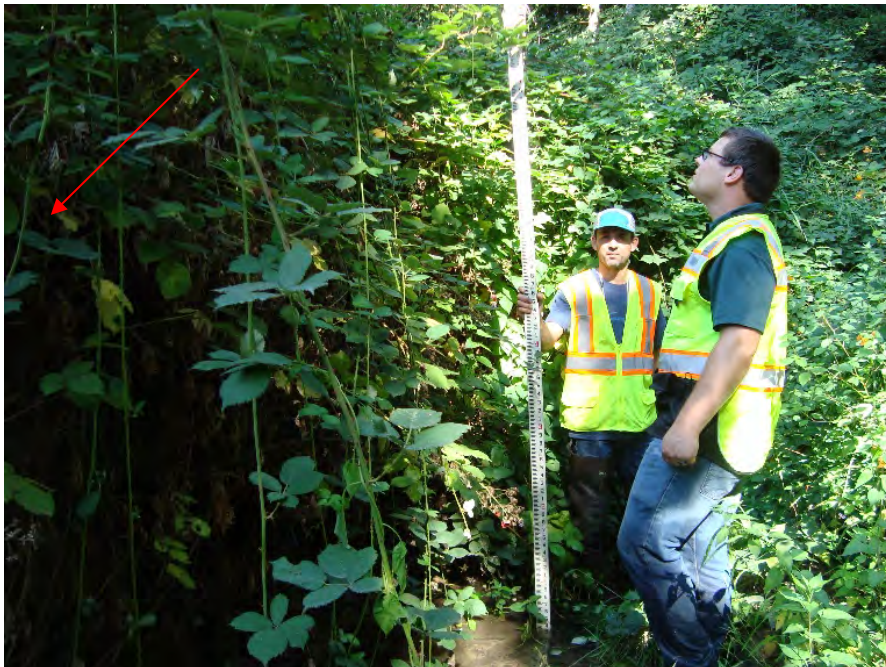

**Site location:** 1300' upstream of SW Tualatin-Sherwood

**Photo number:** H2-12

**Description:** Right bank erosion (red arrow)





**Site location:** 100' downstream from SW Industrial Way  
**Photo number:** H2-13  
**Description:** Rock drop pool formed by rip-rap energy dissipation at culvert outfall



**Site location:** Culvert at SW Industrial Way  
**Photo number:** H2-14  
**Description:** Looking down from right bank



**Site location:** Upstream side of SW Industrial Way  
**Photo number:** H2-15  
**Description:** Fire pond #1 in-line with Hedges Creek



Attachment B-9

Hedges Creek Reach #3A Photo Log

## Attachment B-9

# Photo Documentation

## Hedges Creek Reach #3A (SW 105<sup>th</sup> Avenue/SW Blake St. to Confluence with S. Tributary)

Photographs and descriptions of the field investigation (by site) are provided on the following pages. Photographs are shown in the order that the stream survey was conducted, from the most downstream point in the reach to the most upstream point in the reach. In general, photos were taken in the upstream direction, except where noted. Photographs are labeled with a unique identifier that includes photograph number and stream reach identification. Photographs in Hedges Creek Reach #3 are identified as H3-X, with X being the number of the photograph. Photo locations are shown in Figure 1.

Hedges Creek Reach #3 was broken into two sub-reaches, #3A and #3B, to more effectively describe the unique characteristics that occur upstream and downstream of the confluence of a tributary that enters the main channel from the south downstream of SW Alsea Ct. The photos do not have a sub-reach qualifier in their name, but rather are labeled sequentially from the most downstream location to upstream location, in a similar manner to the other stream reaches assessed.



Figure 1. Hedges Creek Reach #3A Photo Location Points



**Site location:** Culvert under SW 105<sup>th</sup> Ave (downstream side)  
**Photo number:** H3-1  
**Description:** Looking upstream at SW 105<sup>th</sup> Ave. culvert crossing from west side of SW 105<sup>th</sup> Ave.



**Site location:** Culvert at SW 105<sup>th</sup> Ave. (upstream side)  
**Photo number:** H3-2  
**Description:** Looking downstream at SW 105<sup>th</sup> Ave. culvert crossing from east side of SW 105<sup>th</sup> Ave.



**Site location:** 30' upstream of SW 105<sup>th</sup> Ave.

**Photo number:** H3-3

**Description:** Right bank hillslope failures, wetland plants growing on slope (wet)



**Site location:** 150' upstream of SW 105<sup>th</sup> Ave.

**Photo number:** H3-4

**Description:** Rock wall on left bank adjacent to roadway fill



**Site location:** 175' upstream of SW 105<sup>th</sup> Ave.  
**Photo number:** H3-5  
**Description:** Left bank failure, missing wall segment adjacent to SW 105<sup>th</sup> Ave., outside bend



**Site location:** 500' upstream of SW 105<sup>th</sup> Ave.  
**Photo number:** H3-6  
**Description:** Bedrock outcrop in channel



**Site location:** 550' upstream of SW 105<sup>th</sup> Ave.

**Photo number:** H3-7

**Description:** Looking upstream, bedrock channel



**Site location:** 600' upstream of SW 105<sup>th</sup> Ave.

**Photo number:** H3-8

**Description:** Seepage on left bank, 2' above channel





**Site location:** 700' upstream of SW 105<sup>th</sup> Ave.  
**Photo number:** H3-9  
**Description:** Incised side channel on left bank, looking upstream from confluence



**Site location:** 750' upstream of SW 105<sup>th</sup> Ave.  
**Photo number:** H3-10  
**Description:** Side channel, left bank, deep incision, looking downstream



**Site location:** 750' upstream of SW 105<sup>th</sup> Ave.

**Photo number:** H3-11

**Description:** Side channel, adjacent to sewer manhole being eroded by channel. Manhole is 15' from start of headcut (erosion)



**Site location:** 750' upstream of SW 105<sup>th</sup> Ave.

**Photo number:** H3-12

**Description:** Main channel, looking upstream



**Site location:** 800' upstream of SW 105<sup>th</sup> Ave.  
**Photo number:** H3-13  
**Description:** Looking downstream at outside bend, eroding left bank



**Site location:** 900' upstream of SW 105<sup>th</sup> Ave.  
**Photo number:** H3-14  
**Description:** Outside bend erosion



**Site location:** 950' upstream of SW 105<sup>th</sup> Ave.  
**Photo number:** H3-15  
**Description:** Restoration area, looking downstream. Left bank root wads, right bank anchored log



**Site location:** 1100' upstream of SW 105<sup>th</sup> Ave.  
**Photo number:** H3-16  
**Description:** Right bank slope failure, very wet



**Site location:** 1300' upstream of SW 105<sup>th</sup> Ave.

**Photo number:** H3-17

**Description:** Rock in channel, moved downstream from upstream restoration project



**Site location:** 1350' upstream of SW 105<sup>th</sup> Ave.

**Photo number:** H3-18


**Description:** Bed protection and erosion fabric (restoration area)



**Site location:** 1350' upstream of SW 105<sup>th</sup> Ave.

**Photo number:** H3-19

**Description:** Looking downstream at restoration area

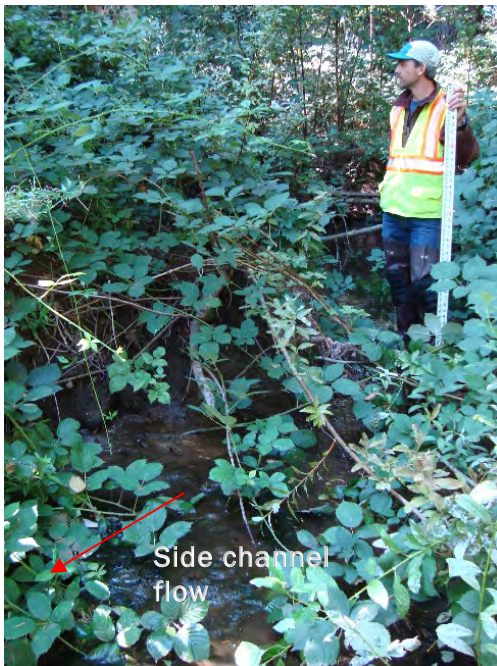

**Site location:** 400' downstream from confluence with S. Tributary

**Photo number:** H3-20

**Description:** Looking upstream, flow is coming in from right bank (very small channel not visible from left side of photo), stagnant water in this location



**Site location:** Immediately downstream from confluence with S. Tributary  
**Photo number:** H3-21  
**Description:** Looking upstream, riprap



**Site location:** Culvert crossing under trail  
**Photo number:** H3-22  
**Description:** Looking downstream, confluence with tributary from the south



**Site location:** Confluence of mainstem with S. Tributary  
**Photo number:** H3-23  
**Description:** Looking upstream at south tributary





Attachment B-10

Hedges Creek Reach #3B Photo Log

## Attachment B-10

# Photo Documentation

## Hedges Creek Reach #3B (Confluence with S. Tributary to SW 99<sup>th</sup> Ave.)

Photographs and descriptions of the field investigation (by site) are provided on the following pages. Photographs are shown in the order that the stream survey was conducted, from the most downstream point in the reach to the most upstream point in the reach. In general, photos were taken in the upstream direction, except where noted. Photographs are labeled with a unique identifier that includes photograph number and stream reach identification. Photographs in Hedges Creek Reach #3 are identified as H3-X, with X being the number of the photograph. Photo locations are shown in Figure 1.

Hedges Creek Reach #3 was broken into two sub-reaches, #3A and #3B, to more effectively describe the unique characteristics that occur upstream and downstream of the confluence of a tributary that enters the main channel from the south downstream of SW Alsea Ct. The photos do not have a sub-reach qualifier in their name, but rather are labeled sequentially from the most downstream location to upstream location, in a similar manner to the other stream reaches assessed.

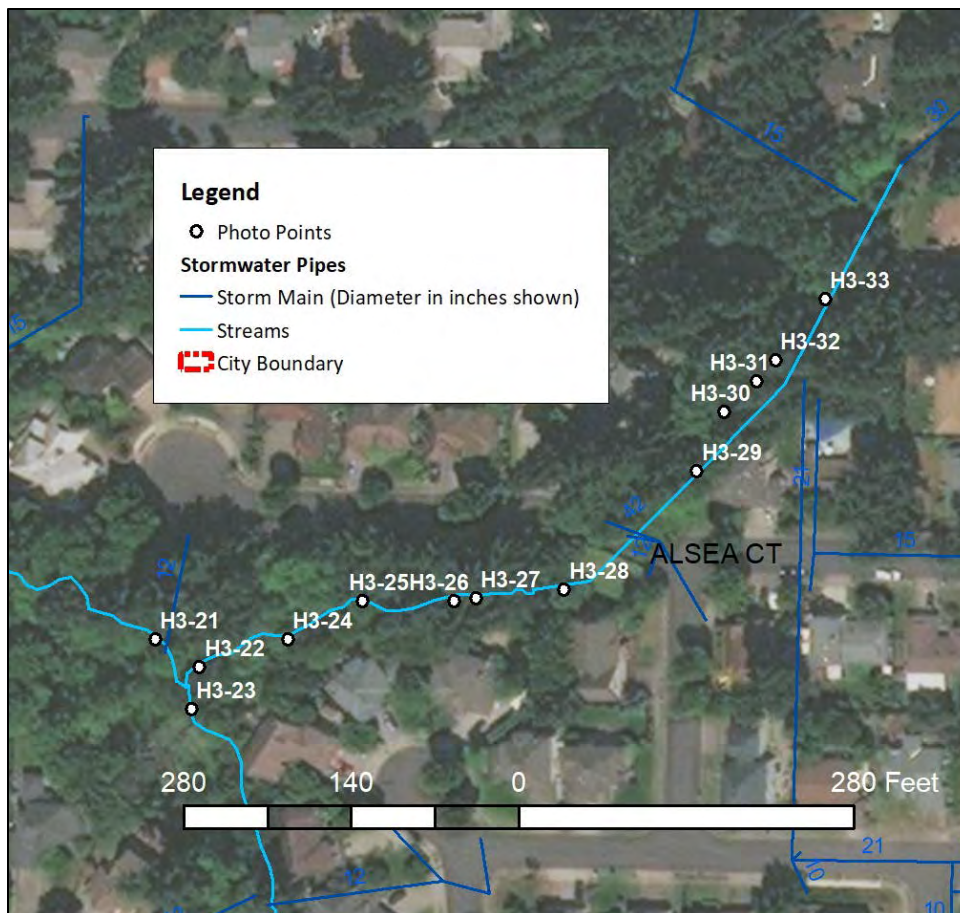


Figure 1. Hedges Creek Reach #3B Photo Location Points



**Site location:** Immediately downstream from confluence with S. tributary

**Photo number:** H3-21

**Description:** Looking upstream, riprap



**Site location:** Culvert crossing under trail

**Photo number:** H3-22

**Description:** Looking downstream, confluence with tributary from the south



**Site location:** Confluence with S. tributary  
**Photo number:** H3-23  
**Description:** Looking upstream at south tributary



**Site location:** 300' upstream of confluence with S. tributary  
**Photo number:** H3-24  
**Description:** Looking upstream, hard silt in channel, incised



**Site location:** 500' upstream of confluence with S. tributary  
**Photo number:** H3-25  
**Description:** Left bank failure, incised channel, unstable




**Site location:** 600' upstream of confluence with S. tributary  
**Photo number:** H3-26  
**Description:** Left bank slumping



**Site location:** 650' upstream of confluence with S. tributary

**Photo number:** H3-27

**Description:** Left bank instability with concrete

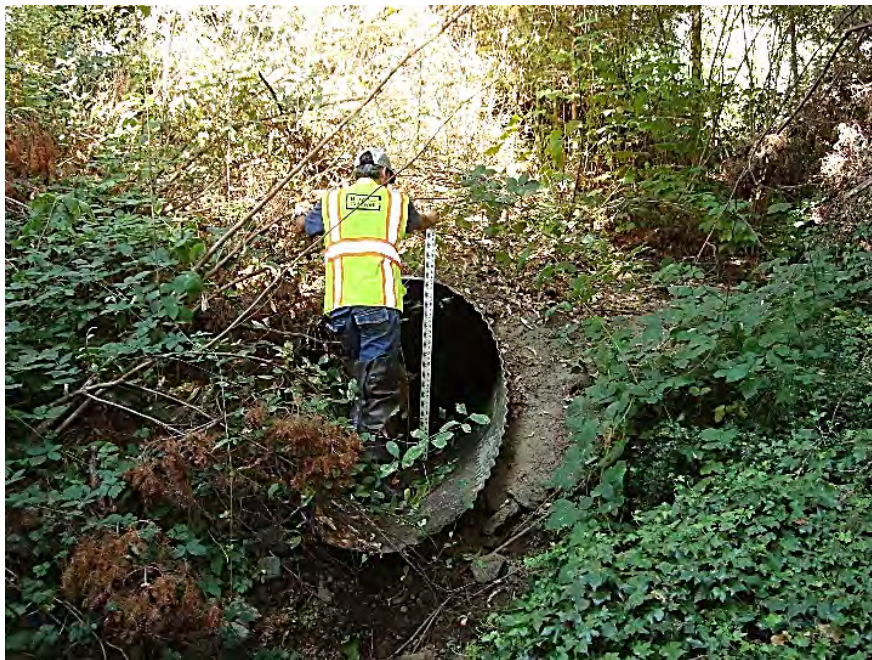

**Site location:** Culvert at SW Alsea Ct.

**Photo number:** H3-28

**Description:** Looking upstream, downstream of SW Alsea Ct.. Culvert is perched. No water.



**Site location:** Culvert at SW Alsea Ct.  
**Photo number:** H3-29  
**Description:** Looking downstream, upstream of SW Alsea Ct. Dry channel.



**Site location:** 200' upstream of SW Alsea Ct.  
**Photo number:** H3-30  
**Description:** Looking upstream, narrow defined channel, dry



Site location: Culvert at 9999 SW Aalsea Ct.

Photo number: H3-31

Description: Head cut below culvert, culvert is 6' above channel bottom (red arrow points to culvert)



Site location: Culvert at 9999 SW Aalsea Ct.

Photo number: H3-32

Description: Plunge pool below culvert. Concrete apron below culvert indicated with red arrow.





**Site location:** Culvert at 9999 SW Alsea Ct in the vicinity of SW 99<sup>th</sup> Ave.

**Photo number:** H3-33

**Description:** Looking downstream from upstream end of culvert. 18-inch culvert to left of 36-inch culvert.



## **Appendix G: CIP Detailed Cost Estimates**

---



Tualatin 2019 Stormwater Master Plan

CIP Cost Summary

CIP ID	Project Title	Capital Expense Total (including contingency)	Engineering and Permitting	Administration	Other fees (studies, mitigation)	Capital Project Implementation Cost Total	Priority Projects (per City)	SDC Eligibility <sup>b</sup>	SDC Percentage	SDC Eligible Cost
1	Manhassat Storm System Improvements	\$1,171,000	\$293,000	\$117,000		\$1,581,000		100%	15%	\$ 237,000.00
2	Nyberg Creek Stormwater Improvements - Phase I	\$1,051,000	\$368,000	\$105,000		\$1,523,000	X	100%	19%	\$ 289,000.00
2	Nyberg Creek Stormwater Improvements - Phase 2	\$863,000	\$302,000	\$86,000		\$1,252,000		100%	19%	\$ 238,000.00
2	Nyberg Creek Stormwater Improvements - Phase 3	\$472,000	\$118,000	\$47,000		\$637,000		100%	19%	\$ 121,000.00
3	Sandalwood Water Quality Retrofit	\$79,000	\$20,000	\$8,000		\$107,000		100%	23%	\$ 25,000.00
4	Mohawk Apartments Stormwater Improvements	\$218,000	\$55,000	\$22,000		\$295,000		100%	20%	\$ 59,000.00
5	Herman Road Storm System	\$758,000	\$189,000	\$76,000		\$1,023,000	X	100%	27%	\$ 276,000.00
6	Blake St Culvert Replacement	\$381,000	\$133,000	\$38,000		\$552,000	X	100%	22%	\$ 121,000.00
7	Boones Ferry Railroad Conveyance Improvements	\$356,000	\$124,000	\$36,000		\$515,000		100%	21%	\$ 108,000.00
8	89th Avenue Water Quality Retrofit	\$209,000	\$31,000	\$21,000		\$262,000		100%	0%	\$ -
9	125th Court Water Quality Retrofit	\$165,000	\$25,000	\$16,000		\$206,000		100%	36%	\$ 74,000.00
10	93rd Avenue Green Street	\$166,000	\$42,000	\$17,000		\$224,000		100%	0%	\$ -
11	Juanita Pohl Water Quality Retrofit	\$116,000	\$29,000	\$12,000		\$156,000	X	100%	0%	\$ -
12	Community Park Water Quality Retrofit	\$117,000	\$29,000	\$12,000		\$158,000	X	100%	0%	\$ -
13	Water Quality Facility Restoration - Venetia	\$52,000	\$8,000	\$5,000		\$65,000	X	0%	23%	\$ -
14	Water Quality Facility Restoration - Piute Court	\$83,000	\$12,000	\$8,000		\$104,000	X	0%	23%	\$ -
15	Water Quality Facility Restoration - Sequoia Ridge	\$67,000	\$10,000	\$7,000		\$83,000	X	0%	36%	\$ -
16	Water Quality Facility Restoration - Sweek Drive Pond	\$83,000	\$12,000	\$8,000		\$103,000	X	0%	21%	\$ -
17	Siuslaw Water Quality Facility Retrofit	\$336,000	\$84,000	\$34,000		\$454,000		100%	23%	\$ 104,000.00
18	Water Quality Facility Restoration - Waterford	\$144,000	\$22,000	\$14,000		\$180,000	X	0%	22%	\$ -
19	Saum Creek Hillslope Repair	\$104,000	\$37,000	\$10,000	\$20,000	\$171,000	X	0%	19%	\$ -
20	Hedges Creek Stream Repair <sup>a</sup>	---	---	---		\$327,000	X	0%	24%	\$ -
21	Nyberg Water Quality Retrofit	\$1,234,000	\$432,000	\$123,000	\$248,000	\$2,037,000	X	100%	13%	\$ 265,000.00

a. Detailed costs provided in Hedges Creek (SW Ibach Road to SW 105th Avenue) Stream Assessment, CIP Opinion of Construction Costs for Identified Sites (February 2018)

b. SDC Eligibility applies to projects that increase capacity or treatment coverage. Maintenance-related projects to correct an existing deficiency are not eligible

**TOTAL      \$12,015,000                      \$ 6,482,000                      \$ 1,917,000**



## Unit Cost Table

Costs based on RS Means, collected bid tabs, and recent master planning efforts, adjusted to 2018 prices.

Item	Unit	Unit Cost (2018)
<b>Inspection</b>		
Mainline Video Inspection	FT	3.50
<b>Earthwork</b>		
General Earthwork/Excavation	CY	20
Embankment	CY	9
Clear and Grub brush including stumps	AC	8,200
Amended Soils and Mulch	CY	45
Jute Matting, Biodegradeable	SY	6
Tree removal	EA	300
Geomembrane	SY	30
Geotextile	SY	3
Energy dissipation pad - Rip-Rap, Class 50	CY	66
Energy dissipation pad - Rip-Rap, Class 100	CY	81
Energy dissipation pad - Rip-Rap, Class 200	CY	96
Drain Rock	CY	101
<b>Water Quality Facility Installation</b>		
Pond Outflow Control Structure	EA	6,100
Pond Inlet Structure	EA	4,500
Water Quality Facility Plantings with Trees	SF	6
Rain Garden	SF	27
Stormwater Planter	SF	40
Gravel Access Road	SF	5
Beehive Overflow	EA	1,500
<b>Structure Installation</b>		
Field Ditch Inlet	EA	4,000
Precast Concrete Manhole (48", 0-8' deep)	EA	5,600
Precast Concrete Manhole (48", 9-12' deep)	EA	6,600
Precast Concrete Manhole (48", 13-20' deep)	EA	10,200
Precast Concrete Manhole (60", 0-8' deep)	EA	7,600
Precast Concrete Manhole (60", 9-12' deep)	EA	9,700
Precast Concrete Manhole (72", 0-8' deep)	EA	9,700
Precast Concrete Manhole (72", 9-12' deep)	EA	12,200
Flow Splitter/WQ Manhole (72", all depths)	EA	12,300
Contech CDS (Model CDS3025, 72")	EA	28,800
StormFilter (2-cartridge catch basin unit, 18" cartridges)	EA	10,100
Drywell (48", 20-25' deep)	EA	12,200
Curb Inlet	EA	1,300
Catch Basin, all types	EA	2,000
Concrete Fill - UIC Decommissioning	EA	10,200
Connection to Existing Lateral	EA	1,200
Connection to Existing Structure, standard	EA	2,000
Abandon Existing Pipe, no excavation (12")	FT	10
Abandon Existing Pipe, no excavation (15"-18")	FT	20
Abandon Existing Pipe, no excavation (21"-24")	FT	25
Abandon Existing Pipe, no excavation (27"-36")	FT	35
Abandon Existing Structure	EA	1,000
Demo pipe	LF	71
Remove existing pavement	SY	10
Remove Manhole Structure	EA	1,000
Plug Existing Pipe	EA	505
Check dams	EA	505
Stem wall check dam	LF	66
Headwall with wingwalls, 84" pipe	EA	14,000
Outfall Improvements	EA	3,000-10,000

## Unit Cost Table

Costs based on RS Means, collected bid tabs, and recent master planning efforts, adjusted to 2018 prices.

Item	Unit	Unit Cost (2018)
<b>Restoration/Resurfacing</b>		
Non-Water Quality Facility Landscaping	AC	15,300
Riparian/Wetland Planting (Non-irrigated)	AC	20,300
Riparian/Wetland Planting (w/temporary irrigation)	AC	32,500
Planting and Bioengineered Restoration	SY	40
4-foot Chain Link Fence	LF	22
Split Rail Fence	LF	25
Hydroseed, large quantities	AC	2500
Seeding, small quantities (< 5,000 sf)	SF	6
Sidewalk Installation	SF	7
Trench resurfacing, Permanent ACP, 6-Inch Depth	SY	71
Concrete Curbs	FT	40
<b>Pipe Unit Cost</b>		
Underdrain Pipe, 4"	LF	29
Underdrain, 6" perforated HDPE	LF	56
HDPE Inlet Lead (12", 2-5' deep)	FT	91
HDPE Pipeline w/asphalt resurfacing (12", 5-10' deep)	FT	140
HDPE Pipeline w/asphalt resurfacing (12", 10-15' deep)	FT	160
HDPE Pipeline w/asphalt resurfacing (18", 5-10' deep)	FT	200
HDPE Pipeline w/asphalt resurfacing (24", 5-10' deep)	FT	275
HDPE Pipeline w/asphalt resurfacing (30", 5-10' deep)	FT	325
HDPE Pipeline (30", 5-10' deep)	FT	240
HDPE Pipeline w/asphalt resurfacing (36", 5-10' deep)	FT	405
HDPE Pipeline (36", 5-10' deep)	FT	265
HDPE Pipeline w/asphalt resurfacing (42", 5-10' deep)	FT	485
HDPE Pipeline (42", 5-10' deep)	FT	345
HDPE Pipeline w/asphalt resurfacing (48", 5-10' deep)	FT	570
HDPE Pipeline (48", 5-10' deep)	FT	430
HDPE Pipeline w/asphalt resurfacing (60", 5-10' deep)	FT	820
HDPE Pipeline (60", 5-10' deep)	FT	680
CMP Pipeline w/asphalt resurfacing (84", 5-10' deep)	FT	1145
CMP Pipeline (84", 5-10' deep)	FT	935
Extra depth pipe	FT	51
<b>Contingencies and Multipliers (applied to construction subtotals)</b>		
Mobilization/Demobilization	LS	10%
Traffic Control/Utility Relocation	LS	5-10%
Erosion Control	LS	2%
Construction Contingency	LS	30%
Engineering and Permitting (%)	LS	15-35%
Administration (%)	LS	10%



## CIP #: 1

## Manhassat Storm System Improvements

## DESIGN ASSUMPTIONS

1,230 LF of 30" diameter and 750 LF of 36" diameter pipe to replace existing open channel/ditch conveyance system

Replace the existing outfall to Hedges Creek

ITEM	UNIT	Unit Cost (2018)	Quantity	Total Cost
<b>Earthwork</b>				
General Earthwork/Excavation	CY	20	400	\$8,000
Clear and Grub brush including stumps	AC	8,200	0.25	\$2,050
<b>Structure Installation</b>				
Precast Concrete Manhole (60", 0-8' deep)	EA	7,600	9	\$68,400
Connection to Existing Lateral	EA	1,200	2	\$2,400
Connection to Existing Structure, standard	EA	2,000	1	\$2,000
Demo Pipe	LF	71	900	\$63,900
Outfall Improvements	EA	5,000	1	\$5,000
<b>Restoration/Resurfacing</b>				
Non-Water Quality Facility Landscaping	AC	15,300	0.25	\$3,825
<b>Pipe Unit Cost</b>				
HDPE Pipeline w/asphalt resurfacing (30", 5-10' deep)	FT	325	180	\$58,500
HDPE Pipeline (30", 5-10' deep)	FT	240	1050	\$252,000
HDPE Pipeline w/asphalt resurfacing (36", 5-10' deep)	FT	405	750	\$303,750
Project Sub-Total				\$769,825
<b>Contingencies and Multipliers</b>				
Mobilization/Demobilization	LS	10%		\$76,983
Traffic Control/Utility Relocation	LS	5%		\$38,491
Erosion Control	LS	2%		\$15,397
Construction Cost Subtotal				\$900,695
Construction Contingency	LS	30%		\$270,209
Capital Expense Total				\$1,170,904
Engineering and Permitting (%)	LS	25%		\$292,726
Administration (%)	LS	10%		\$117,090
			<b>TOTAL</b>	<b>\$1,580,720</b>

## CIP #: 2A

## Nyberg Creek Stormwater Improvements - Phase I

## DESIGN ASSUMPTIONS

Disconnect storm system at Mohawk Dr.

Install new storm trunkline down Martinazzi to new outfall at Nyberg Creek

ITEM	UNIT	Unit Cost (2018)	Quantity	Total Cost
<b>Earthwork</b>				
General Earthwork/Excavation	CY	20	40	\$800
Energy dissipation pad - Rip-Rap, Class 100	CY	81	15	\$1,215
<b>Structure Installation</b>				
Precast Concrete Manhole (60", 0-8' deep)	EA	7,600	9	\$68,400
Catch Basin, all types	EA	2,000	8	\$16,000
Demo Pipe	LF	71	900	\$63,900
Remove Manhole Structure	EA	1,000	6	\$6,000
Outfall Improvements	EA	10,000	1	\$10,000
<b>Restoration/Resurfacing</b>				
Non-Water Quality Facility Landscaping	AC	15,300	0.1	\$1,530
Riparian/Wetland Planting (Non-irrigated)	AC	20,300	0.1	\$2,030
Concrete Curbs	FT	40	1000	\$40,000
<b>Pipe Unit Cost</b>				
HDPE Inlet Lead (12", 2-5' deep)	FT	91	440	\$40,040
HDPE Pipeline w/asphalt resurfacing (24", 5-10' deep)	FT	275	1500	\$412,500
Project Sub-Total				\$662,415
<b>Contingencies and Multipliers</b>				
Mobilization/Demobilization	LS	10%		\$66,242
Traffic Control/Utility Relocation	LS	10%		\$66,242
Erosion Control	LS	2%		\$13,248
Construction Cost Subtotal				\$808,146
Construction Contingency	LS	30%		\$242,444
Capital Expense Total				\$1,050,590
Engineering and Permitting (%)	LS	35%		\$367,707
Administration (%)	LS	10%		\$105,059
			<b>TOTAL</b>	<b>\$1,523,356</b>

## CIP #: 2B

## Nyberg Creek Stormwater Improvements - Phase 2

## DESIGN ASSUMPTIONS

Upsize storm pipe along Warm Springs Drive

Install new outfall to Nyberg Creek at Tonka and Warm Springs

ITEM	UNIT	Unit Cost (2018)	Quantity	Total Cost
<b>Earthwork</b>				
General Earthwork/Excavation	CY	20	50	\$1,000
Energy dissipation pad - Rip-Rap, Class 100	CY	66	15	\$990
<b>Structure Installation</b>				
Precast Concrete Manhole (72", 0-8' deep)	EA	9,700	4	\$38,800
Connection to Existing Lateral	EA	1,200	5	\$6,000
Demo Pipe	LF	71	250	\$17,750
Remove Manhole Structure	EA	1,000	2	\$2,000
Outfall Improvements	EA	10,000	1	\$10,000
<b>Restoration/Resurfacing</b>				
Non-Water Quality Facility Landscaping	AC	15,300	0.5	\$7,650
Riparian/Wetland Planting (Non-irrigated)	AC	20,300	0.1	\$2,030
Concrete Curbs	FT	40	50	\$2,000
<b>Pipe Unit Cost</b>				
HDPE Pipeline w/asphalt resurfacing (48", 5-10' deep)	FT	570	800	\$456,000
Project Sub-Total				\$544,220
<b>Contingencies and Multipliers</b>				
Mobilization/Demobilization	LS	10%		\$54,422
Traffic Control/Utility Relocation	LS	10%		\$54,422
Erosion Control	LS	2%		\$10,884
Construction Cost Subtotal				\$663,948
Construction Contingency	LS	30%		\$199,185
Capital Expense Total				\$863,133
Engineering and Permitting (%)	LS	35%		\$302,097
Administration (%)	LS	10%		\$86,313
			<b>TOTAL</b>	<b>\$1,251,543</b>

CIP #: 2C

## Nyberg Creek Stormwater Improvements - Phase 3

## DESIGN ASSUMPTIONS

Upsize storm pipe along Boones Ferry Road

Install new StormFilter systems for increased treatment to Nasoma Ln.

ITEM	UNIT	Unit Cost (2018)	Quantity	Total Cost
<b>Earthwork</b>				
General Earthwork/Excavation	CY	20	30	\$600
<b>Water Quality Facility Installation</b>				
StormFilter (2-cartridge catch basin unit, 18" cartridges)	EA	10,100	2	\$20,200
<b>Structure Installation</b>				
Precast Concrete Manhole (60", 0-8' deep)	EA	7,600	6	\$45,600
Catch Basin, all types	EA	2,000	2	\$4,000
Connection to Existing Lateral	EA	1,200	5	\$6,000
Remove existing pavement	SY	10	100	\$1,000
Demo Pipe	LF	71	450	\$31,950
Remove Manhole Structure	EA	1,000	7	\$7,000
Outfall Improvements	EA	5,000	2	\$10,000
<b>Restoration/Resurfacing</b>				
Non-Water Quality Facility Landscaping	AC	15,300	0.1	\$1,530
Riparian/Wetland Planting (Non-irrigated)	AC	20,300	0.1	\$2,030
<b>Pipe Unit Cost</b>				
HDPE Inlet Lead (12", 2-5' deep)	FT	91	150	\$13,650
HDPE Pipeline w/asphalt resurfacing (24", 5-10' deep)	FT	275	60	\$16,500
HDPE Pipeline w/asphalt resurfacing (36", 5-10' deep)	FT	405	250	\$101,250
HDPE Pipeline w/asphalt resurfacing (42", 5-10' deep)	FT	485	75	\$36,375
Project Sub-Total				\$297,685
<b>Contingencies and Multipliers</b>				
Mobilization/Demobilization	LS	10%		\$29,769
Traffic Control/Utility Relocation	LS	10%		\$29,769
Erosion Control	LS	2%		\$5,954
Construction Cost Subtotal				\$363,176
Construction Contingency	LS	30%		\$108,953
Capital Expense Total				\$472,128
Engineering and Permitting (%)	LS	25%		\$118,032
Administration (%)	LS	10%		\$47,213
			<b>TOTAL</b>	<b>\$637,373</b>

## CIP #: 3

## Sandalwood Water Quality Retrofit

## DESIGN ASSUMPTIONS

220 LF bioswale with temporary irrigation

Relocated ditch inlet structure

ITEM	UNIT	Unit Cost (2018)	Quantity	Total Cost
<b>Earthwork</b>				
General Earthwork/Excavation	CY	20	250	\$5,000
Embankment	CY	9	70	\$630
Amended Soils and Mulch	CY	45	165	\$7,425
Energy dissipation pad - Rip-Rap, Class 50	CY	66	20	\$1,320
Drain Rock	CY	101	85	\$8,585
<b>Structure Installation</b>				
Field Ditch Inlet	EA	4,000	1	\$4,000
Precast Concrete Manhole (60", 0-8' deep)	EA	7,600	1	\$7,600
Connection to Existing Structure, standard	EA	2,000	1	\$2,000
Check dams	EA	505	3	\$1,515
<b>Restoration/Resurfacing</b>				
Non-Water Quality Facility Landscaping	AC	15,300	0.4	\$6,120
Riparian/Wetland Planting (w/temporary irrigation)	AC	32,500	0.1	\$3,250
<b>Pipe Unit Cost</b>				
HDPE Pipeline (30", 5-10' deep)	FT	240	20	\$4,800
Project Sub-Total				\$52,245
<b>Contingencies and Multipliers</b>				
Mobilization/Demobilization	LS	10%		\$5,225
Traffic Control/Utility Relocation	LS	5%		\$2,612
Erosion Control	LS	2%		\$1,045
Construction Cost Subtotal				\$61,127
Construction Contingency	LS	30%		\$18,338
Capital Expense Total				\$79,465
Engineering and Permitting (%)	LS	25%		\$19,866
Administration (%)	LS	10%		\$7,946
			<b>TOTAL</b>	<b>\$107,277</b>

## CIP #: 4

## Mohawk Apartments Stormwater Improvements

## DESIGN ASSUMPTIONS

CCTV 1,000 LF of pipe with unknown alignment and condition

Install 4 72" diameter manholes for maintenance access

Replace ditch inlet and 170 LF of 36" CMP

ITEM	UNIT	Unit Cost (2018)	Quantity	Total Cost
<b>Inspection</b>				
Mainline Video Inspection	FT	3.50	1000	\$3,500
<b>Earthwork</b>				
General Earthwork/Excavation	CY	20	75	\$1,500
Clear and Grub brush including stumps	AC	8,200	1	\$8,200
<b>Structure Installation</b>				
Field Ditch Inlet	EA	4,000	1	\$4,000
Precast Concrete Manhole (72", 9-12' deep)	EA	12,200	4	\$48,800
Connection to Existing Structure, standard	EA	2,000	9	\$18,000
Demo Pipe	LF	71	170	\$12,070
Remove Manhole Structure	EA	1,000	1	\$1,000
<b>Restoration/Resurfacing</b>				
Non-Water Quality Facility Landscaping	AC	15,300	0.1	\$1,530
<b>Pipe Unit Cost</b>				
HDPE Pipeline (36", 5-10' deep)	FT	265	170	\$45,050
Project Sub-Total				\$143,650
<b>Contingencies and Multipliers</b>				
Mobilization/Demobilization	LS	10%		\$14,365
Traffic Control/Utility Relocation	LS	5%		\$7,183
Erosion Control	LS	2%		\$2,873
Construction Cost Subtotal				\$168,071
Construction Contingency	LS	30%		\$50,421
Capital Expense Total				\$218,492
Engineering and Permitting (%)	LS	25%		\$54,623
Administration (%)	LS	10%		\$21,849
			<b>TOTAL</b>	<b>\$294,964</b>

## CIP #: 5

## Herman Road Storm System

## DESIGN ASSUMPTIONS

New 36" diameter trunkline to replace existing open channel/ditch conveyance system

Water quality treatment is not included and will be reflected with roadway design

Asphalt resurfacing over pipe is not included and will be reflected with roadway design

ITEM	UNIT	Unit Cost (2018)	Quantity	Total Cost
<b>Earthwork</b>				
General Earthwork/Excavation	CY	20	250	\$5,000
<b>Structure Installation</b>				
Precast Concrete Manhole (60", 0-8' deep)	EA	7,600	10	\$76,000
Catch Basin, all types	EA	2,000	12	\$24,000
Connection to Existing Structure, standard	EA	2,000	4	\$8,000
Demo Pipe	LF	71	600	\$42,600
Remove Manhole Structure	EA	1,000	3	\$3,000
<b>Pipe Unit Cost</b>				
HDPE Inlet Lead (12", 2-5' deep)	FT	91	420	\$38,220
HDPE Pipeline (30", 5-10' Deep)	FT	240	110	\$26,400
HDPE Pipeline (36", 5-10' deep)	FT	265	960	\$254,400
Project Sub-Total				\$477,620
<b>Contingencies and Multipliers</b>				
Mobilization/Demobilization	LS	10%		\$47,762
Traffic Control/Utility Relocation	LS	10%		\$47,762
Erosion Control	LS	2%		\$9,552
Construction Cost Subtotal				\$582,696
Construction Contingency	LS	30%		\$174,809
Capital Expense Total				\$757,505
Engineering and Permitting (%)	LS	25%		\$189,376
Administration (%)	LS	10%		\$75,751
			<b>TOTAL</b>	<b>\$1,022,632</b>

## CIP #: 6

## Blake Street Culvert Replacement

## DESIGN ASSUMPTIONS

84" diameter culvert replacement

Construction to occur in conjunction with roadway widening project

Asphalt resurfacing over culvert not reflected in cost estimate.

ITEM	UNIT	Unit Cost (2018)	Quantity	Total Cost
<b>Earthwork</b>				
General Earthwork/Excavation	CY	20	900	\$18,000
Embankment	CY	9	60	\$540
Clear and Grub brush including stumps	AC	8,200	0.1	\$820
Jute Matting, Biodegradable	SY	6	60	\$360
<b>Structure Installation</b>				
Headwall with wingwalls, 84" pipe	EA	14,000	2	\$28,000
Dewatering	EA	50,000	1	\$50,000
Outfall Improvements	EA	10,000	1	\$10,000
<b>Restoration/Resurfacing</b>				
Riparian/Wetland Planting (Non-irrigated)	AC	20,300	1	\$20,300
<b>Pipe Unit Cost</b>				
CMP Pipeline (84", 5-10' deep)	FT	935	120	\$112,200
Project Sub-Total				\$240,220
<b>Contingencies and Multipliers</b>				
Mobilization/Demobilization	LS	10%		\$24,022
Traffic Control/Utility Relocation	LS	10%		\$24,022
Erosion Control	LS	2%		\$4,804
Construction Cost Subtotal				\$293,068
Construction Contingency	LS	30%		\$87,921
Capital Expense Total				\$380,989
Engineering and Permitting (%)	LS	35%		\$133,346
Administration (%)	LS	10%		\$38,099
			<b>TOTAL</b>	<b>\$552,434</b>



## CIP #: 7

## Boones Ferry Railroad Conveyance Improvements

## DESIGN ASSUMPTIONS

Remove existing ballast/accumulated sediment and replace with rip rap.

Install new field ditch inlet and 400 LF of 42-inch pipe.

ITEM	UNIT	Unit Cost (2018)	Quantity	Total Cost
<b>Earthwork</b>				
General Earthwork/Excavation	CY	20	165	\$3,300
Energy dissipation pad - Rip-Rap, Class 100	CY	81	200	\$16,200
<b>Structure Installation</b>				
Field Ditch Inlet	EA	4,000	1	\$4,000
Precast Concrete Manhole (72", 0-8' deep)	EA	9,700	1	\$9,700
Demo pipe	LF	71	400	\$28,400
Outfall Improvements	EA	5,000	1	\$5,000
<b>Restoration/Resurfacing</b>				
Non-Water Quality Facility Landscaping	AC	15,300	0.1	\$1,530
<b>Pipe Unit Cost</b>				
HDPE Pipeline (42", 5-10' deep)	FT	345	480	\$165,600
Project Sub-Total				\$233,730
<b>Contingencies and Multipliers</b>				
Mobilization/Demobilization	LS	10%		\$23,373
Traffic Control/Utility Relocation	LS	5%		\$11,687
Erosion Control	LS	2%		\$4,675
Construction Cost Subtotal				\$273,464
Construction Contingency	LS	30%		\$82,039
Capital Expense Total				\$355,503
Engineering and Permitting (%)	LS	35%		\$124,426
Administration (%)	LS	10%		\$35,550
			<b>TOTAL</b>	<b>\$515,480</b>

## CIP #: 8

## 89th Avenue Water Quality Retrofit

## DESIGN ASSUMPTIONS

Contech CDS (Model CDS 3025) hydrodynamic separator with 150 LF of piping

ITEM	UNIT	Unit Cost (2018)	Quantity	Total Cost
<b>Earthwork</b>				
General Earthwork/Excavation	CY	20	50	\$1,000
Energy dissipation pad - Rip-Rap, Class 50	CY	66	25	\$1,650
<b>Water Quality Facility Installation</b>				
Contech CDS (Model CDS3025, 72")	EA	28,800	1	\$28,800
<b>Structure Installation</b>				
Precast Concrete Manhole (72", 0-8' deep)	EA	9,700	1	\$9,700
Flow Splitter/WQ Manhole (72", all depths)	EA	12,300	1	\$12,300
Demo pipe	LF	71	100	\$7,100
Remove existing pavement	SY	1,000	13	\$13,000
Outfall Improvements	EA	5,000	1	\$5,000
<b>Restoration/Resurfacing</b>				
Non-Water Quality Facility Landscaping	AC	15,300	0.1	\$1,530
Concrete Curbs	FT	40	20	\$800
<b>Pipe Unit Cost</b>				
HDPE Pipeline w/asphalt resurfacing (24", 5-10' deep)	FT	275	50	\$13,750
HDPE Pipeline (48", 5-10' deep)	FT	430	100	\$43,000
Project Sub-Total				\$137,630
<b>Contingencies and Multipliers</b>				
Mobilization/Demobilization	LS	10%		\$13,763
Traffic Control/Utility Relocation	LS	5%		\$6,882
Erosion Control	LS	2%		\$2,753
Construction Cost Subtotal				\$161,027
Construction Contingency	LS	30%		\$48,308
Capital Expense Total				\$209,335
Engineering and Permitting (%)	LS	15%		\$31,400
Administration (%)	LS	10%		\$20,934
			<b>TOTAL</b>	<b>\$261,669</b>

CIP #: 9

## 125th Court Water Quality Retrofit

## DESIGN ASSUMPTIONS

Contech CDS (Model CDS 3025) hydrodynamic separator with 100 LF of piping

ITEM	UNIT	Unit Cost (2018)	Quantity	Total Cost
<b>Earthwork</b>				
General Earthwork/Excavation	CY	20	50	\$1,000
<b>Water Quality Facility Installation</b>				
Contech CDS (Model CDS3025, 72")	EA	28,800	1	\$28,800
<b>Structure Installation</b>				
Precast Concrete Manhole (72", 0-8' deep)	EA	9,700	1	\$9,700
Flow Splitter/WQ Manhole (72", all depths)	EA	12,300	1	\$12,300
Connection to Existing Structure, standard	EA	2,000	3	\$6,000
Demo pipe	LF	71	50	\$3,550
Remove existing pavement	SY	1,000	13	\$13,000
<b>Pipe Unit Cost</b>				
HDPE Pipeline w/asphalt resurfacing (24", 5-10' deep)	FT	275	50	\$13,750
HDPE Pipeline w/asphalt resurfacing (36", 5-10' deep)	FT	405	50	\$20,250
Project Sub-Total				\$108,350
<b>Contingencies and Multipliers</b>				
Mobilization/Demobilization	LS	10%		\$10,835
Traffic Control/Utility Relocation	LS	5%		\$5,418
Erosion Control	LS	2%		\$2,167
Construction Cost Subtotal				\$126,770
Construction Contingency	LS	30%		\$38,031
Capital Expense Total				\$164,800
Engineering and Permitting (%)	LS	15%		\$24,720
Administration (%)	LS	10%		\$16,480
			<b>TOTAL</b>	<b>\$206,000</b>

CIP #: 10

## 93rd Avenue Green Street

## DESIGN ASSUMPTIONS

950 sf of flow-through stormwater planter

Curb and gutter along 550' of unimproved roadway

ITEM	UNIT	Unit Cost (2018)	Quantity	Total Cost
<b>Earthwork</b>				
General Earthwork/Excavation	CY	20	100	\$2,000
<b>Water Quality Facility Installation</b>				
Stormwater Planter	SF	40	950	\$38,000
Beehive Overflow	EA	1,500	2	\$3,000
<b>Structure Installation</b>				
Curb Inlet	EA	1,300	4	\$5,200
Connection to Existing Structure, standard	EA	2,000	2	\$4,000
Abandon Existing Pipe, no excavation (12")	FT	10	30	\$300
Remove Manhole Structure	EA	1,000	2	\$2,000
<b>Restoration/Resurfacing</b>				
Trench resurfacing, Permanent ACP, 6-Inch Depth	SY	71	300	\$21,300
Concrete Curbs	FT	40	550	\$22,000
<b>Pipe Unit Cost</b>				
HDPE Pipeline w/asphalt resurfacing (12", 5-10' deep)	FT	140	50	\$7,000
Project Sub-Total				\$104,800
<b>Contingencies and Multipliers</b>				
Mobilization/Demobilization	LS	10%		\$10,480
Traffic Control/Utility Relocation	LS	10%		\$10,480
Erosion Control	LS	2%		\$2,096
Construction Cost Subtotal				\$127,856
Construction Contingency	LS	30%		\$38,357
Capital Expense Total				\$166,213
Engineering and Permitting (%)	LS	25%		\$41,553
Administration (%)	LS	10%		\$16,621
			<b>TOTAL</b>	<b>\$224,387</b>

## CIP #: 11

## Juanita Pohl Water Quality Retrofit

## DESIGN ASSUMPTIONS

1300 sf of flow through raingarden

ITEM	UNIT	Unit Cost (2018)	Quantity	Total Cost
<b>Earthwork</b>				
General Earthwork/Excavation	CY	20	180	\$3,600
<b>Water Quality Facility Installation</b>				
Rain Garden	SF	27	1300	\$35,100
Beehive Overflow	EA	1,500	2	\$3,000
<b>Structure Installation</b>				
Precast Concrete Manhole (48", 0-8' deep)	EA	5,600	2	\$11,200
Connection to Existing Structure, standard	EA	2,000	2	\$4,000
Check dams	EA	505	2	\$1,010
Stem wall check dams	LF	66	90	\$5,940
<b>Restoration/Resurfacing</b>				
Trench resurfacing, Permanent ACP, 6-Inch Depth	SY	71	50	\$3,550
Concrete Curbs	FT	40	100	\$4,000
<b>Pipe Unit Cost</b>				
HDPE Inlet Lead (12", 2-5' deep)	FT	91	50	\$4,550
Project Sub-Total				\$75,950
<b>Contingencies and Multipliers</b>				
Mobilization/Demobilization	LS	10%		\$7,595
Traffic Control/Utility Relocation	LS	5%		\$3,798
Erosion Control	LS	2%		\$1,519
Construction Cost Subtotal				\$88,862
Construction Contingency	LS	30%		\$26,658
Capital Expense Total				\$115,520
Engineering and Permitting (%)	LS	25%		\$28,880
Administration (%)	LS	10%		\$11,552
<b>TOTAL</b>				<b>\$155,952</b>

## CIP #: 12

## Community Park Water Quality Retrofit

## DESIGN ASSUMPTIONS

1550 sf of raingarden/swale

ITEM	UNIT	Unit Cost (2018)	Quantity	Total Cost
<b>Earthwork</b>				
General Earthwork/Excavation	CY	20	175	\$3,500
<b>Water Quality Facility Installation</b>				
Rain Garden	SF	27	1550	\$41,850
Beehive Overflow	EA	1,500	2	\$3,000
<b>Structure Installation</b>				
Precast Concrete Manhole (48", 0-8' deep)	EA	5,600	2	\$11,200
Connection to Existing Structure, standard	EA	2,000	2	\$4,000
Abandon Existing Pipe, no excavation (12")	FT	10	60	\$600
Remove Manhole Structure	EA	1,000	3	\$3,000
<b>Restoration/Resurfacing</b>				
Trench resurfacing, Permanent ACP, 6-Inch Depth	SY	71	20	\$1,420
Concrete Curbs	FT	40	150	\$6,000
<b>Pipe Unit Cost</b>				
HDPE Inlet Lead (12", 2-5' deep)	FT	91	25	\$2,275
Project Sub-Total				\$76,845
<b>Contingencies and Multipliers</b>				
Mobilization/Demobilization	LS	10%		\$7,685
Traffic Control/Utility Relocation	LS	5%		\$3,842
Erosion Control	LS	2%		\$1,537
Construction Cost Subtotal				\$89,909
Construction Contingency	LS	30%		\$26,973
Capital Expense Total				\$116,881
Engineering and Permitting (%)	LS	25%		\$29,220
Administration (%)	LS	10%		\$11,688
			<b>TOTAL</b>	<b>\$157,790</b>

CIP #: 13

## Water Quality Facility Restoration - Venetia

## DESIGN ASSUMPTIONS

Water quality swale is approx. 15' wide, 200' long, 1.5' deep, with 4' bottom width.

2' of excavation and installation of 1' of amended soils and temporary irrigated vegetation

Refurbish maintenance access road from Lee Street

ITEM	UNIT	Unit Cost (2018)	Quantity	Total Cost
<b>Earthwork</b>				
General Earthwork/Excavation	CY	20	225	\$4,500
Clear and Grub brush including stumps	AC	8,200	0.3	\$2,460
Amended Soils and Mulch	CY	45	100	\$4,500
Energy dissipation pad - Rip-Rap, Class 50	CY	66	5	\$330
<b>Water Quality Facility Installation</b>				
Water Quality Facility Plantings with Trees	SF	6	2580	\$15,480
Gravel Access Road	SF	5	750	\$3,750
<b>Restoration/Resurfacing</b>				
Non-Water Quality Facility Landscaping	AC	15,300	0.2	\$3,060
Project Sub-Total				\$34,080
<b>Contingencies and Multipliers</b>				
Mobilization/Demobilization	LS	10%		\$3,408
Traffic Control/Utility Relocation	LS	5%		\$1,704
Erosion Control	LS	2%		\$682
Construction Cost Subtotal				\$39,874
Construction Contingency	LS	30%		\$11,962
Capital Expense Total				\$51,836
Engineering and Permitting (%)	LS	15%		\$7,775
Administration (%)	LS	10%		\$5,184
			<b>TOTAL</b>	\$64,795

## CIP #: 14

## Water Quality Facility Restoration - Piute Court

## DESIGN ASSUMPTIONS

4,000 sf facility with a 7 ft design depth

3' of excavation and installation of 1' of amended soils and temporary irrigated vegetation

Install a maintenance access road from Piute Court

ITEM	UNIT	Unit Cost (2018)	Quantity	Total Cost
<b>Earthwork</b>				
General Earthwork/Excavation	CY	20	450	\$9,000
Clear and Grub brush including stumps	AC	8,200	0.2	\$1,640
Amended Soils and Mulch	CY	45	150	\$6,750
Energy dissipation pad - Rip-Rap, Class 50	CY	66	10	\$660
<b>Water Quality Facility Installation</b>				
Pond Outflow Control Structure	EA	6,100	1	\$6,100
Gravel Access Road	SF	5	1000	\$5,000
<b>Structure Installation</b>				
Flow Splitter/WQ Manhole (72", all depths)	EA	12,300	1	\$12,300
Connection to Existing Lateral	EA	1,200	2	\$2,400
<b>Restoration/Resurfacing</b>				
Non-Water Quality Facility Landscaping	AC	15,300	0.5	\$7,650
Riparian/Wetland Planting (w/temporary irrigation)	AC	32,500	0.1	\$3,250
Project Sub-Total				\$54,750
<b>Contingencies and Multipliers</b>				
Mobilization/Demobilization	LS	10%		\$5,475
Traffic Control/Utility Relocation	LS	5%		\$2,738
Erosion Control	LS	2%		\$1,095
Construction Cost Subtotal				\$64,058
Construction Contingency	LS	30%		\$19,217
Capital Expense Total				\$83,275
Engineering and Permitting (%)	LS	15%		\$12,491
Administration (%)	LS	10%		\$8,327
			<b>TOTAL</b>	<b>\$104,093</b>



## CIP #: 15

## Water Quality Facility Restoration - Sequoia Ridge

## DESIGN ASSUMPTIONS

4,000 sf facility with a 5 ft design depth

3' of excavation and installation of 1' of amended soils and temporary irrigated vegetation

Install upstream water quality/flow control manhole for offline configuration

ITEM	UNIT	Unit Cost (2018)	Quantity	Total Cost
<b>Earthwork</b>				
General Earthwork/Excavation	CY	20	450	\$9,000
Clear and Grub brush including stumps	AC	8,200	0.4	\$3,280
Amended Soils and Mulch	CY	45	150	\$6,750
Tree removal	EA	300	30	\$9,000
Energy dissipation pad - Rip-Rap, Class 50	CY	66	2	\$132
<b>Water Quality Facility Installation</b>				
Pond Outflow Control Structure	EA	6,100	1	\$6,100
<b>Restoration/Resurfacing</b>				
Non-Water Quality Facility Landscaping	AC	15,300	0.2	\$3,060
Riparian/Wetland Planting (w/temporary irrigation)	AC	32,500	0.2	\$6,500
Project Sub-Total				\$43,822
<b>Contingencies and Multipliers</b>				
Mobilization/Demobilization	LS	10%		\$4,382
Traffic Control/Utility Relocation	LS	5%		\$2,191
Erosion Control	LS	2%		\$876
Construction Cost Subtotal				\$51,272
Construction Contingency	LS	30%		\$15,382
Capital Expense Total				\$66,653
Engineering and Permitting (%)	LS	15%		\$9,998
Administration (%)	LS	10%		\$6,665
			<b>TOTAL</b>	<b>\$83,317</b>

CIP #: 16

## Water Quality Facility Restoration - Sweek Drive Pond

## DESIGN ASSUMPTIONS

3,000 sf facility adjacent to larger Sweek Pond

3' of excavation and installation of 1' of amended soils and temporary irrigated vegetation

ITEM	UNIT	Unit Cost (2018)	Quantity	Total Cost
<b>Earthwork</b>				
General Earthwork/Excavation	CY	20	350	\$7,000
Clear and Grub brush including stumps	AC	8,200	0.2	\$1,640
Amended Soils and Mulch	CY	45	110	\$4,950
Tree Removal	EA	300	30	\$9,000
Energy dissipation pad - Rip-Rap, Class 50	CY	66	4	\$264
<b>Water Quality Facility Installation</b>				
Pond Outflow Control Structure	EA	6,100	1	\$6,100
<b>Structure Installation</b>				
Flow Splitter/WQ Manhole (72", all depths)	EA	12,200	1	\$12,200
Connection to Existing Lateral	EA	1,200	3	\$3,600
<b>Restoration/Resurfacing</b>				
Non-Water Quality Facility Landscaping	AC	15,300	0.2	\$3,060
Riparian/Wetland Planting (w/temporary irrigation)	AC	32,500	0.2	\$6,500
Project Sub-Total				\$54,314
<b>Contingencies and Multipliers</b>				
Mobilization/Demobilization	LS	10%		\$5,431
Traffic Control/Utility Relocation	LS	5%		\$2,716
Erosion Control	LS	2%		\$1,086
Construction Cost Subtotal				\$63,547
Construction Contingency	LS	30%		\$19,064
Capital Expense Total				\$82,612
Engineering and Permitting (%)	LS	15%		\$12,392
Administration (%)	LS	10%		\$8,261
			<b>TOTAL</b>	<b>\$103,264</b>

## CIP #17

## Siuslaw Water Quality Retrofit

## DESIGN ASSUMPTIONS

Replace stormwater pipe from Boones Ferry Rd to Siuslaw Lane due to condition

Regrade/amend soils in existing greenway for enhanced water quality treatment

Install sedimentation manhole upstream of swale

ITEM	UNIT	Unit Cost (2018)	Quantity	Total Cost
<b>Earthwork</b>				
General Earthwork/Excavation	CY	20	560	\$11,200
Amended Soils and Mulch	CY	45	420	\$18,900
Energy dissipation pad - Rip-Rap, Class 100	CY	81	15	\$1,215
<b>Structure Installation</b>				
Precast Concrete Manhole (60", 0-8' deep)	EA	7,600	2	\$15,200
Flow Splitter/WQ Manhole (72", all depths)	EA	12,300	1	\$12,300
Catch Basin, all types	EA	2,000	3	\$6,000
Connection to Existing Lateral	EA	1,200	1	\$1,200
Connection to Existing Structure, standard	EA	2,000	1	\$2,000
Abandon Existing Pipe, no excavation (27"-36")	FT	35	70	\$2,450
Check dams	EA	505	5	\$2,525
Outfall Improvements	EA	3,000	2	\$6,000
<b>Restoration/Resurfacing</b>				
Riparian/Wetland Planting (w/temporary irrigation)	AC	32,500	0.2	\$6,500
<b>Pipe Unit Cost</b>				
HDPE Pipeline w/asphalt resurfacing (30", 5-10' deep)	FT	325	100	\$32,500
HDPE Pipeline (30", 5-10' deep)	FT	240	250	\$60,000
HDPE Pipeline (48", 5-10' deep)	FT	430	100	\$43,000
Project Sub-Total				\$220,990
<b>Contingencies and Multipliers</b>				
Mobilization/Demobilization	LS	10%		\$22,099
Traffic Control/Utility Relocation	LS	5%		\$11,050
Erosion Control	LS	2%		\$4,420
Construction Cost Subtotal				\$258,558
Construction Contingency	LS	30%		\$77,567
Capital Expense Total				\$336,126
Engineering and Permitting (%)	LS	25%		\$84,031
Administration (%)	LS	10%		\$33,613
			<b>TOTAL</b>	<b>\$453,770</b>

## CIP #: 18

## Water Quality Facility Restoration - Waterford

## DESIGN ASSUMPTIONS

2,500 sf facility, approx. 4' deep

3' of excavation and installation of 1' of amended soils and temporary irrigated vegetation

Relocation and replacement of outlet control structure with new 24" pipe

ITEM	UNIT	Unit Cost (2018)	Quantity	Total Cost
<b>Earthwork</b>				
General Earthwork/Excavation	CY	20	560	\$11,200
Clear and Grub brush including stumps	AC	8,200	0.3	\$2,460
Amended Soils and Mulch	CY	45	100	\$4,500
Energy dissipation pad - Rip-Rap, Class 50	CY	66	12	\$792
<b>Water Quality Facility Installation</b>				
Pond Outflow Control Structure	EA	6,100	1	\$6,100
Water Quality Facility Plantings with Trees	SF	6	1200	\$7,200
<b>Structure Installation</b>				
Flow Splitter/WQ Manhole (72", all depths)	EA	12,300	2	\$24,600
Connection to Existing Lateral	EA	1,200	8	\$9,600
Abandon Existing Pipe, no excavation (21"-24")	FT	25	80	\$2,000
Abandon Existing Structure	EA	1,000	1	\$1,000
Remove Manhole Structure	EA	1,000	2	\$2,000
<b>Restoration/Resurfacing</b>				
Non-Water Quality Facility Landscaping	AC	15,300	0.2	\$3,060
Riparian/Wetland Planting (w/temporary irrigation)	AC	32,500	0.2	\$6,500
<b>Pipe Unit Cost</b>				
HDPE Pipeline w/asphalt resurfacing (24", 5-10' deep)	FT	275	50	\$13,750
Project Sub-Total				\$94,762
<b>Contingencies and Multipliers</b>				
Mobilization/Demobilization	LS	10%		\$9,476
Traffic Control/Utility Relocation	LS	5%		\$4,738
Erosion Control	LS	2%		\$1,895
Construction Cost Subtotal				\$110,872
Construction Contingency	LS	30%		\$33,261
Capital Expense Total				\$144,133
Engineering and Permitting (%)	LS	15%		\$21,620
Administration (%)	LS	10%		\$14,413
<b>TOTAL</b>				<b>\$180,166</b>

CIP #: 19

## Saum Creek Hillslope Repair

## DESIGN ASSUMPTIONS

Replace existing 18-inch pipe to outfall

Install bank reinforcement to prevent further erosion

Conduct geotechnical evaluation of bank slope conditions

ITEM	UNIT	Unit Cost (2018)	Quantity	Total Cost
<b>Earthwork</b>				
Clear and Grub brush including stumps	AC	8,200	0.1	\$820
Geotextile	SY	3	140	\$420
Energy dissipation pad - Rip-Rap, Class 200	CY	96	60	\$5,760
<b>Structure Installation</b>				
Precast Concrete Manhole (60", 0-8' deep)	EA	7,600	1	\$7,600
Catch Basin, all types	EA	2,000	1	\$2,000
Demo pipe	LF	71	100	\$7,100
Outfall Improvements	EA	10,000	1	\$10,000
<b>Restoration/Resurfacing</b>				
Riparian/Wetland Planting (Non-irrigated)	AC	20,300	0.4	\$8,120
<b>Pipe Unit Cost</b>				
Underdrain, 6" perforated HDPE	LF	56	50	\$2,800
HDPE Pipeline w/asphalt resurfacing (18", 5-10' deep)	FT	200	120	\$24,000
Project Sub-Total				\$68,620
<b>Contingencies and Multipliers</b>				
Mobilization/Demobilization	LS	10%		\$6,862
Traffic Control/Utility Relocation	LS	5%		\$3,431
Erosion Control	LS	2%		\$1,372
Construction Cost Subtotal				\$80,285
Construction Contingency	LS	30%		\$24,086
Capital Expense Total				\$104,371
Geotechnical Evaluation	LS	20000	1	\$20,000
Engineering and Permitting (%)	LS	35%		\$36,530
Administration (%)	LS	10%		\$10,437
			<b>TOTAL</b>	<b>\$171,338</b>

**CIP #: 20**

**Hedges Creek Stream Repair**

**DESIGN ASSUMPTIONS**

Costs directly from the Hedges Creek (SW Ibach Road to SW 105th Avenue) Stream Assessment, CIP Opinion of Construction Costs for Identified Sites, February 2018, GreenWorks PC and OTAK, INC. Refer to report for detailed cost information.

Stream rehabilitation

Sanitary infrastructure protection

Outfall Improvements

ITEM	UNIT	Unit Cost (2018)	Quantity	Total Cost
<b>Location "M"</b>				
Capital Project Implementation Cost Total				\$146,874
<b>Location "N"</b>				
Capital Project Implementation Cost Total				\$179,793
			<b>TOTAL</b>	<b>\$326,667</b>

## CIP #: 21

## Nyberg Water Quality Retrofit

## DESIGN ASSUMPTIONS

1.5 acres water quality facility with additional site improvements

3' of excavation and installation of 1.5' of amended soils and temporary irrigated vegetation

Excavated outflow channel from facility to Nyberg Creek

Installation of low flow bypass from Martinazzi and Warm Springs to proposed facility

ITEM	UNIT	Unit Cost (2018)	Quantity	Total Cost
<b>Earthwork</b>				
General Earthwork/Excavation	CY	20	5362	\$107,244
Clear and Grub brush including stumps	AC	8,200	1.54	\$12,639
Amended Soils and Mulch	CY	45	2823	\$127,050
Jute Matting, Biodegradable	SY	6	1083	\$6,500
Tree removal	EA	300	20	\$6,000
Energy dissipation pad - Rip-Rap, Class 50	CY	66	59	\$3,911
<b>Water Quality Facility Installation</b>				
Pond Outflow Control Structure	EA	6,100	1	\$6,100
Pond Inlet Structure	EA	4,500	1	\$4,500
Water Quality Facility Plantings with Trees	SF	6	43560	\$261,360
Gravel Access Road	SF	5	1800	\$9,000
Beehive Overflow	EA	1,500	3	\$4,500
<b>Structure Installation</b>				
Precast Concrete Manhole (48", 0-8' deep)	EA	5,600	2	\$11,200
Precast Concrete Manhole (48", 13-20' deep)	EA	10,200	1	\$10,200
Precast Concrete Manhole (60", 0-8' deep)	EA	7,600	1	\$7,600
Precast Concrete Manhole (60", 9-12' deep)	EA	9,700	1	\$9,700
Flow Splitter/WQ Manhole (72", all depths)	EA	12,300	2	\$24,600
Catch Basin, all types	EA	2,000	3	\$6,000
Connection to Existing Lateral	EA	1,200	5	\$6,000
Abandon Existing Pipe, no excavation (12")	FT	10	490	\$4,900
Abandon Existing Structure	EA	1,000	3	\$3,000
Remove Manhole Structure	EA	1,000	2	\$2,000
Outfall Improvements	EA	7,500	1	\$7,500
<b>Restoration/Resurfacing</b>				
Riparian/Wetland Planting (Non-irrigated)	AC	20,300	0.5	\$10,150
Hydroseed, large quantities	AC	2,500	0.5	\$1,250
<b>Pipe Unit Cost</b>				
HDPE Inlet Lead (12", 2-5' Deep)	FT	91	100	\$9,100
HDPE Overflow from Beehive Overflows (12", 2-5' Deep)	FT	76	75	\$5,700
HDPE Pipeline w/asphalt resurfacing (12", 5-10' Deep)	FT	140	485	\$67,900
HDPE Pipeline w/asphalt resurfacing (24", 5-10' deep)	FT	275	275	\$75,625
Project Sub-Total				\$811,229
<b>Contingencies and Multipliers</b>				
Mobilization/Demobilization	LS	10%		\$81,123
Traffic Control/Utility Relocation	LS	5%		\$40,561
Erosion Control	LS	2%		\$16,225
Construction Cost Subtotal				\$949,138
Construction Contingency	LS	30%		\$284,742
Capital Expense Total				\$1,233,880
Engineering and Permitting (%)	LS	35%		\$431,858
Administration (%)	LS	10%		\$123,388
Wetland Delineation	LS	15,000	1	\$15,000
Wetland Mitigation	LS	232,500	1	\$232,500
			<b>TOTAL</b>	<b>\$2,036,626</b>





## Appendix H: Staffing Analysis

---



**Table H-1. Staffing Analysis Summary by CIP ID#**

CIP ID	Project Description	Project Information	Priority Project (Y/N)	Engineering Responsibility	Maintenance Details <sup>a</sup>	Estimated Annual Maintenance Resource Needs (FTE) <sup>b</sup>	Estimated Staff Resource Needs (\$ and FTE) <sup>c</sup>
CIP #1 Manhasset Storm System Improvements	Replace existing conveyance open channel with pipe	<ul style="list-style-type: none"> <li>Engineering and permitting costs estimated at 25% of the construction cost. Assume consultant to complete.</li> <li>Construction administration (City staff) estimated at 10% of the construction cost.</li> <li>New infrastructure will require more frequent maintenance due to anticipated sediment accumulation (annual pipe cleaning).</li> <li>Project cost (total): \$1,581,000.</li> </ul>	N	Staff/consultant	<ul style="list-style-type: none"> <li>1,980 linear feet (LF) of new pipe</li> <li>Annual pipe cleaning (20' /hr)</li> </ul>	Approximately 100 hours of annual maintenance (0.05 FTE)	Construction administration (total): \$117,000 (or 0.78 FTE)
CIP #2a Phase 1 Nyberg Creek Stormwater Improvements	Install upsized and new storm lines in Martinazzi Avenue and construct new outfall to Nyberg Creek	<ul style="list-style-type: none"> <li>Engineering and permitting costs estimated at 35% of the construction cost. Assume consultant to complete.</li> <li>Construction administration (City staff) estimated at 10% of the construction cost.</li> <li>New infrastructure will require more frequent maintenance due to anticipated sediment accumulation (annual pipe cleaning, outfall debris removal).</li> <li>Project cost (total): \$1,523,000.</li> </ul>	Y	Staff/consultant	<ul style="list-style-type: none"> <li>1,940 LF of new pipe, 1 new outfall</li> <li>Annual pipe cleaning (20' /hr)</li> <li>Outfall debris removal (4 hrs)</li> </ul>	Approximately 100 hours of annual maintenance (0.05 FTE)	Construction administration (total): \$105,000 (or 0.70 FTE)
CIP #2b Phase 2 Nyberg Creek Stormwater Improvements	Install upsized and new storm lines along Warm Springs Drive and construct new outfall to Nyberg Creek	<ul style="list-style-type: none"> <li>Engineering and permitting costs estimated at 35% of the construction cost. Assume consultant to complete.</li> <li>Construction administration (City staff) estimated at 10% of the construction cost.</li> <li>New infrastructure will require more frequent maintenance due to anticipated sediment accumulation (annual pipe cleaning, outfall debris removal).</li> <li>Project cost (total): \$1,208,000.</li> </ul>	N	Staff/consultant	<ul style="list-style-type: none"> <li>800 LF of new pipe, 1 new outfall</li> <li>Annual pipe cleaning (20' /hr)</li> <li>Outfall debris removal (4 hrs)</li> </ul>	Approximately 44 hours of annual maintenance (0.03 FTE)	Construction administration (total): \$86,000 (or 0.57 FTE)
CIP #2c Phase 3 Nyberg Creek Stormwater Improvements	Install upsized and new storm lines along Boones Ferry and install new WQ treatment facilities (StormFilter cbs)	<ul style="list-style-type: none"> <li>Engineering and permitting costs estimated at 25% of the construction cost. Assume consultant to complete.</li> <li>Construction administration (City staff) estimated at 10% of the construction cost.</li> <li>New infrastructure will require more frequent maintenance due to anticipated sediment accumulation (annual pipe cleaning, StormFilter cbs maintenance).</li> <li>Project cost (total): \$637,000.</li> </ul>	N	Staff/consultant	<ul style="list-style-type: none"> <li>535 LF of new pipe, 2 new StormFilters</li> <li>Annual pipe cleaning (20' /hr)</li> <li>StormFilter maintenance (6 hr/facility - assumed)</li> </ul>	Approximately 40 hours of annual maintenance (0.02 FTE)	Construction administration (total): \$47,000 (or 0.31 FTE)
CIP #3 Sandalwood Water Quality Retrofit	Retrofit existing open channel to WQ facility	<ul style="list-style-type: none"> <li>Engineering and permitting costs estimated at 25% of the construction cost. Assume consultant to complete.</li> <li>Construction administration estimated at 10% of the construction cost.</li> <li>New WQ facility will require annual inspections and maintenance to ensure plant viability and system functionality.</li> <li>Project cost (total): \$107,000.</li> </ul>	N	Staff/consultant	<ul style="list-style-type: none"> <li>220' water quality swale</li> <li>Inspection four times/year (4 hrs total)</li> <li>Annual swale maintenance (20' /hr)</li> </ul>	Approximately 15 hours of annual maintenance (0.01 FTE)	Construction administration (total): \$8,000 (or 0.06 FTE)
CIP #4 Mohawk Apartments Stormwater Improvements	CCTV pipe, replace pipe, install four new manholes and restore open channel	<ul style="list-style-type: none"> <li>Engineering and permitting costs estimated at 25% of the construction cost. Assume consultant to complete.</li> <li>Construction administration (City staff) estimated at 10% of the construction cost.</li> <li>CCTV effort to be conducted by City staff. New manholes will require annual maintenance (previously unaccounted).</li> <li>Project cost (total): \$295,000.</li> </ul>	N	Staff/consultant	<ul style="list-style-type: none"> <li>1,000 LF of CCTV, 4 new manholes</li> <li>CCTV (200' /hr)</li> <li>Annual WQ manhole maintenance (1 hr/MH with biannual frequency)</li> </ul>	Approximately 13 hours of annual maintenance (0.01 FTE)	Construction administration (total): \$22,000 (or 0.15 FTE)
CIP #5 Herman Road Storm System	Construct new storm conveyance associated with roadway improvements	<ul style="list-style-type: none"> <li>Engineering and permitting costs estimated at 25% of the construction cost. Assume consultant to complete.</li> <li>Construction administration (City staff) estimated at 10% of the construction cost.</li> <li>New infrastructure will require more frequent maintenance due to anticipated sediment accumulation (annual pipe cleaning).</li> <li>Project cost (total): \$1,023,000.</li> </ul>	Y	Staff/consultant	<ul style="list-style-type: none"> <li>1,490 LF of new pipe, 12 new catch basins</li> <li>Annual pipe cleaning (20' /hr)</li> <li>Annual cb maintenance (1hr/cb)</li> </ul>	Approximately 87 hours of annual maintenance (0.05 FTE)	Construction administration (total): \$76,000 (or 0.51 FTE)
CIP #6 Blake Street Culvert Replacement	Replace culvert at Hedges Creek associated with roadway improvements	<ul style="list-style-type: none"> <li>Engineering and permitting costs estimated at 35% of the construction cost. Assume consultant to complete.</li> <li>Construction administration (City staff) estimated at 10% of the construction cost.</li> <li>No additional maintenance requirements.</li> <li>Project cost (total): \$552,000.</li> </ul>	Y	Staff/consultant	<ul style="list-style-type: none"> <li>120 LF of new culvert</li> <li>No increased maintenance obligation or frequency expected.</li> </ul>	N/A	Construction administration (total): \$38,000 (or 0.25 FTE)
CIP #7 Boones Ferry Railroad Conveyance Improvements	Replace 400 LF of undersized pipe, ditch inlet, install a WQ manhole and mitigate gravel migration downstream	<ul style="list-style-type: none"> <li>Engineering and permitting costs estimated at 35% of the construction cost. Assume consultant to complete.</li> <li>Construction administration (City staff) estimated at 10% of the construction cost.</li> <li>New and replaced infrastructure will require more frequent maintenance due to anticipated sediment accumulation (annual pipe cleaning, open channel maintenance)</li> <li>Project cost (total): \$515,000.</li> </ul>	N	Staff/consultant	<ul style="list-style-type: none"> <li>480 LF of replaced pipe, 150' open channel, 1 new manhole</li> <li>Annual pipe cleaning (20' /hr)</li> <li>Annual open channel cleaning (20' /hr)</li> <li>Annual WQ manhole maintenance (1 hr/MH with biannual frequency)</li> </ul>	Approximately 32 hours of annual maintenance (0.02 FTE)	Construction administration (total): \$36,000 (or 0.24 FTE)

**Table H-1. Staffing Analysis Summary by CIP ID#**

CIP ID	Project Description	Project Information	Priority Project (Y/N)	Engineering Responsibility	Maintenance Details <sup>a</sup>	Estimated Annual Maintenance Resource Needs (FTE) <sup>b</sup>	Estimated Staff Resource Needs (\$ and FTE) <sup>c</sup>
CIP #8 89th Ave Water Quality Retrofit	Install WQ CDS unit and associated piping	<ul style="list-style-type: none"> <li>Engineering and permitting costs estimated at 15% of the construction cost. Assume consultant to complete.</li> <li>Construction administration (City staff) estimated at 10% of the construction cost.</li> <li>New infrastructure will require more frequent maintenance due to anticipated sediment accumulation (annual pipe cleaning, CDS maintenance)</li> <li>Project cost (total): \$262,000.</li> </ul>	N	Staff/consultant	<ul style="list-style-type: none"> <li>150 LF of new pipe, new CDS WQ facility</li> <li>Annual pipe cleaning (20' / hr)</li> <li>CDS maintenance (6 hr/facility - assumed)</li> </ul>	Approximately 14 hours of annual maintenance (0.01 FTE)	Construction administration (total): \$21,000 (or 0.14 FTE)
CIP #9 125th Ct Water Quality Retrofit	Install WQ CDS unit and associated piping	<ul style="list-style-type: none"> <li>Engineering and permitting costs estimated at 15% of the construction cost. Assume consultant to complete.</li> <li>Construction administration (City staff) estimated at 10% of the construction cost.</li> <li>New infrastructure will require more frequent maintenance due to anticipated sediment accumulation (annual pipe cleaning, CDS maintenance)</li> <li>Project cost (total): \$206,000.</li> </ul>	N	Staff/consultant	<ul style="list-style-type: none"> <li>100 LF of new pipe, new CDS WQ facility</li> <li>Annual pipe cleaning (20' / hr)</li> <li>CDS maintenance (6 hr/facility - assumed)</li> </ul>	Approximately 11 hours of annual maintenance (0.01 FTE)	Construction administration (total): \$16,000 (or 0.11 FTE)
CIP #10 93rd Ave Green Street	Add WQ planters	<ul style="list-style-type: none"> <li>Engineering and permitting costs estimated at 25% of the construction cost. Assume consultant to complete.</li> <li>Construction administration (City staff) estimated at 10% of the construction cost.</li> <li>New WQ facility will require annual inspections and maintenance to ensure plant viability and system functionality.</li> <li>Project cost (total): \$224,000.</li> </ul>	N	Staff/consultant	<ul style="list-style-type: none"> <li>950 sf of WQ planters</li> <li>Inspection four times/year (4 hrs total)</li> <li>Annual planter maintenance (50 sf/hr)</li> </ul>	Approximately 23 hours of annual maintenance (0.02 FTE)	Construction administration (total): \$17,000 (or 0.11 FTE)
CIP #11 Juanita Pohl Water Quality Retrofit	Retrofit parking lot with WQ planters	<ul style="list-style-type: none"> <li>Engineering and permitting costs estimated at 25% of the construction cost. Assume consultant to complete.</li> <li>Construction administration (City staff) estimated at 10% of the construction cost.</li> <li>New WQ facility will require annual inspections and maintenance to ensure plant viability and system functionality.</li> <li>Project cost (total): \$156,000.</li> </ul>	Y	Staff/consultant	<ul style="list-style-type: none"> <li>1,300 sf of WQ planters</li> <li>Inspection four times/year (4 hrs total)</li> <li>Annual planter maintenance (50 sf/hr)</li> </ul>	Approximately 30 hours of annual maintenance (0.02 FTE)	Construction administration (total): \$12,000 (or 0.08 FTE)
CIP #12 Community Park Water Quality Retrofit	Retrofit parking lot with WQ planters	<ul style="list-style-type: none"> <li>Engineering and permitting costs estimated at 25% of the construction cost. Assume consultant to complete.</li> <li>Construction administration (City staff) estimated at 10% of the construction cost.</li> <li>New WQ facility will require annual inspections and maintenance to ensure plant viability and system functionality.</li> <li>Project cost (total): \$158,000.</li> </ul>	Y	Staff/consultant	<ul style="list-style-type: none"> <li>1,550 sf of WQ planters</li> <li>Inspection four times/year (4 hrs total)</li> <li>Annual planter maintenance (50 sf/hr)</li> </ul>	Approximately 35 hours of annual maintenance (0.02 FTE)	Construction administration (total): \$12,000 (or 0.08 FTE)
CIP #13 Water Quality Facility Maintenance - Venetia	Maintain existing WQ facility to restore function	<ul style="list-style-type: none"> <li>Engineering and permitting costs estimated at 15% of the construction cost. Assume consultant to complete.</li> <li>Construction administration (City staff) estimated at 10% of the construction cost.</li> <li>Ongoing facility maintenance reflected in programmatic project.</li> <li>Project cost (total): \$65,000.</li> </ul>	Y	Staff/consultant	<ul style="list-style-type: none"> <li>WQ facility maintenance</li> <li>Project to be performed by hired contractor</li> <li>Increased maintenance obligation or frequency to be accounted for in programmatic project</li> </ul>	N/A	Construction administration (total): \$5,000 (or 0.03 FTE)
CIP #14 Water Quality Facility Maintenance - Piute Ct	Maintain existing WQ facility to restore function	<ul style="list-style-type: none"> <li>Engineering and permitting costs estimated at 15% of the construction cost. Assume consultant to complete.</li> <li>Construction administration (City staff) estimated at 10% of the construction cost.</li> <li>Ongoing WQ facility maintenance reflected in programmatic project.</li> <li>Project cost (total): \$104,000.</li> </ul>	Y	Staff/consultant	<ul style="list-style-type: none"> <li>WQ facility maintenance</li> <li>Project to be performed by hired contractor</li> <li>Increased maintenance obligation or frequency to be accounted for in programmatic project</li> </ul>	N/A	Construction administration (total): \$8,000 (or 0.05 FTE)
CIP #15 Water Quality Facility Maintenance - Sequoia Ridge	Maintain existing WQ facility to restore function	<ul style="list-style-type: none"> <li>Engineering and permitting costs estimated at 15% of the construction cost. Assume consultant to complete.</li> <li>Construction administration (City staff) estimated at 10% of the construction cost.</li> <li>Ongoing WQ facility maintenance reflected in programmatic project.</li> <li>Project cost (total): \$83,000.</li> </ul>	Y	Staff/consultant	<ul style="list-style-type: none"> <li>WQ facility maintenance</li> <li>Project to be performed by hired contractor</li> <li>Increased maintenance obligation or frequency to be accounted for in programmatic project</li> </ul>	N/A	Construction administration (total): \$7,000 (or 0.05 FTE)
CIP #16 Water Quality Facility Maintenance - Sweek Pond	Maintain existing WQ facility to restore function	<ul style="list-style-type: none"> <li>Engineering and permitting costs estimated at 15% of the construction cost. Assume consultant to complete.</li> <li>Construction administration (City staff) estimated at 10% of the construction cost.</li> <li>Ongoing WQ facility maintenance reflected in programmatic project.</li> <li>Project cost (total): \$103,000.</li> </ul>	Y	Staff/consultant	<ul style="list-style-type: none"> <li>WQ facility maintenance</li> <li>Project to be performed by hired contractor</li> <li>Increased maintenance obligation or frequency to be accounted for in programmatic project</li> </ul>	N/A	Construction administration (total): \$8,000 (or 0.05 FTE)

Table H-1. Staffing Analysis Summary by CIP ID#							
CIP ID	Project Description	Project Information	Priority Project (Y/N)	Engineering Responsibility	Maintenance Details <sup>a</sup>	Estimated Annual Maintenance Resource Needs (FTE) <sup>b</sup>	Estimated Staff Resource Needs (\$ and FTE) <sup>c</sup>
CIP #17 Alsea/BF Rd 99th/Siuslaw Greenway	Replace failing pipes, add pretreatment and enhance water quality along greenway path with WQ swale	<ul style="list-style-type: none"> <li>Engineering and permitting costs estimated at 25% of the construction cost. Assume consultant to complete.</li> <li>Construction administration (City staff) estimated at 10% of the construction cost.</li> <li>New WQ facility will require annual inspections and maintenance to ensure plant viability and system functionality.</li> <li>Project cost (total): \$454,000.</li> </ul>	N	Staff/consultant	<ul style="list-style-type: none"> <li>One new WQ manhole</li> <li>Annual WQ manhole maintenance (1 hr/MH with biannual frequency)</li> <li>500' WQ swale</li> <li>Inspection four times/year (4 hrs total)</li> <li>Annual swale maintenance (20' /hr)</li> </ul>	Approximately 30 hours of annual maintenance (0.02 FTE)	Construction administration (total): \$34,000 (or 0.23 FTE)
CIP #18 Water Quality Facility Maintenance - Waterford	Maintain existing WQ facility to restore function	<ul style="list-style-type: none"> <li>Engineering and permitting costs estimated at 15% of the construction cost. Assume consultant to complete.</li> <li>Construction administration (City staff) estimated at 10% of the construction cost.</li> <li>Ongoing WQ facility maintenance reflected in programmatic project.</li> <li>Project cost (total): \$180,000.</li> </ul>	Y	Staff/consultant	<ul style="list-style-type: none"> <li>WQ facility maintenance</li> <li>Project to be performed by hired contractor</li> <li>Increased maintenance obligation or frequency to be accounted for in programmatic project.</li> </ul>	N/A	Construction administration (total): \$14,000 (or 0.09 FTE)
CIP #19 Saum Creek Slope Repair	Replace existing outfall and repair hillslope failure	<ul style="list-style-type: none"> <li>Engineering and permitting costs estimated at 35% of the construction cost. Assume consultant to complete.</li> <li>Construction administration (City staff) estimated at 10% of the construction cost.</li> <li>Project cost includes additional geotechnical evaluation.</li> <li>No additional maintenance requirements.</li> <li>Project cost (total): \$171,000.</li> </ul>	Y	Staff/consultant	<ul style="list-style-type: none"> <li>Replace outfall and bank slope repair</li> <li>No increased maintenance obligation or frequency expected.</li> </ul>	N/A	Construction administration (total): \$10,000 (or 0.07 FTE)
CIP #20 Hedges Creek Stream Repair	Bank slope stabilization, infrastructure protection, and vegetation management	<ul style="list-style-type: none"> <li>Project information and costs are included in the "Hedges Creek Stream Assessment, SW Ibach St. to SW 105th Ave.", February 2018, GreenWorks PC and OTAK, INC.</li> <li>Ongoing vegetation management reflected in programmatic project.</li> <li>Project cost (total): \$327,000.</li> </ul>	Y	Staff/consultant	<ul style="list-style-type: none"> <li>Increased maintenance obligation or frequency due to be accounted for in programmatic project</li> </ul>	N/A	No related staffing cost estimate
CIP #21 Nyberg Water Quality Facility	Install regional WQ treatment facility at newly acquired City property	<ul style="list-style-type: none"> <li>Engineering and permitting costs estimated at 35% of the construction cost. Assume consultant to complete.</li> <li>Construction administration (City staff) estimated at 10% of the construction cost.</li> <li>Project cost includes additional estimate for fees and mitigation.</li> <li>Project cost (total): \$2,037,000.</li> </ul>	Y	Staff/consultant	<ul style="list-style-type: none"> <li>WQ facility maintenance</li> <li>Project to be performed by hired contractor</li> <li>Increased maintenance obligation or frequency to be accounted for in programmatic project</li> </ul>	N/A	Construction administration (total): \$123,000 (or 0.82 FTE)
<b>Capital Project Total Staffing Estimate (FTE)</b>						<b>5.5 (total) or 0.6 (annual)<sup>d</sup></b>	
<b>Priority Capital Project Staffing Estimate (FTE)</b>						<b>2.8 (total) or 0.3 (annual)<sup>d</sup></b>	
<b>Annual Program Total (FTE), see Table 8-2</b>						<b>0.4</b>	
<b>Annual TOTAL (FTE), All Projects and Programs</b>						<b>1.0</b>	
<b>Annual TOTAL (FTE), Priority Projects and Programs</b>						<b>0.7</b>	

a. Annual maintenance activities are estimated based on new assets added as part of the capital project scope.

b. Hour estimate for maintenance is based on average time/task provided by city staff and is provided for reference only. For purposes of calculating an equivalent FTE per cost estimate, an annual FTE works 2080 hrs; 0.02 FTE is 40 hrs. Costs are rounded to the 0.01 FTE.

c. Estimated combined resource needs are based directly on the construction administration cost. It reflects staff time (engineering, administration, and operations) to support design, construction and annual maintenance activities. For purposes of calculating an equivalent FTE per cost estimate, an annual FTE salary was assumed at \$150,000/year. Costs are rounded to the 0.01 FTE.

d. Annualized over a 10-year planning period.



## **Appendix I: Clean Water Services Review Comments**





## Appendix I

# Clean Water Services' Review Comments on the Draft Tualatin Stormwater Master Plan

Clean Water Services (CWS) reviewed the April 2019 Draft Stormwater Master Plan for the City of Tualatin. Review comments were received in September 2019 and primarily included comments related to City-identified water quality project opportunity locations (Table 3-1) and the resulting water quality retrofit projects.

Through this review process, CWS identified four additional water quality opportunity locations. Two locations (Location ID 27 and 28 as identified in Table I-1 below) are proposed as alternative locations for CIPs #8 and #9. Two locations are newly identified water quality opportunity locations.


Feedback from CWS did not result in direct changes to proposed CIPs, but these additional water quality opportunity areas can be considered with implementation of the City's new Public Water Quality Facility Retrofit Program. Table I-1 summarizes the CWS-identified water quality opportunity locations.

Figure I-1 below, was provided by CWS. The figure shows proposed water quality opportunity locations compared with City-identified water quality opportunity areas.

This page intentionally left blank.

Table I-1. CWS Additional Stormwater Project Opportunities (with CWS comments)									
SW Project Opportunity Area ID	Location	Basin/Waterbody	Problem/Project Category	Source	WQ Retrofit Opportunity	Problem/Project Area Description	Preliminary Project Concepts and Observations (per site visits)	Additional Data Collection/City Input (following Project Development Workshop)	CWS Comments
27* (alternative to Location 16)	125 <sup>th</sup> to Herman Rd	Cummins Creek	Water Quality (WQ)	Stormwater CIP WQ retrofit evaluation	X	<ul style="list-style-type: none"> <li>Project identified through GIS drainage basin analysis, integrating use of archydro basin delineation and storm flow.</li> <li>Large untreated area has the potential for WQ treatment (~ 150 acres)</li> </ul>	<ul style="list-style-type: none"> <li>Partnership with property owners needed to provide LIDA capable of treating the flows to this location.</li> <li>Installation of WQMH (sumped) will enable periodic sediment removal before natural area.</li> <li>Conveyance pipe/outfall replacement due to low slope.</li> </ul>	Flow splitter and WQMH to meet flow and sizing criteria designated by CWS standards.	Difficult location, so consider Public-Private Partnership (3P) to construct WQ facility during redevelopment.
28* (alternative to Location 15)	SW 95 <sup>th</sup> Ave- SW Tualatin Sherwood Rd	Hedges Creek	WQ Infrastructure need	Stormwater CIP WQ retrofit evaluation	X	<ul style="list-style-type: none"> <li>Project identified through drainage basin analysis, integrating use of archydro basin delineation and storm flow.</li> <li>Potential to treat 304 acres, of which 147 acres are currently untreated.</li> <li>Potential for WQ treatment areas to be identified as upstream areas redevelop.</li> <li>Ideal for WQ/green facility in adjacent open area. Consider constructed wetlands.</li> </ul>	<ul style="list-style-type: none"> <li>Current conveyance is provided through dual 24" culverts that cross SW Tualatin-Sherwood Rd and flow into 36" CSP alongside the major arterial.</li> <li>The goal would be to split flows between the current conveyance (36" CSP) and a constructed facility (low flow), which would then reconnect into the 36" pipe.</li> <li>The project would require coordination with Washington County, City of Tualatin, CWS, and the developer, (as well as additional upstream property owners potentially) to advance WQ treatment opportunities.</li> <li>Needs further evaluation by consultant of upstream partial WQ treatment.</li> </ul>	<ul style="list-style-type: none"> <li>Open conveyance between culverts that cross the road and the 36" pipe can be used to place the flow splitter structure, alleviating need of pipe removal.</li> <li>Facility sizing would be included in scope of project.</li> </ul>	<ul style="list-style-type: none"> <li>Land is owned by Zidell Companies who is looking to develop it for commercial use. Consider Public-Private Partnership (3P) to construct WQ facility during redevelopment.</li> <li>Opportunity for partial treatment of large untreated basin with City partnership with smaller WQF construction as upstream development occurs.</li> <li>WQ project(s) could be coordinated with an expansion of the ROW by Washington County .</li> <li>Reference map Site 29 additional for basin detail.</li> </ul>
29*	SW Teton Ave & SW Herman Rd Intersection	Hedges Creek	WQ	Stormwater CIP WQ retrofit evaluation	X	<ul style="list-style-type: none"> <li>Project identified through drainage basin analysis, integrating use of archydro basin delineation and storm flow.</li> <li>Large untreated area has the potential for WQ treatment (~ 80 acres).</li> </ul>	Needs further evaluation by consultant of upstream partial WQ treatment .	Flow splitter and WQMH to meet flow and sizing criteria designated by CWS standards.	Opportunity for partial treatment of large untreated basin with City partnership with smaller WQF construction as upstream development occurs.
30*	SW Nyberg St/65 <sup>th</sup> Ave	Nyberg St	WQ	Stormwater CIP WQ retrofit evaluation	X	<ul style="list-style-type: none"> <li>Project identified through drainage basin analysis, integrating use of archydro basin delineation and storm flow.</li> <li>Large untreated area has the potential for WQ treatment (xx acres).</li> <li>Expanded constructed wetland complex to provide WQ treatment before discharging into wetlands surrounding Nyberg Creek, south of SW Nyberg St.</li> </ul>	<ul style="list-style-type: none"> <li>Potential for WQ facility near convergence of multiple open conveyance ditches, behind site with large businesses.</li> <li>Expected high level of solids removal and additional treatment area.</li> <li>Needs further evaluation by consultant of upstream partial WQ treatment.</li> </ul>	Facility sizing would be included in scope of project.	<ul style="list-style-type: none"> <li>Land owned by the Nyberg Creek Foundation.</li> <li>Opportunity for partial treatment of large untreated basin with City partnership with smaller WQF construction as upstream development occurs.</li> </ul>

\*Indicates that the SW Project Opportunity Area ID created by CWS as an arbitrary value to continue using the City of Tualatin format.

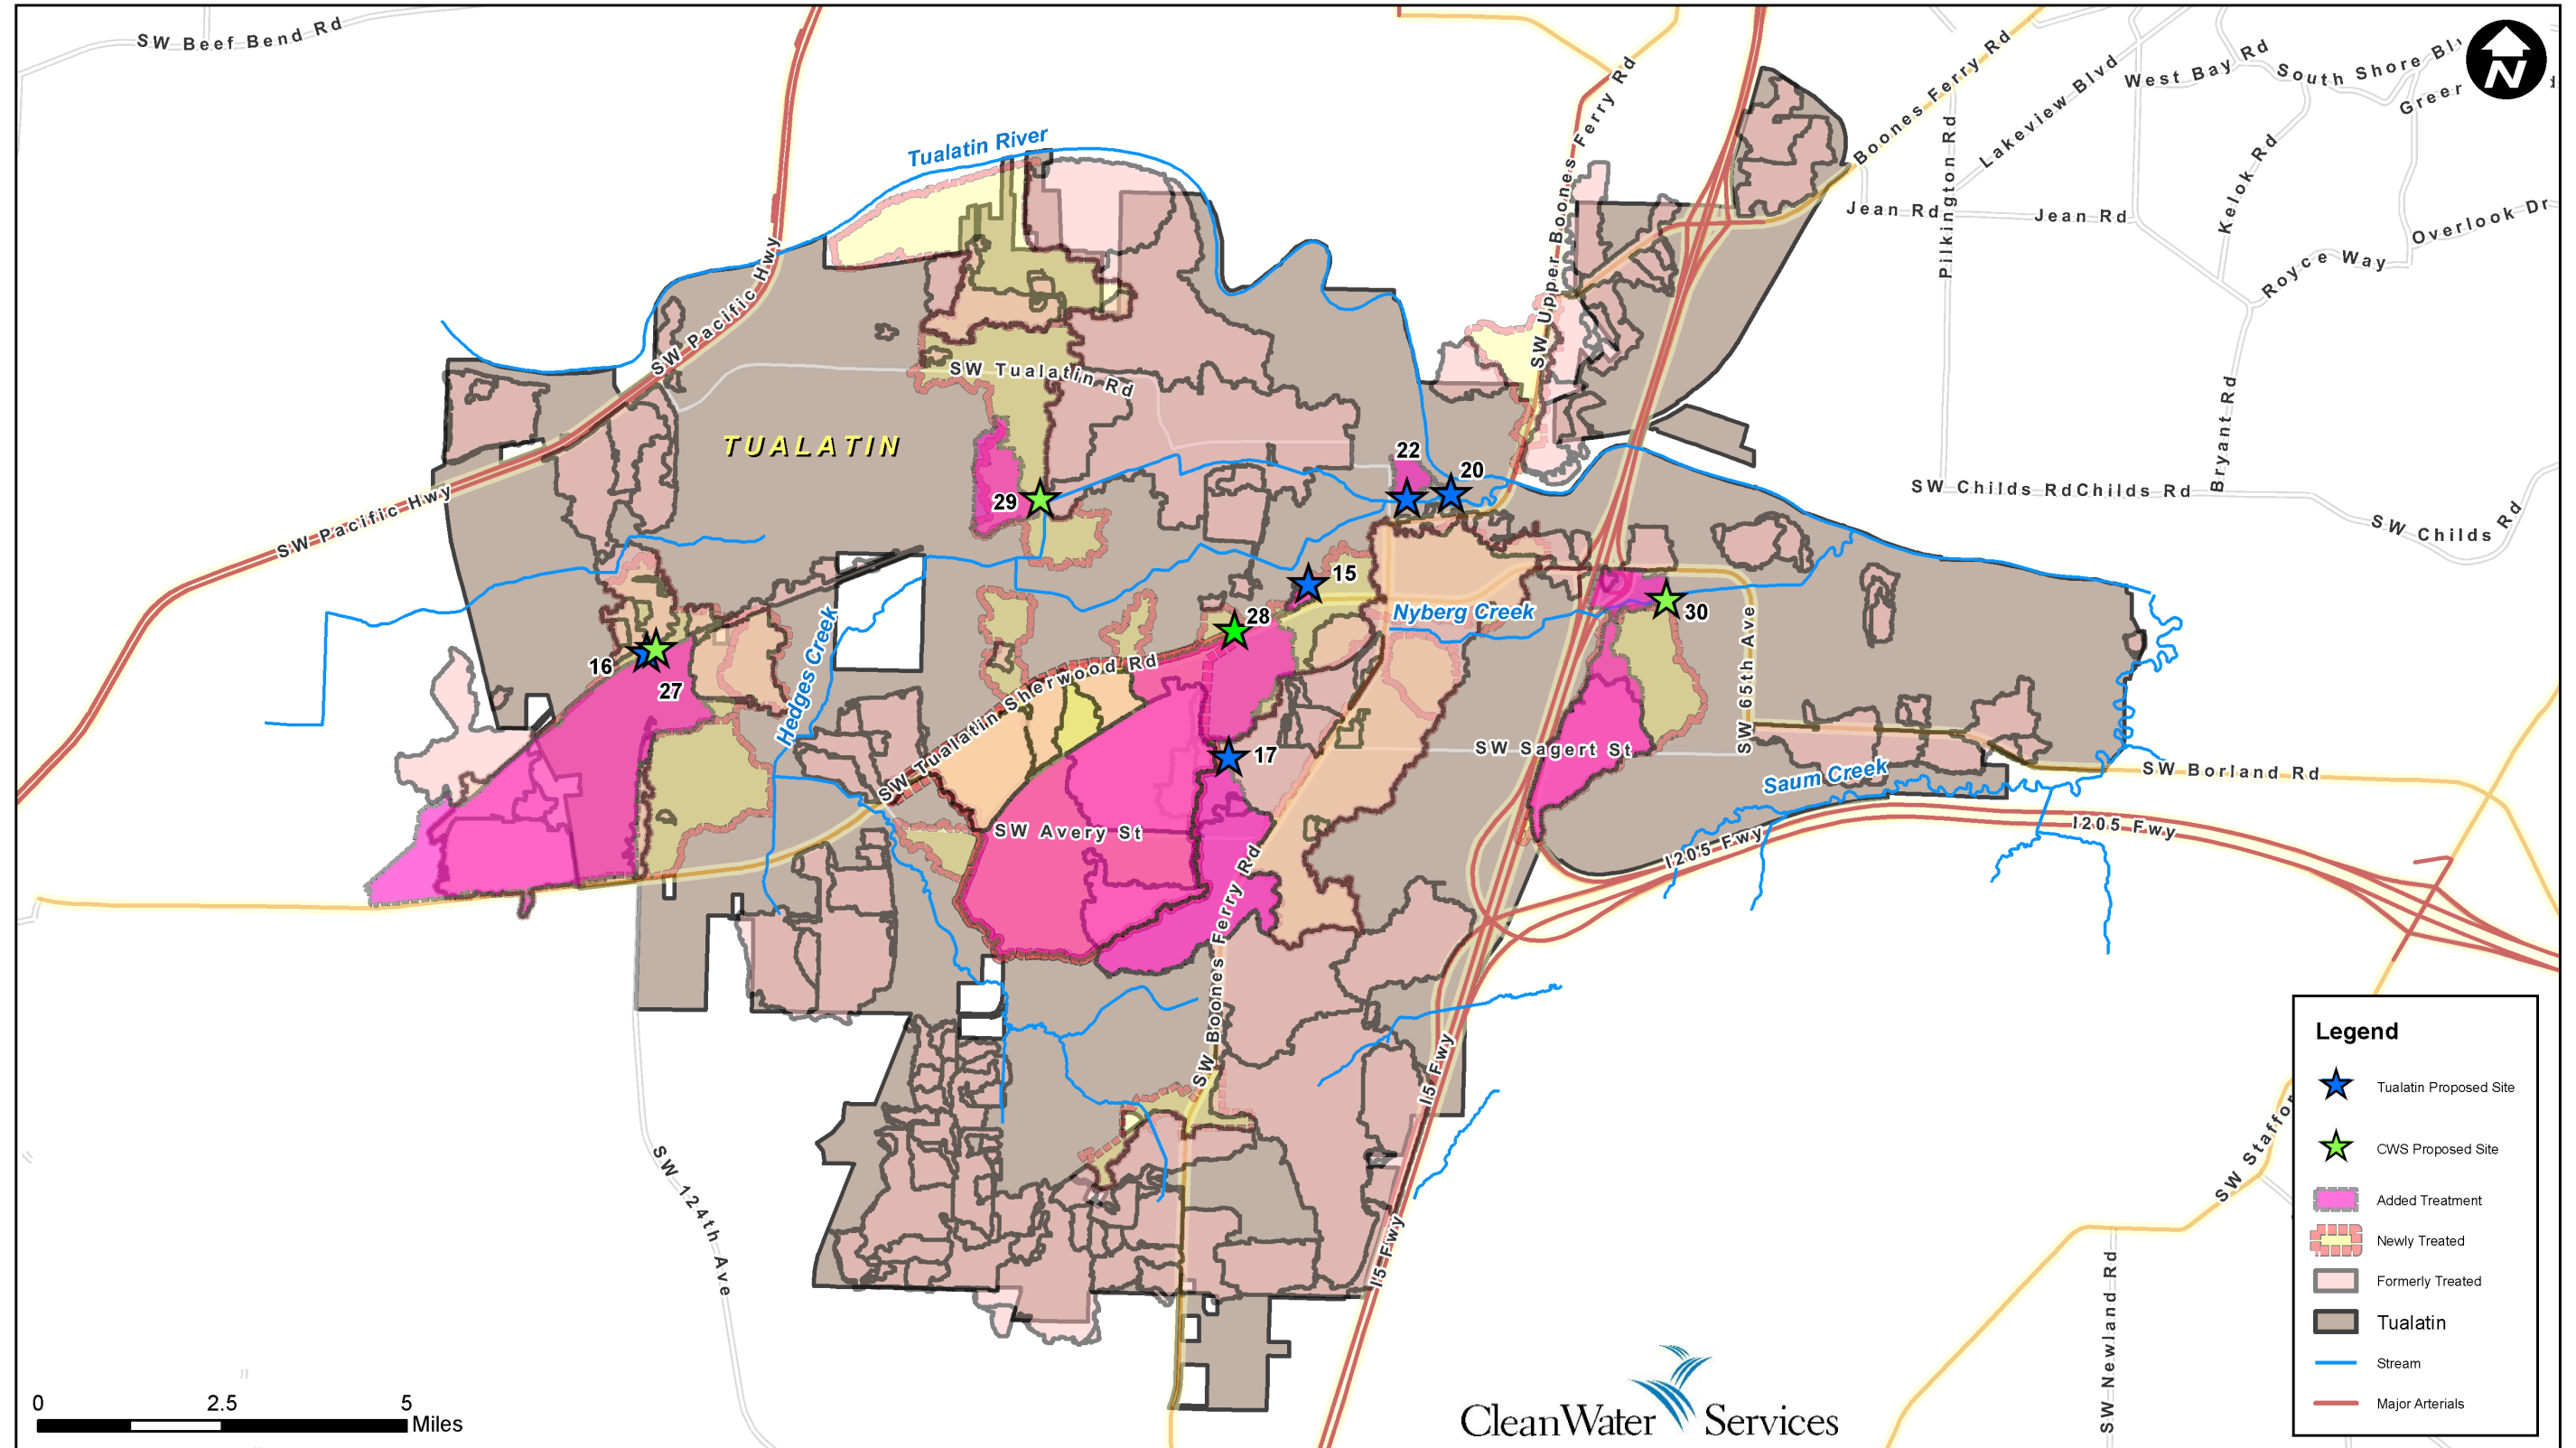

Coordinate System: NAD83 HARN Oregon North | Projection: Lambert Conformal Conic | Source: Clean Water Services | Last Saved By: SahliF on 9/16/2019 at 4:43:15 PM

Figure I-1. Proposed Storm Projects for the Tualatin SMP

Source: Clean Water Services

BCC 19-0557

**Washington County – Tualatin  
Urban Planning Area Agreement**

THIS AGREEMENT is entered into by WASHINGTON COUNTY, a political subdivision in the State of Oregon, hereinafter referred to as the “COUNTY,” and the CITY OF TUALATIN, an incorporated municipality of the State of Oregon, hereinafter referred to as the “CITY.”

WHEREAS, ORS 190.010 provides that units of local government may enter into agreements for the performance of any or all functions and activities that a party to the agreement, its officers or agents, have authority to perform; and

WHEREAS, Statewide Planning Goal #2 (Land Use Planning) requires that City, County, State and Federal agency and special district plans and actions shall be consistent with the comprehensive plans of the cities and counties and regional plans adopted under ORS Chapter 197; and

WHEREAS, the Oregon State Land Conservation and Development Commission (LCDC) requires each jurisdiction requesting acknowledgment of compliance to submit an agreement setting forth the means by which comprehensive planning coordination within the Regional Urban Growth Boundary (UGB) will be implemented; and

WHEREAS, following the Urbanization Forum process, the COUNTY through Resolution & Order 09-63, and the CITY through Resolution 4906-09 agreed that future additions to the UGB during or after 2010 must be governed and urbanized by the CITY in the COUNTY and also agreed to urge Metro to expand the UGB only to such areas as are contiguous to incorporated areas of Washington County; and

WHEREAS, the State legislature with House Bill 4078-A in 2014 and House Bill 2047 in 2015 validated the acknowledged UGB and Urban and Rural Reserves established through the Metro Regional process involving both the COUNTY and the CITY; and

WHEREAS, the Basalt Creek and West Railroad Planning Areas, generally located between the CITY and Wilsonville, were added to the UGB by the Metro Council in 2004, through Ord. No. 04-1040B; and

WHEREAS, Metro Ord. No. 04-1040B included a condition that the Basalt Creek and West Railroad Planning Areas undergo Title 11 concept planning, as defined in Metro Code Chapter 3.07 of the Urban Growth Management Functional Plan (UGMFP); and

WHEREAS, the COUNTY, the CITY, Wilsonville and Metro entered into an Intergovernmental Agreement (2011 IGA) (Contract No. BCC 11-0470) to consider the Basalt Creek and the West Railroad Areas in a single concept planning effort and refer to the two areas generally as the Basalt Creek Planning Area, a distinct subarea; and

WHEREAS, the CITY, COUNTY, Wilsonville and Metro entered into the First Addendum to the 2011 IGA, acknowledging the Basalt Creek Transportation Refinement Plan (BCC 13-0724), a collaborative transportation planning effort that identified the major transportation projects for the Basalt Creek Planning Area; and

WHEREAS, the CITY, Wilsonville and Metro, agreed to extend the 2011 IGA through Addendum No. 2.0 (BCC No. 16-1110) until the cities and COUNTY amend their respective UPAA's and incorporate the Basalt Creek Concept Plan into each city's respective comprehensive plans or until September 28, 2019; and

WHEREAS, the CITY through Resolution 5392-18 and Wilsonville through Resolution 2697 adopted the Basalt Creek Concept Plan, which included the necessary transportation and land use planning for the area as well as an agreement on the boundary between Tualatin and Wilsonville; and

WHEREAS, the COUNTY, CITY, Wilsonville and Metro through the Basalt Creek Area planning process, recognized that major multimodal transportation investments have been identified that require significant multijurisdictional coordination and agreed to seek additional funding for the transportation infrastructure in the Basalt Creek Planning Area as needed; and

WHEREAS, the COUNTY and the CITY desire to amend the Urban Planning Area Agreement (UPAA) to reflect the changes to the UGB, the CITY's Urban Planning Area, and the need for urban planning of the new Urban Reserve lands; and

WHEREAS, the COUNTY and the CITY, to ensure coordinated and consistent comprehensive plans, consider it mutually advantageous to establish:

1. An Urban Planning Area Agreement incorporating a site-specific Urban Planning Area within the UGB where both the COUNTY and the CITY maintain an interest in comprehensive planning, and an Urban Reserve Planning Area outside the UGB where both the COUNTY and the CITY maintain an interest in concept planning;
2. A process for coordinating comprehensive planning and development in the Urban Planning Area and concept planning in the Urban Reserve Planning Area;
3. Special policies regarding comprehensive planning and development in the Urban Planning Area, and concept planning in the Urban Reserve Planning Area; and
4. A process to amend the Urban Planning Area Agreement.

NOW THEREFORE, THE COUNTY AND THE CITY AGREE AS FOLLOWS:

I. Location of the Urban Planning Area and Urban Reserve Planning Area

The Urban Planning Area and Urban Reserve Planning Area mutually defined by the COUNTY and the CITY include the areas designated on the Washington County-Tualatin UPAA “Exhibit A” to this agreement.

II. Coordination of Comprehensive Planning and Development

A. Amendments to or Adoption of a Comprehensive Plan or Implementing Regulation.

1. Definitions

Comprehensive Plan means a generalized, coordinated land use map and policy statement of the governing body of a local government that interrelates all functional and natural systems and activities relating to the use of lands, including, but not limited to, sewer and water systems, transportation systems, educational facilities, recreational facilities, and natural resources and air and water quality management programs. “Comprehensive Plan” amendments do not include small tract comprehensive plan map changes.

Implementing Regulation means any local government zoning ordinance adopted under ORS 197, 215 or 227, a land division ordinance adopted under ORS 92.044 or 92.046 or similar general ordinance establishing standards for implementing a comprehensive plan.

2. The COUNTY shall provide the CITY with the opportunity to participate, review and comment on proposed amendments to or adoption of the COUNTY comprehensive plan or implementing regulations. The CITY shall provide the COUNTY with the opportunity to participate, review and comment on proposed amendments to or adoption of the CITY comprehensive plan or implementing regulations. The following procedures shall be followed by the COUNTY and the CITY to notify and involve one another in the process to amend or adopt a comprehensive plan or implementing regulation:

- a. The CITY or the COUNTY, whichever has jurisdiction over the proposal, hereinafter the originating agency, shall notify the other agency, hereinafter the responding agency, of the proposed action at the time such planning efforts are initiated, but in no case less than 35 calendar days prior to the first hearing on adoption.

For COUNTY or CITY comprehensive plan updates with the potential to affect the responding agency's land use or transportation system, the originating agency shall provide the responding agency with the opportunity to participate in the originating agency's advisory committee, if any.

- b. For COUNTY or CITY comprehensive plan updates with the potential to affect the responding agency's land use or transportation system, the originating agency shall transmit the draft amendments by first class mail or as an attachment to electronic mail to the responding agency for its review and comment at least 10 calendar days before finalizing. The responding agency shall have 10 calendar days after receipt of a draft to submit comments orally or in writing. Lack of response shall be considered "no objection" to the draft.
- c. The originating agency shall respond to the comments made by the responding agency either by a) revising the final draft amendment recommendation(s), or b) a statement on the record explaining why the comments cannot be addressed in the final draft.
- d. Comments from the responding agency shall be given consideration and included as part of the public record on the proposed action. If after such consideration, the originating agency acts contrary to the position of the responding agency, the responding agency may seek appeal of the action through the appropriate appeals body and procedures.
- e. Upon final adoption of the proposed action by the originating agency, it shall transmit the adopting ordinance to the responding agency as soon as publicly available, or if not adopted by ordinance, whatever other written documentation is available to properly inform the responding agency of the final actions taken.

B. Development Actions Requiring Individual Notice to Property Owners

1. Definition

Development Action Requiring Notice means an action by the COUNTY or the CITY which requires notifying by mail the owners of property which could potentially be affected (usually specified as a distance measured in feet) by a proposed development action which directly affects and is applied to a specific parcel or parcels. Such development actions may include, but not be limited to, small tract zoning or comprehensive



plan amendments, conditional or special use permits, land divisions, planned unit developments, variances, and other similar actions requiring a quasi-judicial hearings process.

2. The COUNTY will provide the CITY with the opportunity to review and comment on proposed development actions requiring notice within the designated Urban Planning Area and/or Urban Reserve Planning Area. The CITY will provide the COUNTY with the opportunity to review and comment on proposed development actions requiring notice within the CITY limits that may have an effect on unincorporated portions of the designated Urban Planning Area or the COUNTY's transportation network.
3. The following procedures shall be followed by the COUNTY and the CITY to notify one another of proposed development actions:
  - a. The originating agency with jurisdiction over the proposal, shall send by first class mail or as an attachment to electronic mail a copy of the public hearing notice which identifies the proposed development action to the responding agency, at the earliest opportunity, but no less than 14 calendar days prior to the date of the first scheduled public hearing or end of the comment period, whichever occurs first. The failure of the responding agency to receive a notice shall not invalidate an action if a good faith attempt was made by the originating agency to notify the responding agency.
  - b. The responding agency receiving the notice may respond at its discretion. Comments may be submitted in written or electronic form or an oral response may be made at the public hearing. Lack of written or oral response shall be considered "no objection" to the proposal.
  - c. If received in a timely manner, the originating agency shall include or attach the comments to the written staff report and respond to any concerns addressed by the responding agency in such report or orally at the hearing.
  - d. Comments from the responding agency shall be given consideration and included as a part of the public record on the proposed action. If, after such consideration, the originating agency acts contrary to the position of the responding agency, the responding agency may seek appeal of the action through the appropriate appeals body and procedures.

C. Additional Coordination Requirements

- I. The CITY and the COUNTY shall do the following to notify one another of proposed actions with the potential to affect the responding agency's land use or transportation system, but are not subject to the notification and participation requirements contained in subsections A. and B. above.
  - a. The originating agency with jurisdiction over the proposed actions shall send by first class mail or as an attachment to electronic mail a copy of all public hearings agendas which contain the proposed actions to the responding agency, at the earliest opportunity, but no less than three calendar days prior to the date of the scheduled public hearing. The failure of the responding agency to receive an agenda shall not invalidate an action if a good faith attempt was made by the originating agency to notify the responding agency.
  - b. The responding agency receiving the public hearing agenda may respond at its discretion. Comments may be submitted in written or electronic form or an oral response may be made at the public hearing. Lack of written or oral response shall be considered "no objection" to the proposal.
  - c. Comments from the responding agency shall be given consideration as a part of the public record on the proposed action. If, after such consideration, the originating agency acts contrary to the position of the responding agency, the responding agency may seek appeal of the action through the appropriate appeals body and procedures.

III. Concept Planning for Urban Reserve Areas

A. Definitions

- I. Urban Reserve means those lands outside the UGB that have been so designated by Metro for the purpose of:
  - a. Future expansion of the UGB over a long-term period (40-50 years), and
  - b. The cost-effective provision of public facilities and services when the lands are included within the UGB.

2. Urban Reserve Planning Area (URPA) means those Urban Reserves identified for annexation and urbanization by the CITY at such time as the UGB is amended to include the Urban Reserve Area.
  3. Urban Reserve Planning Area - Planning Responsibility Undefined means those Urban Reserves that the CITY and at least one other city may have an interest in ultimately governing, but no final agreement has been reached. These areas are not considered part of the URPA for the purpose of this agreement.
- B. The CITY's Urban Reserve Planning Area and Urban Reserve Planning Area – Planning Responsibility Undefined are identified on “Exhibit A” to this Agreement.
- C. The CITY shall be responsible for developing a concept plan in consultation with the COUNTY for the URPA in coordination with Metro and appropriate service districts. The concept plan shall include the following:
1. An agreement between the COUNTY and the CITY regarding expectations for road funding, jurisdictional transfer over roadways to and from the CITY and COUNTY, and access management for County roads in the URPA. The agreement should describe any changes to the CITY and/or COUNTY transportation system plans, other comprehensive plan documents, or codes that have been adopted or will be necessary to implement this agreement.
  2. An agreement between the COUNTY and the CITY that preliminarily identifies the likely provider of urban services, as defined in ORS 195.065 (4), when the area is urbanized.
- D. The concept plan shall be approved by the CITY and acknowledged by the COUNTY.
- E. Upon completion and acknowledgement of the concept plan by the CITY and the COUNTY, and the addition of the area into the UGB by Metro, the affected portion of the URPA shall be designated as part of Urban Planning Area, as described below. Inclusion in the Urban Planning Area is automatic and does not require an amendment to this Agreement.
- F. Once an URPA has been added to the UGB and prior to annexation into the CITY, the COUNTY will apply the Future Development 20-Acre (FD-20) land use designation to the land.

IV. Comprehensive Planning and Development Policies for Urban Planning Areas

A. Definition

Urban Planning Area means the incorporated area and certain unincorporated areas contiguous to the incorporated area for which the CITY conducts comprehensive planning and seeks to regulate development activities to the greatest extent possible. The CITY Urban Planning Area is designated on “Exhibit A.”

- B. The CITY shall be responsible for comprehensive planning within the Urban Planning Area.
- C. The CITY shall be responsible for the preparation, adoption and amendment of the public facility plan required by OAR 660-011 within the CITY’s Urban Planning Area in coordination with other service providers that provide urban services within this area.
- D. As required by OAR 660-011-0010, the CITY is identified as the appropriate provider of local water, sanitary sewer, storm sewer and transportation facilities within the Urban Planning Area. Exceptions include facilities provided by other service providers subject to the terms of any intergovernmental agreement the CITY may have with other service providers; facilities under the jurisdiction of other service providers not covered by an intergovernmental agreement; and future facilities that are more appropriately provided by an agency other than the CITY.
- E. The COUNTY shall not approve land divisions within the unincorporated Urban Planning Area that are inconsistent with the provisions of the Future Development 10-Acre District (FD-10) or the Future Development 20-Acre District (FD-20), as applicable.
- F. The COUNTY shall not approve a development proposal in the Urban Planning Area if the proposal would not provide for, nor be conditioned to provide for, an enforceable plan for redevelopment to urban densities consistent with the CITY’s Comprehensive Plan in the future upon annexation to the CITY as indicated by the CITY Comprehensive Plan.
- G. The COUNTY shall not oppose annexations to the CITY within the CITY’s Urban Planning Area.
- H. The Tualatin Comprehensive Plan employs a one-map system wherein the Comprehensive Plan Map fulfills a dual role by serving as both the Plan Map and Zone Map, thus eliminating the need for a separate Zone Map. The CITY’s

Comprehensive Plan Map establishes future land use designations for unincorporated portions of the Urban Planning Area. Upon annexation of any property within the Urban Planning Area to the CITY, the Planning District or zone specified by the Tualatin Comprehensive Plan Map is automatically applied to the property on the effective date of the annexation (as authorized by ORS 215.130 (2) a).

If a property owner, contract purchaser, the authorized representative of a property owner or contract purchaser, or the CITY desire a Planning District or zone different from that shown on the Tualatin Comprehensive Plan Map, an application for a Plan Map Amendment may be filed with the CITY at the time of or following annexation.

- I. The CITY and the COUNTY will implement the applicable Urban Reserve concept plans and related agreements. The CITY will amend the CITY Comprehensive Plan to include this area consistent with the original concept plan. If modifications to the original concept plan are made during the comprehensive planning process, the parties will update the related agreements to reflect these changes, which may include transportation, access and funding, if needed. Until the CITY amends its Transportation System Plan (TSP) to include the land within the CITY's Urban Planning Area, the COUNTY's TSP will serve as the TSP for the Urban Planning Area.

V. Special Policies

- A. The CITY shall specify in its Comprehensive Plan that access to SW 124th Avenue and Basalt Creek Parkway shall be limited to the following locations: SW Tualatin-Sherwood Road, SW Tonquin Road, SW Grahams Ferry Road, SW Boones Ferry Road and one other location within the CITY portion of the Basalt Creek Planning Area.
- B. The CITY agrees to incorporate the planned local street network identified in the Basalt Creek Refinement Plan into the CITY's TSP and include all transportation projects on the COUNTY's Transportation Development Tax (TDT) Road Project List to be eligible for TDT funding.
- C. The CITY agrees to work with the COUNTY and other partners to secure funding for construction of Basalt Creek Parkway from SW Grahams Ferry to SW Boones Ferry Road and other transportation improvements identified on the Basalt Creek Transportation Refinement Plan to support development in the Basalt Creek Planning Area.

- D. Where the CITY Urban Planning Area boundary on “Exhibit A” is shown as SW 124th Avenue, SW Basalt Creek Parkway, SW Tonquin Rd. and/or SW Waldo Way, the boundary shall extend to the centerline of each road.

VI. Amendments to the Urban Planning Area Agreement

- A. The following procedures shall be followed by the CITY and the COUNTY to amend the language of this agreement or the Urban Planning Area Boundary:
1. The CITY or the COUNTY, whichever jurisdiction originates the proposal, shall submit a formal request for amendment to the responding agency.
  2. The formal request shall contain the following:
    - a. A statement describing the amendment.
    - b. A statement of findings indicating why the proposed amendment is necessary.
    - c. If the request is to amend the planning area boundary, a map that clearly indicates the proposed change and surrounding area.
  3. Upon receipt of a request for amendment from the originating agency, the responding agency shall schedule a review of the request before the appropriate reviewing body, with said review to be held within 45 calendar days of the date the request is received.
  4. The CITY and the COUNTY shall make good faith efforts to resolve requests to amend this agreement. Upon completion of the review, the reviewing body may approve the request, deny the request, or make a determination that the proposed amendment warrants additional review. If it is determined that additional review is necessary, the following procedures shall be followed by the CITY and the COUNTY:
    - a. If inconsistencies noted by both parties cannot be resolved in the review process as outlined in Section VI. A. 3, the CITY and the COUNTY may agree to initiate a joint study. Such a study shall commence within 30 calendar days of the date it is determined that a proposed amendment creates an inconsistency, and shall be completed within 90 calendar days of said date. Methodologies and procedures regulating the conduct of the joint study shall be mutually agreed upon by the CITY and the COUNTY prior to commencing the study.

- b. Upon completion of the joint study, the study and the recommendations drawn from it shall be included within the record of the review. The agency considering the proposed amendment shall give careful consideration to the study prior to making a final decision.
  - B. The parties may individually or jointly initiate review of this Agreement to evaluate the effectiveness of the processes set forth herein and determine if conditions warrant any amendments. Both parties shall make a good faith effort to resolve any inconsistencies that may have developed since the previous review. If, inconsistencies still remain at the conclusion of the review period, either party may terminate this Agreement.
- VII. This Agreement shall become effective upon full execution by the CITY and the COUNTY and shall then repeal and replace the Washington County – Tualatin Urban Planning Area Agreement effective December 23, 2009. The effective date of this Agreement shall be the last date of signature on the signature page.


IN WITNESS WHEREOF the parties have executed this Urban Planning Area Agreement on the date set opposite their signatures.

CITY OF TUALATIN

By   
City Manager

Date 5/20/19

Approved as to Form:

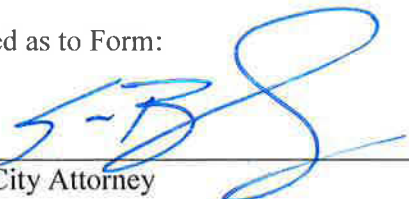By   
City Attorney

Date 5/20/2019

WASHINGTON COUNTY

By  Kathryn Harrington  
Chair, Board of Commissioners

Date 06/06/19

Approved as to Form:

By   
County Counsel

Date 6/4/19

By \_\_\_\_\_  
Recording Secretary

Date \_\_\_\_\_


APPROVED WASHINGTON COUNTY  
BOARD OF COMMISSIONERS

~~MINUTE ORDER #~~ RO 19-31

DATE 4-16-19


BY Barbara Hejtmanek  
CLERK OF THE BOARD



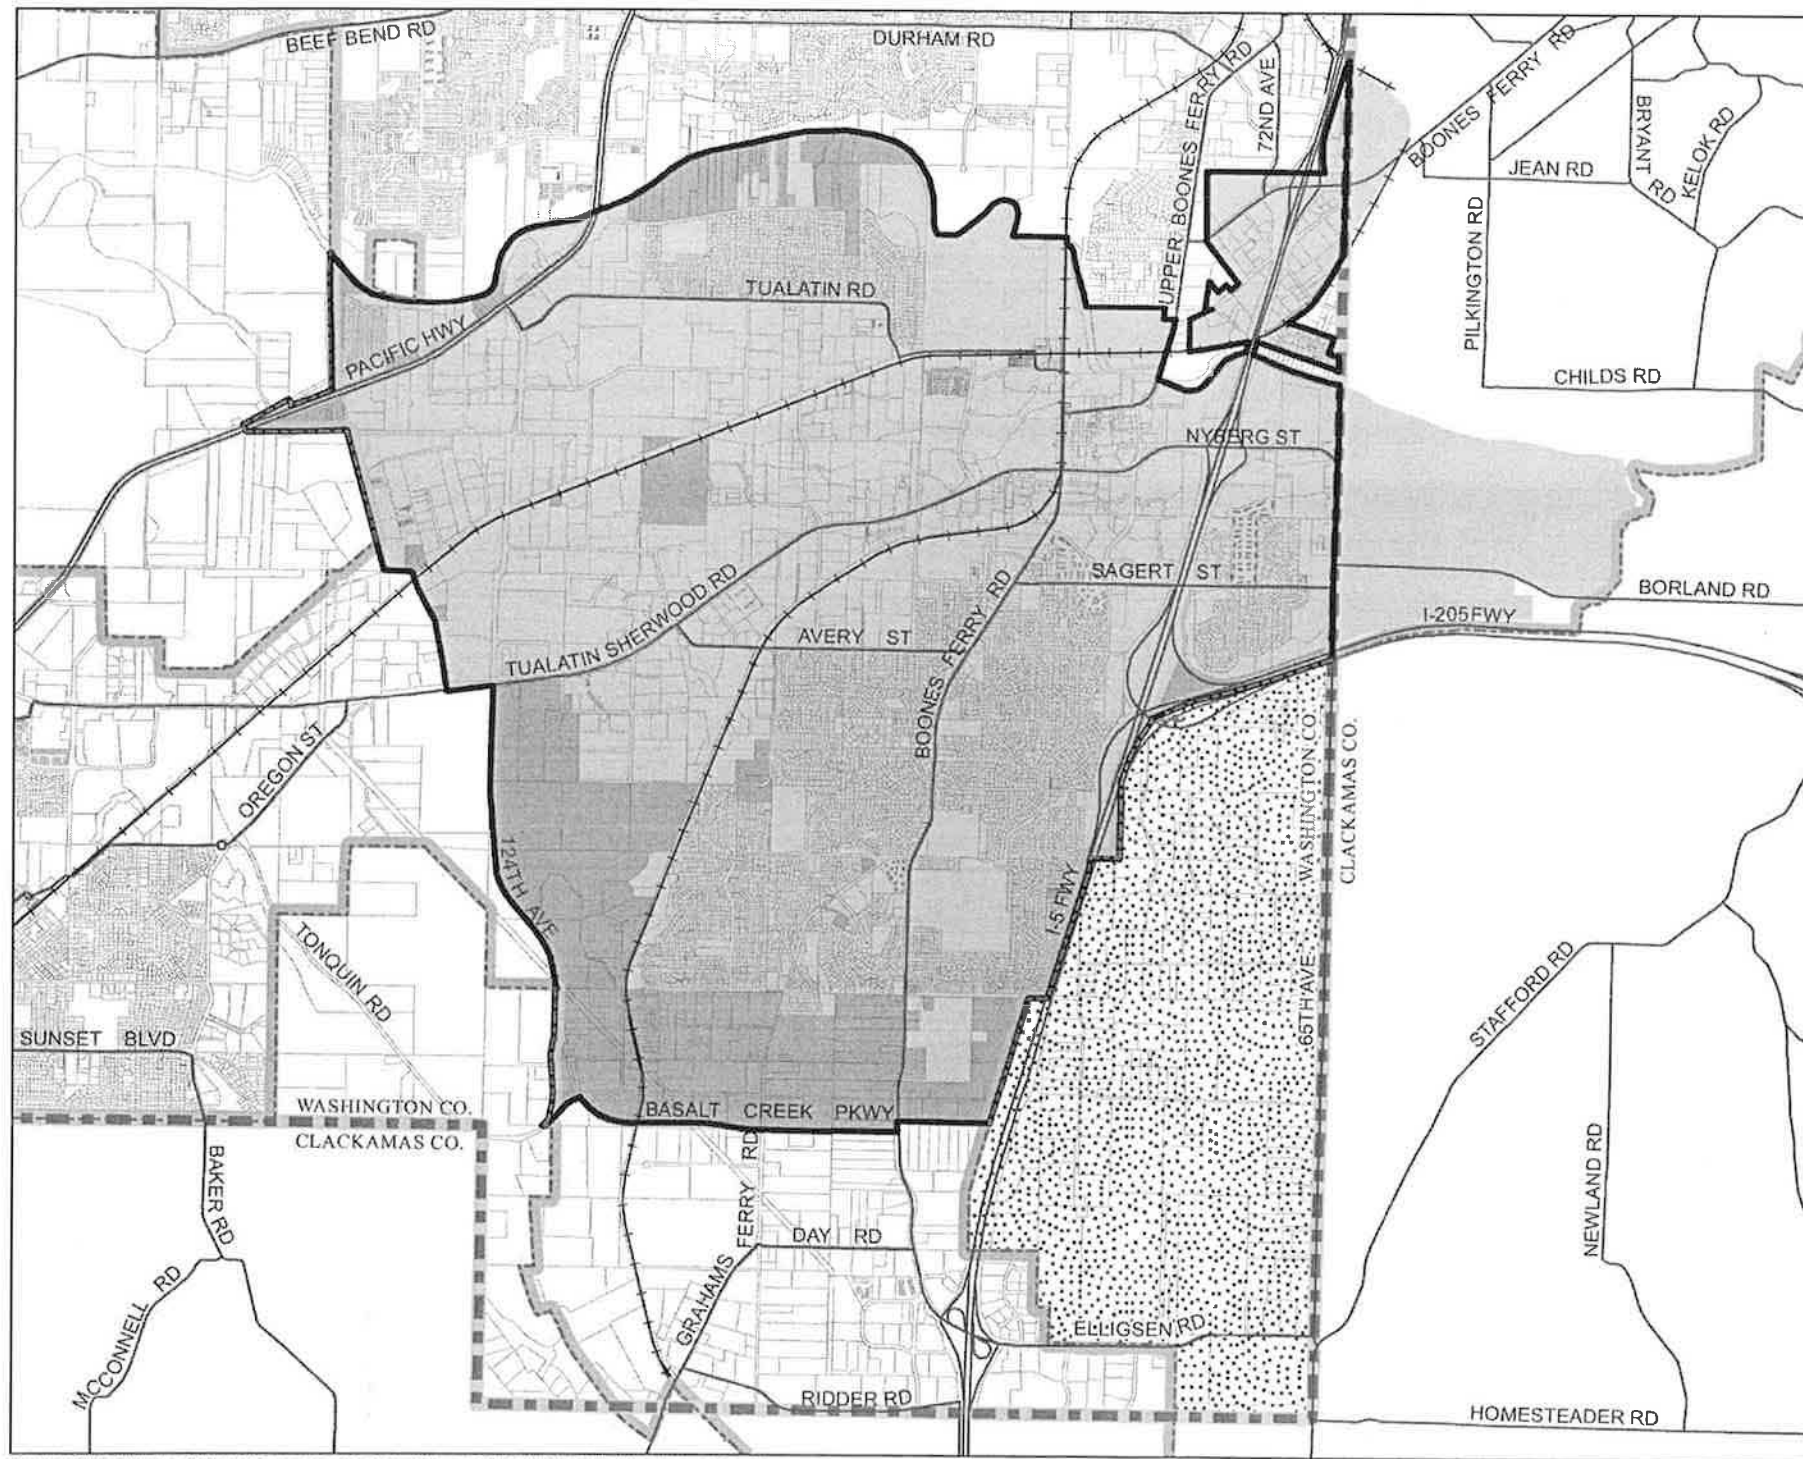

\\img\g\ax\GIS\DATA\Workgroups\GIS\Planning\Community\_Planning\_Projects\UPAAs\_and\_RAs\Tualatin\2018\Tualatin\_UPAA\_Ph00Resp\_11x17.mxd

City of Tualatin  
 Urban Planning Area  
 Washington County - Tualatin  
 Urban Planning Area Agreement  
 Exhibit A

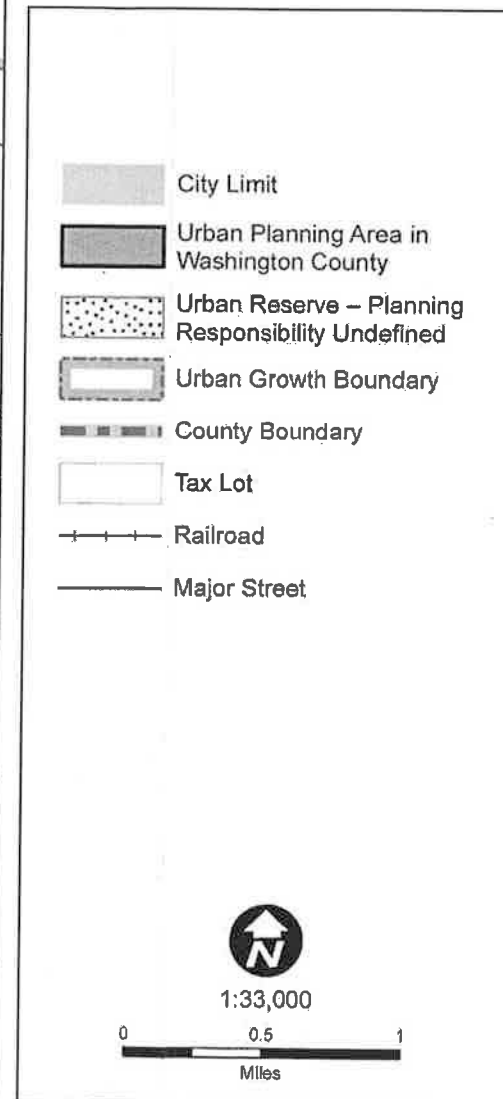

Date: 02/08/2019



# CITY OF TUALATIN

PO BOX 369  
TUALATIN, OREGON 97062-0369  
(503) 692-2000

October 12, 1992

City Council  
City of Tualatin

## CITY OF TUALATIN-CLACKAMAS COUNTY URBAN GROWTH MANAGEMENT AGREEMENT 1992

Attached is a proposed Urban Growth Management Agreement between Clackamas County and City of Tualatin.

### REASONS FOR THE AGREEMENT

The proposed agreement furthers coordination in land use planning between the County and City, as required by Statewide Planning Goal 2. It ensures that development actions or public service extensions that conflict with Tualatin's Comprehensive Plan will not be allowed in unincorporated areas inside the UGB.

The proposed Agreement recognizes the City's authority for public facilities planning within the UGB and provides for coordination with the County, in accordance with Oregon Administrative Rule 660-11-015.

The proposed Agreement provides for the City's planning district designation to apply to an annexed area automatically on the effective date of the annexation. This will eliminate the need for a plan map amendment to accompany each annexation in Clackamas County.

### RECOMMENDATION

Staff recommends that Council adopt the attached resolution authorizing the Mayor and City Recorder to execute the attached Urban Growth Management Agreement.

Submitted by:

Lee D. Leighton  
Associate Planner

Approved By Tualatin City Council

Date 10/12/92

Recording Secretary J.E.

f: Comp Plan/Clackamas County UGMA

RESOLUTION NO. 2766-92

ADOPTING CITY OF TUALATIN - CLACKAMAS COUNTY  
URBAN GROWTH MANAGEMENT AGREEMENT 1992

WHEREAS, the CITY and the COUNTY have a mutual interest in coordinated comprehensive plans, compatible land uses and coordinated planning of urban facilities; and

WHEREAS, OAR 660-03-010 requires management of unincorporated areas within an urban growth boundary to be set forth in a statement submitted to the Land Conservation and Development Commission (LDCD) at the time of acknowledgement request; and

WHEREAS, OAR 660-11-015 requires the responsibility for the preparation, adoption and amendment of the public facility plan to be specified within the urban growth management agreement; and

WHEREAS, Statewide Planning Goal 2 requires coordination between CITY and COUNTY in comprehensive planning; and

BE IT RESOLVED BY THE CITY COUNCIL OF THE CITY OF TUALATIN:

Section 1. The Urban Growth Management Agreement (UGMA) as shown in Exhibit A attached to this resolution is hereby adopted.

Section 2. The Mayor of the City of Tualatin is hereby authorized to sign and date the UGMA in Exhibit A.

Section 3. After signing by the Mayor, the Planning Director shall forward the UGMA to Clackamas County for signing by the Chair and designated members of the Clackamas County Board of Commissioners.

INTRODUCED AND ADOPTED THIS 12th day of October, 1992.

CITY OF TUALATIN, OREGON

BY   
Mayor

ATTEST:

BY   
City Recorder

CITY OF TUALATIN - CLACKAMAS COUNTY  
URBAN GROWTH MANAGEMENT AGREEMENT 1992

WHEREAS, the CITY and the COUNTY have a mutual interest in coordinated comprehensive plans, compatible land uses and coordinated planning of urban facilities; and

WHEREAS, the CITY and the COUNTY will make a good faith effort to reconcile any differences that may emerge from the above mutual interests; and

WHEREAS, information exchanges should concentrate on issues that may have a significant impact on either party and should not entail cumbersome procedural requirements that may increase the time necessary to expedite decision making; and

WHEREAS, OAR 660-03-010 requires management of unincorporated areas within an urban growth boundary to be set forth in a statement submitted to the Land Conservation and Development Commission (LDCD) at the time of acknowledgement request; and

WHEREAS, OAR 660-11-015 requires the responsibility for the preparation, adoption and amendment of the public facility plan to be specified within the urban growth management agreement; and

WHEREAS, Statewide Planning Goal 2 requires coordination between CITY and COUNTY in comprehensive planning; and

WHEREAS, the Tualatin Comprehensive Plan and Development Code employs a one-map system wherein the Plan Map fulfills a dual role acting as the Plan Map and the Zone Map, thus there is a no separate Zone Map.

NOW, THEREFORE, THE CITY AND COUNTY AGREE AS FOLLOWS:

1. Boundary

- A. The Urban Growth Management Boundary (UGMB) shall include unincorporated land within the Urban Growth Boundary (UGB) as shown on map Attachment "A" to this agreement. Any amendments to the Metro UGB, shown on map Attachment "A" will automatically be reflected in the UGMB.

2. Comprehensive Planning, Plan Amendments and Public Facilities Planning

- A. The development of a comprehensive plan and comprehensive plan changes for the area within the UGMB shall be a coordinated CITY-COUNTY planning effort.

CITY shall be responsible for preparing all legislative comprehensive plan amendments in the UGMB. COUNTY shall adopt CITY land use plan designations for all unincorporated lands within the UGMB. COUNTY shall adopt no comprehensive plan amendments for lands within the UGMB, except those which may be needed for consistency with comprehensive plan amendments adopted by CITY.

*City do Pub.  
Facil. Plan*

- B. CITY shall be responsible for the preparation, adoption, and amendment of the public facility plan within the UGMB required by OAR Chapter 660, Division 11, Public Facilities Planning. Preparation and amendment of such public facility plan shall provide for coordination with and participation by COUNTY. No County service or other special districts exist within the UGMB.

3. Development Proposals in UGMB

*County zoning*

- A. COUNTY's zoning shall apply to all unincorporated lands within the UGMB. COUNTY shall zone all unincorporated lands within the UGMB as Future Urbanizable (FU-10). Subject to the terms of this Agreement, COUNTY shall retain responsibility and authority for all implementing regulations and land use actions on all unincorporated lands within the UGMB.

*County issue  
no serv  
permits.*

- B. The provision of public facilities and services shall be consistent with the adopted public facility plan for the unincorporated UGMB. Within the UGMB, COUNTY shall issue no permits or otherwise authorize extension or connection of public facilities and services in violation of the FU-10 zone.

*No new  
serv. dists.*

- C. COUNTY shall not form any new County service districts or support the annexation of land within the unincorporated UGMB to such districts or to other service districts unless agreed to by CITY.

4. City and County Notice and Coordination

- A. The COUNTY shall provide notification to the CITY at least 35 days prior to the first scheduled public hearing open all quasi-judicial actions, proposed legislative changes to the COUNTY comprehensive plan or its implementing ordinances affecting land within the UGMB.

- B. The COUNTY shall provide notification to the CITY at least 15 days prior to staff decision on applications for administrative actions as provided for in the COUNTY's Zoning and Development Ordinance for applications within the UGMB.
- C. The COUNTY shall notify and invite CITY staff to participate in pre-application meetings on significant development proposals, planned unit developments, mobile home parks, or Design Review Committee meetings on development proposals within unincorporated areas of the UGMB. These meetings shall be set by the COUNTY after consultation with CITY staff. If CITY chooses to attend pre-application meeting, the meeting shall occur at a mutually agreeable time. In the event that a mutually agreeable time cannot be achieved, or in the event CITY informs COUNTY that it does not wish to attend a pre-application meeting, such meeting shall occur at COUNTY's convenience within 30 days from the date the CITY is contacted.
- D. The CITY shall provide notification to the COUNTY at least 20 days prior to the first public hearing held by CITY on all proposed annexations, public facilities plans or amendments, or extra-territorial service extensions into unincorporated areas. In the case of a CITY initiated annexation or extra-territorial service application to the Portland Metropolitan Area Local Government Boundary Commission (PMALGBC), the CITY shall notify the COUNTY and provide an opportunity to comment prior to submitting the application. In the case of a private party annexation or extra-territorial service application to the PMALGBC, notice to the COUNTY shall be in accordance with PMALGBC procedures.
- E. The CITY shall provide notification to the COUNTY at least 20 days prior to the first public hearing on all proposed legislative changes to the CITY comprehensive plan or quasi-judicial actions adjacent to unincorporated areas.
- F. Any amendments proposed by the COUNTY or CITY to the UGB as shown on Attachment "A" shall be reviewed by CITY and COUNTY prior to submission to METRO. If and when CITY and COUNTY find it necessary to undertake a change of the UGB, the parties shall follow the procedures and requirements set forth in State statutes and Oregon administrative rules.

- G. The COUNTY shall enter all written comments of the CITY into the public record and shall consider the same in the exercise of its planning and plan implementation responsibilities. The CITY shall enter all written comments of the COUNTY into the public record and shall consider the same in its exercise of its planning and plan implementation responsibilities.

5. City Annexations

- A. The CITY and the COUNTY recognize the final annexation decision making authority of the PMALGBC as set forth in applicable State law.

*City Plan  
desig. auto.  
applies.*

- B. Due to the CITY's one-map Comprehensive Plan System, the CITY Planning District already applying to an unincorporated property is automatically redesignated and effective upon the effective date of the annexation. The Tualatin Development Code, Section 1.080(6), sets forth the automatic affirmation of existing Planning Districts upon annexation. This automatic redesignation complies with ORS 215.130(2)(a). If a property owner, developer, or the CITY desire a Planning District designation other than that already applying to the property, an application for a Plan Map Amendment may be requested at the time of or following annexation.

*City assume  
Juris. of  
County Roads*

- C. Upon annexation, the CITY shall assume jurisdiction of COUNTY roads and local access roads that are within or abutting the area annexed. As a condition of jurisdiction transfer for roads not built to CITY street standards on the date of the final decision on the annexation, the COUNTY agrees to pay the CITY a sum of money equal to the cost of constructing, including labor and materials, a 2-inch asphaltic concrete overlay over the width of the then existing pavement; however, if the width of the pavement is less than 20 feet, the sum shall be calculated for an overlay 20-foot wide. The cost of asphaltic concrete overlay to be used in the calculation shall be the average of the most current asphaltic concrete overlay projects performed by each CITY and COUNTY. Arterial roads will be considered for transfer on a case-by-case basis. Terms of transfer for arterial roads will be negotiated and agreed to by both jurisdictions.

*Arts. case  
by case*

6. Development in Unincorporated Areas

A. Development within UGMB may occur pursuant to the COUNTY's Future Urbanizable - 10 acre minimum zoning. The COUNTY shall not form any new COUNTY service districts for sanitary sewer or water services in the UGMB unless agreed to by the CITY.

*No new  
sew. dists.*

B. Public water and/or sanitary sewer shall be provided by the CITY to health hazard areas in the UGMB when the appropriate authority has determined that a health hazard exists and the health hazard area must be serviced. If the health hazard exists on a tax lot or tax lots contiguous to the CITY limits, such tax lots shall be annexed to the CITY as a condition to the CITY providing public water and/or sanitary sewer service.

*City water  
& Sew.*

C. The CITY shall not extend public water and/or sanitary sewer to the UGMB, except for health hazard situations as in 6B above and extra-territorial approvals by the PMALGBC. In the case of a CITY initiated extra-territorial service application to the PMALGBC, the CITY shall notify the COUNTY and provide an opportunity to comment prior to submitting the application. In the case of a private party extra-territorial service application to the PMALGBC, notice to the COUNTY shall be in accordance with PMALGBC procedures.

*City won't  
extend*

7. Terms of Agreement

A. It is hereby understood that this agreement may be amended in writing at any time by the concurrence of both the CITY and COUNTY. The parties shall review this Agreement at each periodic review and make any necessary changes.


B. This agreement may not be terminated except during either jurisdiction's Periodic Review. At such time, either party may terminate this Agreement after one hundred twenty (120) days written notice to the other party, provide, however, that in the event this action is taken, termination shall not occur until after a representative of the Department of Land Conservation and Development (DLCD) reviews this Agreement and the concerns of both jurisdictions regarding this successful operation.




C. This agreement supersedes the Clackamas County-Tualatin Dual Interest Area Agreement, which was entered into on the 10th day of January, 1980. No other agreements concerning planning and land use jurisdiction in the UGMA exist between Clackamas County and the City of Tualatin.


IN WITNESS WHEREOF, the respective parties have caused to be signed in their behalf to make and enter into this agreement this 3rd day of December, 1992.


CITY OF TUALATIN

By   
Steven L. Stolze, Mayor

CLACKAMAS COUNTY BOARD OF COMMISSIONERS

By   
Ed Lindquist, ~~Chair~~

By   
Julie Hammerstad, Commissioner

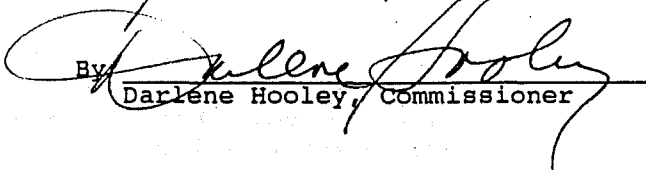By   
Darlene Hooley, Commissioner

ATTEST:

By   
Stephen A. Rhodes, City Recorder

Attachment ("A")  
clugma.agr

ATTACHMENT A

TUALATIN-CLACKAMAS COUNTY  
URBAN GROWTH MANAGEMENT AGREEMENT 1992

Legend:




Clackamas/Washington County Line




Tualatin City Limit



Tualatin Urban Growth Boundary



Unincorporated Areas Subject to  
Urban Growth Management Agreement

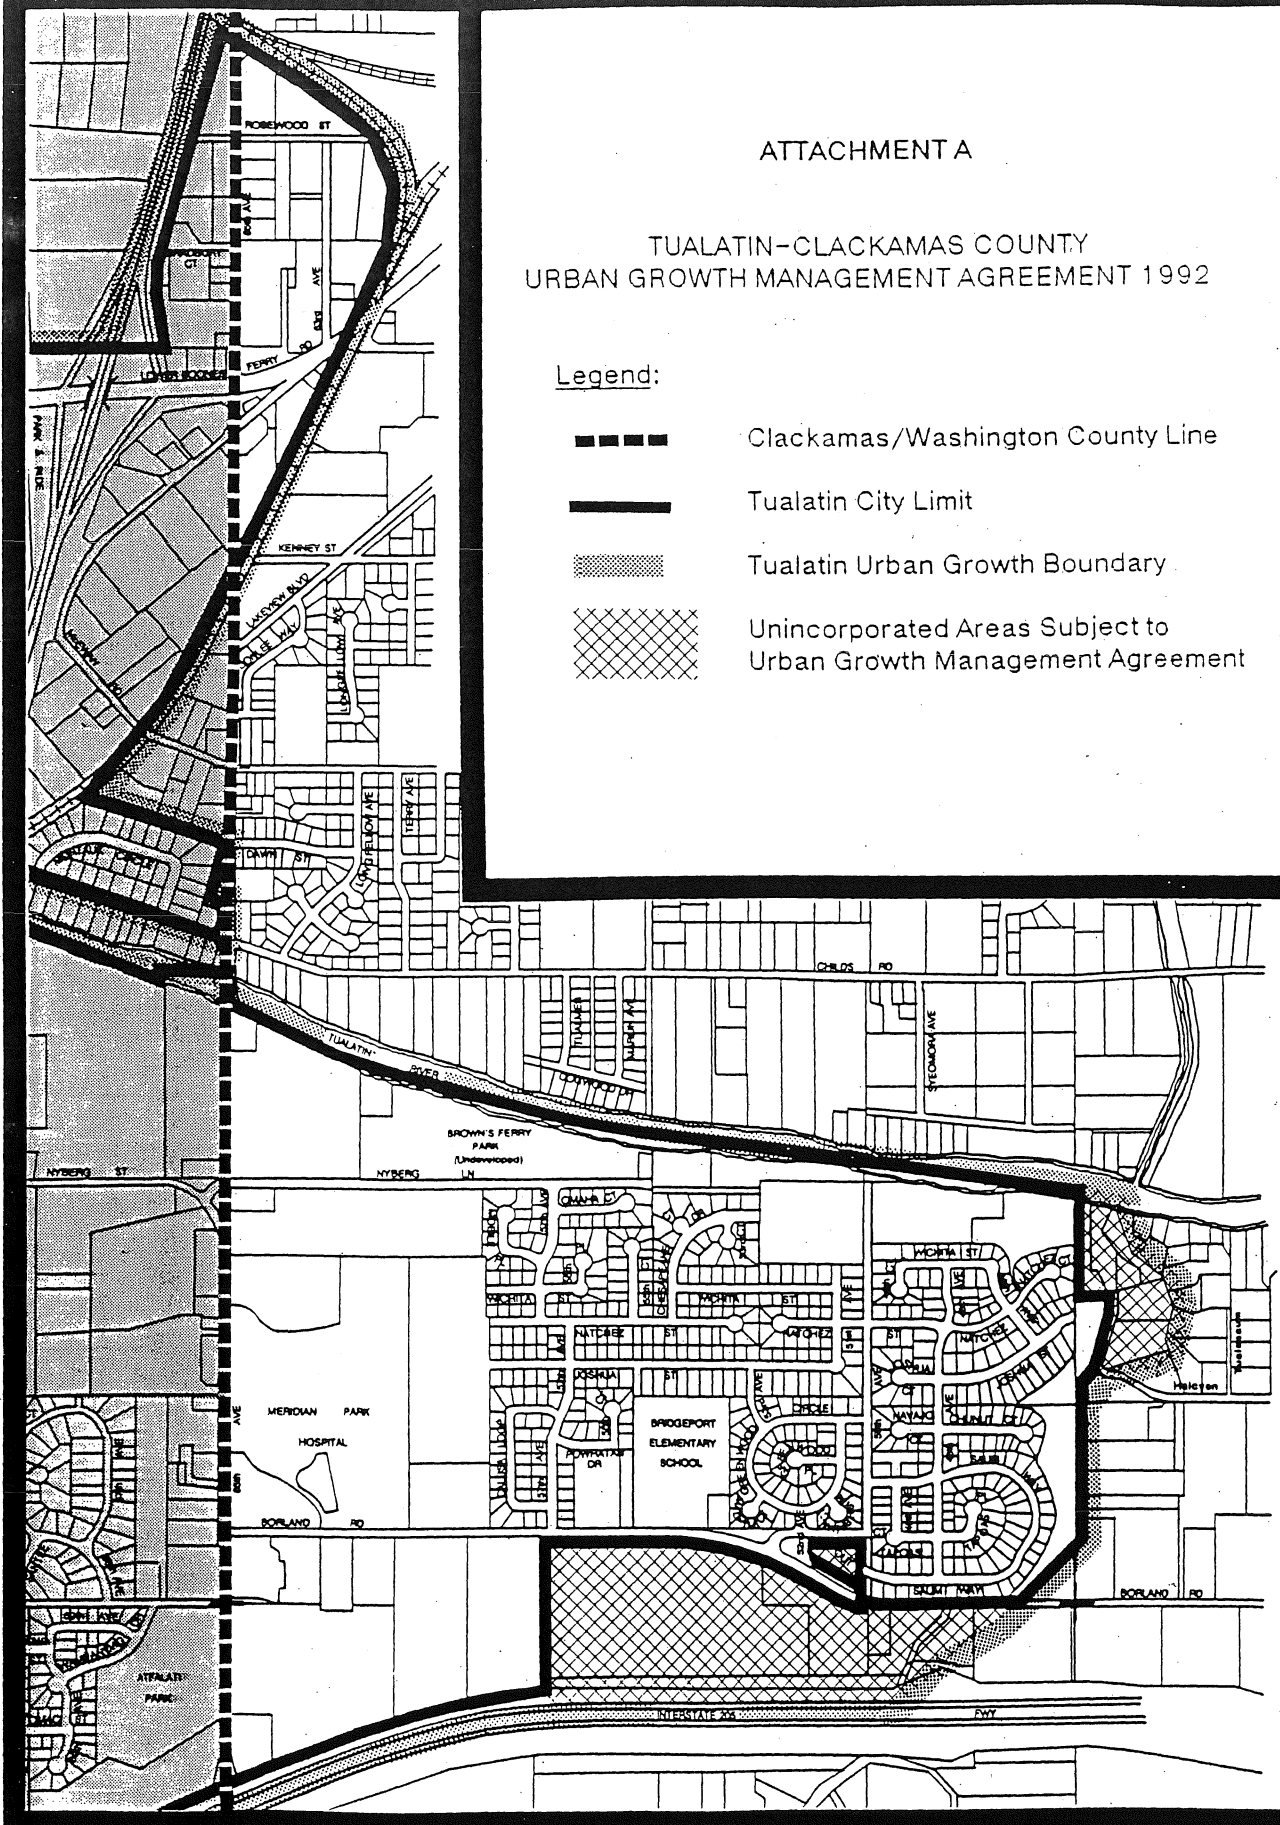

D T D      Comp Plan, Ch. 6 UGMA

BEFORE THE BOARD OF COUNTY COMMISSIONERS  
OF CLACKAMAS COUNTY, STATE OF OREGON

In the Matter of Approving an  
Urban Growth Management Agreement  
Between the City of Tualatin and  
Clackamas County

ORDER NO. 92-1129

This matter coming on at this time  
and it appearing to the Board that agreements for the coordination of  
land use actions within the Clackamas County unincorporated area  
adjacent to cities are needed; and

It further appearing to this Board  
that this Urban Growth Management Agreement replaces the previous  
agreement signed by the Board in January of 1980; and

It further appearing to this Board  
that the City of Tualatin has agreed to the language in this agreement,  
and

It further appearing to this Board  
that said agreement is in the best interests of Clackamas County.

NOW, THEREFORE, IT IS HEREBY ORDERED  
that the within mentioned agreement with the City of Tualatin, a copy of  
which is on file in the Department of Transportation and Development, be  
and the same is approved.

DATED this 3rd day of December, 1992


BOARD OF COUNTY COMMISSIONERS

Judie Hammerstad  
Judie Hammerstad, Chair

Darlene Hooley  
Darlene Hooley, Commissioner

Ed Lindquist  
Ed Lindquist, Commissioner  
CITY OF TUALATIN

DEC 16 1992

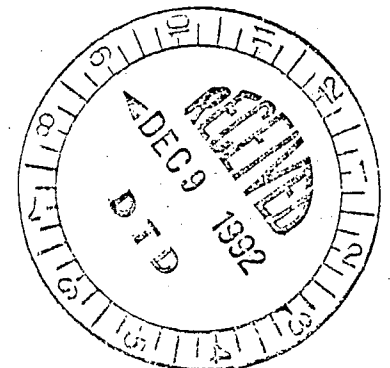

MAYOR \_\_\_\_\_ COUNCIL \_\_\_\_\_ POLICE \_\_\_\_\_ ADM \_\_\_\_\_  
FINANCE \_\_\_\_\_ PLANNING \_\_\_\_\_ LEGAL \_\_\_\_\_ OPER \_\_\_\_\_  
ASST ADM \_\_\_\_\_ PARK & REC \_\_\_\_\_ ENG & BLDG \_\_\_\_\_  
LIBRARY \_\_\_\_\_ ECO DEV \_\_\_\_\_ COURT \_\_\_\_\_ FILE \_\_\_\_\_