

Minute Entry Sign Up Sheet

Date: 8/19/2026

Time: 10:00

Bid # 2026-028WL

Department: WL

Project: WATER MATERIALS 6 MONTH SUPPLY

Attendance

Company

Lindy Smith

COT

Madeira Henley

COT

Cade Armstrong

COT

TUPELO WATER & LIGHT DEPARTMENT
BID TABULATION - WATER MATERIALS (6 MONTH SUPPLY BID)
BID NUMBER 2026-028WL
AUGUST 19, 2026

ITEM	Product	Vendors			
		Consolidated Pipe	Southern Pipe & Supply	G&C Supply	Southern WW Supply
1	¾ x 3 Repair Clamp	\$8.40	\$9.86	\$10.56	\$5.50
2	¾ x 6 Repair Clamp	\$15.75	\$18.36	\$19.70	\$11.00
3	1 x 3 Repair Clamp	\$9.25	\$10.71	\$11.54	\$6.60
4	1 x 6 Repair Clamp	\$16.75	\$19.57	\$20.98	\$12.10
5	1½ x 3 Repair Clamp	\$10.25	\$11.87	\$12.74	\$6.60
6	1½ x 6 Repair Clamp	\$19.25	\$22.36	\$23.94	\$13.20
7	1¼ x 3 Repair Clamp	\$9.50	\$11.10	\$11.86	\$6.60
8	1¼ x 6 Repair Clamp	\$17.65	\$21.00	\$22.10	\$12.10
9	2 x 3 Repair Clamp	\$11.25	\$12.97	\$13.37	\$7.70
10	2 x 6 Repair Clamp	\$20.00	\$23.48	\$24.20	\$14.30
11	2 x 12 Repair Clamp	\$40.95	\$47.66	\$54.16	\$29.70
12	3 x 12 Emergency Clamp	\$148.00	\$140.13	No Bid	No Bid
13	4 x 12 Emergency Clamp	\$160.00	\$163.05	No Bid	No Bid
14	6 x 12 Emergency Clamp	\$195.00	\$196.01	No Bid	No Bid
15	6 x 18 Emergency Clamp	\$308.00	\$356.99	No Bid	No Bid
16	8 x 12 Emergency Clamp	\$227.00	\$230.48	No Bid	No Bid
17	8 x 18 Emergency Clamp	\$308.00	\$385.70	No Bid	No Bid
18	10 x 12 Emergency Clamp	\$290.00	No Bid	No Bid	No Bid
19	10 x 18 Emergency Clamp	\$475.00	No Bid	No Bid	No Bid
20	12 x 12 Emergency Clamp	\$350.00	No Bid	No Bid	No Bid
21	12 x 18 Emergency Clamp	\$475.00	No Bid	No Bid	No Bid
22	4" Tapping Valve - Less Acc	\$1,150.00	\$670.65	No Bid	\$925.20
23	6" Tapping Valve - Less Acc	\$1,458.00	\$896.15	No Bid	\$1,306.05
24	8" Tapping Valve - Less Acc	\$2,325.00	\$1,400.00	No Bid	\$1,939.97
25	10" Tapping Valve - Less Acc	\$3,625.00	\$2,226.00	No Bid	\$2,924.67
26	12" Tapping Valve - Less Acc	\$4,685.00	\$2,687.54	No Bid	\$4,416.75
27	6 x 4 Tapping Tee	\$510.00	\$466.32	\$677.65	No Bid
28	6 x 6 Tapping Tee	\$587.00	\$524.51	\$775.00	No Bid
29	8 x 4 Tapping Tee	\$565.00	\$513.21	\$745.64	No Bid

TUPELO WATER & LIGHT DEPARTMENT
BID TABULATION - WATER MATERIALS (6 MONTH SUPPLY BID)
BID NUMBER 2026-028WL
AUGUST 19, 2026

ITEM	Product	Vendors			
		Consolidated Pipe	Southern Pipe & Supply	G&C Supply	Southern WW Supply
30	8 x 6 Tapping Tee	\$590.00	\$613.23	\$781.25	No Bid
31	8 x 8 Tapping Tee	\$745.00	\$688.05	\$985.42	No Bid
32	10 x 4 Tapping Tee	\$595.00	\$602.54	\$712.60	No Bid
33	10 x 6 Tapping Tee	\$620.00	\$624.22	\$743.55	No Bid
34	10 x 8 Tapping Tee	\$750.00	\$767.34	\$941.42	No Bid
35	10 x 10 Tapping Tee	\$1,275.00	\$917.79	\$1,532.83	No Bid
36	12 x 4 Tapping Tee	\$636.00	\$639.10	\$763.18	No Bid
37	12 x 6 Tapping Tee	\$680.00	\$652.03	\$819.44	No Bid
38	12 x 8 Tapping Tee	\$815.00	\$803.93	\$976.74	No Bid
39	12 x 10 Tapping Tee	\$1,330.00	\$957.77	\$1,599.38	No Bid
40	12 x 12 Tapping Tee	\$1,450.00	\$1,265.81	\$1,740.97	No Bid
41	2" Coupling	\$166.00	\$161.28	\$180.96	No Bid
42	3" Coupling	\$220.00	\$212.41	\$238.73	No Bid
43	4" Coupling	\$280.00	\$272.64	\$305.90	No Bid
44	6" Coupling	\$372.00	\$361.08	\$405.13	No Bid
45	8" Coupling	\$420.00	\$408.48	\$457.40	No Bid
46	10" Coupling	\$540.00	\$524.45	\$567.65	No Bid
47	12" Coupling	\$637.00	\$1,040.00	\$670.00	No Bid
48	3" MJ x MJ Gate Valve - Less Acc	\$730.00	\$628.63	No Bid	\$657.10
49	4" MJ x MJ Gate Valve - Less Acc	\$815.00	\$702.58	No Bid	\$733.52
50	6" MJ x MJ Gate Valve - Less Acc	\$1,040.00	\$896.15	No Bid	\$936.47
51	8" MJ x MJ Gate Valve - Less Acc	\$1,660.00	\$1,427.54	No Bid	\$1,490.21
52	10" MJ x MJ Gate Valve - Less Acc	\$2,580.00	\$2,226.00	No Bid	\$2,323.32
53	12" MJ x MJ Gate Valve - Less Acc	\$3,275.00	\$2,816.73	No Bid	\$2,939.70
54	5.25 x 3' Bury Fire Hydrant	\$3,265.00	No Bid	No Bid	No Bid
55	5.25 x 3.5' Bury Fire Hydrant	\$3,265.00	No Bid	No Bid	No Bid
56	5.25 x 4' Bury Fire Hydrant	\$3,340.00	No Bid	No Bid	No Bid
57	5.25 x 4.5' Bury Fire Hydrant	\$3,420.00	No Bid	No Bid	No Bid
58	5.25 x 5' Bury Fire Hydrant	\$3,495.00	No Bid	No Bid	No Bid

TUPELO WATER & LIGHT DEPARTMENT
BID TABULATION - WATER MATERIALS (6 MONTH SUPPLY BID)
BID NUMBER 2026-028WL
AUGUST 19, 2026

ITEM	Product	Vendors			
		Consolidated Pipe	Southern Pipe & Supply	G&C Supply	Southern WW Supply
59	5.25 x 5.5' Bury Fire Hydrant	\$3,570.00	No Bid	No Bid	No Bid
60	5¼" Fire Hydrant 1' Extension Kit	\$1,120.00	No Bid	No Bid	No Bid
61	5¼" Fire Hydrant 1'-6" Extension Kit	\$1,265.00	No Bid	No Bid	No Bid
62	5¼" Fire Hydrant 2'-6" Extension Kit	\$2,025.00	No Bid	No Bid	No Bid
63	5¼" Fire Hydrant 3'-6" Extension Kit	\$2,435.00	No Bid	No Bid	No Bid
64	5¼" Fire Hydrant 4' Extension Kit	\$2,725.00	No Bid	No Bid	No Bid
65	5¼" Fire Hydrant Flange Repair Kit	\$415.00	No Bid	No Bid	No Bid
66	5¼" Fire Hydrant Main Valve Repair Kit	\$788.00	No Bid	No Bid	No Bid
67	5¼" Fire Hydrant Bonnet Repair Kit	\$125.00	No Bid	No Bid	No Bid
68	¾" Corp Stop	\$44.40	\$43.00	No Bid	\$44.12
69	¾" Curb Stop	\$51.35	\$52.48	No Bid	\$51.02
70	¾" Meter Connector	\$19.60	\$12.80	No Bid	\$19.50
71	¾" Copper Union	\$24.78	\$24.00	No Bid	\$24.65
72	¾" Male Coupling	\$20.35	\$19.71	No Bid	\$20.23
73	¾" Female Coupling	\$21.40	\$20.73	No Bid	\$21.28
74	¾" Quarter Bend Union	\$32.00	\$31.00	No Bid	\$31.82
75	1" Corp Stop	\$67.17	\$65.04	No Bid	\$66.75
76	1" Curb Stop	\$121.25	\$93.54	No Bid	\$120.49
77	1" Meter Connector	\$23.42	\$19.71	No Bid	\$23.28
78	1" Copper Union	\$28.35	\$27.45	No Bid	\$28.18
79	1" Male Coupling	\$24.10	\$23.34	No Bid	\$23.96
80	1" Female Coupling	\$29.00	\$28.13	No Bid	\$28.86
81	1" Quarter Bend Union	\$41.20	\$39.84	No Bid	\$40.94
82	1½" Curb Valve	\$222.40	\$218.13	No Bid	\$220.97
83	1½" Male Coupling	\$66.05	\$63.95	No Bid	\$65.64
84	1½" Female Coupling	\$84.45	\$81.80	No Bid	\$83.95
85	1½" Copper Union	\$94.85	\$91.90	No Bid	\$94.28
86	1½" Quarter Bend Union	\$132.16	\$127.97	No Bid	\$131.32
87	2" Curb Valve	\$325.23	\$317.73	No Bid	\$323.16

TUPELO WATER & LIGHT DEPARTMENT
BID TABULATION - WATER MATERIALS (6 MONTH SUPPLY BID)
BID NUMBER 2026-028WL
AUGUST 19, 2026

ITEM	Product	Vendors			
		Consolidated Pipe	Southern Pipe & Supply	G&C Supply	Southern WW Supply
88	2" Male Coupling	\$96.25	\$93.18	No Bid	\$95.63
89	2" Female Coupling	\$100.55	\$97.40	No Bid	\$99.94
90	2" Copper Union	\$128.10	\$124.05	No Bid	\$127.30
91	2" Quarter Bend Union	\$267.40	\$258.92	No Bid	\$265.70
92	1½" x ¾" IPS Service Saddle	No Bid	No Bid	No Bid	No Bid
93	1½" x 1" IPS Service Saddle	No Bid	No Bid	No Bid	No Bid
94	2" x ¾" IPS Service Saddle	\$32.25	\$32.69	No Bid	No Bid
95	2" x ¾" PVC Service Saddle	No Bid	\$70.73	No Bid	No Bid
96	2" x 1" IPS Service Saddle	\$32.25	\$32.69	No Bid	No Bid
97	2" x 1" PVC Service Saddle	No Bid	\$70.73	No Bid	No Bid
98	4" x ¾" PVC Service Saddle	\$141.00	\$82.57	No Bid	\$137.29
99	4" x 1" PVC Service Saddle	\$141.00	\$82.57	No Bid	\$137.29
100	4" x 1½" PVC Service Saddle	\$164.25	\$91.26	No Bid	\$160.10
101	4" x 2" PVC Service Saddle	\$170.00	\$91.26	No Bid	\$165.57
102	6" x ¾" DIPS Service Saddle	\$143.65	\$51.61	No Bid	\$139.64
103	6" x 1" DIPS Service Saddle	\$143.65	\$51.61	No Bid	\$139.64
104	6" x 1½" DIPS Service Saddle	\$164.25	\$62.88	No Bid	\$159.66
105	6" x 2" DIPS Service Saddle	\$180.40	\$62.88	No Bid	\$175.41
106	8" x ¾" DIPS Service Saddle	\$177.75	\$56.51	No Bid	\$172.82
107	8" x 1" DIPS Service Saddle	\$177.75	\$56.51	No Bid	\$172.82
108	8" x 1½" DIPS Service Saddle	\$187.15	\$70.51	No Bid	\$181.93
109	8" x 2" DIPS Service Saddle	\$203.75	\$70.51	No Bid	\$198.08
110	10" x 1½" DIPS Service Saddle	\$241.00	\$78.06	No Bid	\$235.13
111	10" x 2" DIPS Service Saddle	\$258.50	\$78.06	No Bid	\$252.53
112	12" x 1½" DIPS Service Saddle	\$290.00	\$93.01	No Bid	\$282.61
113	12" x 2" DIPS Service Saddle	\$295.00	\$93.01	No Bid	\$287.71



**WATER MATERIALS
6-MONTH SUPPLY BID**

**City of Tupelo, Mississippi
BID # 2026-028WL**

Publication Dates July 22, 2026, and July 29, 2026

BID Response Deadline: August 19, 2026

ADVERTISEMENT FOR PROPOSALS

NOTICE is hereby given that the City of Tupelo, Mississippi will receive bids for:

**WATER MATERIALS
6-MONTH SUPPLY
BID# 2026-028WL**

Until 10:00 o'clock A.M. local time on August 19, 2026

Bids can be submitted via sealed bid at the Purchasing Office, City Hall 1st Floor, 71 East Troy Street, Tupelo, Mississippi, 38804 or electronically at www.tupelomsbids.com. Bid Documents and Specifications can be viewed and obtained online at www.tupelomsbids.com.

Any questions regarding electronic bidding or access to bid documents should be directed to PH Bidding Group at 662-407-0193 or admin@phbidding.com.

Award will be made to the lowest and best bidder. The Mayor and City Council reserve the right to reject any and all bids and to waive any and all informalities.

BY ORDER OF THE MAYOR AND CITY COUNCIL OF THE CITY OF TUPELO,
MISSISSIPPI.

Kim Hanna
City Clerk

Publishing Dates: July 22, 2026, and July 29, 2026

**WATER MATERIALS
6-MONTH SUPPLY
BID # 2026-028WL**

I. GENERAL

The City of Tupelo will accept competitive sealed proposals until **10:00 AM, August 19, 2026**, at City Hall, 71 East Troy Street, Tupelo, Mississippi 38804. All proposals must be equal in performance and quality to the specifications.

If City Hall is closed for business at the time of the deadline, proposals will be accepted and opened on the next business day of the City, at the originally scheduled hour.

II. TECHNICAL SPECIFICATIONS & BID FORM

The City of Tupelo will be accepting proposals for Water Materials. This is a six (6) month supply bid.

Specifications

Item	Description	Equal or Equivalent to	Unit	Price
1	¾ x 3 Repair Clamp	Smith Blair 245 or Mueller 230		8.40
2	¾ x 6 Repair Clamp	Smith Blair 245 or Mueller 230		15.75
3	1 x 3 Repair Clamp	Smith Blair 245 or Mueller 230		9.25
4	1 x 6 Repair Clamp	Smith Blair 245 or Mueller 230		16.75
5	1 ½ x 3 Repair Clamp	Smith Blair 245 or Mueller 230		10.25
6	1 ½ x 6 Repair Clamp	Smith Blair 245 or Mueller 230		19.25
7	1 ¼ x 3 Repair Clamp	Smith Blair 245 or Mueller 230		9.50
8	1 ¼ x 6 Repair Clamp	Smith Blair 245 or Mueller 230		17.65
9	2 x 3 Repair Clamp	Smith Blair 245 or Mueller 230		11.25
10	2 x 6 Repair Clamp	Smith Blair 245 or Mueller 230		20.00
11	2 x 12 Repair Clamp	Smith Blair 245 or Mueller 230		40.95
12	3 x 12 Emergency Clamp	Mueller 520 Series		148.00
13	4 x 12 Emergency Clamp	Mueller 520 Series		160.00
14	6 x 12 Emergency Clamp	Mueller 520 Series		195.00
15	6 x 18 Emergency Clamp	Mueller 520 Series		308.00
16	8 x 12 Emergency Clamp	Mueller 520 Series		227.00
17	8 x 18 Emergency Clamp	Mueller 520 Series		308.00
18	10 x 12 Emergency Clamp	Mueller 520 Series		290.00
19	10 x 18 Emergency Clamp	Mueller 520 Series		475.00
20	12 x 12 Emergency Clamp	Mueller 520 Series		350.00
21	12 x 18 Emergency Clamp	Mueller 520 Series		475.00
22	4" Tapping Valve – Less Acc	Mueller H-677		1,150.00
23	6" Tapping Valve – Less Acc	Mueller H-677		1,458.00
24	8" Tapping Valve – Less Acc	Mueller H-677		2,325.00

25	10" Tapping Valve – Less Acc	Mueller H-677	3,625.00
26	12" Tapping Valve – Less Acc	Mueller H-677	4,685.00
27	6 x 4 Tapping Tee	Smith Blair 662	510.00
28	6 x 6 Tapping Tee	Smith Blair 662	587.00
29	8 x 4 Tapping Tee	Smith Blair 662	565.00
30	8 x 6 Tapping Tee	Smith Blair 662	590.00
31	8 x 8 Tapping Tee	Smith Blair 662	745.00
32	10 x 4 Tapping Tee	Smith Blair 662	595.00
33	10 x 6 Tapping Tee	Smith Blair 662	620.00
34	10 x 8 Tapping Tee	Smith Blair 662	750.00
35	10 x 10 Tapping Tee	Smith Blair 662	1,275.00
36	12 x 4 Tapping Tee	Smith Blair 662	636.00
37	12 x 6 Tapping Tee	Smith Blair 662	680.00
38	12 x 8 Tapping Tee	Smith Blair 662	815.00
39	12 x 10 Tapping Tee	Smith Blair 662	1,330.00
40	12 x 12 Tapping Tee	Smith Blair 662	1,450.00
41	2" Coupling	Hymax	166.00
42	3" Coupling	Hymax	220.00
43	4" Coupling	Hymax	280.00
44	6" Coupling	Hymax	372.00
45	8" Coupling	Hymax	420.00
46	10" Coupling	Hymax	540.00
47	12" Coupling	Hymax	637.00
48	3" MJxMJ Gate Valve –Less Acc	Mueller A-2360-20	730.00
49	4" MJxMJ Gate Valve –Less Acc	Mueller A-2360-20	815.00
50	6" MJxMJ Gate Valve –Less Acc	Mueller A-2360-20	1,040.00
51	8" MJxMJ Gate Valve –Less Acc	Mueller A-2360-20	1,660.00
52	10" MJxMJ Gate Valve-Less Acc	Mueller A-2360-20	2,580.00
53	12" MJxMJ Gate Valve-Less Acc	Mueller A-2360-20	3,275.00
54	5.25 x 3' Bury Fire Hydrant	Mueller A-423	3,265.00
55	5.25 x 3.5' Bury Fire Hydrant	Mueller A-423	3,265.00
56	5.25 x 4' Bury Fire Hydrant	Mueller A-423	3,340.00
57	5.25 x 4.5' Bury Fire Hydrant	Mueller A-423	3,420.00
58	5.25 x 5' Bury Fire Hydrant	Mueller A-423	3,495.00
59	5.25 x 5.5' Bury Fire Hydrant	Mueller A-423	3,570.00
60	5¼" Fire Hydrant 1' Extension Kit	Mueller Super Centurion	1,120.00
61	5¼" Fire Hydrant 1'-6" Extension Kit	Mueller Super Centurion	1,265.00
62	5¼" Fire Hydrant 2'-6" Extension Kit	Mueller Super Centurion	2,025.00
63	5¼" Fire Hydrant 3'-6" Extension Kit	Mueller Super Centurion	2,435.00
64	5¼" Fire Hydrant 4' Extension Kit	Mueller Super Centurion	2,725.00
65	5¼" Fire Hydrant Flange Repair Kit	Mueller Super Centurion	415.00

66	5¼" Fire Hydrant Main Valve Repair Kit	Mueller Super Centurion		788.00
67	5¼" Fire Hydrant Bonnet Repair Kit	Mueller Super Centurion		125.00
ALL BRASS SHALL BE LEAD-FREE PER ASTM C89833				
68	¾" Corp Stop	A.Y. McDonald 74701 GNS		44.40
69	¾" Curb Stop	A.Y. McDonald 76102 GNS		51.35
70	¾" Meter Connector	A.Y. McDonald 74624 GNS		19.60
71	¾" Copper Union	A.Y. McDonald 74758 GNS		24.78
72	¾" Male Coupling	A.Y. McDonald 74753 GNS		20.35
73	¾" Female Coupling	A.Y. McDonald 74754 GNS		21.40
74	¾" Quarter Bend Union	A.Y. McDonald 74761 GNS		32.00
75	1" Corp Stop	A.Y. McDonald 74701 GNS		67.17
76	1" Curb Stop	A.Y. McDonald 76102 GNS		121.25
77	1" Meter Connector	A.Y. McDonald 74624 GNS		23.42
78	1" Copper Union	A.Y. McDonald 74758 GNS		28.35
79	1" Male Coupling	A.Y. McDonald 74753 GNS		24.10
80	1" Female Coupling	A.Y. McDonald 74754 GNS		29.00
81	1" Quarter Bend Union	A.Y. McDonald 74761 GNS		41.20
82	1½" Curb Valve	A.Y. McDonald 76101 GNS		222.40
83	1½" Male Coupling	A.Y. McDonald 74753 GNS		66.05
84	1½" Female Coupling	A.Y. McDonald 74754 GNS		84.45
85	1½" Copper Union	A.Y. McDonald 74758 GNS		94.85
86	1½" Quarter Bend Union	A.Y. McDonald 74761 GNS		132.16
87	2" Curb Valve	A.Y. McDonald 76101 GNS		325.23
88	2" Male Coupling	A.Y. McDonald 74753 GNS		96.25
89	2" Female Coupling	A.Y. McDonald 74754 GNS		100.55
90	2" Copper Union	A.Y. McDonald 74758 GNS		128.10
91	2" Quarter Bend Union	A.Y. McDonald 74761 GNS		267.40
92	1½" x ¾" IPS Service Saddle	A.Y. McDonald 3825		N/B
93	1½" x 1" IPS Service Saddle	A.Y. McDonald 3825		N/B
94	2" x ¾" IPS Service Saddle	A.Y. McDonald 3841		32.25
95	2" x ¾" PVC Service Saddle	A.Y. McDonald 3845		N/B
96	2" x 1" IPS Service Saddle	A.Y. McDonald 3841		32.25
97	2" x 1" PVC Service Saddle	A.Y. McDonald 3845		N/B
98	4" x ¾" PVC Service Saddle	A.Y. McDonald 3845		141.00
99	4" x 1" PVC Service Saddle	A.Y. McDonald 3845		141.00
100	4" x 1½" PVC Service Saddle	A.Y. McDonald 3845		164.25
101	4" x 2" PVC Service Saddle	A.Y. McDonald 3845		170.00
102	6" x ¾" DIPS Service Saddle	A.Y. McDonald 3825		143.65
103	6" x 1" DIPS Service Saddle	A.Y. McDonald 3825		143.65
104	6" x 1½" DIPS Service Saddle	A.Y. McDonald 3825		164.25
105	6" x 2" DIPS Service Saddle	A.Y. McDonald 3825		180.40
106	8" x ¾" DIPS Service Saddle	A.Y. McDonald 3825		177.75
107	8" x 1" DIPS Service Saddle	A.Y. McDonald 3825		177.75

108	8" x 1½" DIPS Service Saddle	A.Y. McDonald 3825		187.15
109	8" x 2" DIPS Service Saddle	A.Y. McDonald 3825		203.75
110	10" x 1½" DIPS Service Saddle	A.Y. McDonald 3825		241.00
111	10" x 2" DIPS Service Saddle	A.Y. McDonald 3825		258.50
112	12" x 1½" DIPS Service Saddle	A.Y. McDonald 3825		290.00
113	12" x 2" DIPS Service Saddle	A.Y. McDonald 3825		295.00

General Bidders Requirements/Information

1. The City of Tupelo reserves the right to reject any and all bids, to waive any informalities in the bid, or award the bid to whomsoever they may choose.
2. The specifications, as stated, are minimum requirements and may be exceeded by the bidder. However, no additional consideration shall be given for exceeding the minimum requirements and all bids will be evaluated against the specifications set forth in this bid package.
3. Manufacturer's part or item numbers are shown only to describe the item and to determine the level of acceptable quality. Other manufacturer's "equal" items may be bid. The acceptance of "equal" items lies with the Council of the City of Tupelo whose decision shall be final. All items shall be delivered FOB to the location specified on the purchase request in Tupelo, Mississippi 38801.
4. All bid prices shall be net, FOB destination, with transportation charges prepaid by vendor.
5. The bid solicitation is for a supply contract of six (6) months with the City to have the option, at the end of the initial six (6) month period, to renew the contract for an additional six (6) months with no price increase if agreeable with vendor.
6. All items will be ordered on an as needed basis during the life of the contract(s) resulting from this bid process. Minimum order quantities shall be for truckload quantities.
7. No bidder is required to bid on all items. However, the successful bidder(s) shall be determined by item compliance to minimum specifications requirements.
8. Delivery will be a consideration in the awarding of this bid.
9. The burden of proof of specifications is the responsibility of the bidder.

BIDDER INFORMATION FORM

**WATER MATERIALS
6-MONTH SUPPLY
BID# 2026-028WL**

The undersigned proposes to provide water materials which meet the specifications provided. The undersigned certifies that the minimum specifications, terms and conditions contained in this BID have been considered and understood. By submitting a proposal, I/We do certify that the commodities offered do meet the specifications contained in this Invitation to Bid.

BIDDER ACKNOWLEDGES receipt of the following ADDENDA:

NUMBER: _____ DATE: _____
NUMBER: _____ DATE: _____
NUMBER: _____ DATE: _____

BIDDER INFORMATION:

Company Name: Consolidated Pipe And Supply

Company Representative: Lee McCoy

Title: Inside Sales

Business Address:

Street: 2505 Mattox St.

City: TUPELO State: MS Zip: 38801

Signature of Bidder: Lee McCoy

Date: 8-18-2026



**WATER MATERIALS
6-MONTH SUPPLY BID**

**City of Tupelo, Mississippi
BID # 2026-028WL**

Publication Dates..... July 22, 2026, and July 29, 2026

BID Response Deadline:..... August 19, 2026

ADVERTISEMENT FOR PROPOSALS

NOTICE is hereby given that the City of Tupelo, Mississippi will receive bids for:

**WATER MATERIALS
6-MONTH SUPPLY
BID# 2026-028WL**

Until 10:00 o'clock A.M. local time on August 19, 2026

Bids can be submitted via sealed bid at the Purchasing Office, City Hall 1st Floor, 71 East Troy Street, Tupelo, Mississippi, 38804 or electronically at www.tupelomsbids.com. Bid Documents and Specifications can be viewed and obtained online at www.tupelomsbids.com.

Any questions regarding electronic bidding or access to bid documents should be directed to PH Bidding Group at 662-407-0193 or admin@phbidding.com.

Award will be made to the lowest and best bidder. The Mayor and City Council reserve the right to reject any and all bids and to waive any and all informalities.

BY ORDER OF THE MAYOR AND CITY COUNCIL OF THE CITY OF TUPELO,
MISSISSIPPI.

Kim Hanna
City Clerk

Publishing Dates: July 22, 2026, and July 29, 2026

**WATER MATERIALS
6-MONTH SUPPLY
BID # 2026-028WL**

I. GENERAL

The City of Tupelo will accept competitive sealed proposals until **10:00 AM, August 19, 2026**, at City Hall, 71 East Troy Street, Tupelo, Mississippi 38804. All proposals must be equal in performance and quality to the specifications.

If City Hall is closed for business at the time of the deadline, proposals will be accepted and opened on the next business day of the City, at the originally scheduled hour.

II. TECHNICAL SPECIFICATIONS & BID FORM

The City of Tupelo will be accepting proposals for Water Materials. This is a six (6) month supply bid.

Specifications

Item	Description	Equal or Equivalent to	Unit	Price
1	¾ x 3 Repair Clamp	Smith Blair 245 or Mueller 230		9.86
2	¾ x 6 Repair Clamp	Smith Blair 245 or Mueller 230		18.36
3	1 x 3 Repair Clamp	Smith Blair 245 or Mueller 230		10.71
4	1 x 6 Repair Clamp	Smith Blair 245 or Mueller 230		19.57
5	1 ½ x 3 Repair Clamp	Smith Blair 245 or Mueller 230		11.87
6	1 ½ x 6 Repair Clamp	Smith Blair 245 or Mueller 230		22.36
7	1 ¼ x 3 Repair Clamp	Smith Blair 245 or Mueller 230		11.10
8	1 ¼ x 6 Repair Clamp	Smith Blair 245 or Mueller 230		21.00
9	2 x 3 Repair Clamp	Smith Blair 245 or Mueller 230		12.97
10	2 x 6 Repair Clamp	Smith Blair 245 or Mueller 230		23.48
11	2 x 12 Repair Clamp	Smith Blair 245 or Mueller 230		47.66
12	3 x 12 Emergency Clamp	Mueller 520 Series		140.13
13	4 x 12 Emergency Clamp	Mueller 520 Series		163.05
14	6 x 12 Emergency Clamp	Mueller 520 Series		196.01
15	6 x 18 Emergency Clamp	Mueller 520 Series		356.99
16	8 x 12 Emergency Clamp	Mueller 520 Series		230.48
17	8 x 18 Emergency Clamp	Mueller 520 Series		385.70
18	10 x 12 Emergency Clamp	Mueller 520 Series		NA
19	10 x 18 Emergency Clamp	Mueller 520 Series		NA
20	12 x 12 Emergency Clamp	Mueller 520 Series		NA
21	12 x 18 Emergency Clamp	Mueller 520 Series		NA
22	4" Tapping Valve – Less Acc	~~Mueller H-677~~ M&H MSXFLG		1670.63
23	6" Tapping Valve – Less Acc	~~Mueller H-677~~ M&H MSXFLG		896.15
24	8" Tapping Valve – Less Acc	~~Mueller H-677~~ M&H MSXFLG		1,400.00

25	10" Tapping Valve – Less Acc	~~Mueller H-677~~ M+H MSXFLC	\$2,226.90
26	12" Tapping Valve – Less Acc	~~Mueller H-677~~ M+H MSXFLC	\$2,687.54
27	6 x 4 Tapping Tee	Smith Blair 662	\$466.32
28	6 x 6 Tapping Tee	Smith Blair 662	\$524.51
29	8 x 4 Tapping Tee	Smith Blair 662	\$513.21
30	8 x 6 Tapping Tee	Smith Blair 662	\$613.23
31	8 x 8 Tapping Tee	Smith Blair 662	\$655.08
32	10 x 4 Tapping Tee	Smith Blair 662	\$602.54
33	10 x 6 Tapping Tee	Smith Blair 662	\$624.22
34	10 x 8 Tapping Tee	Smith Blair 662	\$717.34
35	10 x 10 Tapping Tee	Smith Blair 662	\$917.79
36	12 x 4 Tapping Tee	Smith Blair 662	\$639.10
37	12 x 6 Tapping Tee	Smith Blair 662	\$652.03
38	12 x 8 Tapping Tee	Smith Blair 662	\$803.93
39	12 x 10 Tapping Tee	Smith Blair 662	\$957.77
40	12 x 12 Tapping Tee	Smith Blair 662	\$1,205.81
41	2" Coupling	Hymax	\$161.28
42	3" Coupling	Hymax	\$212.41
43	4" Coupling	Hymax	\$272.64
44	6" Coupling	Hymax	\$361.08
45	8" Coupling	Hymax	\$408.48
46	10" Coupling	Hymax	\$524.45
47	12" Coupling	Hymax	\$640.00
48	3" MJxMJ Gate Valve –Less Acc	~~Mueller A-2360-20~~ M+H	\$628.63
49	4" MJxMJ Gate Valve –Less Acc	~~Mueller A-2360-20~~ M+H	\$702.58
50	6" MJxMJ Gate Valve –Less Acc	~~Mueller A-2360-20~~ M+H	\$896.15
51	8" MJxMJ Gate Valve –Less Acc	~~Mueller A-2360-20~~ M+H	\$1,427.54
52	10" MJxMJ Gate Valve-Less Acc	~~Mueller A-2360-20~~ M+H	\$2,226.00
53	12" MJxMJ Gate Valve-Less Acc	~~Mueller A-2360-20~~ M+H	\$2,816.73
54	5.25 x 3' Bury Fire Hydrant	Mueller A-423	NA
55	5.25 x 3.5' Bury Fire Hydrant	Mueller A-423	NA
56	5.25 x 4' Bury Fire Hydrant	Mueller A-423	NA
57	5.25 x 4.5' Bury Fire Hydrant	Mueller A-423	NA
58	5.25 x 5' Bury Fire Hydrant	Mueller A-423	NA
59	5.25 x 5.5' Bury Fire Hydrant	Mueller A-423	NA
60	5¼" Fire Hydrant 1' Extension Kit	Mueller Super Centurion	NA
61	5¼" Fire Hydrant 1'-6" Extension Kit	Mueller Super Centurion	NA
62	5¼" Fire Hydrant 2'-6" Extension Kit	Mueller Super Centurion	NA
63	5¼" Fire Hydrant 3'-6" Extension Kit	Mueller Super Centurion	NA
64	5¼" Fire Hydrant 4' Extension Kit	Mueller Super Centurion	NA
65	5¼" Fire Hydrant Flange Repair Kit	Mueller Super Centurion	NA

66	5¼" Fire Hydrant Main Valve Repair Kit	Mueller Super Centurion		NA
67	5¼" Fire Hydrant Bonnet Repair Kit	Mueller Super Centurion		NA
ALL BRASS SHALL BE LEAD-FREE PER ASTM C89833				
68	¾" Corp Stop	A.Y. McDonald 74701 GNS		\$ 43.00
69	¾" Curb Stop	A.Y. McDonald 76102 GNS		\$ 52.48
70	¾" Meter Connector	A.Y. McDonald 74624 GNS		\$ 12.80
71	¾" Copper Union	A.Y. McDonald 74758 GNS		\$ 24.00
72	¾" Male Coupling	A.Y. McDonald 74753 GNS		\$ 19.71
73	¾" Female Coupling	A.Y. McDonald 74754 GNS		\$ 20.73
74	¾" Quarter Bend Union	A.Y. McDonald 74761 GNS		\$ 31.00
75	1" Corp Stop	A.Y. McDonald 74701 GNS		\$ 65.04
76	1" Curb Stop	A.Y. McDonald 76102 GNS		\$ 93.54
77	1" Meter Connector	A.Y. McDonald 74624 GNS		\$ 19.71
78	1" Copper Union	A.Y. McDonald 74758 GNS		\$ 27.45
79	1" Male Coupling	A.Y. McDonald 74753 GNS		\$ 23.34
80	1" Female Coupling	A.Y. McDonald 74754 GNS		\$ 28.13
81	1" Quarter Bend Union	A.Y. McDonald 74761 GNS		\$ 39.84
82	1½" Curb Valve	A.Y. McDonald 76101 GNS		\$ 218.13
83	1½" Male Coupling	A.Y. McDonald 74753 GNS		\$ 63.95
84	1½" Female Coupling	A.Y. McDonald 74754 GNS		\$ 81.80
85	1½" Copper Union	A.Y. McDonald 74758 GNS		\$ 91.90
86	1½" Quarter Bend Union	A.Y. McDonald 74761 GNS		\$ 127.97
87	2" Curb Valve	A.Y. McDonald 76101 GNS		\$ 317.73
88	2" Male Coupling	A.Y. McDonald 74753 GNS		\$ 93.18
89	2" Female Coupling	A.Y. McDonald 74754 GNS		\$ 97.40
90	2" Copper Union	A.Y. McDonald 74758 GNS		\$ 124.05
91	2" Quarter Bend Union	A.Y. McDonald 74761 GNS		\$ 258.92
92	1½" x ¾" IPS Service Saddle	A.Y. McDonald 3825		NA
93	1½" x 1" IPS Service Saddle	A.Y. McDonald 3825		NA
94	2" x ¾" IPS Service Saddle	A.Y. McDonald 3825		\$ 32.69
95	2" x ¾" PVC Service Saddle	A.Y. McDonald 3845		\$ 70.73
96	2" x 1" IPS Service Saddle	A.Y. McDonald 3825		\$ 32.69
97	2" x 1" PVC Service Saddle	A.Y. McDonald 3845		\$ 70.73
98	4" x ¾" PVC Service Saddle	A.Y. McDonald 3845		\$ 82.57
99	4" x 1" PVC Service Saddle	A.Y. McDonald 3845		\$ 82.57
100	4" x 1½" PVC Service Saddle	A.Y. McDonald 3845		\$ 91.26
101	4" x 2" PVC Service Saddle	A.Y. McDonald 3845		\$ 91.26
102	6" x ¾" DIPS Service Saddle	A.Y. McDonald 3825		\$ 51.61
103	6" x 1" DIPS Service Saddle	A.Y. McDonald 3825		\$ 51.61
104	6" x 1½" DIPS Service Saddle	A.Y. McDonald 3825		\$ 62.88
105	6" x 2" DIPS Service Saddle	A.Y. McDonald 3825		\$ 62.88
106	8" x ¾" DIPS Service Saddle	A.Y. McDonald 3825		\$ 56.51
107	8" x 1" DIPS Service Saddle	A.Y. McDonald 3825		\$ 56.51

108	8" x 1½" DIPS Service Saddle	A.Y. McDonald 3825		\$ 70.51
109	8" x 2" DIPS Service Saddle	A.Y. McDonald 3825		\$ 70.51
110	10" x 1½" DIPS Service Saddle	A.Y. McDonald 3825		\$ 78.06
111	10" x 2" DIPS Service Saddle	A.Y. McDonald 3825		\$ 78.06
112	12" x 1½" DIPS Service Saddle	A.Y. McDonald 3825		\$ 93.01
113	12" x 2" DIPS Service Saddle	A.Y. McDonald 3825		\$ 93.01

General Bidders Requirements/Information

1. The City of Tupelo reserves the right to reject any and all bids, to waive any informalities in the bid, or award the bid to whomsoever they may choose.
2. The specifications, as stated, are minimum requirements and may be exceeded by the bidder. However, no additional consideration shall be given for exceeding the minimum requirements and all bids will be evaluated against the specifications set forth in this bid package.
3. Manufacturer's part or item numbers are shown only to describe the item and to determine the level of acceptable quality. Other manufacturer's "equal" items may be bid. The acceptance of "equal" items lies with the Council of the City of Tupelo whose decision shall be final. All items shall be delivered FOB to the location specified on the purchase request in Tupelo, Mississippi 38801.
4. All bid prices shall be net, FOB destination, with transportation charges prepaid by vendor.
5. The bid solicitation is for a supply contract of six (6) months with the City to have the option, at the end of the initial six (6) month period, to renew the contract for an additional six (6) months with no price increase if agreeable with vendor.
6. All items will be ordered on an as needed basis during the life of the contract(s) resulting from this bid process. Minimum order quantities shall be for truckload quantities.
7. No bidder is required to bid on all items. However, the successful bidder(s) shall be determined by item compliance to minimum specifications requirements.
8. Delivery will be a consideration in the awarding of this bid.
9. The burden of proof of specifications is the responsibility of the bidder.

III. QUESTIONS

Failure to examine any specifications and instructions will be at bidder's risk. All procedural and technical questions, or if the attached specifications are incomplete, not clear, or not standardized, shall be made in writing and addressed to the following.

General questions regarding this request should be directed to Kim Hanna, City Clerk, at the City of Tupelo, 71 East Troy Street, Tupelo, MS 38804. The phone number is 662-841-6502 Ext: 109.

Email: kim.hanna@tupeloms.gov

For questions concerning the technical specifications, prospective bidders may contact Drew Kyle, Tupelo Water & Light Department. The phone number is 662-841-6460. Email: drew.kyle@tupeloms.gov

Questions regarding the website or electronic bidding should be directed to Plan House at 662-407-0193 or admin@phbidding.com.

No oral explanations by any member of the city staff will be binding. Receipt of addenda must be acknowledged in writing. Submitting vendors shall be responsible for ensuring that they have received any and all addenda.

IV. OPENING:

Proposal openings, whether electronic or traditional paper method, shall be conducted any time after they are received and shall be conducted by at least two procurement officials. From that point forward, proposals will be considered under advisement. City of Tupelo may conduct written or oral discussions with potential bidders.

The City of Tupelo reserves the right to determine responsive offers or proposals, waive minor informalities in the process, to reject any and all offers or proposals, and to invite priced bids from those companies believed most advantageous to the City.

BIDDER INFORMATION FORM

**WATER MATERIALS
6-MONTH SUPPLY
BID# 2026-028WL**

The undersigned proposes to provide water materials which meet the specifications provided. The undersigned certifies that the minimum specifications, terms and conditions contained in this BID have been considered and understood. By submitting a proposal, I/We do certify that the commodities offered do meet the specifications contained in this Invitation to Bid.

BIDDER ACKNOWLEDGES receipt of the following ADDENDA:

NUMBER: _____ DATE: _____
NUMBER: _____ DATE: _____
NUMBER: _____ DATE: _____

BIDDER INFORMATION:

Company Name: Southern Pipe & Supply
Company Representative: Lee Enlow
Title: Manager

Business Address:

Street: 4094 Rob Drive
City: Tupelo State: MS Zip: 38801
Signature of Bidder: [Signature]
Date: 8-18-26



**WATER MATERIALS
6-MONTH SUPPLY BID**

**City of Tupelo, Mississippi
BID # 2026-028WL**

Publication Dates July 22, 2026, and July 29, 2026

BID Response Deadline: August 19, 2026

**WATER MATERIALS
6-MONTH SUPPLY
BID # 2026-028WL**

I. GENERAL

The City of Tupelo will accept competitive sealed proposals until **10:00 AM, August 19, 2026**, at City Hall, 71 East Troy Street, Tupelo, Mississippi 38804. All proposals must be equal in performance and quality to the specifications.

If City Hall is closed for business at the time of the deadline, proposals will be accepted and opened on the next business day of the City, at the originally scheduled hour.

II. TECHNICAL SPECIFICATIONS & BID FORM

The City of Tupelo will be accepting proposals for Water Materials. This is a six (6) month supply bid.

Specifications

Item	Description	Equal or Equivalent to	Unit	Price
1	¾ x 3 Repair Clamp	Smith Blair 245 or Mueller 230		10.54
2	¾ x 6 Repair Clamp	Smith Blair 245 or Mueller 230		19.70
3	1 x 3 Repair Clamp	Smith Blair 245 or Mueller 230		11.54
4	1 x 6 Repair Clamp	Smith Blair 245 or Mueller 230		20.98
5	1 ½ x 3 Repair Clamp	Smith Blair 245 or Mueller 230		12.74
6	1 ½ x 6 Repair Clamp	Smith Blair 245 or Mueller 230		23.94
7	1 ¼ x 3 Repair Clamp	Smith Blair 245 or Mueller 230		11.80
8	1 ¼ x 6 Repair Clamp	Smith Blair 245 or Mueller 230		22.10
9	2 x 3 Repair Clamp	Smith Blair 245 or Mueller 230		13.37
10	2 x 6 Repair Clamp	Smith Blair 245 or Mueller 230		24.20
11	2 x 12 Repair Clamp	Smith Blair 245 or Mueller 230		54.16
12	3 x 12 Emergency Clamp	Mueller 520 Series		No B.
13	4 x 12 Emergency Clamp	Mueller 520 Series		
14	6 x 12 Emergency Clamp	Mueller 520 Series		
15	6 x 18 Emergency Clamp	Mueller 520 Series		
16	8 x 12 Emergency Clamp	Mueller 520 Series		
17	8 x 18 Emergency Clamp	Mueller 520 Series		
18	10 x 12 Emergency Clamp	Mueller 520 Series		
19	10 x 18 Emergency Clamp	Mueller 520 Series		
20	12 x 12 Emergency Clamp	Mueller 520 Series		
21	12 x 18 Emergency Clamp	Mueller 520 Series		
22	4" Tapping Valve – Less Acc	Mueller H-677		
23	6" Tapping Valve – Less Acc	Mueller H-677		
24	8" Tapping Valve – Less Acc	Mueller H-677		

25	10" Tapping Valve – Less Acc	Mueller H-677		No 13.2
26	12" Tapping Valve – Less Acc	Mueller H-677		1
27	6 x 4 Tapping Tee	Smith Blair 662		677.65
28	6 x 6 Tapping Tee	Smith Blair 662		775.00
29	8 x 4 Tapping Tee	Smith Blair 662		745.64
30	8 x 6 Tapping Tee	Smith Blair 662		781.25
31	8 x 8 Tapping Tee	Smith Blair 662		985.42
32	10 x 4 Tapping Tee	Smith Blair 662		712.60
33	10 x 6 Tapping Tee	Smith Blair 662		743.55
34	10 x 8 Tapping Tee	Smith Blair 662		941.42
35	10 x 10 Tapping Tee	Smith Blair 662		1532.83
36	12 x 4 Tapping Tee	Smith Blair 662		763.18
37	12 x 6 Tapping Tee	Smith Blair 662		819.44
38	12 x 8 Tapping Tee	Smith Blair 662		976.74
39	12 x 10 Tapping Tee	Smith Blair 662		1599.38
40	12 x 12 Tapping Tee	Smith Blair 662		1740.97
41	2" Coupling	Hymax		180.96
42	3" Coupling	Hymax		238.73
43	4" Coupling	Hymax		305.90
44	6" Coupling	Hymax		405.13
45	8" Coupling	Hymax		457.40
46	10" Coupling	Hymax		567.65
47	12" Coupling	Hymax		670.00
48	3" MJxMJ Gate Valve –Less Acc	Mueller A-2360-20		No 13.2
49	4" MJxMJ Gate Valve –Less Acc	Mueller A-2360-20		
50	6" MJxMJ Gate Valve –Less Acc	Mueller A-2360-20		
51	8" MJxMJ Gate Valve –Less Acc	Mueller A-2360-20		
52	10" MJxMJ Gate Valve-Less Acc	Mueller A-2360-20		
53	12" MJxMJ Gate Valve-Less Acc	Mueller A-2360-20		
54	5.25 x 3' Bury Fire Hydrant	Mueller A-423		
55	5.25 x 3.5' Bury Fire Hydrant	Mueller A-423		
56	5.25 x 4' Bury Fire Hydrant	Mueller A-423		
57	5.25 x 4.5' Bury Fire Hydrant	Mueller A-423		
58	5.25 x 5' Bury Fire Hydrant	Mueller A-423		
59	5.25 x 5.5' Bury Fire Hydrant	Mueller A-423		
60	5¼" Fire Hydrant 1' Extension Kit	Mueller Super Centurion		
61	5¼" Fire Hydrant 1'-6" Extension Kit	Mueller Super Centurion		
62	5¼" Fire Hydrant 2'-6" Extension Kit	Mueller Super Centurion		
63	5¼" Fire Hydrant 3'-6" Extension Kit	Mueller Super Centurion		
64	5¼" Fire Hydrant 4' Extension Kit	Mueller Super Centurion		
65	5¼" Fire Hydrant Flange Repair Kit	Mueller Super Centurion		

66	5¼" Fire Hydrant Main Valve Repair Kit	Mueller Super Centurion		No B.C.
67	5¼" Fire Hydrant Bonnet Repair Kit	Mueller Super Centurion		
ALL BRASS SHALL BE LEAD-FREE PER ASTM C89833				
68	¾" Corp Stop	A.Y. McDonald 74701 GNS		
69	¾" Curb Stop	A.Y. McDonald 76102 GNS		
70	¾" Meter Connector	A.Y. McDonald 74624 GNS		
71	¾" Copper Union	A.Y. McDonald 74758 GNS		
72	¾" Male Coupling	A.Y. McDonald 74753 GNS		
73	¾" Female Coupling	A.Y. McDonald 74754 GNS		
74	¾" Quarter Bend Union	A.Y. McDonald 74761 GNS		
75	1" Corp Stop	A.Y. McDonald 74701 GNS		
76	1" Curb Stop	A.Y. McDonald 76102 GNS		
77	1" Meter Connector	A.Y. McDonald 74624 GNS		
78	1" Copper Union	A.Y. McDonald 74758 GNS		
79	1" Male Coupling	A.Y. McDonald 74753 GNS		
80	1" Female Coupling	A.Y. McDonald 74754 GNS		
81	1" Quarter Bend Union	A.Y. McDonald 74761 GNS		
82	1½" Curb Valve	A.Y. McDonald 76101 GNS		
83	1½" Male Coupling	A.Y. McDonald 74753 GNS		
84	1½" Female Coupling	A.Y. McDonald 74754 GNS		
85	1½" Copper Union	A.Y. McDonald 74758 GNS		
86	1½" Quarter Bend Union	A.Y. McDonald 74761 GNS		
87	2" Curb Valve	A.Y. McDonald 76101 GNS		
88	2" Male Coupling	A.Y. McDonald 74753 GNS		
89	2" Female Coupling	A.Y. McDonald 74754 GNS		
90	2" Copper Union	A.Y. McDonald 74758 GNS		
91	2" Quarter Bend Union	A.Y. McDonald 74761 GNS		
92	1½" x ¾" IPS Service Saddle	A.Y. McDonald 3825		
93	1½" x 1" IPS Service Saddle	A.Y. McDonald 3825		
94	2" x ¾" IPS Service Saddle	A.Y. McDonald 3825		
95	2" x ¾" PVC Service Saddle	A.Y. McDonald 3845		
96	2" x 1" IPS Service Saddle	A.Y. McDonald 3825		
97	2" x 1" PVC Service Saddle	A.Y. McDonald 3845		
98	4" x ¾" PVC Service Saddle	A.Y. McDonald 3845		
99	4" x 1" PVC Service Saddle	A.Y. McDonald 3845		
100	4" x 1½" PVC Service Saddle	A.Y. McDonald 3845		
101	4" x 2" PVC Service Saddle	A.Y. McDonald 3845		
102	6" x ¾" DIPS Service Saddle	A.Y. McDonald 3825		
103	6" x 1" DIPS Service Saddle	A.Y. McDonald 3825		
104	6" x 1½" DIPS Service Saddle	A.Y. McDonald 3825		
105	6" x 2" DIPS Service Saddle	A.Y. McDonald 3825		
106	8" x ¾" DIPS Service Saddle	A.Y. McDonald 3825		
107	8" x 1" DIPS Service Saddle	A.Y. McDonald 3825		

108	8" x 1½" DIPS Service Saddle	A.Y. McDonald 3825			1/6 Bie
109	8" x 2" DIPS Service Saddle	A.Y. McDonald 3825			
110	10" x 1½" DIPS Service Saddle	A.Y. McDonald 3825			
111	10" x 2" DIPS Service Saddle	A.Y. McDonald 3825			
112	12" x 1½" DIPS Service Saddle	A.Y. McDonald 3825			
113	12" x 2" DIPS Service Saddle	A.Y. McDonald 3825			

General Bidders Requirements/Information

1. The City of Tupelo reserves the right to reject any and all bids, to waive any informalities in the bid, or award the bid to whomsoever they may choose.
2. The specifications, as stated, are minimum requirements and may be exceeded by the bidder. However, no additional consideration shall be given for exceeding the minimum requirements and all bids will be evaluated against the specifications set forth in this bid package.
3. Manufacturer's part or item numbers are shown only to describe the item and to determine the level of acceptable quality. Other manufacturer's "equal" items may be bid. The acceptance of "equal" items lies with the Council of the City of Tupelo whose decision shall be final. All items shall be delivered FOB to the location specified on the purchase request in Tupelo, Mississippi 38801.
4. All bid prices shall be net, FOB destination, with transportation charges prepaid by vendor.
5. The bid solicitation is for a supply contract of six (6) months with the City to have the option, at the end of the initial six (6) month period, to renew the contract for an additional six (6) months with no price increase if agreeable with vendor.
6. All items will be ordered on an as needed basis during the life of the contract(s) resulting from this bid process. Minimum order quantities shall be for truckload quantities.
7. No bidder is required to bid on all items. However, the successful bidder(s) shall be determined by item compliance to minimum specifications requirements.
8. Delivery will be a consideration in the awarding of this bid.
9. The burden of proof of specifications is the responsibility of the bidder.

BIDDER INFORMATION FORM

**WATER MATERIALS
6-MONTH SUPPLY
BID# 2026-028WL**

The undersigned proposes to provide water materials which meet the specifications provided. The undersigned certifies that the minimum specifications, terms and conditions contained in this BID have been considered and understood. By submitting a proposal, I/We do certify that the commodities offered do meet the specifications contained in this Invitation to Bid.


BIDDER ACKNOWLEDGES receipt of the following ADDENDA:

NUMBER: _____ DATE: _____
NUMBER: _____ DATE: _____
NUMBER: _____ DATE: _____

BIDDER INFORMATION:

Company Name: G & C Supply
Company Representative: Josh Meals
Title: Sales Rep

Business Address:

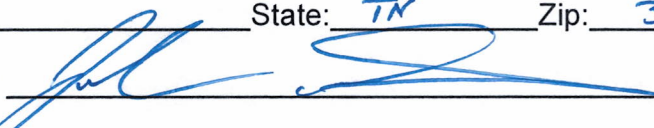Street: 1105 TN-77
City: Atwood State: TN Zip: 38220
Signature of Bidder: 
Date: 8/17/24



**WATER MATERIALS
6-MONTH SUPPLY BID**

**City of Tupelo, Mississippi
BID # 2026-028WL**

Publication Dates..... July 22, 2026, and July 29, 2026

BID Response Deadline:..... August 19, 2026

ADVERTISEMENT FOR PROPOSALS

NOTICE is hereby given that the City of Tupelo, Mississippi will receive bids for:

**WATER MATERIALS
6-MONTH SUPPLY
BID# 2026-028WL**

Until **10:00 o'clock A.M.** local time on **August 19, 2026**

Bids can be submitted via sealed bid at the Purchasing Office, City Hall 1st Floor, 71 East Troy Street, Tupelo, Mississippi, 38804 or electronically at www.tupelomsbids.com. Bid Documents and Specifications can be viewed and obtained online at www.tupelomsbids.com.

Any questions regarding electronic bidding or access to bid documents should be directed to PH Bidding Group at 662-407-0193 or admin@phbidding.com.

Award will be made to the lowest and best bidder. The Mayor and City Council reserve the right to reject any and all bids and to waive any and all informalities.

BY ORDER OF THE MAYOR AND CITY COUNCIL OF THE CITY OF TUPELO,
MISSISSIPPI.

Kim Hanna
City Clerk

Publishing Dates: July 22, 2026, and July 29, 2026

**WATER MATERIALS
6-MONTH SUPPLY
BID # 2026-028WL**

I. GENERAL

The City of Tupelo will accept competitive sealed proposals until **10:00 AM, August 19, 2026**, at City Hall, 71 East Troy Street, Tupelo, Mississippi 38804. All proposals must be equal in performance and quality to the specifications.

If City Hall is closed for business at the time of the deadline, proposals will be accepted and opened on the next business day of the City, at the originally scheduled hour.

II. TECHNICAL SPECIFICATIONS & BID FORM

The City of Tupelo will be accepting proposals for Water Materials. This is a six (6) month supply bid.

Specifications

Item	Description	Equal or Equivalent to	Unit	Price
1	¾ x 3 Repair Clamp	Smith Blair 245 or Mueller 230	Each	\$5.50
2	¾ x 6 Repair Clamp	Smith Blair 245 or Mueller 230	Each	\$11.00
3	1 x 3 Repair Clamp	Smith Blair 245 or Mueller 230	Each	\$6.60
4	1 x 6 Repair Clamp	Smith Blair 245 or Mueller 230	Each	\$12.10
5	1 ½ x 3 Repair Clamp	Smith Blair 245 or Mueller 230	Each	\$6.60
6	1 ½ x 6 Repair Clamp	Smith Blair 245 or Mueller 230	Each	\$13.20
7	1 ¼ x 3 Repair Clamp	Smith Blair 245 or Mueller 230	Each	\$6.60
8	1 ¼ x 6 Repair Clamp	Smith Blair 245 or Mueller 230	Each	\$12.10
9	2 x 3 Repair Clamp	Smith Blair 245 or Mueller 230	Each	\$7.70
10	2 x 6 Repair Clamp	Smith Blair 245 or Mueller 230	Each	\$14.30
11	2 x 12 Repair Clamp	Smith Blair 245 or Mueller 230	Each	\$29.70
12	3 x 12 Emergency Clamp	Mueller 520 Series	Each	no bid
13	4 x 12 Emergency Clamp	Mueller 520 Series	Each	no bid
14	6 x 12 Emergency Clamp	Mueller 520 Series	Each	no bid
15	6 x 18 Emergency Clamp	Mueller 520 Series	Each	no bid
16	8 x 12 Emergency Clamp	Mueller 520 Series	Each	no bid
17	8 x 18 Emergency Clamp	Mueller 520 Series	Each	no bid
18	10 x 12 Emergency Clamp	Mueller 520 Series	Each	no bid
19	10 x 18 Emergency Clamp	Mueller 520 Series	Each	no bid
20	12 x 12 Emergency Clamp	Mueller 520 Series	Each	no bid
21	12 x 18 Emergency Clamp	Mueller 520 Series	Each	no bid
22	4" Tapping Valve – Less Acc	Mueller H-677	Each	\$925.20
23	6" Tapping Valve – Less Acc	Mueller H-677	Each	\$1,306.05
24	8" Tapping Valve – Less Acc	Mueller H-677	Each	\$1,939.97

JCM 110

***American
AVK***

25	10" Tapping Valve – Less Acc	Mueller H-677	Each	\$2,924.67
26	12" Tapping Valve – Less Acc	Mueller H-677	Each	\$4,416.75
27	6 x 4 Tapping Tee	Smith Blair 662	Each	no bid
28	6 x 6 Tapping Tee	Smith Blair 662	Each	no bid
29	8 x 4 Tapping Tee	Smith Blair 662	Each	no bid
30	8 x 6 Tapping Tee	Smith Blair 662	Each	no bid
31	8 x 8 Tapping Tee	Smith Blair 662	Each	no bid
32	10 x 4 Tapping Tee	Smith Blair 662	Each	no bid
33	10 x 6 Tapping Tee	Smith Blair 662	Each	no bid
34	10 x 8 Tapping Tee	Smith Blair 662	Each	no bid
35	10 x 10 Tapping Tee	Smith Blair 662	Each	no bid
36	12 x 4 Tapping Tee	Smith Blair 662	Each	no bid
37	12 x 6 Tapping Tee	Smith Blair 662	Each	no bid
38	12 x 8 Tapping Tee	Smith Blair 662	Each	no bid
39	12 x 10 Tapping Tee	Smith Blair 662	Each	no bid
40	12 x 12 Tapping Tee	Smith Blair 662	Each	no bid
41	2" Coupling	Hymax	Each	no bid
42	3" Coupling	Hymax	Each	no bid
43	4" Coupling	Hymax	Each	no bid
44	6" Coupling	Hymax	Each	no bid
45	8" Coupling	Hymax	Each	no bid
46	10" Coupling	Hymax	Each	no bid
47	12" Coupling	Hymax	Each	no bid
48	3" MJxMJ Gate Valve –Less Acc	Mueller A-2360-20	Each	\$657.10
49	4" MJxMJ Gate Valve –Less Acc	Mueller A-2360-20	Each	\$733.52
50	6" MJxMJ Gate Valve –Less Acc	Mueller A-2360-20	Each	\$936.47
51	8" MJxMJ Gate Valve –Less Acc	Mueller A-2360-20	Each	\$1,490.21
52	10" MJxMJ Gate Valve-Less Acc	Mueller A-2360-20	Each	\$2,323.32
53	12" MJxMJ Gate Valve-Less Acc	Mueller A-2360-20	Each	\$2,939.70
54	5.25 x 3' Bury Fire Hydrant	Mueller A-423	Each	no bid
55	5.25 x 3.5' Bury Fire Hydrant	Mueller A-423	Each	no bid
56	5.25 x 4' Bury Fire Hydrant	Mueller A-423	Each	no bid
57	5.25 x 4.5' Bury Fire Hydrant	Mueller A-423	Each	no bid
58	5.25 x 5' Bury Fire Hydrant	Mueller A-423	Each	no bid
59	5.25 x 5.5' Bury Fire Hydrant	Mueller A-423	Each	no bid
60	5¼" Fire Hydrant 1' Extension Kit	Mueller Super Centurion	Each	no bid
61	5¼" Fire Hydrant 1'-6" Extension Kit	Mueller Super Centurion	Each	no bid
62	5¼" Fire Hydrant 2'-6" Extension Kit	Mueller Super Centurion	Each	no bid
63	5¼" Fire Hydrant 3'-6" Extension Kit	Mueller Super Centurion	Each	no bid
64	5¼" Fire Hydrant 4' Extension Kit	Mueller Super Centurion	Each	no bid
65	5¼" Fire Hydrant Flange Repair Kit	Mueller Super Centurion	Each	no bid

66	5¼" Fire Hydrant Main Valve Repair Kit	Mueller Super Centurion	Each	no bid
67	5¼" Fire Hydrant Bonnet Repair Kit	Mueller Super Centurion	Each	no bid
ALL BRASS SHALL BE LEAD-FREE PER ASTM C89833				
68	¾" Corp Stop	A.Y. McDonald 74701 GNS	Each	\$44.12
69	¾" Curb Stop	A.Y. McDonald 76102 GNS	Each	\$51.02
70	¾" Meter Connector	A.Y. McDonald 74624 GNS	Each	\$19.50
71	¾" Copper Union	A.Y. McDonald 74758 GNS	Each	\$24.65
72	¾" Male Coupling	A.Y. McDonald 74753 GNS	Each	\$20.23
73	¾" Female Coupling	A.Y. McDonald 74754 GNS	Each	\$21.28
74	¾" Quarter Bend Union	A.Y. McDonald 74761 GNS	Each	\$31.82
75	1" Corp Stop	A.Y. McDonald 74701 GNS	Each	\$66.75
76	1" Curb Stop	A.Y. McDonald 76102 GNS	Each	\$120.49
77	1" Meter Connector	A.Y. McDonald 74624 GNS	Each	\$23.28
78	1" Copper Union	A.Y. McDonald 74758 GNS	Each	\$28.18
79	1" Male Coupling	A.Y. McDonald 74753 GNS	Each	\$23.96
80	1" Female Coupling	A.Y. McDonald 74754 GNS	Each	\$28.86
81	1" Quarter Bend Union	A.Y. McDonald 74761 GNS	Each	\$40.94
82	1½" Curb Valve	A.Y. McDonald 76101 GNS	Each	\$220.97
83	1½" Male Coupling	A.Y. McDonald 74753 GNS	Each	\$65.64
84	1½" Female Coupling	A.Y. McDonald 74754 GNS	Each	\$83.95
85	1½" Copper Union	A.Y. McDonald 74758 GNS	Each	\$94.28
86	1½" Quarter Bend Union	A.Y. McDonald 74761 GNS	Each	\$131.32
87	2" Curb Valve	A.Y. McDonald 76101 GNS	Each	\$323.16
88	2" Male Coupling	A.Y. McDonald 74753 GNS	Each	\$95.63
89	2" Female Coupling	A.Y. McDonald 74754 GNS	Each	\$99.94
90	2" Copper Union	A.Y. McDonald 74758 GNS	Each	\$127.30
91	2" Quarter Bend Union	A.Y. McDonald 74761 GNS	Each	\$265.70
92	1½" x ¾" IPS Service Saddle	A.Y. McDonald 3825	Each	no bid
93	1½" x 1" IPS Service Saddle	A.Y. McDonald 3825	Each	no bid
94	2" x ¾" IPS Service Saddle	A.Y. McDonald 3825	Each	no bid
95	2" x ¾" PVC Service Saddle	A.Y. McDonald 3845	Each	no bid
96	2" x 1" IPS Service Saddle	A.Y. McDonald 3825	Each	no bid
97	2" x 1" PVC Service Saddle	A.Y. McDonald 3845	Each	no bid
98	4" x ¾" PVC Service Saddle	A.Y. McDonald 3845	Each	\$137.29
99	4" x 1" PVC Service Saddle	A.Y. McDonald 3845	Each	\$137.29
100	4" x 1½" PVC Service Saddle	A.Y. McDonald 3845	Each	\$160.10
101	4" x 2" PVC Service Saddle	A.Y. McDonald 3845	Each	\$165.57
102	6" x ¾" DIPS Service Saddle	A.Y. McDonald 3825	Each	\$139.64
103	6" x 1" DIPS Service Saddle	A.Y. McDonald 3825	Each	\$139.64
104	6" x 1½" DIPS Service Saddle	A.Y. McDonald 3825	Each	\$159.66
105	6" x 2" DIPS Service Saddle	A.Y. McDonald 3825	Each	\$175.41
106	8" x ¾" DIPS Service Saddle	A.Y. McDonald 3825	Each	\$172.82
107	8" x 1" DIPS Service Saddle	A.Y. McDonald 3825	Each	\$172.82

108	8" x 1½" DIPS Service Saddle	A.Y. McDonald 3825	Each	\$181.93
109	8" x 2" DIPS Service Saddle	A.Y. McDonald 3825	Each	\$198.08
110	10" x 1½" DIPS Service Saddle	A.Y. McDonald 3825	Each	\$235.13
111	10" x 2" DIPS Service Saddle	A.Y. McDonald 3825	Each	\$252.53
112	12" x 1½" DIPS Service Saddle	A.Y. McDonald 3825	Each	\$282.61
113	12" x 2" DIPS Service Saddle	A.Y. McDonald 3825	Each	\$287.71

General Bidders Requirements/Information

1. The City of Tupelo reserves the right to reject any and all bids, to waive any informalities in the bid, or award the bid to whomsoever they may choose.
2. The specifications, as stated, are minimum requirements and may be exceeded by the bidder. However, no additional consideration shall be given for exceeding the minimum requirements and all bids will be evaluated against the specifications set forth in this bid package.
3. Manufacturer's part or item numbers are shown only to describe the item and to determine the level of acceptable quality. Other manufacturer's "equal" items may be bid. The acceptance of "equal" items lies with the Council of the City of Tupelo whose decision shall be final. All items shall be delivered FOB to the location specified on the purchase request in Tupelo, Mississippi 38801.
4. All bid prices shall be net, FOB destination, with transportation charges prepaid by vendor.
5. The bid solicitation is for a supply contract of six (6) months with the City to have the option, at the end of the initial six (6) month period, to renew the contract for an additional six (6) months with no price increase if agreeable with vendor.
6. All items will be ordered on an as needed basis during the life of the contract(s) resulting from this bid process. Minimum order quantities shall be for truckload quantities.
7. No bidder is required to bid on all items. However, the successful bidder(s) shall be determined by item compliance to minimum specifications requirements.
8. Delivery will be a consideration in the awarding of this bid.
9. The burden of proof of specifications is the responsibility of the bidder.

III. QUESTIONS

Failure to examine any specifications and instructions will be at bidder's risk. All procedural and technical questions, or if the attached specifications are incomplete, not clear, or not standardized, shall be made in writing and addressed to the following.

General questions regarding this request should be directed to Kim Hanna, City Clerk, at the City of Tupelo, 71 East Troy Street, Tupelo, MS 38804. The phone number is 662-841-6502 Ext: 109.

Email: kim.hanna@tupeloms.gov

For questions concerning the technical specifications, prospective bidders may contact Drew Kyle, Tupelo Water & Light Department. The phone number is 662-841-6460. Email: drew.kyle@tupeloms.gov

Questions regarding the website or electronic bidding should be directed to Plan House at 662-407-0193 or admin@phbidding.com.

No oral explanations by any member of the city staff will be binding. Receipt of addenda must be acknowledged in writing. Submitting vendors shall be responsible for ensuring that they have received any and all addenda.

IV. OPENING:

Proposal openings, whether electronic or traditional paper method, shall be conducted any time after they are received and shall be conducted by at least two procurement officials. From that point forward, proposals will be considered under advisement. City of Tupelo may conduct written or oral discussions with potential bidders.

The City of Tupelo reserves the right to determine responsive offers or proposals, waive minor informalities in the process, to reject any and all offers or proposals, and to invite priced bids from those companies believed most advantageous to the City.

BIDDER INFORMATION FORM

**WATER MATERIALS
6-MONTH SUPPLY
BID# 2026-028WL**

The undersigned proposes to provide water materials which meet the specifications provided. The undersigned certifies that the minimum specifications, terms and conditions contained in this BID have been considered and understood. By submitting a proposal, I/We do certify that the commodities offered do meet the specifications contained in this Invitation to Bid.

BIDDER ACKNOWLEDGES receipt of the following ADDENDA:

NUMBER: _____ DATE: _____
NUMBER: _____ DATE: _____
NUMBER: _____ DATE: _____

BIDDER INFORMATION:

Company Name: Southern Waterworks Supply, Inc. (601-268-7463)

Company Representative: Zackary Guelker (zack@southernwaterworks.com)

Title: Sales

Business Address:

Street: 429 Cole Road

City: Hattiesburg State: MS Zip: 39402

Signature of Bidder: Zackary Guelker

Date: 8/18/2026

JCM INDUSTRIES

P. O. Box 1220, Nash, TX 75569-1220

Phone 800-527-8482 or 903-832-2581

Fax 800-874-9524 or 903-838-6260


www.jcmindustries.com

Typical Specification

JCM 110 Patch Clamp

All circumferential single band repair clamps 1/2" and larger shall have a minimum material standard of certifiable prime 304 stainless steel band; low profile Ductile Iron Lugs per ASTM A536; lug shall be drop-in design with open receiver slot; replaceable, track head electro-galvanized steel bolt, nut and washer, and a gridded gasket. Clamps 1/2" thru 2" shall have lug to lug gasket. Clamps shall be JCM 110 Patch Clamp or approved equal.

JCM 100 Series Universal Clamp Couplings are ANSI/NSF Standard 61, Annex G and ANSI/NSF Standard 372 Certified.

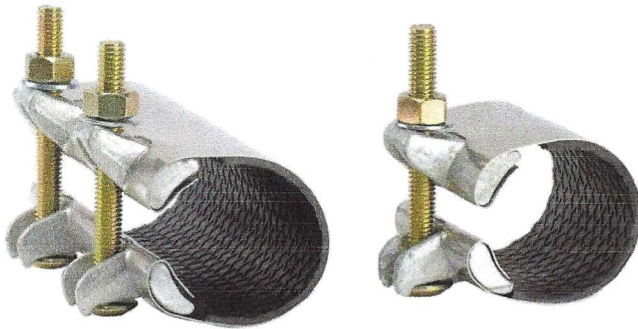

JCM 110 Patch Clamps
6" width and 3" width

This typical specification, provided by JCM Industries, is a proposed guideline for use by specifying agencies to ensure significant design and material features of this product are included within the agencies' individual specifications.



Effective 01.30.19

JCM INDUSTRIES

P. O. Box 1220, Nash, TX 75569-1220

Phone 800-527-8482 or 903-832-2581

Fax 800-874-9524 or 903-838-6260

www.jcmindustries.com

Material Specification

JCM 110 Patch Clamp

- LUG:** Ductile Iron ASTM A-536.
Optional CF8 Stainless Steel, equal to 304.
- GASKET:** Nitrile Butadiene Rubber (NBR, Buna-N) per ASTM D2000. Molded virgin rubber for natural gas, oil, mild acids, bases, water and sewage. Gasket temperature range -40°F to 180°F (-40°C – 82°C). For applications on high temperatures or chemical pipelines, contact JCM Industries Technical Services.
- BAND:** 18-8 Type 304 Stainless Steel
- HARDWARE:** Electro-galvanized Steel.
Optional Stainless Steel available.

JCM 100 Series Universal Clamp Couplings are ANSI/NSF Standard 61, Annex G and ANSI/NSF Standard 372 Certified.

AMERICAN AVK RESILIENT SEATED DUCTILE IRON GATE VALVE
250/350 PSI, Tested to AWWA C509 / C515 (NRS)
Mechanical Joint Ends - Valve Sizes 3" - 16"

45/MMN-WD
MJxMJ

Use:

For water and neutral liquids to maximum 160°F.

Tests:

Hydraulic test to AWWA C509:

Shell Test: 700 PSI 3"-12"

Seat Test: 350 PSI 3"-12"

Shell Test: 500 PSI 14"-16"

Seat Test: 250 PSI 14"-16"

Operating Torque Test

Optional Materials:

Wedge	Ductile iron ASTM A536 encapsulated with NBR-rubber compound
-------	--

Stem	304 stainless steel
------	---------------------

Standard Materials:

Body, Bonnet, Gland Flange, Wrench Nut	Ductile iron ASTM A536 (Wrench Nut-painted black for open left, red for open right)
--	---

Coating	Electrostatically applied fusion- bonded epoxy-resin Meets or exceeds AWWA C550
---------	---

Stem	Standard: Stainless steel 430F
------	--------------------------------

Wedge	Ductile iron ASTM A536 encapsulated with EPDM-rubber compound
-------	---

Wedge Nut, Thrust Collar	Bronze
--------------------------	--------


Bonnet Bolts	Stainless Steel - 316 sealed with hot melt
--------------	---

Gland Bolts	Stainless Steel - 316 Hexagon bolt
-------------	---------------------------------------

Bonnet Gasket, Wiper Ring, O-Ring Stem Seals, O-Ring Gland Seal	ASTM D2000 Buna "N" nitrile rubber
--	---------------------------------------

Approvals:

Certified to: ANSI/NSF 61, ANSI/NSF 372

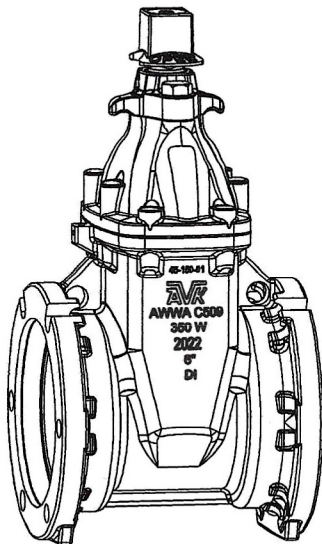


AMERICAN AVK RESILIENT SEATED DUCTILE IRON GATE VALVE
250/350 PSI, Tested to AWWA C509 / C515 (NRS)
Mechanical Joint End - Valve Sizes 3" - 16"

45/MMN-WD
MJxMJ

Component List:

217. Bonnet	227. Gland Flange Bolt	232. Lower Stem Seal O-Ring
218. Bonnet Gasket	228. Gland Flange	233. NRS Stem
219. Body	229. Gland O-Ring	234. Thrust Collar
225. Wrench Nut	230. Upper Stem Seal O-Rings	237. Wedge
226. Wiper Ring	231. Stem Seal Bushing	

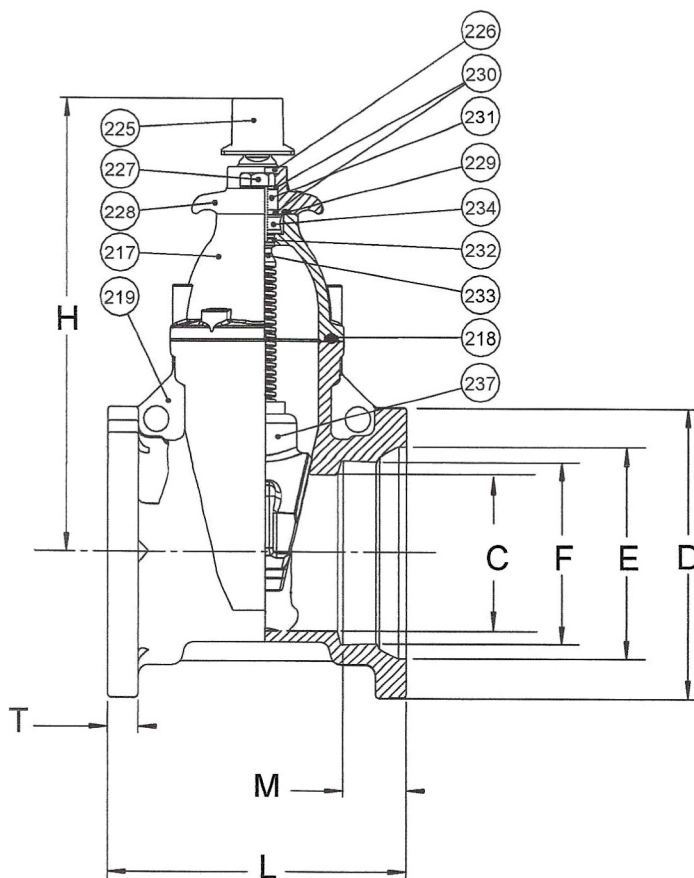

Ref No.	Size	Working Pressure	C	D	E	F	H	L	M	T	Turns to Open	Weight (lbs.)
45-080-MMN-WD	3"	350	3.25"	7.69"	4.96"	4.07"	12.09"	8.50"	2.50"	0.95"	12	43
45-100-MMN-WD	4"	350	4.25"	9.12"	6.00"	4.90"	13.50"	10.00"	2.50"	1.00"	14	62
45-150-MMN-WD	6"	350	6.25"	11.12"	8.12"	7.00"	17.50"	11.50"	2.50"	1.18"	21	103
45-200-MMN-WD	8"	350	8.25"	13.37"	10.27"	9.15"	21.50"	11.50"	2.50"	1.24"	26	155
45-250-MMN-WD	10"	350	10.25"	15.69"	12.34"	11.20"	24.75"	13.00"	2.50"	1.14"	32	240
45-300-MMN-WD	12"	350	12.25"	17.88"	14.44"	13.30"	27.63"	14.00"	2.50"	1.22"	38	337
45-350-MMN-WD	14"	250	14.00"	20.31"	16.61"	15.50"	35.75"	17.95"	3.50"	1.32"	51	794
45-400-MMN-WD	16"	250	16.00"	22.56"	18.64"	17.54"	34.75"	18.00"	3.50"	1.34"	54	800



AMERICAN AVK RESILIENT SEATED DUCTILE IRON GATE VALVE 45/MFN-WD
250/350 PSI, Tested to AWWA C509 / C515 (NRS)
Mechanical Joint by Flanged Ends to ASME B16.42 Class 150 - Valve Sizes 3" - 16"
MJxFL

Use:

For water and neutral liquids to maximum 160°F.

Tests:

Hydraulic test to AWWA C509:

Shell Test: 700 PSI 3"-12"

Seat Test: 350 PSI 3"-12"

Shell Test: 500 PSI 14"-16"

Seat Test: 250 PSI 14"-16"

Operating Torque Test

Optional Materials:

Wedge Ductile iron ASTM A536
encapsulated with NBR-rubber
compound

Stem 304 stainless steel

Standard Materials:

Body, Bonnet, Ductile iron ASTM A536
Gland Flange, (Wrench Nut-painted black for
Wrench Nut open left, red for open right)

Coating Electrostatically applied fusion-
bonded epoxy-resin
Meets or exceeds AWWA C550

Stem Standard: Stainless steel 430F

Wedge Ductile iron ASTM A536
encapsulated with EPDM-rubber
compound

Wedge Nut, Thrust Collar Bronze


Bonnet Bolts Stainless Steel - 316 sealed with
hot melt

Gland Bolts Stainless Steel - 316
Hexagon bolt

Bonnet Gasket, ASTM D2000 Buna "N" nitrile
Wiper Ring, rubber
O-Ring Stem Seals,
O-Ring Gland Seal

Approvals:



Certified to: ANSI/NSF 61, ANSI/NSF 372

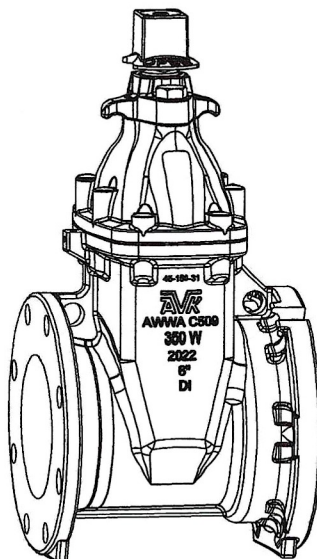

AMERICAN AVK RESILIENT SEATED DUCTILE IRON GATE VALVE 45/MFN-WD
250/350 PSI, Tested to AWWA C509 / C515 (NRS)
MJxFL
Mechanical Joint by Flanged Ends to ASME B16.42, Class 150 - Valve Sizes 3" - 16"

Component List:

217. Bonnet	227. Gland Flange Bolt	232. Lower Stem Seal O-Ring
218. Bonnet Gasket	228. Gland Flange	233. NRS Stem
219. Body	229. Gland O-Ring	234. Thrust Collar
225. Wrench Nut	230. Upper Stem Seal O-Rings	237. Wedge
226. Wiper Ring	231. Stem Seal Bushing	

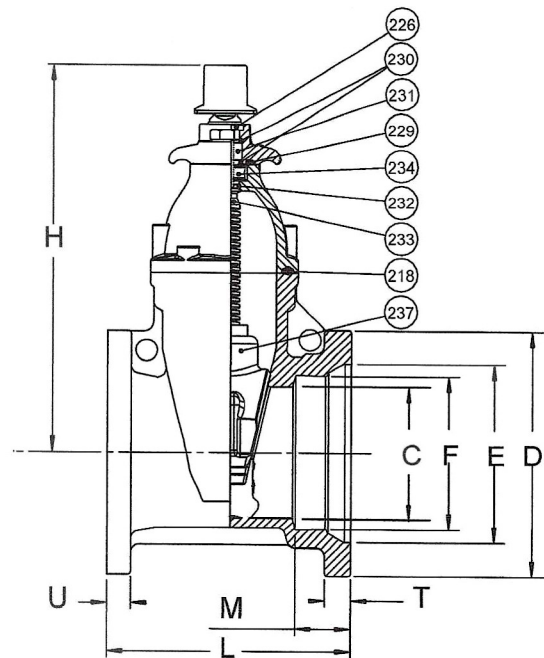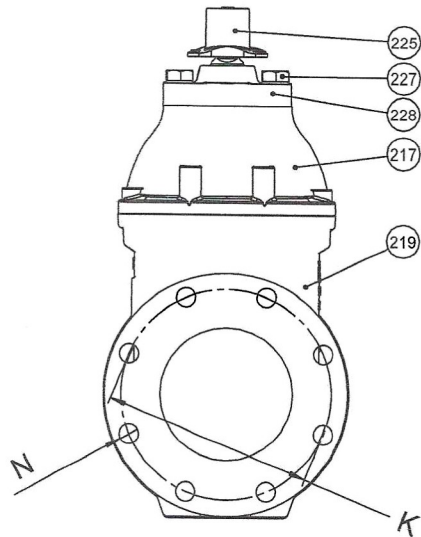

Ref No.	Size	Working Pressure	C	D	E	F	K	H	L	M	N	T	U	Flange Holes	Turns to Open	Wt. (lbs.)
45-080-MFN-WD	3"	350	3.25"	7.69"	4.96"	4.08"	6.00"	12.09"	9.0"	2.50	0.75"	1.00"	0.88"	4	12	43
45-100-MFN-WD	4"	350	4.25"	9.12"	6.02"	4.90"	7.50"	13.50"	9.0"	2.50	0.75"	1.00"	1.00"	8	14	62
45-150-MFN-WD	6"	350	6.25"	11.12"	8.12"	7.00"	9.50"	17.50"	10.50"	2.50	0.88"	1.18"	1.06"	8	20	103
45-200-MFN-WD	8"	350	8.25"	13.37"	10.27"	9.15"	11.75"	21.50"	11.50"	2.50	0.88"	1.24"	1.14"	8	26	155
45-250-MFN-WD	10"	350	10.25"	15.69"	12.34"	11.20"	14.25"	24.75"	13.00"	2.50	1.00"	1.14"	1.22"	12	32	240
45-300-MFN-WD	12"	350	12.25"	17.88"	14.44"	13.30"	17.00"	27.63"	14.00"	2.50	1.00"	1.22"	1.30"	12	38	337
45-350-MFN-WD	14"	250	14.00"	20.31"	16.61"	15.50"	18.75"	35.75"	17.50"	3.50	1.13"	1.32"	1.40"	12	51	840
45-400-MFN-WD	16"	250	16.00"	22.56"	18.64"	17.54"	21.25"	34.75"	17.00"	3.50	1.13"	1.34"	1.44"	16	54	820

