



FIELD INSTALLED VIBRATION DAMPENER

INSTALLATION PROCEDURE:

CAUTION: BEFORE INSTALLATION, POWER TO THE POLE SHOULD BE DISCONNECTED AND AN INSPECTION MADE BY AN AUTHORIZED ELECTRICIAN TO ENSURE THAT THE WIRING AND ELECTRICAL COMPONENTS WILL ALLOW FOR EASY AND SAFE INSERTION OF THE DAMPENING SYSTEM. ITEMS SUCH AS TERMINAL BLOCK AND FUSE ASSEMBLIES MAY REQUIRE TEMPORARY REMOVAL.

1. REMOVE THE HANDHOLE DOOR FROM THE POLE IN WHICH THE DAMPENER IS TO BE INSERTED.
2. INSERT ONE END OF THE DAMPENER INTO THE POLE THROUGH THE HANDHOLE OPENING.
3. PUSH THE DAMPENER INTO THE POLE. (THE DAMPENER WILL "SNAKE" UP INSIDE THE POLE)
4. WHEN THE DAMPENER IS FULLY INSERTED, IT WILL SLIP DOWN TO REST ON THE FOUNDATION. IT IS **IMPORTANT** THAT THE DAMPENER BE LOWERED SLOWLY, WITH THE BOTTOM END HELD TIGHTLY TO ONE SIDE IN ORDER TO PREVENT DAMAGE TO THE ELECTRICAL COMPONENTS.
5. RETURN THE HANDHOLE DOOR TO THE POLE.

CAUTION: ELECTRICAL INSPECTION IS AGAIN REQUIRED TO CHECK THE SYSTEM AND VERIFY SAFE OPERATION.

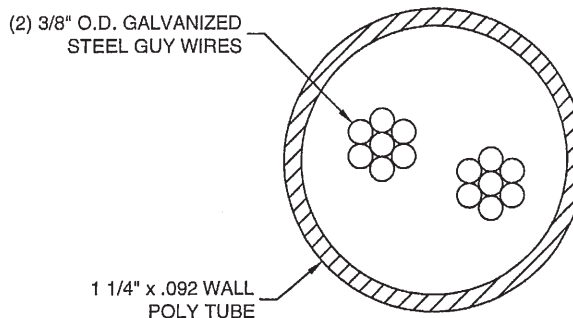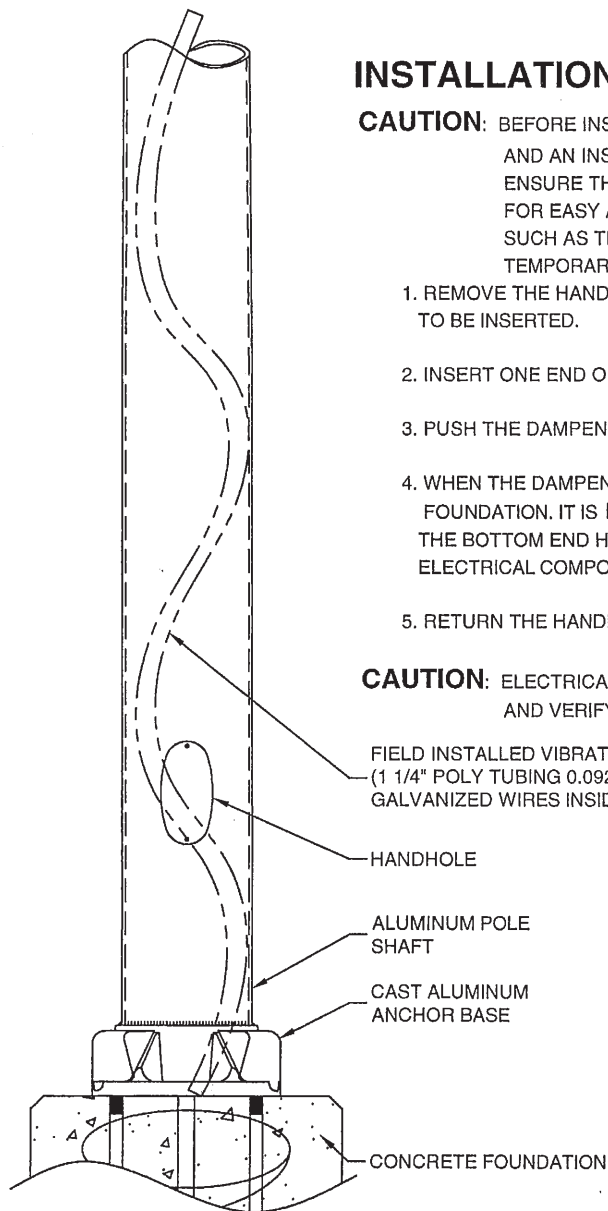

VIBRATION DAMPENER CROSS SECTION