

THIS DRAWING AND ALL INFORMATION CONTAINED HEREIN IS THE EXCLUSIVE PROPERTY OF FISHER AND ASSOCIATES, LLC. IT IS NOT TO BE COPIED OR USED IN ANY WAY WITHOUT THE WRITTEN APPROVAL OF FISHER AND ASSOCIATES, LLC. ANY REQUEST FOR REPRINTS UPON REQUEST. THIS DRAWING IS NOT FOR GENERAL USE OR PUBLICATION. ALL RIGHTS RESERVED.


TO THE BEST OF MY KNOWLEDGE, THE SPECIFICATIONS AND PLANS SHOWN HEREIN COMPLY WITH THE APPLICABLE MINIMUM BUILDING CODES IN EFFECT AT THIS TIME.

FISHER AND ASSOCIATES, LLC.  
ARCHITECTS  
PLANNERS  
INTERIOR DESIGNERS  
235 BELLEAIR RD, CLEARWATER, FL 33764 (727) 443-4436  
AA2800738

**PHOTOMETRIC SITE PLAN  
PUBlix AT WESTLAKE PLAZA  
SWC OF SEMINOLE PRATT WHITNEY RD  
and PERIMMUN BLVD  
CITY OF WEST LAKE, PALM BEACH COUNTY, FL**

RELEASED FOR:  
 BID  
 PERMIT  
 CONSTR.

REVISIONS:

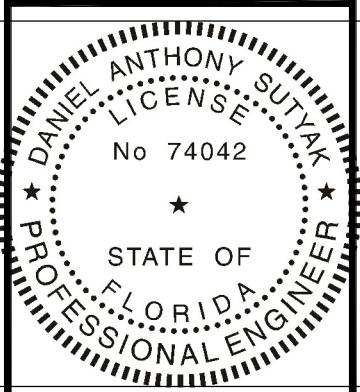Consulting Engineers, Inc.  
Engineering Business No. 9021  
Daniel Anthony Sutayak  
P.E. No.74042

4750 East Adamo Drive  
Tampa, Florida 33605  
Tel: 813-241-2525  
www.colwillengineering.com  
©2020 ALL RIGHTS RESERVED

EP1.1

Copyright 2020

Issue Date: 08.21.20

Project No.: 220016

**NOT FOR CONSTRUCTION**



Consulting Engineers, Inc.  
Engineering Business No. 9021

Daniel Anthony Sutayak  
P.E. No.74042


4750 East Adamo Drive  
Tampa, Florida 33605  
Tel: 813-241-2525  
www.colwillengineering.com  
©2020 ALL RIGHTS RESERVED

EP1.1

Copyright 2020

Issue Date: 08.21.20

Project No.: 220016

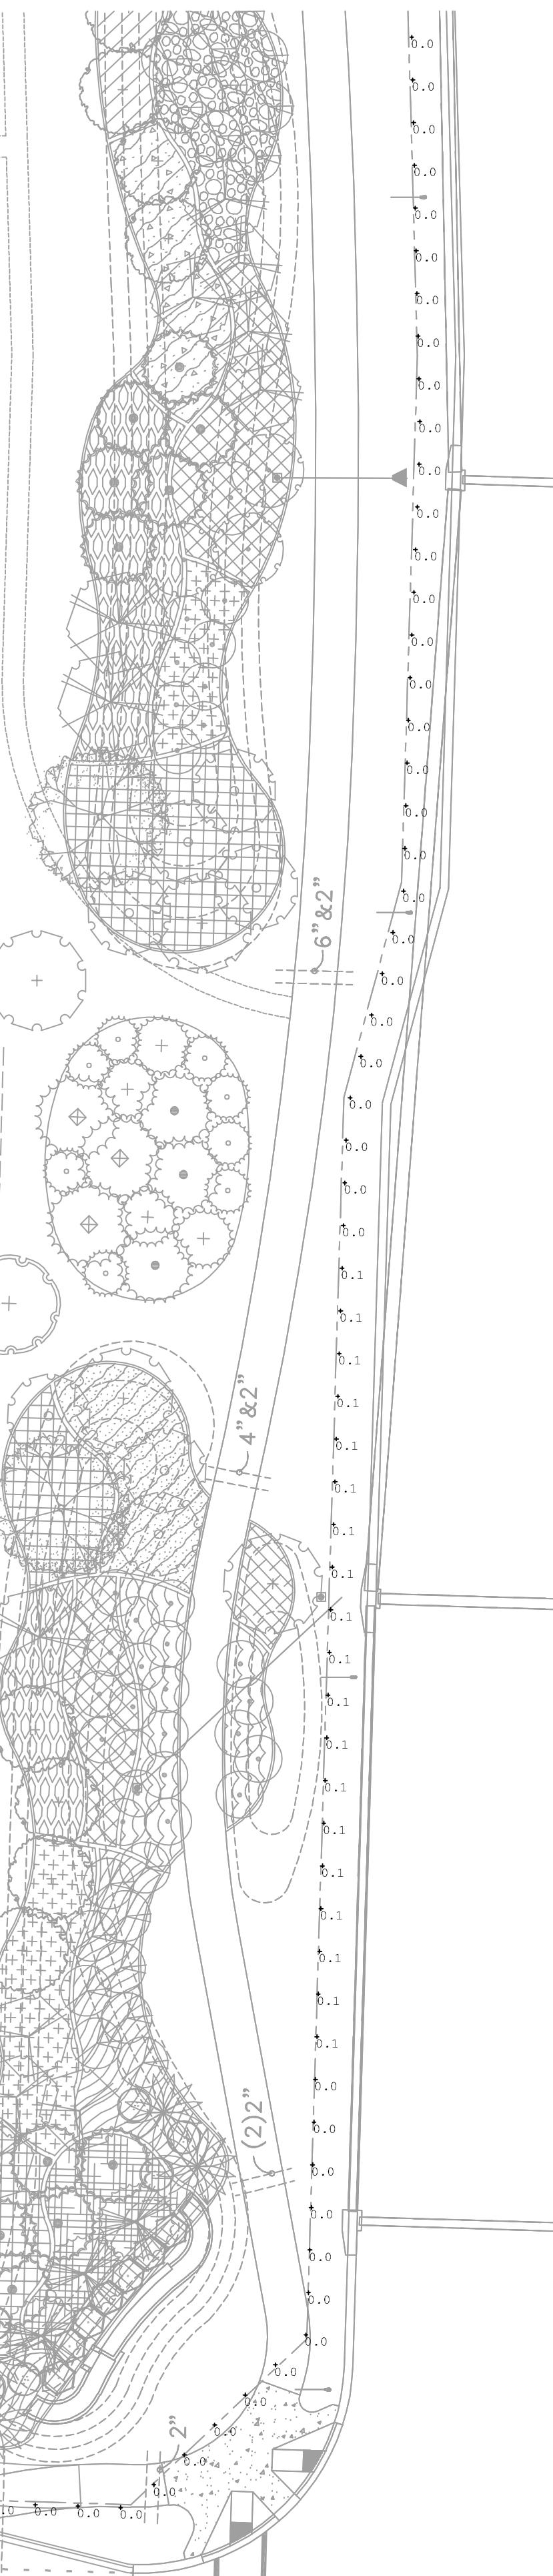


Calculation Summary						
Label	Units	Avg	Max	Min	Avg/Min	Max/Min
Boudary Line	Fc	0.10	1.3	0.0	N.A.	N.A.
Entry Drives_1	Fc	3.24	6.4	1.1	2.95	5.82
Parking Area	Fc	5.38	10.7	1.8	2.99	5.94

This item has been digitally signed and sealed by Daniel A. Sutayak, PE on the date adjacent to the seal.  
Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

**PHOTOMETRIC SITE PLAN**  
SCALE: 1"=30'-0"



Luminaire Schedule			
Symbol	Tag	LLF	Description
□	S1	0.950	VP-L-96L-280-4K7-2-BC
□	S2	0.950	VP-L-96L-280-4K7-5QM
□	S3	0.950	VP-L-96L-280-4K7-5W
□	S4	0.950	VP-L-96L-280-4K7-4
□	S5	0.950	VP-L-96L-280-4K7-4-BC

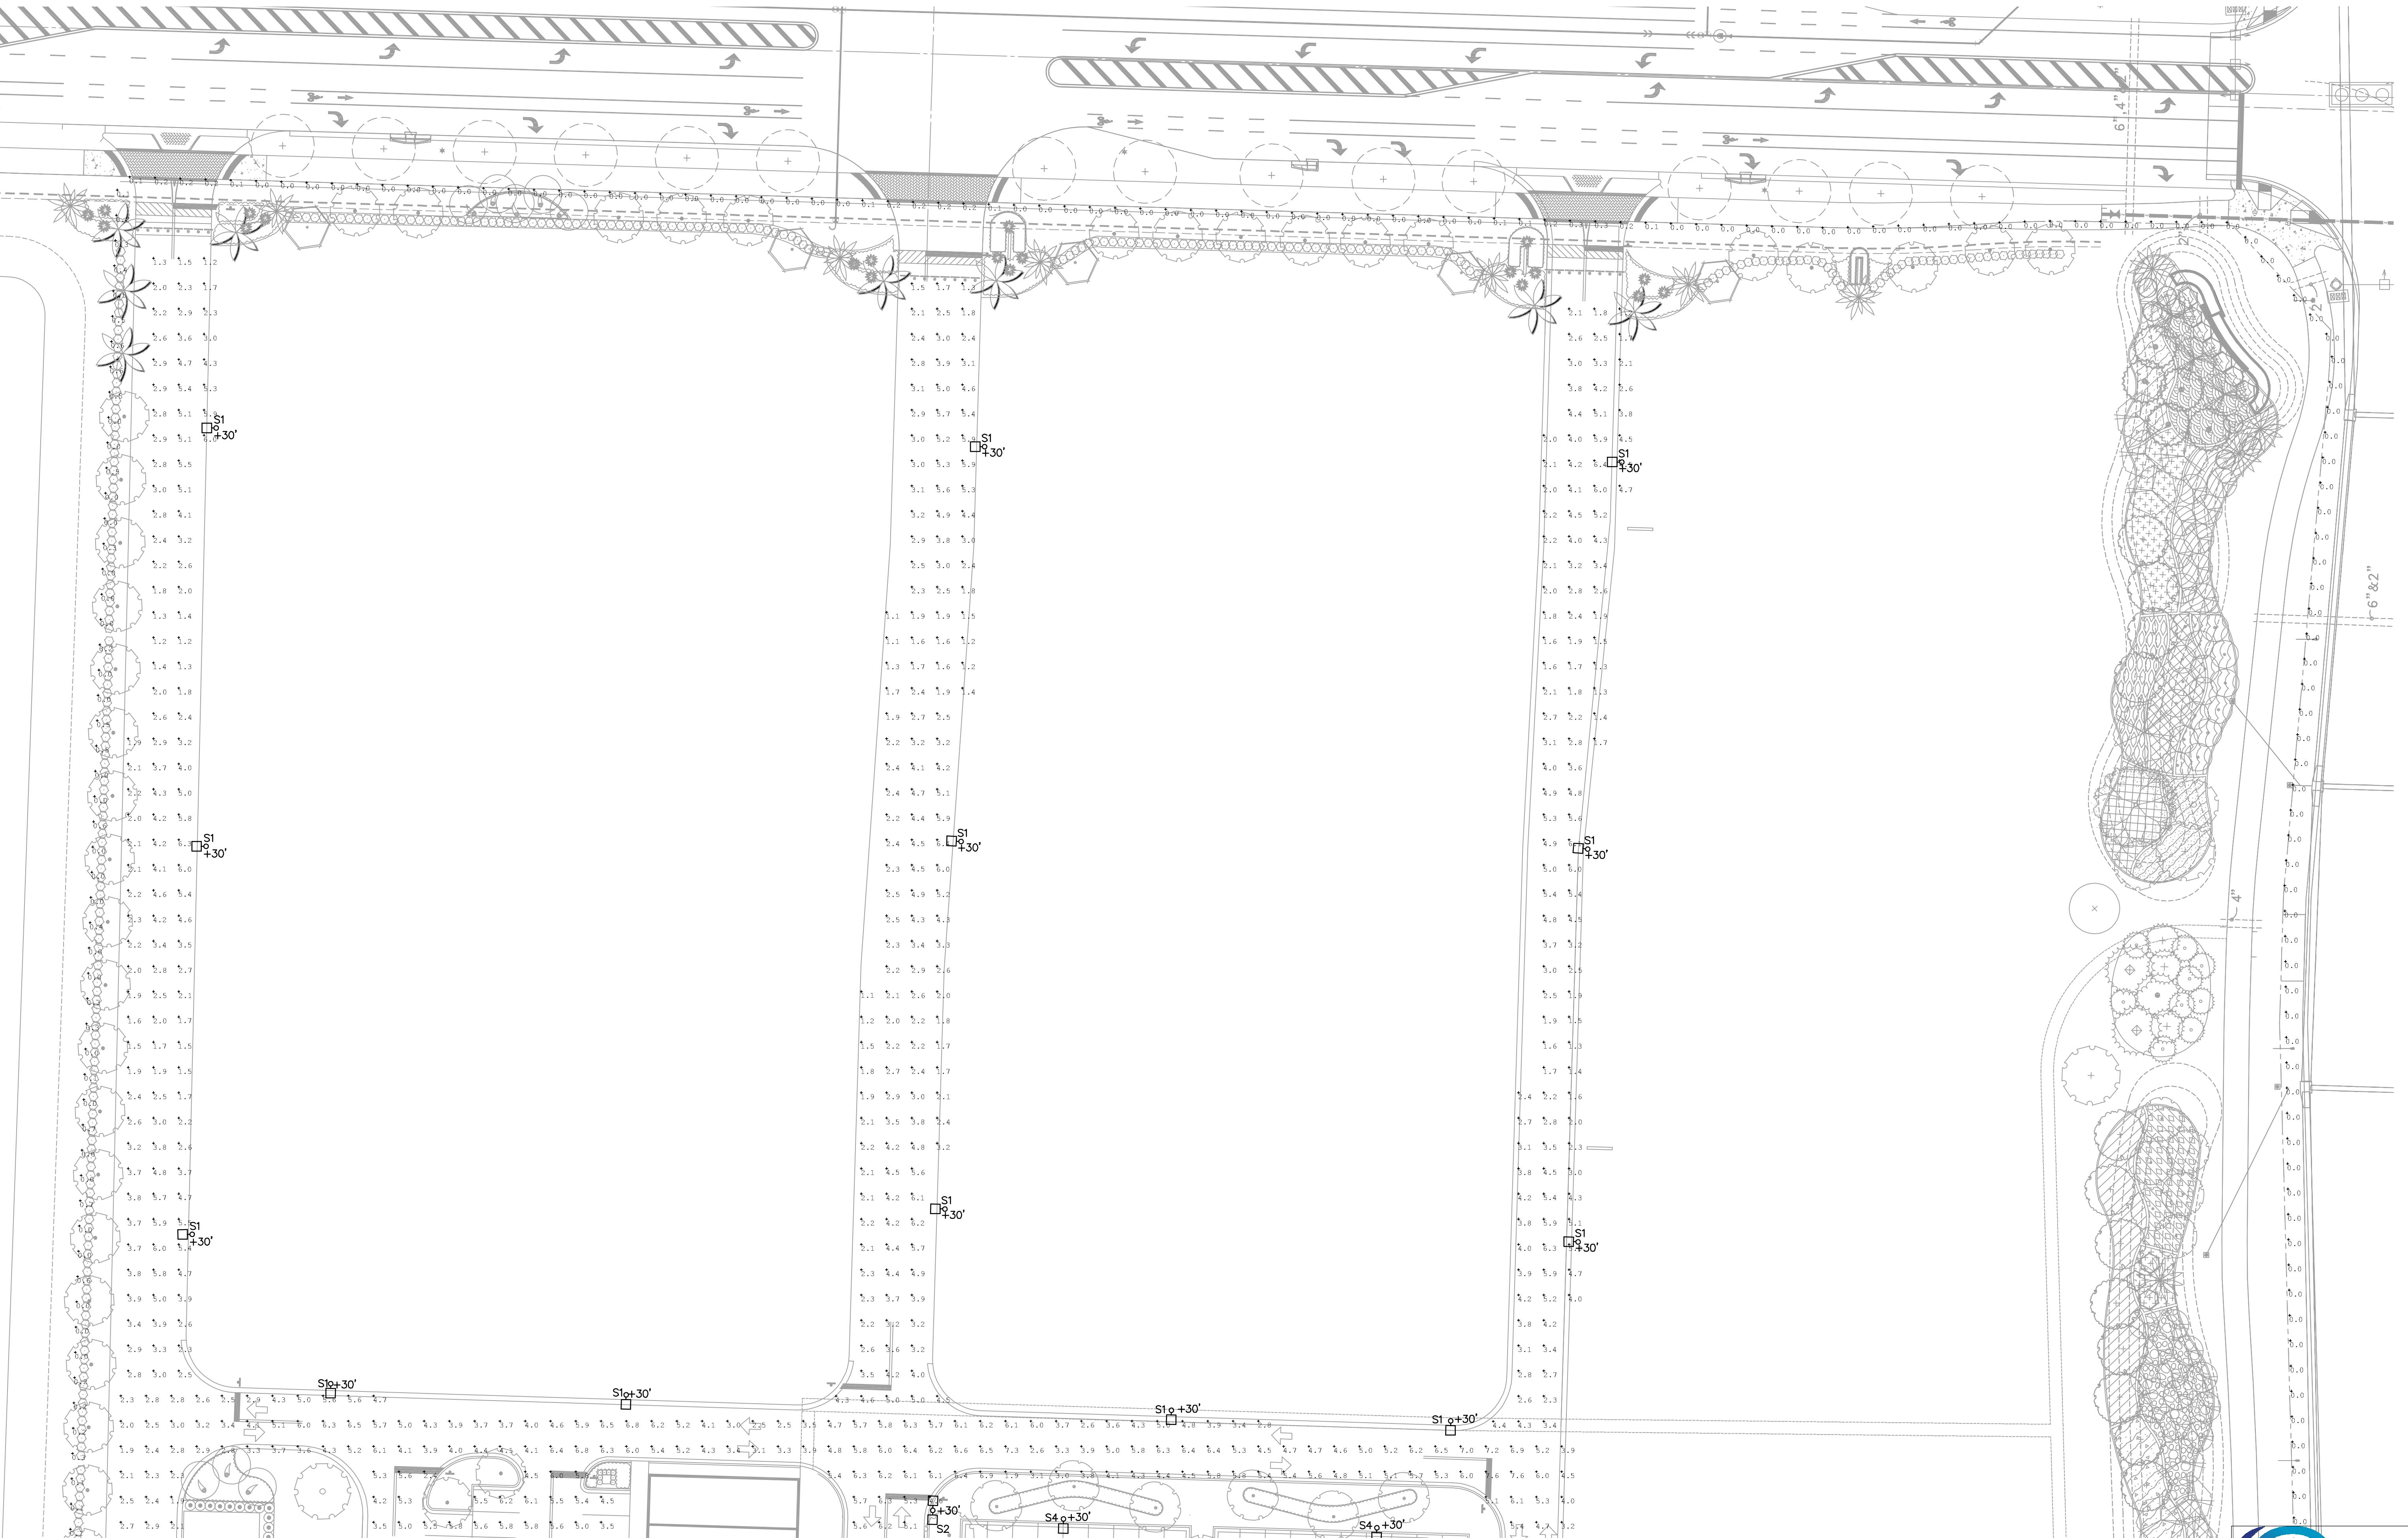


Luminaire Schedule			
Symbol	Tag	LLF	Description
□	S1	0.950	VP-L-96L-280-4K7-2-BC
□	S2	0.950	VP-L-96L-280-4K7-5QM
□	S3	0.950	VP-L-96L-280-4K7-5W
□	S4	0.950	VP-L-96L-280-4K7-4
□	S5	0.950	VP-L-96L-280-4K7-4-BC

 PHOTOMETRIC SITE PLAN  
SCALE: 1"=30'-0"

Calculation Summary						
Label	Units	Avg	Max	Min	Avg/Min	Max/Min
Boundary Line	Fc	0.10	1.3	0.0	N.A.	N.A.
Entry Drives_1	Fc	3.24	6.4	1.1	2.95	5.82
Parking Area	Fc	5.38	10.7	1.8	2.99	5.94

This item has been digitally signed and sealed by Daniel A. Sutayak, PE on the date adjacent to the seal.  
Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

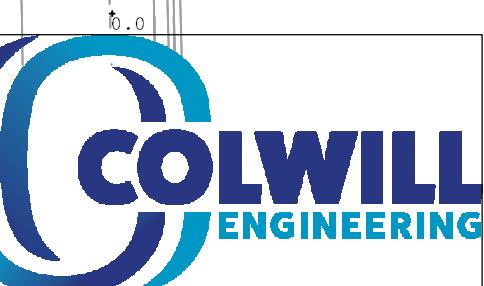

Consulting Engineers, Inc.  
Engineering Business No. 9021  
Daniel Anthony Sutayak  
P.E. No. 74042

4750 East Adamo Drive  
Tampa, Florida 33605  
Tel: 813-241-2525  
www.colwillengineering.com

©2020 ALL RIGHTS RESERVED  
Job Number: 58383

NOT FOR CONSTRUCTION  
Copyright 2020  
Issue Date: 08.21.20  
Project No.: 220016

FISHER AND ASSOCIATES, LLC.  
ARCHITECTS  
PLANNERS  
INTERIOR DESIGNERS



PHOTOMETRIC SITE PLAN  
PUBlix AT WESTLAKE PLAZA  
SWC OF SEMINOLE PRATT WHITNEY RD  
and PERSIMMON BLVD  
CITY OF WEST LAKE, PALM BEACH COUNTY, FL

RELEASED FOR:  
BID \_\_\_\_\_  
PERMIT \_\_\_\_\_  
CONSTR. \_\_\_\_\_

REVISIONS:


DANIEL ANTHONY SUTAYAK  
LICENSURE NO. 74042  
STATE OF FLORIDA  
PROFESSIONAL ENGINEER

EP1.2  
Copyright 2020  
4750 East Adamo Drive  
Tampa, Florida 33605  
Tel: 813-241-2525  
www.colwillengineering.com  
©2020 ALL RIGHTS RESERVED  
Job Number: 58383

THIS DRAWING AND ALL INFORMATION CONTAINED HEREIN IS THE EXCLUSIVE PROPERTY OF FISHER AND ASSOCIATES, AND IS NOT TO BE COPIED OR USED IN ANY WAY WITHOUT THE WRITTEN CONSENT OF FISHER AND ASSOCIATES. THIS DRAWING IS NOT TO BE REOPENED UPON REQUEST, NOR IS IT TO BE REFERRED TO FOR GENERAL USE OR PUBLICATION. ALL RIGHTS RESERVED.  
TO THE BEST OF MY KNOWLEDGE, THE SPECIFICATIONS AND PLANS SHOWN HEREIN COMPLY WITH THE APPLICABLE MINIMUM BUILDING CODES IN EFFECT AT THIS TIME.

THIS DRAWING AND ALL INFORMATION CONTAINED HEREIN IS THE EXCLUSIVE PROPERTY OF FISHER AND ASSOCIATES, LLC. IT MAY NOT BE COPIED OR USED IN ANY WAY WITHOUT THE WRITTEN CONSENT OF THE OWNER. THIS DRAWING IS PROVIDED FOR GENERAL USE OR REFERENCE ONLY. THIS DRAWING IS NOT FOR GENERAL USE OR PUBLICATION. ALL RIGHTS RESERVED.

TO THE BEST OF MY KNOWLEDGE, THE SPECIFICATIONS AND PLANS SHOWN HEREIN COMPLY WITH THE APPLICABLE MINIMUM BUILDING CODES IN EFFECT AT THIS TIME.

FISHER AND ASSOCIATES, LLC.

PLANNERS


ARCHITECTS

INTERIOR DESIGNERS



## PHOTOMETRIC DETAILS PUBlix AT WESTLAKE PLAZA SWC OF SEMINOLE PRATT WHITNEY RD and PERIMMON BLVD CITY OF WEST LAKE, PALM BEACH COUNTY, FL

NOT FOR CONSTRUCTION

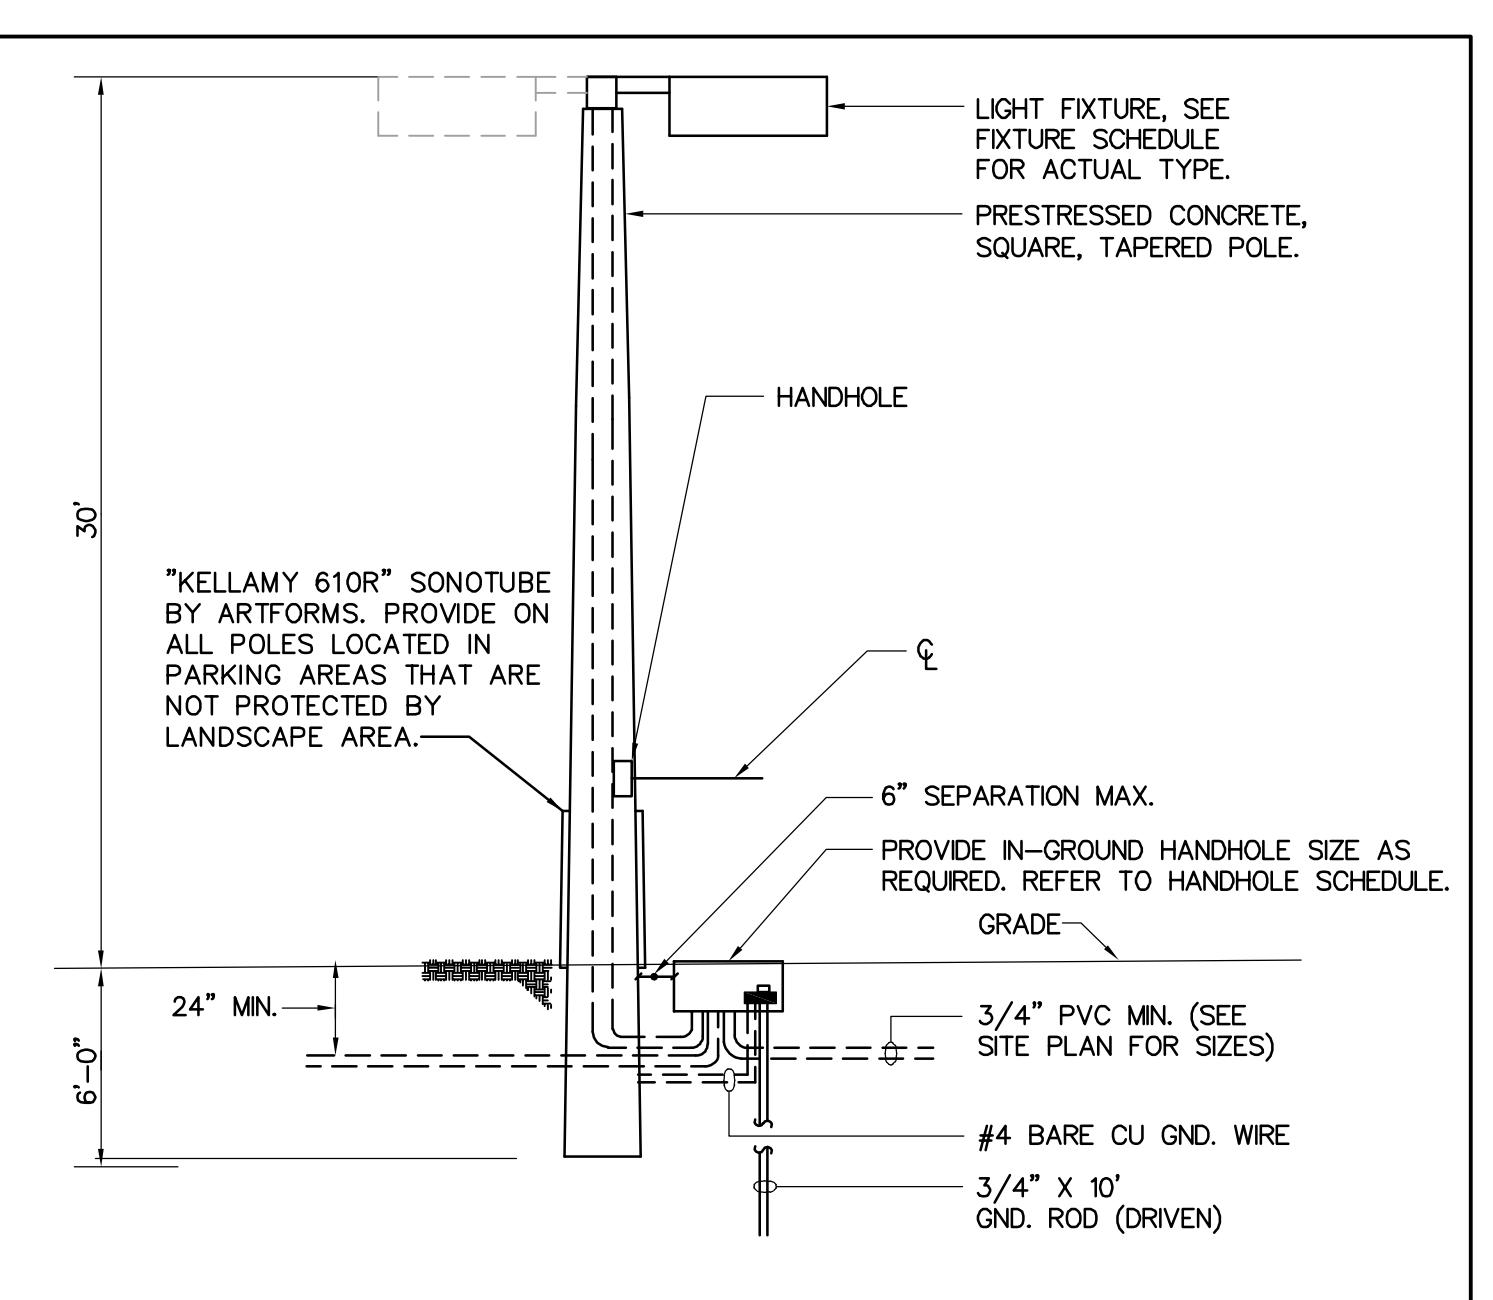


### PARKING LOT CONCRETE POLE DETAIL

SCALE: NONE

#### GENERAL NOTES

- At each pole location, the contractor shall provide a 3/4" x 10' copper clad ground rod connected to a #4 bare copper conductor, cast in pole, extended to tenon slip fitter. Equipment grounding conductors shall also be bonded to the ground rod. All connections to the ground rod shall be by exothermic weld connection.
- All poles are to be provided with hand holes (minimum 3" x 5").
- Provide all hardware necessary to complete the intended installation.
- Contractor shall be required to submit calculations from the pole manufacturer, sealed by a structural engineer licensed in the state of Florida, to certify conformance of each entire pole and fixture assembly to the following standards:
  - 90 MPH in accordance with AASHTO specifications.
  - 150 MPH in accordance with calculations dictated in the Florida Building Code.
- Contractor is to furnish and install in-line ballast fuses in Busmann "TRON" weatherproof fuse holders #HEB-series with KTK fuses (size as required). Fuse each luminaire separately. Locate fuses in handhole of pole.
- An in-ground handhole shall be installed at every pole location whether or not indicated on the drawings. The handhole shall be sized to contain all connector kits and ground rods. All connections in handhole shall be made with waterproof snap-lock gel-filled connector kits equal to CMC #DSR2/0 or Raychem #GTAP-2 and King "dry-conn" wire nuts for fuse to fixture connection.

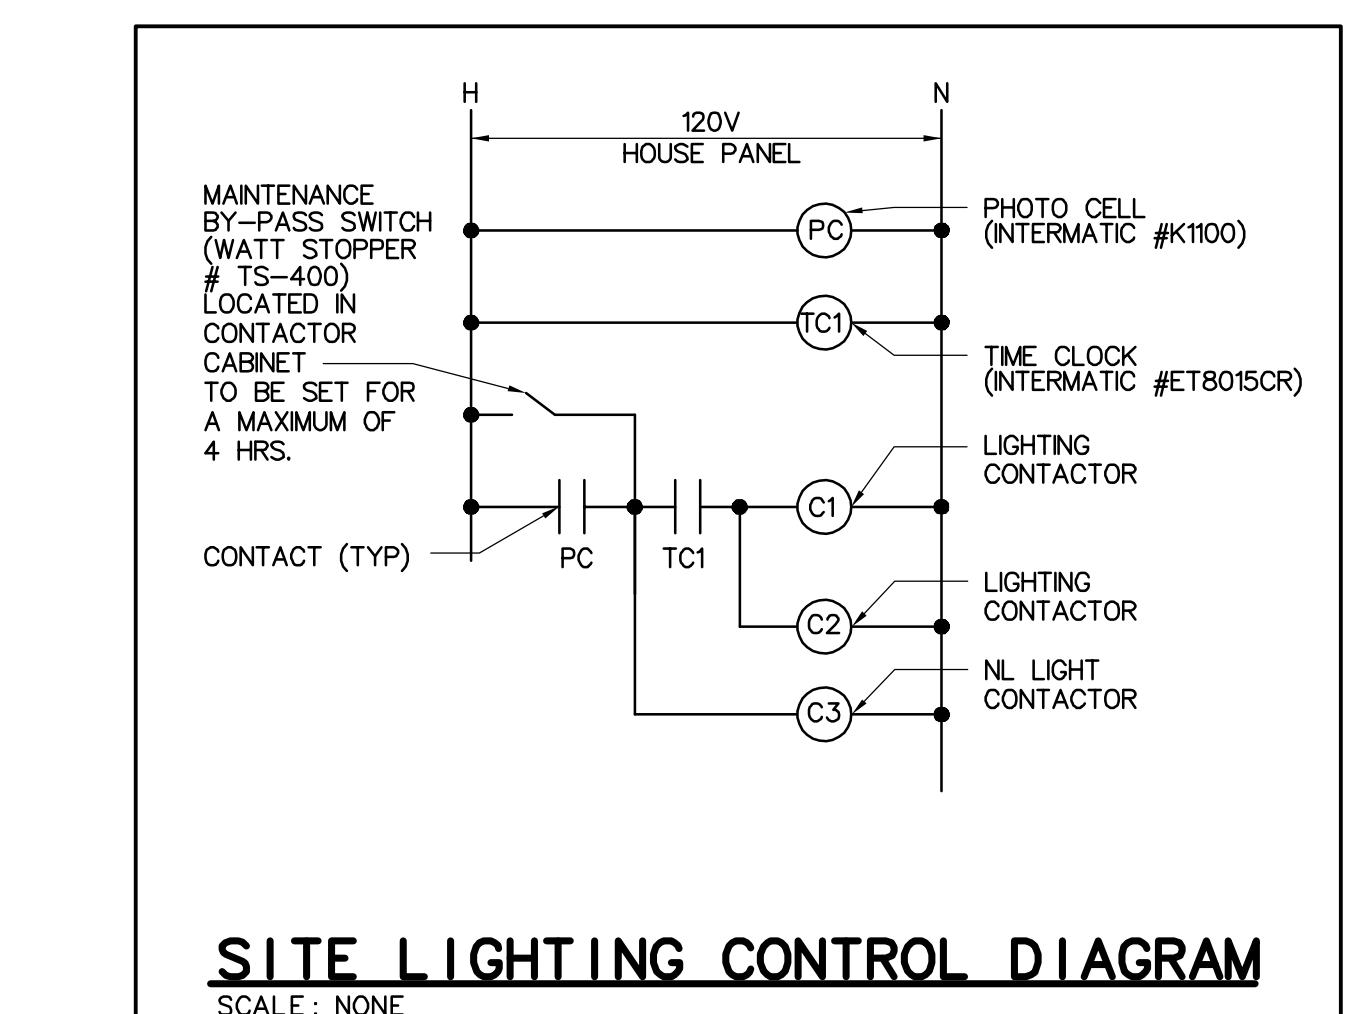

### SITE LIGHTING CONTROL DIAGRAM

SCALE: NONE

#### REVISIONS:

