

ORDINANCE NO. 2024-034

AN ORDINANCE OF THE CITY COUNCIL OF THE CITY OF WOLFFORTH, TEXAS, AMENDING CHAPTER 3, ARTICLE I – PLUMBING REGULATIONS OF THE CODE OF ORDINANCES BY ADOPTING THE 2021 EDITION OF THE INTERNATIONAL PLUMBING CODE, PROVIDING A SEVERABILITY CLAUSE; PROVIDING FOR THE REPEAL OF ORDINANCES IN CONFLICT HEREWITH; PROVIDING FOR PUBLICATION; AND PROVIDING FOR AN EFFECTIVE DATE.

BE IT ORDAINED BY THE CITY COUNCIL OF THE CITY OF WOLFFORTH, TEXAS, THAT:

Part 1. Enacted

THAT, Chapter 3, Article I PLUMBING REGULATIONS of the Code of Ordinances is hereby amended by amending Sec. 3.01.001, which shall read as follows:

Sec. 3.01.001 Adoption of Code

The International Plumbing Code, 2021 edition, as published by the International Code Council, is hereby adopted by reference as the city plumbing code as if fully set out in this article with the additions, deletions, insertions and changes as follows.

Amendments-

(a) Protection against physical damage. Section 305.6 is hereby amended to read as follows:

305.6 Protection against physical damage. In concealed locations where piping, other than cast iron or galvanized steel, is installed through holes or notches in studs, joints, rafters or similar members less than 1.5 inches (38 mm) from the nearest edge of the member, the pipe shall be protected by steel shield plates. Such shield plates shall have a thickness of not less than 0.0575 inch (1.463 mm) (No. 16 gage). Such plates shall cover the area of the pipe where the member is notched or bored.

(b) Over-excavation. Section 306.2.1 is hereby amended to read as follows:

306.2.1 Over-excavation. Where trenches are excavated below the installation level of the pipe such that the bottom of the trench does not form the bed for the pipe, the trench shall be backfilled to the installation level of the bottom of the pipe placed in layers of 6 inches (152 mm) maximum depth and such backfill shall be compacted after each placement. The backfill material may consist of sand or fine gravel, or excavated material that complies with Section 306.3.

(c) Drainage and vent water test. Section 312.2 is hereby amended to read as follows:

312.2 Drainage and vent water test. A water test shall be applied to the drainage system either in its entirety or in sections. If applied to the entire system, all openings in the piping shall be tightly closed, except the highest opening, and the system shall be filled with water to the point of overflow. If the system is tested in sections, each opening shall be tightly plugged except the

(unapproved draft)

highest openings of the section under test, and each section shall be filled with water, but no section shall be tested with less than a 5-foot (1524 mm) head of water above floor height. In testing successive sections, at least the upper 10 feet (3048 mm) of the next preceding section shall be tested so that no joint or pipe in the building, except the uppermost 10 feet (3048 mm) of the system, shall have been submitted to a test of less than a 5-foot head of water above floor height. The water shall be kept in the system, or in the portion under test, for at least 15 minutes before inspection starts. The system shall then be tight at all points.

(d) Gravity sewer test. Section 312.6 is hereby amended to read as follows:

312.6 Gravity sewer test. Gravity sewer tests shall consist of plugging the end of the *building sewer* at the point of connection with the public *sewer*, filling the *building sewer* with water, testing with not less than a 5-foot (1524 mm) head of water and maintaining such pressure for 15 minutes.

(e) Ductless mini-split system traps. Section 314.2.4.1 is hereby deleted in its entirety.

(f) Sheet lead. Section 402.4 is hereby amended to read as follows:

402.4 Sheet lead. Sheet lead for pans shall not weigh less than two and one-half (2-1/2) pounds per square foot (12.2 kg/m²) and shall be coated with an asphalt paint or other *approved* coating.

(g) Sheet lead. Section 421.5.2.3 is hereby amended to read as follows:

421.5.2.3 Sheet lead. Sheet lead shall weigh not less than two and one-half (2- 1 /2) pounds per square foot (12.2 kg/m²) and shall be coated with an asphalt paint or other *approved* coating. The lead sheet shall be insulated from conducting substances other than the connecting drain by 15-pound (6.80 kg) asphalt felt or an equivalent. Sheet lead shall be joined by burning.

(h) Water hammer. Section 604.9 is hereby amended to read as follows:

604.9 Water hammer. The flow velocity of the water distribution system shall be controlled to reduce the possibility of water hammer. An air chamber or a water- hammer arrestor shall be installed where quick-closing valves are utilized, unless otherwise approved. Water-hammer arrestors shall be installed in accordance with the manufacturer's instructions. Water-hammer arrestors shall conform to ASSE 1010.

(i) Solvent cementing. Section 605.2 1.3 is hereby amended to read as follows:

605.21.3 Solvent cementing. Joint surfaces shall be clean and free from moisture. A purple primer that conforms to ASTM F656 shall be applied. Clear primer in lieu of purple is acceptable where joints are accessible. Solvent cement not purple in color and conforming to ASTM D2564 or CSA CAN/CSA-B 137.3 shall be applied to all joint surfaces. The joint shall be made while the cement is wet and shall be in accordance with ASTM D2855. Solvent-cement joints shall be permitted above or below ground.

(j) Location of full-open valves. Section 606.1 is hereby amended to read as follows:

606.1 Location of full-open valves. Full-open valves shall be installed in the following locations:

1. On the building water service pipe from the public water supply.
2. On the water distribution supply pipe at the entrance into the structure if the water meter is more than 100 feet from the building.
3. On the water supply pipe to a gravity or pressurized water tank.

(unapproved draft)

4. On the water supply pipe to every water heater.

(k) Location of shutoff valves. Section 606.2 is hereby amended to read as follows:

606.2 Location of shutoff valves. Shutoff valves shall be installed in the following locations:

1. On the fixture supply to each plumbing fixture in other than bathtubs and showers in one- and two-family and multiple-family residential occupancies, and other than in individual sleeping units that are provided with unit shutoff valves in hotels, motels, boarding houses and similar occupancies.

2. On the water supply pipe to each appliance or mechanical equipment.

(l) Slope of horizontal drainage pipe. Table 704.1 is hereby amended to read as follows:

TABLE 704.1
SLOPE OF HORIZONTAL DRAINAGE PIPE

Size (inches)	Minimum slope (inch per foot)
2-1/2 or less	1/4 ^a
3 to 5	1/8 ^a
6 or larger	1/16 ^a

a. Slopes for piping draining to a grease interceptor shall comply with Section 704.1.

(m) Solvent cementing. Section 705.10.2 is hereby amended to read as follows:

705.10.2 Solvent cementing. Joint surfaces shall be clean and free from moisture. A purple primer that conforms to ASTM F656 shall be applied. Clear primer in lieu of purple primer is acceptable where joints are accessible. Solvent cement not purple in color and conforming to ASTM D2564 CSA CAN/CSA- 8137.3, CSA CAN/CSA-8181.2 or CSA CAN/CSA-BV182.1 shall be applied to all joint surfaces. The joint shall be made while the cement is wet and shall be in accordance with ASTM D2855. Solvent-cement joints shall be permitted above or below ground.

Exception: A primer is not required where both of the following conditions apply:

1. The solvent cement used is third-party certified as conforming to ASTM D2564.
2. The solvent cement is used only for joining PVC drain, waste and vent pipe and fittings in non-pressure applications in sizes up to and including 4 inches (102 mm) in diameter.

(n) Installation of fittings. Section 706.3 is hereby amended to read as follows:

706.3 Installation of fitting. Fittings shall be installed to guide sewage and waste in the direction of flow. Change in direction shall be made by fittings installed in accordance with Table 706.3. Change in direction by combination fittings, side inlets or increasers shall be installed in accordance with Table 706.3 based on the pattern of flow created by the fitting. Double sanitary tee patterns shall not receive the discharge of back-to-back water closets and fixtures or appliances with pumping action discharge.

(o) Building drains and sewers. Table 710.1(1) is hereby amended to read as follows:

(unapproved draft)

Table 710.1(1)				
BUILDING DRAINS AND SEWERS				
DIAMETER OF PIPE (inches)	MAXIMUM NUMBER OF DRAINAGE FIXTURE UNITS CONNECTED TO ANY PORTION OF THE BUILDING DRAIN OR THE BUILDING SEWER, INCLUDING BRANCHES OF THE BUILDING DRAIN⁹			
	Slope per foot			
	1/16 inch	1/8 inch	1/4 inch	1/2 inch
1-1/4	-	-	1	1
1-1/2	-	-	3	3
2	-	-	21	26
2-1/2	-	-	24	31
3	-	36	42	50
4	-	180	216	250
5	-	390	480	575
6	620	700	840	1000
8	1400	1600	1920	2300
10	2500	2900	3500	4200



Table 710.1(1)				
BUILDING DRAINS AND SEWERS				
DIAMETER OF PIPE (inches)	MAXIMUM NUMBER OF DRAINAGE FIXTURE UNITS CONNECTED TO ANY PORTION OF THE BUILDING DRAIN OR THE BUILDING SEWER, INCLUDING BRANCHES OF THE BUILDING DRAIN ¹			
	Slope per foot			
	1/16 inch	1/8 inch	1/4 inch	1/2 inch
12	3900	4600	5600	6700
15	7000	8300	10,000	12,000

a. The minimum size of any building drain serving a water closet shall be 3 inches.

(p) Roof extension unprotected. Section 903.1.1 is hereby amended to read as follows:

903.1.1 Roof extension unprotected. Open vent pipes that extend through a roof shall be terminated not less than 10 inches (254 mm) above the roof.

(q) Storm drainage-general (tests). Section 1101.4 is hereby amended to read as follows:

1101.4 Tests. The building storm drain shall be tested in accordance with Section 312 and within the building only and shall not require 5-foot head, but roof drain level only.

(r) Roof design. Section 1101.7 is hereby amended to read as follows:

1101.7 Roof design. Roofs shall be designed for the maximum possible depth of water that will pond thereon as determined by the relative levels of roof deck and overflow weirs, scuppers, edges or serviceable drains in combination with the deflected structural elements in accordance with Section 1611 of the International Building Code. In determining the maximum possible depth of water, all primary roof drainage means shall be assumed to be blocked. The maximum possible depth of water on the roof shall include the height or the water required above the inlet of the secondary roof drainage means to achieve the required flow rate of the secondary drainage means to accommodate the design rainfall as required by Section 1106.

(w) Strainers. A new Section 1105.3 is hereby added to read as follows:

1105.3 Strainers. Roof drains shall have strainers extending not less than 4 inches (102 mm) above the surface of the roof immediately adjacent to the roof drain. Strainers shall have an available inlet area, above roof level, of not less than one and one-half times the area of the conductor or leader to which the drain is connected.

(x) Flat decks. A new Section 1105.4 is hereby added to read as follows:

1105.4 Flat decks. Roof drain strainers for use on sun decks, parking decks and similar areas that are normally serviced and maintained shall comply with Section 1105.3 or shall be of the flat-

(unapproved draft)

surface type, installed level with the deck, with an available inlet area not less than two times the area of the conductor or leader to which the drain is connected.

(y) Size of conductors, leaders and storm drains. Section 1106 is hereby deleted and replaced with the following:

SECTION 1106

SIZE OF CONDUCTORS, LEADERS AND STORM DRAINS

1106.1 General. The size of the vertical conductors and leaders, building *storm drains*, building *storm sewers*, and any horizontal branches of such drains or *sewers* in Wolfforth, Texas, shall be based on a minimum 100-year hourly rainfall rate of 3.3 inches (84 mm) per hour.

1106.2 Vertical conductors and leaders. Vertical conductors and leaders shall be sized for the maximum projected roof area, in accordance with Table L1106.2(1) and Table L1106.2(2).

TABLE L1106.2(1)

SIZE OF CIRCULAR VERTICAL CONDUCTORS AND LEADERS

Horizontally Projected Roof Area (square feet)

Diameter of leader (inches) ^a	Rainfall Rate (inches per hour)		
	3	3.3	4
2	960	888	720
3	2,930	2,711	2,200
4	6,130	5,671	4,600
5	11,530	10,666	8,650
6	17,995	16,647	13,500
8	38,660	35,762	29,000

a. Sizes indicated are the diameter of circular piping. This table is applicable to piping of other shapes, provided the cross-sectional shape fully encloses a circle of the diameter indicated in this table. For rectangular leaders, see Table L1106.2(2). Interpolation is permitted for pipe sizes that fall between those listed in this table.

b. The Rate of Rainfall for Wolfforth, Texas, is 3.3 inches per hour, as shown in Appendix B of the 2021 International Plumbing Code.

TABLE L1106.2(2)

SIZE OF RECTANGULAR VERTICAL CONDUCTORS AND LEADERS

Dimensions Of Common

Horizontally Projected Roof Area (square feet)

Leader Sizes width x

Rainfall Rate (inches per hour)

(unapproved draft)

length

(inches)^{a,b}	3	3.3	4
1-3/4 x 2-1/2	1,130	1,046	850
2 x 3	1,840	1,702	1,380

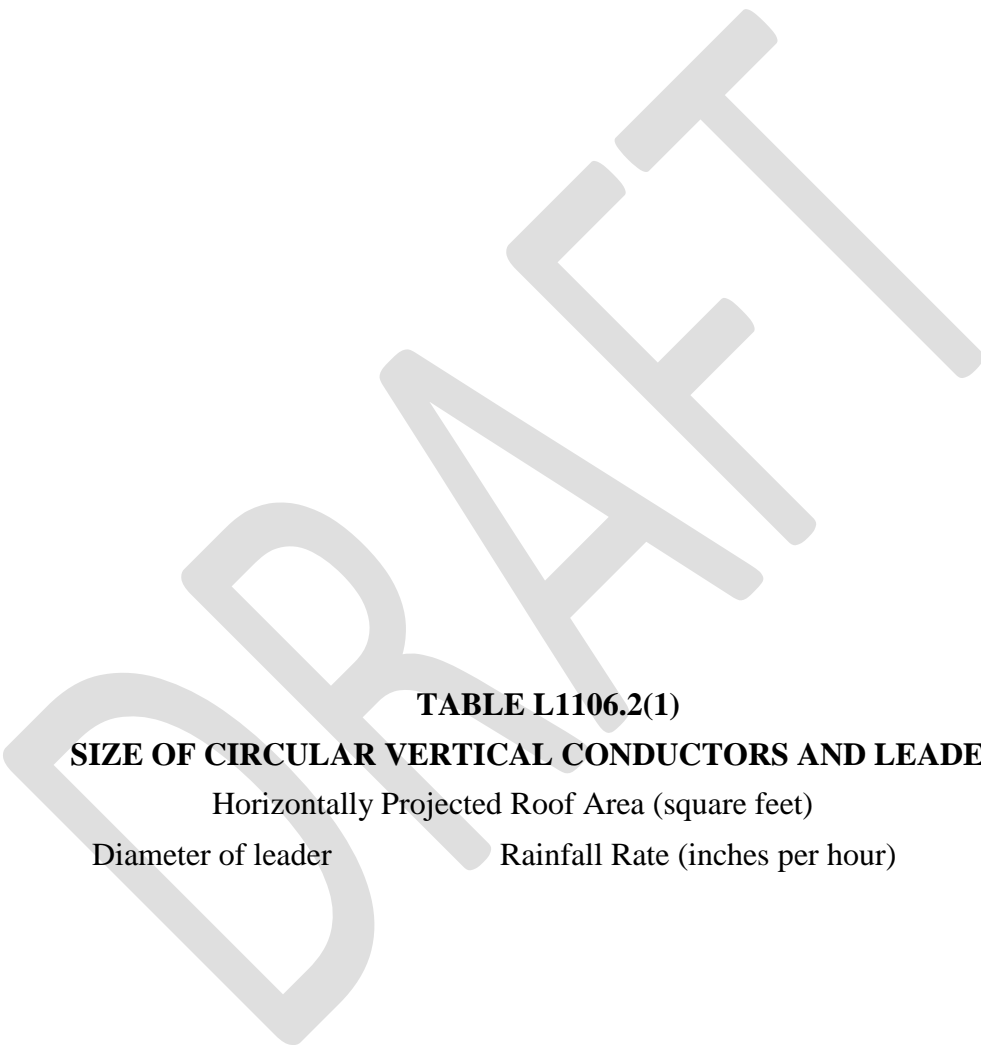


TABLE L1106.2(1)
SIZE OF CIRCULAR VERTICAL CONDUCTORS AND LEADERS
Horizontally Projected Roof Area (square feet)
Diameter of leader Rainfall Rate (inches per hour)

(unapproved draft)

(inches) ³	3	3.3	4
2-3/4 X 4-1/4	4,270	3,949	3,200
3x4	4,400	4,070	3,300
3-1/2 X 4	5,300	4,901	3,970
3-1/2 X 5	7,100	6,566	5,320
3-1/4 X 4-3/4	7,320	6,771	5,490
3-3/4 X 5-1/4	8,500	7,864	6,380
3-1/2 X 6	9,260	8,564	6,940
4x6	10,990	10,165	8,240
5-1/2 X 5-1/2	14,760	13,653	11,070
7-1/2 X 7-1/2	33,500	30,986	25,120

- a. Sizes indicated are nominal width x length of the opening for rectangular piping.
- b. For shapes not included in this table, Equation 11-1 shall be used to determine the equivalent circular diameter, D_e , of rectangular piping for use in interpolation using the data from Table L1106.2(1).

$$D_e = (\text{width} \times \text{length})^{1/2} \quad (\text{Equation 11-1})$$

where:

D_e = equivalent circular diameter; D_e , width, and length are in inches.

- c. The Rate of Rainfall for Wolfforth, Texas, is 3.3 inches per hour, as shown.

TABLE L1106.2(1)
SIZE OF CIRCULAR VERTICAL CONDUCTORS AND LEADERS

Horizontally Projected Roof Area (square feet)

Diameter of leader (inches) ^a	3	3.3	4
---	---	-----	---

- a. in Appendix B of the 2021 International Plumbing Code.

(unapproved draft)

1106.3 Building storm drains and sewers. The size of the building storm drain, building storm sewer and their horizontal branches having a slope of one-half unit or less vertical in 12 units horizontal (4-percent slope) shall be based on the maximum projected roof area in accordance with Table L1106.3. The slope of horizontal branches shall be not less than one-eighth unit vertical in 12 units horizontal (I-percent slope) unless otherwise approved.

TABLE L1106.3
SIZE OF HORIZONTAL STORM DRAINAGE PIPING

Size of Horizontal Piping Inches	Horizontally Projected Roof Area (square feet)		
	Rainfall Rate (inches per hour)		
	3	3.3	4
*1/8 unit vertical in 12 units horizontal (1 percent slope)			
3	1,096	1,014	822
4	2,506	2,294	1,800
5	4,453	4,119	3,340
6	7,133	6,598	5,350
8	15,330	14,181	11,500
10	27,600	25,530	20,700
12	44,400	41,070	33,300

TABLE L1106.3
SIZE OF HORIZONTAL STORM DRAINAGE PIPING

Horizontally Projected Roof Area (square feet)
Size of Horizontal Piping Rainfall Rate (inches per hour)

(unapproved draft)

(inches)	3	3.3	4
15	72,800	68,810	59,500
1/4 unit vertical in 12 units horizontal (2 percent slope)			
3	1,546	1,430	1,160
4	3,533	3,268	2,650
5	6,293	5,821	4,720
6	10,066	9,311	7,550
8	21,733	20,103	16,300
10	38,950	36,025	29,200
12	62,600	57,920	47,000
15	112,000	103,600	84,000
1/2 unit vertical in 12 units horizontal (4 percent slope)			
3	2,295	2,100	1,644
4	5,010	4,635	3,760
5	8,900	8,234	6,680
6	13,700	12,800	10,700
8	30,650	28,355	23,000
10	55,200	51,060	41,400

TABLE L1106.3
SIZE OF HORIZONTAL STORM DRAINAGE PIPING

Horizontally Projected Roof Area (square feet)

Size of Horizontal Piping

Rainfall Rate (inches per hour)

(unapproved draft)

(inches)	3	3.3	4
12	88,800	82,140	66,600
15	158,800	146,860	119,000

The rate of rainfall for Lubbock, Texas, is 3.3 inches per hour, as shown in appendix B of the 2021 International Plumbing Code.

1106.4 Vertical walls. In sizing roof drains and storm drainage piping, one-half of the area of any vertical wall that diverts rainwater to the roof shall be added to the projected roof area for inclusion in calculating the required size of vertical conductors, leaders and horizontal storm drainage piping.

1106.5 Parapet wall scupper location. Parapet wall roof drainage scupper and overflow scupper location shall comply with the requirements of Section 1502 of the International Building Code.

1106.6 Size of roof gutters. The size of semicircular gutters shall be based on the maximum projected roof area in accordance with Table L1106.6.

TABLE L1106.6

SIZE OF SEMICIRCULAR ROOF GUTTERS

Horizontally Projected Roof Area (square feet)

Size of Horizontal Piping	Rainfall Rate (inches per hour)		
Inches	3	3.3	4

*1/16 unit vertical in 12 units horizontal (0.5 percent slope)

3	226	209	170
4	480	444	360

TABLE L1106.6

SIZE OF SEMICIRCULAR ROOF GUTTERS

Horizontally Projected Roof Area (square feet)

Diameter of Gutters	Rainfall Rate (inches per hour)		
---------------------	---------------------------------	--	--

(unapproved draft)

(inches)	3	3.3	4
5	834	771	625
6	1,280	1,184	960
7	1,840	1,702	1,380
8	2,655	2,456	1,990
10	4,800	4,440	3,600
<u>1/8 unit vertical in 12 units horizontal (1 percent slope)</u>			
3	320	296	240
4	681	630	510
5	1,172	1,084	880
6	1,815	1,679	1,360
7	2,600	2,405	1,950
8	3,740	3,458	2,800
10	6,800	6,290	5,100
<u>1/4 unit vertical in 12 units horizontal (2 percent slope)</u>			
3	454	420	340
4	960	888	720
5	1,668	1,543	1,250

TABLE L1106.6

SIZE OF SEMICIRCULAR ROOF GUTTERS

Horizontally Projected Roof Area (square feet)

Diameter of Gutters

Rainfall Rate (inches per hour)

(unapproved draft)

(inches)	3	3.3	4
6	2,560	2,368	1,920
7	3,860	3,530	2,760
8	5,310	4,911	3,980
10	9,600	8,880	7,200
<u>1/2 unit vertical in 12 units horizontal (4 percent slope)</u>			
3	640	592	480
4	1,360	1,258	1,020
5	2,360	2,183	1,770
6	3,695	3,418	2,770
7	5,200	4,810	3,900
8	7,460	6,902	5,600
10	13,330	12,331	10,000

The rate of rainfall for Wolfforth, Texas, is 3.3 inches per hour, as shown in appendix B of the 2021 International Plumbing Code.

(z) Secondary (Emergency) Roof Drains. Section 1108 is hereby deleted and replaced with the following:

SECTION 1108

SECONDARY (EMERGENCY) ROOF DRAINS

1108.1 Secondary (emergency overflow) drains or scuppers. Where roof drains are required, secondary (emergency overflow) roof drains or scuppers shall be provided where the roof perimeter construction extends above the roof in such a manner that water will be entrapped if the primary drains allow buildup for any reason.

1108.2 Separate systems required. Secondary roof drain systems shall have the end point of discharge separate from the primary system. Discharge shall be above grade, in a location that would normally be observed by the building occupants or maintenance personnel.

1108.3 Sizing of secondary drains. Secondary (emergency) roof drain systems shall be sized in accordance with Section 1106 based on the rainfall rate for which the primary system is sized in Tables L1106.2(1), L1106.2(2), L1106.3 and LI 106.6. Scuppers shall be sized to prevent the

(unapproved draft)

depth of ponding water from exceeding that for which the roof was designed as determined by Section 1101.7. Scuppers shall be sized in accordance with Tables L1108.3(1) and L1108.3(2) so that the rain load on the roof does not exceed 20 psf. Notify the structural engineer when the roof and wall areas contributing to the scuppers exceed the values shown in Table L1108.3(2) so that the structure can be designed for increased rain load. Scuppers shall have an opening dimension of not less than 4 inches (102 mm). The flow through the primary system shall not be considered when sizing the secondary roof drain system.

TABLE L1108.3(1)

SIZE OF SCUPPERS

		Length of Scupper, L (inches)									
		5"	6"	8"	10"	12"	18"	24"	30"	36"	
Head, H (inches)	4"										
	1"	11.4	14.4	17.4	23.4	29.4	35.4	53.3	71.3	89.3	107.3
	1.846"	27.3	34.8	42.3	57.3	72.4	87.4	132.5	177.6	222.7	267.7



TABLE L1108.3(1)

SIZE OF SCUPPERS

		Length of Scupper, L (inches)									
		5"	6"	8"	10"	12"	18"	24"	30"	36"	
Head, H (inches)	4"										
	2"	30.5	39.0	47.5	64.4	81.4	98.3	149.1	200.0	250.8	301.7

(unapproved draft)

Note: The Table is based on the Francis weir formula:

$$Q = 3.33 \times (L - 0.2 \times H) \times H^{1.5}$$

Where:

Q = Flow Rate (cubic feet per second)

L = Length of Scupper Opening (feet)

H = Head on Scupper (feet, measured 6 feet back from opening)

TABLE L1108.3(2)

MAXIMUM CONTRIBUTING AREAS FOR PARAPET WALL SCUPPERS

For This Table: $d_s = 2"$, $I = 3.3 \text{ in./hr.}$, and Rain Load, $R = 20 \text{ psf}$

Width of Scupper, L Maximum Contributing Roof and Wall Areas, A

(inches)

(square feet)

4"

796



(unapproved draft)

TABLE LI108.3(1)
SIZE OF SCUPPERS

Length of Scupper, L (inches)

5" 6" 8" 10" 12" 18" 24" 30" 36"

Head, H 4"

(inches)	CAPACITY OF SCUPPER, Q (gallons per minute)
5"	1015
6"	1234
7"	1453
8"	1673
10"	2111
12"	2549
16"	3426
24"	5179

A - Maximum allowable horizontally-projected roof areas plus one-half of the vertical wall areas contributing to the roof drainage area so that the maximum rain load on the roof, R, does not exceed 20 psf.

ds = Depth of rainwater from the primary roof drain up to the bottom of the scupper inlet (also referred to as static head), inches. For this Table: ds = 2".

11 = Maximum depth of additional rainwater above the bottom of the scupper inlet (also referred to as hydraulic head), inches. For this Table: 11 = 1.846" maximum.

(11 = 20 psf/5.2 psf/in. of thickness - ds = 3.846" - 2" = 1.846")

i = The rate of rainfall for Wolfforth, Texas is 3.3 inches per hour, as shown in Appendix B of the 2021 IPC. The rate of rainfall is based on a storm of one hour duration and a 100-year return period.

(unapproved draft)

TABLE L1108.3(1)
SIZE OF SCUPPERS

		Length of Scupper, L (inches)								
		5"	6"	8"	10"	12"	18"	24"	30"	36"
Head, H	4"									
(inches)		CAPACITY OF SCUPPER, Q (gallons per minute)								

$$Q = 3.33 \times (L - 0.2 \times H) \times H^{1.5} \quad A = Q/i$$

Q = Flow rate through the scupper, gallons per minute (gpm)

Note: the minimum scupper height shall be 4". Scupper heights greater than 4" do not change the values in the table.

(aa) Combined Sanitary and Storm Public Sewer. Section 1109 is hereby deleted in its entirety.

(bb) Medical gas certification. Section 1202 is hereby amended by adding a new Section 1202.2, as follows:

1202.2 Certification required. A medical gas certification must be furnished to the building inspection department before a final inspection will be approved.

Part 2. Open Meetings Act

This meeting was open to the public as required by law and that public notice of the time, place, and purpose of said meeting was given as required.

Part 3. Severability Clause

If any section, sub-section, clause, phrase, or portion of this ordinance shall be held unconstitutional or invalid by a court of competent jurisdiction, such section, sub-section, sentence, clause, phrase, or portion shall be deemed to be a separate, distinct and independent provision and such invalidity shall not affect the validity of the remaining portions.

Part 4. Repeal

All ordinances or parts of ordinances and sections of any of the City Code of Ordinances in conflict with this Ordinance are hereby repealed.

Part 5. Effect on Pending Proceedings

(unapproved draft)

That nothing in this legislation or in the Plumbing Code hereby adopted shall be construed to affect any suit or proceeding pending in any court, or any rights acquired, or liability incurred, or any cause or causes of action acquired or existing, under any act or ordinance hereby repealed as cited in Part 4 of this Ordinance; nor shall any just or legal right or remedy of any character be lost, impaired or affected by this legislation.

Part 6. Publication

The City Secretary is authorized and directed to publish the caption and penalty prescribed by this ordinance in accordance with State Law.

Part 7. Enforcement

Any person, firm or individual who shall violate any of the provisions of this Ordinance shall be guilty of a misdemeanor, and upon conviction shall be fined not less than one dollar (\$1.00) or more than two thousand dollars (\$2,000.00) in accordance with Code of Ordinance Sec. 1.01.009. Each day the violation continues shall constitute a separate and distinct offense.

Part 8. Effective Date

This Ordinance shall be in force and effect from and after October 1, 2024.

CITY OF WOLFFORTH

CHARLES ADDINGTON II, MAYOR

ATTEST:

Terri Robinette, City Secretary